

2010 Florida Building Code Wind Standard

Building Codes and Standards Mo Madani, CBO, Technical Unit Manager Joe Bigelow, Presentation Designer, Florida Building Code Staff










Building Codes and Standards

Contents

- Part 1 The Florida Building Code
- Part 2 Wind Speeds
- Part 3 Impact

Part 1 The Florida Building Code 3



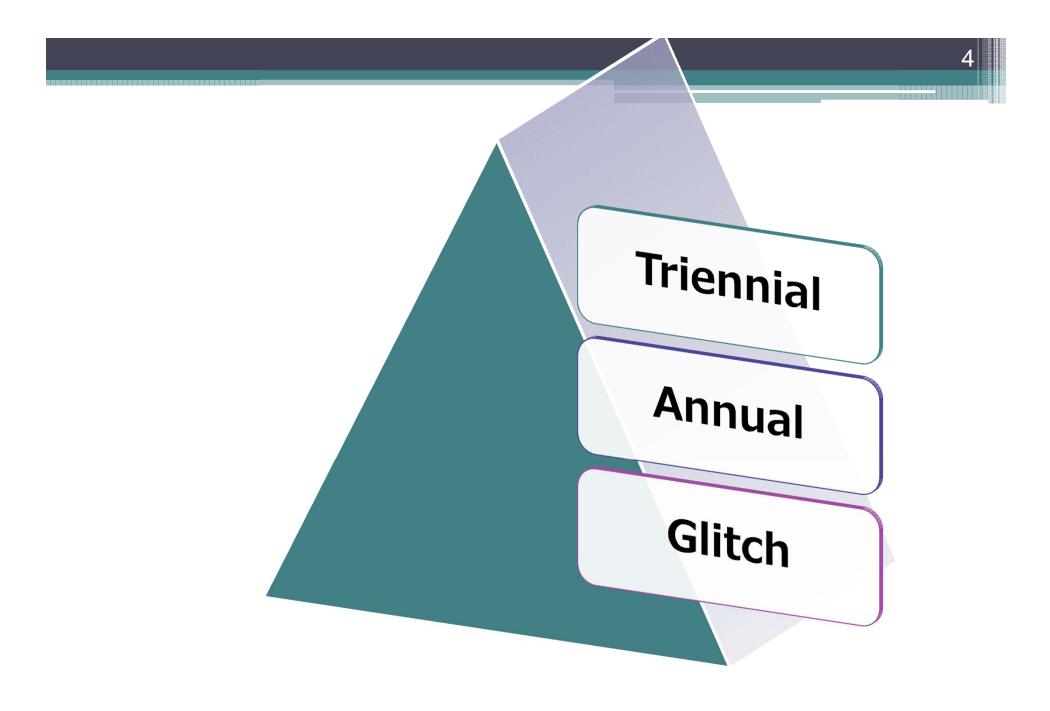


How to use the next chart

	2001 FBC	2004 FBC
Effective Date	March 1, 2002	October 1, 2005
BuildingVolume - Based on	1997 Southern Building Code	2003 IBC
Plumbing Volume -	1997 IPC	2003 IPC
Mechanical Volume - Based on		2003 IMC

The 2004 Florida Building Code Mechanical Volume is based on the 2003 IMC (International Mechanical Code)

Florida Building Code Editions


	2001 FBC	2004 FBC	2007 FBC	2010 FBC
Effective Date	March 1, 2002	October 1, 2005	March 1, 2009	March 15, 2012
Building Volume – Based on	1997 Southern Building Code	2003 IBC	2006 IBC	2009 IBC
Plumbing Volume – Based on	1997 IPC	2003 IPC	2006 IPC	2009 IPC
Mechanical Volume – Based on	1998 IMC	2003 IMC	2006 IMC	2009 IMC
Fuel/Gas Volume – Based on	1998 IFGC	2003 IFGC	2006 IFGC	2009 IFGC
Electrical Volume – Based on	2002 NEC	2005 NEC	2005 NEC	2005 NEC
Fire Volume – Based on	2001 FFPC	2004 FFPC	2007 FFPC	2010 FFPC
Existing Building Volume – Based on		2003 IEBC	2006 IEBC	2009 IEBC
Residential Volume – Based on		2003 IRC	2006 IRC	2009 IRC
Energy Conservation Volume – Based on				2009 IECC
Accessibility Volume – Based on				2010 ADA

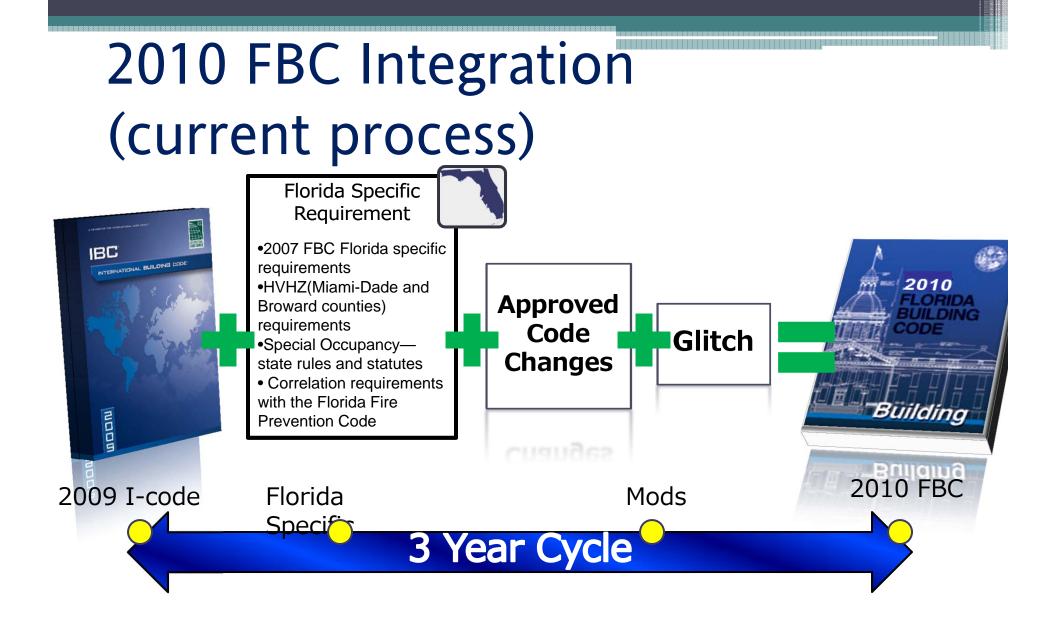

Code development Schedule

• 2009 I- Codes and FBC Supplement posted	
2/1/10	
 Proposed amendment due and closes 	4/2/10
 Proposed amendment posted for comments 	
4/15/10	
 45 day comment period ends 	5/31/10
 TAC review and make recommendations 	7/27-8/25
 TAC recommendations posted 	9/3/10
 45 day comment period ends 	10/18/10
 TAC review comments on recommendations 	11/15/10
 Commission considers TAC recommendation 	12/7-8/10
 Code amended to resolve glitches 	4/11-6/11
 Code printed 	10/1/11
Code implemented	3/15/12

Materials Available BCIS www.floridabuilding.org Proposed Code Module -

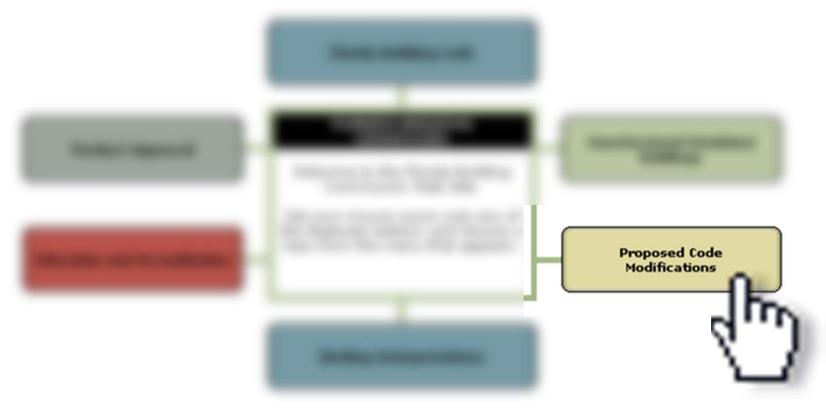

9

9

FBC 2010

- 1609.1.1 Determination of wind loads. Wind loads on every building or structure shall be determined in accordance with Chapters 26 through 30 of ASCE 7 or the provisions of the alternate all-heights method in Section 1609.6. Wind shall be assumed to come from any horizontal direction and wind pressures shall be assumed to act normal to the surface considered.
- Exceptions:
- 1. ICC 600 for Group R-2 and R-3 buildings.
- 2. AF&PA WFCM.
- 3. AISI S230.
- 4. Designs using NAAMM FP 1001.
- 5. Designs using TIA-222 for antenna-supporting structures and antennas.
- 6. Wind tunnel tests in accordance with Section 6.6 of ASCE
 - 7. subject to the limitations in Section 1609.1.1.2.

FBC 201 continued

 The wind speeds in Figure 1609A, 1609B and 1609C shall be converted to nominal wind speeds. V_{asd}, in accordance with Section 1609.3.1 when the provisions of the standards referenced in Exceptions 1 through 5 and 7 are used unless the wind provisions in the standards are based on Ultimate Wind Speeds as specified in accordance with Figures 1609A, 1609B, or 1609C or Chapter 26 of ASCE 7.

• [S4673]

Part 2 – Wind Speeds

ASCE 7-10



12

TABLE 1604.5 OCCUPANCY CATEGORY OF BUILDINGS AND OTHER STRUCTURES

OCCUPANCY CATEGORY	NATURE OF OCCUPANCY
Ι	 Buildings and other structures that represent a low hazard to human life in the event of failure, including but not limited to: Agricultural facilities. Certain temporary facilities. Minor storage facilities.
II	Buildings and other structures except those listed in Occupancy Categories I, III and IV
	 Buildings and other structures that represent a substantial hazard to human life in the event of failure, including but not limited to: Buildings and other structures whose primary occupancy is public assembly with an occupant load greater than 300. Buildings and other structures containing elementary school, secondary school or day care facilities with an occupant load greater than 250. Buildings and other structures containing adult education facilities, such as colleges and universities, with an occupant load greater than 500. Group I-2 occupancies with an occupant load of 50 or more resident patients but not having surgery or emergency treatment facilities. Group I-3 occupancies. Any other occupancy with an occupant load greater than 5,000^a. Power-generating stations, water treatment facilities for potable water, waste water treatment facilities and other public utility facilities not included in Occupancy Category IV. Buildings and other structures not included in Occupancy Category IV containing sufficient quantities of toxic or explosive substances to be dangerous to the public if released.
IV	 Buildings and other structures designated as essential facilities, including but not limited to: Group I-2 occupancies having surgery or emergency treatment facilities. Fire, rescue, ambulance and police stations and emergency vehicle garages. Designated earthquake, hurricane or other emergency shelters. Designated emergency preparedness, communications and operations centers and other facilities required for emergency response. Power-generating stations and other public utility facilities required as emergency backup facilities for Occupancy Category IV structures. Structures containing highly toxic materials as defined by Section 307 where the quantity of the material exceeds the maximum allowable quantities of Table 307.1(2). Aviation control towers, air traffic control centers and emergency aircraft hangars. Buildings and other structures having critical national defense functions. Water storage facilities and pump structures required to maintain water pressure for fire suppression.

	2010 Florida Building Code – Projected to go into effect 12/31/2011
OCCUPANCY	CATEGORY NATURE OF OCCUPANCY
	 Buildings and other structures that represent a low hazard to human life in the event of failure, including but not limited to: Agricultural facilities. Certain temporary facilities. Minor storage facilities.

	2010 Florida Building Code – Projected to go into effect 12/31/2011
OCCUPANCY	CATEGORY NATURE OF OCCUPANCY
	Buildings and other structures except those listed in Occupancy Categories I, III and IV

	2010 Florida Building Code – Projected to go into effect 12/31/2011
OCCUPANCY	CATEGORY NATURE OF OCCUPANCY
	 Buildings and other structures that represent a substantial hazard to human life in the event of failure, including but not limited to: Buildings and other structures whose primary occupancy is public assembly with an occupant load greater than 300.

	2010 Florida Building Code – Projected to go into effect 12/31/2011
OCCUPANCY	CATEGORY NATURE OF OCCUPANCY
	 Group I-2 occupancies with an occupant load of 50 or more resident patients but not having surgery or emergency treatment facilities. Group I-3 occupancies. Any other occupancy with an occupant load greater than 5,000a. Power-generating stations, water treatment facilities for potable water, waste water treatment facilities and other public utility facilities not included in Occupancy IV. Buildings and other structures not included in Occupancy


	2010 Florida Building Code – Projected to go into effect 12/31/2011
OCCUPANCY	CATEGORY NATURE OF OCCUPANCY
	 Buildings and other structures designated as essential facilities, including but not limited to: Group I-2 occupancies having surgery or emergency treatment facilities. Fire, rescue, ambulance and police stations and emergency vehicle garages. Designated earthquake, hurricane or other emergency shelters.

	2010 Florida Building Code – Projected to go into effect 12/31/2011
OCCUPANCY	CATEGORY NATURE OF OCCUPANCY
	 Structures containing highly toxic materials as defined by Section 307 where the quantity of the material exceeds the maximum allowable quantities of Table 307.1(2). Aviation control towers, air traffic control centers and emergency aircraft hangars. Buildings and other structures having critical national defense functions. Water storage facilities and pump structures required to maintain water pressure for fire suppression.

State of Florida

Category I Building and Structures In Miles Per Hour

Figure C

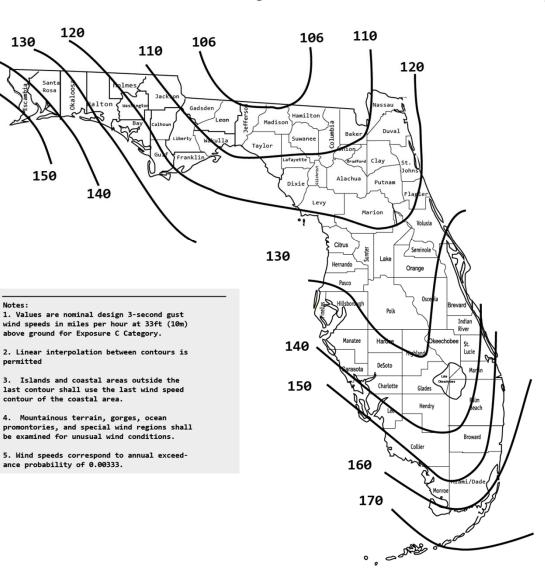

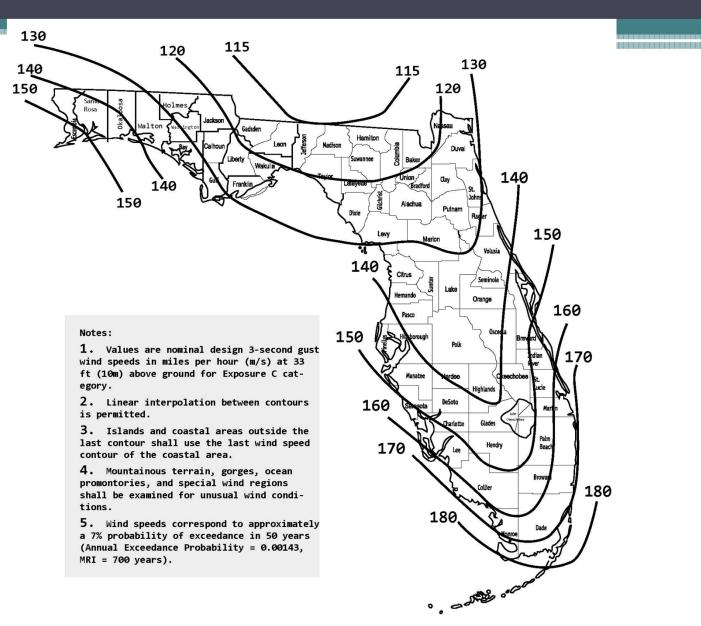
2010 FBC Figure C 

Figure 1609A Ultimate Design Wind Speeds, V_{ult} , for Risk Category II Buildings and Other Structures

FINAL FIGURE A

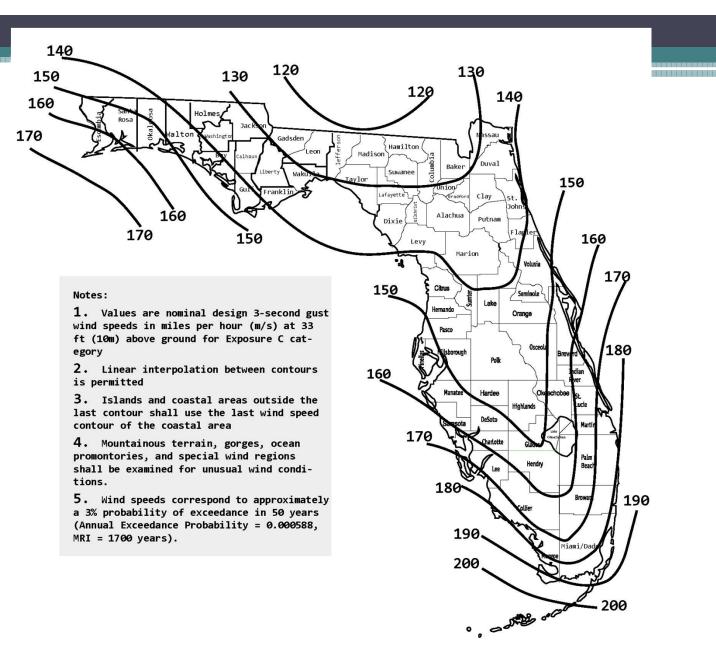


Figure 1609B Ultimate Design Wind Speeds, $V_{\rm ult}$, for Risk Category III and IV Buildings and other Structures

FINAL FIGURE B

TABLE C26.5-6Design Wind Speeds: ASCE 7-93 to ASCE 7-10

ASCE 7-05 Design Wind Speed (3-sec gust in mph)	ASCE 7-10 Design Wind Speed (3-sec gust in mph)	ASCE 7-93 Design Wind Speed (fastest mile in mph)
85	110*	71
90	115*	76
100	126	85
105	133	90
110	139	95
120	152	104
130	164	114
140	177	123
145	183	128
150	190	133
170	215	152

* Wind speed values of 110 mph and 115 mph were rounded from the "exact" conversions of $85\sqrt{1.6} = 108$ and $90\sqrt{1.6} = 114$ mph, respectively.

TABLE 1609.3.1 WIND SPEED CONVERSIONS^{abc}

 V_{asd} = nominal design wind speed V_{ult} = ultimate design wind speed determined from Figures 1609A, 1609B, or 1609C

The new maps, when used in combination with the 1.0 load factor on wind for strength design and the 0.6 factor on wind for allowable stress design, **result in a net decrease in design wind loads in Hurricane-Prone Regions.** Parts of southern Florida (due to the re-introduction of Exposure D for coastal areas) are approximately the same when compared to previous editions of the maps. In the remainder of the Hurricane-Prone Regions of Florida, the design wind pressures are on average approximately <u>20%</u> <u>less</u> than the loads determined from ASCE 7-05.

Nominal design wind speed "V_{asd}"- using Allowable Stress Design (ASCE 7 - 2005) - old maps

Ultimate design wind speed " V_{ult} " - using Strength Design (ASCE - 2010) - new maps

In order to convert the load "dp/design pressure" from ultimate to nominal you multiply by a factor of .6.

2007 FBC	i A	SCE 7-1 0 Cat. I	ASCE 7 – 10 Cat. B. II	ASCE 7 – 10 Cat. B III & IV	
Palm Bea 170 MPH	ch	130	150	160	
Wall –cc dp - psf		30.4/-33.0	40.5/-43.9	46.1/-50.0	51.1/-56
((X .6)	24.3/-26.34	27.66/-30.0	30.66/-33.6	

HVHZ

- 1620.2 Change to read as shown.
- 1620.2 Wind velocity (3-second gust) used in structural calculations shall be as follows:

165


- Miami-Dade County
 Risk Category I Buildings and Structures: mph
 Bisk Category II Buildings and Structures;
- Risk Category II Buildings and Structures: 175
 mph
- Risk Category III and IV Buildings and Structures: 186 mph
- Broward County
- Risk Category I Buildings and Structures: 156
 mph
- Risk Category II Buildings and Structures: 170
 mph
- Risk Category III and IV Buildings and Structures: 180 mph
- [S4799]

Part 3 - Impact



Wind-Borne Debris Region

- Areas within *hurricane- prone regions* located:
- Within 1 mile (1.61 km) of the coastal mean high water line where the ultimate design wind speed V_{ult} is 130 (48 m/s) or greater; or
- In areas where the ultimate design wind speed V_{ult} is
 140 mph (53 m/s) or greater;
- For Risk Category II buildings and structures and occupancy category III buildings and structures, except health care facilities, the windborne debris region shall be based on Figure 1609A. For occupancy category IV buildings and structures and occupancy category III health care facilities, the windborne debris region shall be based on Figure 1609B.

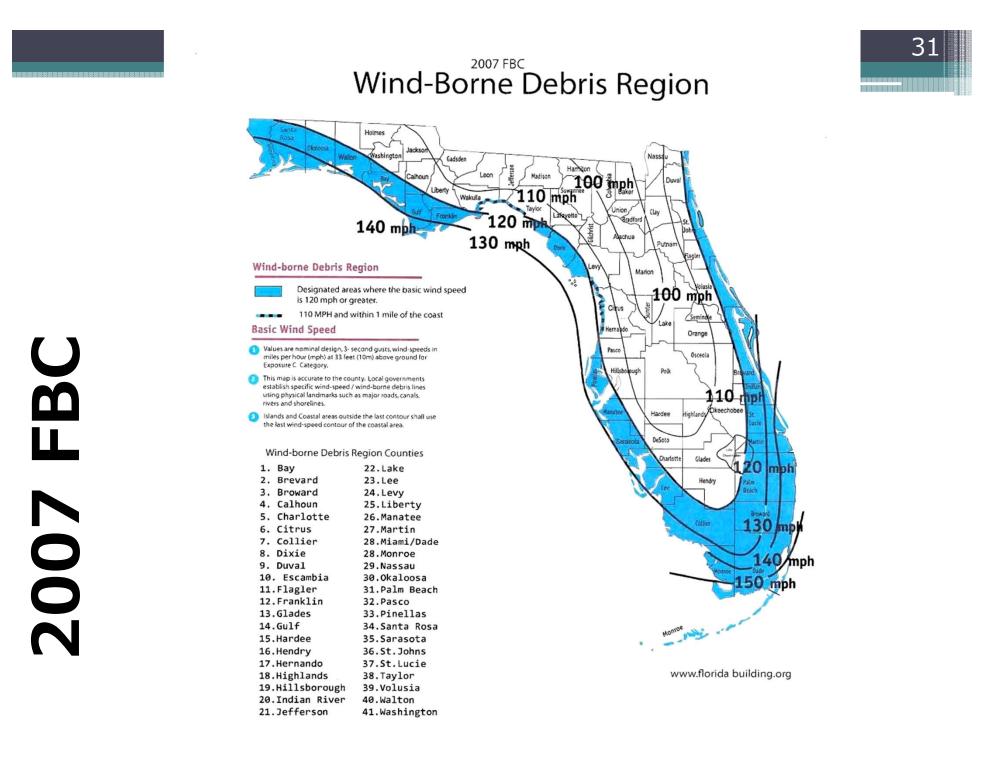

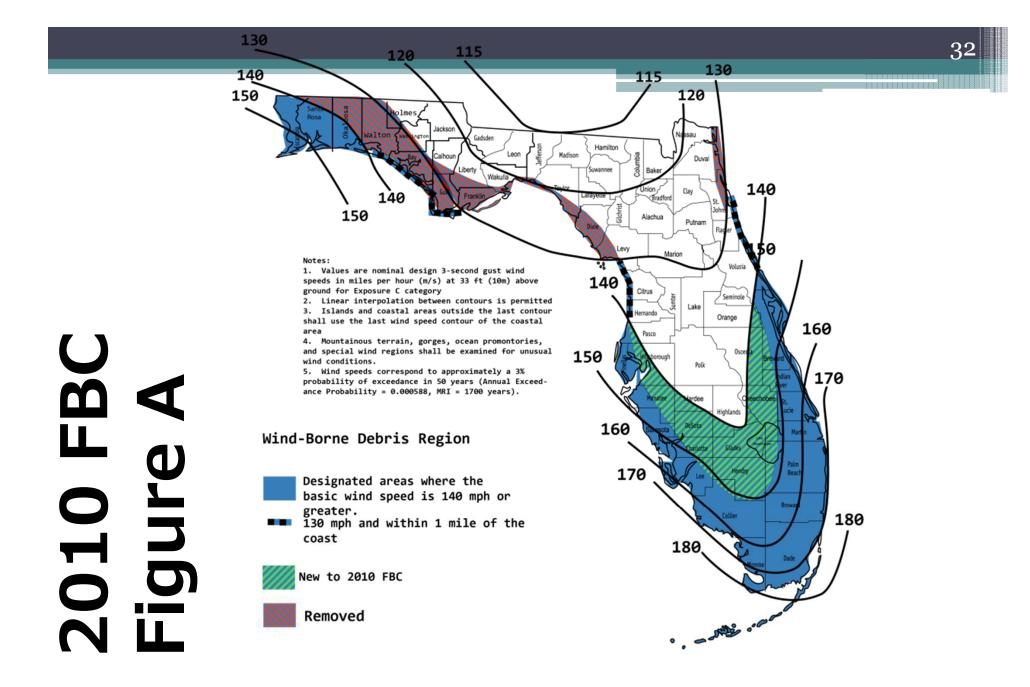


Figure 1609A Wind-Borne Debris Region, Category II and III Buildings and Structures except health care facilities in Miles Per Hour

33

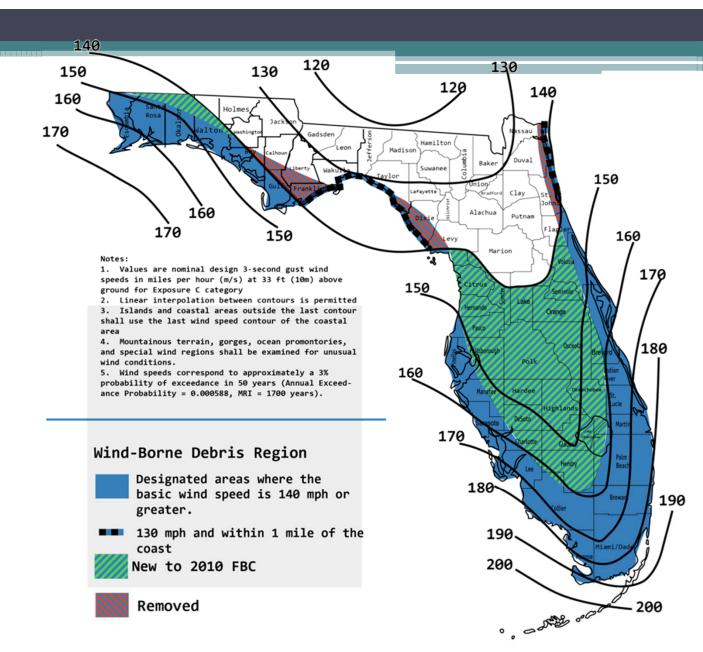


Figure 1609B Risk Category III and IV Buildings and other Structures and Category III healthcare facilities

2010 FBC Figure B

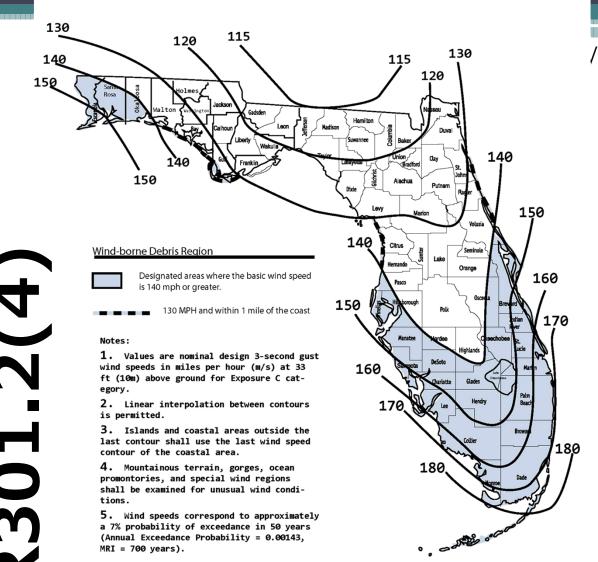


Figure R301.2(4) Ultimate Design Wind Speeds, Vult

FINAL FIGURE R301.2(4)

Background Information

- Wind speed lines have changed because of the improved science (i.e. computer simulations).
- The updated maps are based on a new and more complete analysis of hurricane characteristics performed over the past 10 years.
- The wind speed indicated for each wind speed line is different for the 2010 standard due to change in wind speed calculation philosophy.
- The wind borne debris was changed from opening protection required for currently for 120 mph and higher wind speeds under current code to opening protection required for 110 mph equivalent current code wind speed (140 mph 2010 wind speeds) and higher wind speeds for the 2010 standard.