



AAMA CERTIFICATION PROGRAM
An FGIA Product Certification Program



AUTHORIZATION FOR PRODUCT CERTIFICATION

MI Windows & Doors, LLC
P.O. Box 370
Gratz, PA 17030-0370

Attn: Rick Sawdey

This authorization is based on the successful completion of tests, and the reporting to the AAMA Validator of the results of the tests by an AAMA Accredited Laboratory. The product information below will be added to the next update of the AAMA Certified Products Directory.

SPECIFICATION	RECORD OF PRODUCT TESTED			
AAMA/WDMA/CSA 101/I.S.2/A440-11 LC-PG50*-1829x1346 (72x53)-HS Negative Design Pressure = -60 psf				
COMPANY AND CODE	CPD NO.	SERIES MODEL & PRODUCT DESCRIPTION	MAXIMUM SIZE TESTED	
MI Windows & Doors, LLC Code: MTL	15950	1630 HS (FIN) (PVC)(OX)(OG)(INS GL) (REINF)(ASTM)	<u>FRAME</u> 1829 mm x 1346 mm (6'0" x 4'5")	<u>SASH</u> 905 mm x 1270 mm (3'0" x 4'2")
Design Pressure (psf): +60/-60 (Pa): +2880/-2880		Water Test Pressure (psf): 7.52 (Pa): 360		

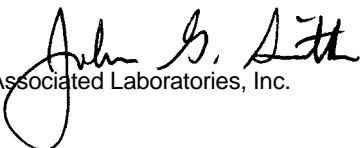
This Certification will expire **September 15, 2026 (extended from September 15, 2021 per AAMA 103-19)** and requires validation until then by continued listing in the current AAMA Certified Products Directory.

Product Tested and Reported by: **Intertek-ATI**

Report No.: **G2937.01-109-47**

Date of Report: **September 30, 2016**

Evaluated for Certification: **July 7, 2021**


Associated Laboratories, Inc.

Authorized for Certification: **July 7, 2021**


Fenestration and Glazing Industry Alliance



(Validator / Operations Administrator)