



**AAMA CERTIFICATION PROGRAM**  
An FGIA Product Certification Program



**AUTHORIZATION FOR PRODUCT CERTIFICATION**

**JELD-WEN Windows & Doors**  
P.O. Box 1329  
Klamath Falls, OR 97601

**Attn: Joshua Goossen**

This authorization is based on the successful completion of tests, and the reporting to the AAMA Validator of the results of the tests by an AAMA Accredited Laboratory. The product information below will be added to the next update of the AAMA Certified Products Directory.

SPECIFICATIONS		RECORD OF PRODUCT TESTED			
<b>AAMA/WDMA/CSA 101/I.S.2/A440-11 LC-PG50-2741x1829 (108x72)-FW</b> Negative Design Pressure = -55 psf	<b>AAMA 506</b>				
COMPANY AND CODE	Missile Level: <b>D</b> Rating: <b>+50/-55, 108x72</b> Wind Zone: <b>3</b>  Rating above conforms to the requirements of: <b>ASTM E1886</b> and <b>E1996</b>	CPD NO.	SERIES MODEL & PRODUCT DESCRIPTION	MAXIMUM SIZE TESTED	
<b>JELD-WEN Windows &amp; Doors</b> Code: <b>JW</b>		<b>16395</b>	<b>PREMIUM VINYL V-4500 TRIPLE STATIONARY CASEMENT (FIN &amp; MASONRY STRAPS) (PVC)(OOO)(OG) (INS 0.090" PVB LAM GL) (MODIF)(REINF)(ASTM)</b>	<u>FRAME (mm)</u> <b>2741 x 1829</b> <b>(9'0" x 6'0")</b>	<u>FIXED VENTS</u> <b>866 x 1789</b> <b>(2'10" x 5'10")</b>

This Certification will expire **January 24, 2027 (extended from January 24, 2022 per AAMA 103-19)** and requires validation until then by continued listing in the current AAMA Certified Products Directory.

Structural Test & Report By:

**National Certified Testing Laboratories**

Report No: **SJW2014-026 & SJW2014-029**

Date of Report: **March 10, 2014 & April 22, 2014**

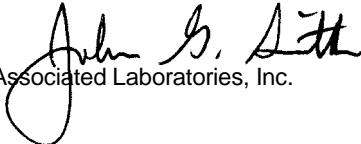
Missile Impact Test & Report By:

**National Certified Testing Laboratories**

Report No: **NCTL-110-17-023**

Date of Report: **March 9, 2017**

Evaluated for Certification: **April 6, 2021**

  
Associated Laboratories, Inc.

Authorized for Certification: **April 6, 2021**



Fenestration and Glazing Industry Alliance



(Validator / Operations Administrator)

ACP-04 (Rev. 2/20)