



AAMA CERTIFICATION PROGRAM
An FGIA Product Certification Program



AUTHORIZATION FOR PRODUCT CERTIFICATION

JELD-WEN Windows & Doors
P.O. Box 1329
Klamath Falls, OR 97601

Attn: Joshua Goossen

This authorization is based on the successful completion of tests, and the reporting to the AAMA Validator of the results of the tests by an AAMA Accredited Laboratory. The product information below will be added to the next update of the AAMA Certified Products Directory.

| SPECIFICATIONS | | RECORD OF PRODUCT TESTED | | | |
|--|--|--------------------------|---|---|---|
| AAMA/WDMA/CSA 101/I.S.2/A440-11 LC-PG50-2742x1830 (108x72)-FW Negative Design Pressure = -55 psf | AAMA 506 | | | | |
| COMPANY AND CODE | Missile Level: C Rating: +50/-55, 108x72 Wind Zone: 2 Rating above conforms to the requirements of: ASTM E1886 and E1996 | CPD NO. | SERIES MODEL & PRODUCT DESCRIPTION | MAXIMUM SIZE TESTED | |
| JELD-WEN Windows & Doors Code: JW | | 16408 | PREMIUM VINYL V-4500 TRIPLE STATIONARY CASEMENT (FIN & MASONRY STRAPS) (PVC)(OOO)(OG) (INS 0.060" PVB LAM GL) (MODIF)(REINF)(ASTM) | <u>FRAME (mm)</u> 2742 x 1830 (9'0" x 6'0") | <u>FIXED VENTS</u> 870 x 1790 (2'10" x 5'10") |

This Certification will expire **February 14, 2027 (extended from February 14, 2022 per AAMA 103-19)** and requires validation until then by continued listing in the current AAMA Certified Products Directory.

Structural Test & Report By:

National Certified Testing Laboratories

Report No: **SJW2014-026 & SJW2014-029**

Date of Report: **March 10, 2014 & April 22, 2014**

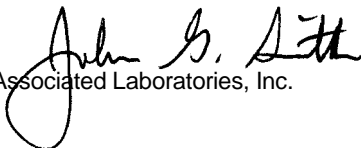
Missile Impact Test & Report By:

National Certified Testing Laboratories

Report No: **NCTL-110-17-049**

Date of Report: **March 20, 2017**

Evaluated for Certification: **April 6, 2021**


Associated Laboratories, Inc.

Authorized for Certification: **April 6, 2021**



Fenestration and Glazing Industry Alliance



(Validator / Operations Administrator)

ACP-04 (Rev. 2/20)