

**AAMA
CERTIFICATION PROGRAM**



AUTHORIZATION FOR PRODUCT CERTIFICATION

Simonton Windows
1 Cochrane Dr.
Pennsboro, WV 26415

Attn: Tina Seese

The product described below is hereby approved for listing in the next issue of the AAMA Certified Products Directory. The approval is based successful completion of tests, and the reporting to the Administrator of the results of tests, accompanied by related drawings, by an AAMA Accredited Laboratory.

1. The listing below will be added to the next published AAMA Certified Products Directory.

SPECIFICATIONS		RECORD OF PRODUCT TESTED			
AAMA/WDMA/CSA 101/I.S.2/A440-08 R-PG50-914x1575 (36x62)-C	AAMA 506				
COMPANY AND CODE	Missile Level: C Rating: +50/-50, 36x62 Wind Zone: 2	CPD NO.	SERIES MODEL & PRODUCT DESCRIPTION	MAXIMUM SIZE TESTED	
Simonton Windows Code: SIM	Rating above conforms to the requirements of: ASTM E1886 and E1996	8575	42-19 CASEMENT (PVC)(X)(OG) (INS PVB LAM GL) (MODIF)(ASTM)	<u>FRAME (mm)</u> 914 x 1575 (3'0" x 5'2")	<u>VENT (mm)</u> 870 x 1530 (2'10" x 5'0")

2. This Certification will expire **January 18, 2020 (extended from January 18, 2015 per AAMA 103-15)** and requires validation until then by continued listing in the current AAMA Certified Products Directory.

3. Structural Test & Report By:

Architectural Testing, Inc.

Report No: **A6992.01-501-47**

Date of Report: **February 17, 2011**

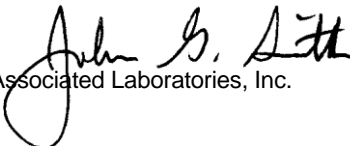
Missile Impact Test & Report By:

PRI Construction Materials Technologies/Architectural Testing, Inc.

Report No: **SIMO-003-03-03; ref. B7593.01-501-47**

Date of Report: **February 5, 2015; April 20, 2012 (Revised June 11, 2012)**

Validated for Certification


 Associated Laboratories, Inc.

Date: **February 25, 2016**

Cc: AAMA

JGS

ACP-14 (Rev. 1/11)

Authorized for Certification


 American Architectural Manufacturers Association