



Metal Roof Certification & Listing Program Compliance Report



11033-003-KCI

145 Limekiln Road, Suite 100B
New Cumberland, PA 17070
www.keystonecerts.com

Issue Dated: 11/29/2017
Revision Date: 11/29/2017
Expiration Date: 11/29/2022

Construction Specifications Institute (CSI) Category:

Division: 07 00 00 – Thermal & Moisture Protection

Section: 07 41 13 – Metal Roof Panels

1. Program Licensee:



Reed's Metals, Inc.
19 E. Lincoln Drive NE
Brookhaven, Mississippi 39601
800-581-4645
<https://reedsmetals.com/>

2. Certified Roof Covering:

Reeds Metals Model Secure-Seam non-structural standing seam minimum 26 gauge metal roof panels installed over nominal 15/32" plywood sheathing roof deck for use in new construction and re-roofing applications.

3. Scope of Certification:

This Certification Report provides technical data substantiating that the use of the certified roof covering and the evaluated roof systems are in compliance with the following:

- 2017 Florida Building Code - Building, 6th Edition, Section 1504.3.2.
- Florida Product Approval Rule 61G20-3.

Properties Evaluated:

- Wind Uplift Resistance

4. Evaluated Roof System Description:

4.1. **Roof Covering:** Secure-Seam metal roof panels are cold roll-formed from minimum 26 gauge (0.021" / 0.508mm coated thickness) Grade 80 steel sheet. The panels are aluminum-zinc alloy coated per ASTM A792 (AZ50) and shall be installed in accordance with the manufacturer's instructions and this Certification Report.

4.2. **Roof Deck:** Secure-Seam metal roof panels are certified for use over solid or closely-spaced, nominal 15/32" plywood sheathing complying with 2017 Florida Building Code, Section 2303.1.5 with a minimum slope of 2% (1/4:12).

4.3. **Anchorage:** Secure-Seam metal roof panels shall be anchored to the roof deck using SFS Intec G90 galvanized 18 Gauge 1-3/4" Snap Lock (2 Hole) Clips with two (2) #10-16 x 1" SFS Intec Type A Pancake Head or approved equivalent, applied in the anchorage patterns described in Table 1 and illustrated in Appendix 1.

5. Installation

Secure-Seam metal roof panels in new construction applications shall be installed in accordance with the 2017 Florida Building Code Section 1507.4, the manufacturer's published installation instructions and this Certification Report.



Metal Roof Certification & Listing Program
Compliance Report
 11033-003-KCI



Secure-Seam metal roof panels in re-roofing applications shall be installed in accordance with the 2017 Florida Building Code Sections 1507.4 & 1511, the manufacturer’s published installation instructions and this Certification Report.

The manufacturer’s installation instructions shall be made available at the time of installation. If there are differences between this report and the manufacturer’s installation instructions, this report shall take precedence.

6. Performance and Limitations of Use

The performance of the Secure-Seam non-structural standing seam metal roof panels described in this Certification Report has been determined in accordance with:

- UL 580-06, *Tests for Uplift Resistance of Roof Assemblies.*
- UL 1897-04, *Uplift Tests for Roof Covering Systems.*

As tested & reported by the following independent accredited laboratory:

Laboratory	Report Ref.
Force Engineering & Testing	101-0156T-15A & B

Note: The UL 1897-04 standard is equivalent to the UL 1897-2012 standard.

6.1. Wind Resistance

The allowable design uplift pressures for Secure-Seam anchored as illustrated in Appendix 1, when tested in accordance with the referenced standards with an applied safety factor of 2.0 are found in Table 1.

Table 1

Description	Anchor Pattern	Max Design Uplift Pressure
Over 15/32” Plywood Sheathing	A 24” O.C.	-56.0 psf
Over 15/32” Plywood Sheathing	B 12” O.C.	-86.0 psf

7. Conditions of Use

Secure-Seam standing seam metal roof panels must be insulated against other materials or metals including concrete, lead, copper and treated lumber that contains corrosive materials.

8. Limitations of Use

Secure-Seam standing seam metal roof panels are not qualified for use in the High Velocity Hurricane Zone (HVHZ).

Fire classification, shear diaphragm design, roof deck design & attachment to supporting members are not within the scope of this Certification Report.

Roof support framing shall comply with 2017 Florida Building Code Chapter 22 for steel, Chapter 23 for wood and Chapter 16 for structural loading.



9. Licensed Manufacturing Facilities

This Certification Report is applicable only to Secure-Seam standing seam metal roof panels manufactured at the following locations:

<p>Reed's Metals, Inc. 19 E. Lincoln Drive NE Brookhaven, Mississippi 39601</p> <p>Reeds Metals Inc. 16454 SE Highway 19 Cross City, Florida 32628</p>
--

Aaron Shultz
Validations Manager

Each licensed facility is subject to periodic inspection by Keystone Certifications to verify conformance with Keystone Roof Covering Certification & Listing Program requirements.

10. Identification


Secure-Seam standing seam metal roof panels represented by this report shall be identified with Keystone Roof Covering Certification & Listing Program certification labeling illustrated below, to be applied to individual panels, packaging, invoicing or bills of lading:




Appendix 1

Notes: In all cases (new construction and re-roofing), the anchors shall fully penetrate the plywood roof deck.
 Lap sealant is required for slopes less than 3:12.

Anchor Pattern A

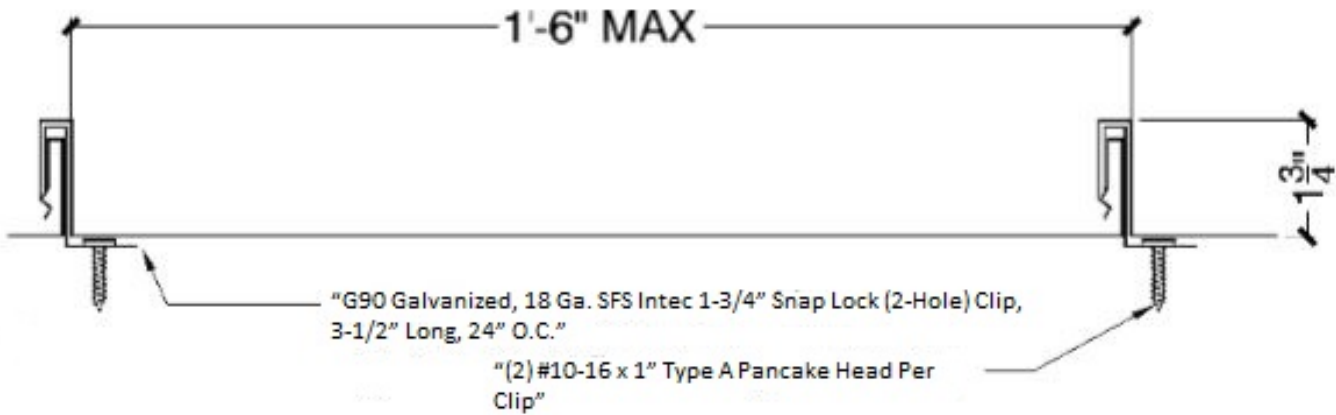

Anchor Pattern B

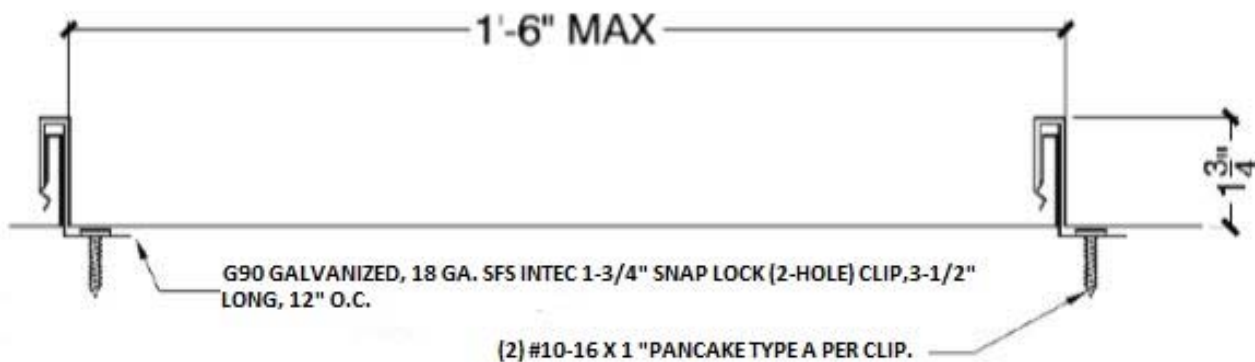



Metal Roof Certification & Listing Program

Compliance Report

11033-003-KCI



145 Limekiln Road, Suite 100B
New Cumberland, PA 17070
www.keystonecerts.com

Issue Dated: 11/29/2017
Revision Date: 11/29/2017
Expiration Date: 11/29/2022

Certificate Revisions

Rev #	Date	Description
0	11/29/2017	Initial issuance.