
16, 0.C. Ţ, 16" O.C. TYP.

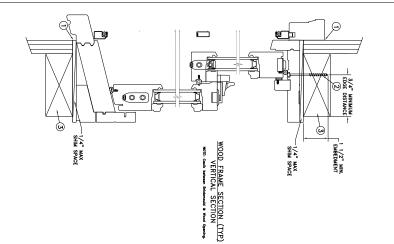

1 1/2" MIN. EMBEDMENT 3/4" MINIMUM EDGE DISTANCE W FRAME JAMB SECTION (TYP) HORIZONTAL SECTION NOTE: Caulk between Brickmould & Wood Opening. 1/4" MAX SHIM SPACE

THROUGH FRAME INSTALLATION

Z O	/-55	+50,	76	×	∞	W	37
IMPACT	O	DF	ne	Frame	一	Max	<

Installation Notes:

TYPICAL ELEVATION WITH FASTENER SPACING

- Seal brickmould/frame to substrate.
- into the wood framing. For 2x wood frame substrate (min. S.G. = 0.42) Use #8 PH or greater fastener through the frame with sufficient length to penetrate a minimum of 1 1/2"
- Host structure (wood buck, masonry, steel) to be designed and anchored to properly transfer all loads project of installation. to the structure. The host structure is the responsibility of the architect or engineer of record for the

ယ

General Notes:

- Building Code (FBC) and the industry requirement for the stated conditions. of the adopted International Building Code (IBC), the International Residential Code (IRC), the Florida The product shown herein is designed tested and manufactured to comply with the wind load criteria
- All glazing shall conform to ASTM E1300


αω4

- At minimum, glazing shall be double strength annealed insulating glass.
- Use structural or composite shims where required


NCTL-110-17-078 Bend-OR	PART/PROJECT No.: D010786	D.STOKES	APPROVED BY:	C.ABBOTT	CHECKED BY:	J.HAWKINS	DRAWN BY:	PROJECT ENGINEER:
8 Bend-OR)	TITLE:	NTS		DATE: 09/06/2017
Cab DWG. No.: CustWDDH Cert			Custom wood Double Hu				M	NEW CLIE
REV: A SHEET	-		Hung			PHONE: (800) 535-3936	4	

reproduced or copied in whole or in part or used or disclosed to others except as authorized by JELD-WEN Inc. This drawing and its contents are confidential and are not to be

complete installation procedure, see the instructions packaged with the consideration that may arise in different wall conditions. For the a guide to the installation process and does not address he sealing (where applicable) up to the size limitations noted. It is not intended as window to achieve the rated design pressure and impact performance This schedule addresses only the fasteners required to anchor the

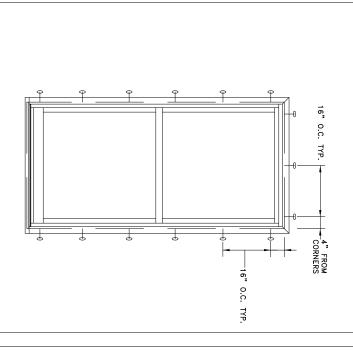

TRAME SECTION (TYP) VERTICAL SECTION (TYP) SHIM SPACE SHIM SPACE

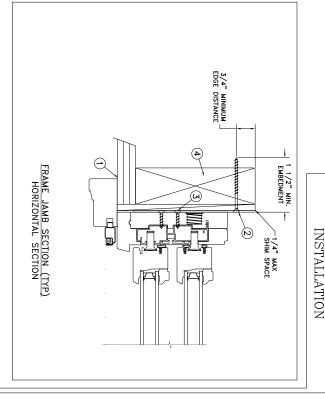

MASONRY STRAF

ON O	/-55	/05+	76	×	8	3	37
IMPACT	U	DF	ne	Frame		Max	Z

Installation Notes:

TYPICAL ELEVATION WITH FASTENER SPACING

- Seal brickmould/frame to substrate.
- Use 2-#8 PFH or larger fasteners through masonry strap with sufficient length to penetrate a minimum
 of 1 1/2" into the masonry or buck. For concrete (min. fc = 3000 psi) or masonry substrate (CMU shall
 adhere to ASTM C90).
- Use 2-#8 PFH or larger fasteners through masonry strap into jamb without penetrating through the jamb into product causing visability or collateral damage to product.

ယ

Host structure (wood buck, masonry, steel) to be designed and anchored to properly transfer all loads to the structure. The host structure is the responsibility of the architect or engineer of record for the project of installation.

General Notes:

- The product shown herein is designed, tested and manufactured to comply with the wind load criteria of the adopted International Building Code (IBC), the International Residential Code (IRC), the Florida Building Code (FBC) and the industry requirement for the stated conditions.
- All glazing shall conform to ASTM E1300.

0 2 4

- At minimum, glazing shall be double strength annealed insulating glass
- Use structural or composite shims where required.

PART/PROJECT No.: D010786 APPROVED BY: CHECKED BY DRAWN BY: PROJECT ENGINEER: IDENTIFIER No. NCTL-110-17-078 **D.STOKES** C.ABBOTT J.HAWKINS 09/06/201<u>7</u> THE SCALE PLANT NAME AND LOCATION: Bend-OR STN **Custom Wood Double Hung** CustWDDH Cert CAD DWG No WEN KLAMATH FALLS OR, 97601 REV PHONE: (800) 535-3936 \triangleright 3737 LAKEPORT BLVD. SHEET

CLAIMER

a guide to the installation process and does not address he sealing consideration that may arise in different wall conditions. For the complete installation procedure, see the instructions packaged with the This schedule addresses only the fasteners required to anchor the window to achieve the rated design pressure and impact performance (where applicable) up to the size limitations noted. It is not intended as

This drawing and its contents are confidential and are not to be reproduced or copied in whole or in part or used or disclosed to others except as authorized by JELD-WEN Inc.

d are not to be