	REVISIONS					
REV	DESCRIPTION	DATE	APPROVED			
Е	ADDED SILLS	12/17/19	R.L.			

NOTES:

- 1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH REQUIREMENTS OF THE FLORIDA BUILDING CODE.
- 2. WOOD FRAMING AND MASONRY OPENING TO BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO STRUCTURE. FRAMING AND MASONRY OPENING IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.
- 3. 1X BUCK OVER MASONRY/CONCRETE IS OPTIONAL.
- 4. WHERE SHIM OR BUCK THICKNESS IS LESS THAN 1-1/2" WINDOW UNITS MUST BE ANCHORED THROUGH THE FRAME IN ACCORDANCE WITH MANUFACTURER'S PUBLISHED INSTALLATION INSTRUCTIONS. ANCHORS SHALL BE SECURELY FASTENED DIRECTLY INTO MASONRY, CONCRETE OR OTHER STRUCTURAL SUBSTRATE MATERIAL.
- 5. WHERE WOOD BUCK THICKNESS IS 1-1/2" OR GREATER, BUCK SHALL BE SECURELY FASTENED TO MASONRY, CONCRETE OR OTHER STRUCTURAL SUBSTRATE. WINDOW UNITS MAY BE ANCHORED THROUGH FRAME TO SECURED WOOD BUCK IN ACCORDANCE WITH MANUFACTURER'S PUBLISHED INSTALLATION INSTRUCTIONS.
- 6. WHERE 1X BUCK IS NOT USED DISSIMILAR MATERIALS MUST BE SEPARATED WITH APPROVED COATING OR MEMBRANE. SELECTION OF COATING OR MEMBRANE IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.
- 7. BUCKS SHALL EXTEND BEYOND WINDOW INTERIOR FACE SO THAT FULL FRAME SUPPORT IS PROVIDED.
- 8. SHIM AS REQUIRED AT EACH ANCHOR LOCATION WITH LOAD BEARING SHIM. SHIM WHERE SPACE OF 1/16" OR GREATER OCCURS. MAXIMUM ALLOWABLE SHIM STACK TO BE 1/4".
- 9. SHIMS SHALL BE LOCATED, APPLIED AND MADE FROM MATERIALS AND THICKNESS CAPABLE OF SUSTAINING APPLICABLE LOADS.
- 10. WIND LOAD DURATION FACTOR Cd=1.6 WAS USED FOR WOOD ANCHOR CALCULATIONS.
- 11. FRAME MATERIAL: WOOD WITH G=.46 MINIMUM SPECIFIC GRAVITY OR FRAMESAVER OR FUSION FRAME.
- 12. UNITS MUST BE GLAZED PER ASTM E1300-04/09, WITH SAFETY GLAZING.
- 13. APPROVED IMPACT PROTECTIVE SYSTEM <u>IS NOT REQUIRED</u> FOR THIS PRODUCT IN WIND BORNE DEBRIS REGIONS.
- 14. FOR ANCHORING THROUGH FRAME INTO WOOD FRAMING OR 2X BUCK USE #10 WOOD SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE A 1 3/8" MINIMUM EMBEDMENT INTO SUBSTRATE, LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.

- 15. FOR ANCHORING THROUGH FRAME INTO MASONRY/CONCRETE USE 3/16" TAPCONS WITH SUFFICIENT LENGTH TO ACHIEVE A 1 1/4" MINIMUM EMBEDMENT INTO SUBSTRATE WITH 2" MINIMUM EDGE DISTANCE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
- 16. FOR ANCHORING THROUGH FRAME INTO METAL STRUCTURE USE #10 SMS OR SELF DRILLING SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE 3 THREADS MINIMUM BEYOND STRUCTURE INTERIOR WALL. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
- 17. ALL FASTENERS TO BE CORROSION RESISTANT.
- 18. INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BELOW:
 - A. WOOD MINIMUM SPECIFIC GRAVITY OF G=0.42
 - B. CONCRETE MINIMUM COMPRESSIVE STRENGTH OF 3,192 PSI.
 - C. MASONRY STRENGTH CONFORMANCE TO ASTM C-90, GRADE N. TYPE 1 (OR GREATER).


PROVIA, LLC.

D. METAL STRUCTURE: STEEL 18GA, 33KSI OR ALUMINUM 6063-T5 .048" THICK MINIMUM

SIGNED: 01/08/2020

Luis R. Lomas P.E. FL No.: 62514

		2150 STATE ROUTE 39 WEST SUGARCREEK, OH 44681				
	TABLE OF CONTENTS	6'8 HERITAGE FIBERGLASS OPAQUE IS/OS DOOR LARGE MISSILE IMPACT WITH OR WITHOUT SIDELITES NOTES				
SHEET NO.	DESCRIPTION					
1	NOTES	DRAWN: DWG NO.			REV	
2	ELEVATIONS	V.L.	V.L.		08-01362 E	
3	ANCHORING LAYOUTS	SCALE NTS DATE 10/03/11 SHEET 1 OF 31				
4 - 29	– 29 INSTALLATION DETAILS L. ROBERTO LOMAS P.E. 1432 WOODFORD RD LEWISVILLE. NC 27023					
30 - 31	COMPONENTS	434-688-0609 rllomas@lrlomaspe.com				

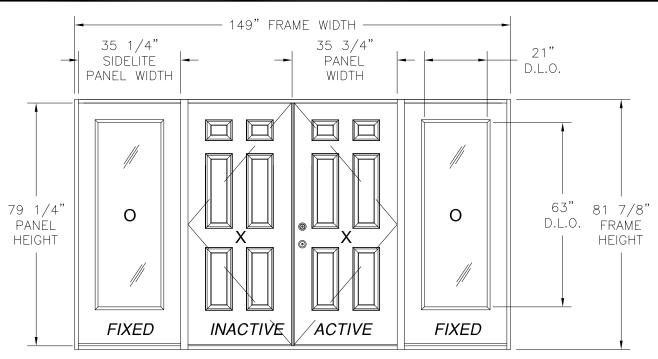

6'8 HERITAGE FIBERGLASS OPAQUE INSWING/OUTSWING DOUBLE DOOR W/SIDELITES EXTERIOR VIEW

Approved Configurations and Ratings

Approved Configurations and Ratings											
			Rating where water infiltration is not required (psf)		Rating where water infiltration is required (psf)						
Config	Configuration		Max Size	is not required (psr)		Standard Threshold		High Dam Threshold		Impact	
Comiguration		max 0.20	Schlage or Emtek hardware	Trilennium hardware	Schlage or Emtek hardware	Trilennium hardware	Schlage or Emtek hardware	Trilennium hardware	Rating		
Single	Х	IS	3'0" x 6'8"	±64.2	±60	+19/-64.2	+19/-60	-	-		
Olligic	^	^ os	^ os	30 x 00	±64.2	±60	±64.2	±60	-	-	
Double	×	IS	6'0" x 6'8"	±50.5	±50.5	+19/-50.5	+19/-50.5	-	-	Large	
Double		os		+55/-50.5	+55/-50.5	+40/-50.5	+40/-50.5	+55/-50.5	+55/-50.5	Missile	
Single w/	OX, XO	OX, XO IS 6'0" x 6'8"	±50.5	±50.5	+19/-50.5	+19/-50.5	-	-	Impact		
Sidelite			delite	os	00 x 00	+55/-50.5	+55/-50.5	+40/-50.5	+40/-50.5	+55/-50.5	+55/-50.5
Single w/	ОХО	IS OLOT A CIOT	9'0" x 6'8"	±50.5	±50.5	+19/-50.5	+19/-50.5	-	-	Zone 4	
Sidelites	os	90 X 00	+55/-50.5	+55/-50.5	+40/-50.5	+40/-50.5	+55/-50.5	+55/-50.5	Level D		
Double w/	OXXO	IS	12'6" x 6'8"	±50.5	±50.5	+19/-50.5	+19/-50.5	-	-		
sidelites	0,00	os	120 800	+55/-50.5	+55/-50.5	+40/-50.5	+40/-50.5	+55/-50.5	+55/-50.5		

Door Panels are Impact Rated, Sidelites need protection, see note 13


	HARDWARE SCHEDULE				
Α.	F-SERIES ASSEMBLY DOOR KNOB BY SCHLAGE.				
В.	B-SERIES DEADBOLT ASSEMBLY BY SCHLAGE				
C.	F-SERIES DEADBOLT ASSEMBLY BY SCHLAGE				
D.	EMTEK RESIDENTIAL GRADE DOOR HANDLE ASSEMBLY (ALTERNATE)				
E.	TRILLENIUM MULTI-POINT LOCK HANDLE ASSEMBLY (ALTERNATE)				
F.	INSWING HURRICANE ASTRAGAL BY ENDURA				
G.	OUTSWING HURRICANE ASTRAGAL BY ENDURA				
Н.	(4) 4" X 4" BALL BEARING HINGES BY PENROD				
1.	(3) 4" X 4" SPRING BOMMER HINGES BY PENROD				


35 3/4" X 79 1/4" PANELS SHOWN. OTHER PANEL SIZES ARE APPROVED AS LONG AS INDIVIDUAL PANEL AREA DOES NOT EXCEED 19.67 FT²


REVISIONS

REV DESCRIPTION DATE APPROVED

E ADDED SILLS 12/17/19 R.L.









SINGLE W/SIDELITE
EXTERIOR VIEW

SINGLE W/SIDELITE
EXTERIOR VIEW



SINGLE W/SIDELITES
EXTERIOR VIEW



DOUBLE EXTERIOR VIEW

NOTE:

ALL APPROVED CONFIGURATIONS CAN BE INSWING OR OUTSWING MODELS.


ALL APPROVED CONFIGURATIONS ARE SHOWN AS RIGHT HAND ACTIVE, LEFT HAND ACTIVE IS ALSO APPOVED.

SIGNED: 01/08/2020


;	PROVIA, LLC. 2150 state route 39 west sugarcreek, oh 44681						
6'8 HERITAGE FIBERGLASS OPAQUE IS/OS DOOR LARGE MISSILE IMPACT WITH OR WITHOUT SIDELITES OXXO ELEVATION							
DRAWN: DWG NO. RE			rev E				
SCALE NTS DATE 10/03/11 SHEET 2 OF 31							
L. ROBERTO LOMAS P.E. 1432 WOODFORD RD LEWISVILLE, NC 27023 434-688-0609 rllomas@lrlomaspe.com							



Luis R. Lomas P.E. FL No.: 62514

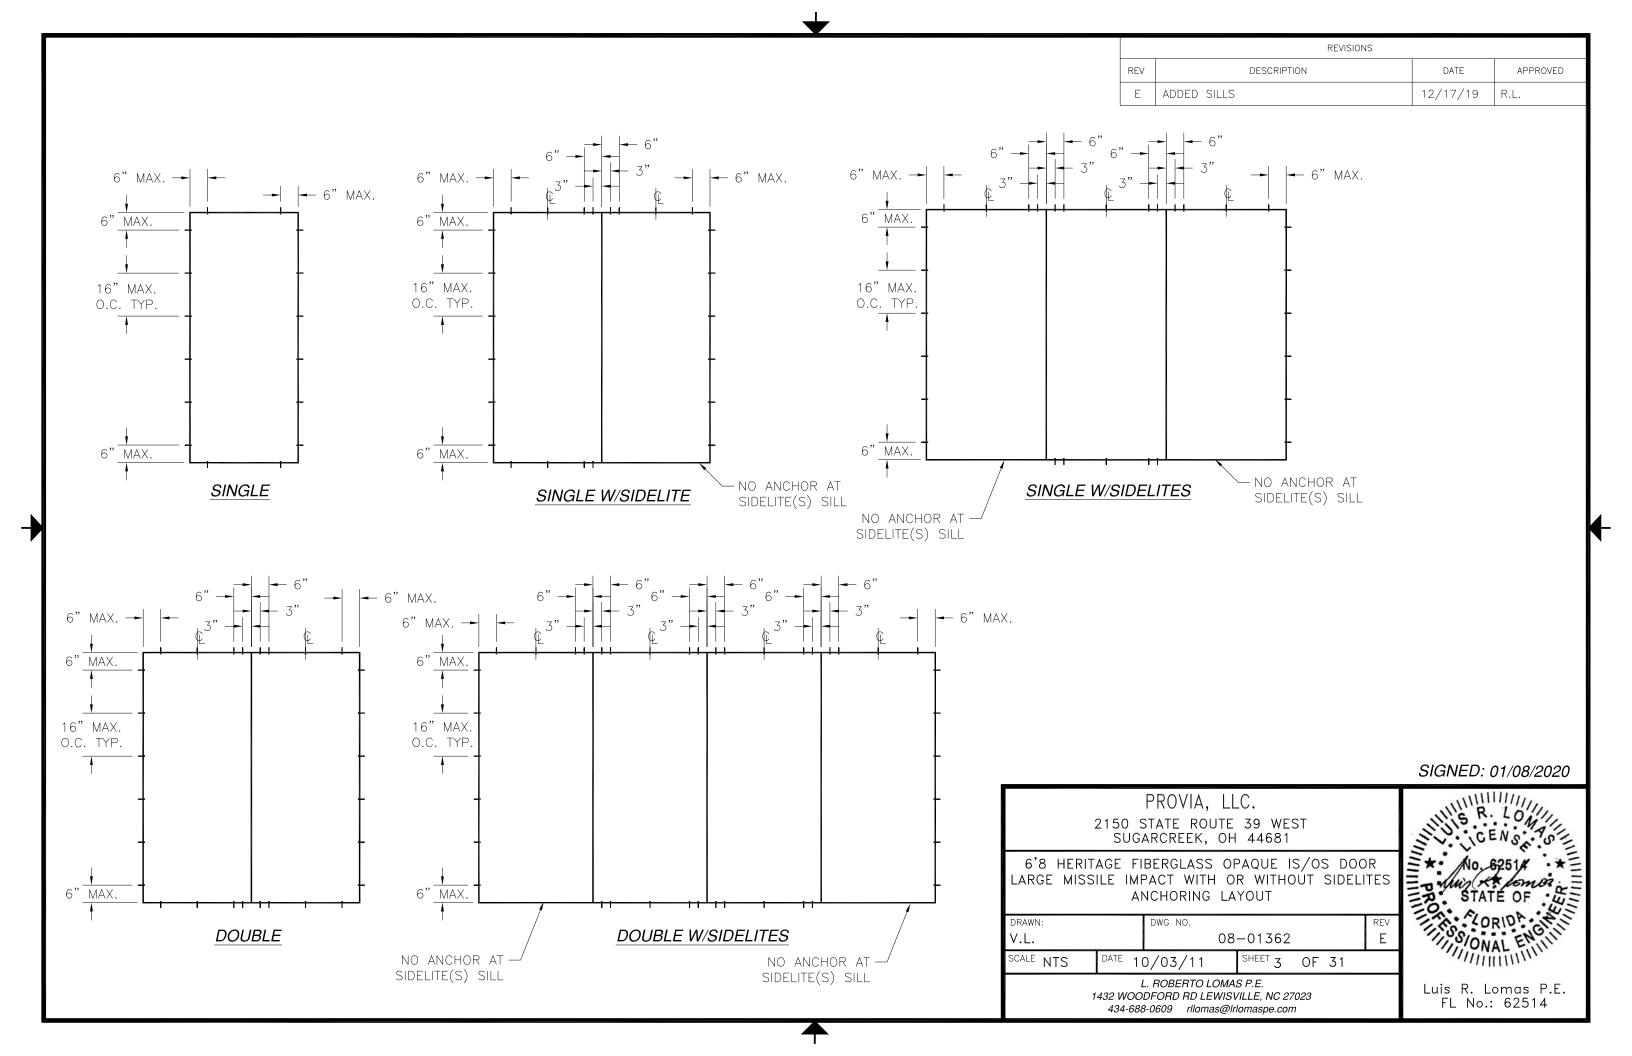





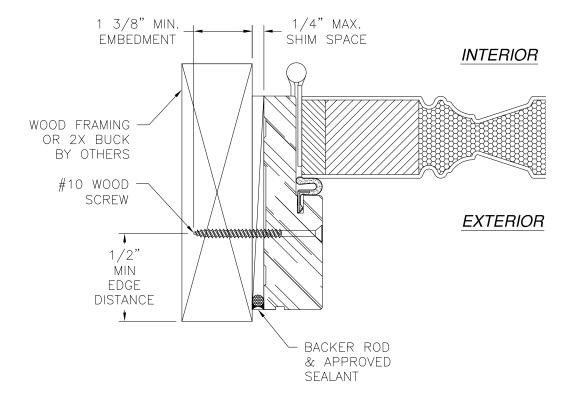

JAMB INSTALLATION DETAIL
WOOD FRAMING OR 2X BUCK INSTALLATION

SIGNED: 01/08/2020

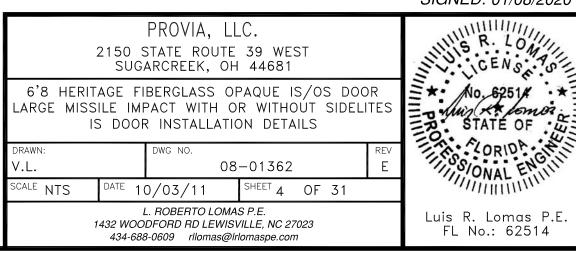

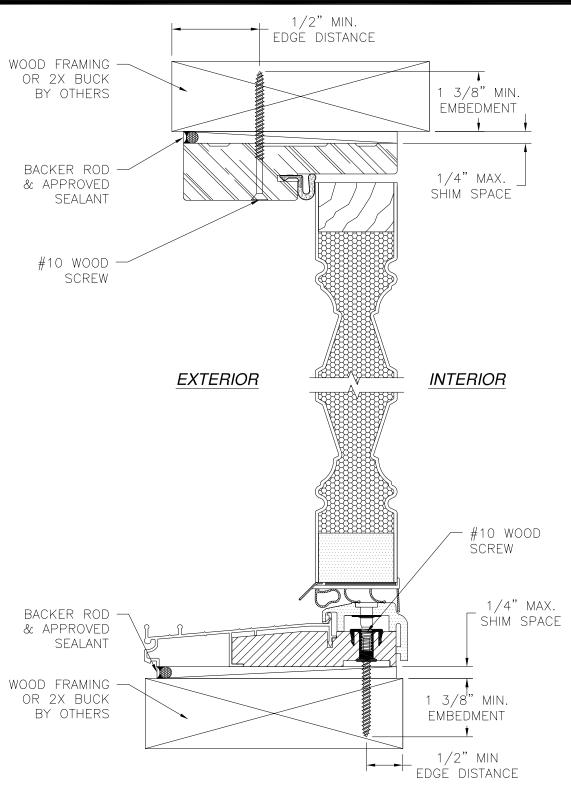

VERTICAL CROSS SECTION
WOOD FRAMING OR 2X BUCK INSTALLATION


NOTES:

1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS,

NOT SHOWN FOR CLARITY.

2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112


	REVISIONS						
REV	DESCRIPTION	DATE	APPROVED				
Е	ADDED SILLS	12/17/19	R.L.				

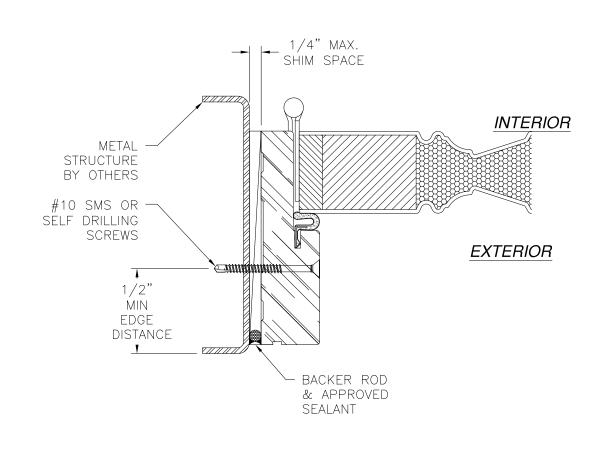

JAMB INSTALLATION DETAIL


METAL STRUCTURE INSTALLATION

SIGNED: 01/08/2020

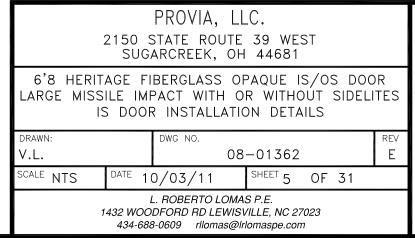

REV STATE CORIDA CHILINGS ON AL ENGINE Luis R. Lomas P.E. FL No.: 62514

1/2" MIN



INTERIOR

#10 SMS OR SELF DRILLING

SCREW

1/2" MIN

EDGE DISTANCE

1/4" MAX.

SHIM SPACE

STRUCTURE BY OTHERS APPROVED SEALANT

EXTERIOR

VERTICAL CROSS SECTION

METAL STRUCTURE INSTALLATION

#10 SMS OR

SELF DRILLING SCREWS

NOTES: 1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS,

NOT SHOWN FOR CLARITY.

BACKER ROD


& APPROVED


SEALANT

METAL-STRUCTURE BY OTHERS

2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE

DESIGNED IN ACCORDANCE WITH ASTM E2112

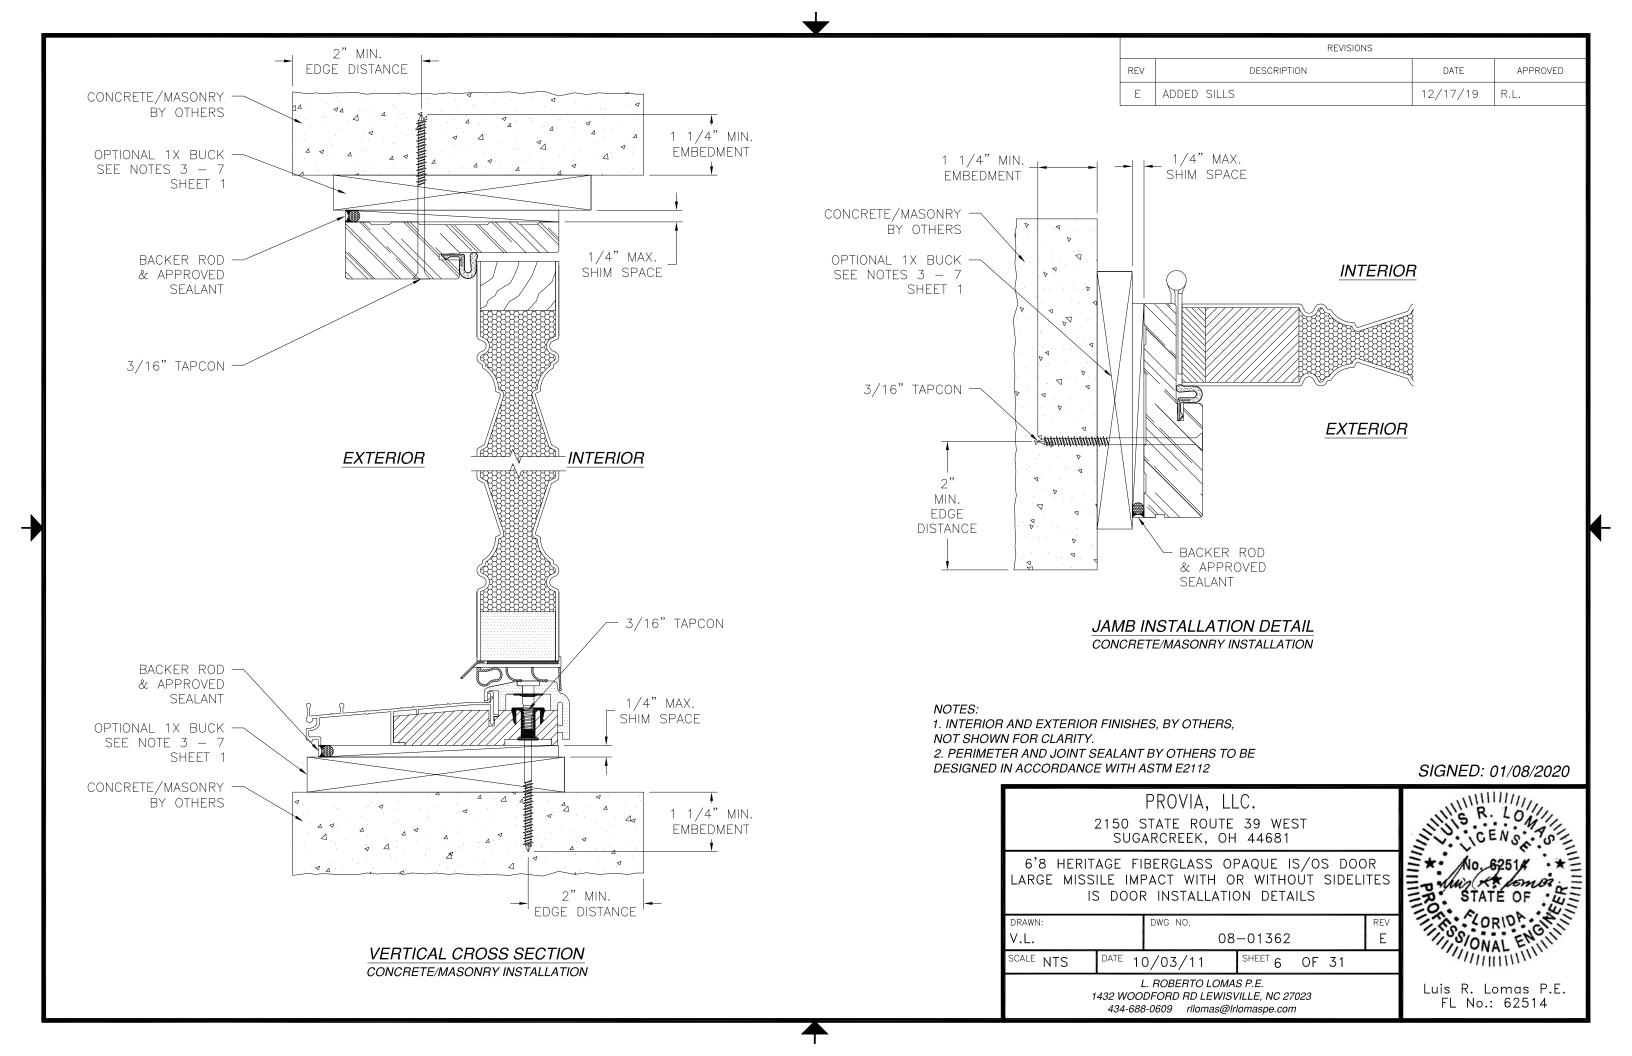

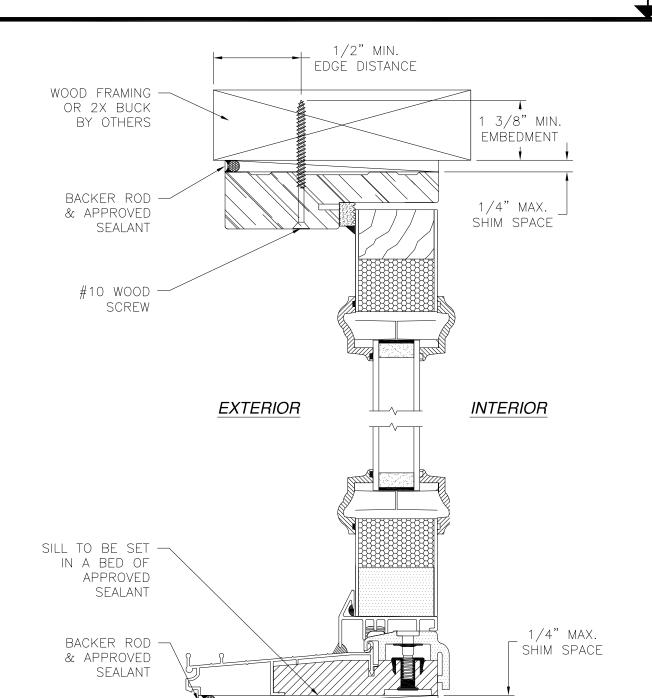

VERTICAL CROSS SECTION WOOD FRAMING OR 2X BUCK INSTALLATION

NOTES:


1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS,

NOT SHOWN FOR CLARITY.

2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112


WOOD FRAMING OR 2X BUCK BY OTHERS


REVISIONS DESCRIPTION APPROVED REV DATE Ε ADDED SILLS 12/17/19 R.L.

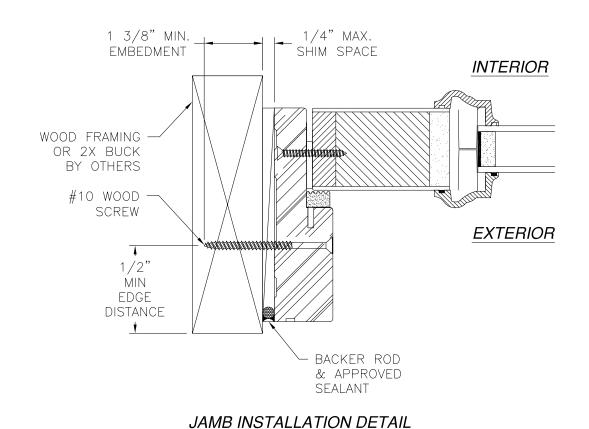


WOOD FRAMING OR 2X BUCK INSTALLATION


SIGNED: 01/08/2020

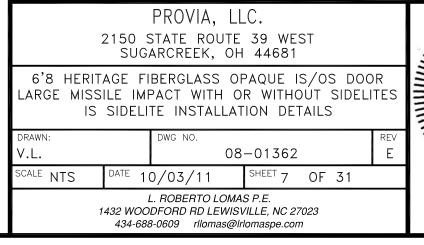



Luis R. Lomas P.E. FL No.: 62514



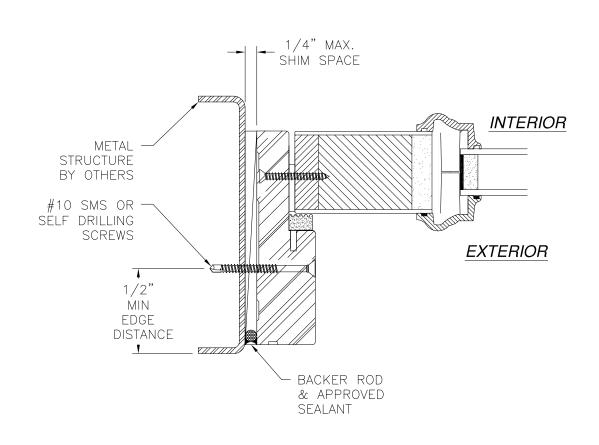

JAMB INSTALLATION DETAIL

METAL STRUCTURE INSTALLATION


SIGNED: 01/08/2020



REV E

REV E

Luis R. Lomas P.E. FL No.: 62514

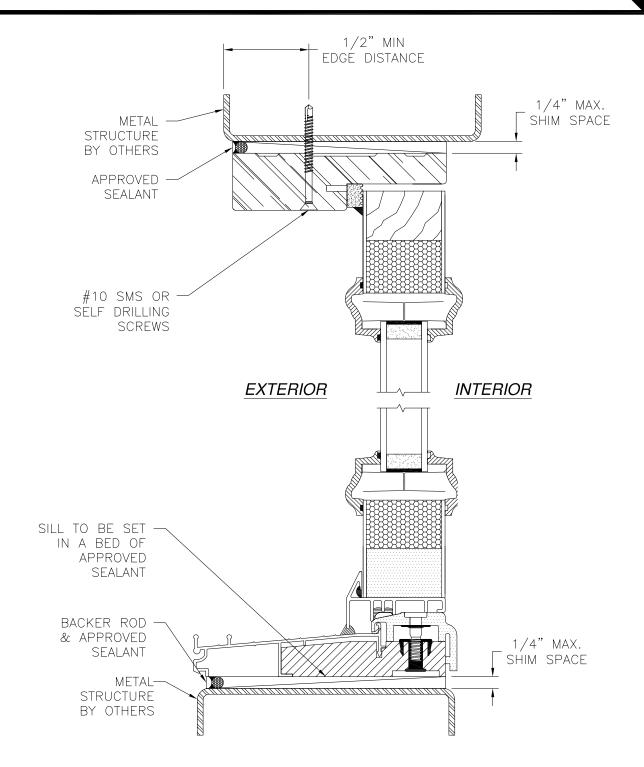



VERTICAL CROSS SECTION


METAL STRUCTURE INSTALLATION

NOTES:

- 1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS,
- NOT SHOWN FOR CLARITY.
- 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

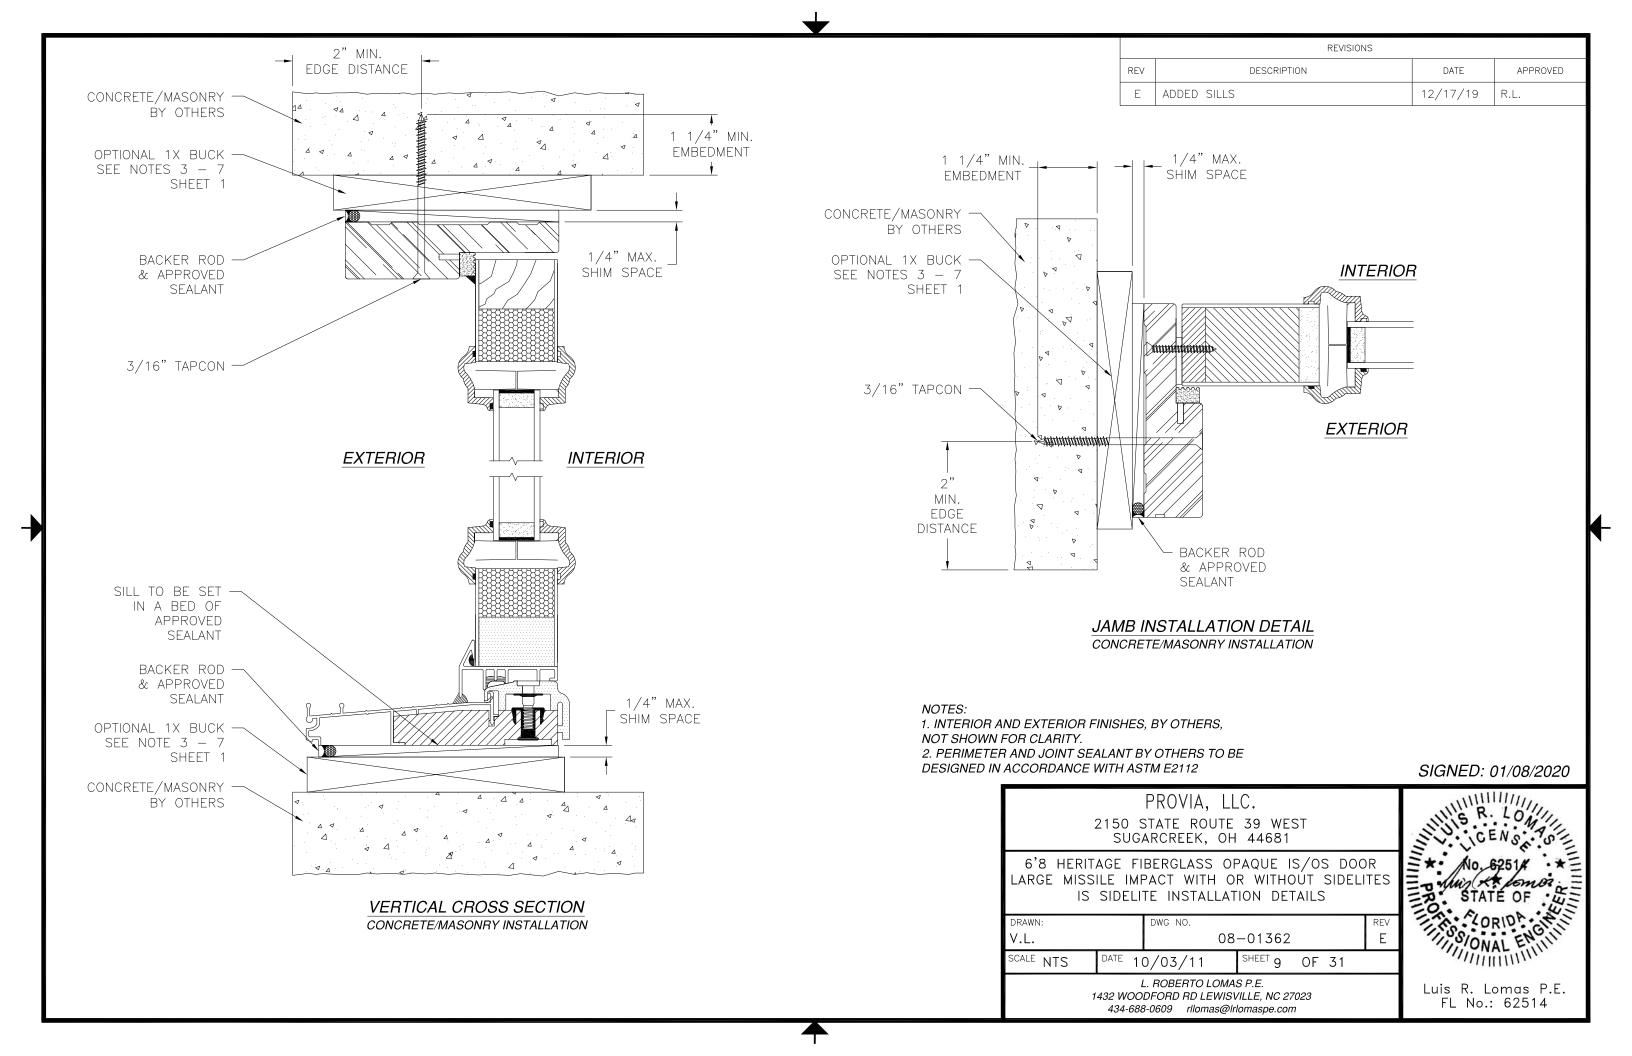





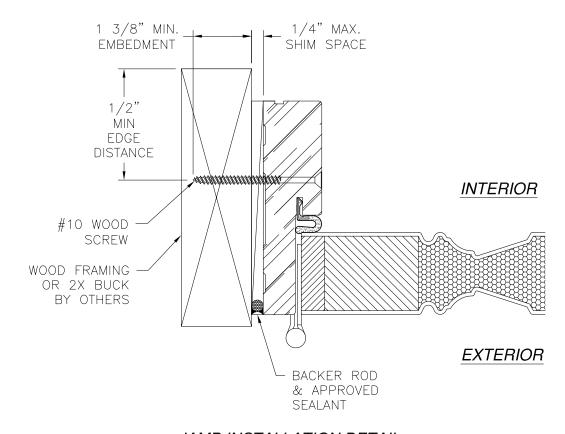

JAMB INSTALLATION DETAIL
WOOD FRAMING OR 2X BUCK INSTALLATION

SIGNED: 01/08/2020

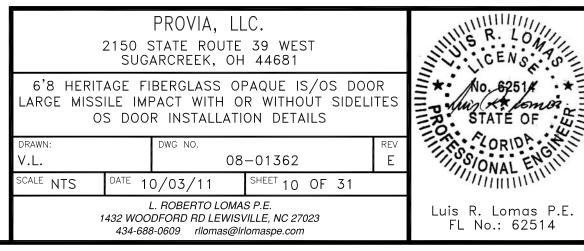

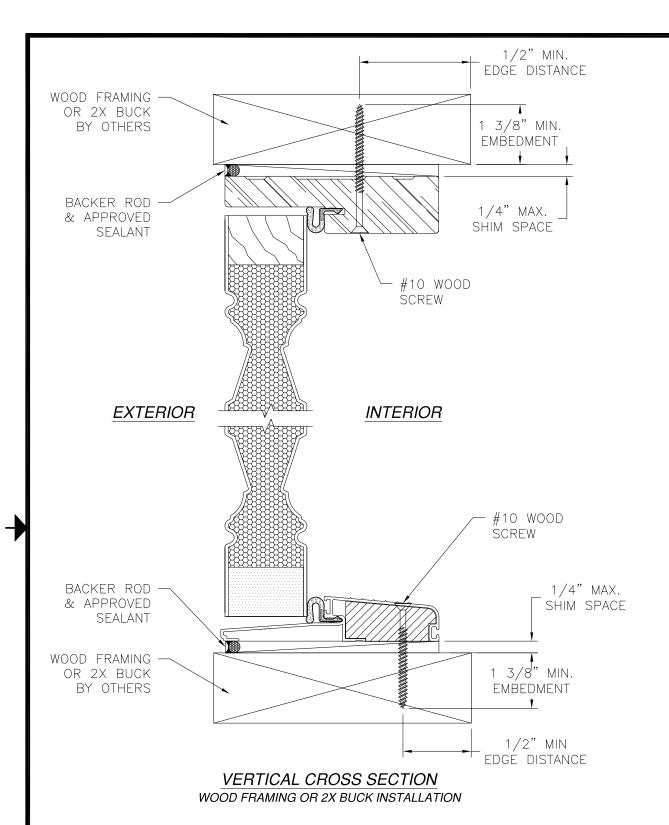



NOTES:

1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS,

NOT SHOWN FOR CLARITY.

2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112



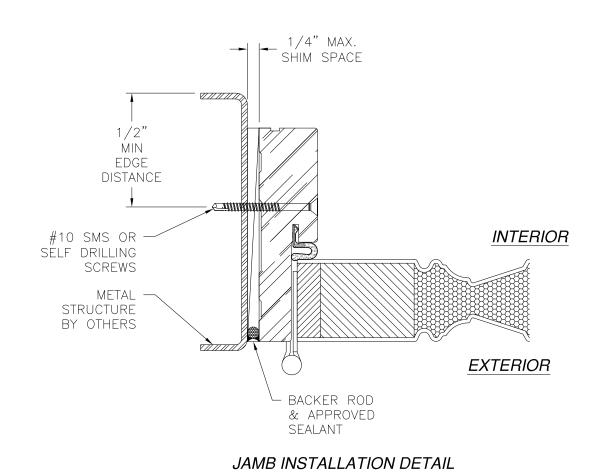


METAL STRUCTURE INSTALLATION

SIGNED: 01/08/2020

Luis R. Lomas P.E.

FL No.: 62514


PROVIA, LLC. 2150 STATE ROUTE 39 WEST SUGARCREEK, OH 44681 REV STATE CORIDA CHILINGS ON AL ENGLISH 6'8 HERITAGE FIBERGLASS OPAQUE IS/OS DOOR LARGE MISSILE IMPACT WITH OR WITHOUT SIDELITES OS DOOR INSTALLATION DETAILS DRAWN: DWG NO. V.L. 08-01362 SCALE NTS DATE 10/03/11 SHEET 11 OF 31 L. ROBERTO LOMAS P.E. 1432 WOODFORD RD LEWISVILLE, NC 27023 434-688-0609 rllomas@lrlomaspe.com

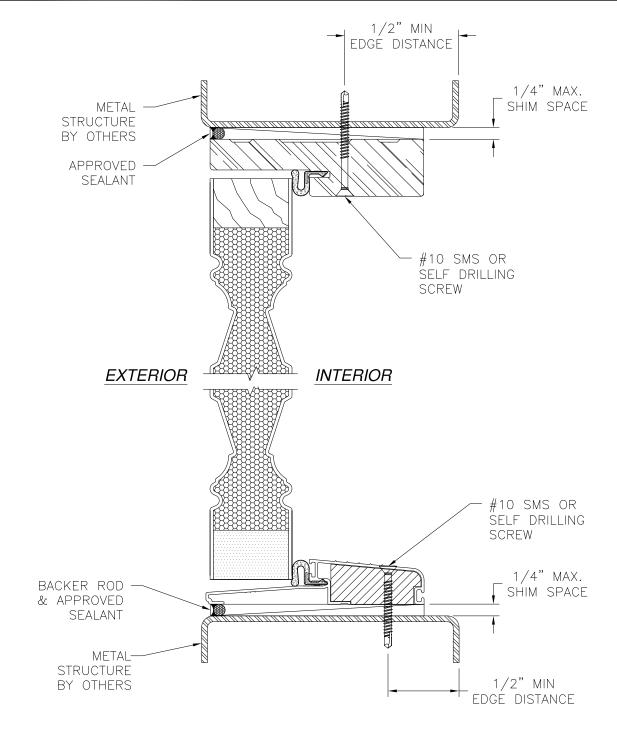


VERTICAL CROSS SECTION METAL STRUCTURE INSTALLATION

NOTES:

- 1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
- 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE
- DESIGNED IN ACCORDANCE WITH ASTM E2112

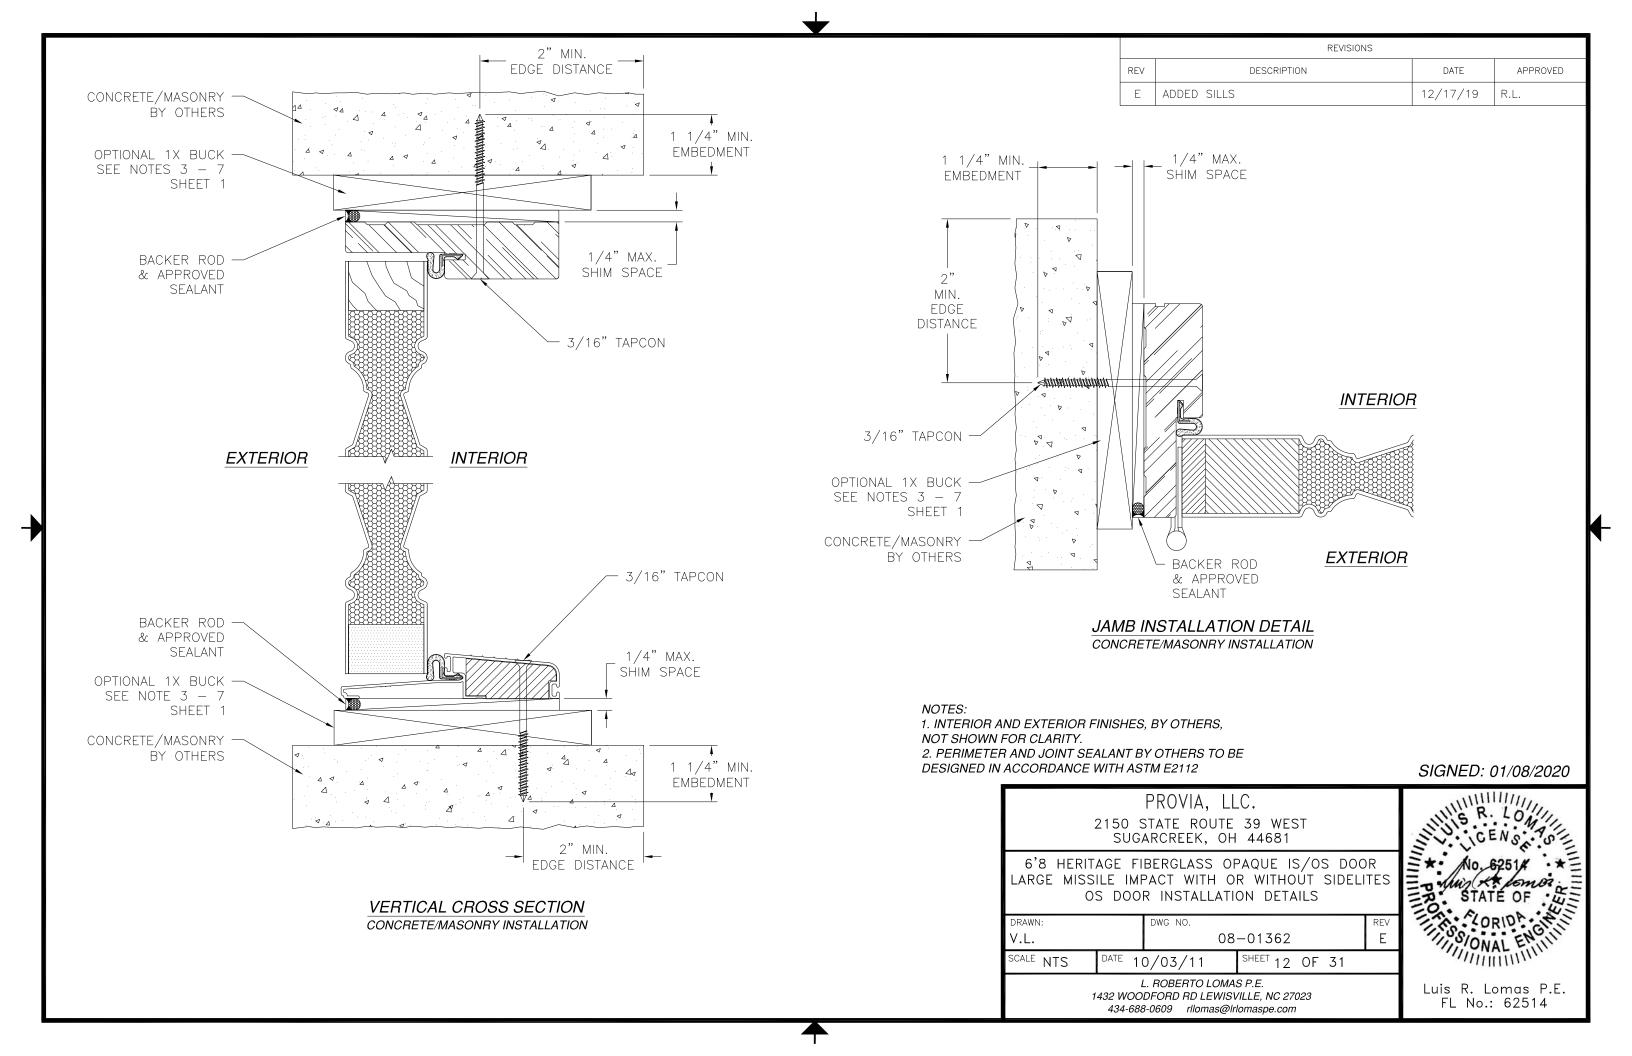


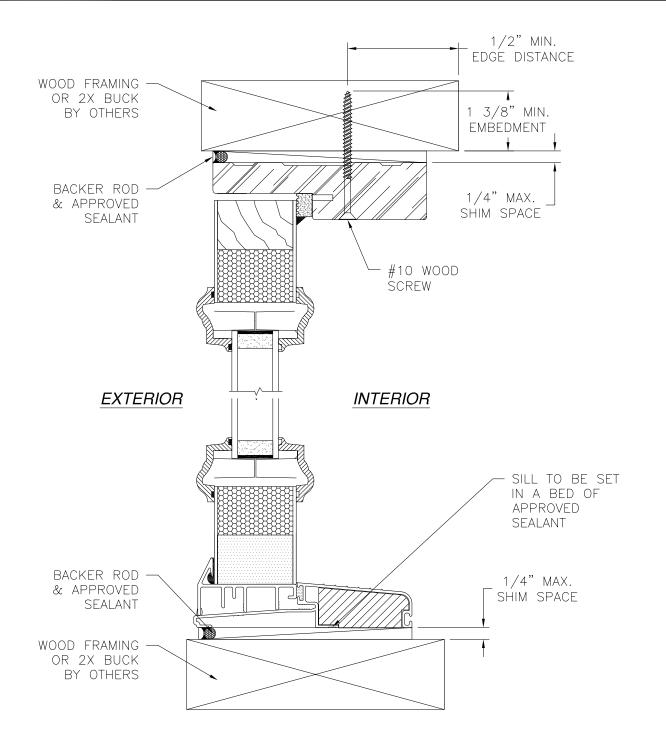

VERTICAL CROSS SECTION WOOD FRAMING OR 2X BUCK INSTALLATION


NOTES: 1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY. 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112


REVISIONS DESCRIPTION APPROVED REV DATE Ε ADDED SILLS 12/17/19 R.L.

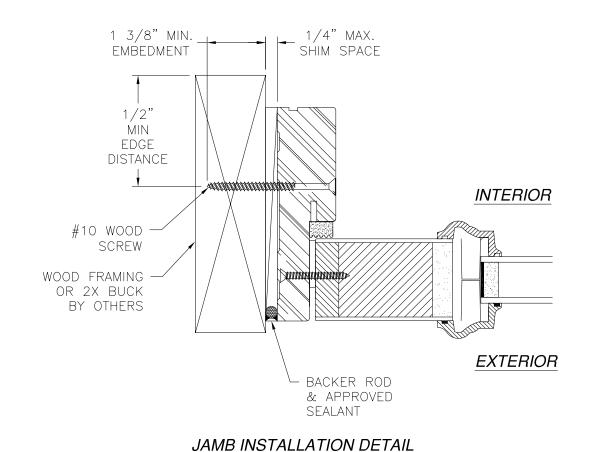


WOOD FRAMING OR 2X BUCK INSTALLATION

SIGNED: 01/08/2020

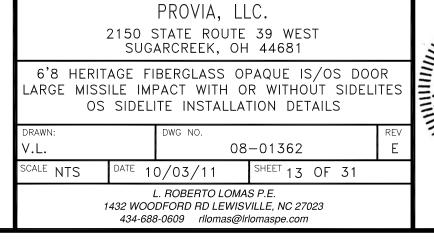



Luis R. Lomas P.E. FL No.: 62514

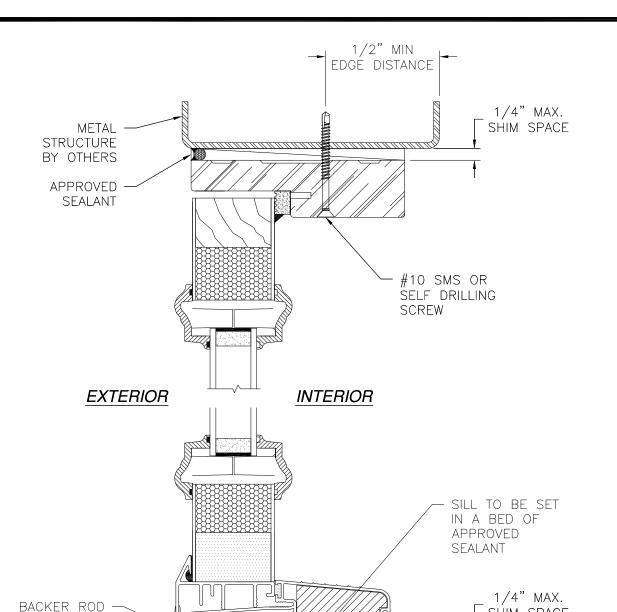

SHIM SPACE

VERTICAL CROSS SECTION METAL STRUCTURE INSTALLATION

NOTES: 1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.


& APPROVED

SEALANT

METAL: STRUCTURE BY OTHERS

2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112


REVISIONS DESCRIPTION APPROVED REV DATE Ε ADDED SILLS 12/17/19 R.L.

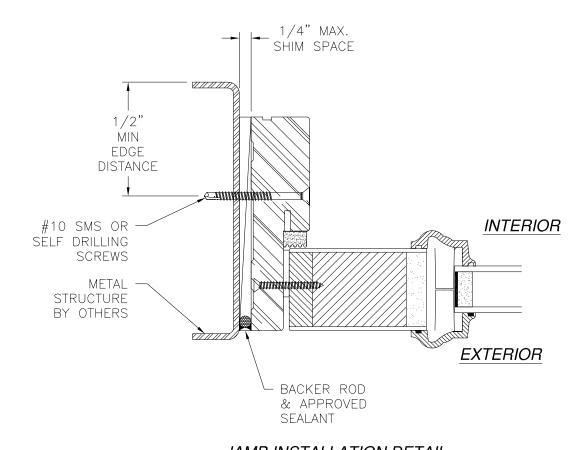


JAMB INSTALLATION DETAIL METAL STRUCTURE INSTALLATION


SIGNED: 01/08/2020





FL No.: 62514

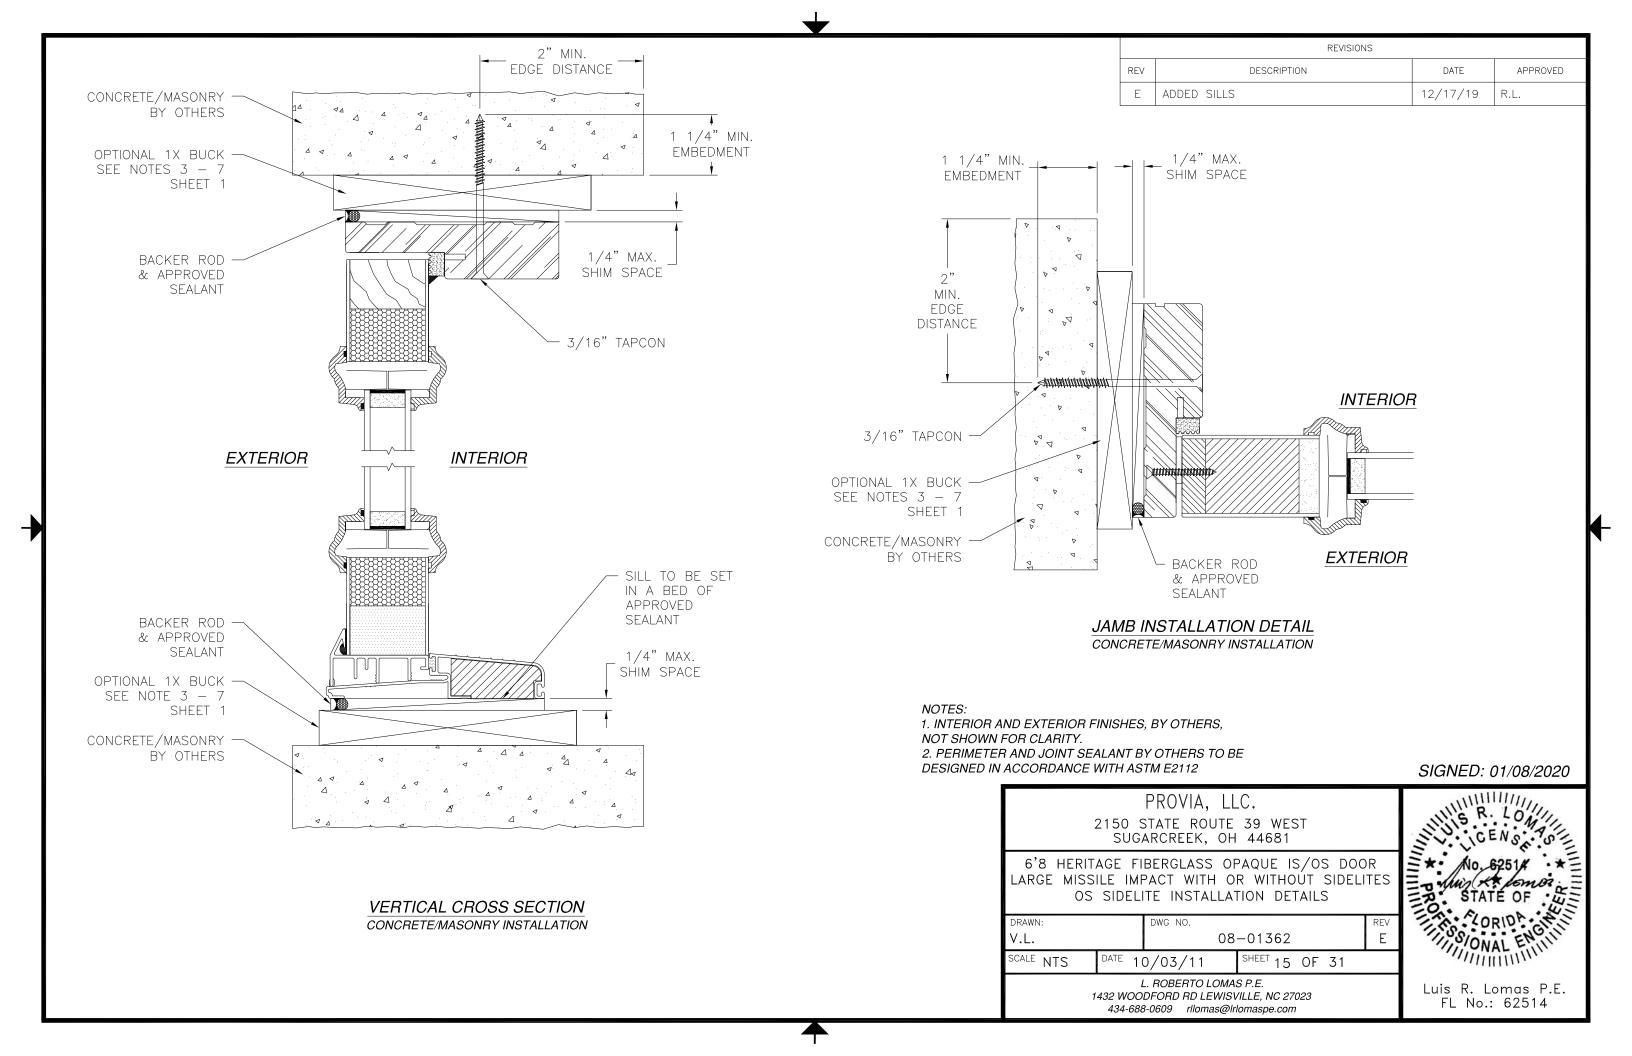

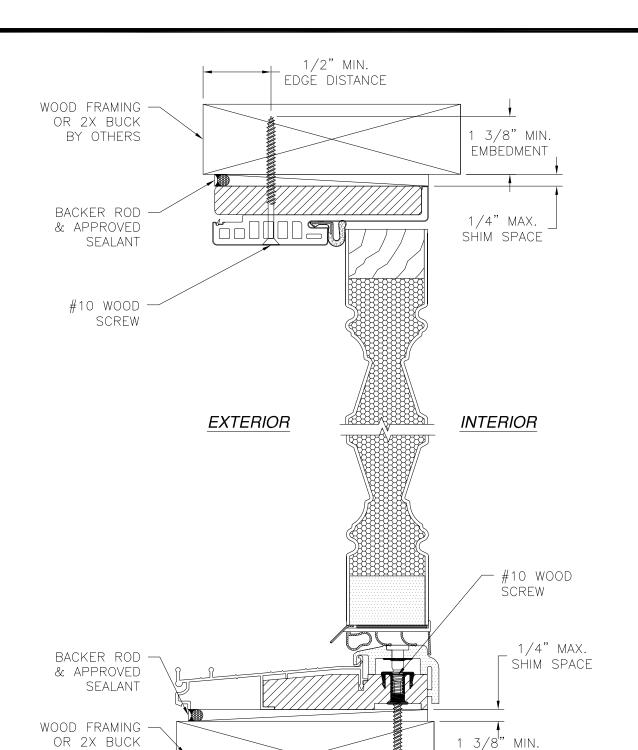

VERTICAL CROSS SECTION
WOOD FRAMING OR 2X BUCK INSTALLATION

EMBEDMENT


1/2" MIN EDGE DISTANCE

BY OTHERS

REVISIONS

REV DESCRIPTION DATE APPROVED

E ADDED SILLS 12/17/19 R.L.

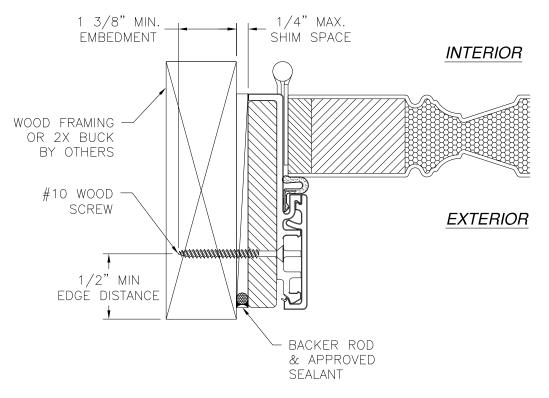


JAMB INSTALLATION DETAIL WOOD FRAMING OR 2X BUCK INSTALLATION


NOTES:


- 1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY. 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE
- DESIGNED IN ACCORDANCE WITH ASTM E2112

SIGNED: 01/08/2020

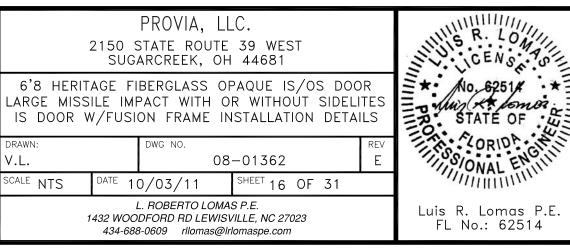

—



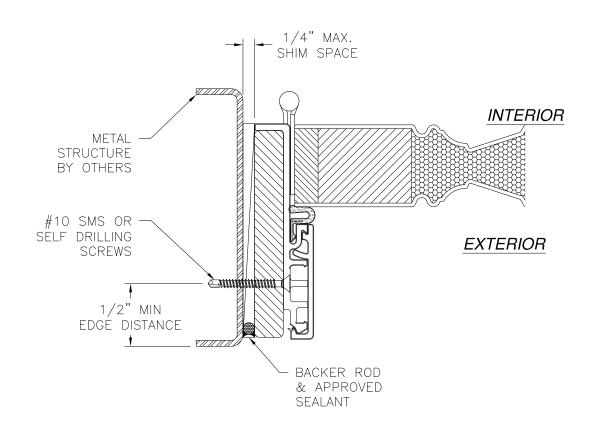


JAMB INSTALLATION DETAIL
METAL STRUCTURE INSTALLATION


NOTES:

1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY. 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE

DESIGNED IN ACCORDANCE WITH ASTM E2112


SIGNED: 01/08/2020

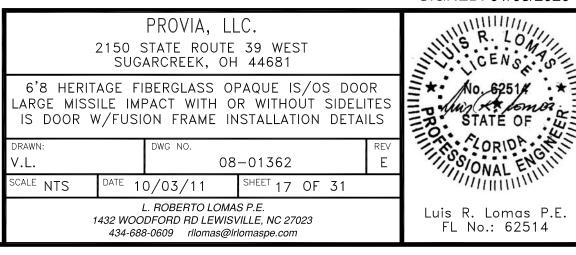


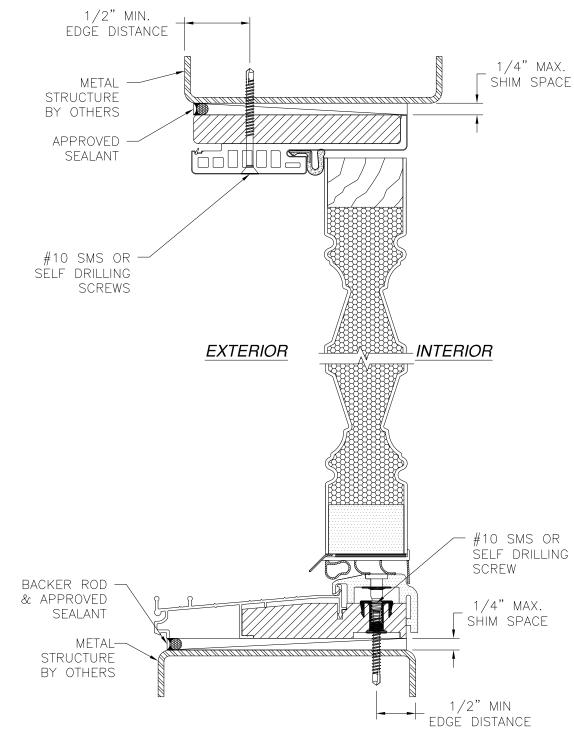

VERTICAL CROSS SECTION

METAL STRUCTURE INSTALLATION

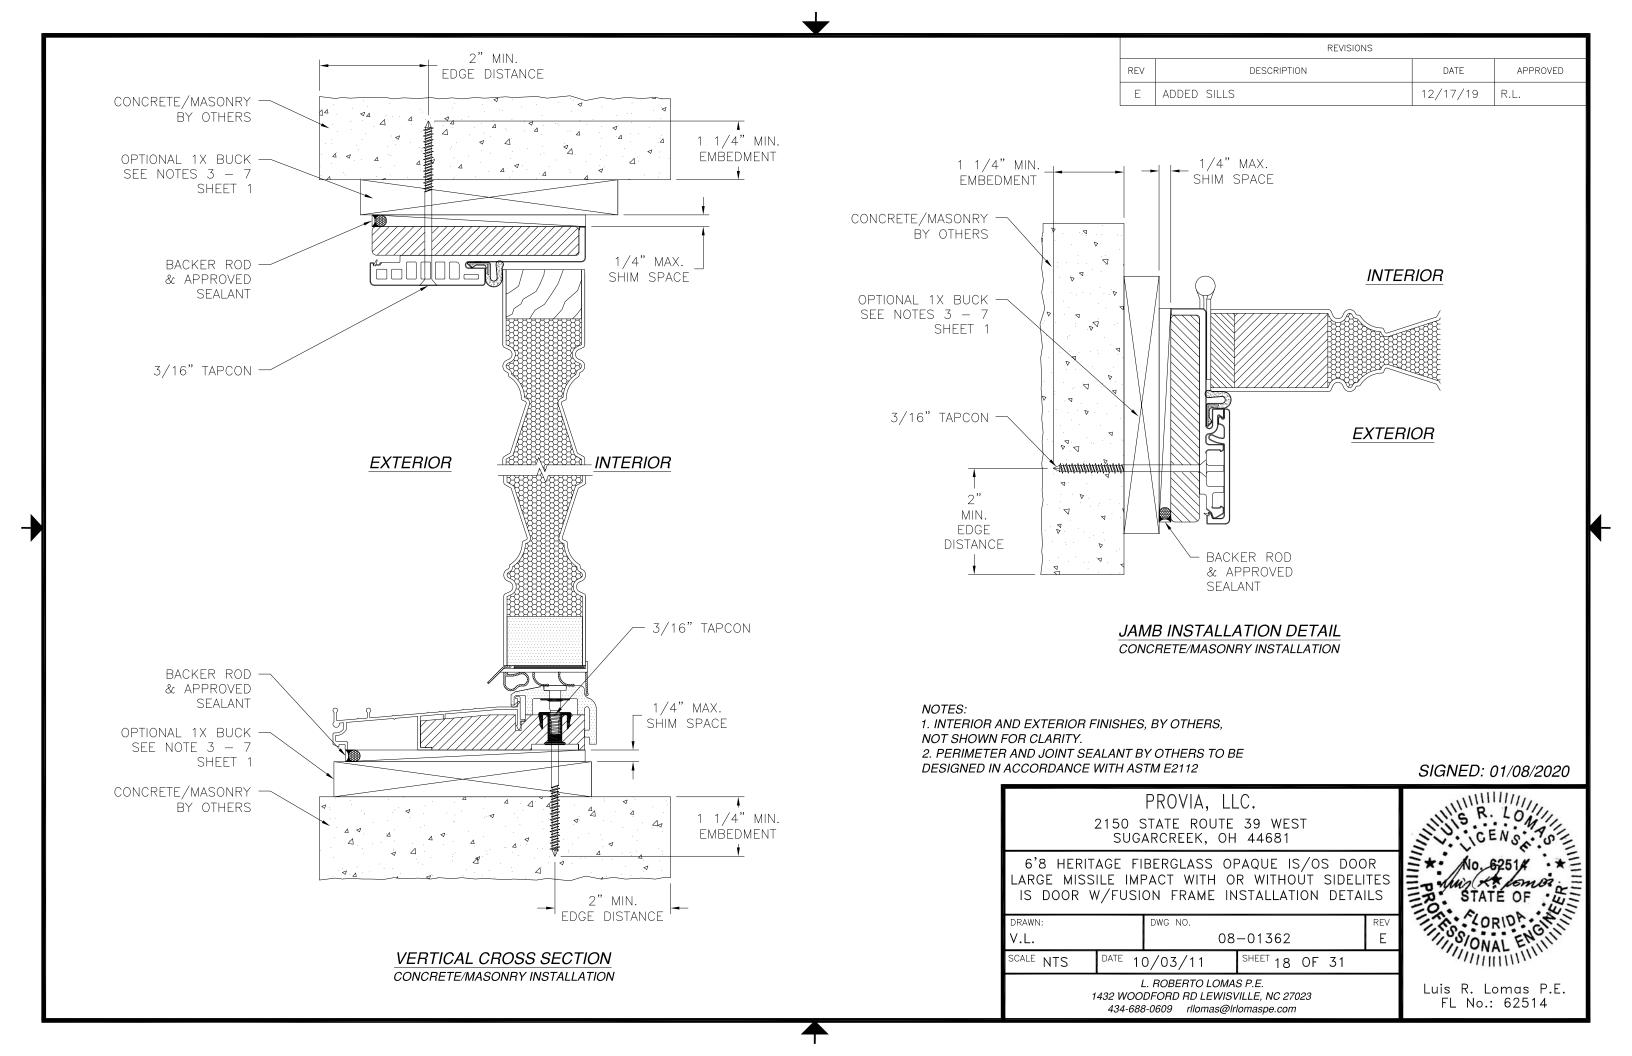

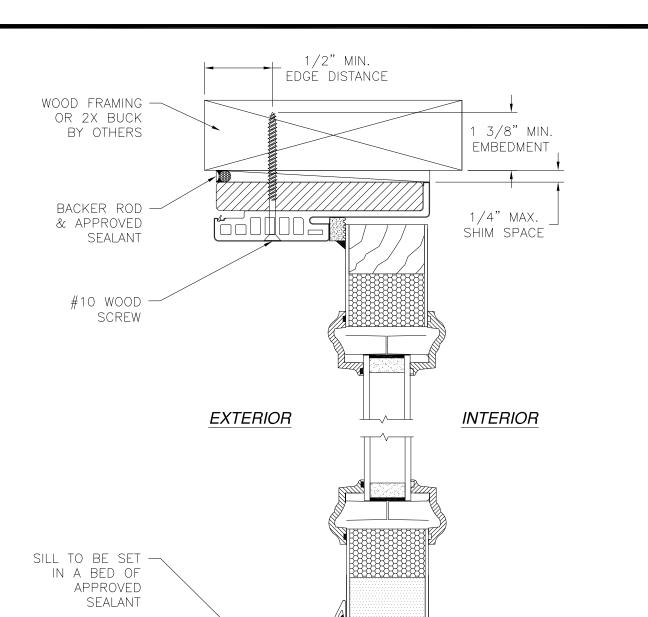

VERTICAL CROSS SECTION
WOOD FRAMING OR 2X BUCK INSTALLATION

BACKER ROD

& APPROVED SEALANT

WOOD FRAMING


OR 2X BUCK

BY OTHERS

REVISIONS

REV DESCRIPTION DATE APPROVED

E ADDED SILLS 12/17/19 R.L.

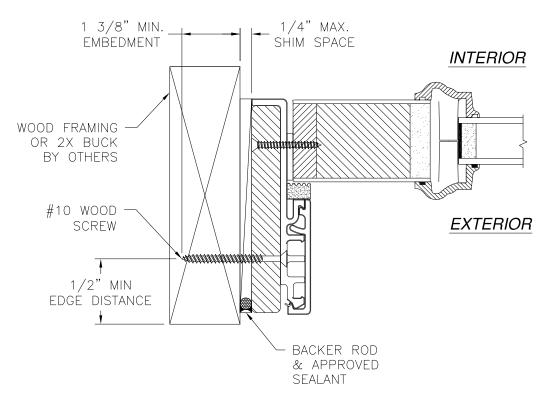

JAMB INSTALLATION DETAIL WOOD FRAMING OR 2X BUCK INSTALLATION

NOTES:


- 1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
- 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112


SIGNED: 01/08/2020



1/4" MAX.

SHIM SPACE



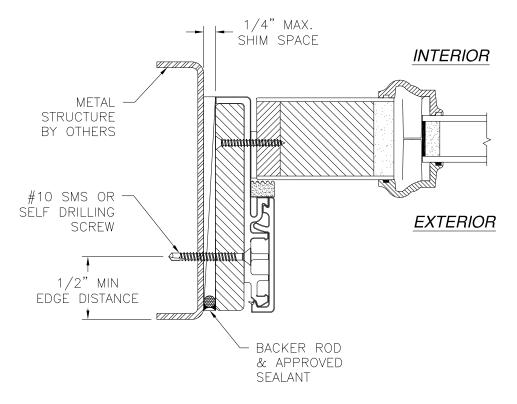



JAMB INSTALLATION DETAIL METAL STRUCTURE INSTALLATION

NOTES:

- 1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
- 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112


SIGNED: 01/08/2020

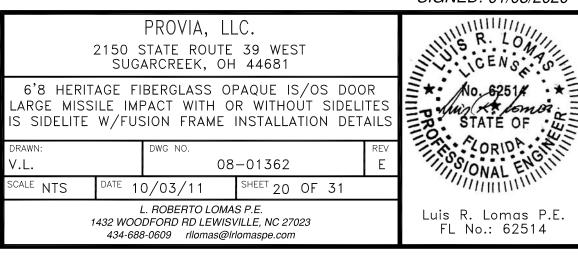

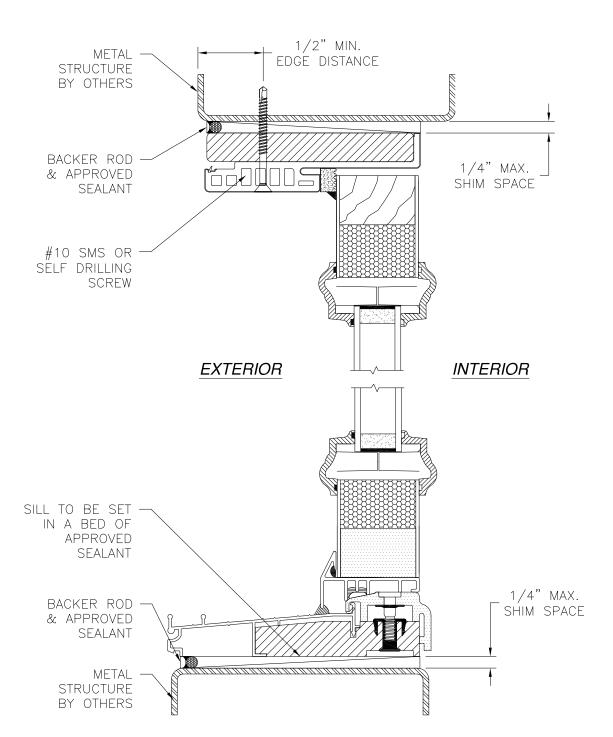

VERTICAL CROSS SECTION


METAL STRUCTURE INSTALLATION

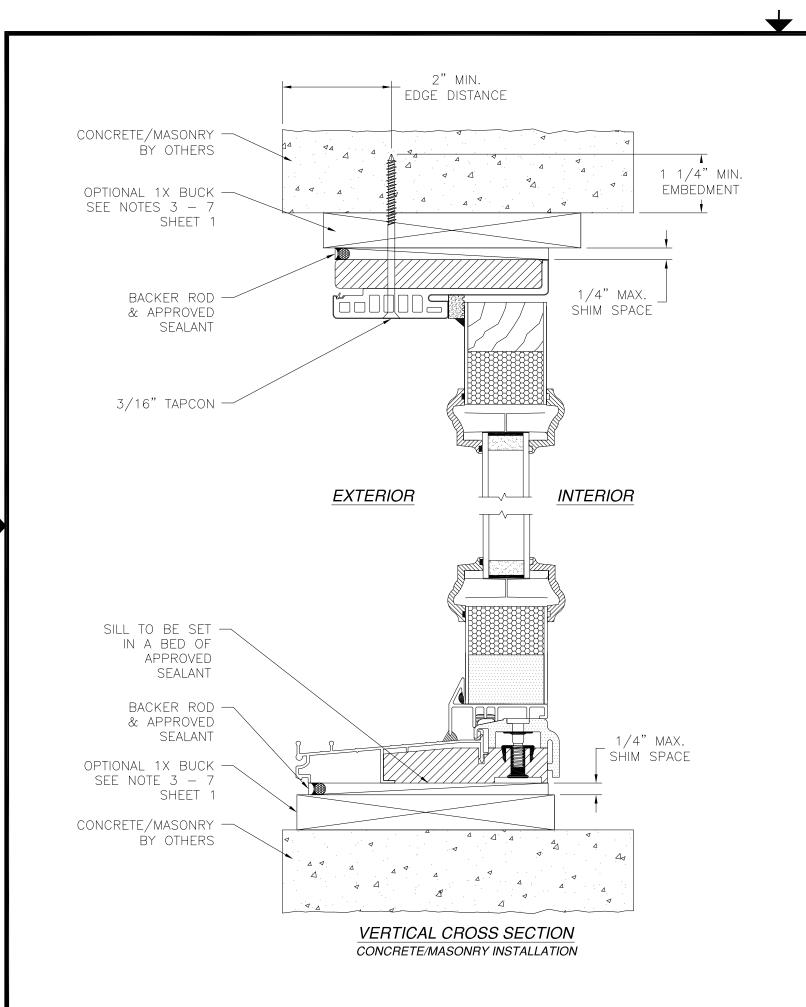

REVISIONS

REV DESCRIPTION DATE APPROVED

E ADDED SILLS 12/17/19 R.L.

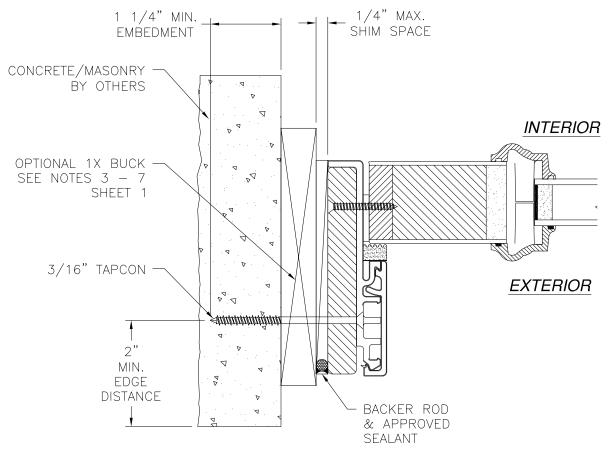


JAMB INSTALLATION DETAIL CONCRETE/MASONRY INSTALLATION


NOTES:


- 1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY. 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE
- DESIGNED IN ACCORDANCE WITH ASTM E2112

SIGNED: 01/08/2020

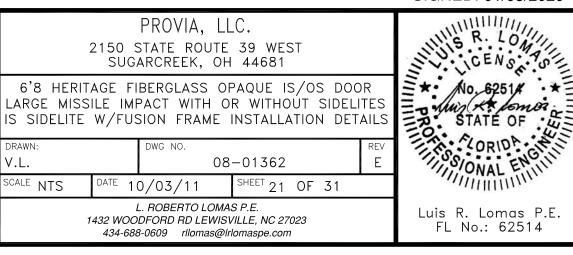

Ŧ



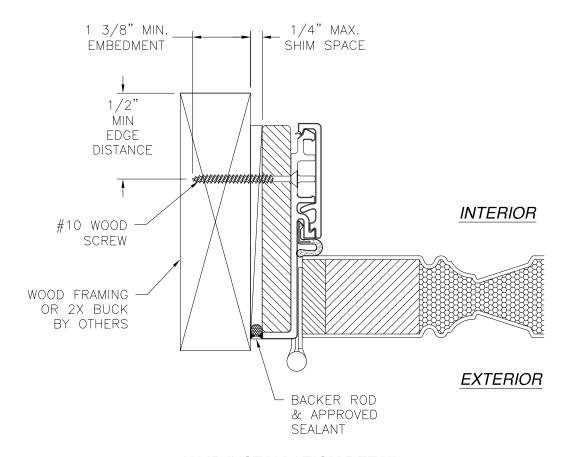



JAMB INSTALLATION DETAIL WOOD FRAMING OR 2X BUCK INSTALLATION


NOTES:

1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY. 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

SIGNED: 01/08/2020

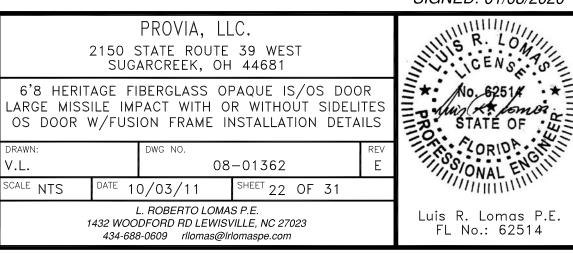

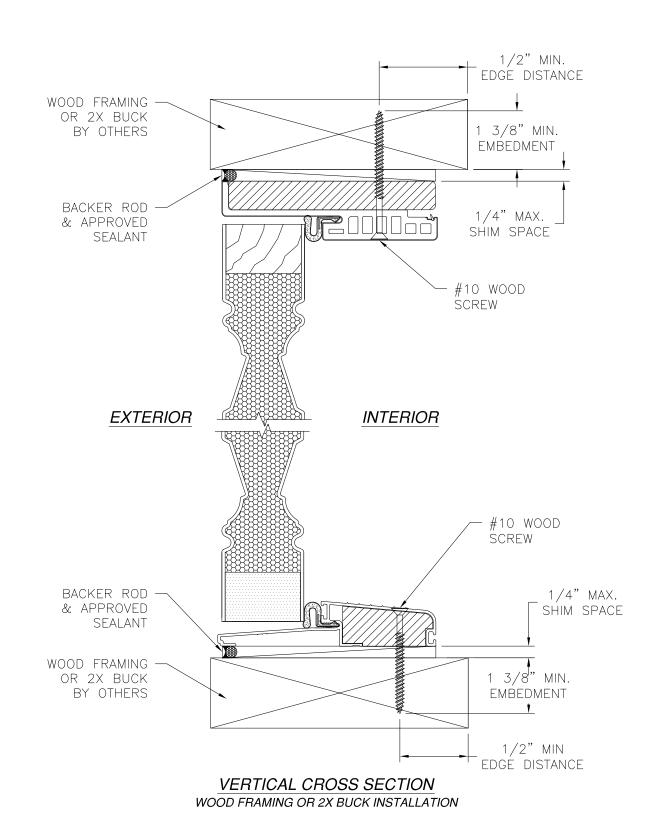

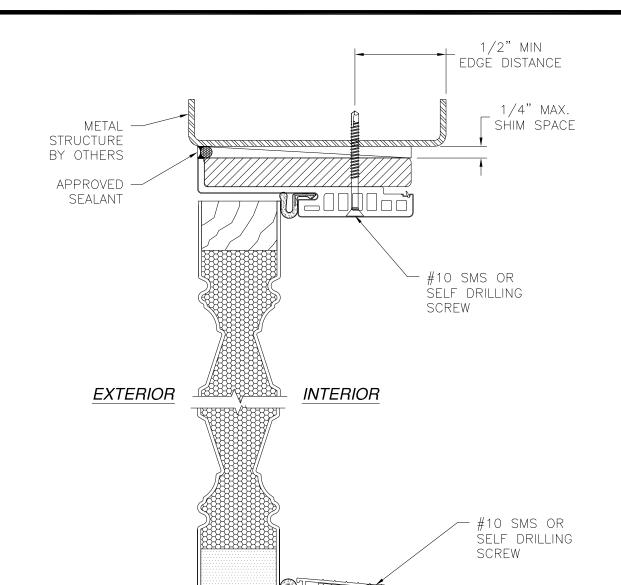

VERTICAL CROSS SECTION

METAL STRUCTURE INSTALLATION

BACKER ROD


& APPROVED

SEALANT

BY OTHERS

METAL-STRUCTURE

		REVISIONS					
	REV	DESCRIPTION	DATE	APPROVED			
	E	ADDED SILLS	12/17/19	R.L.			

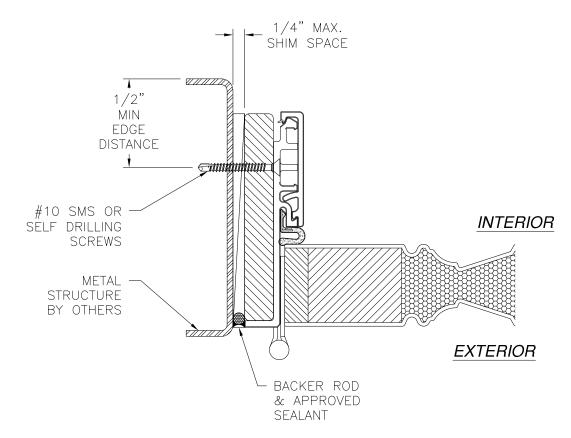


JAMB INSTALLATION DETAIL METAL STRUCTURE INSTALLATION

NOTES:

- 1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
- 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

SIGNED: 01/08/2020

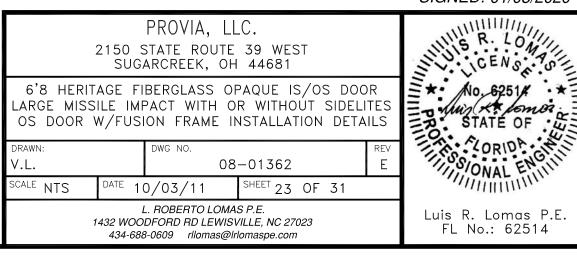


—

1/4" MAX.

SHIM SPACE

1/2" MIN


EDGE DISTANCE

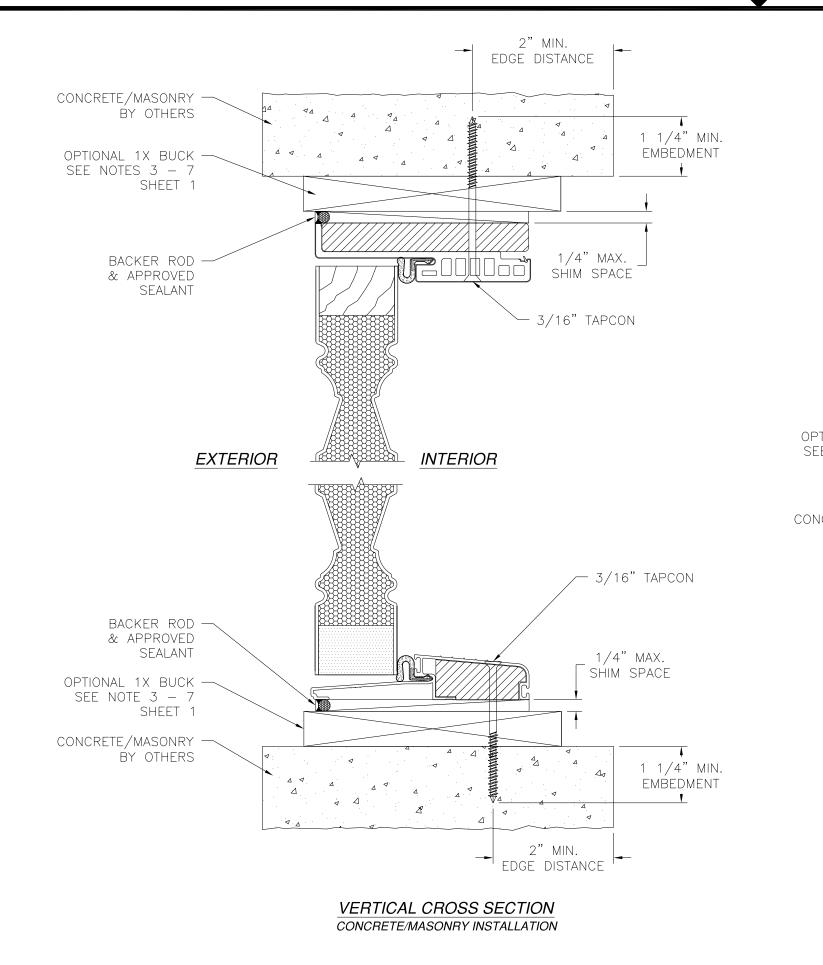

REVISIONS

REV DESCRIPTION DATE APPROVED

E ADDED SILLS 12/17/19 R.L.

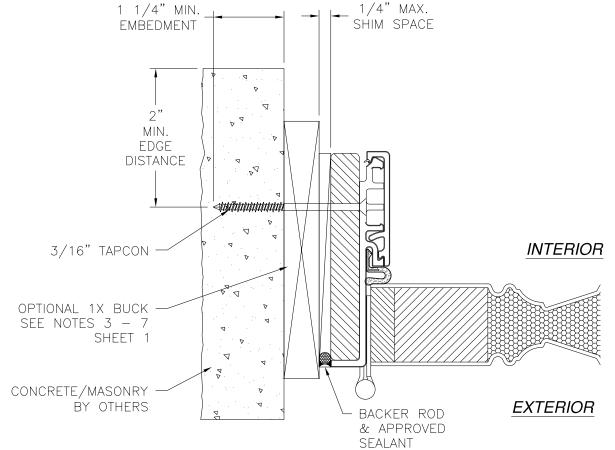


JAMB INSTALLATION DETAIL CONCRETE/MASONRY INSTALLATION


NOTES:

1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY. 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE

DESIGNED IN ACCORDANCE WITH ASTM E2112

SIGNED: 01/08/2020

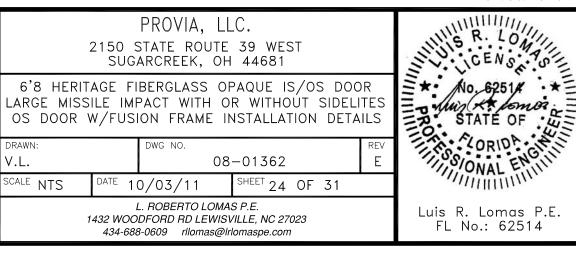


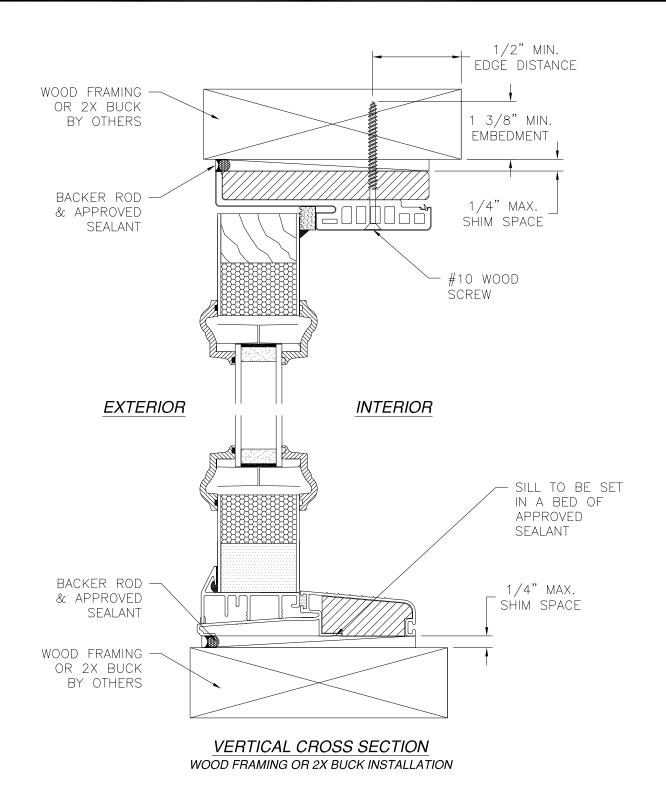

REVISIONS

REV DESCRIPTION DATE APPROVED

E ADDED SILLS 12/17/19 R.L.

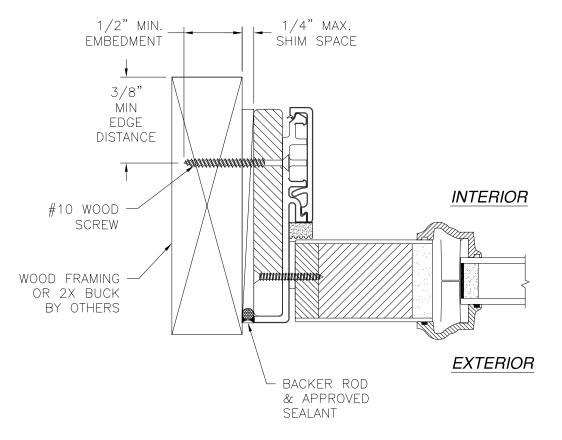



JAMB INSTALLATION DETAIL WOOD FRAMING OR 2X BUCK INSTALLATION

NOTES:

- 1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY. 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE
- DESIGNED IN ACCORDANCE WITH ASTM E2112

SIGNED: 01/08/2020

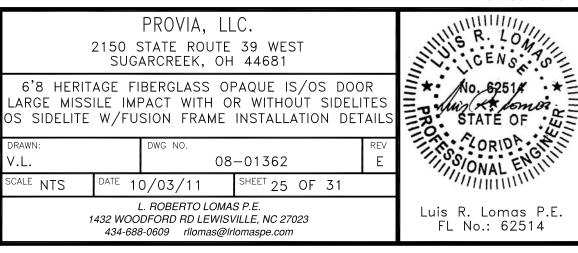

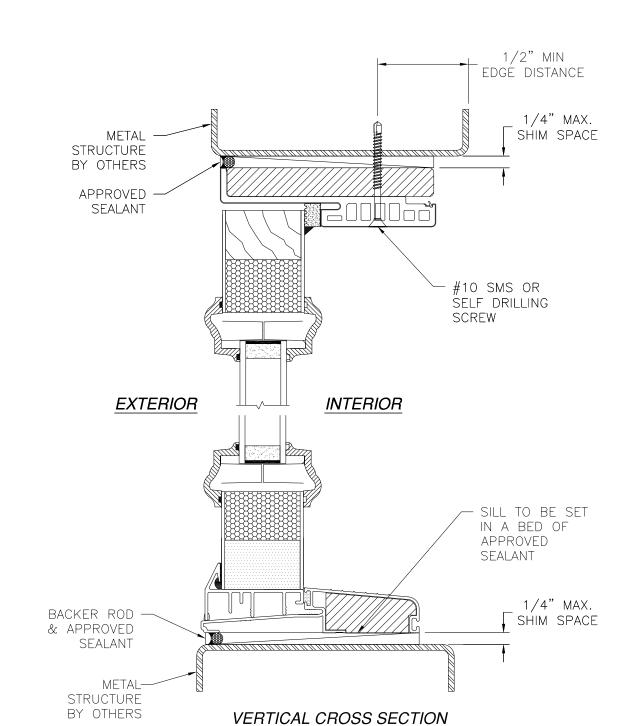


METAL STRUCTURE INSTALLATION

REVISIONS

REV DESCRIPTION DATE APPROVED

E ADDED SILLS 12/17/19 R.L.

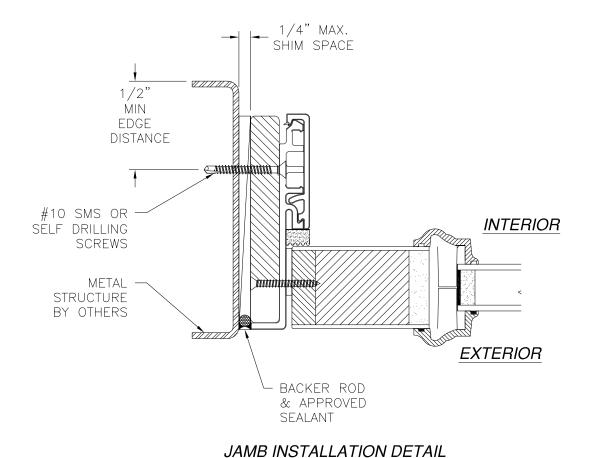

METAL STRUCTURE INSTALLATION


- NOTES:


 1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS,
 NOT SHOWN FOR CLARITY.

 2. PERIMETER AND JOINT SEALANT BY OTHERS TO
- 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112


SIGNED: 01/08/2020



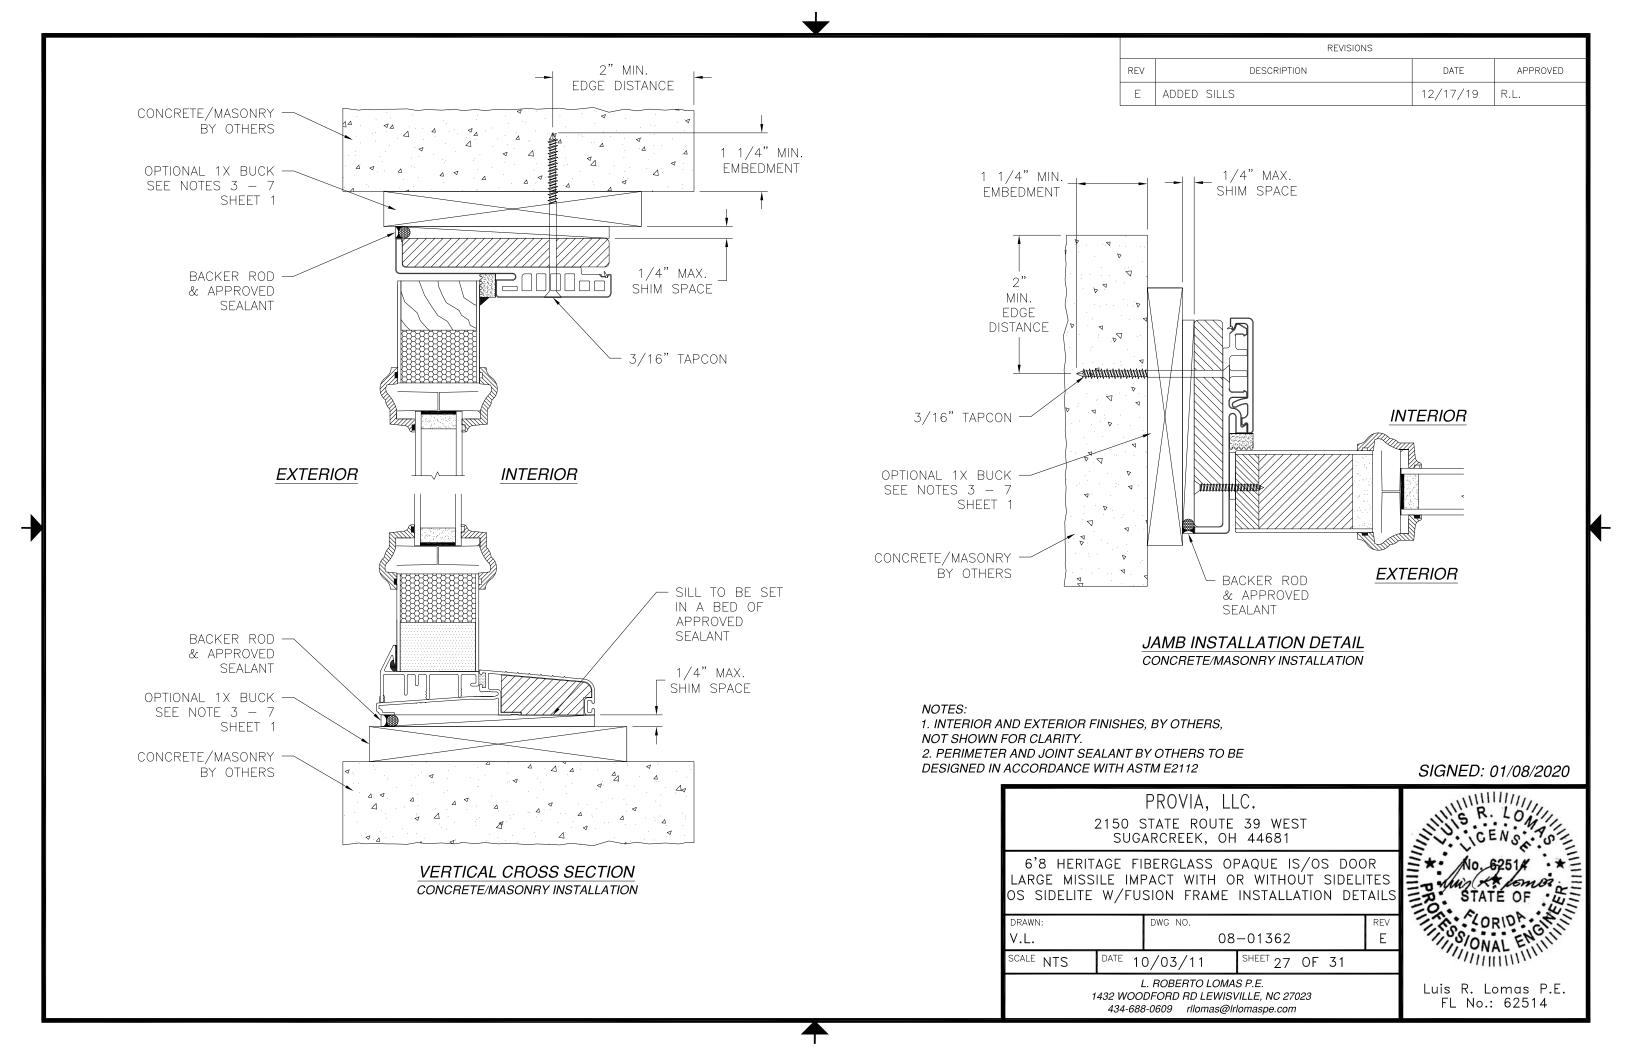

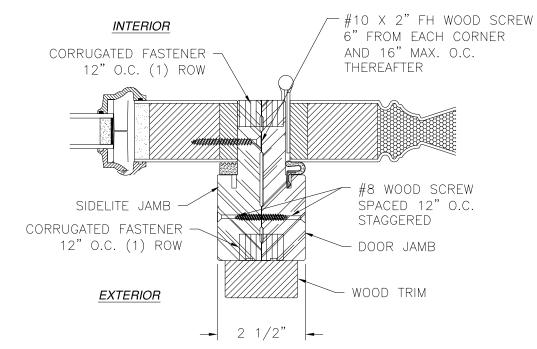



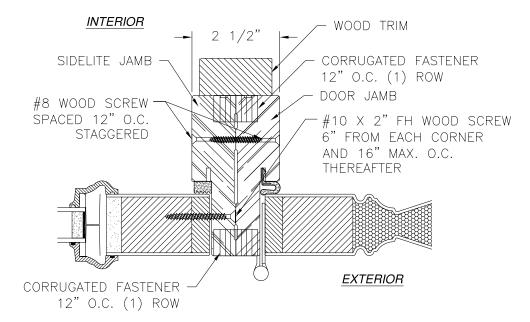


OUTSWING MULLION DETAIL
STANDARD FRAME SHOWN,
COMPOSITE AND FUSION FRAME SIMILAR


REVISIONS


REV DESCRIPTION DATE APPROVED

E ADDED SILLS 12/17/19 R.L.

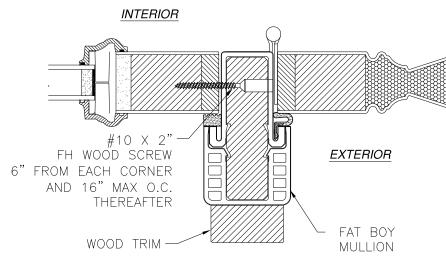


INSWING MULLION DETAIL
WITH HYBRID FAT BOY MULLION

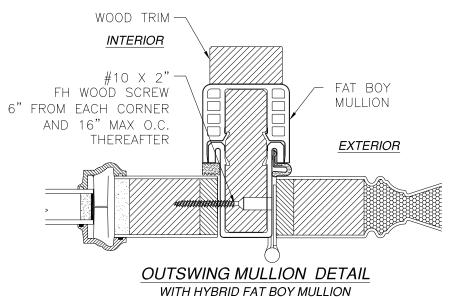

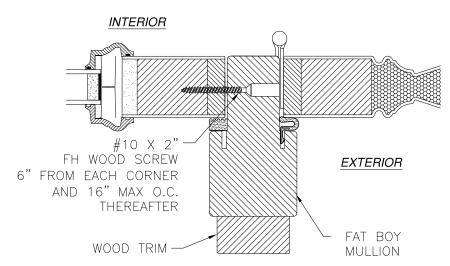

INSWING MULLION DETAIL
WITH FAT BOY MULLION

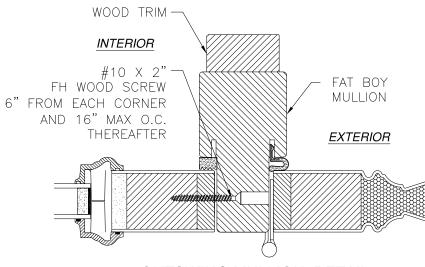

OUTSWING MULLION DETAIL
WITH FAT BOY MULLION

SIGNED: 01/08/2020



6'8 HERITAGE FIBERGLASS OPAQUE IS/OS DOOR LARGE MISSILE IMPACT WITH OR WITHOUT SIDELITES MULLION INSTALLATION DETAILS


DRAWN: DWG NO. REV V.L. 08-01362 E

SCALE NTS DATE 10/03/11 SHEET 28 OF 31


L. ROBERTO LOMAS P.E. 1432 WOODFORD RD LEWISVILLE, NC 27023 434-688-0609 rllomas@lrlomaspe.com




Luis R. Lomas P.E. FL No.: 62514



ASTRAGAL HEAD STRIKE DETAIL 2X BUCK/WOOD FRAMING




ASTRAGAL HEAD STRIKE DETAIL MASONRY/CONCRETE




ASTRAGAL BOLT HOLE MUST BE DRILLED THROUGH SILL AND INTO SUBSTRATE DEEP ENOUGH TO ACHIEVE 1 3/8" THROW


ASTRAGAL SILL DETAIL




HURRICANE ASTRAGAL DETAIL

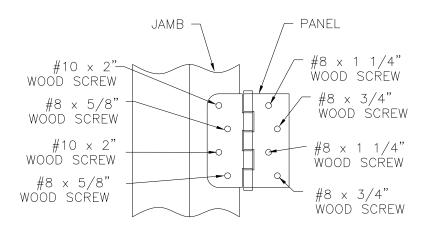

HINGE INSTALLATION DETAIL 2X BUCK/WOOD FRAMING

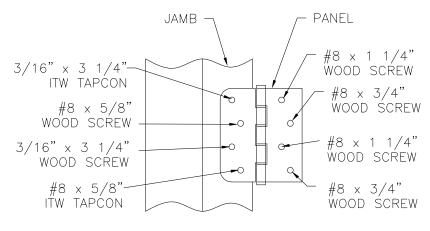

HINGE INSTALLATION DETAIL MASONRY/CONCRETE

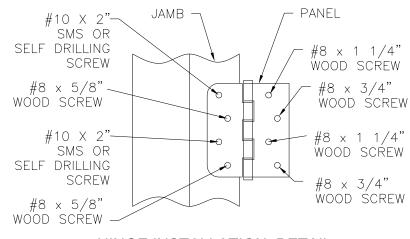

HINGE INSTALLATION DETAIL METAL STRUCTURE

REVISIONS DESCRIPTION REV DATE APPROVED Ε ADDED SILLS 12/17/19 R.L.


SIGNED: 01/08/2020

PROVIA, LLC. 2150 STATE ROUTE 39 WEST SUGARCREEK, OH 44681


6'8 HERITAGE FIBERGLASS OPAQUE IS/OS DOOR LARGE MISSILE IMPACT WITH OR WITHOUT SIDELITES ASTRAGAL AND HINGES INSTALLATION DETAILS

DRAWN: DWG NO. V.L. 08-01362 SCALE NTS DATE 10/03/11 SHEET 29 OF 31 L. ROBERTO LOMAS P.E.

1432 WOODFORD RD LEWISVILLE, NC 27023 434-688-0609 rllomas@lrlomaspe.com



Luis R. Lomas P.E. FL No.: 62514

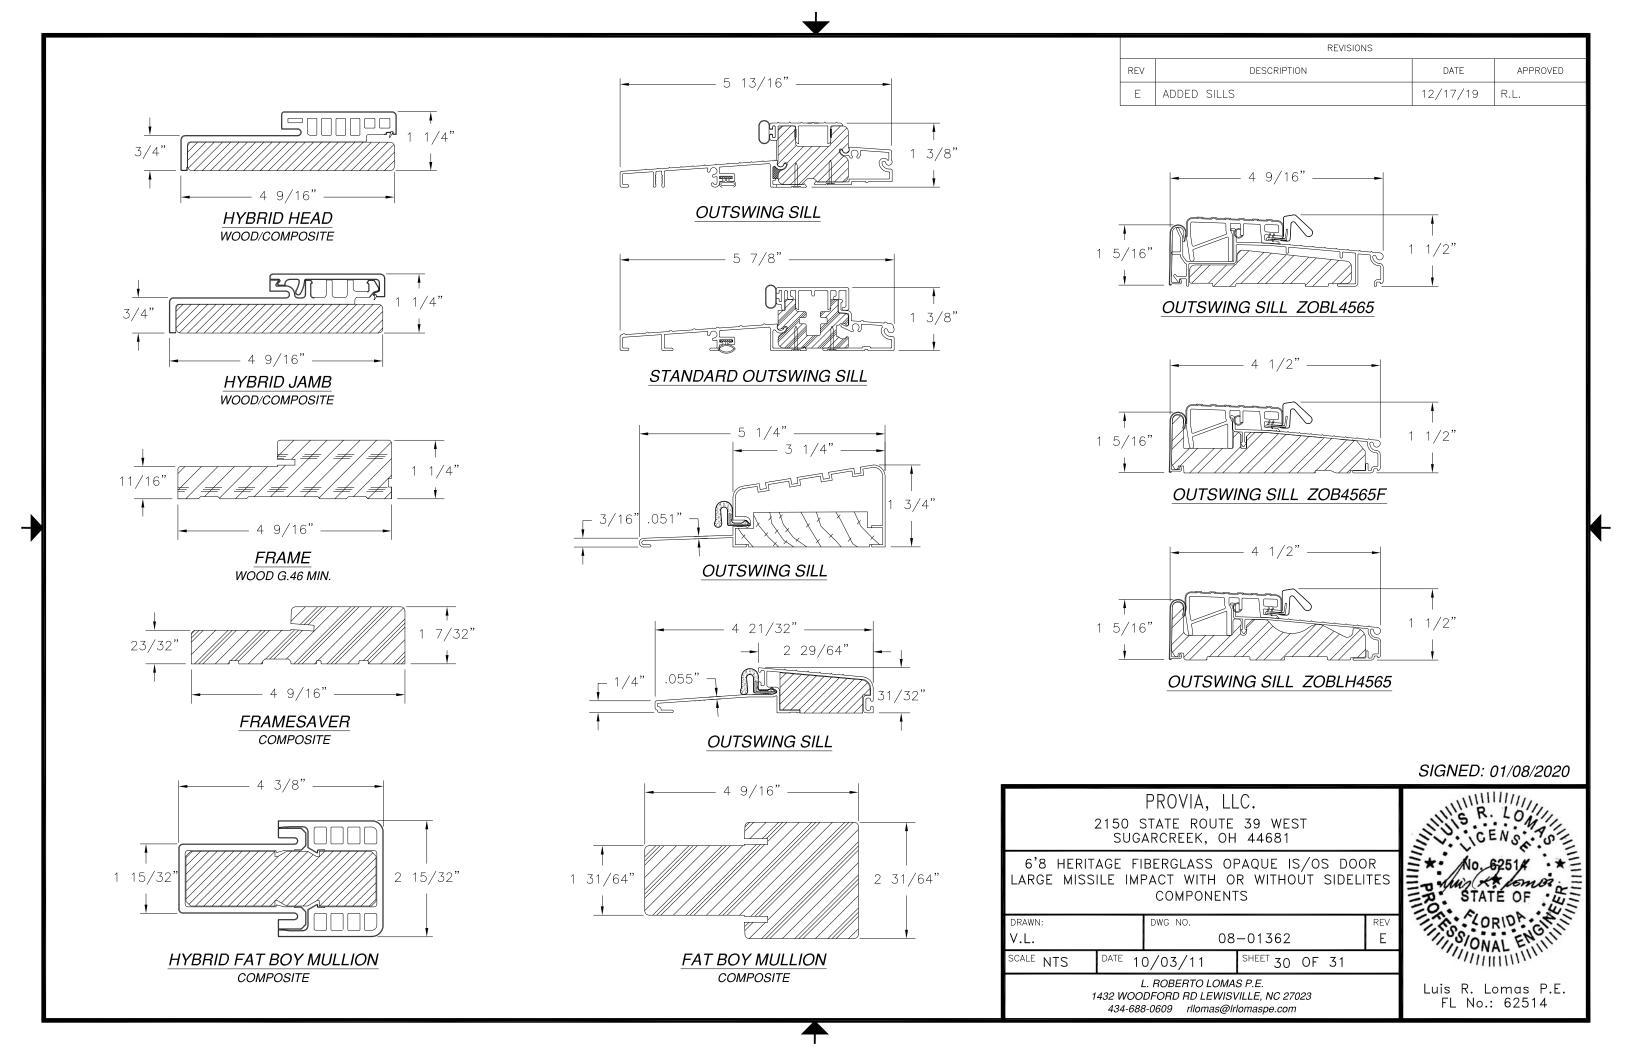

		REVISIONS					
	REV	DESCRIPTION	DATE	APPROVED			
	Е	ADDED SILLS	12/17/19	R.L.			

