


# THRU JAMB INSTALLATION

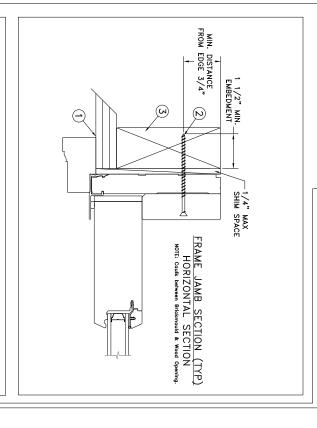

95 1/4" × 36"	Max Frame	WIDE STILE SLIDING
+/-65	DP	DOOR
NO	IMPACT	TRANSOM

## Installation Notes:


- Seal flange/frame to substrate.


  Use #8 PH or greater fastener through the frame with sufficient length to penetrate a minimum of 1 1/2" into the wood framing. For 2x wood frame substrate (min. S.G. = 0.42)
- ယ project of installation. Host structure (wood buck, masonry, steel) to be designed and anchored to properly transfer all loads to the structure. The host structure is the responsibility of the architect or engineer of record for the

### General Notes

- of the adopted International Building Code (IBC), the International Residential Code (IRC), the Florida Building Code (FBC) and the industry requirement for the stated conditions. The product shown herein is designed, tested and manufactured to comply with the wind load criteria
- αω4 All glazing shall conform to ASTM E1300.
  - At minimum, glazing is 3.1mm tempered 13.0mm airspace 3.1mm tempered glass
- Use structural or composite shims where required

DISCLAIMER: This drawing and its contents are confidential and are not to be reproduced or copied in whole or in part or used or disclosed to others except as authorized by JELD-WEN Inc.			window or go to www.jeld-wen.com/resources/installation.	complete installation procedure, see the instructions packaged with the	consideration that may arise in different wall conditions. For the	(where applicable) up to the size initiations hoted. It is not intended as	window to achieve the rated design pressure and impact performance	This schedule addresses only the fasteners required to anchor the			
T/ 21/ 10 (A)	1/21/16 (1)										
1/21/10 (A) obudie i disolii cel illication liito new ioniidi.	Indito transport of the post format										REVISION
ī	IDENTIFIER No.	D004573	PART/PROJECT No.:	D.STOKES	APPROVED BY:	C.GRAETSCH	CHECKED BY:	J.HAWKINS	DRAWN BY		PROJECT ENGINEER:
Rantoul-IL	PLANT NAME AND LOCATION				Siteline		TITLE	NTS	SCALE:	1/21/16	DATE:
SitelineWDSLDR TRAN Cert		Siteline Wood Wide Stile Sliding Patio Door Transom Thru Jamb Installation (95x36)					JELISWEN KLAMATH FALLS OR, 97601 PHONE: (800) 535-3936				

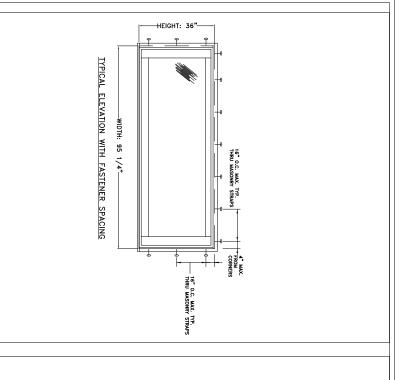

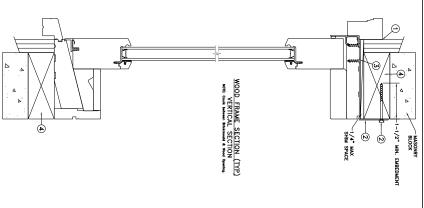

MASONR' BLOCK

4

# 1-1/2" MIN. EMBEDMENT 4 -1/4" MAX SHIM SPACE

MASONRY INSTALLATION



FRAME JAMB SECTION (TYP)
HORIZONTAL SECTION
NOTE: Caulk between Brickmould & Wood Opening.

## Installation Notes:

- 1 1/2" into the masonry or buck. For concrete (min. fc = 3000 psi) or masonry substrate (CMU shall Seal flange/frame to substrate.

  Use #8 PFH or larger fasteners through masonry strap with sufficient length to penetrate a minimum of adhere to ASTM C90)
- ယ into product causing visability or collateral damage to product. Use #8 PFH or larger fasteners through masonry strap into jamb without penetrating through the jamb
- project of installation. Host structure (wood buck, masonry, steel) to be designed and anchored to properly transfer all loads to the structure. The host structure is the responsibility of the architect or engineer of record for the

#### General Notes

- the adopted International Building Code (IBC), the International Residential Code (IRC), the Florida The product shown herein is designed, tested and manufactured to comply with the wind load criteria of Building Code (FBC) and the industry requirement for the stated conditions.
- All glazing shall conform to ASTM E1300.

0 2 4

- At minimum, glazing is 3.1mm tempered 13.0mm airspace 3.1mm tempered glass
- Use structural or composite shims where required

except as authorized by JELD-WEN Inc. 1/21/1	This schedule addresses only the fasteners required to anchor the window to achieve the rated design pressure and impact performance (where applicable) up to the size limitations noted. It is not intended as a guide to the installation process and does not address he sealing consideration that may arise in different wall conditions. For the complete installation procedure, see the instructions packaged with the window or go to www.jeld-wen.com/resources/installation.						
1/21/16 (A) Updated transom certification into new format.							REVISION
IDENTIFIER No.	D004573	D.STOKES	APPROVED BY:	C.GRAETSCH	CHECKED BY:	J.HAWKINS	PROJECT ENGINEER:
Rantoul-IL			Siteline	) F	TITLE	SCALE: NTS	DATE: 1/21/16
ION: CAD DWG, No.: REV: A SHEET	Siteline Wood Wide Stile Sliding Patio Door Transom Masonry Installation (95x36)					PHONE: (800) 535-3936	IFI TAVEN 3737 LAKEPORT BLVD.