

**NAIL FIN INSTALLATION**

<b>Max Frame</b>	<b>DP RATING IMPACT</b>
<b>36 x 72</b>	<b>+50/-55 NO</b>

- Installation Notes:**
1. Seal flange/frame to substrate.
  2. Use #8 PH or greater fastener through the nail fin with sufficient length to penetrate a minimum of 1" into the wood framing. For 2X wood frame substrate (min. S.G. = 0.42).
  3. Host structure (wood buck, masonry, steel) to be designed and anchored to properly transfer all loads to the structure. The host structure is the responsibility of the architect or engineer of record for the project of installation.

- General Notes:**
1. The product shown herein is designed, tested and manufactured to comply with the wind load criteria of the adopted International Building Code(IBC), the International Residential Code(IRC), the Florida Building Code(FBC) and the industry requirement for the stated conditions.
  2. All glazing shall conform to ASTM E1300.
  3. At minimum, glazing shall be 3/32" annealed - 3/32" annealed insulating glass.
  4. Use structural or composite shims where required.
  5. An impact protective system is required where wind borne debris protection is mandated by local building code.
  6. Maximum sizes are buck sizes and do not include fin or flange.




This schedule addresses only the fasteners required to anchor the window to achieve the rated design pressure up to the size limitations noted. It is not intended as a guide to the installation process and does not address the sealing consideration that may arise in different wall conditions. For the complete installation procedure, see the instructions packaged with the window or go to [www.jeld-wen.com/resources/installation](http://www.jeld-wen.com/resources/installation).

**DISCLAIMER:**  
This drawing and its contents are confidential and are not to be reproduced or copied in whole or in part or used or disclosed to others except as authorized by JELD-WEN Inc.

PROJECT ENGINEER:	DATE:	05/28/2014
DRAWN BY:	SCALE:	NTS
CHECKED BY:	TITLE:	Premium Vinyl Casement Window Nail Fin Installation (36" x 72")
APPROVED BY:		
PART/PROJECT No.:		
D011267		
IDENTIFIER NO.:	PLANT NAME AND LOCATION:	
SW2013-249-FBC		
CAD DWG. No.:	REV:	00
	SHEET:	1 OF 1

3737 Lakeport Blvd  
Klamath Falls, OR, 97601  
Phone: (541) 882-3451

**\*AS TESTED\***

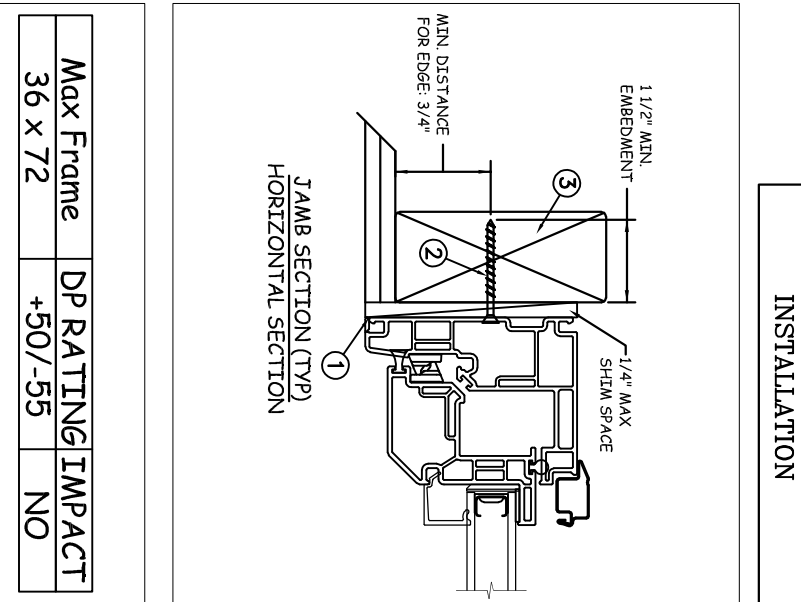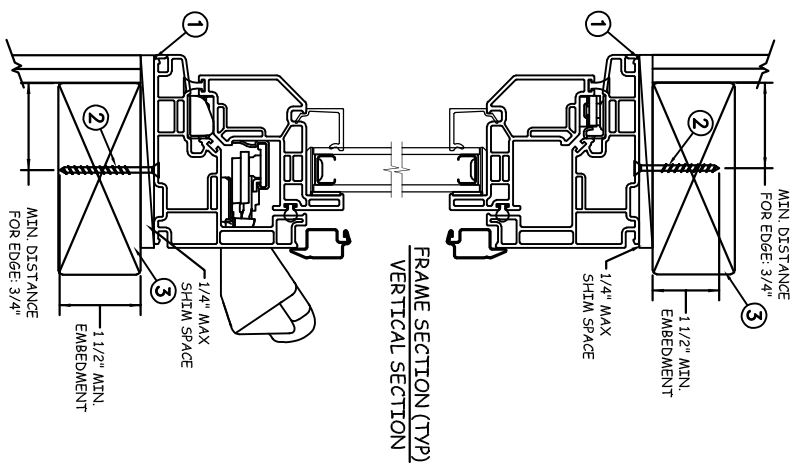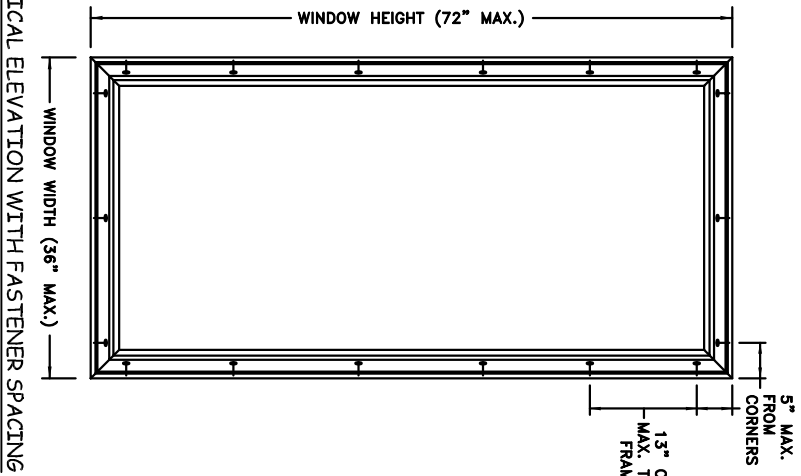

**THROUGH FRAME  
INSTALLATION**

Max Frame	DP RATING	IMPACT
36 x 72	+50/-55	NO

**Installation Notes:**

1. Seal flange/frame to substrate.
2. Use #8 x 2-1/2" PH or greater fastener through the frame with sufficient length to penetrate a minimum of 1 1/2" into the wood framing. For 2X wood frame substrate (min. S.G. = 0.42).
3. Host structure (wood buck, masonry, steel) to be designed and anchored to properly transfer all loads to the structure. The host structure is the responsibility of the architect or engineer of record for the project of installation.

**General Notes:**

1. The product shown herein is designed, tested and manufactured to comply with the wind load criteria of the adopted International Building Code(IBC), the International Residential Code(IRC), the Florida Building Code(FBC) including HVHZ and the industry requirement for the stated conditions.
2. All glazing shall conform to ASTM E1300.
3. At minimum, glazing shall be 3/32" annealed - 3/32" annealed Insulating glass.
4. Use structural or composite shims where required.
5. Installation methods can be interchanged within the same opening.
6. An impact protective system is required where wind borne debris protection is mandated by local building code.
7. Maximum sizes are buck sizes and do not include fin or flange.

This schedule addresses only the fasteners required to anchor the window to achieve the rated design pressure up to the size limitations noted. It is not intended as a guide to the installation process and does not address the sealing consideration that may arise in different wall conditions. For the complete installation procedure, see the instructions packaged with the window or go to [www.jeld-wen.com/resources/installation](http://www.jeld-wen.com/resources/installation).

**DISCLAIMER:**

This drawing and its contents are confidential and are not to be reproduced or copied in whole or in part or used or disclosed to others except as authorized by JELD-WEN Inc.

PROJECT ENGINEER:		DATE:	
DRAWN BY:		SCALE:	
CHECKED BY:		TITLE:	
APPROVED BY:		PART/PROJECT NO.:	
IDENTIFIER NO.		PLANT NAME AND LOCATION:	
CAD DWG. No.:		REV:	
SHEET		1 OF 1	

PROJECT ENGINEER: --- DATE: 05/12/2014  
 DRAWN BY: D. VEZO SCALE: NTS  
 CHECKED BY: J. Kantola  
 APPROVED BY: ---  
 PART/PROJECT NO.: D011267  
 IDENTIFIER NO. H5874.02-301-47  
 CAD DWG. No.:  
 REV: 00  
 SHEET 1 OF 1

**JELD-WEN**  
 Premium Vinyl Casement Window  
 Through Frame Installation (36" x 72")  
 3737 Lakeport Blvd  
 Klamath Falls, OR, 97601  
 Phone: (541) 882-3451

"AS TESTED"