

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
C	REVISED PER NEW STANDARDS	01/26/2022	R.L.

NOTES:


1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH REQUIREMENTS OF THE FLORIDA BUILDING CODE.
2. WOOD FRAMING AND MASONRY OPENING TO BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO STRUCTURE. FRAMING AND MASONRY OPENING IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.
3. WHERE SHIM OR BUCK THICKNESS IS LESS THAN 1-1/2" WINDOW UNITS MUST BE ANCHORED THROUGH THE FRAME IN ACCORDANCE WITH MANUFACTURER'S PUBLISHED INSTALLATION INSTRUCTIONS. ANCHORS SHALL BE SECURELY FASTENED DIRECTLY INTO MASONRY, CONCRETE OR OTHER STRUCTURAL SUBSTRATE MATERIAL.
4. WHERE WOOD BUCK THICKNESS IS 1-1/2" OR GREATER, BUCK SHALL BE SECURELY FASTENED TO MASONRY, CONCRETE OR OTHER STRUCTURAL SUBSTRATE. WINDOW UNITS MAY BE ANCHORED THROUGH FRAME TO SECURED WOOD BUCK IN ACCORDANCE WITH MANUFACTURER'S PUBLISHED INSTALLATION INSTRUCTIONS.
5. WHERE 1X BUCK IS NOT USED DISSIMILAR MATERIALS MUST BE SEPARATED WITH APPROVED COATING OR MEMBRANE. SELECTION OF COATING OR MEMBRANE IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.
6. BUCKS SHALL EXTEND BEYOND WINDOW INTERIOR FACE SO THAT FULL FRAME SUPPORT IS PROVIDED.
7. FOR FIN INSTALLATION SHIM AS NEEDED. FOR FRAME INSTALLATION SHIM AS REQUIRED AT EACH ANCHOR LOCATION WITH LOAD BEARING SHIM. SHIM WHERE SPACE OF 1/16" OR GREATER OCCURS. MAXIMUM ALLOWABLE SHIM STACK TO BE 1/4".
8. SHIMS SHALL BE LOCATED, APPLIED AND MADE FROM MATERIALS AND THICKNESS CAPABLE OF SUSTAINING APPLICABLE LOADS.
9. WIND LOAD DURATION FACTOR Cd=1.6 WAS USED FOR WOOD ANCHOR CALCULATIONS.
10. FRAME MATERIAL: EXTRUDED RIGID PVC.
11. UNITS MUST BE GLAZED PER ASTM E1300, SEE SHEET 2 FOR GLASS DETAILS.
12. APPROVED IMPACT PROTECTIVE SYSTEM IS NOT REQUIRED FOR THIS PRODUCT IN WIND BORNE DEBRIS REGIONS.
13. FOR ANCHORING THROUGH FIN INTO WOOD FRAMING OR 2X BUCK USE #8 WOOD SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE A 1 1/2" MINIMUM EMBEDMENT INTO SUBSTRATE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.

14. FOR ANCHORING THROUGH FRAME INTO WOOD FRAMING OR 2X BUCK USE #10 WOOD SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE A 1 1/4" MINIMUM EMBEDMENT INTO SUBSTRATE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
15. FOR ANCHORING THROUGH FRAME INTO MASONRY/CONCRETE USE 3/16" TAPCONS WITH SUFFICIENT LENGTH TO ACHIEVE A 1 1/4" MINIMUM EMBEDMENT INTO SUBSTRATE WITH 2" MINIMUM EDGE DISTANCE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
16. FOR ANCHORING THROUGH FRAME INTO METAL STRUCTURE USE #10 SMS OR SELF DRILLING SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE 3 THREADS MINIMUM BEYOND STRUCTURE INTERIOR WALL. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
17. ALL FASTENERS TO BE CORROSION RESISTANT.
18. INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BELOW:
 - A. WOOD: MINIMUM SPECIFIC GRAVITY OF G=0.42
 - B. CONCRETE: MINIMUM COMPRESSIVE STRENGTH OF 2,000 PSI.
 - C. MASONRY: HOLLOW/FILLED BLOCK PER ASTM C90 WITH Fm=2,000PSI MINIMUM.
 - D. METAL STRUCTURE: STEEL 18GA (.048") FY=33KSI/FU=52KSI OR ALUMINUM 6063-T5 FU=30KSI 1/8" THICK MINIMUM

SIGNED: 03/25/2022


TABLE OF CONTENTS	
SHEET NO.	DESCRIPTION
1	NOTES
2	ELEVATION AND GLAZING DETAIL
3 - 7	INSTALLATION DETAILS

STERGIS WINDOWS & DOORS, INC. 79 WALTON ST. ATTLEBORO, MA 02703		
STORMGATE IMPACT NC DOUBLE HUNG WINDOW 47" X 71" NOTES		
DRAWN: R.L.	DWG NO. 08-01413	REV C
SCALE NTS	DATE 11/30/11	SHEET 1 OF 7
L. ROBERTO LOMAS P.E. 400 S. PALM AVE, INDIALANTIC, FL 32903 434-688-0609 rllomas@rlomaspe.com		

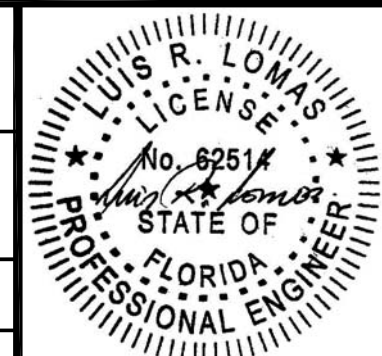


Luis R. Lomas P.E.
FL No.: 62514

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
C	REVISED PER NEW STANDARDS	01/26/2022	R.L.

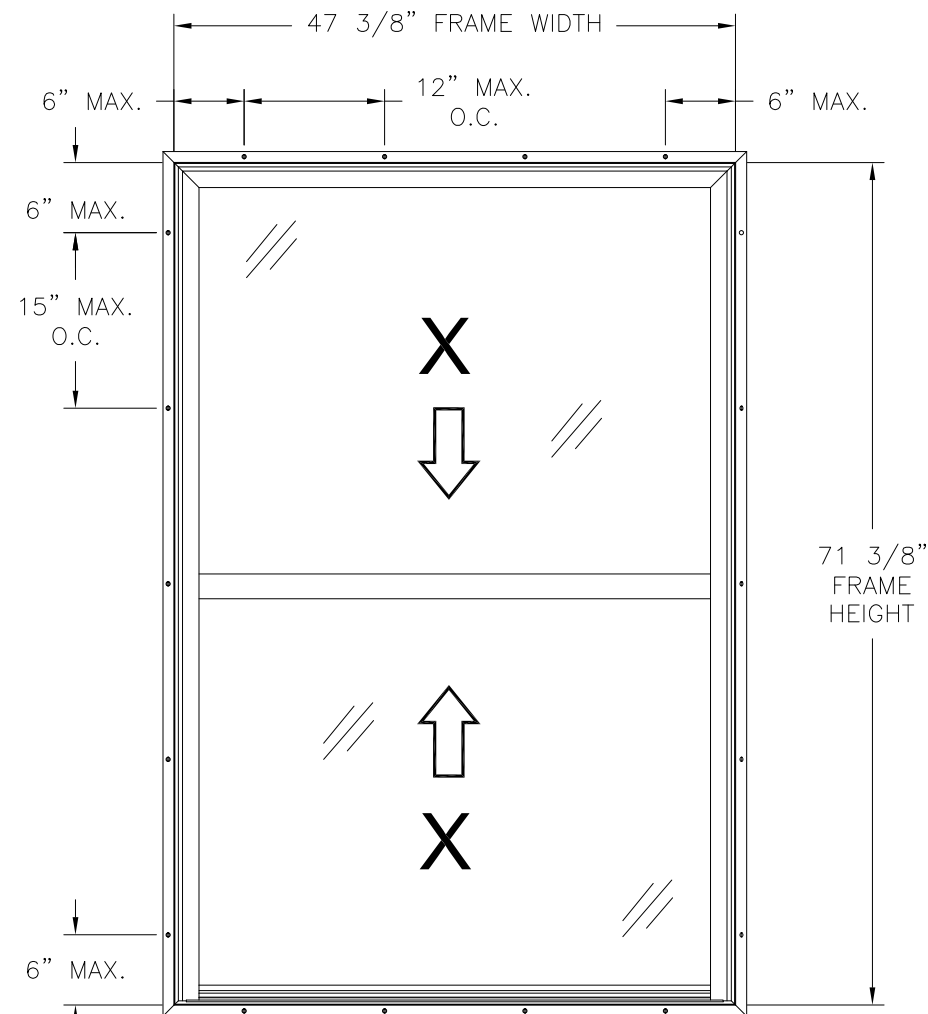

STORMGATE IMPACT NC DOUBLE HUNG WINDOW
EXTERIOR VIEW
FIN INSTALLATION

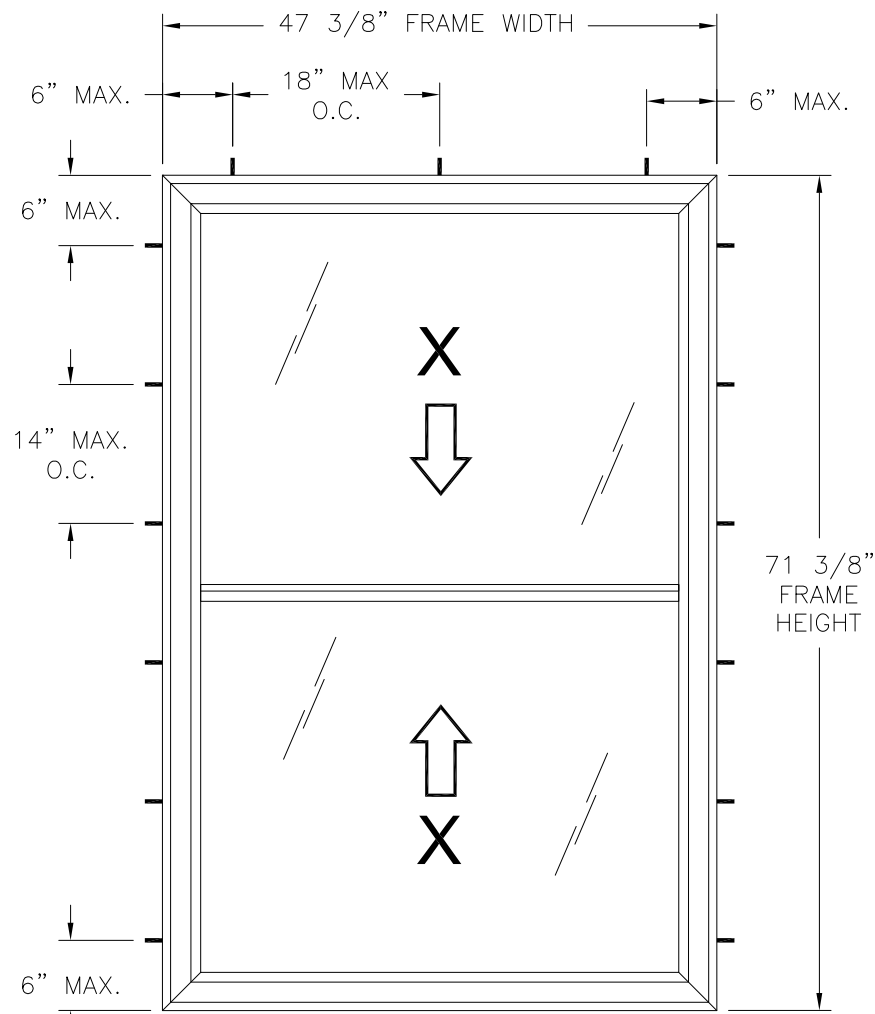


STORMGATE IMPACT NC DOUBLE HUNG WINDOW
EXTERIOR VIEW
FRAME INSTALLATION

DESIGN PRESSURE RATING	IMPACT RATING
±50PSF	LARGE MISSILE IMPACT

MISSILE LEVEL D, WIND ZONE 3

47 3/8" X 71 3/8" UNIT SHOWN. OTHER SIZES APPROVED AS LONG AS FRAME AREA DOES NOT EXCEED 23.48" FT²

- NOTES:
- SASH SIZE: 44 1/4" X 35 5/8"
 - DLO: 40 13/16" X 32"

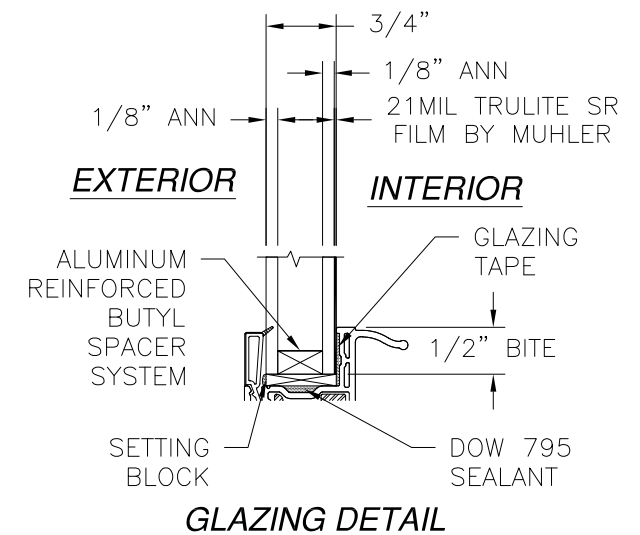

GLAZING DETAIL

HARDWARE SCHEDULE	
A.	(2) METAL SWEEP LOCKS W/ KEEPERS AT MEETING RAIL 8" FROM EACH END.
B.	(2) IMPACT CLIP AT EACH END OF TOP RAIL
C.	(4) METAL TILT LATCH AT INTERIOR MEETING RAIL AND TOP RAILS.
D.	(4) METAL PIVOT BARS AT EXTERIOR MEETING RAIL AND BOTTOM RAIL ENDS
E.	(2) "J" IMPACT BRACKET AT EACH JAMB ADJACENT TO TILT LATCH AT MEETING RAIL
F.	(4) SS IMPACT BRACKET SILL AT 9" FROM ENDS AND ADJACENT BOTTOM RAIL OF LOWER SASH
G.	(4) CONSTANT FORCE BALANCE TWO PER JAMB
J.	ALUMINUM REINFORCEMENT (142 DH-003) AT SILL
K.	ALUMINUM REINFORCEMENT (194 DH-002) AT SASH STILES & RAILS
L.	ALUMINUM REINFORCEMENT (HAM-S-3) AT LOWER STILES

STERGIS WINDOWS & DOORS, INC.


79 WALTON ST.
ATTLEBORO, MA 02703

STORMGATE IMPACT NC DOUBLE HUNG WINDOW
47" X 71"
ELEVATIONS

DRAWN: R.L.	DWG NO. 08-01413	REV C
SCALE NTS	DATE 11/30/11	SHEET 2 OF 7




L. ROBERTO LOMAS P.E.
400 S. PALM AVE, INDIALANTIC, FL 32903
434-688-0609 rllomas@rlomaspe.com

SIGNED: 03/25/2022

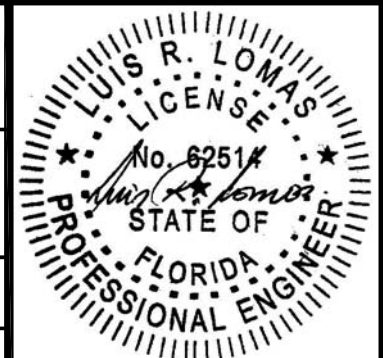


Luis R. Lomas P.E.
FL No.: 62514

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
C	REVISED PER NEW STANDARDS	01/26/2022	R.L.

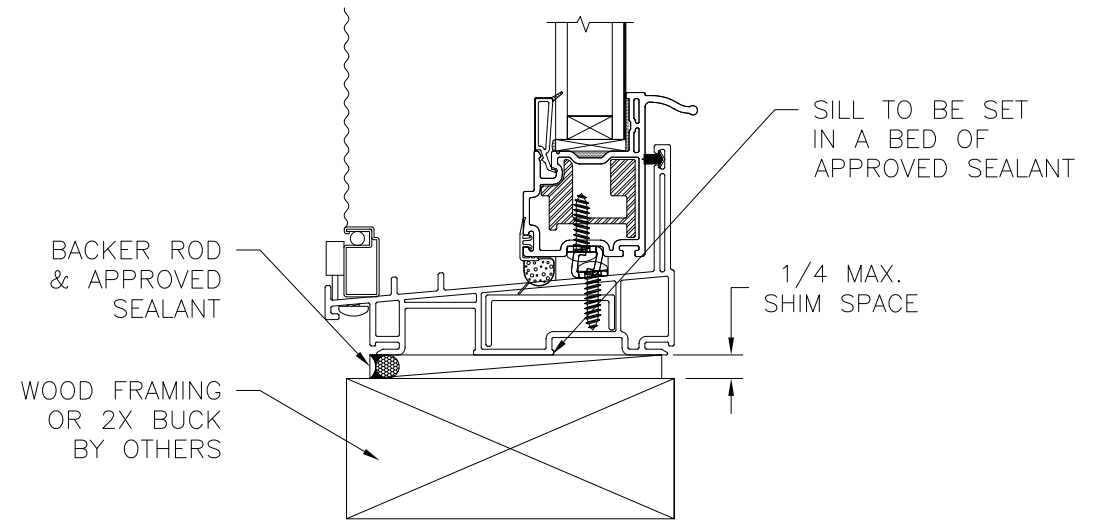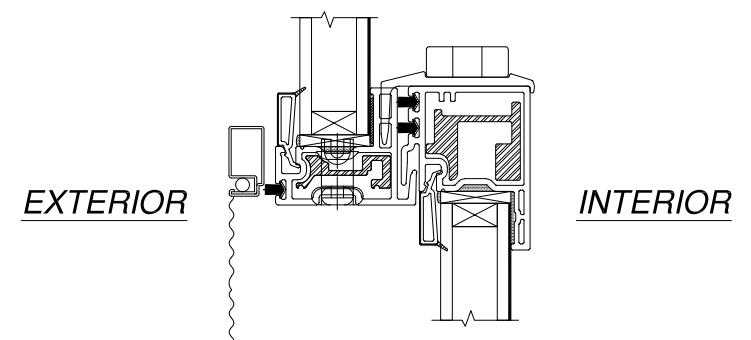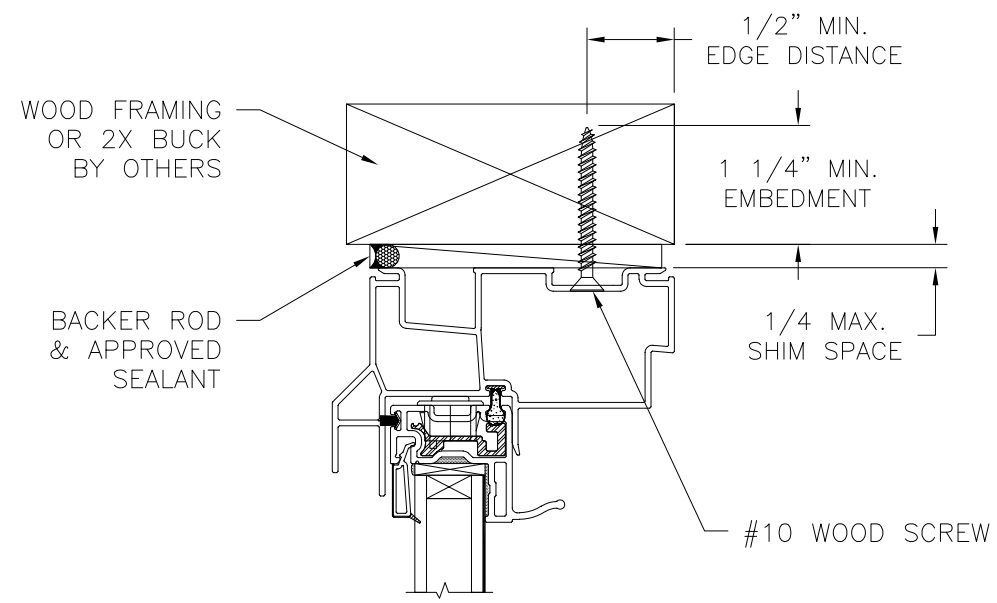

VERTICAL CROSS SECTION
WOOD FRAMING OR 2X BUCK INSTALLATION

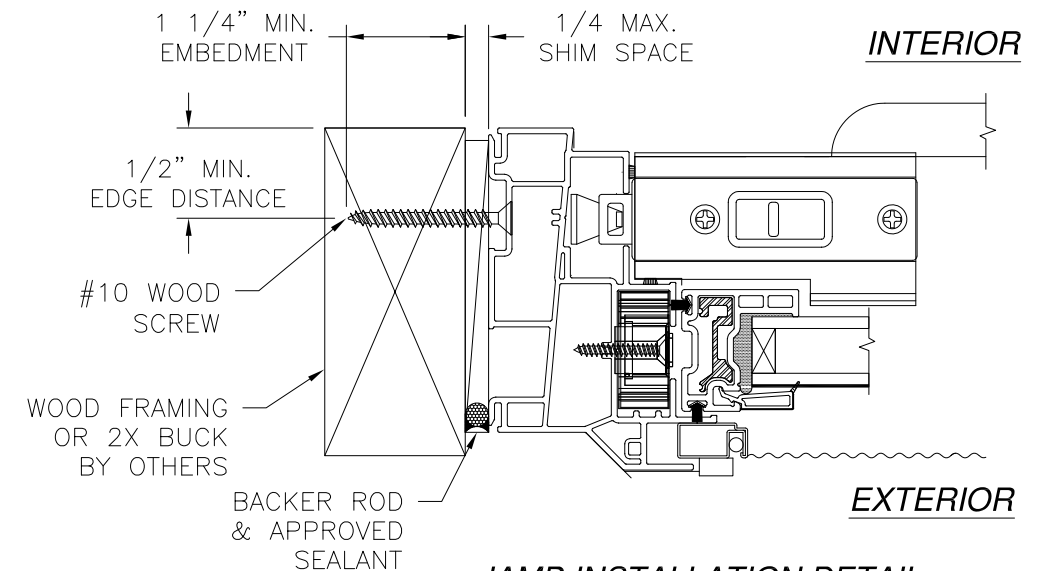

JAMB INSTALLATION DETAIL
WOOD FRAMING OR 2X BUCK INSTALLATION

- NOTES:**
1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112


SIGNED: 03/25/2022

STERGIS WINDOWS & DOORS, INC.
79 WALTON ST.
ATTLEBORO, MA 02703

STORMGATE IMPACT NC DOUBLE HUNG WINDOW
47" X 71"
INSTALLATION DETAILS




DRAWN: R.L.	DWG NO. 08-01413	REV C
SCALE NTS	DATE 11/30/11	SHEET 3 OF 7

L. ROBERTO LOMAS P.E.
400 S. PALM AVE, INDIALANTIC, FL 32903
434-688-0609 rllomas@rlomaspe.com

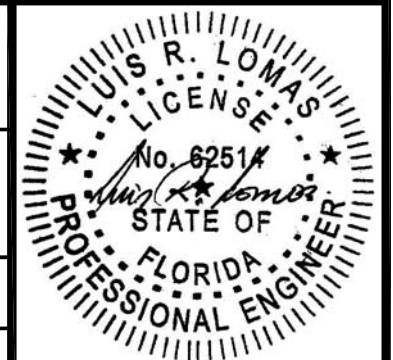


Luis R. Lomas P.E.
FL No.: 62514

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
C	REVISED PER NEW STANDARDS	01/26/2022	R.L.

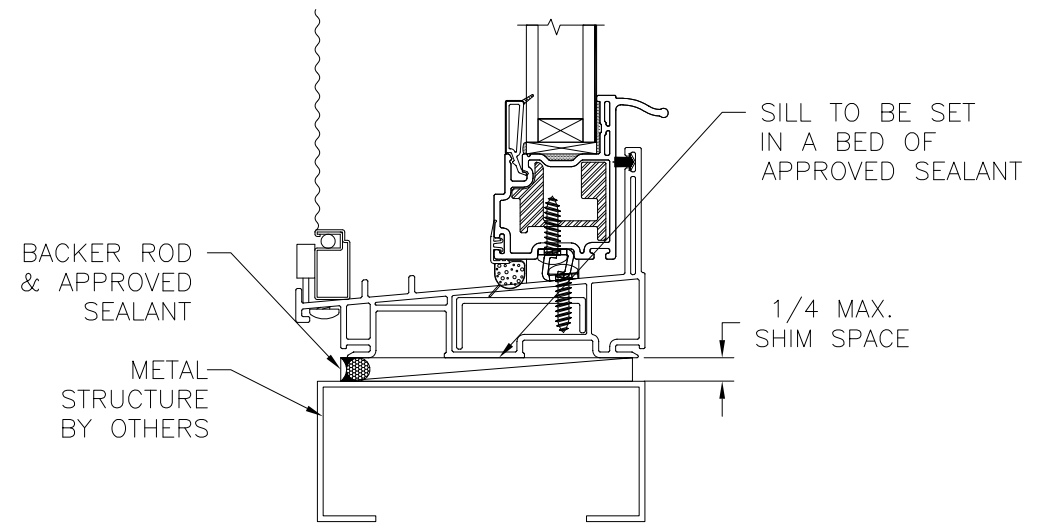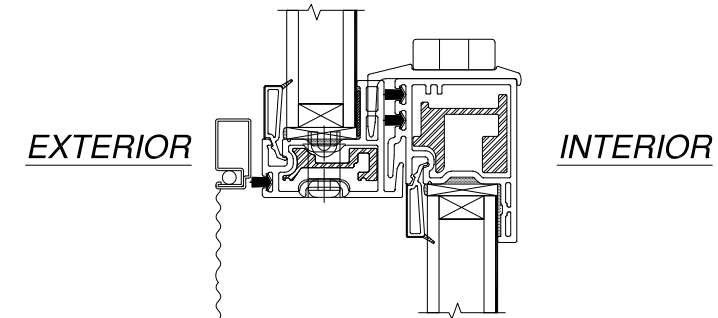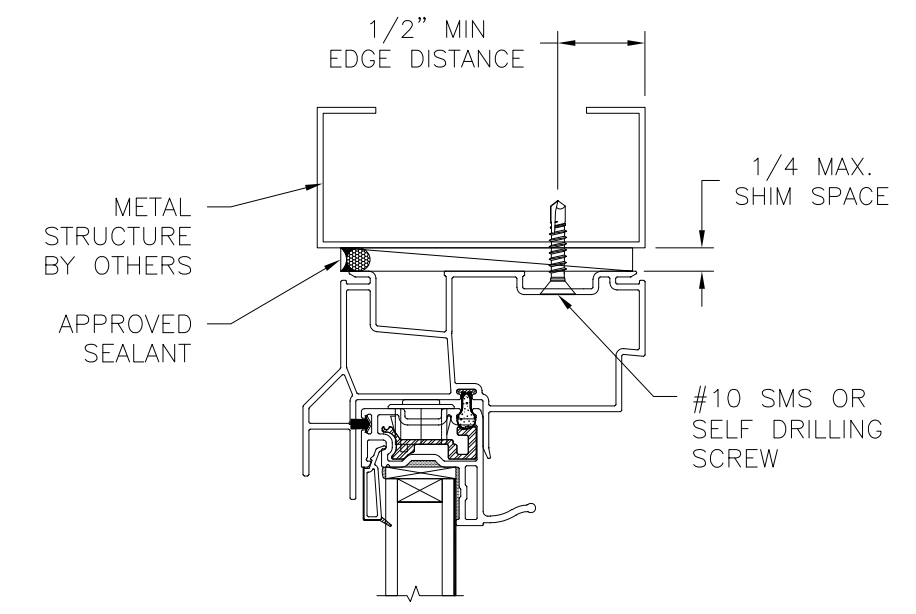

VERTICAL CROSS SECTION
METAL STRUCTURE INSTALLATION

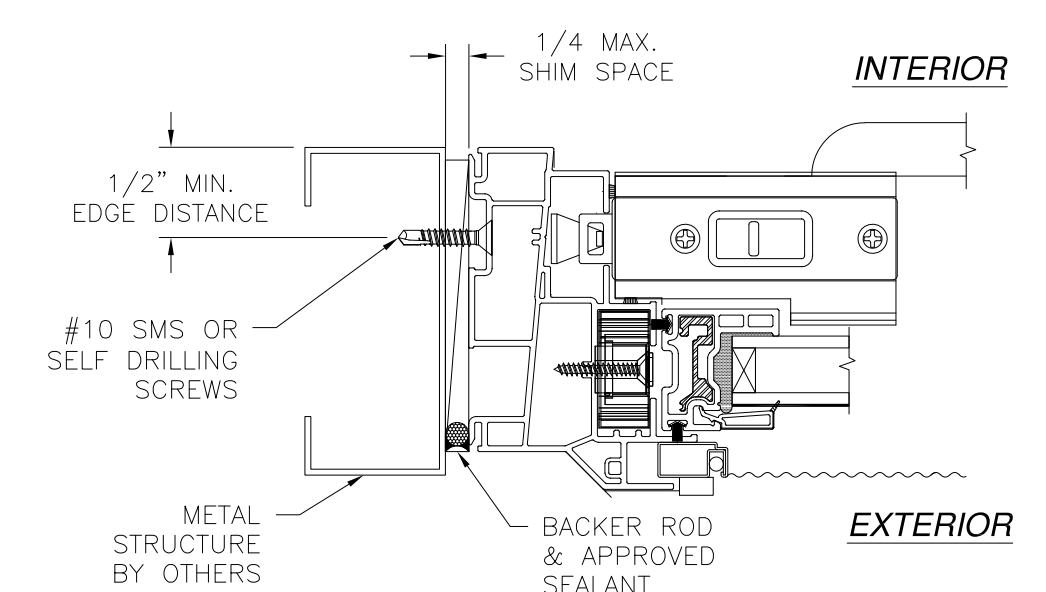

JAMB INSTALLATION DETAIL
METAL STRUCTURE INSTALLATION

- NOTES:**
1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112


SIGNED: 03/25/2022

STERGIS WINDOWS & DOORS, INC.
79 WALTON ST.
ATTLEBORO, MA 02703

STORMGATE IMPACT NC DOUBLE HUNG WINDOW
47" X 71"
INSTALLATION DETAILS




DRAWN: R.L.	DWG NO. 08-01413	REV C
SCALE NTS	DATE 11/30/11	SHEET 4 OF 7

L. ROBERTO LOMAS P.E.
400 S. PALM AVE, INDIALANTIC, FL 32903
434-688-0609 rllomas@rlomaspe.com

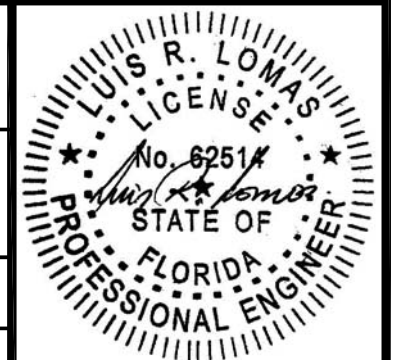

Luis R. Lomas P.E.
FL No.: 62514

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
C	REVISED PER NEW STANDARDS	01/26/2022	R.L.

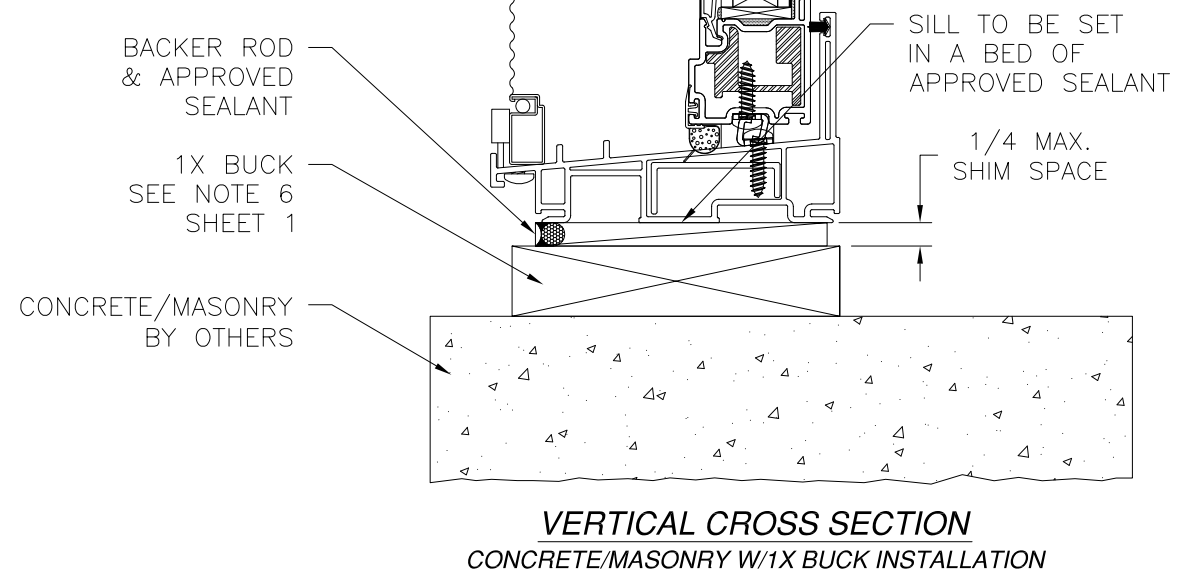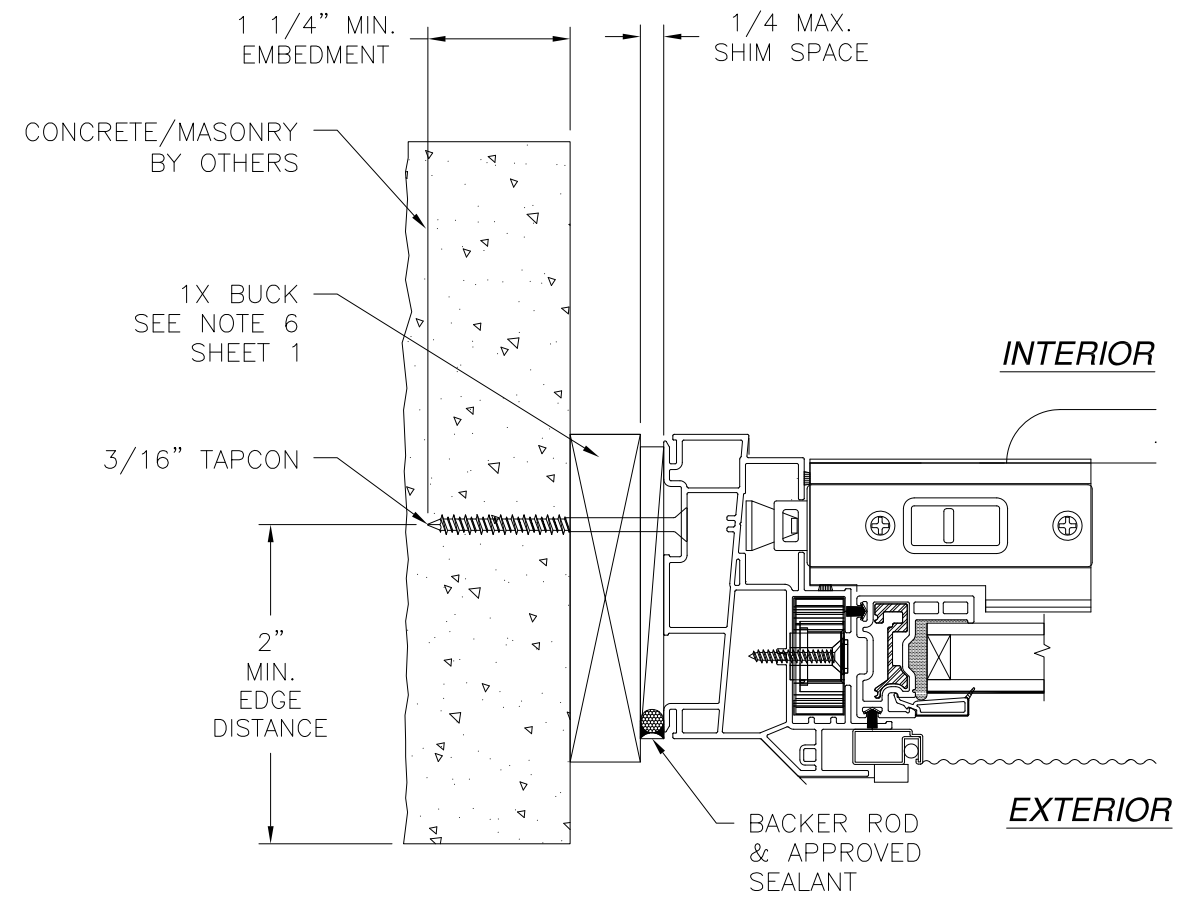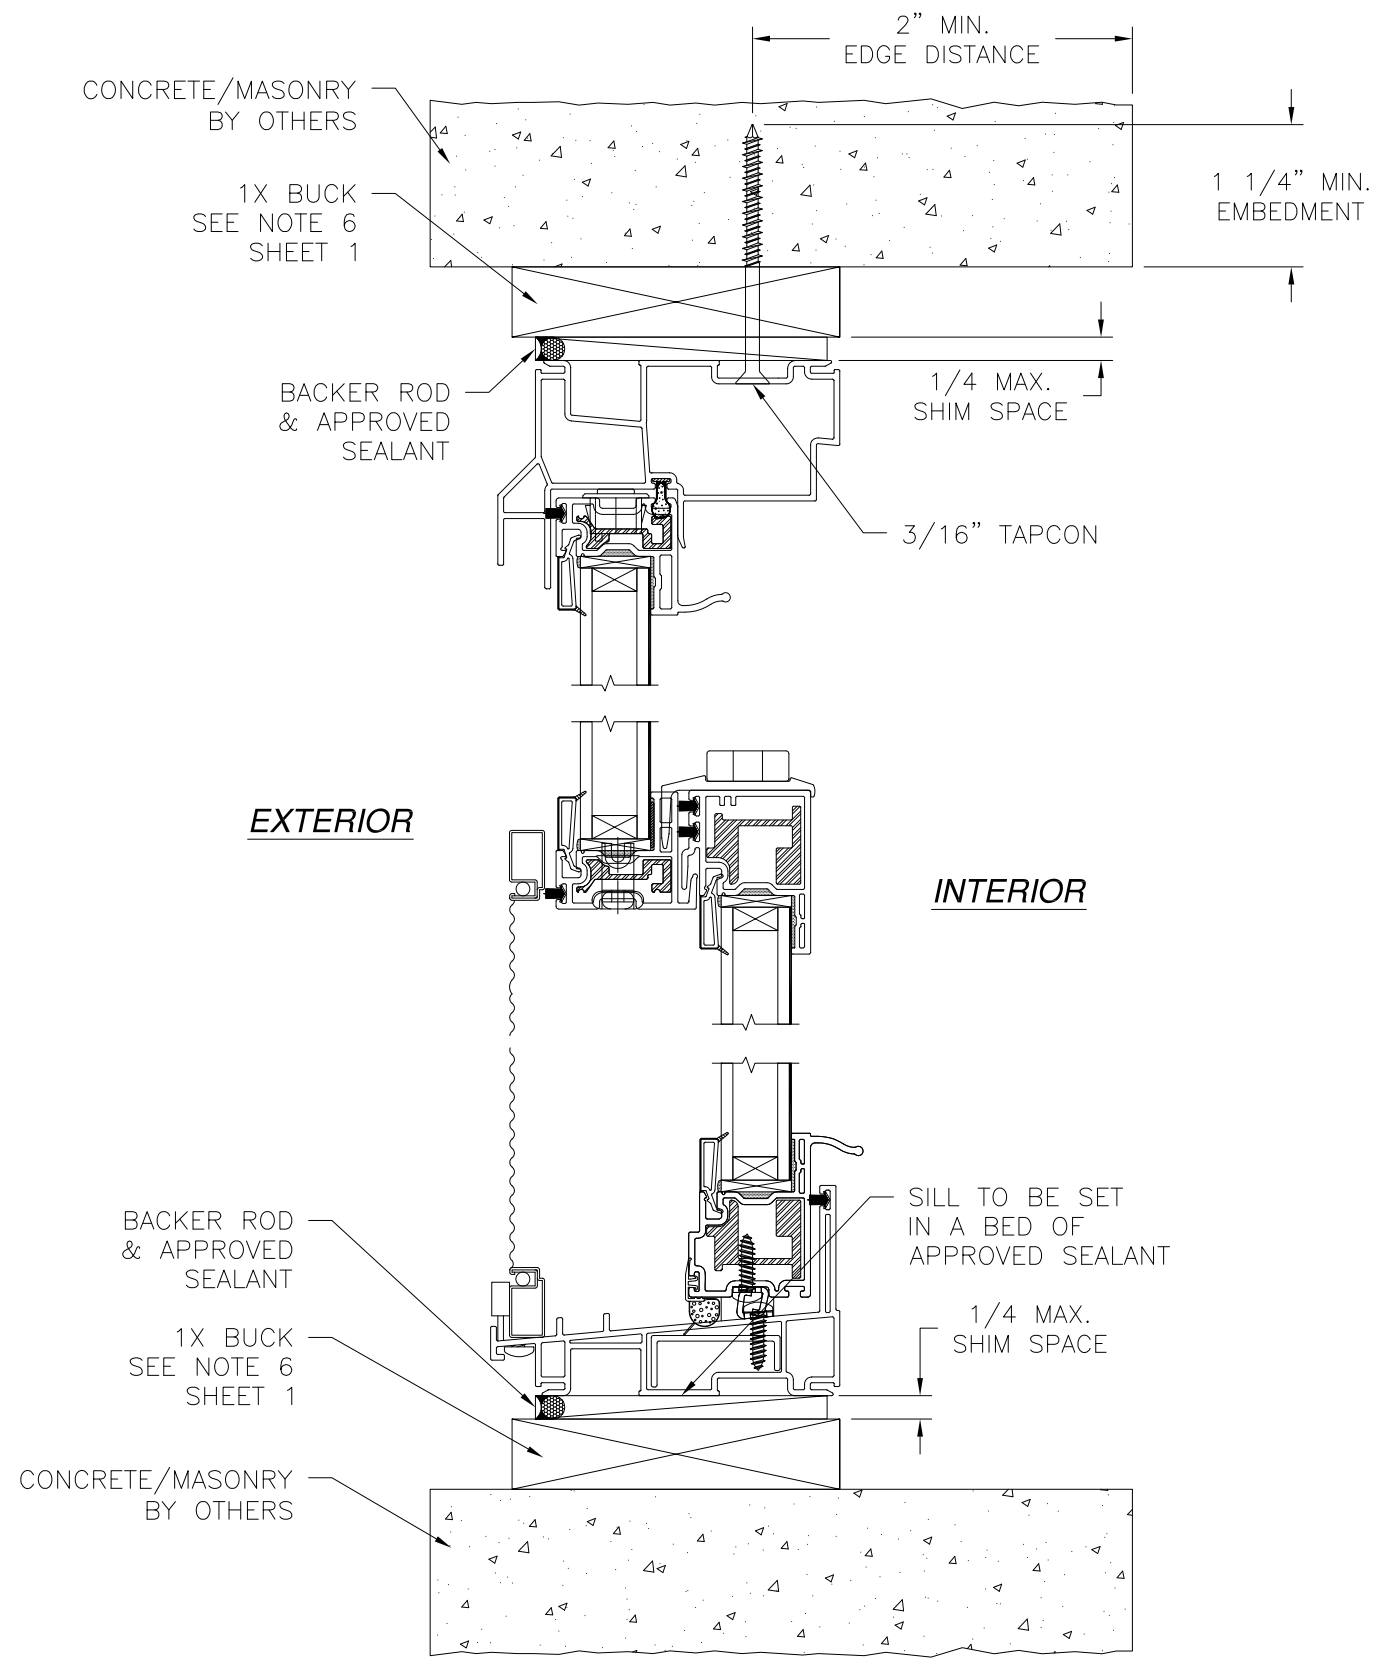

- NOTES:
1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112


SIGNED: 03/25/2022

STERGIS WINDOWS & DOORS, INC.
 79 WALTON ST.
 ATTLEBORO, MA 02703

STORMGATE IMPACT NC DOUBLE HUNG WINDOW
 47" X 71"
 INSTALLATION DETAILS


DRAWN: R.L.	DWG NO. 08-01413	REV C
SCALE NTS	DATE 11/30/11	SHEET 5 OF 7

L. ROBERTO LOMAS P.E.
 400 S. PALM AVE, INDIALANTIC, FL 32903
 434-688-0609 rllomas@rlomaspe.com

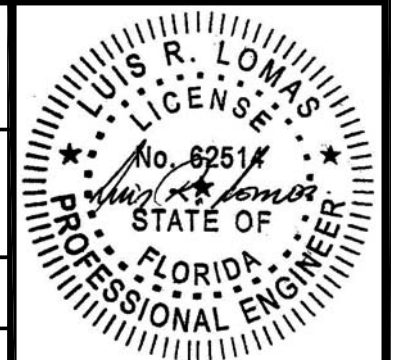


Luis R. Lomas P.E.
 FL No.: 62514

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
C	REVISED PER NEW STANDARDS	01/26/2022	R.L.

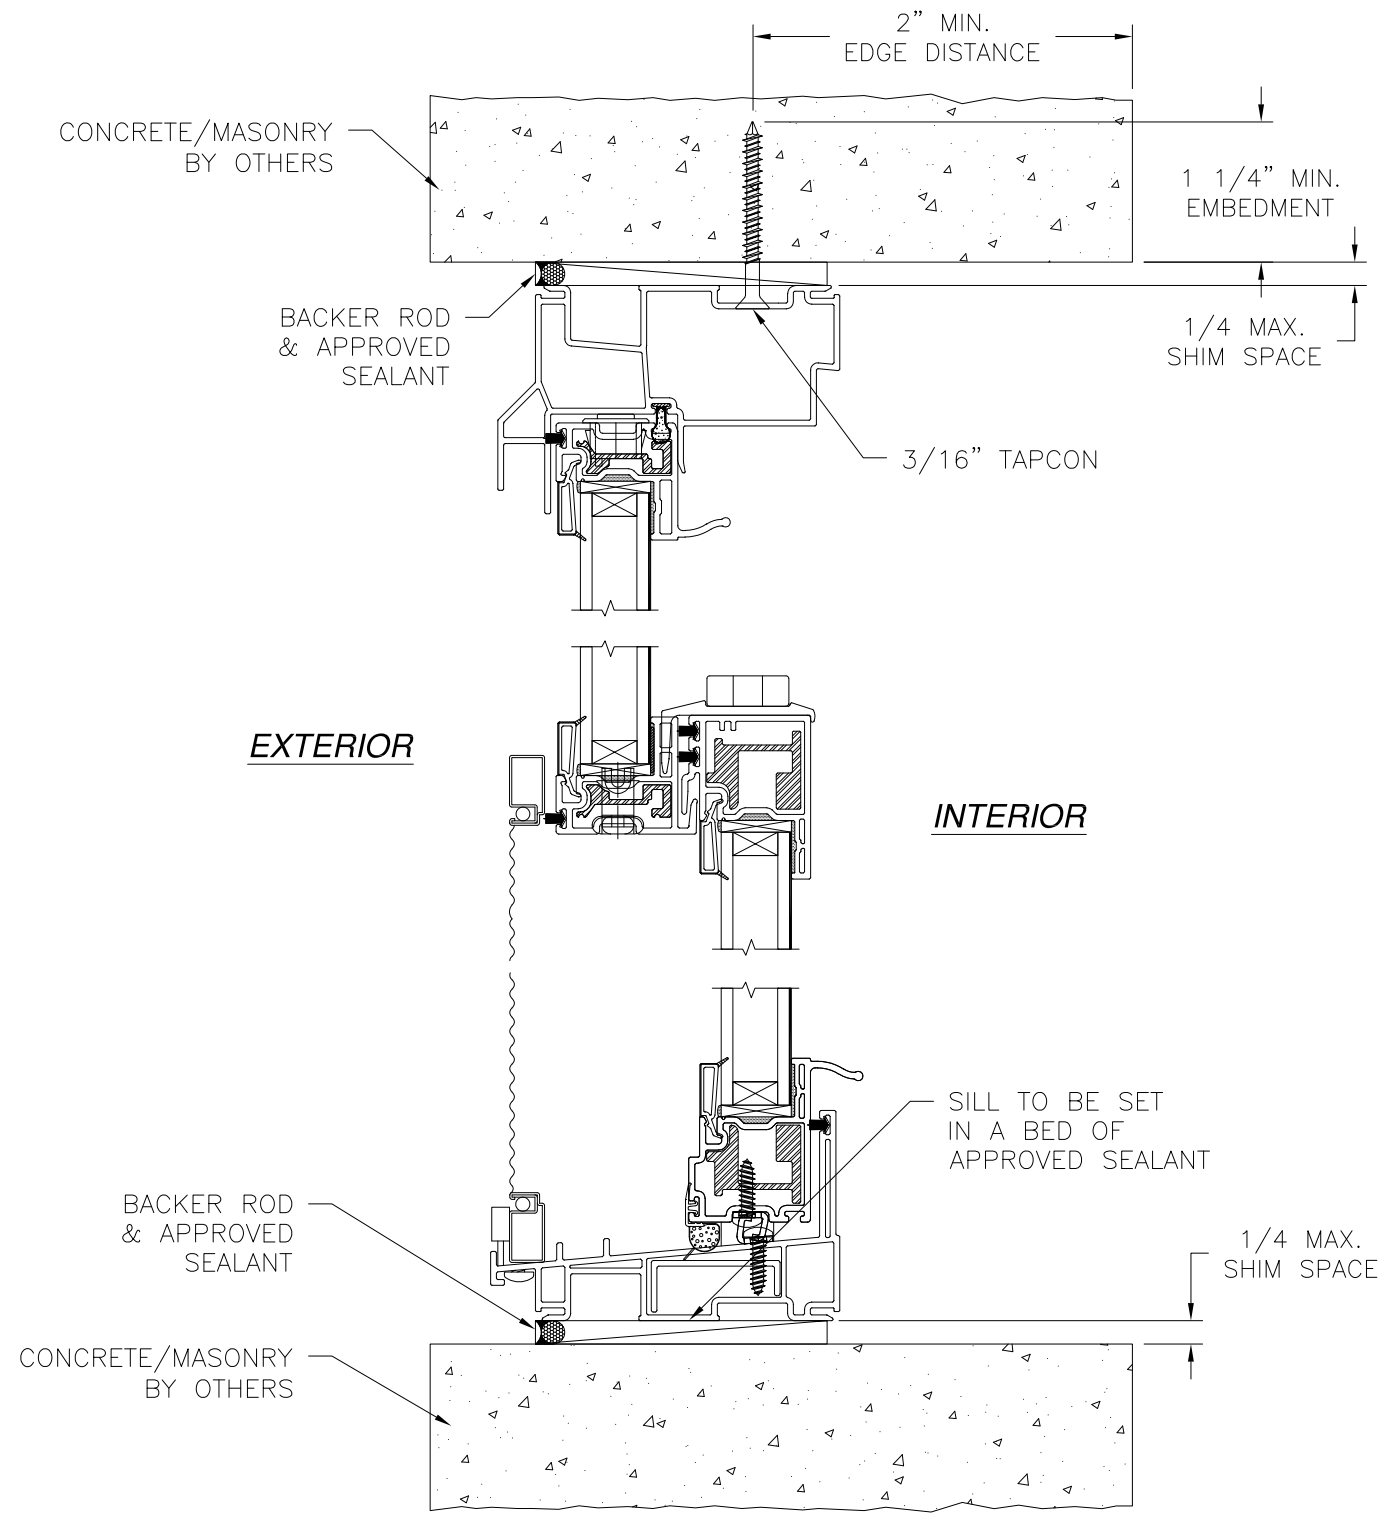

VERTICAL CROSS SECTION
CONCRETE/MASONRY INSTALLATION

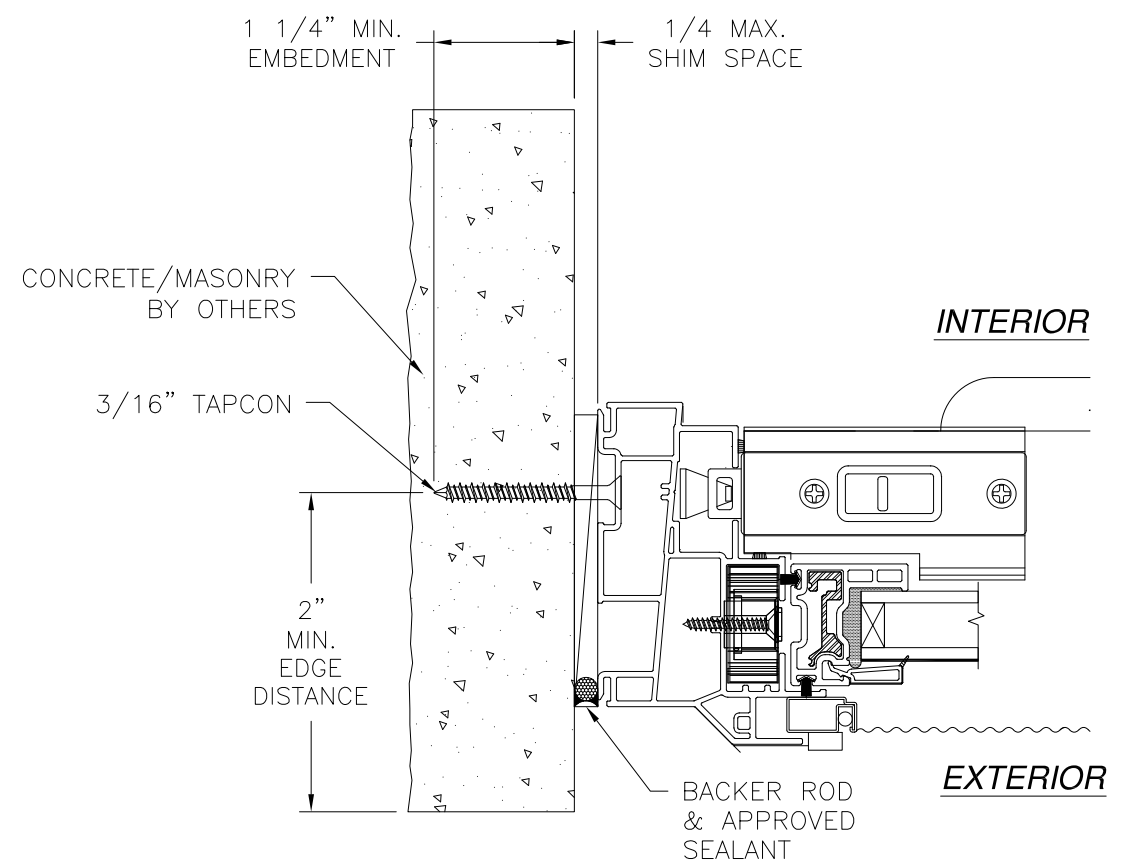

JAMB INSTALLATION DETAIL
CONCRETE/MASONRY INSTALLATION

- NOTES:**
1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112


SIGNED: 03/25/2022

STERGIS WINDOWS & DOORS, INC.
79 WALTON ST.
ATTLEBORO, MA 02703

STORMGATE IMPACT NC DOUBLE HUNG WINDOW
47" X 71"
INSTALLATION DETAILS


DRAWN: R.L.	DWG NO. 08-01413	REV C
SCALE NTS	DATE 11/30/11	SHEET 6 OF 7

L. ROBERTO LOMAS P.E.
400 S. PALM AVE, INDIALANTIC, FL 32903
434-688-0609 rllomas@rlomaspe.com

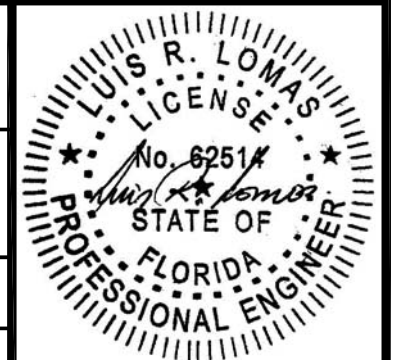


Luis R. Lomas P.E.
FL No.: 62514

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
C	REVISED PER NEW STANDARDS	01/26/2022	R.L.

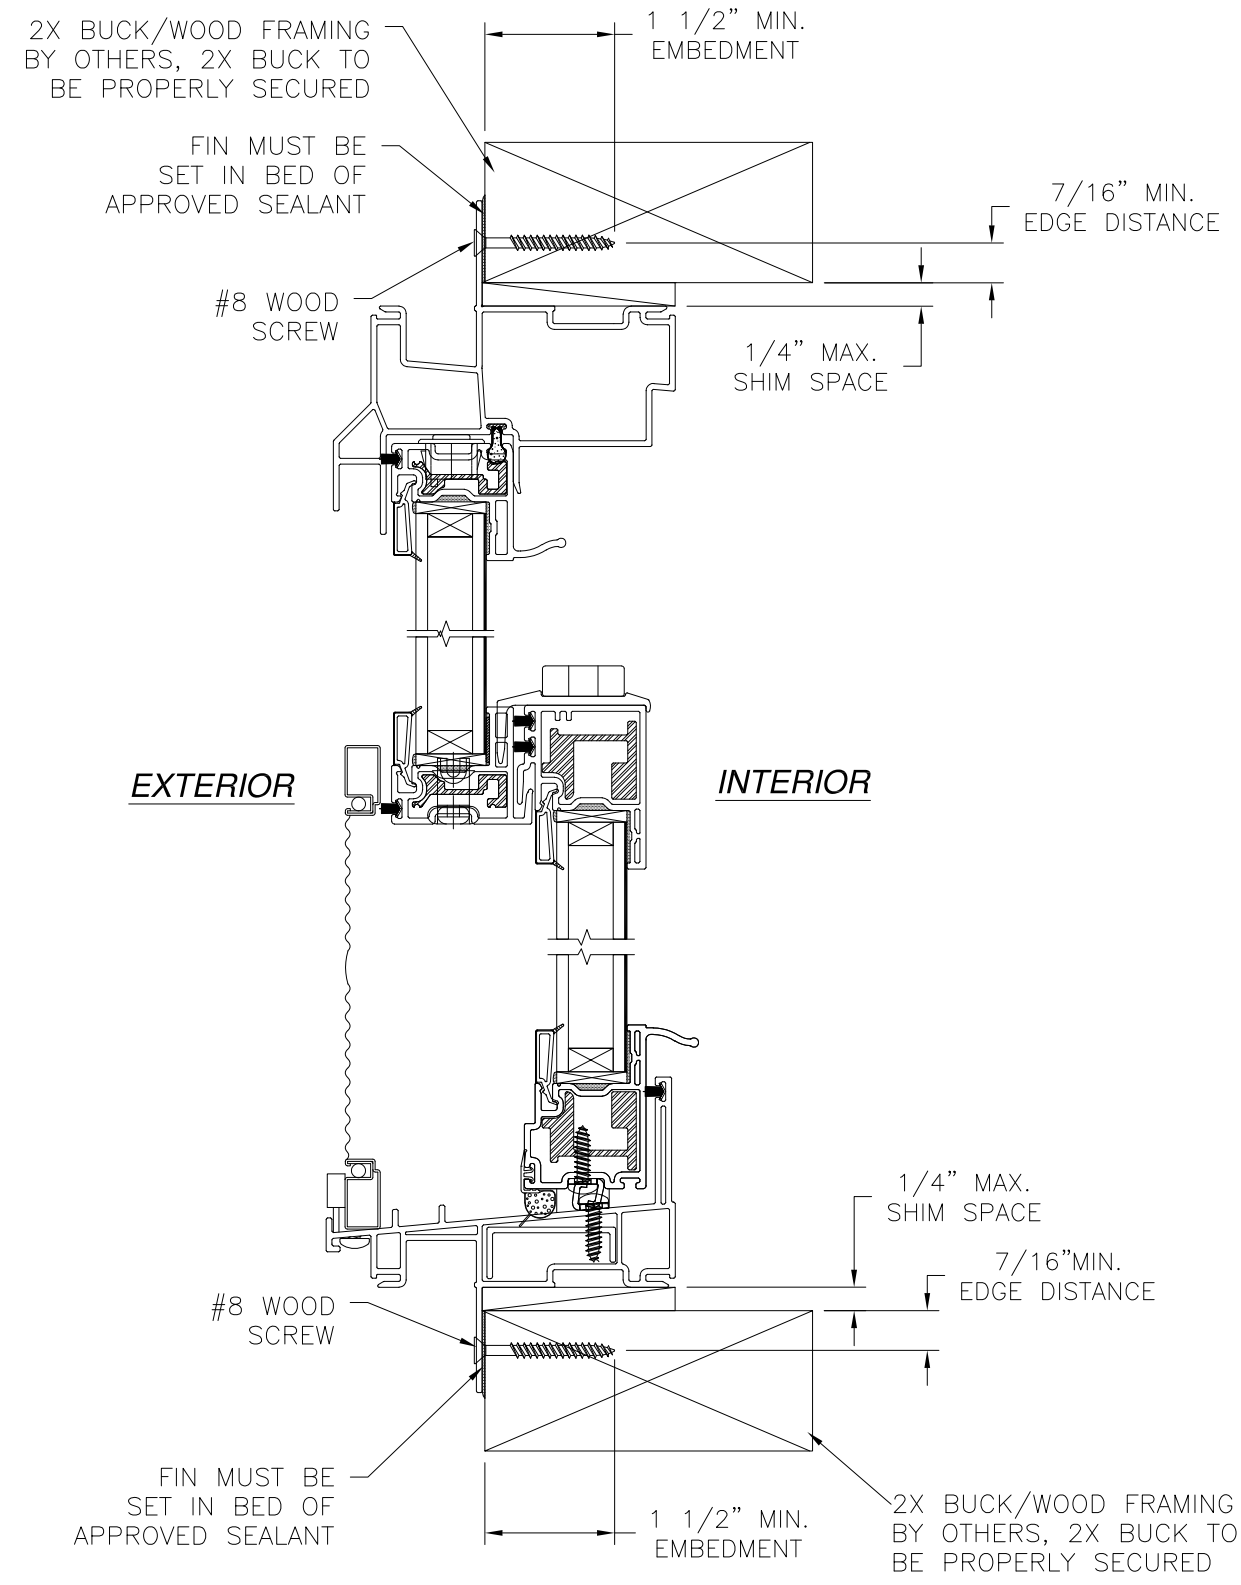

VERTICAL CROSS SECTION
2X BUCK/WOOD FRAMING

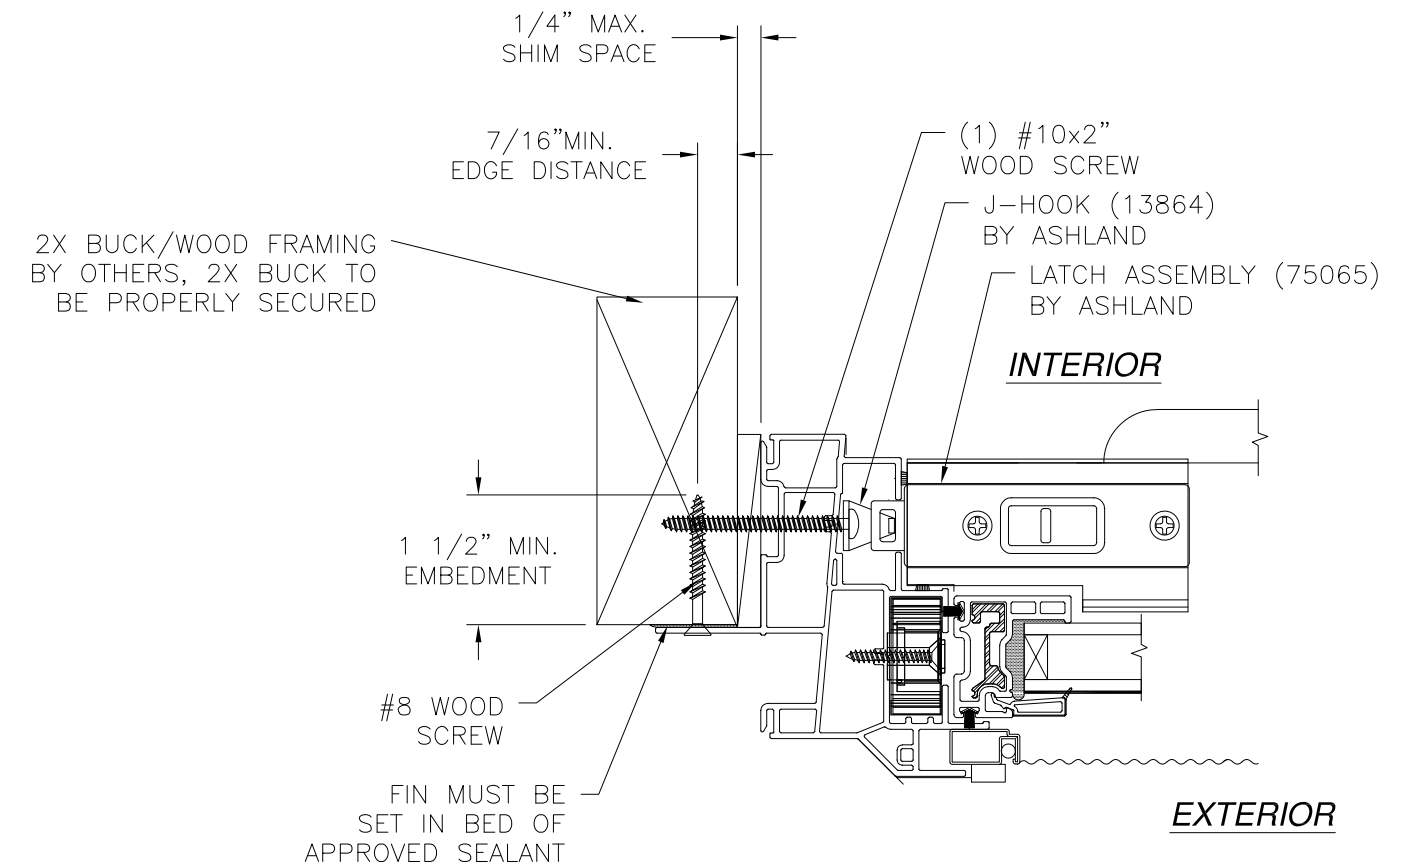

HORIZONTAL CROSS SECTION
2X BUCK/WOOD FRAMING

- NOTES:**
1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112


SIGNED: 03/25/2022

STERGIS WINDOWS & DOORS, INC.
79 WALTON ST.
ATTLEBORO, MA 02703

STORMGATE IMPACT NC DOUBLE HUNG WINDOW
47" X 71"
FIN INSTALLATION DETAILS

DRAWN: R.L.	DWG NO. 08-01413	REV C
SCALE NTS	DATE 11/30/11	SHEET 7 OF 7

L. ROBERTO LOMAS P.E.
400 S. PALM AVE, INDIALANTIC, FL 32903
434-688-0609 rllomas@rlomaspe.com

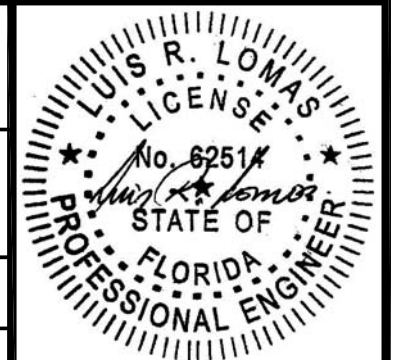

Luis R. Lomas P.E.
FL No.: 62514