	REVISIONS						
REV	DESCRIPTION	DATE	APPROVED				
D	REVISED INSTALLATION & GLAZING DETAILS	01/04/2023	R.L.				

NOTES:

- 1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH REQUIREMENTS OF THE FLORIDA BUILDING CODE.
- 2. WOOD FRAMING AND MASONRY OPENING TO BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO STRUCTURE. FRAMING AND MASONRY OPENING IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.
- 3. WHERE SHIM OR BUCK THICKNESS IS LESS THAN 1-1/2" WINDOW UNITS MUST BE ANCHORED THROUGH THE FRAME IN ACCORDANCE WITH MANUFACTURER'S PUBLISHED INSTALLATION INSTRUCTIONS. ANCHORS SHALL BE SECURELY FASTENED DIRECTLY INTO MASONRY, CONCRETE OR OTHER STRUCTURAL SUBSTRATE MATERIAL.
- 4. WHERE WOOD BUCK THICKNESS IS 1-1/2" OR GREATER, BUCK SHALL BE SECURELY FASTENED TO MASONRY, CONCRETE OR OTHER STRUCTURAL SUBSTRATE. WINDOW UNITS MAY BE ANCHORED THROUGH FRAME TO SECURED WOOD BUCK IN ACCORDANCE WITH MANUFACTURER'S PUBLISHED INSTALLATION INSTRUCTIONS.
- 5. WHERE 1X BUCK IS NOT USED DISSIMILAR MATERIALS MUST BE SEPARATED WITH APPROVED COATING OR MEMBRANE. SELECTION OF COATING OR MEMBRANE IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.
- 6. BUCKS SHALL EXTEND BEYOND WINDOW INTERIOR FACE SO THAT FULL FRAME SUPPORT IS PROVIDED.
- 7. SHIM AS REQUIRED AT EACH ANCHOR LOCATION WITH LOAD BEARING SHIM. SHIM WHERE SPACE OF 1/16" OR GREATER OCCURS. MAXIMUM ALLOWABLE SHIM STACK TO BE 1/4".
- 8. SHIMS SHALL BE LOCATED, APPLIED AND MADE FROM MATERIALS AND THICKNESS CAPABLE OF SUSTAINING APPLICABLE LOADS.
- 9. WIND LOAD DURATION FACTOR Cd=1.6 WAS USED FOR WOOD ANCHOR CALCULATIONS.
- 10. FRAME MATERIAL: EXTRUDED RIGID PVC.
- 11. UNITS MUST BE GLAZED PER ASTM E1300, SEE SHEET 12 FOR GLASS DETAILS.
- 12. APPROVED IMPACT PROTECTIVE SYSTEM IS NOT REQUIRED FOR THIS PRODUCT IN WIND BORNE DEBRIS REGIONS.
- 13. FOR ANCHORING THROUGH FIN INTO WOOD FRAMING OR 2X BUCK USE #8 WOOD SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE A 1 1/4" MINIMUM EMBEDMENT INTO SUBSTRATE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.

- 14. FOR ANCHORING THROUGH FRAME INTO WOOD FRAMING OR 2X BUCK USE #10 WOOD SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE A 1 1/4" MINIMUM EMBEDMENT INTO SUBSTRATE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
- 15. FOR ANCHORING THROUGH FRAME INTO MASONRY/CONCRETE USE 3/16" TAPCONS WITH SUFFICIENT LENGTH TO ACHIEVE A 1 1/4" MINIMUM EMBEDMENT INTO SUBSTRATE WITH 2" MINIMUM EDGE DISTANCE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
- 16. FOR ANCHORING THROUGH FRAME INTO METAL STRUCTURE USE #10 SMS OR SELF DRILLING SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE 3 THREADS MINIMUM BEYOND STRUCTURE INTERIOR WALL. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
- 17. ALL FASTENERS TO BE CORROSION RESISTANT.
- 18. INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BELOW: A. WOOD - MINIMUM SPECIFIC GRAVITY OF G=0.42B. CONCRETE - MINIMUM COMPRESSIVE STRENGTH OF 3,192 PSI.
- 19. APPROVED CONFIGURATIONS: XO, OX.
- 20. UNITS MAY BE INSTALLED WITH OR WITHOUT FLANGE.


		ALUMINUM IMPACT WINDO	AND VINYL		
		SERIES 4241 HR			
	TABLE OF CONTENTS		IMPACT NOTES		
SHEET NO.	DESCRIPTION	DRAWN:	DWG NO.		
1	NOTES	ТЈН	0		
2	ELEVATION	SCALE NTS DATE O	1/29/10		
3 - 11	INSTALLATION DETAILS		L. ROBERTO LO 400 S. PALM AVE, INDIAL		
12	COMPONENTS		8-0609 rllomas@		

C. MASONRY - STRENGTH CONFORMANCE TO ASTM C-90, GRADE N, TYPE 1 (OR GREATER). D. METAL STRUCTURE: STEEL 18GA, 33KSI OR ALUMINUM 6063-T5 .048" THICK MINIMUM

Easter


EASTERN ARCHITECTURAL SYSTEMS A DIVISION OF EASTERN METAL SYPPLY 16341 DOMESTIC AVE FORT MYERS, FL 33912 800-432-2204	ILUIS R. LOM
RIZONTAL SLIDING WINDOW ACT DTES	No. 6251# *
08-00937 REV	SORIDA CHI
O <sup>Sheet</sup> 1 OF 10	
D LOMAS P.E. IDIALANTIC, FL 32903 mas@lrlomaspe.com	Luis R. Lomas P.E. FL No.: 62514


SIGNED: 02/01/2023

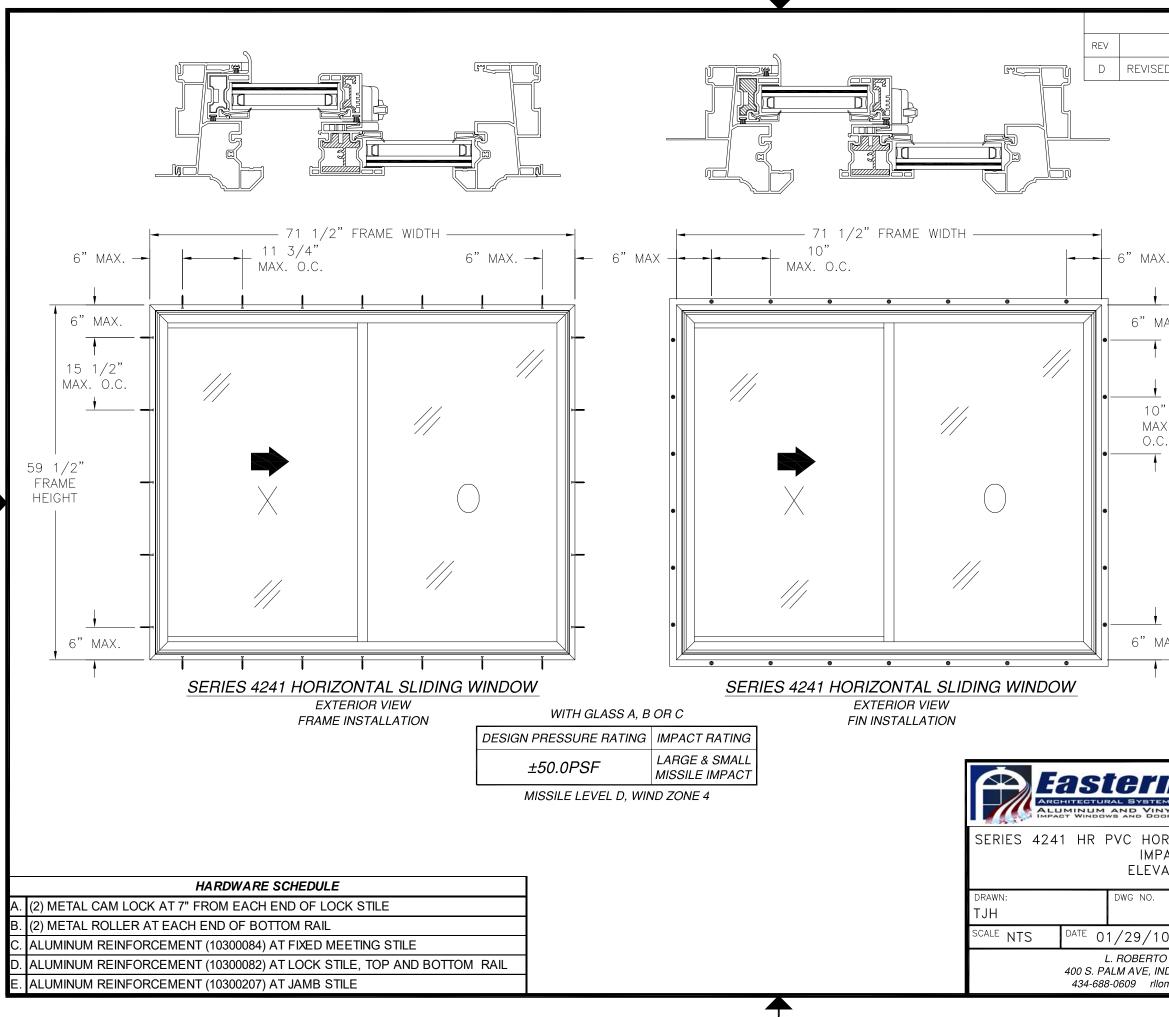


		REVISIO	NS		
DESCRIPTION			DATE	APPROVED	
ED INSTALLATIO	DN &	GLAZING	DETAILS	01/04/2023	R.L.
MAX MAX C. 59 1/2" FRAME HEIGHT	2. 3.	MAXIMUN 1/2" (8) 3/8 FROM E RAIL AN (2) 1" END OF (2) 3/8 1/2" FC EXTERIO (4) 1" EACH C TRACK	M D.L.O. ACH CC D GLAZ X 3/16 SILL IN 3" X 1/ DRM EAC R SILL X 1/8" ORNER /4" X 3" FRC	WEEP SLOT OF EXTERIOF 1/4" WEEP DM EACH CC	X 54 LOT 3" DITOM T AT EACH LEG OT 3 OF 3" FROM R SILL
MAX					
				SIGNED: (	02/01/2023


EASTERN ARCHITECTURAL SYSTEMS A DIVISION OF EASTERN METAL SYPPLY 16341 DOMESTIC AVE FORT MYERS, FL 33912 800-432-2204	LICENST 70	
RIZONTAL SLIDING WINI ACT ATIONS	* No. 6251# *=	
08-00937	SONAL ENUL	
O <sup>Sheet</sup> 2 OF 10		
O LOMAS P.E. IDIALANTIC, FL 32903 omas@Irlomaspe.com	Luis R. Lomas P.E. FL No.: 62514	

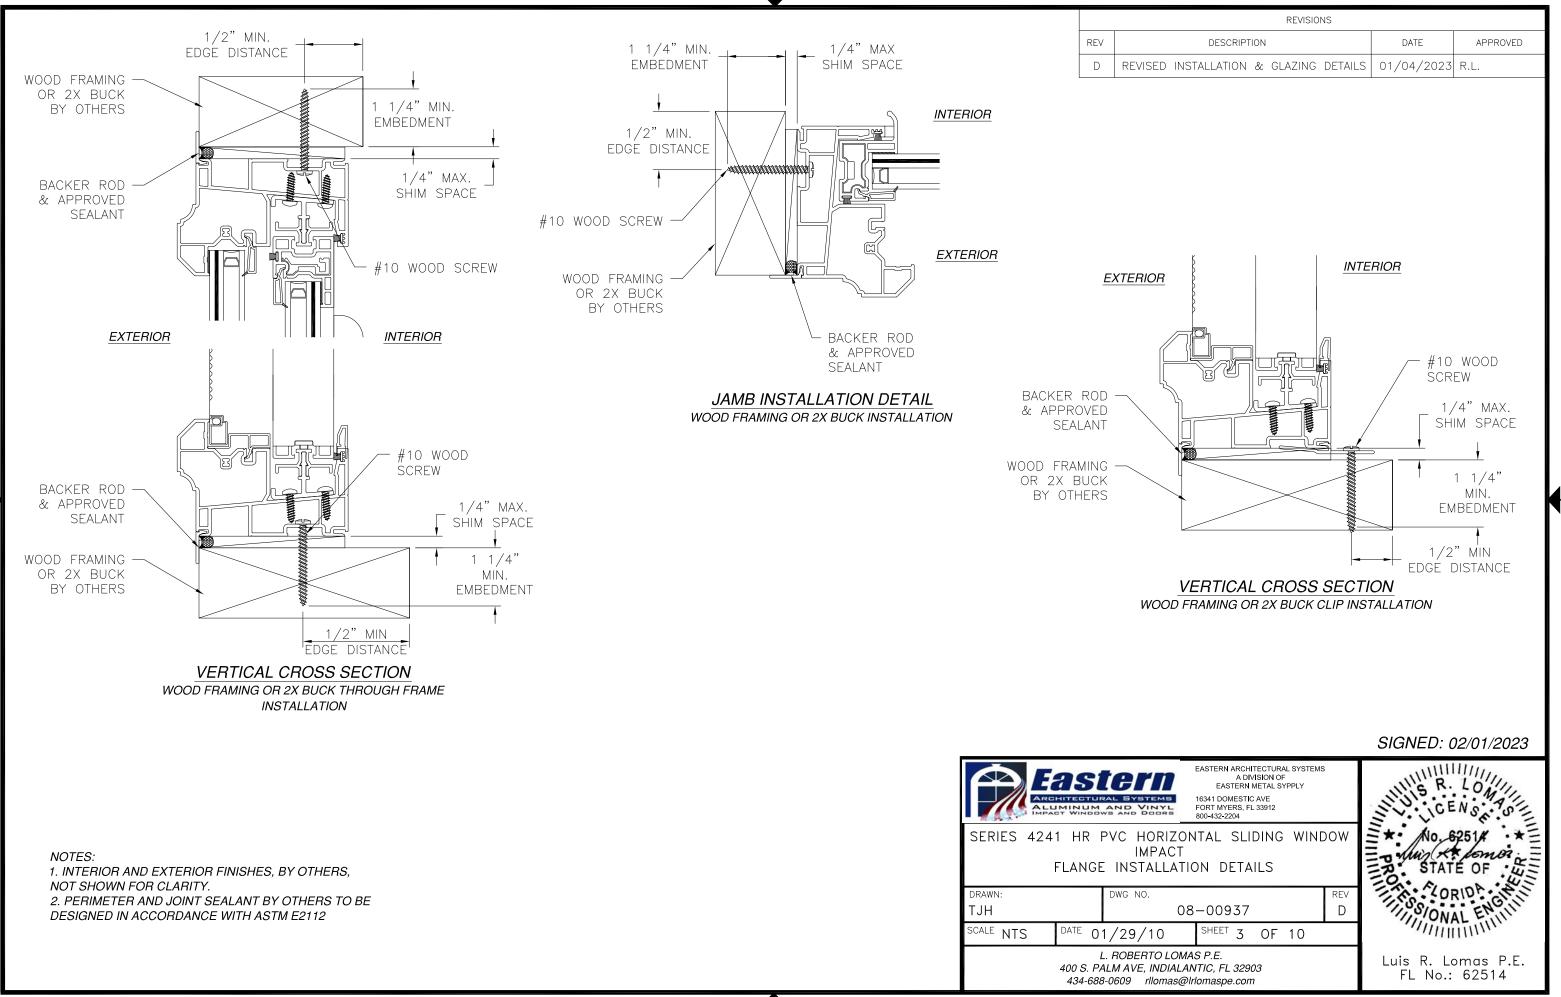


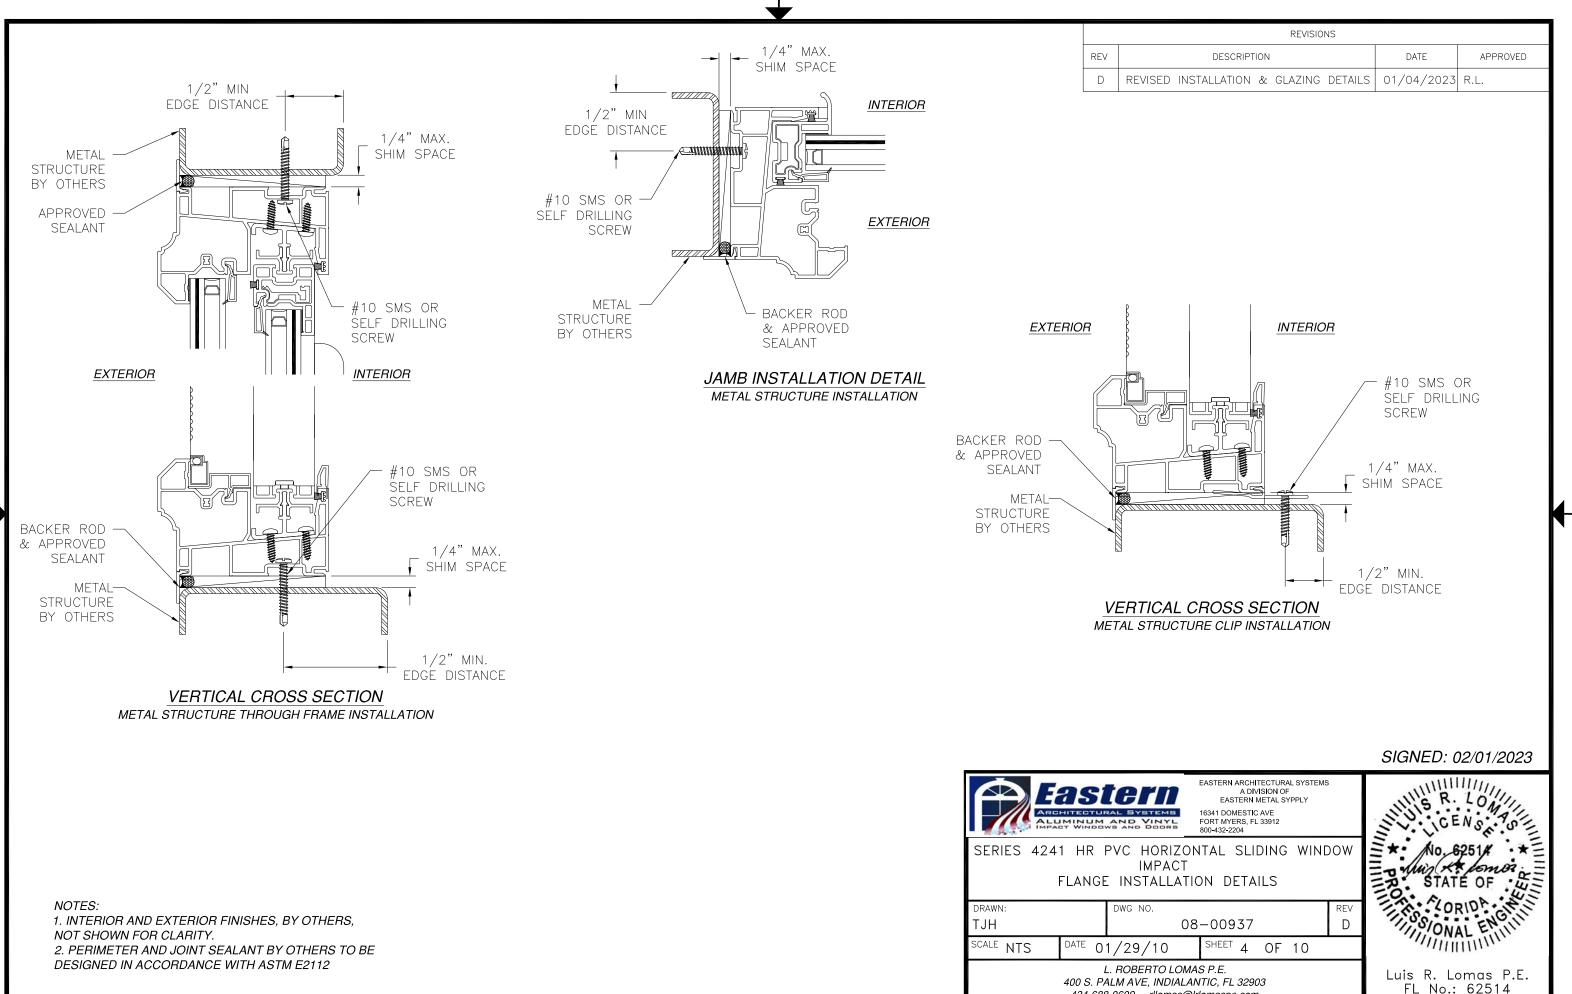



434-688-0609 rllomas@lrlomaspe.com

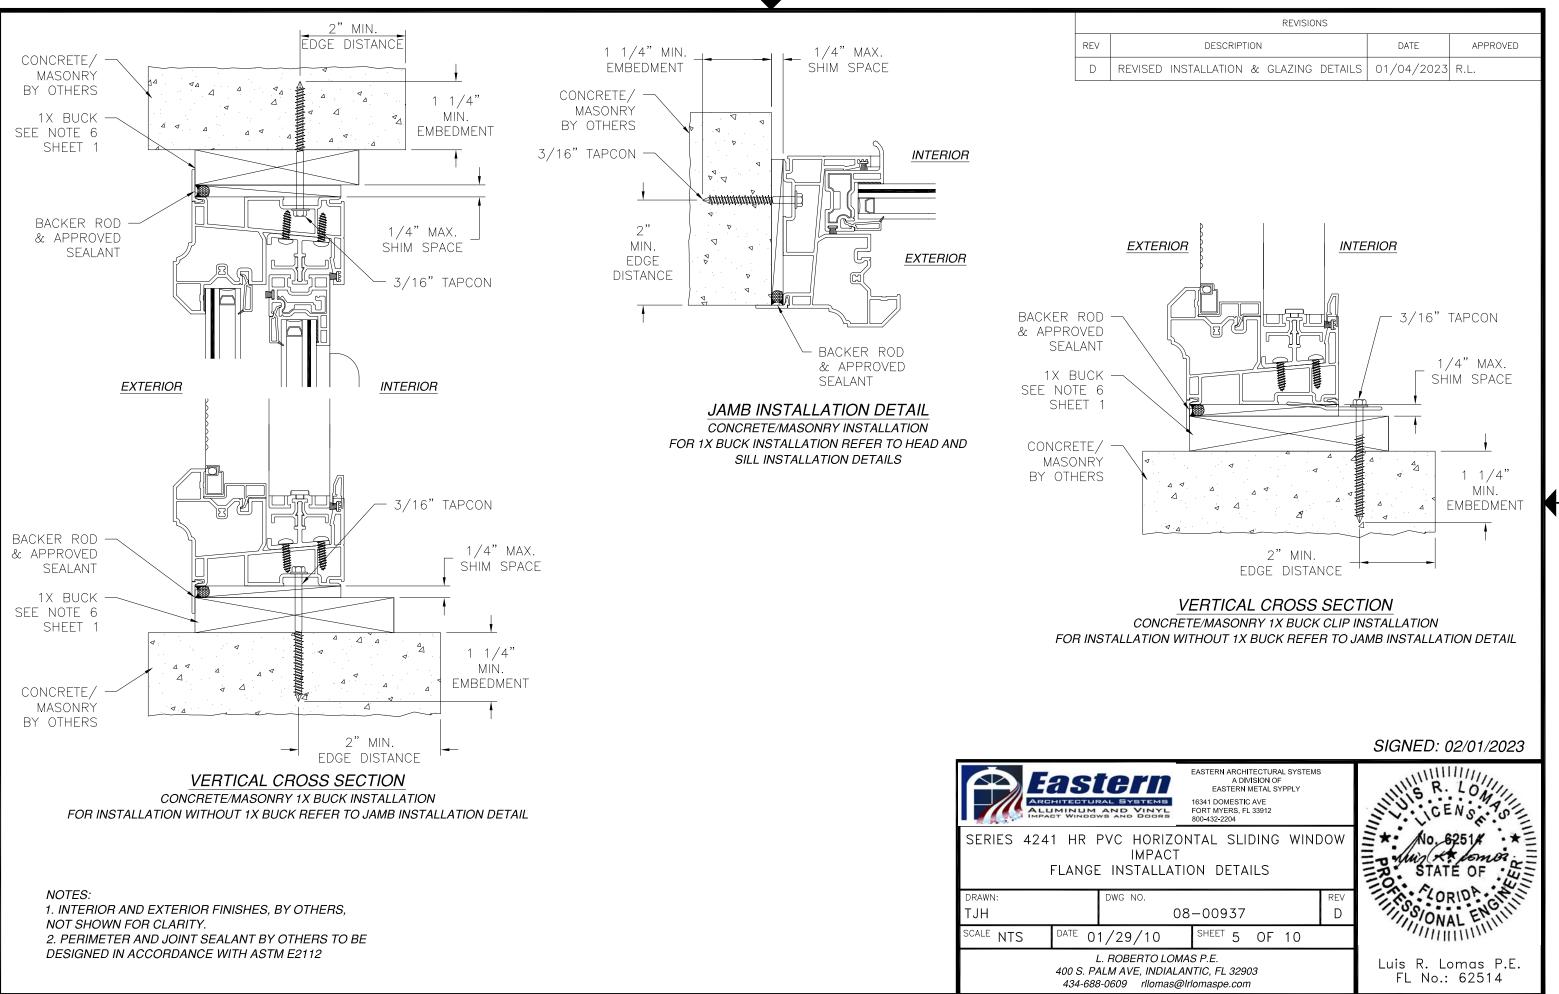

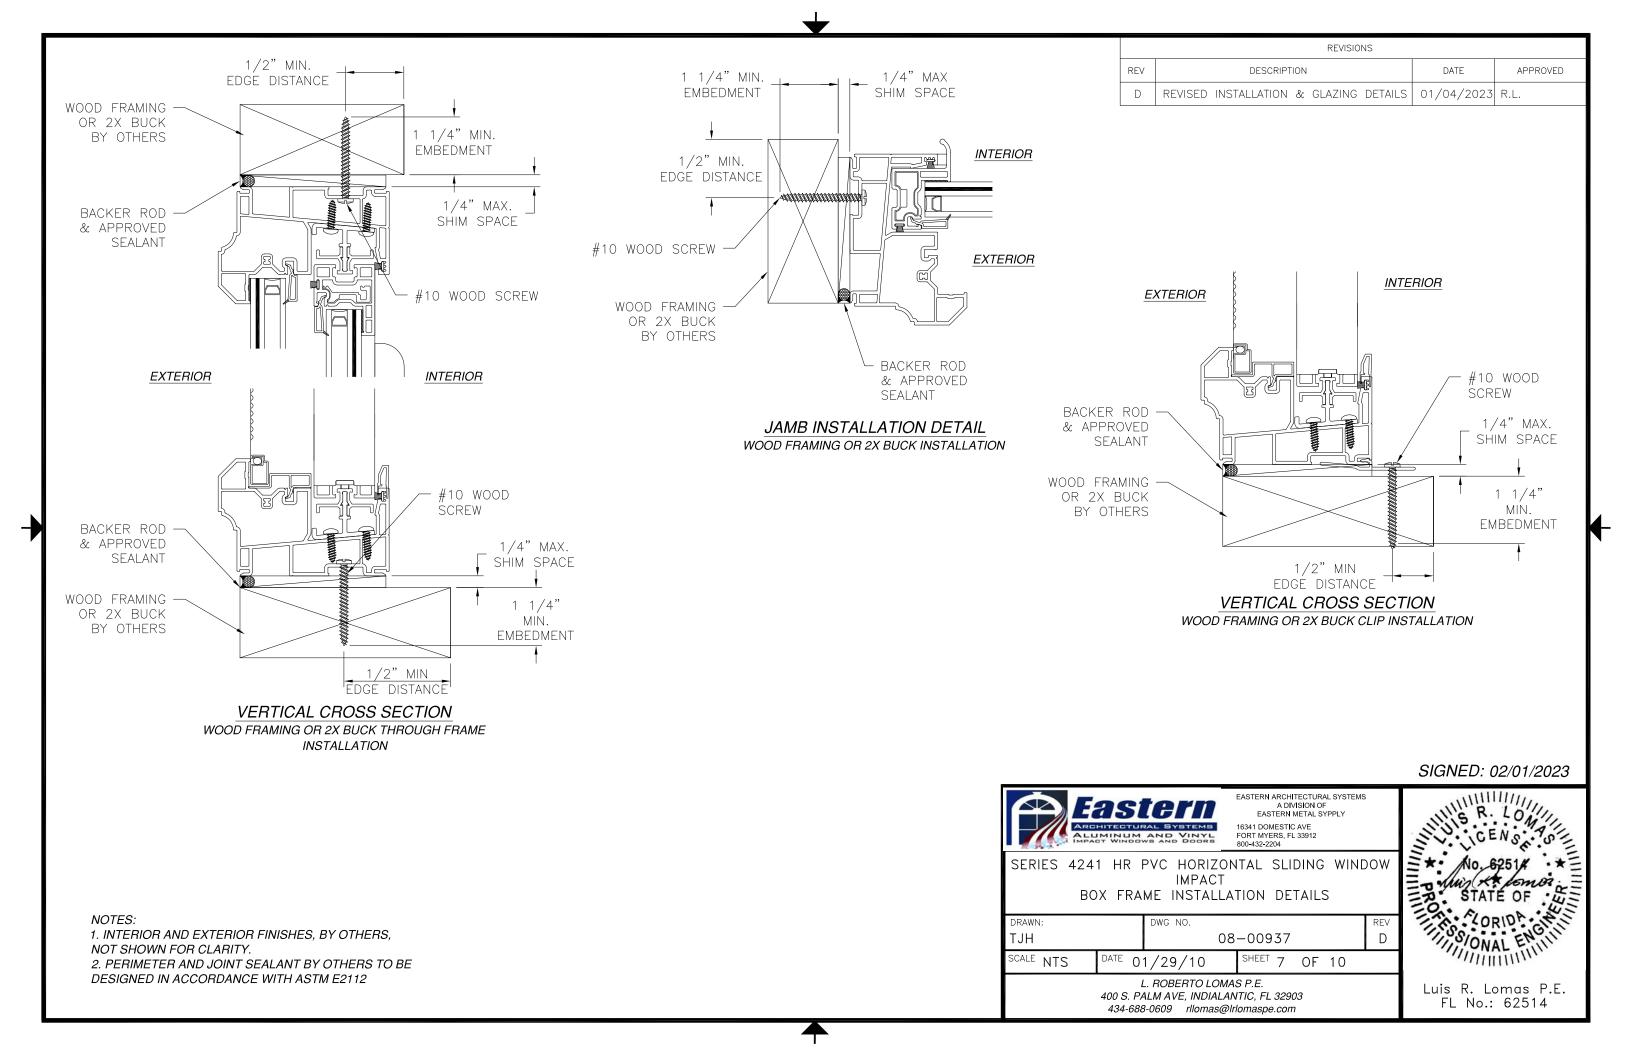

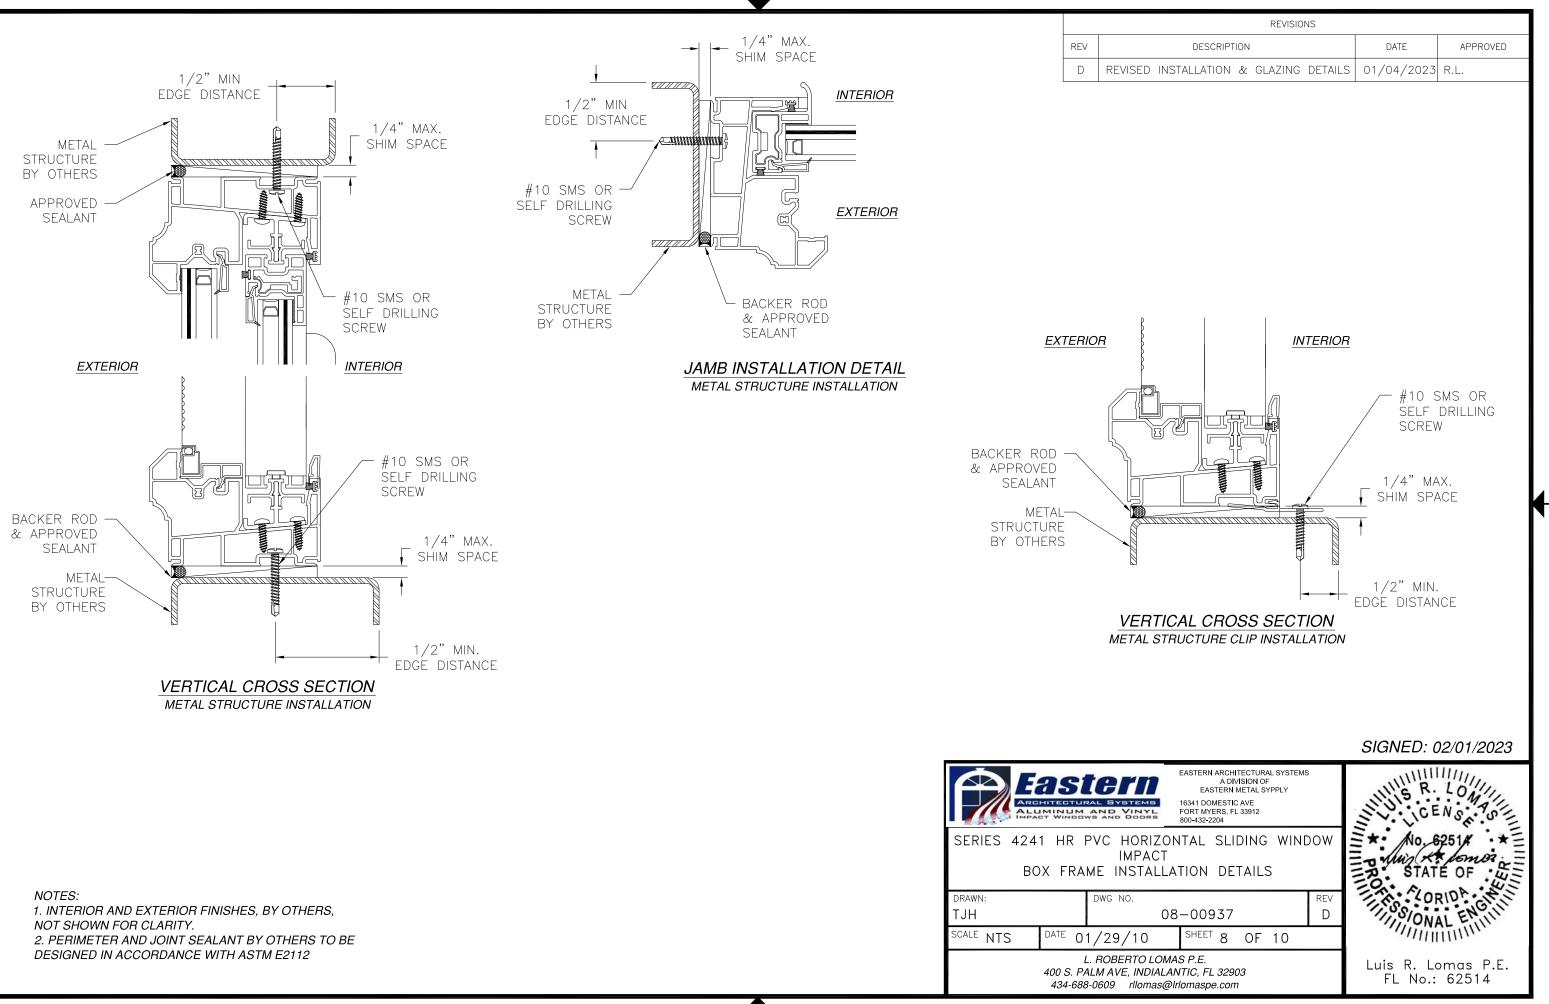

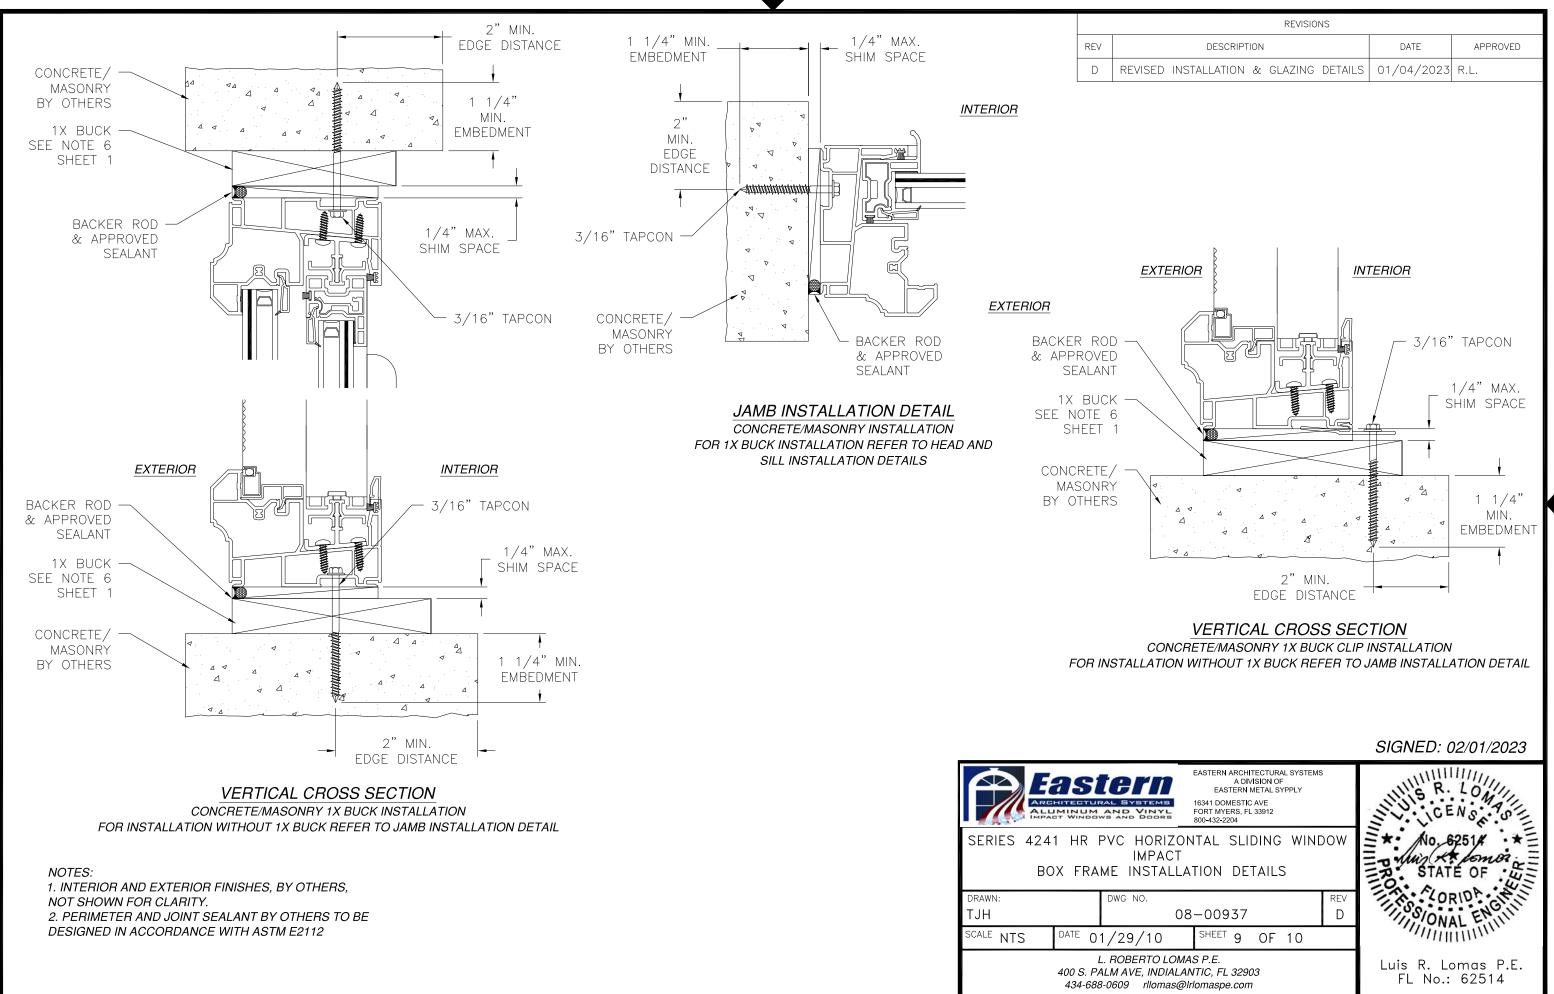

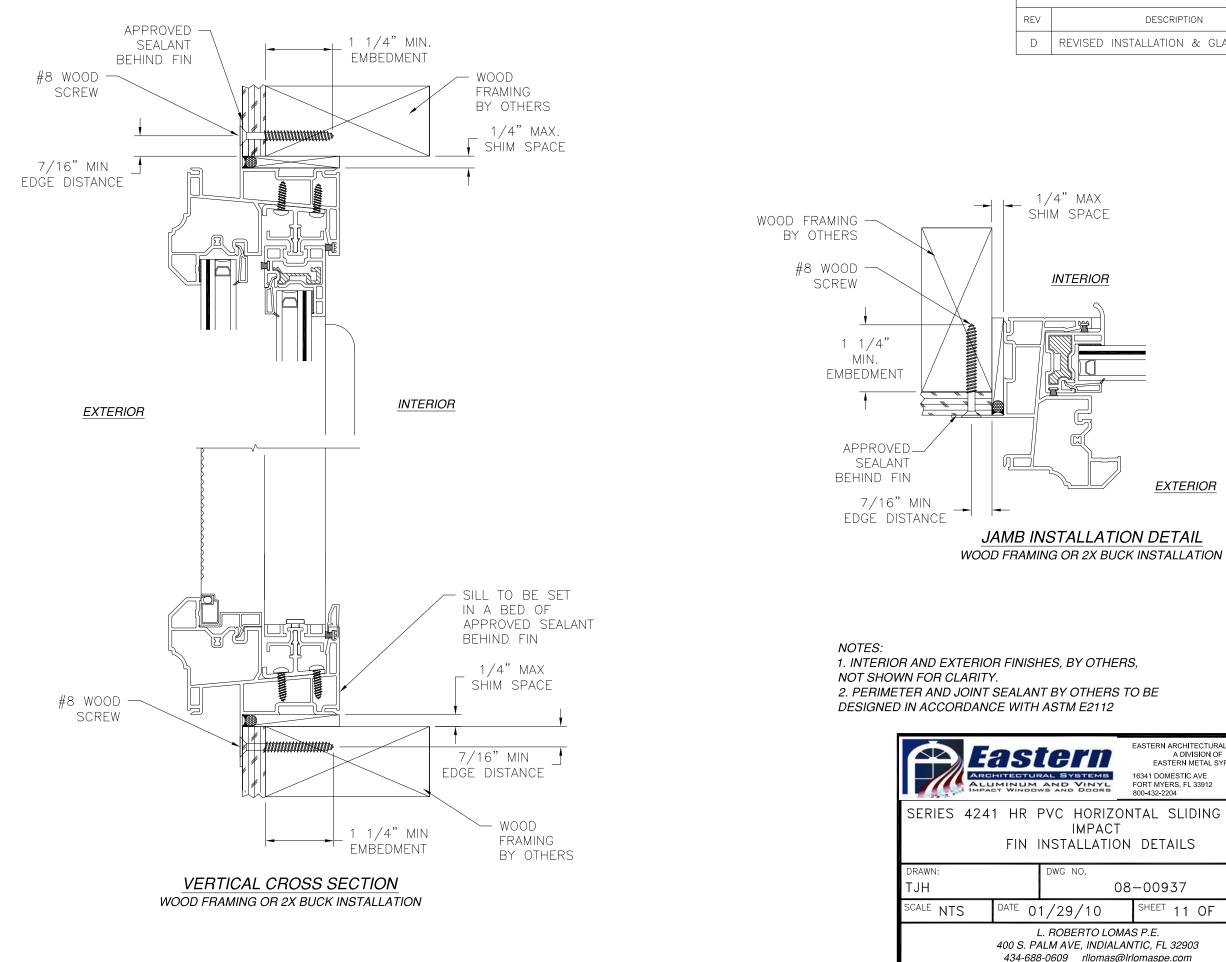


 $\mathbf{T}$ 

REVISIONS			
DESCRIPTION		DATE	APPROVED
ED INSTALLATION & GL	AZING DETAILS	01/04/2023	R.L.

EXTERIOR

EASTERN ARCHITECTURAL SYSTEMS A DIVISION OF EASTERN METAL SYPPLY 16341 DOMESTIC AVE FORT MYERS, FL 33912 800-432-2204	LICENS TOT
PRIZONTAL SLIDING WIND PACT ATION DETAILS	OW
08-00937	D SONAL ENUL
0 SHEET 11 OF 10	
O LOMAS P.E. NDIALANTIC, FL 32903 iomas@Irlomaspe.com	Luis R. Lomas P.E. FL No.: 62514

SIGNED: 02/01/2023

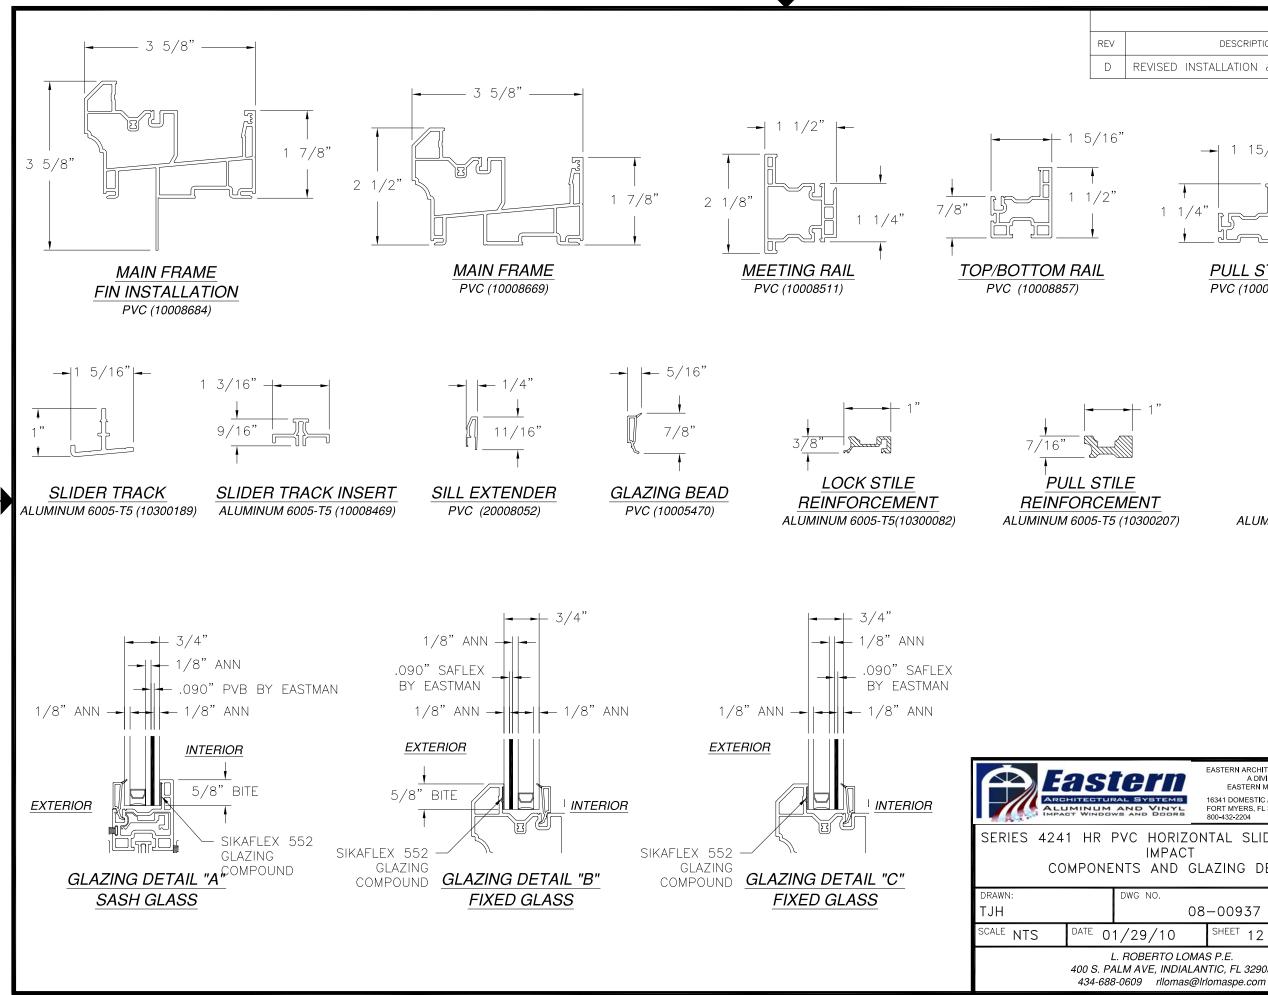

REVISIONS			
DESCRIPTION	DATE	APPROVED	
ED INSTALLATION & GLAZING DETAIL	S 01/04/2023	R.L.	
→ 1 15/16" 1 1/4" → 1 1 → 1 15/16" → 1 11 → 1 15/16" → 1 11 → 1 15/16" → 1 11 → 1 15/16" → 1 15/16"		∫5/8" ∱ STILE	
			€-
	SIGNED: (	02/01/2023	
EASTERN ARCHITECTURAL SYSTEMS A DIVISION OF EASTERN METAL SYPPLY 16341 DOMESTIC AVE FORT MYERS, FL 33912 800-432-2204 ORIZONTAL SLIDING WINDOW		LOMA NSK-7011	
PACT ND GLAZING DETAIL	R STAT	E OF	
08-00937 D	III SION	AL ENUITIN	
10 SHEET 12 OF 10 TO LOMAS P.E. INDIALANTIC, FL 32903 Ilomas@Irlomaspe.com	Luis R. Lo FL No.:		