

NAIL FIN INSTALLATION

Max Frame	DP	IMP <i>AC</i> T
73 x 84	+35/-40	NO
	•	•

JAMB SECTION (TYP)
HORIZONTAL SECTION

Installation Notes:

- Seal flange/frame to substrate. Sill shall be set on a continuous serpentine bead of structural grade silicone caulk when no fastener is used to anchor the sill (typical).
- Use #8 PH or greater fastener through the nail fin with sufficient length to penetrate a minimum of 1 1/2" into the wood framing. For two (2X) wood frame substrate (min. S.G. = 0.42).
- Host structure (wood buck, masonry, steel) to be designed and anchored to properly transfer all loads to the structure. The host structure is the responsibility of the architect or engineer of record for the project of installation.


This schedule addresses only the fasteners required to anchor the window to achieve the rated design pressure up to the size limitations noted. It is not intended as a guide to the installation process and does not address the sealing consideration that may arise in different wall conditions. For the complete installation procedure, see the instructions packaged with the window or go to www.jeld-wen.com/resources/installation.


DISCLAIMER:

This drawing and its contents are confidential and are not to be reproduced or copied in whole or in part or used or disclosed to others except as authorized by JELD-WEN Inc.


- The product shown herein is designed, tested and manufactured to comply with the wind load criteria of the adopted International Building Code (IBC), the International Residential Code (IRC), the current Florida Building Code (FBC) and the industry requirement for the stated conditions.
- 2. All glazing shall conform to ASTM E1300.
- 3. At minimum, glazing shall be double strength annealed insulated glass.
- 4. Use structural or composite shims where required.



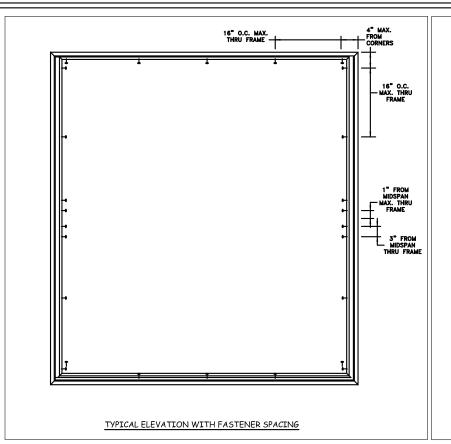

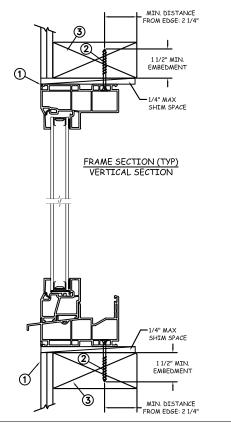

THROUGH FRAME INSTALLATION

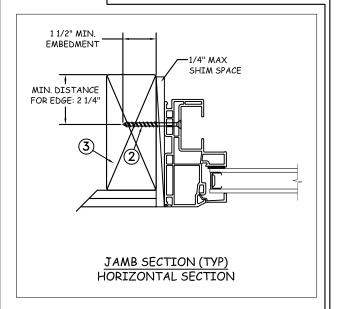

Max Frame	DP	IMPACT
73 x 84	+35/-40	NO
		-

Installation Notes:


- Seal flange/frame to substrate. Sill shall be set on a continuous serpentine bead of structural grade silicone caulk when no fastener is used to anchor the sill (typical).
- Use #8 PH or greater fastener through the frame with sufficient length to penetrate a minimum of 1 1/2" into the wood framing. For two (2X) wood frame substrate (min. S.G. = 0.42).
- Host structure (wood buck, masonry, steel) to be designed and anchored to properly transfer all loads
 to the structure. The host structure is the responsibility of the architect or engineer of record for the
 project of installation.

This schedule addresses only the fasteners required to anchor the window to achieve the rated design pressure up to the size limitations noted. It is not intended as a guide to the installation process and does not address the sealing consideration that may arise in different wall conditions. For the complete installation procedure, see the instructions packaged with the window or go to www.jeld-wen.com/resources/installation.


DISCLAIMER:

This drawing and its contents are confidential and are not to be reproduced or copied in whole or in part or used or disclosed to others except as authorized by JELD-WEN Inc.


- The product shown herein is designed, tested and manufactured to comply with the wind load criteria of the adopted International Building Code (IBC), the International Residential Code (IRC), the current Florida Building Code (FBC) and the industry requirement for the stated conditions.
- 2. All glazing shall conform to ASTM E1300.
- 3. At minimum, glazing shall be double strength annealed insulated glass.
- 4. Use structural or composite shims where required.

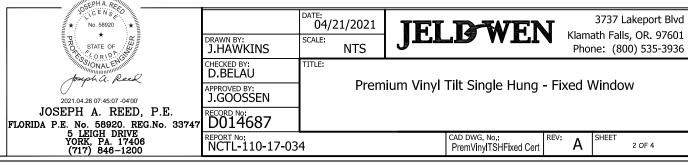

16" O.C. MAX. THRU FRAME MIDSPAN 3" FROM TYPICAL ELEVATION WITH FASTENER SPACING

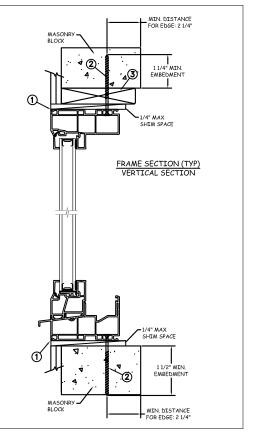

MASONRY INSTALLATION

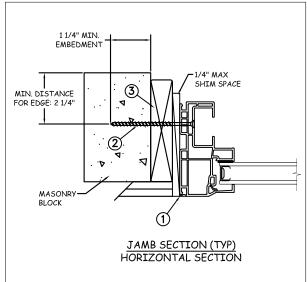

Max Frame	DP	IMPACT
73 x 84	+35/-40	NO

Installation Notes:

- 1. Seal flange/frame to substrate. Sill shall be set on a continuous serpentine bead of structural grade silicone caulk when no fastener is used to anchor the sill (typical).
- Use 3/16" Tapcon or equivalent fastener through frame with sufficient length to penetrate a minimum of 1 1/4" into concrete (min. f'c = 3000 psi) or masonry (per ASTM = C-90).
- 3. Host structure (wood buck, masonry, steel) to be designed and anchored to properly transfer all loads to the structure. The host structure is the responsibility of the architect or engineer of record for the project of installation.

This schedule addresses only the fasteners required to anchor the window to achieve the rated design pressure up to the size limitations noted. It is not intended as a guide to the installation process and does not address the sealing consideration that may arise in different wall conditions. For the complete installation procedure, see the instructions packaged with the window or go to www.jeld-wen.com.


DISCLAIMER:

This drawing and its contents are confidential and are not to be reproduced or copied in whole or in part or used or disclosed to others except as authorized by JELD-WEN Inc.


- The product shown herein is designed, tested and manufactured to comply with the wind load criteria of the adopted International Building Code (IBC), the International Residential Code (IRC), the current Florida Building Code (FBC) and the industry requirement for the stated conditions.
- 2. All glazing shall conform to ASTM E1300.
- 3. At minimum, glazing shall be double strength annealed insulated glass.
- 4. Use structural or composite shims where required.



FROM CORNERS 16" O.C. MAX. THRU FRAME MIDSPAN 3" FROM TYPICAL ELEVATION WITH FASTENER SPACING

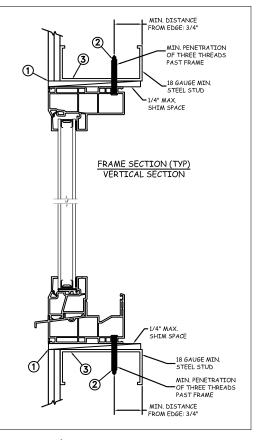

STEEL INSTALLATION

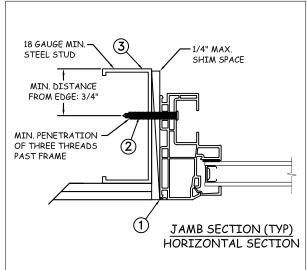

Max Frame	DP DP	IMPACT
73 × 84	+35/-40	NO
/3 X 84	+35/-40	

Installation Notes:

- 1. Seal flange/frame to substrate. Sill shall be set on a continuous serpentine bead of structural grade silicone caulk when no fastener is used to anchor the sill (typical).
- For anchoring into metal framing, use #10 TEK Self Tapping screws with sufficient length to achieve a
 minimum penetration of three threads past the frame thickness. Locate anchors as shown in elevations
 and installation details. Steel substrate min. 18ga., fy = 33 ksi.
- Host structure (wood buck, masonry, steel) to be designed and anchored to properly transfer all loads to the structure. The host structure is the responsibility of the architect or engineer of record for the project of installation.

This schedule addresses only the fasteners required to anchor the window to achieve the rated design pressure up to the size limitations noted. It is not intended as a guide to the installation process and does not address the sealing consideration that may arise in different wall conditions. For the complete installation procedure, see the instructions packaged with the window or go to www.jeld-wen.com.

DISCLAIMER:

This drawing and its contents are confidential and are not to be reproduced or copied in whole or in part or used or disclosed to others except as authorized by JELD-WEN Inc.

- The product shown herein is designed, tested and manufactured to comply with the wind load criteria of the adopted International Building Code (IBC), the International Residential Code (IRC), the current Florida Building Code (FBC) and the industry requirement for the stated conditions.
- 2. All glazing shall conform to ASTM E1300.
- 3. At minimum, glazing shall be double strength annealed insulated glass.
- 4. Use structural or composite shims where required.

