REVISIONS							
REV	DESCRIPTION	DATE	APPROVED				
Ι	ADDED MULTILITE PANELS & TRIMS	08/10/2021	R.L.				

NOTES


- 1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH REQUIREMENTS OF THE FLORIDA BUILDING CODE.
- 2. WOOD FRAMING, METAL STRUCTURE AND MASONRY OPENING TO BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO STRUCTURE. FRAMING AND MASONRY OPENING IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.
- 3. 1X BUCK OVER MASONRY/CONCRETE IS OPTIONAL. WHERE 1X BUCK IS NOT USED DISSIMILAR MATERIALS MUST BE SEPARATED WITH APPROVED COATING OR MEMBRANE. SELECTION OF COATING OR MEMBRANE IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.
- 4. ALLOWABLE STRESS INCREASE OF 1/3 WAS NOT USED IN THE DESIGN OF THE PRODUCT SHOWN HEREIN. WIND LOAD DURATION FACTOR Cd=1.6 WAS USED FOR WOOD ANCHOR CALCULATIONS.
- 5. FRAME MATERIAL: WOOD WITH G=.46 MINIMUM SPECIFIC GRAVITY, OR COMPOSITE, OR FRAMESAVER, OR FUSION FRAME.


 DOOR SKIN MATERIAL: STEEL .033" THICK (MINIMUM)
- 6. UNITS MUST BE GLAZED PER ASTM E1300, SEE SHÉET 7 FOR GLASS DETAILS.
- 7. APPROVED IMPACT PROTECTIVE SYSTEM <u>IS NOT REQUIRED</u> FOR THIS PRODUCT IN WIND BORNE DEBRIS REGIONS.
- 8. SHIM AS REQUIRED AT EACH INSTALLATION ANCHOR WITH LOAD BEARING SHIM. SHIM WHERE SPACE OF 1/16" OR GREATER OCCURS. MAXIMUM ALLOWABLE SHIM STACK TO BE 1/4".
- 9. FOR ANCHORING INTO WOOD FRAMING OR 2X BUCK USE #8 WOOD SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE A 1 1/4" MINIMUM EMBEDMENT INTO SUBSTRATE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
- 10. FOR ANCHORING INTO MASONRY/CONCRETE USE 3/16" TAPCONS WITH SUFFICIENT LENGTH
 TO ACHIEVE A 1 3/4" MINIMUM EMBEDMENT INTO SUBSTRATE WITH 2" MINIMUM EDGE
 DISTANCE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
- 11. FOR ANCHORING INTO METAL STRUCTURE USE #8 SMS OR SELF DRILLING SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE 3 THREADS MINIMUM BEYOND STRUCTURE INTERIOR WALL. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.


- 12. ALL FASTENERS TO BE CORROSION RESISTANT.
- 13. INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BELOW:
 - A. WOOD MINIMUM SPECIFIC GRAVITY OF G=0.42
 - B. CONCRETE MINIMUM COMPRESSIVE STRENGTH OF 3,192 PSI.
 - C. MASONRY GROUT FILLED STRENGTH CONFORMANCE TO ASTM C-90, GRADE N, TYPE 1 (OR GREATER).
 - D. METAL STRUCTURE: STEEL 18GA, 33KSI OR ALUMINUM 6063-T5 .048" THICK MINIMUM


SIGNED: 09/07/2021


		PROVIA, LLC. 2150 state route 39 west sugarcreek, oh 44681					IN CENSO. TO	
	TABLE OF CONTENTS	STEEL INSW	'ING GL		- SINGLE & DO	JBLE	E ★ No. 6251# .*	
HEET NO. DESCRIPTION		IMPACT NOTES					STATE OF	
1	NOTES	DRAWN:		DWG NO.		REV	TORIDA .	
2	ELEVATIONS	V.L.		08-01957		Н	MONAL ENGLI	
3 – 6	INSTALLATION DETAILS	SCALE NTS	DATE 0	3/05/13	SHEET 1 OF 10		Milling	
7	GLAZING DETAILS	L. ROBERTO LOMAS P.E. ———————————————————————————————————					Luis R. Lomas P.E.	
8 - 10	COMPONENTS	434-688-0609		· · · · · · · · · · · · · · · · · · ·			FL No.: 62514	

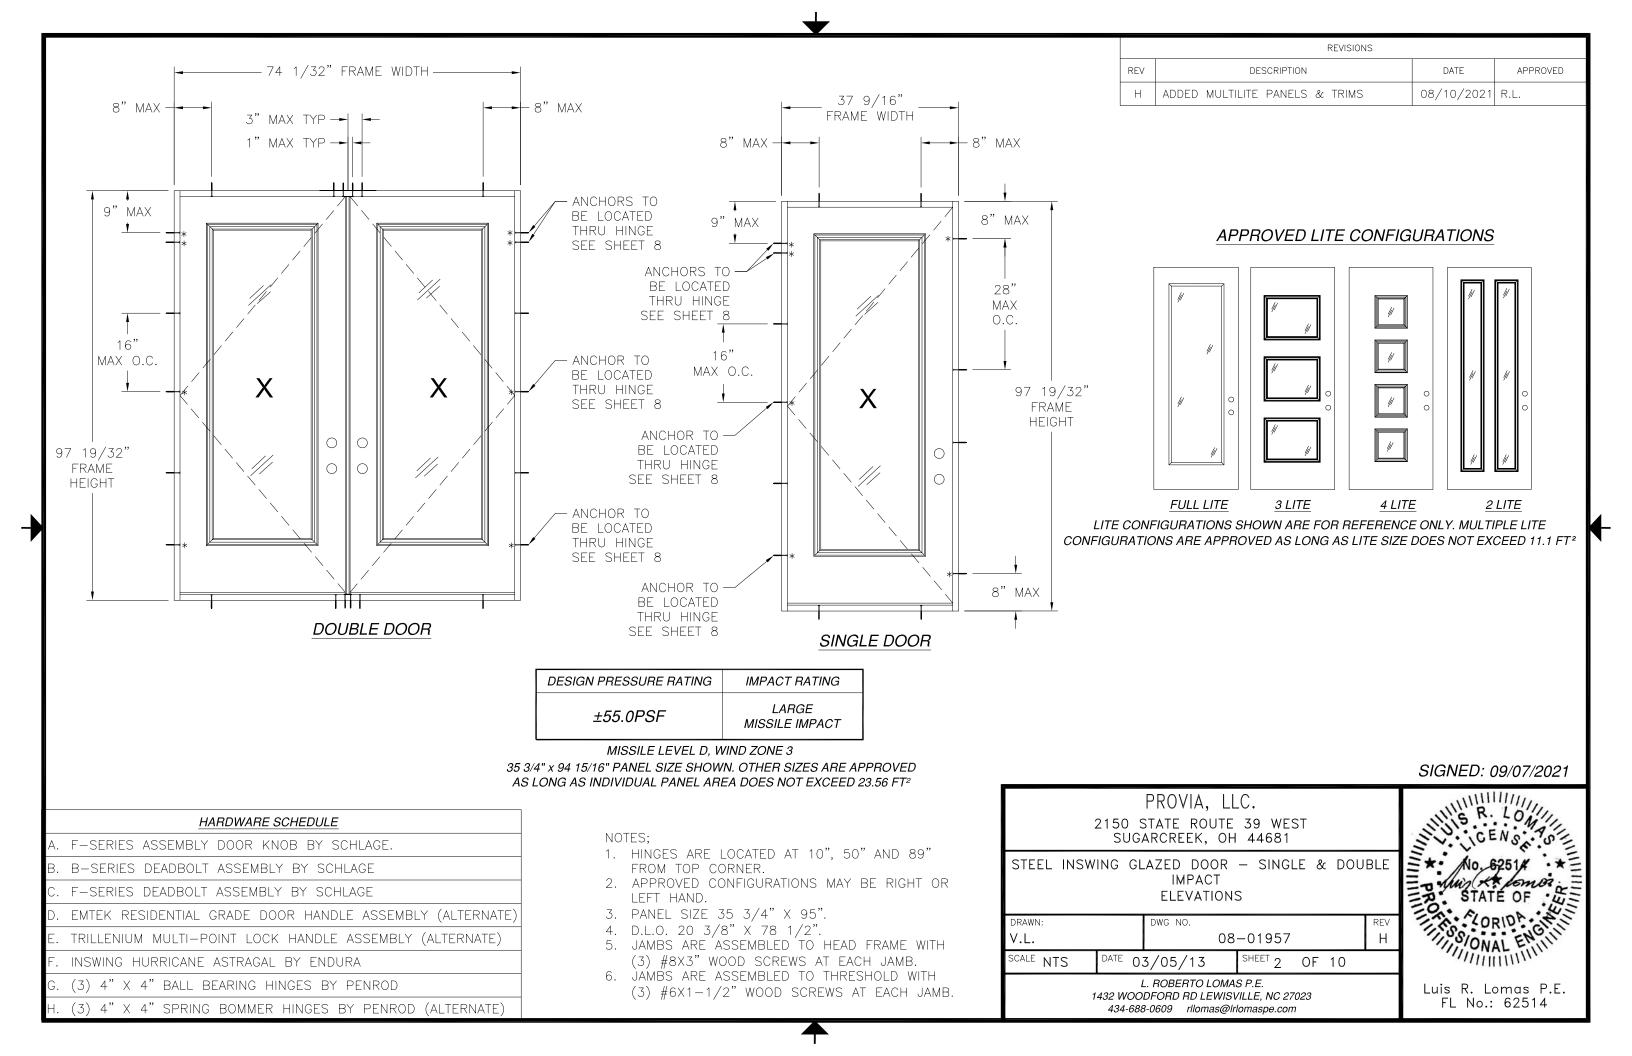

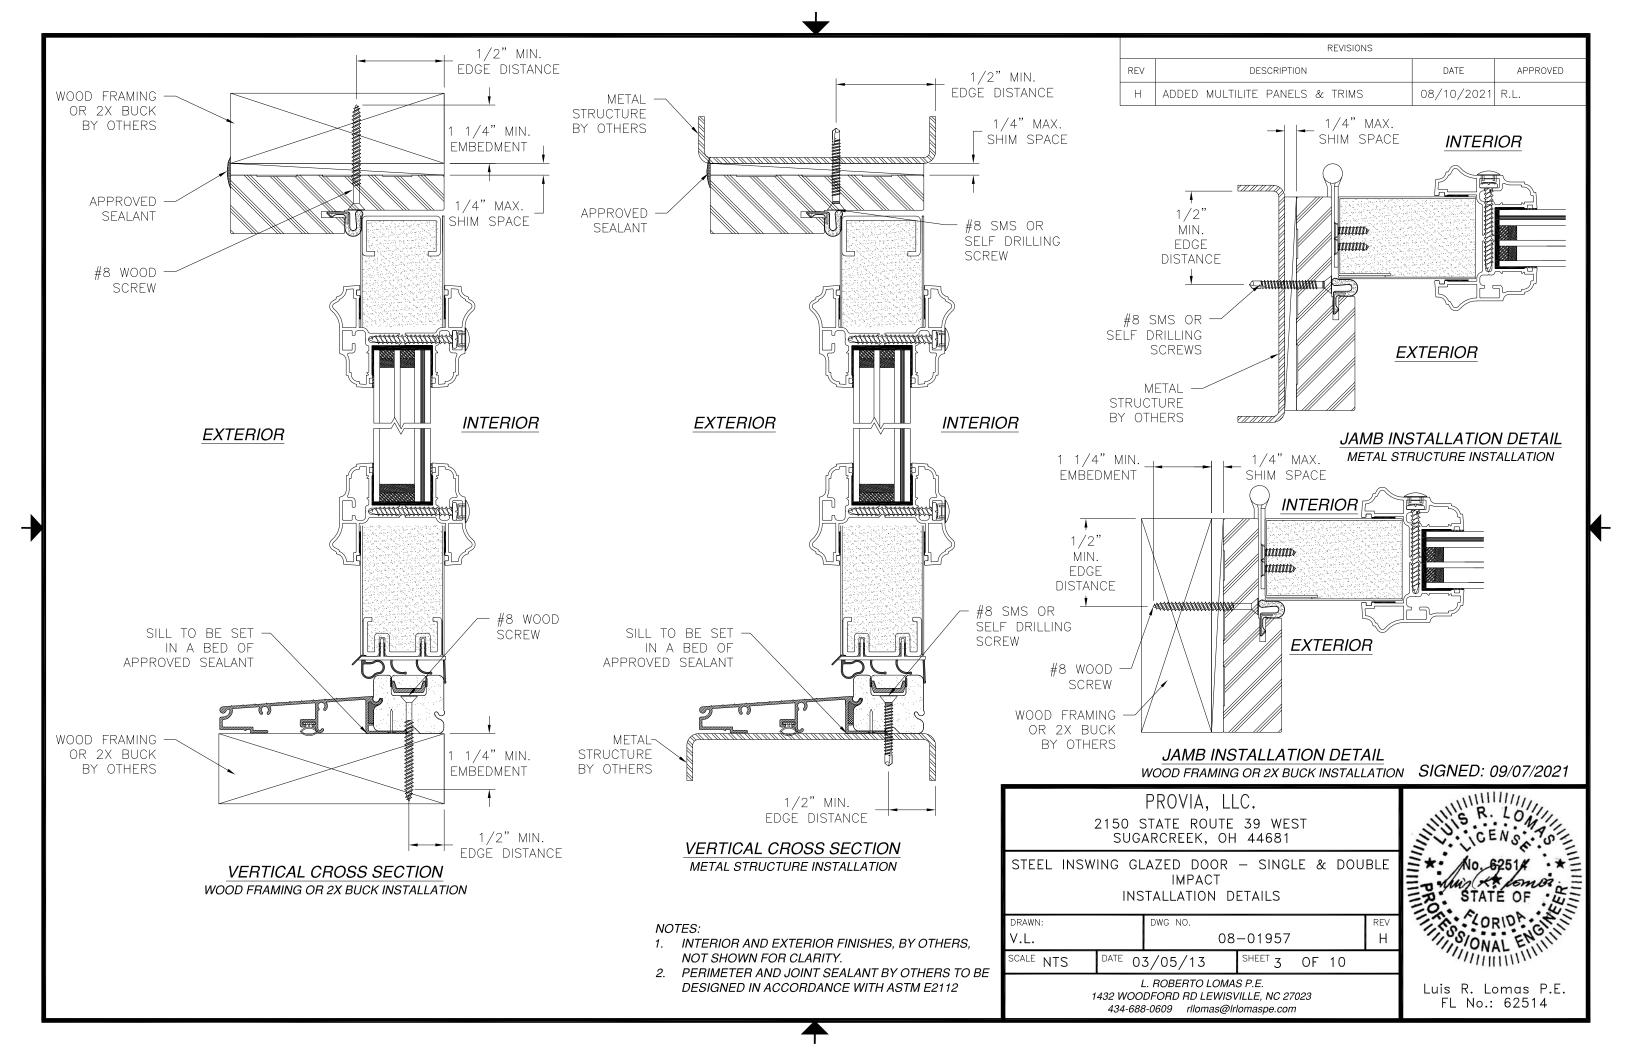

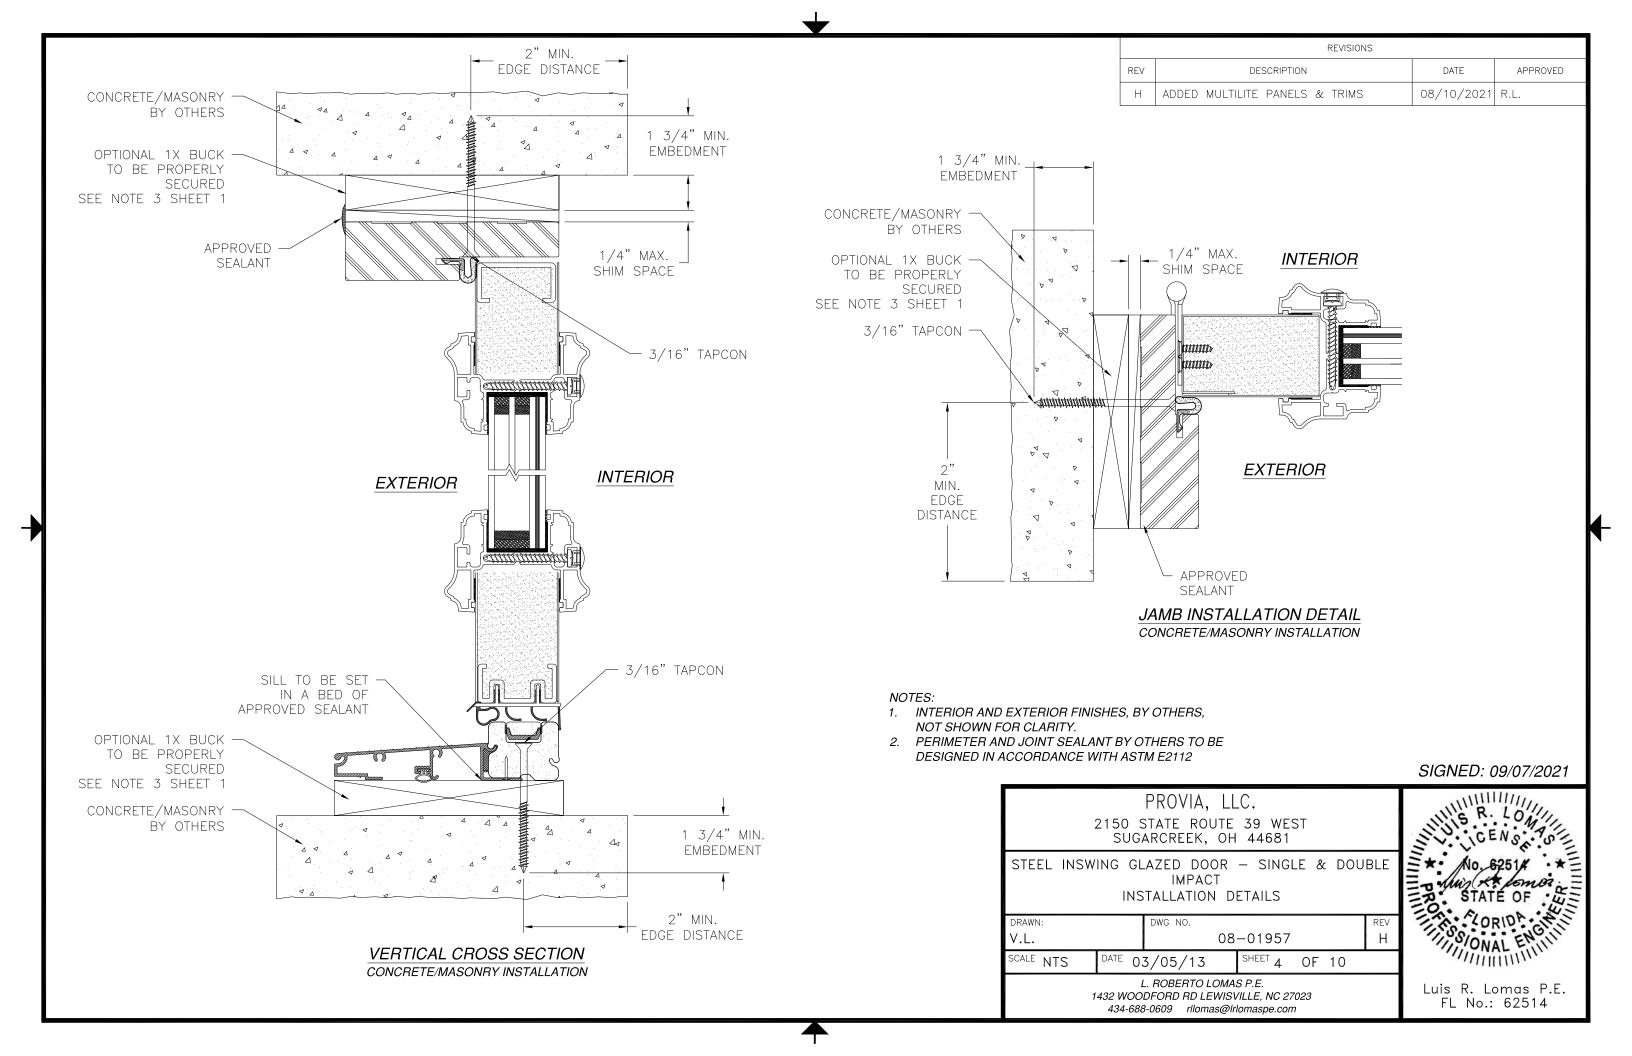

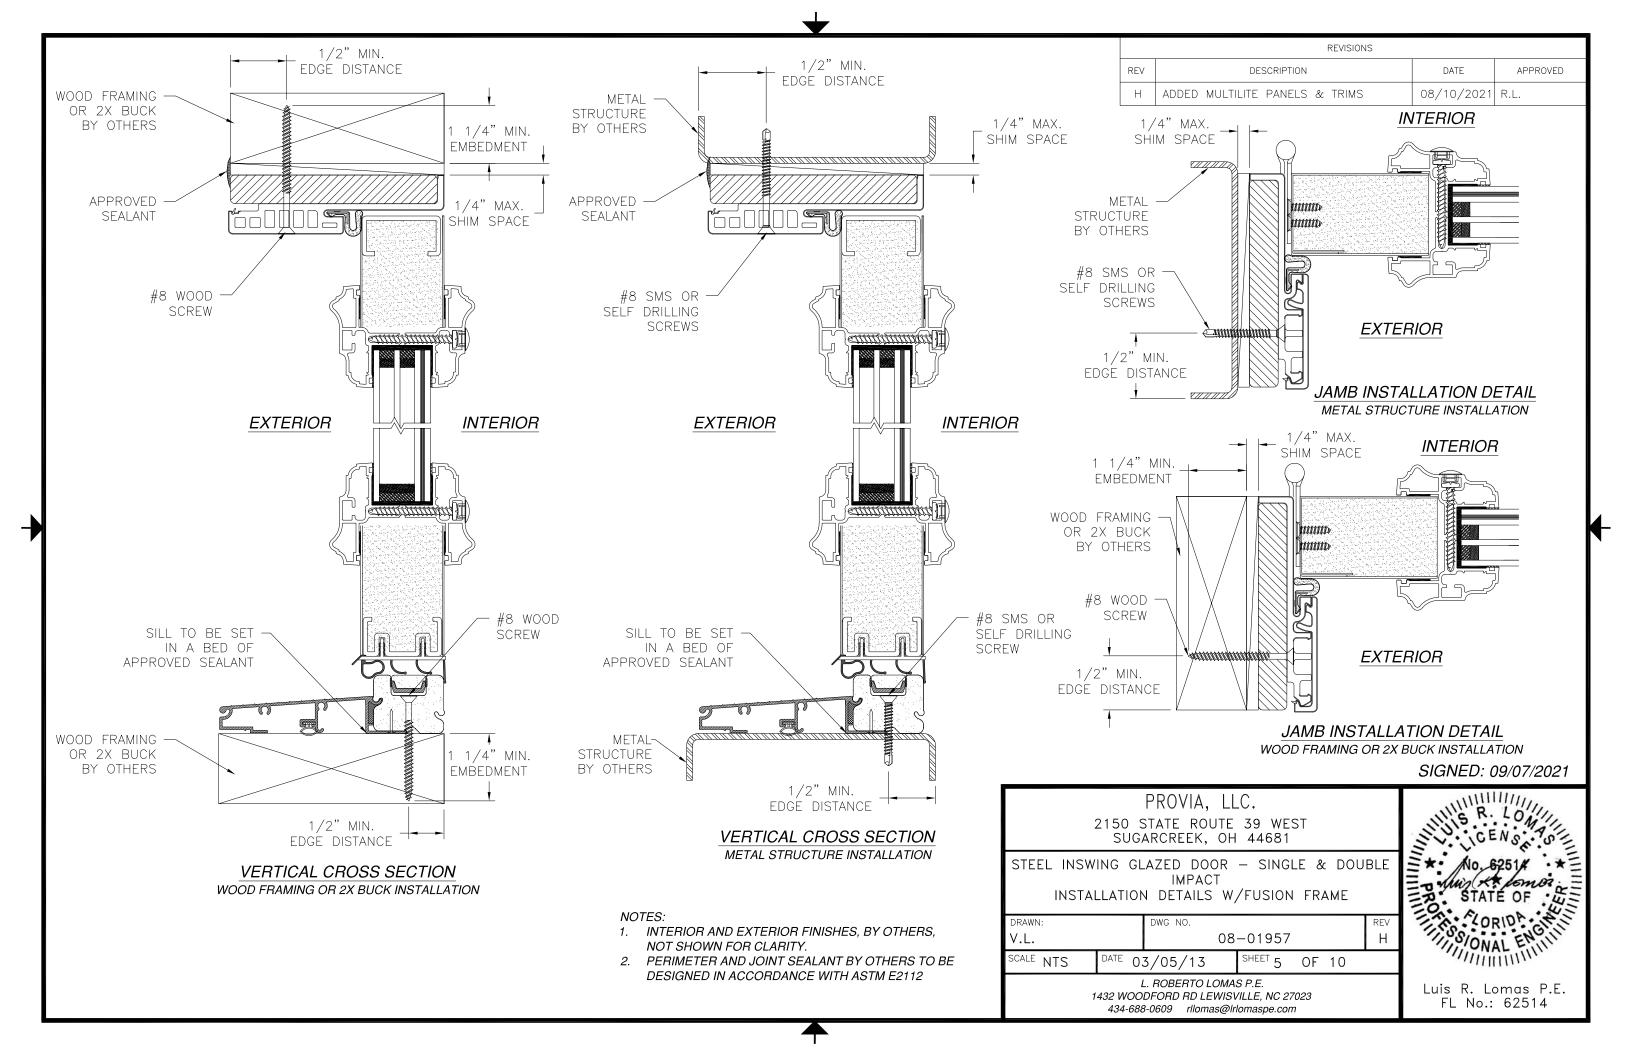


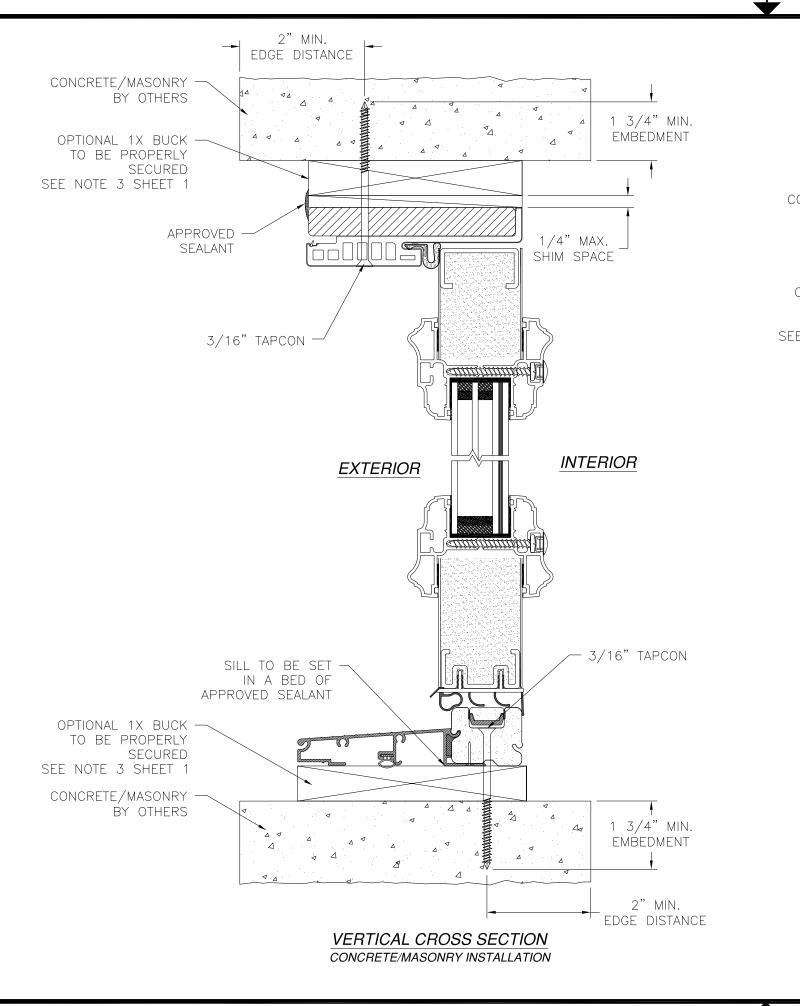

REVISIONS

REV DESCRIPTION DATE APPROVED

H ADDED MULTILITE PANELS & TRIMS 08/10/2021 R.L.

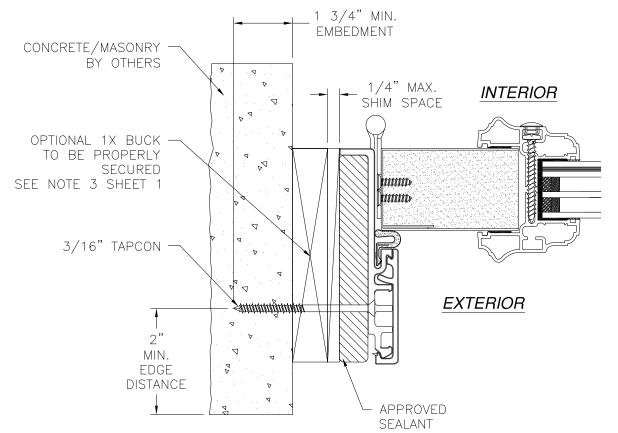


JAMB INSTALLATION DETAIL CONCRETE/MASONRY INSTALLATION


NOTES:


- 1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
- 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

SIGNED: 09/07/2021

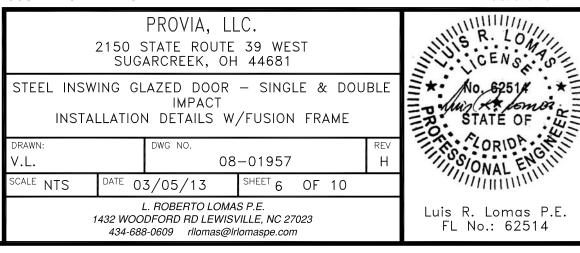



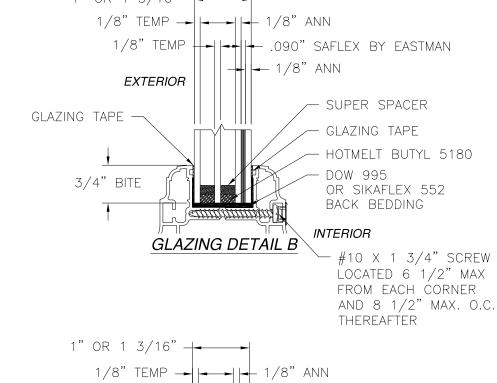

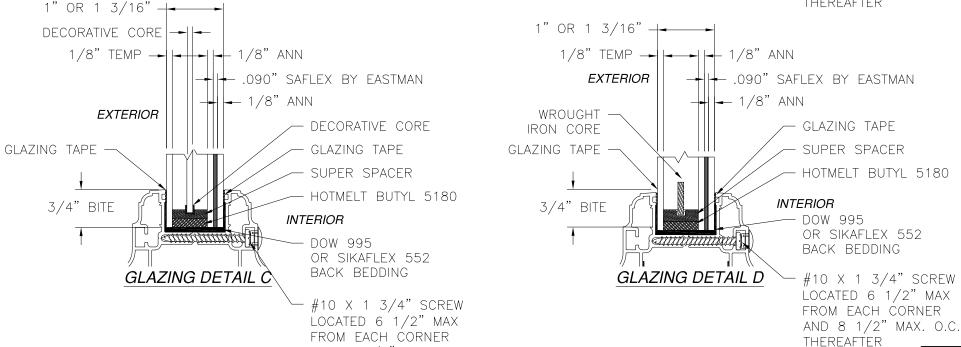

SUPER SPACER

GLAZING TAPE

DOW 995

INTERIOR

HOTMELT BUTYL 5180

#10 X 1 3/4" SCREW LOCATED 6 1/2" MAX

AND 8 1/2" MAX. O.C.

AND 8 1/2" MAX. O.C.

THEREAFTER

FROM EACH CORNER

OR SIKAFLEX 552

BACK BEDDING

THEREAFTER

EXTERIOR


GLAZING DETAIL A


GLAZING TAPE -

3/4" BITE

SIGNED: 09/07/2021

	2150 S SUG	CENSO TO					
STEEL INSWI	NG GL	No. 62514 *					
DRAWN: V.L.		DWG NO.	-01957			rev H	ONAL ENGINE
BCALE NTS	DATE O	3/05/13	SHEET 7	OF	10		Milling
14	l 432 WOO 434-688	Luis R. Lomas P.E. FL No.: 62514					





#8 X 5/8"


#8 X 5/8"

WOOD SCREW


WOOD ŚCREW

ASTRAGAL BOLT HOLE MUST BE DRILLED THROUGH SILL AND INTO SUBSTRATE DEEP ENOUGH TO ACHIEVE 1 3/8" THROW


ASTRAGAL SILL DETAIL




ASTRAGAL HEAD STRIKE DETAIL MASONRY/CONCRETE




ASTRAGAL HEAD STRIKE DETAIL 2X BUCK/WOOD FRAMING



SIGNED: 09/07/2021

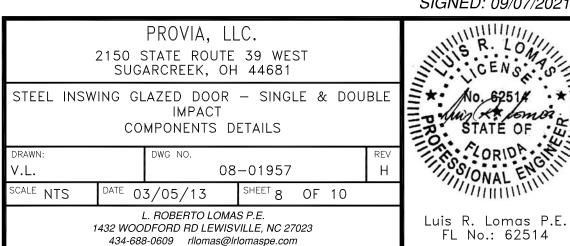

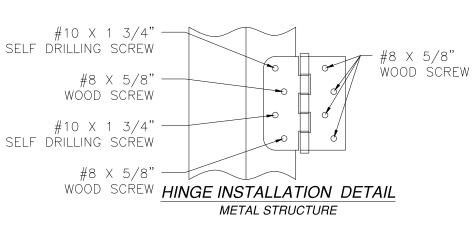

TAPCON HINGE INSTALLATION DETAIL

MASONRY/CONCRETE

WOOD SCREW HINGE INSTALLATION DETAIL

2X BUCK/WOOD FRAMING

0

#10 X 2 1/2" —

#8 X 5/8" -WOOD SCREW

WOOD SCREW

#10 X 2 1/2" -WOOD SCREW

#8 X 5/8"

3/16' X 3 1/4" —

TAPCON

#8 X 5/8" -WOOD SCREW

#8 X 5/8" -

WOOD SCREW

3/16' X 3 1/4"



