





GENERAL NOTES

1. EVALUATED FOR USE IN LOCATIONS ADHERING TO THE FLORIDA BUILDING CODE AND WHERE PRESSURE REQUIREMENTS AS DETERMINED BY ASCE 7, MINIMUM DESIGN LOADS FOR BUILDINGS AND OTHER STRUCTURES, DOES NOT EXCEED THE DESIGN PRESSURES LISTED.
2. HURRICANE PROTECTIVE SYSTEM (SHUTTERS) IS NOT REQUIRED.
3. IN THE HVHZ, FACTORY PRIMED DOORS MUST BE PAINTED IN ACCORDANCE WITH SECTION 2220 OF THE FBC.
4. POLYURETHANE CORE FLAME SPREAD INDEX OF 50 AND SMOKE DEVELOPED INDEX OF 60 PER ASTM E84.

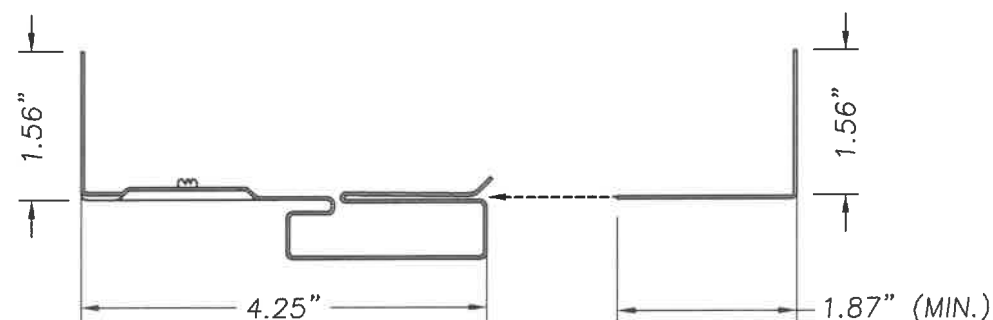

TWO-PIECE ADJUSTABLE STEEL FRAME (20GA.)

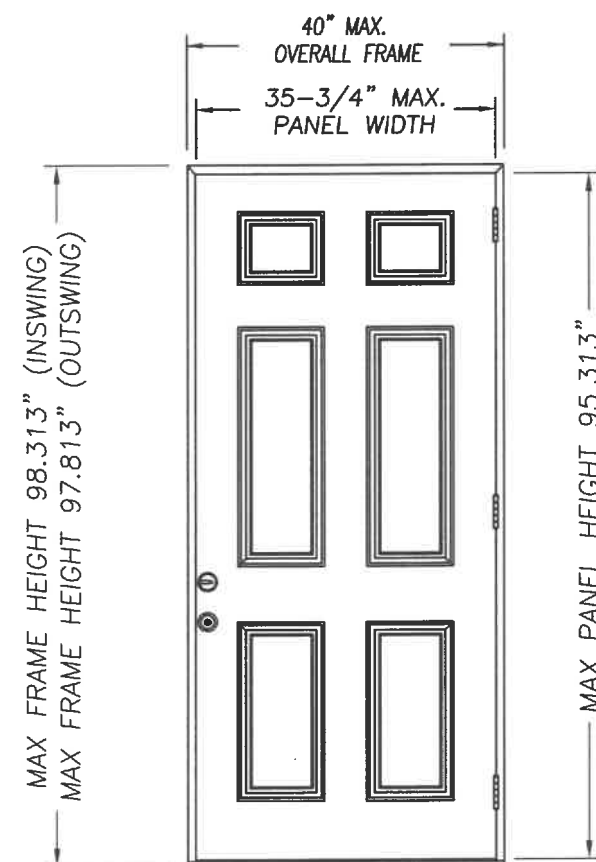

SINGLE DOOR UNIT

		DESIGN PRESSURE RATING (1:1 OVERHANG OR WHERE NO WATER REQUIRED)			WHERE WATER INFILTRATION PERFORMANCE IS REQUIRED TO BE 15% OF DESIGN PRESSURE		
CONFIG	MAX WIDTH	INSWING OR ADA	OUTSWING	BUMP O/S ADA*	INSWING OR ADA	OUTSWING	BUMP O/S ADA*
X	39.125"	+65.0 / -65.0	+65.0 / -65.0	+55.0 / -55.0	NA	+55.0 / -55.0	+55.0 / -55.0

* REQUIRES THE ADDITION OF PEMKO S88 GASKET AND PEMKO 305CR TO FRAME JAMBS AND PEMKO 3452AV SWEEP APPLIED TO THE DOOR SLAB IN ACCORDANCE WITH PEMKO INSTRUCTIONS.

TABLE OF CONTENTS	
SHEET #	DESCRIPTION
1	TYPICAL ELEVATIONS & GENERAL NOTES
2	ANCHORING LOCATIONS & DETAILS

[illegible]

DATE: 05/29/13

SCALE: N.T.S.

DWG. BY: TR

CHK. BY:

DRAWING NO.:

DWG-MA-FL0179-11

SHEET 1 OF 2

MASONITE INTERNATIONAL CORP.
1955 POWIS RD.
WEST CHICAGO, IL 60185

DUCT:
"EXTERIOR DOOR PRODUCT"
METAL-EDGE STEEL DOOR
IN TWO-PIECE STEEL FRAME

ASSEMBLY:
TYPICAL ELEVATIONS
& GENERAL NOTES

BY	
SWS	
SWS	

MISC EDITS
ANCHOR REVISIONS11/5/20
5/28/15
DATE

B	A	VO.
---	---	-----

/29/13

N.T.S.

TR

10

0.:

-F


OF 2

PRODUCT:
"EXTERIOR DOOR PRODUCT"
8" OPAQUE METAL-EDGE STEEL DOOR
IN TWO-PIECE STEEL FRAME

PART OR ASSEMBLY:
ANCHORING LOCATIONS
DOOR TO BUCK

NO.	DATE	ANCHOR REVISIONS	SWS	BY
B	11/5/20	ANCHOR REVISIONS	SWS	BY
A	5/28/15	ANCHOR REVISIONS	SWS	BY
REVISIONS				

DATE: 05/29/13
SCALE: N.T.S.
DWG. BY: TR
CHK. BY:
DRAWING NO.:
DWG-MA-FL0179-11
SHEET 2 OF 2

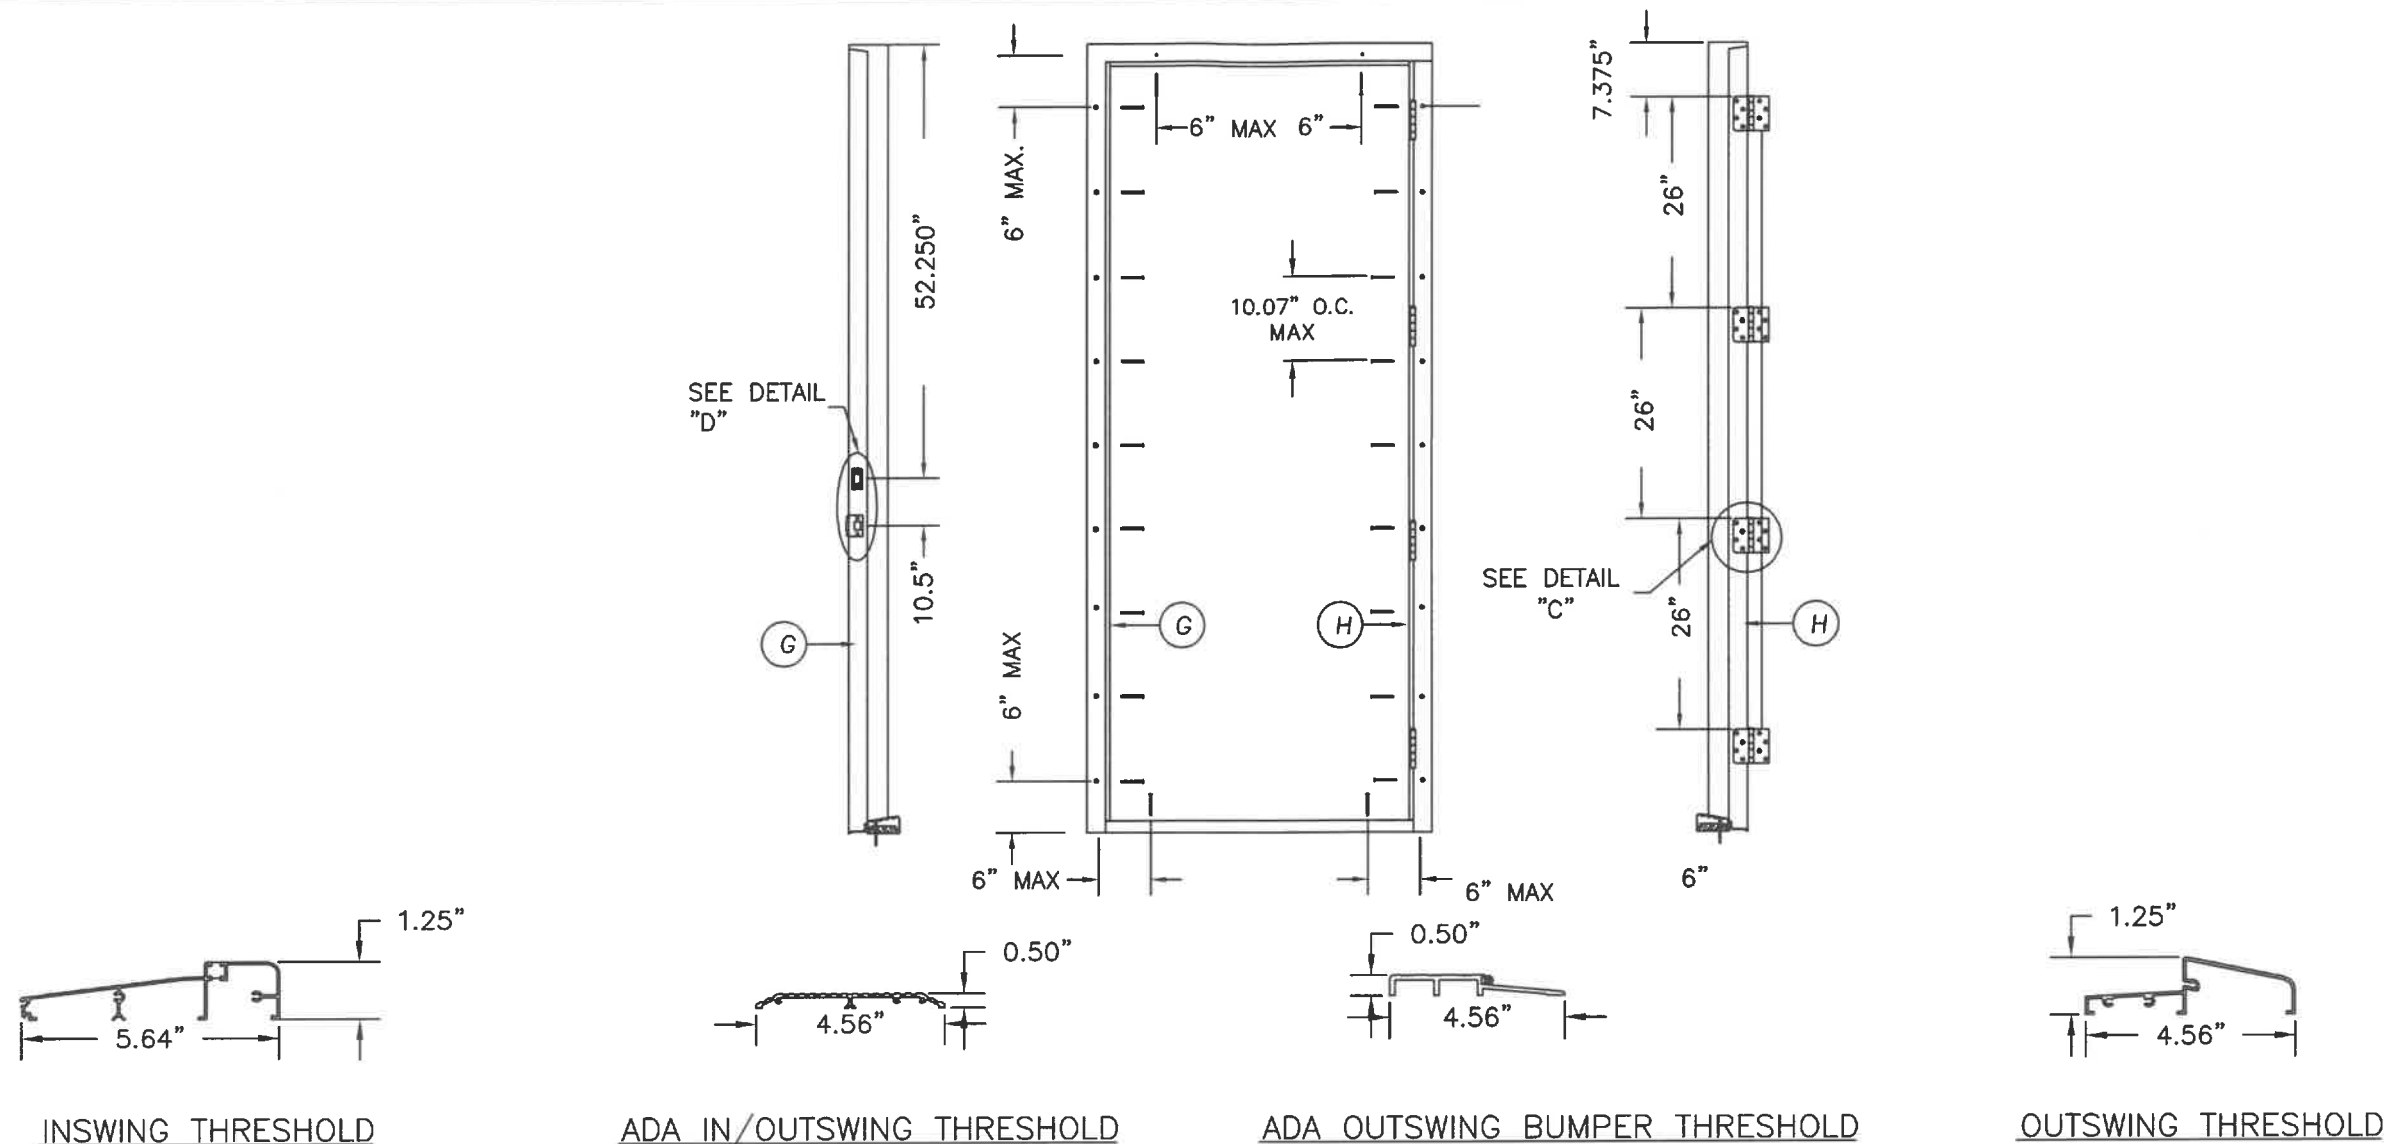


INSWING THRESHOLD


ADA IN/OUTSWING THRESHOLD

ADA OUTSWING BUMPER THRESHOLD


OUTSWING THRESHOLD

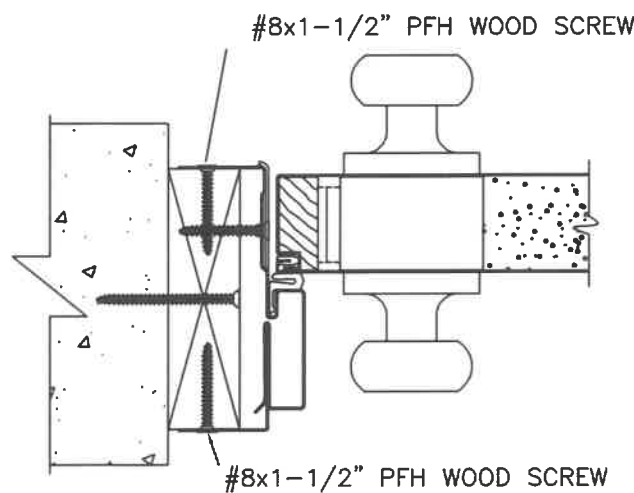

TYPICAL WOOD BUCK INSTALLATION

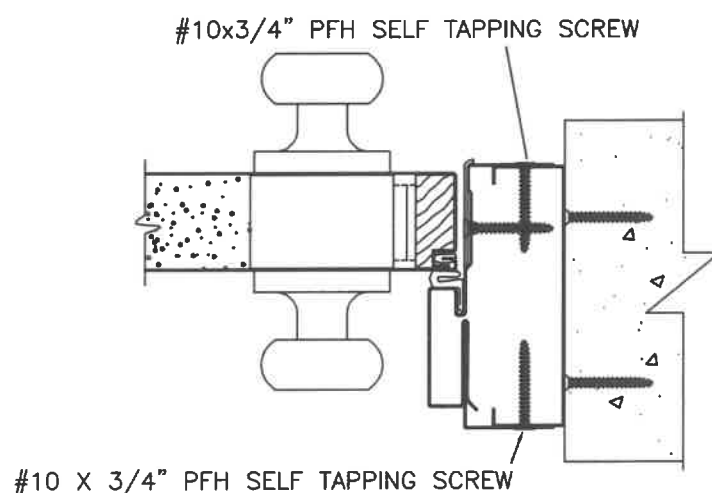

TYPICAL STEEL BUCK INSTALLATION

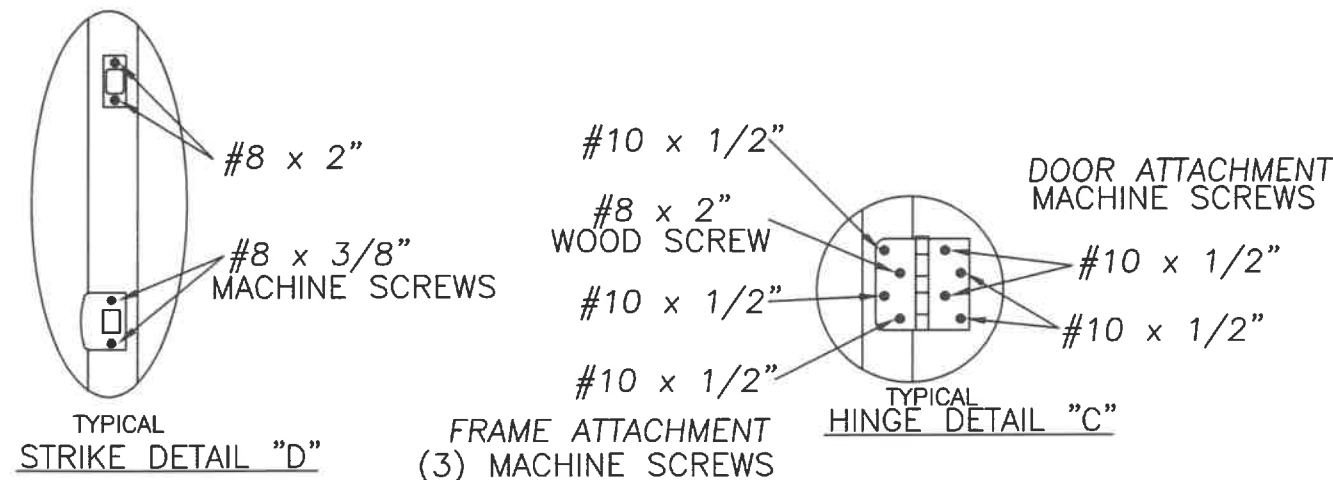

HARDWARE SCHEDULE

NOTES:

1. THRESHOLD ANCHORS ANALYZED ARE 1/4" TAPCONS WITH 1-3/4" MIN EMBEDMENT.
2. TAPCON EDGE DISTANCE MIN 2-1/2". SCREW EDGE DISTANCE MIN 1/2".
3. BUCKS BY OTHERS MUST BE PROPERLY ANCHORED TO TRANSFER LOAD TO STRUCTURE.

1. KWIKSET SERIES 400 CYLINDRICAL AND SERIES 980 DEADLOCK OR SCHLEGE F-SERIES CYLINDRICAL AND B-SERIES DEADLOCK HARDWARE TO BE AT 10-1/2" CENTERLINE.
2. 4" X 4" FULL MORTISE BUTT HINGES.