REVISIONS				
REV	DESCRIPTION	DATE	APPROVED	
А	REVISED ANCHORING SPACING	05/20/2021	R.L.	

EASTERN ARCHITECTURAL SYSTEMS

A DIVISION OF EASTERN METAL SUPPLY

#### NOTES

- 1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH REQUIREMENTS OF THE FLORIDA BUILDING CODE INCLUDING THE HVHZ.
- 2. WOOD FRAMING AND MASONRY OPENING TO BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO STRUCTURE. FRAMING AND MASONRY OPENING IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.
- 3. WHERE SHIM OR BUCK THICKNESS IS LESS THAN 1-1/2" WINDOW UNITS MUST BE ANCHORED THROUGH THE FRAME IN ACCORDANCE WITH MANUFACTURER'S PUBLISHED INSTALLATION INSTRUCTIONS. ANCHORS SHALL BE SECURELY FASTENED DIRECTLY INTO MASONRY, CONCRETE OR OTHER STRUCTURAL SUBSTRATE MATERIAL.
- 4. WHERE WOOD BUCK THICKNESS IS 1-1/2" OR GREATER, BUCK SHALL BE SECURELY FASTENED TO MASONRY, CONCRETE OR OTHER STRUCTURAL SUBSTRATE. WINDOW UNITS MAY BE ANCHORED THROUGH FRAME TO SECURED WOOD BUCK IN ACCORDANCE WITH MANUFACTURER'S PUBLISHED INSTALLATION INSTRUCTIONS.
- 5. WHERE 1X BUCK IS NOT USED DISSIMILAR MATERIALS MUST BE SEPARATED WITH APPROVED COATING OR MEMBRANE. SELECTION OF COATING OR MEMBRANE IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.
- 6. BUCKS SHALL EXTEND BEYOND WINDOW INTERIOR FACE SO THAT FULL FRAME SUPPORT IS PROVIDED.
- 7. FOR FIN INSTALLATION SHIM AS NEEDED. FOR FRAME INSTALLATION SHIM AS REQUIRED AT EACH ANCHOR LOCATION WITH LOAD BEARING SHIM. SHIM WHERE SPACE OF 1/16" OR GREATER OCCURS. MAXIMUM ALLOWABLE SHIM STACK TO BE 1/4".
- 8. SHIMS SHALL BE LOCATED, APPLIED AND MADE FROM MATERIALS AND THICKNESS CAPABLE OF SUSTAINING APPLICABLE LOADS.
- 9. WIND LOAD DURATION FACTOR Cd=1.6 WAS USED FOR WOOD ANCHOR CALCULATIONS.
- 10. FRAME MATERIAL: EXTRUDED RIGID PVC.
- 11. UNITS MUST BE GLAZED PER ASTM E1300, SEE SHEET 9 FOR GLASS DETAILS.
- 12. APPROVED IMPACT PROTECTIVE SYSTEM <u>IS NOT REQUIRED</u> FOR THIS PRODUCT IN WIND BORNE DEBRIS REGIONS.
- 13. FOR FIN INSTALLATION INTO WOOD FRAMING OR 2X BUCK USE #10 WOOD SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE A 1 1/2" MINIMUM EMBEDMENT INTO SUBSTRATE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.

- 14. FOR FRAME ANCHORING INTO WOOD FRAMING OR 2X BUCK USE #12 WOOD SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE A 1 1/4" MINIMUM EMBEDMENT INTO SUBSTRATE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
- 15. FOR FRAME ANCHORING INTO MASONRY/CONCRETE USE 1/4" TAPCONS WITH SUFFICIENT LENGTH TO ACHIEVE A 1 1/4" MINIMUM EMBEDMENT INTO SUBSTRATE WITH 2" MINIMUM EDGE DISTANCE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
- 16. FOR FRAME ANCHORING INTO METAL STRUCTURE USE #12 SMS OR SELF DRILLING SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE 3 THREADS MINIMUM BEYOND STRUCTURE INTERIOR WALL. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
- 17. ALL FASTENERS TO BE CORROSION RESISTANT.
- 18. INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BELOW:


  A. WOOD MINIMUM SPECIFIC GRAVITY OF G=0.42
  - B. CONCRETE MINIMUM COMPRESSIVE STRENGTH OF 3,192 PSI.
  - C. MASONRY STRENGTH CONFORMANCE TO ASTM C-90, GRADE N, TYPE 1 (OR GREATER).
- D. METAL STRUCTURE: STEEL 18GA, 33KSI OR ALUMINUM 6063-T5 .125" THICK MINIMUM
- 19. APPROVED CONFIGURATION: XOX.
- 20. UNITS MAY BE INSTALLED WITH OR WITHOUT FLANGE, OUTSIDE THE HVHZ.

**Eastern** 

SIGNED: 03/25/2022

Luis R. Lomas P.E. FL No.: 62514

				AND VINYL	16341 DOMESTIC AVE FORT MYERS, FL 33912 800-432-2204	
TABLE OF CONTENTS			SERIES 176 HRP 424 PVB VINYL HORIZONTAL SLIDING WINDOW (XOX) 111" X 63"			
SHEET NO.	DESCRIPTION	NOTES				
1	NOTES	DRAWN: DWG NO.			REV	
2	ELEVATIONS	A.R.		30	3-03659	Α
3	HORIZONTAL CROSS SECTIONS	SCALE NTS	DATE O	1/11/21	SHEET 1 OF 9	
4 - 8	INSTALLATION DETAILS	L. ROBERTO LOMAS P.E. 400 S. PALM AVE. INDIALANTIC. FL 32903				
9	COMPONENTS AND GLAZING DETAILS	434-688-0609 rllomas@lrlomaspe.com				

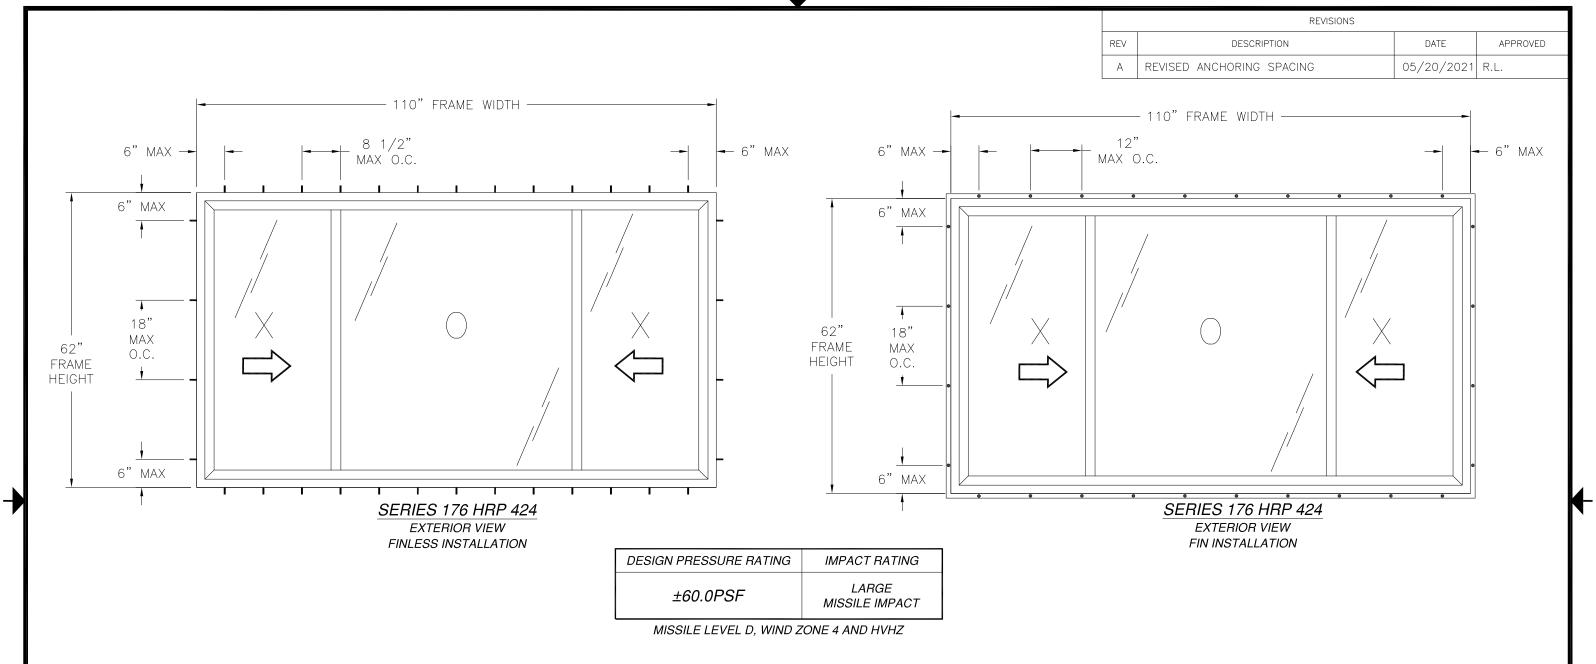


- 1. OPERABLE SASH SIZE: 28 1/16" X 59 3/8".
- 2. OPERABLE SASH D.L.O.: 28 1/16" X 55 7/8".
- 3. FIXED SASH D.L.O.: 50 1/2" X 57 3/16"
- 4. (2) WEEPS WITH COVER (97-03) AT SILL FACE FROM EACH CORNER.
- 5. (2) 1 1/2" X 1/4" WEEP SLOT AT SILL FACE 4 1/8" FROM EACH CORNER.
- 6. (2) 1/8" X 12" WEEP SLOT AT SILL FACE AND SILL SASH 3 1/8" FROM EACH END.
- 7. (2) 1/2" X 1/8" WEEP SLOT AT SILL BEHIND GLAZING LEG.

	HARDWARE SCHEDULE						
	(4) ASHLAND DUAL KEEPERS (13999) AT FIXED MEETING STILE 8" FROM HEAD & SILL						
В.	(4) ASHLAND DUAL LOCKS (D2100AL/R) AT SASH LOCK STILE 8" FROM SASH CORNERS						
C.	(4) ROLLER HOUSINGS AT EACH CORNER OF SASH BOTTOM RAILS.						
D.	(3) TRACKS AT OPERABLE SASH HEAD & SILL						
Ε.	(1) ALUMINUM REINFORCEMENT (10300265) IN FIXED MEETING RAIL						
F.	(5) ALUMINUM REINFORCEMENT (10300266) IN SASH TOP AND BOTTOM RAILS, JAMB STILES AND SASH LOCK RAIL						


SIGNED: 03/25/2022



REVISIONS				
REV	DESCRIPTION	DATE	APPROVED	
A	REVISED ANCHORING SPACING	05/20/2021	R.L.	

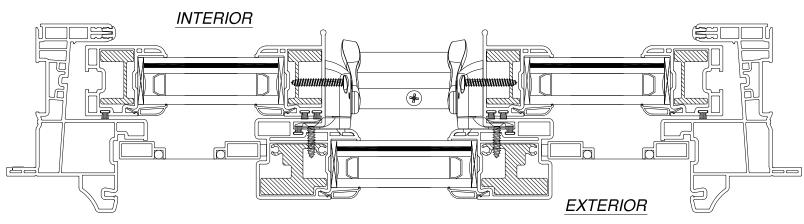


HORIZONTAL CROSS SECTIONS FINLESS INSTALLATION

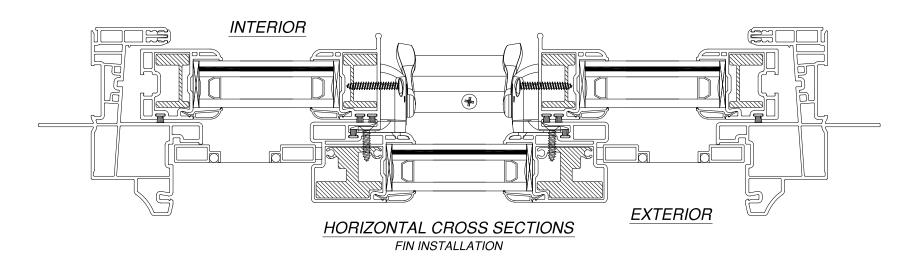



SIGNED: 03/25/2022







Luis R. Lomas P.E. FL No.: 62514




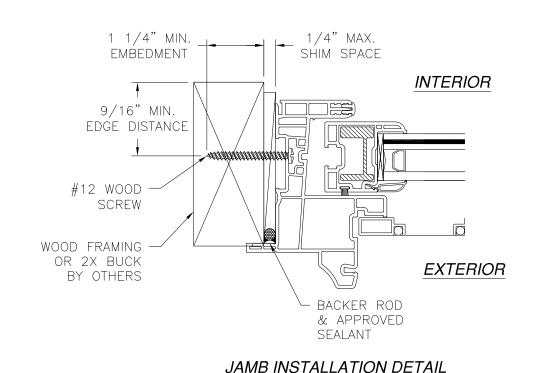

WOOD FRAMING OR 2X BUCK INSTALLATION

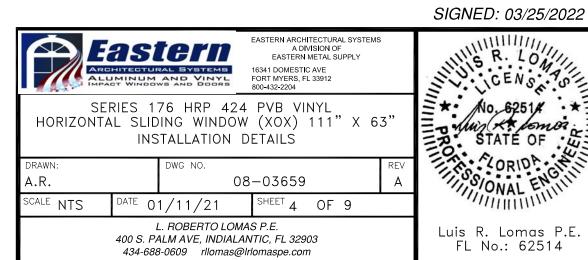

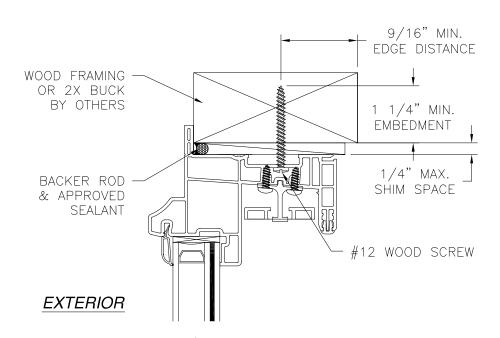

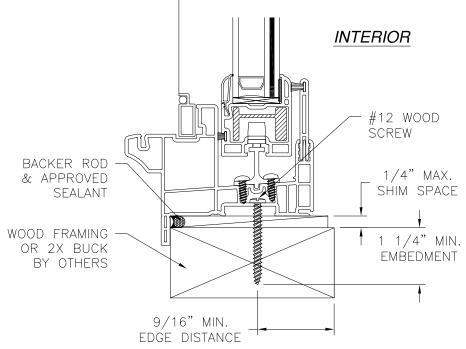



VERTICAL CROSS SECTION
WOOD FRAMING OR 2X BUCK INSTALLATION

1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.

2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

	REVISIONS				
REV	DESCRIPTION	DATE	APPROVED		
А	REVISED ANCHORING SPACING	05/20/2021	R.L.		

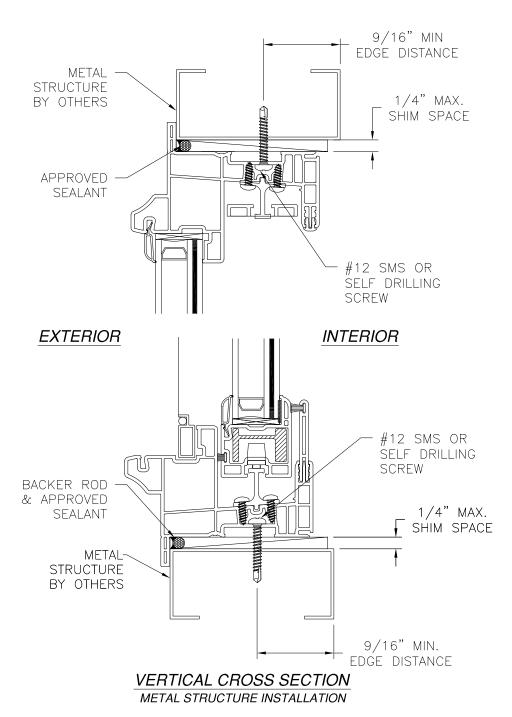

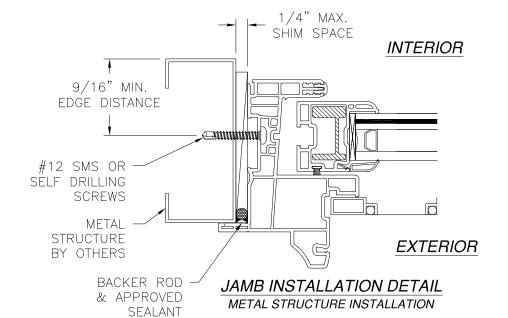

SIGNED: 03/25/2022



NOTES:


1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS,

NOT SHOWN FOR CLARITY.

2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE

DESIGNED IN ACCORDANCE WITH ASTM E2112



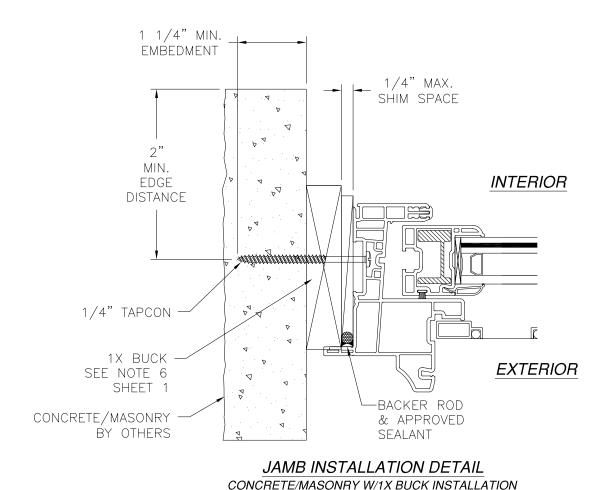


1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY. 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE

DESIGNED IN ACCORDANCE WITH ASTM E2112

NOTES:


SIGNED: 03/25/2022 EASTERN ARCHITECTURAL SYSTEMS A DIVISION OF EASTERN METAL SUPPLY 16341 DOMESTIC AVE FORT MYERS, FL 33912 800-432-2204 T REV STATE STATE STATE OF ORIDAR CHILINGS OF OTHER PROPERTY OF THE PROPERTY O SERIES 176 HRP 424 PVB VINYL HORIZONTAL SLIDING WINDOW (XOX) 111" X 63" INSTALLATION DETAILS DRAWN: DWG NO. A.R. 08-03659 SCALE NTS DATE 01/11/21 SHEET 6 OF 9 L. ROBERTO LOMAS P.E. Luis R. Lomas P.E. 400 S. PALM AVE, INDIALANTIC, FL 32903 FL No.: 62514 434-688-0609 rllomas@lrlomaspe.com

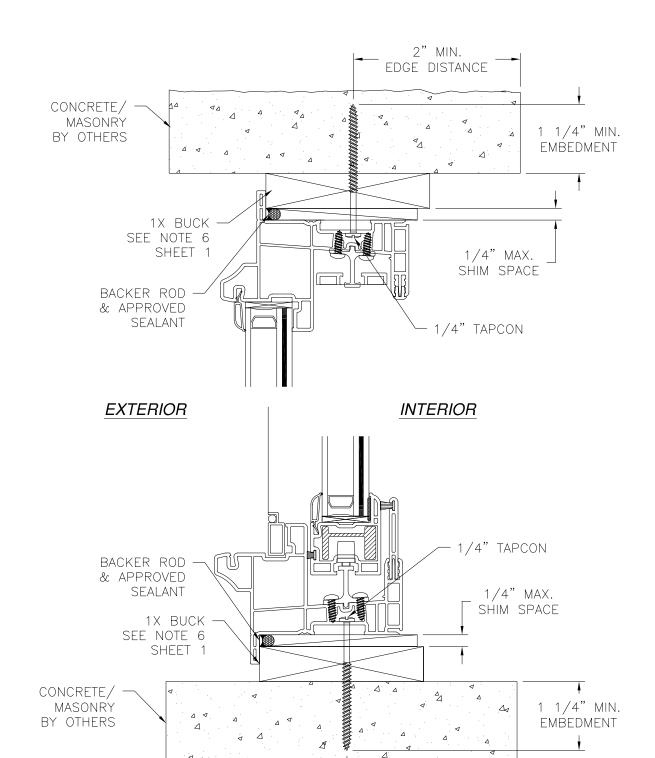


**VERTICAL CROSS SECTION** CONCRETE/MASONRY W/1X BUCK INSTALLATION


EDGE DISTANCE

	REVISIONS		
REV	DESCRIPTION	DATE	APPROVED
А	REVISED ANCHORING SPACING	05/20/2021	R.L.

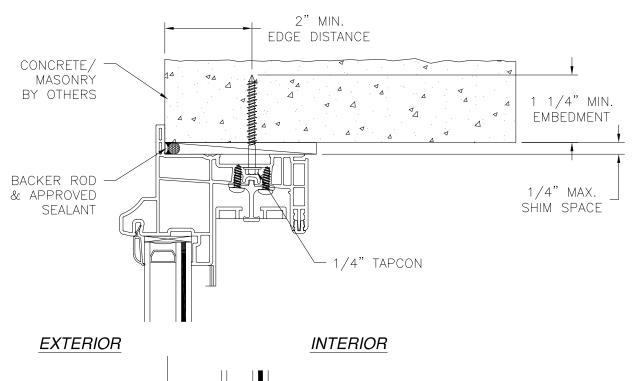

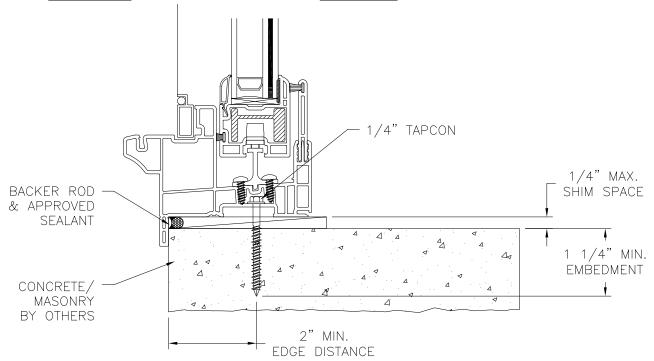

VERTICAL CROSS SECTION CONCRETE/MASONRY INSTALLATION

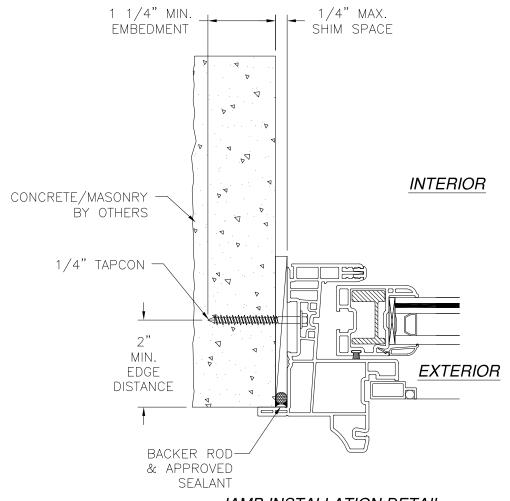

JAMB INSTALLATION DETAIL CONCRETE/MASONRY INSTALLATION


1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY. 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112


SIGNED: 03/25/2022



Luis R. Lomas P.E.



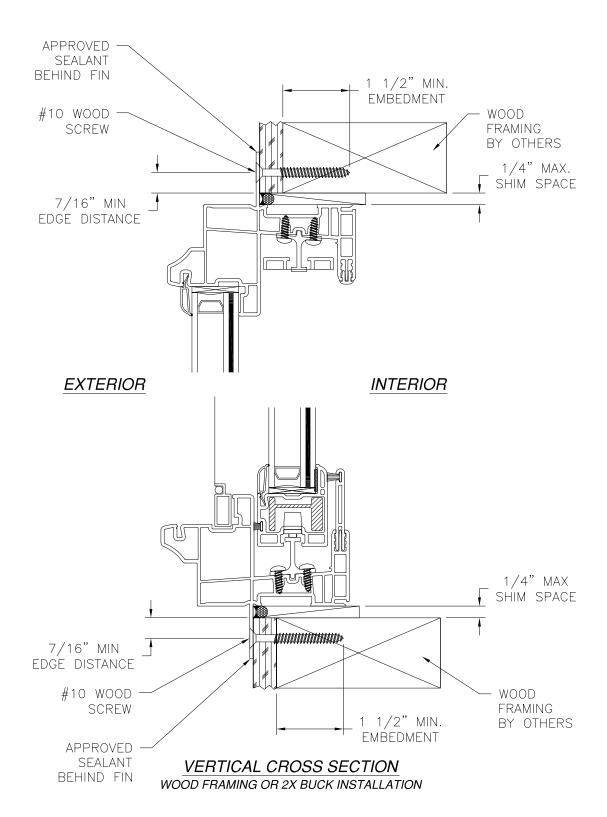

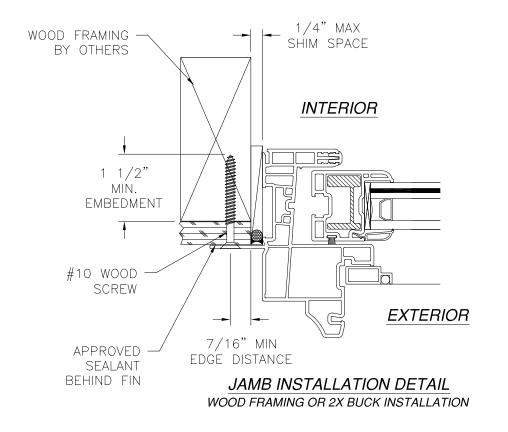



 INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
 PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112


SIGNED: 03/25/2022






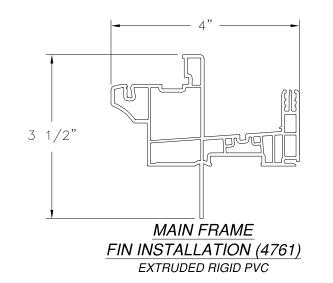









BOTTOM RAIL (5539) EXTRUDED RIGID PVC


LOCK RAIL (4720) EXTRUDED RIGID PVC





EXTRUDED RIGID PVC









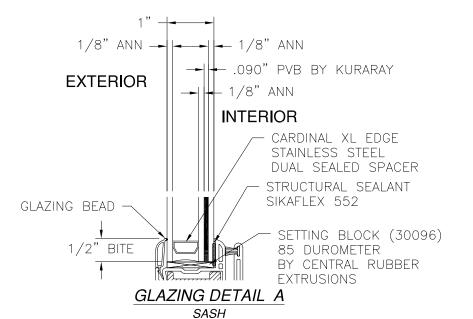

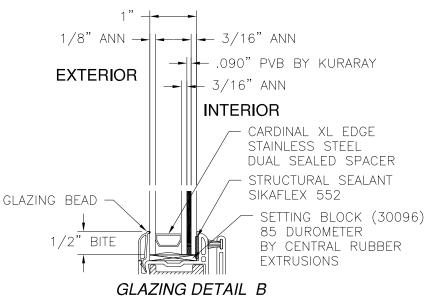

**FIXED** 

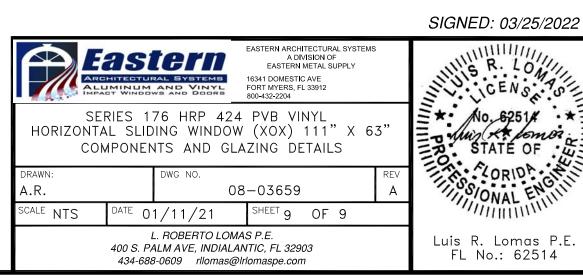



Luis R. Lomas P.E. FL No.: 62514