

Registry No. 29824 17520 Edinburgh Drive Tampa, FL 33647 (813) 480-3421

#### **EVALUATION REPORT**

#### FLORIDA BUILDING CODE, 7<sup>TH</sup> EDITION (2020)

Manufacturer: JOHNS MANVILLE CORPORATION

Issued April 24, 2023

P.O. Box 5108 Denver, CO 80217 (303) 978-2478 www.jm.com

Manufacturing Plants: Southgate, CA

Oklahoma City, OK

Macon, GA

Quality Assurance: UL LLC (QUA9625)

SCOPE

Category: Roofing

Subcategory: Modified Bitumen Roof System

**Code Edition:** Florida Building Code, 7<sup>th</sup> Edition (2020) including High-Velocity Hurricane Zones (HVHZ) **Code Sections:** 1504.3.1, 1504.6, 1507.2.9.2, 1507.10.2, 1507.11.2, 1515.1.1, 1515.1.4, 1523.1.1, 1523.6.2

**Properties:** Wind Resistance, Physical Properties

#### **PRODUCT DESCRIPTION**

Products	Specification	Description
JM APP Base	ASTM D 6509	APP modified asphalt, fiberglass reinforced, smooth surfaced base
		sheet.
APPeX 4S	ASTM D 6222	APP modified asphalt, polyester reinforced, smooth surfaced
		membrane for use as a Base or Ply sheet only.
APPeX 4S Embossed	ASTM D 6222	APP modified asphalt, polyester reinforced, smooth surfaced
		membrane for use as a Base or Ply sheet only.
APPeX 4.5 M	ASTM D 6222	APP modified asphalt, polyester reinforced, mineral surfaced
		membrane.
APPeX 4.5 M FR	ASTM D 6222	APP modified asphalt, polyester reinforced, fire-retardant, mineral
		surfaced membrane.
APPeX 4.5M CR G	ASTM D 6222	APP modified asphalt, polyester reinforced, surfaced with reflective
		roofing granules.
APPeX 4.5M FR CR G	ASTM D 6222	APP modified asphalt, polyester reinforced, fire-retardant, surfaced
		with reflective roofing granules.
Bicor S	ASTM D 6223	APP modified asphalt, polyester/glass reinforced, smooth surfaced
		membrane for use as a Base or Ply sheet only.
Bicor M FR	ASTM D 6223	APP modified asphalt, polyester/glass reinforced, granule surfaced
		membrane.
DynaBase HW	ASTM D 6163	A glass reinforced SBS modified bitumen base sheet for heat welded
		applications.
DynaFast 180 HW	ASTM D 6164	A polyester reinforced SBS modified bitumen base or inner ply sheet
		for use in heat weld applications.
DynaFast 180 S	ASTM D 6164	A polyester reinforced SBS modified bitumen base or inner ply sheet.
DynaFast 250 HW	ASTM D 6164	A polyester reinforced SBS modified bitumen base or inner ply sheet
		for use in heat weld applications.
DynaGrip Base SD/SA	ASTM D 4601	Self-adhering, asphalt impregnated and coated glass fiber base sheet
		for use in conventional and modified bitumen built-up roofing.
DynaGrip Base PR SD/SA	ASTM D 6164	Self-adhering, asphalt impregnated and coated polyester base sheet
		for use in conventional and modified bitumen built-up roofing.

JMC14001.19b FL17013-R19 Page 1 of 6

#### **APPENDIX A**

Products	Specification	Description
DynaWeld 250 S	ASTM D 6164	A polyester reinforced SBS modified bitumen base or inner ply sheet for use in heat weld applications.
GlasBase Plus	ASTM D 4601	Type II asphalt impregnated and coated glass fiber base sheet for use in conventional and modified bitumen built-up roofing.
GlasPly IV	ASTM D 2178	Type IV asphalt impregnated glass felt for use in conventional and modified bitumen built-up roofing.
GlasPly Premier	ASTM D 2178	Type VI asphalt impregnated glass felt for use in conventional and modified bitumen built-up roofing.
PermaPly 28	ASTM D 4601	Type II asphalt impregnated and coated glass fiber base sheet for use in conventional and modified bitumen built-up roofing.
Tricor M FR	ASTM D 6223	APP modified asphalt, polyester/glass reinforced, granule surfaced membrane.
Tricor M FR CR	ASTM D 6223	APP modified asphalt, polyester/glass reinforced, coated granule surfaced membrane.
Tricor S	ASTM D 6223	APP modified asphalt, polyester/glass reinforced, smooth surfaced membrane for use as a Base or Ply sheet only.
Ventsulation Felt	ASTM D 4897	Heavy duty fiber glass base sheet impregnated and coated on both sides with asphalt with or without fine mineral stabilizer. Surfaced on the bottom side with coarse mineral granules embedded in asphaltic coating.

#### **REFERENCES**

Entity	Report No.	Standards (Year)
FM Approvals (TST1867)	0V7A4.AM	FM 4470 (2016)
FM Approvals (TST1867)	0W6A2.AM	FM 4470 (2016)
FM Approvals (TST1867)	0X0A9.AM	FM 4470 (2016)
FM Approvals (TST1867)	0X7A4.AM	FM 4470 (2016)
FM Approvals (TST1867)	3001482	FM 4470 (2016)
FM Approvals (TST1867)	3002823	FM 4470 (2016)
FM Approvals (TST1867)	3003468	FM 4470 (2016)
FM Approvals (TST1867)	3007148	FM 4470 (2016)
FM Approvals (TST1867)	3009499	FM 4470 (2016)
FM Approvals (TST1867)	3011248	FM 4470 (2016)
FM Approvals (TST1867)	3012974	FM 4470 (2016)
FM Approvals (TST1867)	3037540	FM 4470 (2016)
FM Approvals (TST1867)	3043824	FM 4470 (2016)
FM Approvals (TST1867)	3052113	FM 4470 (2016)
FM Approvals (TST1867)	3056303	FM 4470 (2016)
FM Approvals (TST1867)	3063554	FM 4470 (2016)
FM Approvals (TST1867)	PR450753	FM 4470 (2016)
FM Approvals (TST1867)	PR453769	FM 4470 (2016)
FM Approvals (TST1867)	PR454134	FM 4470 (2016)
FM Approvals (TST1867)	PR459758	FM 4470 (2016)
FM Approvals (TST1867)	PR461495	FM 4470 (2016)
FM Approvals (TST1867)	RR229337	FM 4470 (2016)
FM Approvals (TST1867)	RR229341	FM 4470 (2016)
FM Approvals (TST1867)	RR230185	FM 4470 (2016)
FM Approvals (TST1867)	RR232747	FM 4470 (2016)
FM Approvals (TST1867)	RR233717	FM 4470 (2016)
FM Approvals (TST1867)	RR234327	FM 4470 (2016)
FM Approvals (TST1867)	RR460477	FM 4470 (2016)
Nemo etc. (TST6049)	4a-CEL-19-LSWUS-01.C	FM 4474 (2011)
		TAS 114 (J) (2011)
Nemo  Etc LLC (TST6049)	4a-CEL-22-LSWUS01A	FM 4474(B) (2011); TAS 114(D) (2011)
PRI Construction Materials Technologies (TST5878)	JMC-030-02-01	TAS 110 (2000)
		ASTM D 5147 (2014)
		ASTM D 6222 (2011)

JMC14001.19b FL17013-R19 Page 2 of 6

#### **APPENDIX A**

Entity PRI Construction Materials Technologies (TST5878)	Report No. JMC-030-02-02	Standards (Year) TAS 110 (2000)
		ASTM D 5147 (2014) ASTM D 6222 (2011)
PRI Construction Materials Technologies (TST5878)	JMC-030-02-03	TAS 110 (2000) ASTM D 5147 (2014)
PRI Construction Materials Technologies (TST5878)	JMC-053-02-01	ASTM D 6222 (2011) ASTM D 5147 (2014) ASTM D 6222 (2011)
PRI Construction Materials Technologies (TST5878)	JMC-054-02-01	ASTM D 5147 (2014) ASTM D 6223 (2002(2009)E1)
PRI Construction Materials Technologies (TST5878)	JMC-055-02-01	ASTM D 6509 (2009(2015))
PRI Construction Materials Technologies (TST5878)	JMC-070-02-01	ASTM D 2178 (2015)
PRI Construction Materials Technologies (TST5878) PRI Construction Materials Technologies (TST5878)	JMC-072-02-02 JMC-074-02-01	ASTM D 4601 (2004(2012)E1) ASTM D 4897 (2001(2009))
PRI Construction Materials Technologies (1313878)	JMC-074-02-01 JMC-075-02-04.2	TAS 110 (2000)
FRI Construction Materials Technologies (1313076)	310-073-02-04.2	ASTM D 6164 (2011)
		ASTM G 155 (2013)
PRI Construction Materials Technologies (TST5878)	JMC-093-02-01	ASTM D 4601 (2004(2012)E1)
PRI Construction Materials Technologies (TST5878)	JMC-106-02-01	ASTM D 6164 (2011)
PRI Construction Materials Technologies (TST5878)	JMC-107-02-01.11	ASTM D 903 (1998(2010))
		ASTM D 1876 (2008(2015)e1)
		ASTM D 5147 (2014) TAS 117(A & B) (1995)
		TAS 117(A & B) (1993) TAS 114(C) (1995)
PRI Construction Materials Technologies (TST5878)	JMC-108-02-01	FM 4474 (D) (2011)
3		TAS 114 (J) (2011)
PRI Construction Materials Technologies (TST5878)	JMC-113-02-01	ASTM D 6164 (2011)
PRI Construction Materials Technologies (TST5878)	JMC-114-02-01	FM 4474 (D) (2011)
DDI Construction Metariala Tankanlanian (TCT5070)	IMC 440 00 00	TAS 114 (J) (2011)
PRI Construction Materials Technologies (TST5878)	JMC-118-02-02	FM 4474 (C) (2011) TAS 114 (C) (1995)
PRI Construction Materials Technologies (TST5878)	JMC-126-02-01	FM 4474 (D) (2011)
3		TAS 114 (J) (2011)
PRI Construction Materials Technologies (TST5878)	JMC-131-02-01	FM 4474 (D) (2011) TAS 114 (J) (2011)
PRI Construction Materials Technologies (TST5878)	JMC-132-02-01	FM 4474 (B) (2011) TAS 114 (D) (2011)
PRI Construction Materials Technologies (TST5878)	JMC-141-02-01	FM 4474 (D) (2011) TAS 114 (J) (2011)
PRI Construction Materials Technologies (TST5878)	JMC-167-02-01	FM 4474 (C) (2011) TAS 114 (C) (1995)
PRI Construction Materials Technologies (TST5878)	JMC-168-02-01	FM 4474 (D) (2011) TAS 114 (J) (2011)
PRI Construction Materials Technologies (TST5878)	JMC-222-02-01	FM 4474 (D) (2011)
PRI Construction Materials Technologies (TST5878)	JMC-222-02-02	TAS 114 (J) (2011) FM 4474 (D) (2011)
PRI Construction Materials Technologies (TST5878)	JMC-222-02-04	TAS 114 (J) (2011) FM 4474 (D) (2011)
PRI Construction Materials Technologies (TST5878)		TAS 114 (J) (2011)
PRI Construction Materials Technologies (1515676)	JMC-242-02-01	FM 4474 (D) (2011) TAS 114 (J) (2011)
PRI Construction Materials Technologies (TST5878)	JMC-245-02-01	FM 4474 (D) (2011) TAS 114 (J) (2011)
PRI Construction Materials Technologies (TST5878)	JMC-267-02-01	UL 1897 (2012) FM 4474 (D) (2011) TAS 114 (J) (2011)
PRI Construction Materials Technologies (TST5878)	JMC-272-02-01	UL 1897 (2012) FM 4474 (D) (2011) TAS 114 (J) (2011)
PRI Construction Materials Technologies (TST5878) PRI Construction Materials Technologies (TST5878)	JMC-337-02-01 507T0144A	UL 1897 (2012) ASTM D 4601 (2004(2012)E1) FM 4474 (C) (2011)

JMC14001.19b FL17013-R19 Page 3 of 6

Johns Manville Corporation APP Modified Roofing Systems

#### **APPENDIX A**

Entity	Report No.	Standards (Year)
PRI Construction Materials Technologies (TST5878)	507T0153	ASTM D 5147 (2014)
1 Tri Construction Materials Technologies (1013070)	30710133	ASTM D 5147 (2014) ASTM D 6222 (2011)
DDI Construction Metariala Trabanianian (TCT5070)	F07T04F0A	,
PRI Construction Materials Technologies (TST5878)	507T0153A	FM 4474 (C) (2011)
PRI Construction Materials Technologies (TST5878)	507T0155	FM 4474 (B) (2011)
PRI Construction Materials Technologies (TST5878)	507T0187.2	TAS 117(A & B) (1995)
		FM 4470 (2016)
PRI Construction Materials Technologies (TST5878)	507T0199.1	TAS 114 (D) (2011)
PRI Construction Materials Technologies (TST5878)	JMC-071-02-01	ASTM D 2178 (2015)
PRI Construction Materials Technologies (TST5878)	507T0009	FM 4474 (C) (2011)
PRI Construction Materials Technologies (TST5878)	507T0031	FM 4474 (C) (2011)
<b>9</b> ,		* * * *
PRI Construction Materials Technologies (TST5878)	507T0224	FM 4474 (D) (2011);
DDI 0	F07T0000	TAS 114 (J) (2011)
PRI Construction Materials Technologies (TST5878)	507T0236	FM 4474 (C) (2011)
PRI Construction Materials Technologies (TST5878)	507T0222	ASTM D 6164 (2011)
PRI Construction Materials Technologies (TST5878)	507T0184	ASTM D 5147 (2014)
		ASTM D 6223 (2002(2009)E1)
PRI Construction Materials Technologies (TST5878)	507T0241	FM 4474 (D) (2011)
<b>3</b> ( , ,		TAS 114 (J) (2011)
PRI Construction Materials Technologies (TST5878)	507T0256A	FM 4474 (C) (2011)
PRI Construction Materials Technologies (TST5878)	JMC-242-02-01	FM 4474 (D) (2011)
1 11 Construction Materials Technologies (1015076)	31010-242-02-01	TAS 114 (J) (2011)
DDI Construction Metariala Trabuslanias (TCT5070)	IMC 044 00 00	. , , ,
PRI Construction Materials Technologies (TST5878)	JMC-241-02-03	FM 4474 (C) (2011)
PRI Construction Materials Technologies (TST5878)	JMC-268-02-01	FM 4474 (D) (2011)
		TAS 114 (J) (2011)
PRI Construction Materials Technologies (TST5878)	507T0278	FM 4474 (C) (2011)
PRI Construction Materials Technologies (TST5878)	507T0283	FM 4474 (B) (2011)
PRI Construction Materials Technologies (TST5878)	507T0266	FM 4474 (D) (2011)
		TAS 114 (J) (2011)
		UL 1897 (2012)
PRI Construction Materials Technologies (TST5878)	507T0267	FM 4474 (C) (2011)
PRI Construction Materials Technologies (TST5878)	507T0273	FM 4474 (C) (2011)
PRI Construction Materials Technologies (TST5878)	507T0304	FM 4474 (B) (2011)
PRI Construction Materials Technologies (TST5878)	507T0306.1	FM 4474 (D)(2011); TAS 114(J) (2011)
<b>9</b> ,		
PRI Construction Materials Technologies (TST5878)	507T0320	FM 4474(C) (2011)
PRI Construction Materials Technologies (TST5878)	507T0331	FM 4474(C) (2011)
PRI Construction Materials Technologies (TST5878)	507T0339	FM 4474(D) (2011)
Trinity ERD (TST6049)	02843.02.05-10	TAS 114 (2011)
		FM 4474 (2011)
Trinity ERD (TST6049)	10390A-10.97-1	TAS 114 (2011)
, ,		FM 4474 (2011)
Trinity/ERD (TST6049)	10390A-12.97-1	TAS 114 (2011)
		FM 4474 (2011)
Trinity ERD (TST6049)	10391.01.03	TAS 114 (2011)
Timity ETED (TOTOG40)	10001.01.00	FM 4474 (2011)
Trinity ERD (TST6049)	4361-2.04.97-1	TAS 114 (2011)
11111ty END (1310049)	4301-2.04.97-1	FM 4474 (2011)
Trinity/FDD /TCTC040)	124400 02 44	
Trinity ERD (TST6049)	J34190.03.11	TAS 114 (J) (2011)
T: '/ IEDD /TOTO(10)	145000 05 40 4	FM 4474 (2011)
Trinity ERD (TST6049)	J45020.05.13-1	TAS 114 (C) (1995)
Trinity ERD (TST6049)	J5260.03.07	TAS 114 (J) (2011)
		FM 4474 (2011)
Trinity ERD (TST6049)	JM-11190.03.16	FM 4474 (D) (2011)
		TAS 114 (J) (2011)



Johns Manville Corporation APP Modified Roofing Systems

**APPENDIX A** 


#### LIMITATIONS

- 1. Fire classification is not within the scope of this evaluation.
- 2. The roof deck and the roof deck attachment information are provided based on testing. FBC requirements for the rational design of the roof deck, including the attachment, are not within scope of this evaluation.
- 3. Foam plastic insulation shall be installed in accordance with the FBC Section 2603.4 and 2603.6.
- 4. In the HVHZ, fastener spacing for insulation attachment is determined using a Minimum Characteristic Force (F') of 275 lbf as demonstrated via testing to TAS 105. If the field tested fastener value is below 275 lbf, then insulation attachment shall not be acceptable.
- 5. In the HVHZ, fastener spacing for base sheets or membrane attachment shall meet the minimum fastener resistance value and the MDP for the specified assembly. It is permissible for a qualified professional to submit a revised fastener spacing utilizing the withdrawal resistance value obtained from TAS 105 testing and calculations performed in accordance with RAS 117 and/or RAS 137, when the fastener resistance is found less than required.
- 6. In the HVHZ, if mechanical attachment through the lightweight insulating concrete to the structural deck is proposed, a field fastener withdrawal test shall be conducted in compliance with TAS 105 to determine equivalent or increased attachment densities. Revised fastener densities shall be submitted utilizing the withdrawal resistance value obtained from TAS 105 testing and calculations performed in accordance with RAS 117 and/or RAS 137.
- 7. HVHZ: For assemblies containing mechanical attachment, the allowable uplift pressure for the selected assembly shall meet or exceed the minimum design loads as determined in accordance with the FBC Chapter 16. The attachment density may be increased by a qualified design professional, as necessary, to meet the design pressure requirements in the periphery zones. Calculations shall be conducted in compliance with RAS 117 and/or RAS 137.
  - **Non-HVHZ:** For assemblies containing mechanical attachment or adhered in ribbon-applied adhesive, the allowable uplift pressure for the selected assembly shall meet or exceed the minimum design loads as determined in accordance with the FBC Chapter 16. The attachment density may be increased by a qualified design professional, as necessary, to meet the design pressure requirements in the periphery zones. Calculations shall be conducted in compliance with RAS 117, RAS 137, or Section 2.2.10.1 FM LPDS 1-29 (February 2020).
- 8. Reroofing applications shall be examined in accordance with FBC Section 1511 outside of the HVHZ and FBC Section 1521 within the HVHZ. For mechanically fastened systems, a field withdrawal resistance test (TAS 105 in the HVHZ; ANSI/SPRI FX-1 or TAS 105 in the non-HVHZ) shall be conducted by a qualified professional to ensure the fastener meets the minimum design load requirements of the system. For adhered systems, a field uplift resistance test (TAS 124 in the HVHZ; ASTM E 907, FM LPDS 1-52, ANSI/SPRI IA-1, or TAS 124 in the non-HVHZ) shall be conducted to confirm conformance of the existing to the minimum design loads.
- 9. **HVHZ:** For assemblies containing fully adhered or ribbon adhered attachment, or where extrapolation of the assembly is not permitted, the *MDP* for the selected assembly shall meet or exceed the minimum design loads as determined in accordance with the FBC Chapter 16 without augmentation.
  - **Non-HVHZ:** For assemblies adhered in ribbon-applied adhesive, the allowable uplift pressure for the selected assembly shall meet or exceed the minimum design loads as determined in accordance with the FBC Chapter 16. The attachment density may be increased by a qualified design professional, as necessary, to meet the design pressure requirements in the periphery zones. Calculations shall be conducted in compliance with Section 2.2.10.1 FM LPDS 1-29 (February 2020).
- 10. Installation of the evaluated products shall comply with this report, the FBC, and the manufacturer's published application instructions. Where discrepancies exist between these sources, the more restrictive and FBC compliant installation detail shall prevail.
- 11. The minimum roof slope shall be 1/4:12 for new construction.
- 12. All products listed in this report shall be manufactured under a quality assurance program in compliance with Rule 61G20-3.

#### **APPENDIX A**

#### **COMPLIANCE STATEMENT**

The products evaluated herein by Zachary R. Priest, P.E. have demonstrated compliance with the Florida Building Code, 7<sup>th</sup> Edition (2020) including High-Velocity Hurricane Zones (HVHZ) as evidenced in the referenced documents submitted by the named manufacturer.



This item has been digitally signed and sealed by Zachary R. Priest, PE, on 4/24/2023.

Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Zachary R. Priest, P.E. Florida Registration No. 74021 Organization No. ANE9641

#### **CERTIFICATION OF INDEPENDENCE**

CREEK Technical Services, LLC does not have, nor will it acquire, a financial interest in any company manufacturing or distributing products under this evaluation.

CREEK Technical Services, LLC is not owned, operated, or controlled by any company manufacturing or distributing products under this evaluation.

Zachary R. Priest, P.E. does not have, nor will acquire, a financial interest in any company manufacturing or distributing products under this evaluation.

Zachary R. Priest, P.E. does not have, nor will acquire, a financial interest in any other entity involved in the approval process of the product.

#### **APPENDICES**

- 1) APPENDIX A Installation (4 pages)
- 2) APPENDIX B Nomenclature and Approved Assemblies (28 pages)



Johns Manville Corporation APP Modified Roofing Systems

#### **APPENDIX A**

#### INSTALLATION

Note - Refer to the <u>Approved Assemblies</u> section of this report within Appendix B for specific installation details of a selected assembly.

Unless otherwise specified in this report the following installation details shall be met for the named products:

Component	Product	Installation Detail
	JM All Purpose Fastener	#14 fasteners; Min. 3/4-inch penetration through the top rib of the steel deck or wood deck; Min. 1-inch penetration into concrete deck
	JM APB Plates	2-inch diameter; Galvalume steel plate with reinforcing ribs and barbs
	JM High Load Plates	2 3/8-inch diameter; Galvalume steel plate with eyehooks
	JM High Load Fastener	#15 fastener; Min. 3/4-inch penetration through the top rib of the steel deck or wood deck
	JM Lightweight Concrete (LWC) CR Base Sheet Fastener	Min. 1.7-inch shank; Pre-Assembled with 2.7-inch galvalume coated steel plate. Full embedment of shank into substrate
	JM Polymer Membrane Batten	Membrane anchors and plastic strips
	JM Structural Concrete Deck Fasteners	Hammer-in fasteners; Min. 1-inch penetration into concrete deck
	JM UltraFast Fastener #12 Hex Head	#12 fastener; Min. 3/4-inch penetration through the top rib of the steel deck or wood deck
	JM UltraFast 3" Round Metal Plate or UltraFast Plate Metal Recessed	3-inch diameter round; Galvalume steel plate
	JM UltraFast Square Metal Plate or UltraFast Plate Metal Flat	3-inch square; Galvalume steel plate
	SFS Intec Dekfast DF-#12-PH3 Fastener	#12 fasteners; Min. 3/4-inch penetration through the top rib of the steel deck or wood deck;
Fastening Systems	SFS Intec Dekfast DF-#14-PH3 Fastener	#15 fasteners; Min. 3/4-inch penetration through the top rib of the steel deck or wood deck; Min. 1-inch penetration into concrete deck
	SFS Intec Dekfast DF-#15-PH3 Fastener	#15 fasteners; Min. 3/4-inch penetration through the top rib of the steel deck or wood deck; Min. 1-inch penetration into concrete deck
	SFS Intec Dekfast PLT-H-2-7/8	2-7/8" hexagonal galvalume steel stress plate
	SFS Intec Dekfast PLT-R-3	3-inch diameter round; Galvalume steel plate
	Trufast 3" Metal Insulation Plate	3-inch diameter round; Galvalume steel plate
	Trufast #12 DP Fastener	#12 fasteners; Min. 3/4-inch penetration through the top rib of the steel deck or wood deck;
	Trufast #14 HD Fastener	#14 fasteners; Min. 3/4-inch penetration through the top rib of the steel deck or wood deck; Min. 1-inch penetration into concrete deck
	Trufast #15 EHD Fastener	#15 fasteners; Min. 3/4-inch penetration through the top rib of the steel deck or wood deck;
	Trufast Deep Well Coiled Batten Bar	Galvalume steel membrane batten with recessed holes
	OMG 3" Round Metal Plate	3-inch diameter round; Galvalume steel plate
	Trufast Twin Loc-Nail Batten Fastener	Min. 1.8" length base sheet fastener for use with Twin Loc Coiled Batten Bar
	Trufast Twin Lock Coiled Batten Bar	1" x 100' pre-punched oval coil metal batten bar
	TRUFAST VERSA-FAST Fastener	Min. 2 1/4-inch embedment into; for LWIC or Gypsum decks
	TRUFAST VERSA-FAST Metal Plate	3-inch diameter; 0.017-inch thick Galvalume steel plate with one (1) center hole and eight (8) equally spaced perimeter holes for multiple fastening
Insulation	ASTM D 312, Type IV Asphalt	Fully adhered within the EVT range at a rate of 20-40 lbs/100 ft <sup>2</sup>
Adhesives	JM Two Part Urethane Insulation Adhesive or JM Two-Part UIA	Ribbon adhered in 3/4 to 1-inch wide beads

JMC14001.19b FL17013-R19 Page 1 of 4

#### **APPENDIX A**


Component	Product	Installation Detail	
Insulation	JM Two-Part Urethane Adhesive Canister or JM Two-Part UIA Canister	Ribbon adhered in 3/4 to 1-inch wide beads	
Adhesives (Cont'd)	JM One-Step Foamable Adhesive	Ribbon adhered in 3/4 to 1-inch wide beads	
. ,	JM Roofing System Urethane Adhesive	Ribbon adhered in 3/4-inch wide beads	
Membrane	ASTM D 312, Type IV Asphalt	Fully adhered within the EVT range at a rate of 20-40 lbs/100 ft <sup>2</sup>	
Adhesives	MBR Cold Application Adhesive  MBR Premium Cold Application Adhesive	Fully adhered at a rate of 1.5 to 2 gal/100 ft <sup>2</sup>	
	Blue Ridge Fiber Board Strucktodek® High-Density Fiber Board Roof Insulation	Min. 0.5-inch thick; Adhered boards shall be a maximum 4-ft x 4-ft	
	Georgia-Pacific DensDeck Georgia-Pacific DensDeck Prime	Min. 0.25-inch thick	
	JM ENRGY 3 and tapered		
	JM ENRGY 3 C1 and tapered	-	
	JM ENRGY 3 AGF and tapered	Min. 0.5-inch thick; Min. 20 psi; Adhered boards shall be a	
	JM ENRGY 3 CGF and tapered	maximum 4-ft x 4-ft	
	JM ENRGY 3 C1 CGF and tapered	-	
	JM ENRGY 3 FR and tapered	Min. 0.5-inch thick; Min. 20 psi; Adhered boards shall be a maximum 4-ft x 4-ft	
	JM DuraBoard	Min. 0.5-inch thick; Adhered boards shall be a maximum	
	JM Retro-Fit Board	4-ft x 4-ft	
Insulation/Cover Boards	JM Fesco Board	Min. 3/4-inch thick	
Doarus	JM DuraFoam	Min. 1.5-inch thick; Adhered boards shall be a maximum	
	JM FescoFoam	4-ft x 4-ft	
	JM ProtectoR HD	0.5-inch thick; Min. 80 psi; Adhered boards shall be a	
	JM ProtectoR HD FR	maximum 4 ft x 4 ft	
	JM SECUROCK Gypsum-Fiber Roof Board	Min. 0.25-inch thick	
	JM SeparatoR	0.5-inch thick; Min. 25 psi; Adhered boards shall be a	
	JM SeparatoR CGF		
	JM SeparatoR FR	maximum 4 ft x 4 ft	
	National Gypsum DEXcell FA Glass Mat Roof Board	Min. 0.25-inch thick	
	USG SECUROCK Cement Board	Min. 0.5-inch thick; Adhered boards shall be a maximum 4 ft x 4 ft	
	JM APP Base		
	APPeX 4S	Min. 4-inch wide side-laps; Min. 6-inch end laps; Side-laps	
	APPeX 4S Embossed	shall be installed perpendicular to the direction of the steel deck ribs and parallel to the direction of the wood trusses	
	Bicor S	for mechanically attached systems	
	Tricor S	To modification and office the	
	DynaBase		
	DynaBase PR		
	DynaFast 180 HW		
	DynaFast 180 S		
Base/Ply Sheets	DynaFast 250 HW		
Dadon ly Ollocto	DynaLastic 180 S	Min. 3-inch wide side-laps; Min. 6-inch end laps; Side-laps	
	DynaLastic 250 S	shall be installed perpendicular to the direction of the steel	
	DynaWeld 250 S	deck ribs and parallel to the direction of the wood trusses	
	GlasBase Plus	for mechanically attached systems	
	GlasPly IV	†	
	GlasPly Premier	1	
	PermaPly 28	1	
	Ventsulation Felt	1	
	v Gritoulation i Git		

JMC14001.19b FL17013-R19 Page 2 of 4

#### **APPENDIX A**

Component	Product	Installation Detail	
Base/Ply Sheets	DynaGrip Base SD/SA	Min. 3 5/8-inch side-laps; Self-adhered	
(Cont'd)	DynaGrip Base PR SD/SA	Willi. 3 3/6-inch side-laps, Sell-adhered	
	APPeX 4.5 M		
	APPeX 4.5 M FR		
Cap Sheets	Bicor M FR	Min. 4-inch wide side-laps; Min. 6-inch end laps	
	Tricor M FR		
	Tricor M FR CR		
	Celcore MF with HS Rheology Admixture	Slurry coat min. 0.25-inch thick; 1-inch thick EPS board (1 lbs/ft³); Min. 2-inch thick top coat; Celcore PVA curing compound applied at rate of 300 ft²/gal	
Cellular Lightweight Concrete	Celcore S-1	Steel deck is treated by applying a continuous film with a broom prior to placement of the Celcore lightweight concrete	
	Elastizell	Slurry coat min. 1/8-inch thick; Min. 1-inch thick EPS board	
	Cellular Lightweight Concrete	(1 lbs/ft <sup>3</sup> ); Min. 2-inch top coat;	
	DynaBase HW	Min. 3-inch wide side-laps; Min. 6-inch end laps; Torch adhered to primed concrete deck	
	JM DynaWeld Base		
	JM DynaWeld Cap	danorea to primica controle dook	
	JM DynaBase		
	JM DynaBase PR	Min. 3-inch wide side-laps; Min. 6-inch end laps; Applied	
	DynaFast 180 S	with hot or cold <i>approved</i> adhesives	
Vapor Barrier	JM DynaLastic 180 S		
Vapor Barrier	JM DynaLastic 250 S		
	JM DynaGrip Base SD/SA		
	JM DynaGrip Base PR SD/SA	Min. 3-inch wide side-laps; Min. 6-inch end laps; Self-	
	JM Vapor Barrier SA	adhered	
	JM Vapor Barrier SAR		
	JM APP Base	Min. 4-inch wide side-laps; Min. 6-inch end laps; Torch adhered to primed concrete deck	
Vapor Barrier	DynaSet 1k	Min. 4-inch laps sealed at a rate of 1.5-2.0gal/100ft <sup>2</sup> ;  Applied to substrate in 0.5-0.75-inch wide continuous	
Adhesives	DynaSet 2k	ribbons	

#### **APPENDIX A**

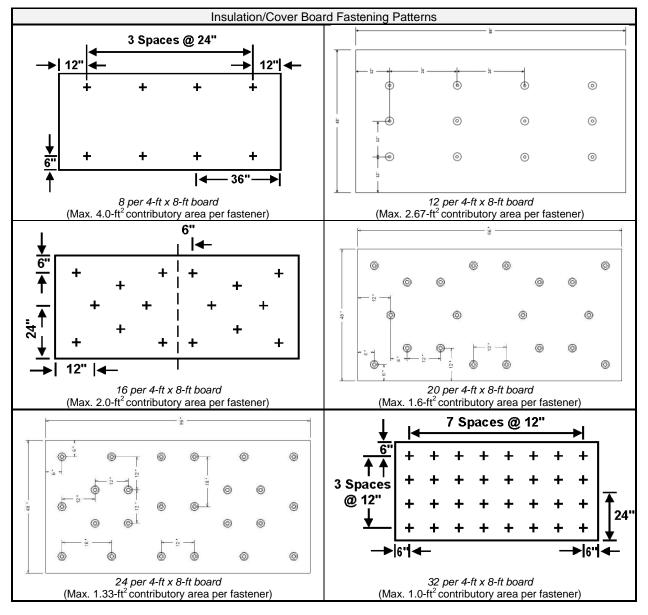



Johns Manville Corporation APP Modified Roofing Systems

**APPENDIX B** 

#### NOMENCLATURE

The following naming conventions are utilized to specify products in the <u>APPROVED ASSEMBLIES</u> section of this report. Refer to the nomenclature below when deciphering the allowable products for use in the selected assembly. Installation requirements shall be as noted in the <u>APPROVED ASSEMBLIES</u> and <u>INSTALLATION</u> section of this report.

Name	Definition			
2-Part UIA	JM Two-Part Uret	JM Two-Part Urethane Insulation Adhesive, JM Two-Part UIA, JM Two-Part Urethane Adhesive Canister, or JM Two-Part UIA Canister		
AP Fasteners & Plates			HD Fastener, or Structural Concrete Deck Fastener (concrete only) and UltraFast 3" Round Metal Plate, UltraFast te Metal Flat, or UltraFast Square Metal Plate	
APB Fasteners & Plates	JM APB Plates ar	JM APB Plates and JM High Load Fasteners or Trufast #15 EHD Fasteners		
APPex 4S	One or more plies	of APPeX 4S or A	PPeX 4S Embossed fully bonded by torch adhering	
As Tested	Information provid	Information provided to the report user based on the as tested condition of the roof system		
Asphalt			rete deck shall be primed with ASTM D 41 primer prior to application	
BA APP Cap	One ply of Bicor N	M FR, Tricor M FR,	or Tricor M FR CR fully bonded in MBR Bonding Adhesive	
BA APP Ply	One or more plies	of Bicor S or Trico	or S fully bonded in MBR Bonding Adhesive	
Batten Bar			ne Batten or High Load Fastener and Trufast Deep Well Coiled Batten Bar	
CA APP Cap	One ply of Bicor N	M FR, Tricor M FR,	or Tricor M FR CR fully bonded in MBR Cold Application Adhesive	
CA APP Ply	One or more plies	of JM APP Base,	Bicor S or Tricor S fully bonded in MBR Cold Application Adhesive	
CA APP BUR			Bicor S, GlasBase Plus, or PermaPly 28 fully bonded in MBR Cold Application Adhesive	
			s in accordance with FBC requirements. are described as follows: psi at 28 days	
		only. The follow	= 40 ksi) Wide Rib Deck (Type WR) conforming to ANSI/SDI-RD1.0 & FBC; 0.5% Vented for <i>LWIC</i> applications ving nomenclature is used to further describe the <i>As Tested</i> condition:	
		F<#>	Number <#> #12-24 HWH self-drilling screws or equivalent fastener at each flute used to secure the deck to the structural supports; Min. 1/4-inch penetration	
	Steel Deck	G<#>	Min. Grade <#> of Steel Deck	
	Oleci Deek	L<#>	Max. span of <#> ft	
Deck Detail		Р	Min. 5/8-inch diameter puddle welds at each flute used to secure the deck to the structural supports	
Book Botan		S<#>	1/4"-14 HWH x7/8" self-drilling screws or equivalent fastener secured <#>-inch o.c. along the panel side laps	
		W	3/4-inch O.D. flat washer used with indicated fastener	
		The following no	omenclature is used to further describe the As Tested condition:	
		T<#>	Min. <#>-inch thickness of the plywood or wood plank	
		L<#>	Max. span of <#> inches	
	Wood Deck	N<#>	Min. 0.113-inch diameter x 2-3/8-inch ring shank nails spaced <#>-inch o.c. at all intermediate supports and at the perimeter of each board	
		#8-<#1>/<#2>	#8 x 2-inch wood screws; Secured <#1>-inch o.c. at all intermediate supports and <#2> -o.c. at the perimeter of each board	

JMC14001.19b FL17013-R19 Page 1 of 28

This evaluation report is provided for State of Florida product approval under Rule 61G20-3. The manufacturer shall notify CREEK Technical Services, LLC of any product changes or quality assurance changes throughout the duration for which this report is valid. This evaluation report does not express nor imply warranty, installation, recommended use, or other product attributes that are not specifically addressed herein.



#### **APPENDIX B**

Name	Definition	Definition						
DensDeck Prime	Min. 0.25-inch DensDeck	Min. 0.25-inch DensDeck Prime Roof Board						
DEXcell FA	Min. 0.25-inch DEXcell F	A Glass Mat Roof Board						
DF	Deck, or Wood Deck) wit	Dekfast DF-#12-PH3 Steel Deck, or Wood Deck), Dekfast DF-#14-PH# (Concrete Deck, Steel Deck, or Wood Deck), or Dekfast DF-#15-PH3 (Steel Deck, or Wood Deck) with Dekfast PLT-R-3						
DynaFast 1	One ply of DynaFast 180	) HW or DynaFast 250 HW mechanically attac	hed as prescribed per the approved assembly					
DynaFast 2	One ply of DynaFast 180	S, DynaFast 180 HW or DynaFast 250 HW m	nechanically attached as prescribed per the approved assemb	oly				
E3	JM ENRGY 3 or JM ENR	JM ENRGY 3 or JM ENRGY 3 CGF						
E3 C1	JM ENRGY 3 C1 or JM E	ENRGY 3 C1 CGF						
	Choose one of the follow	ving fastener and plate combinations for the given	ven conditions:					
	Board or Base Sheet	Fastener	Plate	Roof Deck				
	Any	JM All Purpose Fastener, JM Structural Concrete Deck Fastener, Dekfast DF-#14- PH3, or Trufast #14 HD Fastener	JM UltraFast Metal Plate (Square), UltraFast Plate Metal Flat, UltraFast Metal Plate (Round), or UltraFast Plate Metal Recessed	Concrete				
	Any	JM UltraFast Fastener, Trufast #12 DP Fastener, Trufast #14 HD Fastener, JM High Load Fastener, Dekfast DP-#15-PH3, or Trufast #15 EHD Fastener	JM UltraFast Metal Plate (Square), UltraFast Plate Metal Flat, UltraFast Metal Plate (Round), or UltraFast Plate Metal Recessed	Steel				
	Any	JM UltraFast Fastener, Trufast #12 DP Fastener, Dekfast DF-#12-PH3, JM All Purpose Fastener, Dekfast DF-#14-PH#, JM High Load Fastener, Dekfast DF-#15- PH3, or Trufast #15 EHD Fastener	JM UltraFast Metal Plate (Square), UltraFast Plate Metal Flat, UltraFast Metal Plate (Round), or UltraFast Plate Metal Recessed	Plywood or OSB				
	Any	Dekfast DF-#14-PH3	Dekfast PLT-R-3	Concrete				
Fasteners & Plates	Any	Dekfast DF-#12-PH3 or Dekfast DFDekfast DP-#15-PH3	Dekfast PLT-R-3	Steel				
r asteriers & r lates	Any	Dekfast DF-#12-PH3, Dekfast DF-#14- PH#, or Dekfast DF-#15-PH3	Dekfast PLT-R-3	Plywood or OSB				
	Any	JM All Purpose Fastener, JM Structural Concrete Deck Fastener, or Trufast #14 HD Fastener	Trufast 3" Metal Insulation Plates	Concrete				
	ENRGY 3, SeparatoR CGF, DensDeck Prime, DEXcell FA, or SECUROCK	JM UltraFast Fastener or JM High Load Fastener	Trufast 3" Metal Insulation Plates	Steel				
	ENRGY 3, SeparatoR CGF, DensDeck Prime, DEXcell FA, or SECUROCK	JM UltraFast Fastener, JM All Purpose Fastener or JM High Load Fastener	Trufast 3" Metal Insulation Plates	Plywood or OSB				
	Any	Trufast #12 DP Fastener, Trufast #14 HD Fastener or Trufast #15 EHD Fastener	Trufast 3" Metal Insulation Plates	Steel or OSB				
	Any	Trufast #12 DP Fastener or Trufast #15 EHD Fastener	Trufast 3" Metal Insulation Plates	Plywood				
FB	One or more plies of Per	One or more plies of PermaPly 28, GlasBase Plus or Ventsulation Felt preliminarily fastened below Base Sheet as a Fire Barrier						

JMC14001.19b FL17013-R19 Page 2 of 28

This evaluation report is provided for State of Florida product approval under Rule 61G20-3. The manufacturer shall notify CREEK Technical Services, LLC of any product changes or quality assurance changes throughout the duration for which this report is valid. This evaluation report does not express nor imply warranty, installation, recommended use, or other product attributes that are not specifically addressed herein.

**APPENDIX B** 

Name	Definition				
HA BUR Base	One ply of PermaPly 28 or GlasBase Plus fully bonded in ASTM D 312, Type IV Asphalt				
HA BUR Base 2	One ply of PermaPly 28, GlasBase Plus, G	One ply of PermaPly 28, GlasBase Plus, GlasPly Premier or GlasPly IV fully bonded in ASTM D 312, Type IV Asphalt			
HA BUR Ply	One or more plies of GlasPly IV or GlasPly	Premier fully bonded in ASTM D 312, Type IV	Asphalt		
HL Fasteners & Plates	JM High Load Fasteners, Trufast #15 EHD Plates	Fasteners (steel or wood deck only), or JM All	Purpose Fasteners (concrete deck only) and JM High Load		
Insulation	One of more layers in any combination of: -DensDeck -DensDeck Prime -DEXcell Glass Mat Roof Board -DEXcell FA Glass Mat Roof Board -DEXcel Cement Board -DuraBoard -DuraFoam -ENRGY 3 -ENRGY 3 AGF -ENRGY 3 C1	-ENRGY 3 C1 CGF -ENRGY 3 CGF -ENRGY 3 FR -Fesco Board -FescoFoam -Invinsa Roof Board -Invinsa FR Roof Board -ProtectoR HD -ProtectoR HD FR -Retro-Fit Board	-RetroPlus Roof Board -SECUROCK Glass-Mat Roof Board -SECUROCK Gypsum-Fiber Roof Board -SECUROCK Cement Roof Board -SeparatoR -SeparatoR CGF -SeparatoR FR -EPS		
LWIC	Poured-in-place Cellular Lightweight Concr	ete with encapsulated insulation board			
MBR CA	MBR Cold Application Adhesive				
MBR PCA	MBR Premium Cold Application Adhesive				
MA Base	Two or more plies of PermaPly 28 or Ventsulation Felt mechanically attached as prescribed per the approved assembly				
MCRF	Minimum Characteristic Resistance Force as determined by TAS 105 for the named fastener in the selected assembly				
MDP	Maximum Design Pressure				
OSFA	JM One-Step Foamable Adhesive	'			
Preliminarily Secured	Fastened at minimum rate of four (4) faster	ners per 4-ft x 8-ft board or two (2) fasteners pe	er 4-ftx 4-ft board		
Recover	roof is not permitted. Recover roofing shall HVHZ. For mechanically fastened roof ass	Where assemblies are used to recover an existing roof, the existing roof shall consist of only one layer of roofing, i.e. recovering a previously recovered roof is not permitted. Recover roofing shall be conducted in compliance with FBC Section 1511 outside of the HVHZ and FBC Section 1521 within the HVHZ. For mechanically fastened roof assemblies, i.e. systems x-M-#, the insulation layer is optional, or any INSULATION board or slip sheet may be used as separation layer prior to installing the approved roof assembly.			
RSUA	JM Roofing System Urethane Adhesive	JM Roofing System Urethane Adhesive			
SECUROCK	Min. 0.25-inch JM SECUROCK Gypsum-Fi	ber Roof Board			
Structodek HD	Min. 0.5-inch Blue Ridge Fiber Board Struc	todek® High-Density Fiber Board Roof Insulat	ion		
TA APP Cap	One ply of APPeX 4.5 M or APPeX4.5 M F	R fully bonded by torch adhering			
TA APP Cap 2	One ply of APPeX 4.5 M, APPeX4.5 M FR,	Bicor M R, Tricor M FR or Tricor M FR CR ful	ly bonded by torch adhering		
TA APP Ply	One or more plies of JM APP Base, APPeX 4S, or APPeX 4S Embossed fully bonded by torch adhering				
TA APP Ply 2	One or more plies of APPeX 4S, APPeX 4S Embossed, Bicor S, or Tricor S fully bonded by torch adhering				
TA APP Ply 3	One or more plies of JM APP Base, APPe	(4S, APPeX 4S Embossed, Bicor S, or Tricor	S fully bonded by torch adhering		
TA SBS Ply	One or more plies of DynaFast 180 HW, DynaFast 250 HW or DynaWeld 250 S fully bonded by torch adhering				
TF	Trufast #12 DP Fastener (Steel Deck or Wood Deck), Trufast #14 HD Fastener (Concrete Deck, Steel Deck, or Wood Deck), or Trufast #15 EHD Fasteners (Concrete Deck, Steel Deck or Wood Deck) with Trufast 3" Metal Insulation Plate				
Tricor	One ply of Tricor M FR or Tricor M FR CR				

JMC14001.19b FL17013-R19 Page 3 of 28

**APPENDIX B** 

Name	Definition				
UF	JM UltraFast Fasteners ( <i>Steel Deck</i> or <i>Wood Deck</i> ), JM All Purpose Fasteners ( <i>Concrete Deck</i> , <i>Steel Deck</i> , or <i>Wood Deck</i> ), or JM High Load Fasteners ( <i>Wood Deck</i> or <i>Steel Deck</i> ) with JM UltraFast Metal Plate (Square), UltraFast Plate Metal Flat, UltraFast Metal Plate (Round), or UltraFast Plate Metal Recessed				
UF Fasteners & Plates		DP Fastener, Dekfast DP-#15-PH3, Trufast #15 essed, UltraFast Plate Metal Flat or UltraFast Sc		d Fastener with UltraFast 3" R	ound Metal
UF Fasteners & Plates (Square)	Plate or UltraFast Plate Metal Fla			·	
	One of the following options may Assembly and the MDP for the ch	be utilized as allowed by the <i>Approved Asseml</i> nosen vapor barrier.	bly. The MDP shall be limite	d to the lesser of rating of the	Approved
	Primer	Vapor Barrier	VB Application	Insulation Adhesive	MDP (psf)
	None	DynaBase HW	Torch adhered	OSFA 12-inch o.c.	-172.5
	None	DynaBase HW	Torch adhered	2-Part UIA 12-inch o.c.	-135
	None	DynaBase HW	Torch adhered	RSUA 12-inch o.c.	-195
	ASTM D 41	DynaGrip Base SD/SA	Self-adhered	OSFA 12-inch o.c.	-90
	ASTM D 41	DynaGrip Base SD/SA	Self-adhered	2-Part UIA 12-inch o.c.	-97.5
	ASTM D 41	DynaGrip Base SD/SA	Self-adhered	RSUA 12-inch o.c.	-82.5
	ASTM D 41	DynaGrip Base PR SD/SA	Self-adhered	RSUA 12-inch o.c.	-202.5
	ASTM D 41	DynaGrip Base PR SD/SA	Self-adhered	2-Part UIA 12-inch o.c	-262.5
	None	DynaLastic 180 S, DynaLastic 250 S, DynaFast 180 S, or DynaBase PR; Laps sealed with DynaSet 1k	DynaSet 1k 12-inch o.c.	OSFA, 2-Part UIA, or RSUA 12-inch o.c.	-232.5
Vapor Barriers for Adhered Assemblies over	None	DynaLastic 180 S, DynaLastic 250 S, DynaFast 180 S, or DynaBase PR; Laps sealed with DynaSet 1k	DynaSet 1k 12-inch o.c.	ASTM D 312, Type IV Asphalt	-337.5
Concrete Deck	None	DynaLastic 180, DynaLastic 180 FR, DynaLastic 250, DynaLastic 250 FR, DynaMax, or DynaMax FR; Laps sealed with DynaSet 1k	DynaSet 1k 12-inch o.c.	OSFA, 2-Part UIA, or RSUA 12-inch o.c.	-232.5
	None	DynaLastic 180 S, DynaLastic 250 S, DynaFast 180 S, or DynaBase PR; Laps sealed with DynaSet 2k	DynaSet 2k 12-inch o.c.	OSFA, 2-Part UIA, or RSUA 12-inch o.c.	-97.5
	None	DynaLastic 180 S, DynaLastic 250 S, DynaFast 180 S, or DynaBase PR; Laps sealed with DynaSet 2k	DynaSet 2k 12-inch o.c.	ASTM D 312, Type IV Asphalt	-75
	ASTM D 41	DynaWeld Base	Torch adhered	OSFA 12-inch o.c.	-150
	ASTM D 41	DynaWeld Base	Torch adhered	2-Part UIA 12-inch o.c.	-120
	ASTM D 41	DynaWeld Base	Torch adhered	RSUA 12-inch o.c.	-285
	JM SA Primer Low VOC	JM Vapor Barrier SA or SAR	Self-adhered	OSFA or RSUA 12-inch o.c.	-135
	JM SA Primer Low VOC	JM Vapor Barrier SA or SAR	Self-adhered	2-Part UIA 12-inch o.c.	-82.5

JMC14001.19b FL17013-R19 Page 4 of 28



Johns Manville Corporation
APP Modified Roofing Systems

**APPENDIX B** 

Name	Definition						
Vapor Barriers for	One of the following option Assembly and the MDP for			proved Assembly. The N	IDP shall be limited to	the lesser of rating of the	Approved
Adhered Assemblies over CWF Deck	Thermal Barrier	TB Adhesive	Primer	Vapor Barrier	VB Application	Insulation Adhesive	MDP (psf)
OWI DOOR	SECUROCK	RSUA 12-inch o.c.	ASTM D 41	DynaWeld Cap	Torch adhered	RSUA 12-inch o.c.	-250

Johns Manville Corporation APP Modified Roofing Systems

APPENDIX B

#### **APPROVED ASSEMBLIES**

The following notes shall be observed when using the assembly tables below.

- 1. MDPs were calculated using a 2:1 margin of safety per FBC Section 1504.9 and 1523.4.
- 2. Refer to LIMITATIONS and NOMENCLATURE sections of this evaluation when using the table(s) below.
- 3. Refer to INSTALLATION section of this report for installation detail when the information is not explicitly stated for the selected assembly.
- 4. The on-center (o.c.) spacing given is the maximum allowable attachment spacing for the rated system.
- 5. As Tested information for roof deck construction is provided for information only. The addition of the As Tested deck information does not obviate the requirement for rational design of the roof deck and roof deck attachment in accordance with FBC requirements.
- 6. Prior to application of the approved assembly an optional vapor barrier, such as 4-6 mil polyethylene or JM Vapor Barrier SA, JM, Vapor Barrier SAR, DynaGrip Base SD/SA or DynaBase HW adhered to SECUROCK Gypsum-Fiber Roof Board, DensDeck Prime, or DEXcell FA Glass Mat Roof Board may be installed over concrete or steel decks when the approved assembly contains insulation or the membrane fastened through to the deck.
- 7. Base Insulation in assemblies with All Layers Adhered may be installed in one or more layers.

	Assembly System Numbers and Definitions	
C-A-#	Assemblies with All Layers Adhered over Concrete Deck (New or Existing)	
C-AM-#	Assemblies with Adhered Membranes over Insulated Concrete Deck (New, Existing, or Recover)	
C-M-#	Mechanically Fastened Assemblies over Concrete Deck (New, Existing, or Recover)	
CW-A-#	Assemblies with All Layers Adhered over Cementitious Wood Fiber Deck (New or Existing)	
G-A-#	Assemblies with All Layers Adhered over Poured Gypsum Deck (New or Existing)	
LC-A-#	Lightweight Concrete Assemblies with All Layers Adhered over Concrete Deck (New or Existing)	
LC-AM-#	Lightweight Concrete Assemblies with Adhered Membranes over Concrete Deck (New or Existing)	
LC-M-#	Mechanically Fastened Lightweight Concrete Assemblies over Concrete Deck (New or Existing)	
LS-M-#	Mechanically Fastened Lightweight Concrete Assemblies over Steel Deck (New or Existing)	
S-A-#	Adhered Steel Deck Assemblies (New or Existing)	
S-AM-#	Assemblies with Adhered Membranes over Insulated Steel Deck (New, Existing, or Recover)	
S-M-#	Mechanically Fastened Assemblies over Steel Deck (New, Existing, or Recover)	
W-A-#	Assemblies with All Layers Adhered over Wood Deck (New or Existing)	
W-AM-#	Assemblies with Adhered Membranes over Insulated Wood Deck (New, Existing, or Recover)	
W-M-#	Mechanically Fastened Assemblies over Wood Deck (New, Existing, or Recover)	

	Assemblies with All Layers Adhered over Concrete Deck (New or Existing)										
System No.	Vapor Barrier	Base Insulation (Note 7)	Top Insulation	Base Sheet	Ply Sheet	Cap Sheet	MDP (psf)				
C-A-1	OPTIONAL Vapor Barriers for Adhered Assemblies over Concrete Deck	Min. 1.5-inch <i>E3</i> , FescoFoam or DuraFoam fully adhered in <i>Asphalt</i>	DuraBoard fully adhered in Asphalt	TA APP Ply	OPTIONAL TA APP Ply	TA APP Cap	-67.5 (Lim. 9)				

JMC14001.19b FL17013-R19 Page 6 of 28

**APPENDIX B** 

		Assemblies with All L	ayers Adhered over Concrete	Deck (New or Exi	sting)		
System No.	Vapor Barrier	Base Insulation (Note 7)	Top Insulation	Base Sheet	Ply Sheet	Cap Sheet	MDP (psf)
C-A-2	OPTIONAL Vapor Barriers for Adhered Assemblies over Concrete Deck	Min. 1.5-inch <i>E</i> 3 fully adhered in Asphalt	DuraBoard or FescoBoard fully adhered in Asphalt	PermaPly 28 fully bonded in Asphalt (OPTIONAL with HA BUR Ply)	OPTIONAL TA APP Ply or HA BUR Ply	TA APP Cap	-120 (Lim. 9)
C-A-3	OPTIONAL Vapor Barriers for Adhered Assemblies over Concrete Deck	Min. 1.5-inch ENRGY 3 secured with 2-Part UIA, OSFA, or RSUA ribbons spaced 12-inch o.c.	ProtectoR HD secured with 2-Part UIA, OSFA, or RSUA ribbons spaced 12-inch o.c.	CA APP Ply	OPTIONAL CA APP Ply	CA APP Cap	-112.5 (Lim. 9)
C-A-4	OPTIONAL Vapor Barriers for Adhered Assemblies over Concrete Deck	Min. 1.5-inch ENRGY 3 secured with 2-Part UIA, OSFA, or RSUA ribbons spaced 12-inch o.c.	-	CA APP Ply	OPTIONAL CA APP Ply	CA APP Cap	-120 (Lim. 9)
C-A-5	OPTIONAL Vapor Barriers for Adhered Assemblies over Concrete Deck	Min. 1-inch ENRGY 3 secured with OSFA, 2-Part UIA, or RSUA ribbons spaced 12-inch o.c.	DensDeck Prime, DEXcell FA, or SECUROCK secured with OSFA, 2-Part UIA, or RSUA ribbons spaced 12-inch o.c.	CA APP Ply	OPTIONAL CA APP Ply	CA APP Cap	-120 (Lim. 9)
C-A-6	OPTIONAL Vapor Barriers for Adhered Assemblies over Concrete Deck	Min. 1.5-inch ENRGY 3 secured with 2-Part UIA, OSFA, or RSUA ribbons spaced 12-inch o.c.	-	DynaGrip Base SD/SA	OPTIONAL TA APP Ply 2	TA APP Cap 2	-135 (Lim. 9)
C-A-7	OPTIONAL Vapor Barriers for Adhered Assemblies over Concrete Deck	Retro-Fit Board, DuraBoard, Fesco Board, or min. 1.5-inch <i>E3</i> , FescoFoam or DuraFoam fully adhered in <i>Asphalt</i>	-	PermaPly 28 fully bonded in Asphalt	OPTIONAL TA APP Ply	TA APP Cap	-150 (Lim. 9)
C-A-8	OPTIONAL Vapor Barriers for Adhered Assemblies over Concrete Deck	Min. 1.5-inch ENRGY 3 secured with 2-Part UIA, OSFA, or RSUA ribbons spaced 12-inch o.c.	ProtectoR HD secured with 2-Part UIA, OSFA, or RSUA ribbons spaced 12-inch o.c.	DynaGrip Base SD/SA	OPTIONAL TA APP Ply 2	TA APP Cap 2	-165 (Lim. 9)

JMC14001.19b FL17013-R19 Page 7 of 28



**APPENDIX B** 

Assemblies with All Layers Adhered over Concrete Deck (New or Existing)  System Vanar Barrier Base Insulation Top Insulation Base Sheet Bly Sheet Con Sheet MDR										
Vapor Barrier	Base Insulation (Note 7)	Top Insulation	Base Sheet	Ply Sheet	Cap Sheet	MDP (psf)				
OPTIONAL Vapor Barriers for Adhered Assemblies over Concrete Deck	Min. 1.5-inch ENRGY 3 secured with 2-Part UIA, OSFA, or RSUA ribbons spaced 12-inch o.c.	-	DynaGrip Base SD/SA	OPTIONAL TA APP Ply	TA APP Cap	-172.5 (Lim. 9)				
OPTIONAL Vapor Barriers for Adhered Assemblies over Concrete Deck	Min. 1.5-inch ENRGY 3 secured with 2-Part UIA, OSFA, or RSUA ribbons spaced 12-inch o.c.	ProtectoR HD secured with 2-Part UIA, OSFA, or RSUA ribbons spaced 12-inch o.c.	DynaGrip Base SD/SA	OPTIONAL TA APP Ply	TA APP Cap	-187.5 (Lim. 9)				
OPTIONAL Vapor Barriers for Adhered Assemblies over Concrete Deck	Min. 1.5-inch ENRGY 3 secured with RSUA ribbons spaced 12-inch o.c.	DensDeck Prime secured with RSUA ribbons spaced 12-inch o.c.	JM APP Base torch adhered	OPTIONAL APPeX 4S	TA APP Cap	-195 (Lim. 9)				
OPTIONAL Vapor Barriers for Adhered Assemblies over Concrete Deck	Min. 2-inch ENRGY 3 secured in 2-Part UIA or OSFA spaced 12-inch o.c.	SECUROCK secured with 2-Part UIA or OSFA ribbons spaced 12-inch o.c.	APPeX 4S	OPTIONAL APPeX 4S	TA APP Cap	-232.5 (Lim. 9)				
OPTIONAL Vapor Barriers for Adhered Assemblies over Concrete Deck	Min. 2-inch ENRGY 3 secured in 2-Part UIA or OSFA spaced 12-inch o.c.	SECUROCK secured with 2-Part UIA or OSFA ribbons spaced 12-inch o.c.	DynaGrip Base SD/SA	OPTIONAL TA APP Ply 3	TA APP Cap 2	-232.5 (Lim. 9)				
Vapor Barriers for Adhered Assemblies over Concrete Deck	Min. 1.5-inch ENRGY 3 secured in RSUA spaced 12-inch o.c.	SECUROCK primed with ASTM D 41 primer secured with RSUA ribbons spaced 12-inch o.c.	APPeX 4S	OPTIONAL APPeX 4S	TA APP Cap	-245 (Lim. 9)				
Vapor Barriers for Adhered Assemblies over Concrete Deck	Min. 1.5-inch ENRGY 3 secured in RSUA spaced 12-inch o.c.	SECUROCK primed with ASTM D 41 primer secured with RSUA ribbons spaced 12-inch o.c.	DynaGrip Base SD/SA	OPTIONAL TA APP Ply 3	TA APP Cap 2	-245 (Lim. 9)				
Vapor Barriers for Adhered Assemblies over Concrete Deck	Min. 1.5-inch ENRGY 3 secured in RSUA spaced 12-inch o.c.	-	DynaGrip Base SD/SA	OPTIONAL TA APP Ply 3	TA APP Cap 3	-245 (Lim. 9; Non- HVHZ)				
	OPTIONAL Vapor Barriers for Adhered Assemblies over Concrete Deck OPTIONAL Vapor Barriers for Adhered Assemblies over Concrete Deck OPTIONAL Vapor Barriers for Adhered Assemblies over Concrete Deck OPTIONAL Vapor Barriers for Adhered Assemblies over Concrete Deck OPTIONAL Vapor Barriers for Adhered Assemblies over Concrete Deck OPTIONAL Vapor Barriers for Adhered Assemblies over Concrete Deck Vapor Barriers for Adhered Assemblies over Concrete	Vapor Barrier  OPTIONAL Vapor Barriers for Adhered Assemblies over Concrete Deck  OPTIONAL Vapor Barriers for Adhered Assemblies over Concrete Deck  OPTIONAL Vapor Barriers for Adhered Assemblies over Concrete Deck  OPTIONAL Vapor Barriers for Adhered Assemblies over Concrete Deck  OPTIONAL Vapor Barriers for Adhered Assemblies over Concrete Deck  OPTIONAL Vapor Barriers for Adhered Assemblies over Concrete Deck  OPTIONAL Vapor Barriers for Adhered Assemblies over Concrete Deck  OPTIONAL Vapor Barriers for Adhered Assemblies over Concrete Deck  Vapor Barriers for Adhered Assemblies Over Co	Vapor Barrier OPTIONAL Vapor Barriers for Adhered Assemblies over Concrete Deck OPTIONAL Vapor Barriers for Adhered Assemblies over Concrete Deck OPTIONAL Vapor Barriers for Adhered Assemblies over Concrete Deck OPTIONAL Vapor Barriers for Adhered Assemblies over Concrete Deck OPTIONAL Vapor Barriers for Adhered Assemblies over Concrete Deck OPTIONAL Vapor Barriers for Adhered Assemblies over Concrete Deck OPTIONAL Vapor Barriers for Adhered Assemblies over Concrete Deck OPTIONAL Vapor Barriers for Adhered Assemblies over Concrete Deck OPTIONAL Vapor Barriers for Adhered Assemblies over Concrete Deck OPTIONAL Vapor Barriers for Adhered Assemblies over Concrete Deck OPTIONAL Vapor Barriers for Adhered Assemblies over Concrete Deck Vapor Barriers for Adhered Assemblies over Concrete	Vapor Barrier OPTIONAL Vapor Barriers for Adhered Assemblies over Concrete Deck OPTIONAL Vapor Barriers for Adhered Assemblies over Concrete Deck OPTIONAL Vapor Barriers for Adhered Assemblies over Concrete Deck OPTIONAL Vapor Barriers for Adhered Assemblies over Concrete Deck OPTIONAL Vapor Barriers for Adhered Assemblies over Concrete Deck OPTIONAL Vapor Barriers for Adhered Assemblies over Concrete Deck OPTIONAL Vapor Barriers for Adhered Assemblies over Concrete Deck OPTIONAL Vapor Barriers for Adhered Assemblies over Concrete Deck OPTIONAL Vapor Barriers for Adhered Assemblies over Concrete Deck OPTIONAL Vapor Barriers for Adhered Assemblies over Concrete Deck OPTIONAL Vapor Barriers for Adhered Assemblies over Concrete Deck Vapor Barriers for Adhered Assemblies Over Concrete	Vapor Barrier	Vapor Barrier   Base Insulation   Note 7   Note 7   Note 7				

JMC14001.19b FL17013-R19 Page 8 of 28

This evaluation report is provided for State of Florida product approval under Rule 61G20-3. The manufacturer shall notify CREEK Technical Services, LLC of any product changes or quality assurance changes throughout the duration for which this report is valid. This evaluation report does not express nor imply warranty, installation, recommended use, or other product attributes that are not specifically addressed herein.



#### **APPENDIX B**

	Assemblies with All Layers Adhered over Concrete Deck (New or Existing)										
System No.	Vapor Barrier	Base Insulation (Note 7)	Top Insulation	Base Sheet	Ply Sheet	Cap Sheet	MDP (psf)				
C-A-17	OPTIONAL Vapor Barriers for Adhered Assemblies over Concrete Deck	Min. 1.5-inch ENRGY 3 CGF fully adhered in <i>Asphalt</i>	DuraBoard fully adhered in <i>Asphalt</i>	PermaPly 28 fully bonded in ASTM D 312 Type IV Asphalt	OPTIONAL TA APP Ply	TA APP Cap	-277.5 (Lim. 9)				
C-A-18	Vapor Barriers for Adhered Assemblies over Concrete Deck	Min. 1.5-inch ENRGY 3 CGF secured in <i>RSUA</i> spaced 12-inch o.c.	SECUROCK primed with ASTM D 41 primer secured with RSUA ribbons spaced 12-inch o.c.	APPeX 4S	OPTIONAL APPeX 4S	TA APP Cap	-292.5 (Lim. 9)				
C-A-19	OPTIONAL Vapor Barriers for Adhered Assemblies over Concrete Deck	Min. 1.5-inch ENRGY 3, ENRGY 3 AGF or FescoFoam fully adhered in Asphalt	DuraBoard fully adhered in <i>Asphalt</i>	PermaPly 28 fully bonded in Asphalt	OPTIONAL TA APP Ply	TA APP Cap	-305 (Lim. 9)				
C-A-20	OPTIONAL Vapor Barriers for Adhered Assemblies over Concrete Deck	-	-	PermaPly 28 fully bonded in Asphalt	OPTIONAL TA APP Ply	TA APP Cap	-305 (Lim. 9)				
C-A-21	OPTIONAL Vapor Barriers for Adhered Assemblies over Concrete Deck	-	-	TA APP Ply	OPTIONAL TA APP Ply	TA APP Cap	-315 (Lim. 9)				

	Assemblies with Adhered Membranes over Insulated Concrete Deck (New, Existing, or Recover)											
System No.	Base Insulation	Base Insulation Attachment	Top Insulation	Top Insulation Attachment	Base Sheet	Ply Sheet	Cap Sheet	MDP (psf)				
C-AM-1	Min. 1.5-inch E3	Simultaneously fastened with Top Insulation	ProtectoR HD	Fasteners & Plates secured at a rate of 1 per 4.0 ft <sup>2</sup>	DynaGrip Base PR SD/SA	OPTIONAL TA APP Ply 2	TA APP Cap 2	-30 (Lim. 7; Non- HVHZ)				
C-AM-2	Min. 1.5-inch E3	Simultaneously fastened with Top Insulation	ProtectoR HD	Fasteners & Plates secured at a rate of 1 per 4.0 ft <sup>2</sup>	BA APP Ply or CA APP Ply	OPTIONAL BA APP Ply or CA APP Ply	BA APP Cap or CA APP Cap	-30 (Lim. 7; Non- HVHZ)				

JMC14001.19b FL17013-R19 Page 9 of 28

#### APPENDIX B

		Assemblies with Adher	red Membranes over	r Insulated Concrete	Deck (New, Exis	ting, or <i>Recover</i> )		
System No.	Base Insulation	Base Insulation Attachment	Top Insulation	Top Insulation Attachment	Base Sheet	Ply Sheet	Cap Sheet	MDP (psf)
C-AM-3	Min. 1.5-inch E3	Simultaneously fastened with Top Insulation	Min. 0.5-inch DEXcell FA	Fasteners & Plates secured at a rate of 1 per 4.0 ft <sup>2</sup>	CA APP Ply	OPTIONAL CA APP Ply	CA APP Cap	-37.5 (Lim. 7; Non- HVHZ)
C-AM-4	Min. 1.5-inch E3, FescoFoam or DuraFoam	UF Fasteners & Plates secured at a rate of 1 fastener per 2 ft <sup>2</sup>	Retro-Fit Board, DuraBoard, Structodek <i>HD</i> , or Fesco Board	Asphalt	PermaPly 28 fully bonded in Asphalt	OPTIONAL TA APP Ply	TA APP Cap	-45 (Lim. 7)
C-AM-5	Min. 1.5-inch <i>E</i> 3	Simultaneously fastened with Top Insulation	Min. 0.5-inch DensDeck Prime	Fasteners & Plates secured at a rate of 1 fastener per 5.33ft <sup>2</sup>	CA APP Ply or TA APP Ply 3	OPTIONAL CA APP Ply or TA APP Ply 3	CA APP Cap or TA APP Cap 2	-45 (Non- HVHZ; Lim. 7)
C-AM-6	Min. 1.5-inch <i>E3</i>	Simultaneously fastened with Top Insulation	DensDeck Prime	Fasteners & Plates secured at a rate of 1 fastener per 4ft <sup>2</sup>	CA APP Ply or TA APP Ply 3	OPTIONAL CA APP Ply or TA APP Ply 3	CA APP Cap or TA APP Cap 2	-45 (Non- HVHZ; Lim. 7)
C-AM-7	Min. 2-inch E3	Fasteners & Plates secured at a rate of 1 fastener per 4ft <sup>2</sup>	ProtectoR HD	OSFA, RSUA, or 2- Part UIA applied 12- inch o.c.	DynaGrip Base SD/SA	OPTIONAL TA APP Ply 3	TA APP Cap 2	-45 (Non- HVHZ; Lim. 7)
C-AM-8	Min. 2-inch E3	Fasteners & Plates secured at a rate of 1 fastener per 4ft <sup>2</sup>	DensDeck Prime, DEXcell FA, or SECUROCK	OSFA, RSUA, or 2- Part UIA applied 12- inch o.c.	CA APP Ply or TA APP Ply 2	OPTIONAL CA APP Ply or TA APP Ply 2	CA APP Cap or TA APP Cap 2	-45 (Non- HVHZ; Lim. 7)
C-AM-9	Min. 2-inch E3	Fasteners & Plates secured at a rate of 1 fastener per 4ft <sup>2</sup>	DensDeck Prime, DEXcell FA, or SECUROCK	OSFA, RSUA, or 2- Part UIA applied 12- inch o.c.	DynaGrip Base SD/SA	OPTIONAL TA APP Ply 3	TA APP Cap 2	-45 (Non- HVHZ; Lim. 7)
C-AM-10	Min. 2-inch E3	Fasteners & Plates secured at a rate of 1 fastener per 4ft <sup>2</sup>	Min. 1.5-inch <i>E</i> 3	RSUA or 2-Part UIA applied 12-inch o.c.	DynaGrip Base SD/SA	OPTIONAL TA APP Ply 3	TA APP Cap 2	-45 (Non- HVHZ; Lim. 7)
C-AM-11	Min. 1.5-inch E3, FescoFoam or DuraFoam	UF Fasteners & Plates secured at a rate of 1 fastener per 1.33 ft <sup>2</sup>	Retro-Fit Board, DuraBoard, Structodek <i>HD</i> , or Fesco Board	Asphalt	PermaPly 28 fully bonded in Asphalt	OPTIONAL TA APP Ply	TA APP Cap	-52.5 (Lim. 7)
C-AM-12	OPTIONAL Min. 1.5-inch <i>E</i> 3	Simultaneously fastened with Top Insulation	Min. 3/4-inch DuraBoard	Fasteners & Plates secured at a rate of 1 per 1.33 ft <sup>2</sup>	TA APP Ply	-	TA APP Cap	-67.5 (Lim. 7)
C-AM-13	OPTIONAL Min. 1.5-inch <i>E</i> 3	Simultaneously fastened with Top Insulation	Min. 3/4-inch DuraBoard	Fasteners & Plates secured at a rate of 1 per 1.33 ft <sup>2</sup>	TA APP Ply	-	TA APP Cap	-75 (Lim. 7)

JMC14001.19b FL17013-R19 Page 10 of 28



#### **APPENDIX B**

		Assemblies with Adhe	red Membranes over	r Insulated Concrete	Deck (New, Exis	ting, or Recover)		
System No.	Base Insulation	Base Insulation Attachment	Top Insulation	Top Insulation Attachment	Base Sheet	Ply Sheet	Cap Sheet	MDP (psf)
C-AM-14	Min. 2-inch <i>E</i> 3	Fasteners & Plates s secured at a rate of 1 per 1.45 ft <sup>2</sup>	Min. 0.5-inch Retro- Fit Board or DuraBoard	Asphalt	3 plies HA BUR Ply	-	TA APP Cap	-75 (Lim. 7)
C-AM-15	OPTIONAL Insulation	Simultaneously fastened with Top Insulation	Min. 2-inch <i>E</i> 3	Fasteners & Plates secured at a rate of 20 per 4-ft x 8-ft board	DynaGrip Base SD/SA	OPTIONAL TA APP Ply 3	TA APP Cap 2	-75 (Lim. 7)

	Mechanically Fastened Assemblies over Concrete Deck (New, Existing, or Recover)										
System No.	Insulation	Base Sheet	Base Sheet Attachment	Ply Sheet	Cap Sheet	MDP (psf)					
C-M-1	OPTIONAL Retro-Fit Board DuraBoard, Fesco Board, or Min. 1.5-inch E3, FescoFoam or DuraFoam Preliminarily Secured	MA Base	UF Fasteners & Plates spaced 9-inch o.c. in the 4-inch lap and 12-inch o.c.in two rows staggered in field of the sheet	OPTIONAL TA APP Ply	TA APP Cap	-52.5 (Lim. 7)					
C-M-2	Retro-Fit Board DuraBoard, Fesco Board, or Min. 1.5-inch E3, FescoFoam or DuraFoam Preliminarily Secured	GlasBase Plus	UF Fasteners & Plates spaced 9-inch o.c. in the 4-inch lap and 12-inch o.c.in two rows staggered in field of the sheet	OPTIONAL TA APP Ply	TA APP Cap	-97.5 (Lim. 7)					

	Assemblies with All Layers Adhered over Cementitious Wood Fiber Deck (New or Existing)									
System No.	Vapor Barrier	Base Insulation (Note 7)	Base Attachment	Top Insulation	Top Attachment	Base Ply	Ply Sheet	Cap Sheet	MDP (psf)	
CW-A-1	OPTIONAL Vapor Barriers for Adhered Assemblies over CWF Deck	Min. 1.5-inch ENRGY 3	RSUA applied 12-inch o.c.	ProtectoR HD	RSUA applied 12-inch o.c.	CA APP Ply	OPTIONAL CA APP Ply	CA APP Cap	-112.5 (Lim. 9; HVHZ Only)	
CW-A-2	OPTIONAL Vapor Barriers for Adhered Assemblies over CWF Deck	Min. 1.5-inch ENRGY 3	RSUA applied 12-inch o.c.	-	-	CA APP Ply	OPTIONAL CA APP Ply	CA APP Cap	-120 (Lim. 9; HVHZ Only)	
CW-A-3	OPTIONAL Vapor Barriers for Adhered Assemblies over CWF Deck	Min. 1.5-inch ENRGY 3	RSUA applied 12-inch o.c.	DensDeck Prime or SECUROCK	RSUA applied 12-inch o.c.	CA APP Ply	OPTIONAL CA APP Ply	CA APP Cap	-120 (Lim. 9; HVHZ Only)	
CW-A-4	OPTIONAL Vapor Barriers for Adhered Assemblies over CWF Deck	Min. 1.5-inch ENRGY 3	RSUA applied 12-inch o.c.	-	-	DynaGrip Base SD/SA	OPTIONAL <i>TA APP Ply</i>	TA APP Cap	-172.5 (Lim. 9; HVHZ Only)	

JMC14001.19b FL17013-R19 Page 11 of 28

This evaluation report is provided for State of Florida product approval under Rule 61G20-3. The manufacturer shall notify CREEK Technical Services, LLC of any product changes or quality assurance changes throughout the duration for which this report is valid. This evaluation report does not express nor imply warranty, installation, recommended use, or other product attributes that are not specifically addressed herein.

**APPENDIX B** 

		Assemblies v	with All Layers	Adhered over C	ementitious Wo	od Fiber Deck (Ne	w or Existing)		
System No.	Vapor Barrier	Base Insulation (Note 7)	Base Attachment	Top Insulation	Top Attachment	Base Ply	Ply Sheet	Cap Sheet	MDP (psf)
CW-A-5	OPTIONAL Vapor Barriers for Adhered Assemblies over CWF Deck	Min. 1.5-inch ENRGY 3	RSUA applied 12-inch o.c.	ProtectoR HD	RSUA applied 12-inch o.c.	DynaGrip Base SD/SA	OPTIONAL TA APP Ply	TA APP Cap	-187.5 (Lim. 9; HVHZ Only)
CW-A-6	OPTIONAL Vapor Barriers for Adhered Assemblies over CWF Deck	Min. 1.5-inch ENRGY 3	RSUA applied 12-inch o.c.	DensDeck Prime	RSUA applied 12-inch o.c.	JM APP Base torch adhered	OPTIONAL APPeX 4S	TA APP Cap	-195 (Lim. 9; HVHZ Only)
CW-A-7	OPTIONAL Vapor Barriers for Adhered Assemblies over CWF Deck	Min. 1.5-inch ENRGY 3	RSUA applied 12-inch o.c.	SECUROCK	RSUA applied 12-inch o.c.	APPeX 4S	OPTIONAL APPeX 4S	TA APP Cap	-232.5 (Lim. 9; HVHZ Only)
CW-A-8	OPTIONAL Vapor Barriers for Adhered Assemblies over CWF Deck	Min. 1.5-inch ENRGY 3	RSUA applied 12-inch o.c.	SECUROCK	RSUA applied 12-inch o.c.	DynaGrip Base SD/SA	OPTIONAL TA APP Ply 2	TA APP Cap 3	-232.5 (Lim. 9; HVHZ Only)

		Assemblies	with All Layers Ad	hered over Poured Gyp	sum Deck (New or	Existing)		
System No.	Base Insulation (Note 7)	Base Insulation Attachment	Cover Board	Cover Board Attachment	Base Ply	Ply Sheet	Cap Sheet	MDP (psf)
G-A-1	Min. 1.5-inch ENRGY 3	OSFA or RSUA applied 12-inch o.c.	DensDeck Prime, DEXcell FA, or SECUROCK	OSFA or RSUA applied 12-inch o.c.	TA APP Ply 3	OPTIONAL TA APP Ply 3	TA APP Cap 2	-45 (Lim. 9)
G-A-2	Min. 1.5-inch ENRGY 3	OSFA or RSUA applied 12-inch o.c.	DensDeck Prime, DEXcell FA, or SECUROCK	OSFA or RSUA applied 12-inch o.c.	CA APP Ply	OPTIONAL CA APP Ply	CA APP Cap	-45 (Lim. 9)
G-A-3	Min. 1.5-inch ENRGY 3	OSFA or RSUA applied 12-inch o.c.	DensDeck Prime, DEXcell FA, or SECUROCK	OSFA or RSUA applied 12-inch o.c.	DynaGrip Base SD/SA	OPTIONAL TA APP Ply 3	TA APP Cap 2	-45 (Lim. 9)

JMC14001.19b FL17013-R19 Page 12 of 28



#### APPENDIX B

		Lightweight Concre	te Assemblies witl	h All Layers Adhered o	ver Concrete Deck (	New or Existing)		
System No.	Vapor Barrier	LWIC	Base Insulation (Note 7)	Cover Board	Base Ply	Ply Sheet	Cap Sheet	MDP (psf)
LC-A-1	-	Min. 350 psi Celcore MF with HS Rheology Admixture	Min. 0.5-inch ENRGY 3 adhered in <i>OSFA</i> applied 12-inch o.c.	DensDeck Prime, DEXcell FA, or SECUROCK adhered in OSFA applied 12-inch o.c.	TA APP Ply 3	OPTIONAL TA APP Ply 3	TA APP Cap 2	-90 (Lim. 9)
LC-A-2	-	Min. 400 psi Celcore MF with HS Rheology Admixture with DynaBase PR adhered in DynaSet 1k applied 12-inch o.c.	Min. 0.5-inch ENRGY 3 adhered in <i>RSUA</i> applied 12-inch o.c.	DensDeck Prime, DEXcell FA, or SECUROCK adhered n RSUA applied 12-inch o.c.	TA APP Ply 3	OPTIONAL TA APP Ply 3	TA APP Cap 2	-180 (Lim. 9)
LC-A-3	-	Min. 400 psi Celcore MF with HS Rheology Admixture with DynaBase PR adhered in DynaSet 1k applied 12-inch o.c.	Min. 0.5-inch ENRGY 3 adhered in <i>RSUA</i> applied 12-inch o.c.	SECUROCK adhered n RSUA applied 12-inch o.c.	DynaGrip Base SD/SA	OPTIONAL TA APP Ply 3	TA APP Cap 2	-180 (Lim. 9)
LC-A-4	-	Min. 350 psi Celcore MF with HS Rheology Admixture	Min. 0.5-inch ENRGY 3 adhered in <i>RSUA</i> applied 12-inch o.c.	DensDeck Prime, DEXcell FA, or SECUROCK adhered n RSUA applied 12-inch o.c.	TA APP Ply 3	OPTIONAL TA APP Ply 3	TA APP Cap 2	-232.5 (Lim. 9)
LC-A-5	-	Min. 350 psi Celcore MF with HS Rheology Admixture	Min. 0.5-inch ENRGY 3 adhered in <i>RSUA</i> applied 12-inch o.c.	SECUROCK adhered n RSUA applied 12-inch o.c.	DynaGrip Base SD/SA	OPTIONAL TA APP Ply 3	TA APP Cap 2	-232.5 (Lim. 9)

		Lightweight Con	crete Assemblies with Adh	ered Membranes over <i>Con</i>	crete Deck (New or Exi	sting)	
System No.	Vapor Barrier	LWIC	Base Sheet	Insulation/Cover Board	Ply Sheet	Cap Sheet	MDP (psf)
LC-AM-1	-	Min. 350 psi Celcore MF with HS Rheology Admixture	DynaBase, DynaLastic 180 S, GlasBase Plus, or Ventsulation Felt secured with min. 1.7-inch LWC CR Base Sheet Fasteners secured 7-inch o.c. at the 3-inch lap and 7-inch o.c. in two (2) equally spaced staggered rows in the field	Min. 0.5-inch E3 or E3 C1 followed by DensDeck Prime, DEXcell FA, or SECUROCK adhered in 2- Part UIA applied 12-inch o.c.	TA APP Ply 3	TA APP Cap 2	-45 (Lim. 7)

JMC14001.19b FL17013-R19 Page 13 of 28

#### **APPENDIX B**

		Lightweight Con	crete Assemblies with Adh	ered Membranes over Cond	crete Deck (New or Exi	sting)	
System No.	Vapor Barrier	LWIC	Base Sheet	Insulation/Cover Board	Ply Sheet	Cap Sheet	MDP (psf)
LC-AM-2	-	Min. 350 psi Celcore MF with HS Rheology Admixture	DynaBase, DynaLastic 180 S, GlasBase Plus, or Ventsulation Felt secured with min. 1.7-inch LWC CR Base Sheet Fasteners secured 7-inch o.c. at the 3-inch lap and 7-inch o.c. in two (2) equally spaced staggered rows in the field	Min. 0.5-inch E3 or E3 C1 followed by DensDeck Prime, DEXcell FA, or SECUROCK adhered in 2- Part UIA applied 12-inch o.c.	DynaGrip Base SD/SA	TA APP Cap 2	-45 (Lim. 7)
LC-AM-3	-	Min. 350 psi Celcore MF with HS Rheology Admixture	DynaBase, DynaLastic 180 S, GlasBase Plus, or Ventsulation Felt secured with min. 1.7-inch LWC CR Base Sheet Fasteners secured 7-inch o.c. at the 3-inch lap and 7-inch o.c. in two (2) equally spaced staggered rows in the field	DensDeck Prime, DEXcell FA, or SECUROCK adhered in 2-Part UIA applied 12-inch o.c.	TA APP Ply 3	TA APP Cap 2	-45 (Lim. 7)
LC-AM-4	-	Min. 350 psi Celcore MF with HS Rheology Admixture	DynaBase, DynaLastic 180 S, GlasBase Plus, or Ventsulation Felt secured with min. 1.7-inch LWC CR Base Sheet Fasteners secured 7-inch o.c. at the 3-inch lap and 7-inch o.c. in two (2) equally spaced staggered rows in the field	Min. 0.5-inch E3 or E3 C1 adhered 12-inch o.c. in 2- Part UIA followed by DEXcell FA adhered 12-inch o.c. in OSFA	Bicor S adhered in <i>MBR PCA</i>	<i>Tricor</i> adhered in <i>MBR PCA</i>	-45 (Lim. 7)
LC-AM-5	-	Min. 350 psi Celcore MF with HS Rheology Admixture	DynaBase, DynaLastic 180 S, GlasBase Plus, or Ventsulation Felt secured with min. 1.7-inch LWC CR Base Sheet Fasteners secured 7-inch o.c. at the 3-inch lap and 7-inch o.c. in two (2) equally spaced staggered rows in the field	Min. 0.5-inch E3 or E3 C1 adhered 12-inch o.c. in 2- Part UIA followed by SeparatoR CGF adhered 12-inch o.c. in 2-Part UIA, OSFA, or RSUA	CA APP BUR	<i>Tricor</i> adhered in <i>MBR CA</i>	-45 (Lim. 7)

JMC14001.19b FL17013-R19 Page 14 of 28

**APPENDIX B** 

	Me	echanically Fastened Li	ghtweight Concr	ete Assemblies over Concrete Deck	(New or Existing)		
System No.	Vapor Barrier	LWIC	Base Sheet	Base Sheet Attachment	Ply Sheet	Cap Sheet	MDP (psf)
LC-M-1	-	Min. 300 psi <i>Existing</i> Cellular Lightweight Concrete ( <i>MCRF</i> ≥ 83lbf)	JM APP Base	1.7-inch Lightweight Concrete (LWC) CR Base Sheet Fastener installed 7- inch o.c. in 3-inch lap and 7-inch o.c. in two (2) equally spaced, staggered rows in the field	TA SBS Ply	TA APP Cap 2	-37.5 (Lim. 7; Non- HVHZ)
LC-M-2	-	Min. 400 psi Celcore MF with HS Rheology Admixture	JM APP Base	1.7-inch Lightweight Concrete (LWC) CR Base Sheet Fastener installed 12- inch o.c. in 4-inch lap and 12-inch o.c. in three (3) equally spaced, staggered rows in the field	TA APP Ply 2	TA APP Cap 2	-45 (Lim. 7)
LC-M-3	-	Min. 310 psi Elastizell with Zell-Crete Fibers	JM APP Base	1.7-inch Lightweight Concrete (LWC) CR Base Sheet Fastener installed 7- inch o.c. in 3-inch lap and 7-inch o.c. in two (2) equally spaced, staggered rows in the field	TA SBS Ply	TA APP Cap 2	-45 (Lim. 7)
LC-M-4	OPTIONAL DynaBase HW torch applied over deck primed with ASTM D 41 primer	Min. 440 psi Celcore MF with HS Rheology Admixture	DynaFast 1	Trufast Twin Loc-Nail Batten Fastener and Trufast Twin Lock Coiled Batten Bar spaced 6-inch o.c. within the 4-inch wide heat welded side laps	OPTIONAL TA SBS Ply	TA APP Cap 2	-52.5 (Lim. 7)
LC-M-5	OPTIONAL DynaBase HW torch applied over deck primed with ASTM D 41 primer	Min. 500 psi Celcore MF with HS Rheology Admixture	DynaFast 1	Trufast Twin Loc-Nail Batten Fastener and Trufast Twin Lock Coiled Batten Bar spaced 6-inch o.c. within the 4-inch wide heat welded side laps	OPTIONAL TA SBS Ply	TA APP Cap 2	-60 (Lim. 7)
LC-M-6	-	Min. 440 psi Elastizell with Zell-Crete Fibers	DynaFast 1	HL Fasteners & Plates spaced 12-inch o.c within 5-inch heat welded side laps	OPTIONAL TA SBS Ply	TA APP Cap 2	-60 (Lim. 7)
LC-M-7	-	Min. 430 psi <i>Existing</i> Cellular Lightweight Concrete ( <i>MCRF</i> ≥ 106lbf)	JM APP Base	1.7-inch Lightweight Concrete (LWC) CR Base Sheet Fastener installed 7- inch o.c. in 4-inch lap and 7-inch o.c. in two (2) equally spaced, staggered rows in the field	TA SBS Ply	TA APP Cap 2	-67.5 (Lim. 7)
LC-M-8	-	Min. 340 psi Celcore MF with HS Rheology Admixture over deck treated with Celcore S-1	JM APP Base	1.7-inch Lightweight Concrete (LWC) CR Base Sheet Fastener installed 7- inch o.c. in 3-inch lap and 7-inch o.c. in two (2) equally spaced, staggered rows in the field	TA SBS Ply	TA APP Cap 2	-67.5 (Lim. 7)
LC-M-9	-	Min. 350 psi Celcore MF with HS Rheology Admixture	DynaFast 1	(4) 2.25" VERSA-FAST Fasteners installed in each VERSA-FAST Metal Plate; Plates spaced 10-inch o.c. within the 5-inch wide, torched adhered side laps	OPTIONAL TA SBS Ply	TA APP Cap 2	-67.5 (Lim. 7)

JMC14001.19b FL17013-R19 Page 15 of 28



**APPENDIX B** 

	Me	echanically Fastened Li	ghtweight Concr	ete Assemblies over Concrete Deck	(New or Existing)		
System No.	Vapor Barrier	LWIC	Base Sheet	Base Sheet Attachment	Ply Sheet	Cap Sheet	MDP (psf)
LC-M-10	-	Min. 440 psi Elastizell with Zell-Crete Fibers	JM APP Base	1.7-inch Lightweight Concrete (LWC) CR Base Sheet Fastener installed 7- inch o.c. in 4-inch lap and 7-inch o.c. in two (2) equally spaced, staggered rows in the field	TA SBS Ply	TA APP Cap 2	-75 (Lim. 7)

		Lightweight (	Concrete Assemblies with Ac	hered Membranes over St	eel Deck (New or Exist	ing)	
System No.	Deck Detail	LWIC	Base Sheet	Insulation/Cover Board	Ply Sheet	Cap Sheet	MDP (psf)
LS-AM-1	L6, G33, P, S24	Min. 350 psi Celcore MF with HS Rheology Admixture	DynaBase, DynaLastic 180 S, GlasBase Plus, or Ventsulation Felt secured with min. 1.7-inch LWC CR Base Sheet Fasteners secured 7-inch o.c. at the 3-inch lap and 7-inch o.c. in two (2) equally spaced staggered rows in the field	Min. 0.5-inch E3 or E3 C1 followed by DensDeck Prime, DEXcell FA, or SECUROCK adhered in 2- Part UIA applied 12-inch o.c.	TA APP Ply 3	TA APP Cap 2	-45 (Lim. 7)
LS-AM-2	L6, G33, P, S24	Min. 350 psi Celcore MF with HS Rheology Admixture	DynaBase, DynaLastic 180 S, GlasBase Plus, or Ventsulation Felt secured with min. 1.7-inch LWC CR Base Sheet Fasteners secured 7-inch o.c. at the 3-inch lap and 7-inch o.c. in two (2) equally spaced staggered rows in the field	Min. 0.5-inch <i>E3</i> or <i>E3 C1</i> followed by <i>SECUROCK</i> adhered in <i>2-Part UIA</i> applied 12-inch o.c.	DynaGrip Base SD/SA	TA APP Cap 2	-45 (Lim. 7)
LS-AM-3	L6, G33, P, S24	Min. 350 psi Celcore MF with HS Rheology Admixture	DynaBase, DynaLastic 180 S, GlasBase Plus, or Ventsulation Felt secured with min. 1.7-inch LWC CR Base Sheet Fasteners secured 7- inch o.c. at the 3-inch lap and 7-inch o.c. in two (2) equally spaced staggered rows in the field	DensDeck Prime, DEXcell FA ,or SECUROCK adhered in 2-Part UIA applied 12-inch o.c.	TA APP Ply 3	TA APP Cap 2	-45 (Lim. 7)

JMC14001.19b FL17013-R19 Page 16 of 28

**APPENDIX B** 

		Lightweight (	Concrete Assemblies with Ac	thered Membranes over St	teel Deck (New or Exist	ing)	
System No.	Deck Detail	LWIC	Base Sheet	Insulation/Cover Board	Ply Sheet	Cap Sheet	MDP (psf)
LS-AM-4	L6, G33, P, S24	Min. 350 psi Celcore MF with HS Rheology Admixture	DynaBase, DynaLastic 180 S, GlasBase Plus, or Ventsulation Felt secured with min. 1.7-inch LWC CR Base Sheet Fasteners secured 7- inch o.c. at the 3-inch lap and 7-inch o.c. in two (2) equally spaced staggered rows in the field	SECUROCK adhered in 2-Part UIA applied 12-inch o.c.	DynaGrip Base SD/SA	TA APP Cap 2	-45 (Lim. 7)
LS-AM-5	L6, G33, P, S24	Min. 350 psi Celcore MF with HS Rheology Admixture	DynaBase, DynaLastic 180 S, GlasBase Plus, or Ventsulation Felt secured with min. 1.7-inch LWC CR Base Sheet Fasteners secured 7- inch o.c. at the 3-inch lap and 7-inch o.c. in two (2) equally spaced staggered rows in the field	Min. 0.5-inch E3 or E3 C1 adhered 12-inch o.c. in 2- Part UIA followed by DEXcell FA adhered 12-inch o.c. in OSFA	Bicor S adhered in MBR PCA	<i>Tricor</i> adhered in <i>MBR PCA</i>	-45 (Lim. 7)
LS-AM-6	L6, G33, P, S24	Min. 350 psi Celcore MF with HS Rheology Admixture	DynaBase, DynaLastic 180 S, GlasBase Plus, or Ventsulation Felt secured with min. 1.7-inch LWC CR Base Sheet Fasteners secured 7- inch o.c. at the 3-inch lap and 7-inch o.c. in two (2) equally spaced staggered rows in the field	Min. 0.5-inch E3 or E3 C1 adhered 12-inch o.c. in 2- Part UIA followed by SeparatoR CGF adhered 12-inch o.c. in 2-Part UIA, OSFA, or RSUA	CA APP BUR	<i>Tricor</i> adhered in <i>MBR</i> CA	-45 (Lim. 7)

		Mechani	cally Fastened Light	weight Concrete Assemblies over Stee	el Deck (New or Existir	ng)	
System No.	Deck Detail	LWIC	Base Sheet	Base Sheet Attachment	Ply Sheet	Cap Sheet	MDP (psf)
LS-M-1	G33, L6, P, S18	Min. 300 psi Existing Cellular Lightweight Concrete (MCRF≥ 83lbf)	JM APP Base	1.7-inch Lightweight Concrete (LWC) CR Base Sheet Fastener installed 7-inch o.c. in 3-inch lap and 7-inch o.c. in two (2) equally spaced, staggered rows in the field	TA SBS Ply	TA APP Cap 2	-37.5 (Lim. 7; Non- HVHZ)
LS-M-2	G33, L5, P, S12	Min. 400 psi Celcore MF with HS Rheology Admixture over deck treated with Celcore S-1	JM APP Base	1.7-inch Lightweight Concrete (LWC) CR Base Sheet Fastener installed 12-inch o.c. in 4-inch lap and 12-inch o.c. in three (3) equally spaced, staggered rows in the field	TA APP Ply 2	TA APP Cap 2	-45 (Lim. 7)

JMC14001.19b FL17013-R19 Page 17 of 28

APPENDIX B

		Mechanic	cally Fastened Light	weight Concrete Assemblies over Stee	el Deck (New or Existi	ng)	
System No.	Deck Detail	LWIC	Base Sheet	Base Sheet Attachment	Ply Sheet	Cap Sheet	MDP (psf)
LS-M-3	G33, L6, P, S18	Min. 310 psi Elastizell with Zell-Crete Fibers	JM APP Base	1.7-inch Lightweight Concrete (LWC) CR Base Sheet Fastener installed 7-inch o.c. in 3-inch lap and 7-inch o.c. in two (2) equally spaced, staggered rows in the field	TA SBS Ply	TA APP Cap 2	-45 (Lim. 7)
LS-M-4	G33, L5, P, S12W	Min. 440 psi Celcore MF with HS Rheology Admixture over deck treated with Celcore S-1	DynaFast 1	Trufast Twin Loc-Nail Batten Fastener and Trufast Twin Lock Coiled Batten Bar spaced 6-inch o.c. within the 4-inch wide heat welded side laps	OPTIONAL TA SBS Ply	TA APP Cap 2	-52.5 (Lim. 7)
LS-M-5	G33, L5, P, S15W	Min. 500 psi Celcore MF with HS Rheology Admixture over deck treated with Celcore S-1	DynaFast 1	Trufast Twin Loc-Nail Batten Fastener and Trufast Twin Lock Coiled Batten Bar spaced 6-inch o.c. within the 4-inch wide heat welded side laps	OPTIONAL TA SBS Ply	TA APP Cap 2	-60 (Lim. 7)
LS-M-6	G33, L5, P, S12	Min. 440 psi Elastizell with Zell-Crete Fibers	DynaFast 1	HL Fasteners & Plates spaced 12-inch o.c within 5-inch heat welded side laps	OPTIONAL TA SBS Ply	TA APP Cap 2	-60 (Lim. 7)
LS-M-7	G33, L5, F1, S20	Min. 430 psi <i>Existing</i> Cellular Lightweight Concrete ( <i>MCRF</i> ≥ 106lbf)	JM APP Base	1.7-inch Lightweight Concrete (LWC) CR Base Sheet Fastener installed 7-inch o.c. in 4-inch lap and 7-inch o.c. in two (2) equally spaced, staggered rows in the field	TA SBS Ply	TA APP Cap 2	-67.5 (Lim. 7)
LS-M-8	G33, L6, P, S18	Min. 340 psi Celcore MF with HS Rheology Admixture over deck treated with Celcore S-1	JM APP Base	1.7-inch Lightweight Concrete (LWC) CR Base Sheet Fastener installed 7-inch o.c. in 3-inch lap and 7-inch o.c. in two (2) equally spaced, staggered rows in the field	TA SBS Ply	TA APP Cap 2	-67.5 (Lim. 7)
LS-M-9	G33, P, L6, S18	Min. 350 psi Celcore MF with HS Rheology Admixture over deck treated with Celcore S-1	DynaFast 1	(4) 2.25" VERSA-FAST Fasteners installed in each VERSA-FAST Metal Plate; Plates spaced 10-inch o.c. within the 5-inch wide, torched adhered side laps	OPTIONAL TA SBS Ply	TA APP Cap 2	-67.5 (Lim. 7)
LS-M-10	G33, L5, P, S12	Min. 440 psi Elastizell with Zell-Crete Fibers	JM APP Base	1.7-inch Lightweight Concrete (LWC) CR Base Sheet Fastener installed 7-inch o.c. in 4-inch lap and 7-inch o.c. in two (2) equally spaced, staggered rows in the field	TA SBS Ply	TA APP Cap 2	-75 (Lim. 7)

JMC14001.19b FL17013-R19 Page 18 of 28

**APPENDIX B** 

			Adhered Steel	Deck Assemblies (New	and Existing)			
System No.	Deck Detail	Thermal Barrier/ Vapor Barrier	Base Insulation (Note 7)	Top Insulation	Base Ply	Ply Sheet	Cap Sheet	MDP (psf)
S-A-1	G33	Optional JM Vapor Barrier SA	Min. 1.5-inch E3 applied in 2-Part UIA or RSUA spaced12-inch o.c. followed by OPTIONAL Min. 1-inch E3 applied in 2-Part UIA or RSUA spaced12-inch o.c.	Min. 1-inch <i>E3</i> applied in 2-Part UIA or <i>RSUA</i> spaced12-inch o.c.	DynaGrip Base SD/SA	OPTIONAL TA APP Ply 3	TA APP Cap 2	-45 (Lim. 9; Non- HVHZ)
S-A-2	G33	Optional JM Vapor Barrier SA	Min. 1.5-inch E3 applied in 2-Part UIA or RSUA spaced 12-inch o.c. followed by OPTIONAL Min. 1-inch E3 applied in 2-Part UIA or RSUA spaced12-inch o.c.	DensDeck Prime applied in 2-Part UIA, OSFA, or RSUA spaced 12" o.c.	CA APP Ply or TA APP Ply 2	OPTIONAL CA APP Ply or TA APP Ply 2	CA APP Cap or TA APP Cap 2	-45 (Lim. 9; Non- HVHZ)
S-A-3	G33	Optional JM Vapor Barrier SA	Min. 1.5-inch E3 applied in 2-Part UIA or RSUA spaced 12-inch o.c. followed by OPTIONAL Min. 1-inch E3 applied in 2-Part UIA or RSUA spaced12-inch o.c.	DensDeck Prime applied in 2-Part UIA, OSFA, or RSUA spaced 12" o.c.	DynaGrip Base SD/SA	OPTIONAL TA APP Ply 3	TA APP Cap 2	-45 (Lim. 9; Non- HVHZ)
S-A-4	G33	Optional JM Vapor Barrier SA	Min. 1.5-inch E3 applied in 2-Part UIA or RSUA spaced 12-inch o.c. followed by OPTIONAL Min. 1-inch E3 applied in 2-Part UIA or RSUA spaced12-inch o.c.	DEXcell FA, or SECUROCK secured with 2-Part UIA, OSFA, or RSUA spaced 12" o.c.	TA APP Ply 2	OPTIONAL TA APP Ply 2	TA APP Cap 2	-45 (Lim. 9; Non- HVHZ)
S-A-5	G33	Optional JM Vapor Barrier SA	Min. 1.5-inch E3 applied in 2-Part UIA or RSUA spaced 12-inch o.c. followed by OPTIONAL Min. 1-inch E3 applied in 2-Part UIA or RSUA spaced12-inch o.c.	ProtectoR HD, DEXcell FA, or SECUROCK secured with 2-Part UIA, OSFA, or RSUA spaced 12" o.c.	DynaGrip Base SD/SA	OPTIONAL TA APP Ply 3	TA APP Cap 2	-45 (Lim. 9; Non- HVHZ)
S-A-6	G33	Optional JM Vapor Barrier SA	Min. 1.5-inch E3 applied in 2-Part UIA or RSUA spaced 12-inch o.c. followed by OPTIONAL Min. 1-inch E3 applied in 2-Part UIA or RSUA spaced12-inch o.c.	ProtectoR HD or DEXcell FA secured with 2-Part UIA, OSFA, or RSUA spaced 12" o.c.	CA APP Ply	OPTIONAL CA APP Ply	CA APP Cap	-45 (Lim. 9; Non- HVHZ)

JMC14001.19b FL17013-R19 Page 19 of 28

**APPENDIX B** 

			Adhered Steel	Deck Assemblies (New a	and Existing)			
System No.	Deck Detail	Thermal Barrier/ Vapor Barrier	Base Insulation (Note 7)	Top Insulation	Base Ply	Ply Sheet	Cap Sheet	MDP (psf)
S-A-7	G33	Min. 0.5-inch DensDeck Prime secured with <i>DF</i> or <i>TF at</i> 1 fastener per 4ft <sup>2</sup> over OPTIONAL Vapor Barrier	Min. 1.5-inch ENRGY 3 applied in 2-Part UIA, OSFA, or RSUA applied 12" o.c.	DEXcell FA, SECUROCK, or DensDeck Prime applied in 2-Part UIA, OSFA, or RSUA applied 12" o.c.	TA APP Ply 2	OPTIONAL TA APP Ply 2	TA APP Cap 2	-45 (Lim. 7; Non- HVHZ)
S-A-8	G33	Min. 0.5-inch DensDeck Prime secured with <i>DF</i> or <i>TF at</i> 1 fastener per 4ft² over OPTIONAL Vapor Barrier	Min. 1.5-inch ENRGY 3 applied in 2-Part UIA, OSFA, or RSUA applied 12" o.c.	OPTIONAL ProtectoR HD, DEXcell FA, SECUROCK, or DensDeck Prime applied in 2-Part UIA, OSFA, or RSUA applied 12" o.c.	DynaGrip Base SD/SA	OPTIONAL TA APP Ply 3	TA APP Cap 2	-45 (Lim. 7; Non- HVHZ)
S-A-9	G33	Min. 0.5-inch DensDeck Prime secured with <i>DF</i> or <i>TF at</i> 1 fastener per 4ft <sup>2</sup> over OPTIONAL <i>Vapor Barrier</i>	Min. 1.5-inch ENRGY 3 applied in 2-Part UIA, OSFA, or RSUA applied 12" o.c.	OPTIONAL ProtectoR HD, DEXcell FA, or DensDeck Prime applied in 2-Part UIA, OSFA, or RSUA applied 12" o.c.	CA APP Ply	OPTIONAL CA APP Ply	CA APP Cap	-45 (Lim. 7; Non- HVHZ)
S-A-10	G33	0.5-inch DEXcell FA secured with Fasteners & Plates at a rate of 1 fastener per 4ft <sup>2</sup> ; DynaBase HW torch applied	Min. 1.5-inch <i>E3 RSUA</i> or 2- Part UIA ribbons spaced 12-inch o.c.	ProtectoR HD adhered in RSUA or 2-Part UIA ribbons spaced 12-inch o.c.	BA APP Ply or CA APP Ply	OPTIONAL BA APP Ply or CA APP Ply	BA APP Cap or CA APP Cap	-45 (Non- HVHZ; Lim. 7)
S-A-11	L6, G33, P, S24	Min. 0.5-inch DEXcell FA secured with Fasteners & Plates secured at a rate of 16 per 4-ft x 8-ft board; DynaWeld Base torch applied	Min. 1.5-inch ENRGY 3 secured with OSFA, 2-Part UIA or RSUA ribbons spaced 12-inch o.c.	DensDeck Prime, DEXcell FA or SECUROCK secured with OSFA, 2-Part UIA or RSUA spaced 12-inch o.c.	TA APP Ply 2	OPTIONAL TA APP Ply 2	TA APP Cap 2	-45 (Lim. 7)
S-A-12	L6, G33, P, S24	Min. 0.5-inch DEXcell FA secured with Fasteners & Plates secured at a rate of 16 per 4-ft x 8-ft board; DynaWeld Base torch applied	Min. 1.5-inch ENRGY 3 secured with <i>OSFA</i> , 2-Part UIA or RSUA ribbons spaced 12-inch o.c.	DensDeck Prime, DEXcell FA or SECUROCK secured with OSFA, 2-Part UIA or RSUA spaced 12-inch o.c.	DynaGrip Base SD/SA	OPTIONAL TA APP Ply 3	TA APP Cap 2	-45 (Lim. 7)

JMC14001.19b FL17013-R19 Page 20 of 28



#### **APPENDIX B**

		As	semblies with Adl	nered Membra	nes over Insulated St	teel Deck (New, Existin	g, or Recover)		
System No.	Deck Detail	Base Insulation	Base Insulation Attachment	Top Insulation	Top Insulation Attachment	Base Ply	Ply Sheet	Cap Sheet	MDP (psf)
S-AM-1	L5, G33	Min. 1.5-inch E3	Simultaneously fastened with Top Insulation	ProtectoR HD	Fasteners & Plates secured at a rate of 1 per 4.0 ft <sup>2</sup>	DynaGrip Base PR SD/SA	OPTIONAL TA APP Ply 2	TA APP Cap 2	-30 (Lim. 7; Non- HVHZ)
S-AM-2	L5, G33	Min. 1.5-inch E3	Simultaneously fastened with Top Insulation	ProtectoR HD	Fasteners & Plates secured at a rate of 1 per 4.0 ft <sup>2</sup>	BA APP Ply or CA APP Ply	OPTIONAL <i>BA APP Ply</i> or <i>CA APP Ply</i>	BA APP Cap or CA APP Cap	-30 (Lim. 7; Non- HVHZ)
S-AM-3	L5, G33	Min. 1.5-inch E3	Simultaneously fastened with Top Insulation	Min. 0.5-inch DEXcell FA	Fasteners & Plates secured at a rate of 1 per 4.0 ft <sup>2</sup>	CA APP Ply	OPTIONAL CA APP Ply	CA APP Cap	-37.5 (Lim. 7; Non- HVHZ)
S-AM-4	L5, G33	Min. 1.5-inch E3	UF Fasteners & Plates secured at a rate of 1 per 4.0 ft <sup>2</sup>	Min. 0.5-inch SECUROCK	2-Part UIA spaced 12-inch o.c.	APPeX 4S	OPTIONAL APPeX 4S	TA APP Cap	-45 (Lim. 7; Non- HVHZ)
S-AM-5	L5, G33	Min. 2-inch E3	UF Fasteners & Plates secured at a rate of 1 per 5.33 ft <sup>2</sup>	Min. 0.5-inch SECUROCK	2-Part UIA spaced 12-inch o.c.	APPeX 4S	OPTIONAL APPeX 4S	TA APP Cap	-45 (Lim. 7; Non- HVHZ)
S-AM-6	L5, G33	OPTIONAL Insulation under Min. 1.5-inch E3	Simultaneously fastened with Top Insulation	Min. 0.5-inch DensDeck Prime	UltraFast Metal Plate (Square) and High Load fasteners secured at a rate of 1 fastener per 5.33ft <sup>2</sup>	JM APP Base torch adhered or CA APP Ply	OPTIONAL APPeX 4S or CA APP Ply	CA APP Cap or TA APP Cap	-45 (Non- HVHZ; Lim. 7)
S-AM-7	L5, G33	OPTIONAL Insulation under Min. 1.5-inch E3	Simultaneously fastened with Top Insulation	DensDeck Prime	Fasteners & Plates secured at a rate of 1 fastener per 4ft <sup>2</sup>	JM APP Base torch adhered or CA APP Ply	OPTIONAL APPeX 4S or CA APP Ply	CA APP Cap or TA APP Cap	-45 (Non- HVHZ; Lim. 7)
S-AM-8	L5, G33	Min. 1.5-inch E3	Simultaneously fastened with Top Insulation	Min. 0.5-inch DensDeck Prime	Fasteners & Plates secured at a rate of 1 fastener per 5.33ft <sup>2</sup>	CA APP Ply or TA APP Ply 3	OPTIONAL CA APP Ply or TA APP Ply 3	CA APP Cap or TA APP Cap 2	-45 (Non- HVHZ; Lim. 7)
S-AM-9	L5, G33	Min. 1.5-inch E3	Simultaneously fastened with Top Insulation	DensDeck Prime	Fasteners & Plates secured at a rate of 1 fastener per 4ft <sup>2</sup>	CA APP Ply or TA APP Ply 3	OPTIONAL CA APP Ply or TA APP Ply 3	CA APP Cap or TA APP Cap 2	-45 (Non- HVHZ; Lim. 7)
S-AM-10	L5, G33	Min. 1.5-inch <i>E</i> 3	Simultaneously fastened with Top Insulation	Min. 0.5-inch SECUROCK Cement Board; primed with ASTM D 41 primer	Fasteners & Plates secured at a rate of 1 fastener per 4ft <sup>2</sup>	TA APP Ply 2	OPTIONAL TA APP Ply 2	TA APP Cap 2	-45 (Non- HVHZ; Lim. 7)

JMC14001.19b FL17013-R19 Page 21 of 28

This evaluation report is provided for State of Florida product approval under Rule 61G20-3. The manufacturer shall notify CREEK Technical Services, LLC of any product changes or quality assurance changes throughout the duration for which this report is valid. This evaluation report does not express nor imply warranty, installation, recommended use, or other product attributes that are not specifically addressed herein.

**APPENDIX B** 

		As	semblies with Adl	nered Membra	nes over Insulated S	teel Deck (New, Existin	g, or Recover)		
System No.	Deck Detail	Base Insulation	Base Insulation Attachment	Top Insulation	Top Insulation Attachment	Base Ply	Ply Sheet	Cap Sheet	MDP (psf)
S-AM-11	L5, G33	Min. 0.5-inch SECUROCK Cement Board primed with ASTM D 41 primer followed by Tricor M FR torch adhered after board is fastened	Fasteners & Plates secured at a rate of 1 fastener per 4ft <sup>2</sup>	Min. 1.5-inch ENRGY 3 followed by Min. 0.5-inch SECUROCK Cement Board primed with ASTM D 41 primer	ENRGY 3 and SECUROCK Cement Board adhered in RSUA applied 12-inch o.c.	TA APP Ply 2	OPTIONAL TA APP Ply 2	TA APP Cap 2	-45 (Non- HVHZ; Lim. 7)
S-AM-12	L5, G33	OPTIONAL Insulation	Simultaneously fastened with Top Insulation	Min. 2-inch ENRGY 3	Fasteners & Plates at a rate of 1 fastener per 4ft <sup>2</sup>	DynaGrip Base SD/SA	OPTIONAL APPeX 4S	TA APP Cap	-45 (Non- HVHZ; Lim. 7)
S-AM-13	L5, G33	OPTIONAL Insulation	Simultaneously fastened with Top Insulation	Min. 2-inch ENRGY 3	Fasteners & Plates at a rate of 1 fastener per 4ft <sup>2</sup>	CA APP Ply	OPTIONAL CA APP Ply	CA APP Cap	-45 (Non- HVHZ; Lim. 7)
S-AM-14	L5, G33	Min. 2-inch E3	Fasteners & Plates secured at a rate of 1 fastener per 4ft <sup>2</sup>	ProtectoR HD	OSFA, RSUA, or 2-Part UIA applied 12-inch o.c.	DynaGrip Base SD/SA	OPTIONAL TA APP Ply 3	TA APP Cap 2	-45 (Non- HVHZ; Lim. 7)
S-AM-15	L5, G33	Min. 2-inch E3	Fasteners & Plates secured at a rate of 1 fastener per 4ft <sup>2</sup>	Min. 0.5-inch SECUROCK Cement Board primed with ASTM D 41 primer	RSUA applied 12-inch o.c.	TA APP Ply 2	OPTIONAL TA APP Ply 2	TA APP Cap 2	-45 (Non- HVHZ; Lim. 7)
S-AM-16	L5, G33	Min. 2-inch E3	Fasteners & Plates secured at a rate of 1 fastener per 4ft <sup>2</sup>	DensDeck Prime, DEXcell FA, or SECUROCK	OSFA, RSUA, or 2-Part UIA applied 12-inch o.c.	CA APP Ply or TA APP Ply 2	OPTIONAL CA APP Ply or TA APP Ply 2	CA APP Cap or TA APP Cap 2	-45 (Non- HVHZ; Lim. 7)
S-AM-17	<i>L5,</i> G33	Min. 2-inch E3	Fasteners & Plates secured at a rate of 1 fastener per 4ft <sup>2</sup>	DensDeck Prime, DEXcell FA, or SECUROCK	OSFA, RSUA, or 2-Part UIA applied 12-inch o.c.	DynaGrip Base SD/SA	OPTIONAL TA APP Ply 3	TA APP Cap 2	-45 (Non- HVHZ; Lim. 7)
S-AM-18	L5, G33	Min. 2-inch E3	Fasteners & Plates secured at a rate of 1 fastener per 4ft <sup>2</sup>	Min. 1-inch E3	RSUA or 2-Part UIA applied 12-inch o.c.	DynaGrip Base SD/SA	OPTIONAL TA APP Ply 3	TA APP Cap 2	-45 (Non- HVHZ; Lim. 7)

JMC14001.19b FL17013-R19 Page 22 of 28

**APPENDIX B** 

		As	semblies with Adl	hered Membra	nes over Insulated S	teel Deck (New, Existin	g, or <i>Recover</i> )		
System No.	Deck Detail	Base Insulation	Base Insulation Attachment	Top Insulation	Top Insulation Attachment	Base Ply	Ply Sheet	Cap Sheet	MDP (psf)
S-AM-19	L5, G33	Min. 1.5-inch E3	Fasteners & Plates secured 1 fastener per 2.67ft <sup>2</sup>	Min. 1-inch E3	2-Part UIA or RSUA applied 12" o.c.	DynaGrip Base SD/SA	OPTIONAL TA APP Ply 3	TA APP Cap 2	-45 (Lim. 7; Non- HVHZ)
S-AM-20	L5, G33	Min. 1.5-inch <i>E</i> 3	Fasteners & Plates secured 1 fastener per 2.67ft <sup>2</sup>	ProtectoR HD	OSFA, RSUA, or 2-Part UIA applied 12-inch o.c.	DynaGrip Base SD/SA	OPTIONAL TA APP Ply 3	TA APP Cap 2	-45 (Lim. 7; Non- HVHZ)
S-AM-21	L5, G33	Min. 1.5-inch <i>E</i> 3	Fasteners & Plates secured 1 fastener per 2.67ft <sup>2</sup>	Min. 0.5-inch SECUROCK Cement Board primed with ASTM D 41 primer	RSUA applied 12-inch o.c.	TA APP Ply 2	OPTIONAL TA APP Ply 2	TA APP Cap 2	-45 (Lim. 7; Non- HVHZ)
S-AM-22	L5, G33	Min. 1.5-inch E3	Fasteners & Plates secured 1 fastener per 2.67ft <sup>2</sup>	DensDeck Prime, DEXcell FA, or SECUROCK	OSFA, RSUA, or 2-Part UIA applied 12-inch o.c.	CA APP Ply or TA APP Ply 2	OPTIONAL CA APP Ply or TA APP Ply 2	CA APP Cap or TA APP Cap 2	-45 (Lim. 7; Non- HVHZ)
S-AM-23	L5, G33	Min. 1.5-inch E3	Fasteners & Plates secured 1 fastener per 2.67ft <sup>2</sup>	DensDeck Prime, DEXcell FA, or SECUROCK	OSFA, RSUA, or 2-Part UIA applied 12-inch o.c.	DynaGrip Base SD/SA	OPTIONAL TA APP Ply 3	TA APP Cap 2	-45 (Lim. 7; Non- HVHZ)
S-AM-24	L6, G33, F1, S30	Min. 1.5-inch E3	Fasteners & Plates secured at a rate of 1 per 1.78 ft <sup>2</sup>	Min. 0.5-inch SECUROCK	2-Part UIA spaced 12-inch o.c.	APPeX 4S	OPTIONAL APPeX 4S	TA APP Cap	-60 (Lim. 7)
S-AM-25	L6, G33, P, S20	OPTIONAL Min. 1.5-inch <i>E</i> 3	Simultaneously fastened with Top Insulation	SECUROCK	UF Fasteners & Plates secured at a rate of 1 per 1.78 ft <sup>2</sup>	APPeX 4S	OPTIONAL APPeX 4S	TA APP Cap	-60 (Lim. 7)
S-AM-26	L6, G33, P, S20	OPTIONAL Min. 1.5-inch <i>E</i> 3	Simultaneously fastened with Top Insulation	SECUROCK	UF Fasteners & Plates secured at a rate of 1 per 1.78 ft <sup>2</sup>	DynaGrip Base SD/SA	OPTIONAL TA APP Ply 3	TA APP Cap 2	-60 (Lim. 7)
S-AM-27	L6, G33, P, S20	OPTIONAL Min. 1.5-inch <i>E</i> 3	Simultaneously fastened with Top Insulation	DensDeck Prime or DEXcell FA	Fasteners & Plates secured at a rate of 1 per 1.78 ft <sup>2</sup>	APPeX 4S	OPTIONAL APPeX 4S	TA APP Cap	-60 (Lim. 7)
S-AM-28	L6, G33, F2, S24	OPTIONAL Insulation	Simultaneously fastened with Top Insulation	Min 1.5-inch <i>E</i> 3	Fasteners & Plates secured at a rate of 1 fastener per 1.78ft <sup>2</sup>	DynaGrip Base SD/SA	OPTIONAL TA APP Ply 3	TA APP Cap 2	-60 (Lim. 7)

JMC14001.19b FL17013-R19 Page 23 of 28

**APPENDIX B** 

		As	semblies with Adh	nered Membra	nes over Insulated S	teel Deck (New, Existin	g, or <i>Recover</i> )		
System No.	Deck Detail	Base Insulation	Base Insulation Attachment	Top Insulation	Top Insulation Attachment	Base Ply	Ply Sheet	Cap Sheet	MDP (psf)
S-AM-29	L6, G33, F1, S30	OPTIONAL Min. 1.5-inch <i>E</i> 3	Simultaneously fastened with Top Insulation	Min. 3/4-inch DuraBoard	Fasteners & Plates secured at a rate of 1 per 1.33 ft <sup>2</sup>	TA APP Ply	-	TA APP Cap	-67.5 (Lim. 7)
S-AM-30	L6, G80, F1, S30	Min. 1.5-inch E3	Fasteners & Plates secured at a rate of 1 per 1.33 ft <sup>2</sup>	Min. 0.5-inch SECUROCK	2-Part UIA spaced 12-inch o.c.	APPeX 4S	OPTIONAL APPeX 4S	TA APP Cap	-67.5 (Lim. 7)
S-AM-31	L6, G80, F1, S30	Min. 1.5-inch <i>E</i> 3	Fasteners & Plates secured at a rate of 1 per 1.33 ft <sup>2</sup>	Min. 0.5-inch SECUROCK	2-Part UIA spaced 12-inch o.c.	DynaGrip Base SD/SA	OPTIONAL TA APP Ply 3	TA APP Cap 2	-67.5 (Lim. 7)
S-AM-32	L6, G80, F1, S30	OPTIONAL Min. 1.5-inch <i>E</i> 3	Simultaneously fastened with Top Insulation	Min. 3/4-inch DuraBoard	Fasteners & Plates secured at a rate of 1 per 1.33 ft <sup>2</sup>	TA APP Ply	-	TA APP Cap	-75 (Lim. 7)
S-AM-33	L6, G33, F1, S30	Min. 2-inch E3	Fasteners & Plates secured at a rate of 1 per 1.45 ft <sup>2</sup>	Min. 0.5-inch Retro-Fit Board or DuraBoard	Asphalt	3 plies HA BUR Ply	-	TA APP Cap	-75 (Lim. 7)
S-AM-34	L6, G80, F1, S30	Min. 2-inch E3	Simultaneously fastened with Top Insulation	Min. 0.5-inch SECUROCK	JM All Purpose fasteners and OMG 3" Round Metal Plates secured at a rate of 1 per 1.78 ft <sup>2</sup>	APPeX 4S	OPTIONAL APPeX 4S	TA APP Cap	-75 (Lim. 7)
S-AM-35	L6, G80, F1, S30	Min. 2-inch E3	Simultaneously fastened with Top Insulation	Min. 0.5-inch SECUROCK	JM All Purpose fasteners and OMG 3" Round Metal Plates secured at a rate of 1 per 1.78 ft <sup>2</sup>	DynaGrip Base SD/SA	OPTIONAL TA APP Ply 3	TA APP Cap 2	-75 (Lim. 7)
S-AM-36	L6, G33, F2, S24	Min. 1.5-inch E3	Simultaneously fastened with Top Insulation	Min. 0.5-inch SECUROCK	Fasteners & Plates secured at a rate of 1 per 1.45 ft <sup>2</sup>	APPeX 4S	OPTIONAL APPeX 4S	TA APP Cap	-75 (Lim. 7)
S-AM-37	L6, G33, F2, S24	Min. 1.5-inch E3	Simultaneously fastened with Top Insulation	Min. 0.5-inch SECUROCK	Fasteners & Plates secured at a rate of 1 per 1.45 ft <sup>2</sup>	DynaGrip Base SD/SA	OPTIONAL TA APP Ply 3	TA APP Cap 2	-75 (Lim. 7)
S-AM-38	L6, G33, F2, S24	Min. 1.5-inch E3	Simultaneously fastened with Top Insulation	Min. 0.5-inch Prime or DEXcell FA	Fasteners & Plates secured at a rate of 1 per 1.45 ft <sup>2</sup>	APPeX 4S	OPTIONAL APPeX 4S	TA APP Cap	-75 (Lim. 7)

JMC14001.19b FL17013-R19 Page 24 of 28



#### **APPENDIX B**

		As	semblies with Adh	nered Membra	nes over Insulated Sa	teel Deck (New, Existin	g, or Recover)		
System No.	Deck Detail	Base Insulation	Base Insulation Attachment	Top Insulation	Top Insulation Attachment	Base Ply	Ply Sheet	Cap Sheet	MDP (psf)
S-AM-39	L6, G33, F2, S24	Min. 2-inch E3	Fasteners & Plates secured at a rate of 1 per 1.45 ft <sup>2</sup>	Min. 0.5-inch SECUROCK	2-Part UIA spaced 12-inch o.c.	APPeX 4S	OPTIONAL APPeX 4S	TA APP Cap	-75 (Lim. 7)
S-AM-40	L6, G33, F2, S24	Min. 2-inch E3	Fasteners & Plates secured at a rate of 1 per 1.45 ft <sup>2</sup>	Min. 0.5-inch SECUROCK	2-Part UIA spaced 12-inch o.c.	DynaGrip Base SD/SA	OPTIONAL TA APP Ply 3	TA APP Cap 2	-75 (Lim. 7)
S-AM-41	L6, G33, P, S24	OPTIONAL Insulation	Simultaneously fastened with Top Insulation	Min. 2-inch <i>E</i> 3	Fasteners & Plates secured at a rate of 20 per 4-ft x 8-ft board	DynaGrip Base SD/SA	OPTIONAL TA APP Ply 3	TA APP Cap 2	-75 (Lim. 7)
S-AM-42	L6, G33, F1, S24	OPTIONAL Insulation under Min. 2-inch E3	DF secured at a rate of 20 per 4-ft x 8-ft Board	DensDeck Prime, DEXcell FA, or SECUROCK	OSFA, RSUA or 2-Part UIA ribbons spaced 6-inch o.c.	APPeX 4S	OPTIONAL APPeX 4S	TA APP Cap	-75 (Lim. 7)
S-AM-43	L6, G33, F1, S24	OPTIONAL Insulation under Min. 2-inch E3	DF secured at a rate of 20 per 4-ft x 8-ft Board	SECUROCK	OSFA, RSUA or 2-Part UIA ribbons spaced 6-inch o.c.	DynaGrip Base SD/SA	OPTIONAL TA APP Ply 3	TA APP Cap 2	-75 (Lim. 7)

		N	Mechanically Fastened	d Assemblies over Steel Deck (Nev	w, Existing, or Recover)		
System No.	Deck Detail	Insulation	Base Sheet	Base Sheet Attachment	Ply Sheet	Cap Sheet	MDP (psf)
S-M-1	L6, G33, F1, S24	Min. 1-inch <i>E3</i> <i>Preliminarily</i> Secured	DynaFast 1	HL Fasteners & Plates spaced 6-inch o.c. in every other lap within the 4-inch wide heat welded side laps in row spaced max. 70-inches	OPTIONAL TA SBS Ply	TA APP Cap 2	-52.5 (Lim. 7)
S-M-2	L6, G33, P	Min. 1.5-inch <i>E3</i> <i>Preliminarily</i> <i>Secured</i>	DynaFast 2	HL Fasteners & Plates spaced 12-inch o.c. within the 4-inch wide heat welded side laps	OPTIONAL TA SBS Ply	TA APP Cap 2	-67.5 (Lim. 7)
S-M-3	L6, G33, P	Min. 1-inch E3 Preliminarily Secured	DynaFast 2	Batten Bar spaced 6-inch o.c. within the 4-inch wide heat welded side laps in row spaced max. 71-inches	OPTIONAL TA SBS Ply	TA APP Cap 2	-90 (Lim. 7)
S-M-4	L6, G50, P	Min. 1.5-inch <i>E3</i> Preliminarily  Secured	DynaFast 2	APB Fasteners & Plates or HL Fasteners & Plates spaced 6-inch o.c within 4-inch heat welded side laps	OPTIONAL TA SBS Ply	TA APP Cap 2	-105 (Lim. 7)

JMC14001.19b FL17013-R19 Page 25 of 28



#### **APPENDIX B**

	Mechanically Fastened Assemblies over Steel Deck (New, Existing, or Recover)											
System No.	Deck Detail	Insulation	Base Sheet	Base Sheet Attachment	Ply Sheet	Cap Sheet	MDP (psf)					
S-M-5	L6, G80, F1W, S24	Min. 1-inch <i>E</i> 3 <i>Preliminarily</i> <i>Secured</i>	DynaFast 2	HL Fasteners & Plates spaced 6-inch o.c. within the 4-inch wide heat welded side laps	OPTIONAL TA SBS Ply	TA APP Cap 2	-105 (Lim. 7)					

		Assemblies w	rith All Layers Adhered ove	r Wood Deck (New or	Existing)		
System No.	Deck Detail	Base Insulation (Note 7)	Top Insulation	Base Ply	Ply Sheet	Cap Sheet	MDP (psf)
W-A-1	T15/32P, L24	Min. 1.5-inch ENRGY 3 applied in <i>RSUA</i> 12-inch o.c.	-	DynaGrip Base SD/SA	OPTIONAL TA APP Ply 3	TA APP Cap 2	-45 (Lim. 9; Non- HVHZ)
W-A-2	7/16O, L24	-	ProtectoR HD applied in 2-Part UIA or RSUA 12-inch o.c.	DynaGrip Base SD/SA	OPTIONAL TA APP Ply 3	TA APP Cap 2	-45 (Lim. 9; Non- HVHZ)
W-A-3	7/160, L24	-	ProtectoR HD applied in 2-Part UIA or RSUA 12-inch o.c.	BA APP Ply or CA APP Ply	OPTIONAL BA APP Ply or CA APP Ply	BA APP Cap or CA APP Cap	-45 (Lim. 9; Non- HVHZ)

		Ass	emblies with Adhere	ed Membranes over	Insulated Wood D	eck (New, Existing	g, or <i>Recover</i> )		
System No.	Deck Detail	Anchor Sheet	Anchor Attachment	Base Insulation	Top Insulation	Base Ply	Ply Sheet	Cap Sheet	MDP (psf)
W-AM-1	T7/160, L24	-	-	OPTIONAL Insulation	Min. 1.5-inch E3 fastened with Trufast VERSA- FAST fastener and UltraFast Metal Plate (Round) secured 12 per 4-ft x 8-ft board	DynaGrip Base SD/SA	OPTIONAL TA APP Ply 3	TA APP Cap 2	-30 (Lim. 7; Non- HVHZ)
W-AM-2	T7/160, L24	-	-	OPTIONAL Insulation	Min. 1.5-inch E3 fastened with Trufast VERSA- FAST fastener and UltraFast Metal Plate (Round) secured 12 per 4-ft x 8-ft board	CA APP Ply	OPTIONAL CA APP Ply	CA APP Cap	-30 (Lim. 7; Non- HVHZ)

JMC14001.19b Page 26 of 28

This evaluation report is provided for State of Florida product approval under Rule 61G20-3. The manufacturer shall notify CREEK Technical Services, LLC of any product changes or quality assurance changes throughout the duration for which this report is valid. This evaluation report does not express nor imply warranty, installation, recommended use, or other product attributes that are not specifically addressed herein.

**APPENDIX B** 

		Asse	emblies with Adher	ed Membranes over	Insulated Wood D	eck (New, Existing	g, or <i>Recover</i> )		
System No.	Deck Detail	Anchor Sheet	Anchor Attachment	Base Insulation	Top Insulation	Base Ply	Ply Sheet	Cap Sheet	MDP (psf)
W-AM-3	T7/160 or T15/32P, L24	-	-	OPTIONAL Insulation under min. 1.5-inch E3 fastened with UF secured at a rate of 16 per 4-ft x 8-ft Board	DensDeck Prime, DEXcell FA, or SECUROCK adhered with OSFA, RSUA or 2-Part UIA spaced 12-inch o.c.	CA APP Ply or TA APP Ply 2	OPTIONAL CA APP Ply or TA APP Ply 2	CA APP Cap or TA APP Cap 2	-37.5 (Lim.7; Non- HVHZ)
W-AM-4	T7/160 or T15/32P, L24	-	-	OPTIONAL <i>Insulation</i> under min. 1.5-inch <i>E</i> 3	DEXcell FA fastened with UF secured at a rate of 15 per 4-ft x 8-ft Board.	CA APP Ply or TA APP Ply 2	OPTIONAL CA APP Ply or TA APP Ply 2	CA APP Cap or TA APP Cap 2	-37.5 (Lim.7; Non- HVHZ)
W-AM-5	T7/16O, L24	-	-	OPTIONAL Insulation	DensDeck Prime fastened with Trufast VERSA- FAST fastener and UltraFast Metal Plate (Round) secured 12 per 4-ft x 8-ft board	DynaGrip Base SD/SA	OPTIONAL TA APP Ply 3	TA APP Cap 2	-37.5 (Lim. 7; Non- HVHZ)
W-AM-6	T7/16O, L24	-	-	OPTIONAL Insulation	DensDeck Prime fastened with Trufast VERSA- FAST fastener and UltraFast Metal Plate (Round) secured 12 per 4-ft x 8-ft board	CA APP Ply	OPTIONAL CA APP Ply	CA APP Cap	-37.5 (Lim. 7; Non- HVHZ)
W-AM-7	T7/160 or T15/32P, L24	-	-	OPTIONAL INSULATION under min. 1.5-inch E3 or E3 C1 JM High Load Fasteners and UltraFast Plates secured at a rate of 16 per 4-ft x 8-ft board	DensDeck Prime, DEXcell FA, or SECUROCK adhered with OSFA, RSUA, or 2-Part	CA APP Ply or TA APP Ply 2	OPTIONAL CA APP Ply or TA APP Ply 2	CA APP Cap or TA APP Cap 2	-45 (Lim.7; Non- HVHZ)
W-AM-8	T15/32P, L24, 0.113-6/6	-	-	OPTIONAL Min. 0.5-inch <i>E</i> 3	Min. 2-inch ENRGY or ENRGY 3 CGF 3 fastened with Fasteners & Plates secured at a rate of 16 per 4-ft x 8-ft Board	DynaGrip Base SD/SA	OPTIONAL TA APP Ply 3	TA APP Cap 2	-52.5 (Lim. 7)

JMC14001.19b FL17013-R19 Page 27 of 28

This evaluation report is provided for State of Florida product approval under Rule 61G20-3. The manufacturer shall notify CREEK Technical Services, LLC of any product changes or quality assurance changes throughout the duration for which this report is valid. This evaluation report does not express nor imply warranty, installation, recommended use, or other product attributes that are not specifically addressed herein.



#### **APPENDIX B**

	Assemblies with Adhered Membranes over Insulated Wood Deck (New, Existing, or Recover)											
System No.	Deck Detail	Anchor Sheet	Anchor Attachment	Base Insulation	Top Insulation	Base Ply	Ply Sheet	Cap Sheet	MDP (psf)			
W-AM-9	T15/32P, L24, 0.113-6/6	-	-	Optional Insulation and/or Vapor Barrier	Min. 2-inch E3 fastened with Fasteners & Plates secured 24 per 4-ft x 8-ft board	DynaGrip Base SD/SA	OPTIONAL TA APP Ply 3	TA APP Cap 2	-75 (Lim. 7)			

		Mech	nanically Fastened	Assemblies over Wood	d Deck (New, Existing, or Rec	over)		
System No.	Deck Detail	Fire Barrier	Insulation	Base Sheet	Base Sheet Attachment	Ply Sheet	Cap Sheet	MDP (psf)
W-M-1	T15/32, L24, N6	-	-	MA Base	UF Fasteners & Plates (Square) spaced 9-inch o.c. in a 4-inch lap and two rows staggered in center 12-inch o.c.	OPTIONAL TA APP Ply	TA APP Cap	-52.5 (Lim. 7)
W-M-2	T19/32 (New only) or T15/32, L24, #8-6/6	OPTIONAL Any approved fire barrier	Min. 1.5-inch E3 Preliminarily Secured	<i>DynaFast 2</i> above OPTIONAL <i>FB</i>	APB Fasteners & Plates or HL Fasteners & Plates spaced 9-inch o.c within 4-inch heat welded side laps	OPTIONAL TA SBS Ply	TA APP Cap 2	-60 (Lim. 7)
W-M-3	T19/32 (New only) or T15/32, L24, #8-6/6	OPTIONAL Any approved fire barrier	Min. 1.5-inch E3 Preliminarily Secured	<i>DynaFast 2</i> above OPTIONAL <i>FB</i>	Batten Bar spaced 6-inch o.c. within the 4-inch wide heat welded side laps	OPTIONAL TA SBS Ply	TA APP Cap 2	-82.5 (Lim. 7)

#### **END OF REPORT**