


**GENERAL NOTES**


1. THE PRODUCT SHOWN HERIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE CURRENT FLORIDA BUILDING CODE (FBC) EXCLUDING HVHZ.
2. ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE/MASONRY AND 2X FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
3. 1X AND 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
4. THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HERIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.
5. APPROVED IMPACT PROTECTIVE SYSTEM **IS REQUIRED** ON THIS PRODUCT IN AREAS REQUIRING IMPACT RESISTANCE.
6. GLASS MEETS THE REQUIREMENTS OF ASTM E1300 GLASS CHARTS.
7. DESIGNATIONS "X" AND "O" STAND FOR THE FOLLOWING:  
X: OPERABLE PANEL  
O: FIXED PANEL

**INSTALLATION NOTES:**

1. ONE INSTALLATION ANCHOR IS REQUIRED AT EACH ANCHOR LOCATION SHOWN.
2. THE NUMBER OF INSTALLATION ANCHORS DEPICTED IS THE MINIMUM NUMBER OF ANCHORS TO BE USED FOR THE PRODUCT INSTALLATION.
3. INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF +/-1/2 INCH OF THE DEPICTED LOCATION IN THE ANCHOR LAYOUT DETAIL (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
4. SHIM AS REQUIRED AT EACH INSTALLATION ANCHOR WITH LOAD BEARING SHIM(S). MAXIMUM ALLOWABLE SHIM STACK TO BE 1/4 INCH. SHIM WHERE SPACE OF 1/16 INCH OR GREATER OCCURS. SHIM(S) SHALL BE CONSTRUCTED OF HIGH DENSITY PLASTIC OR BETTER.
5. FOR INSTALLATION INTO WOOD FRAMING USE #12 WOOD SCREWS OF SUFFICIENT LENGTH TO ACHIEVE 1 1/2 INCH MINIMUM EMBEDMENT INTO WOOD SUBSTRATE.
6. FOR INSTALLATION THROUGH 1X BUCK TO CONCRETE/MASONRY, OR DIRECTLY INTO CONCRETE/MASONRY, USE 3/16 INCH DIAMETER ITW TAPCONS OF SUFFICIENT LENGTH TO ACHIEVE 1 1/4 INCH MINIMUM EMBEDMENT.
7. FOR INSTALLATION INTO STEEL STUD FRAMING USE #12 SELF-TAPPING SCREWS OF SUFFICIENT LENGTH TO ACHIEVE 3 THREADS OF MINIMUM ENGAGEMENT BEYOND STEEL STUD SUBSTRATE.
8. MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES, INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICKVENEER, AND SIDING.
9. INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING.
10. FOR HOLLOW BLOCK AND GROUT FILLED BLOCK, DO NOT INSTALL INSTALLATION ANCHORS INTO MORTAR JOINTS. EDGE DISTANCE IS MEASURED FROM FREE EDGE OF BLOCK OR EDGE OF MORTAR JOINT INTO FACE OF SHELL OF BLOCK.
11. INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BY THE ANCHOR MANUFACTURER.
12. INSTALLATION ANCHOR CAPACITIES FOR PRODUCTS HERIN ARE BASED ON SUBSTRATE MATERIALS WITH THE FOLLOWING PROPERTIES:
  - A. WOOD - MINIMUM SPECIFIC GRAVITY OF 0.55.
  - B. CONCRETE - MINIMUM COMPRESSIVE STRENGTH OF 3000 PSI.
  - C. MASONRY - STRENGTH CONFORMANCE TO ASTM C-90 WITH MINIMUM COMPRESSIVE YIELD STRENGTH OF 2000 PSI.
  - D. STEEL - MINIMUM TENSILE YIELD STRENGTH OF 33 KSI. MINIMUM WALL THICKNESS OF 49 MILS. (18 GAUGE)

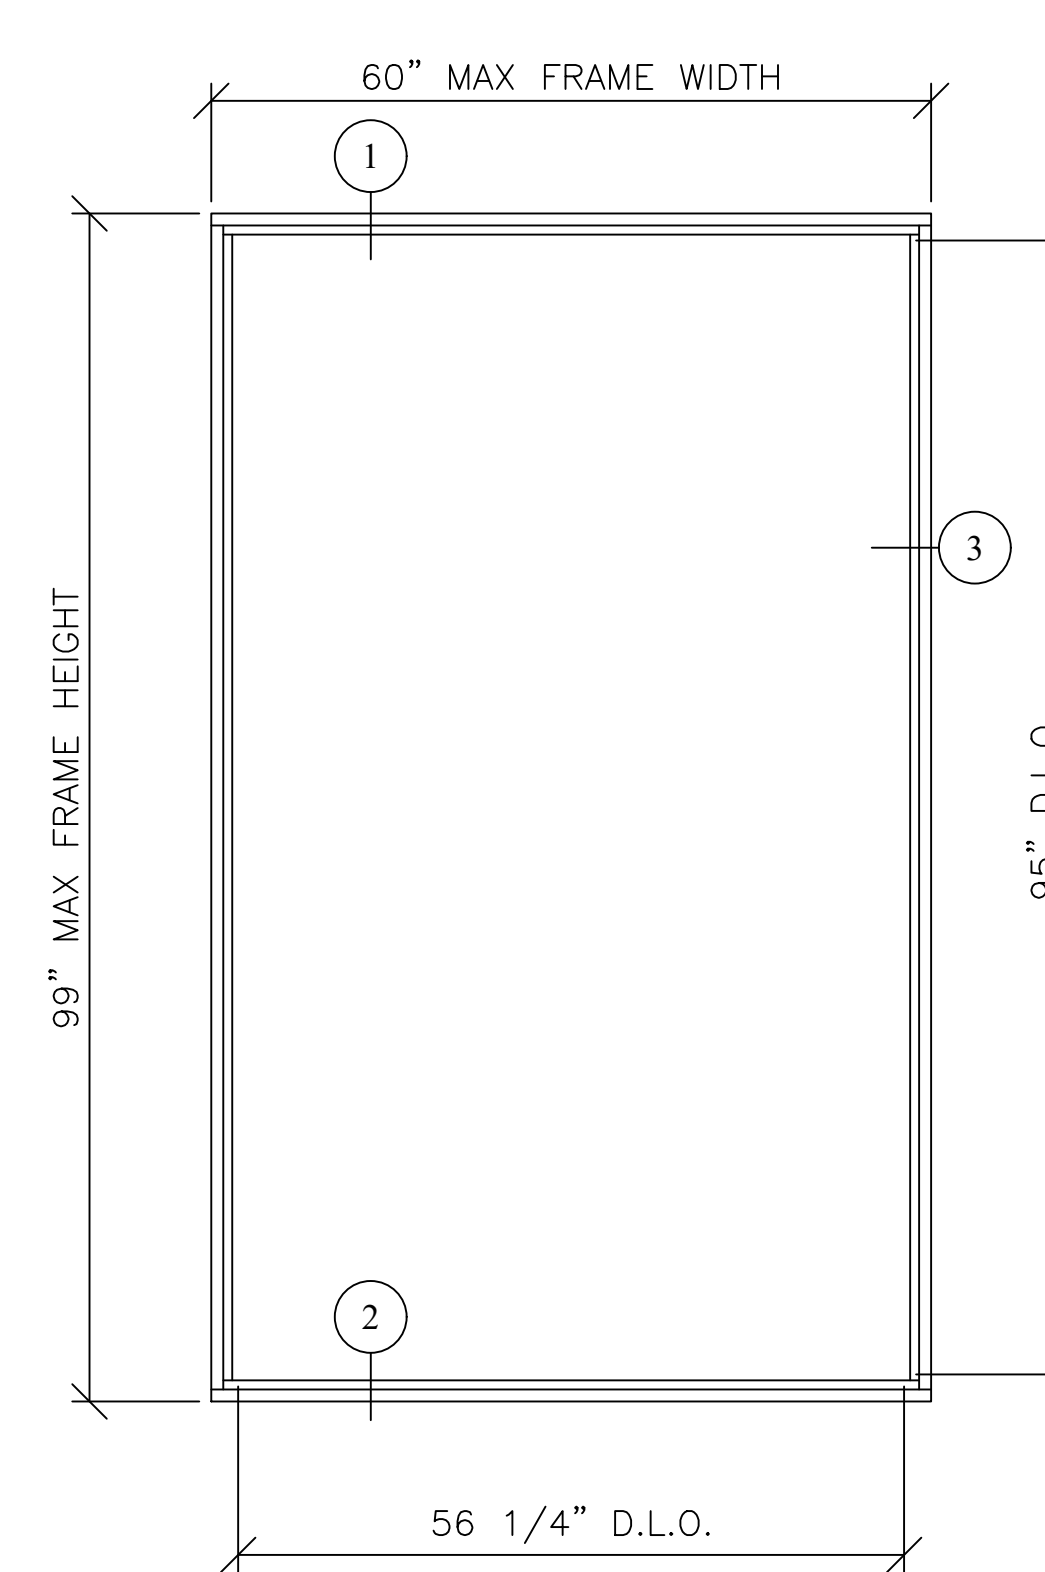

**EXTERIOR ELEVATION**

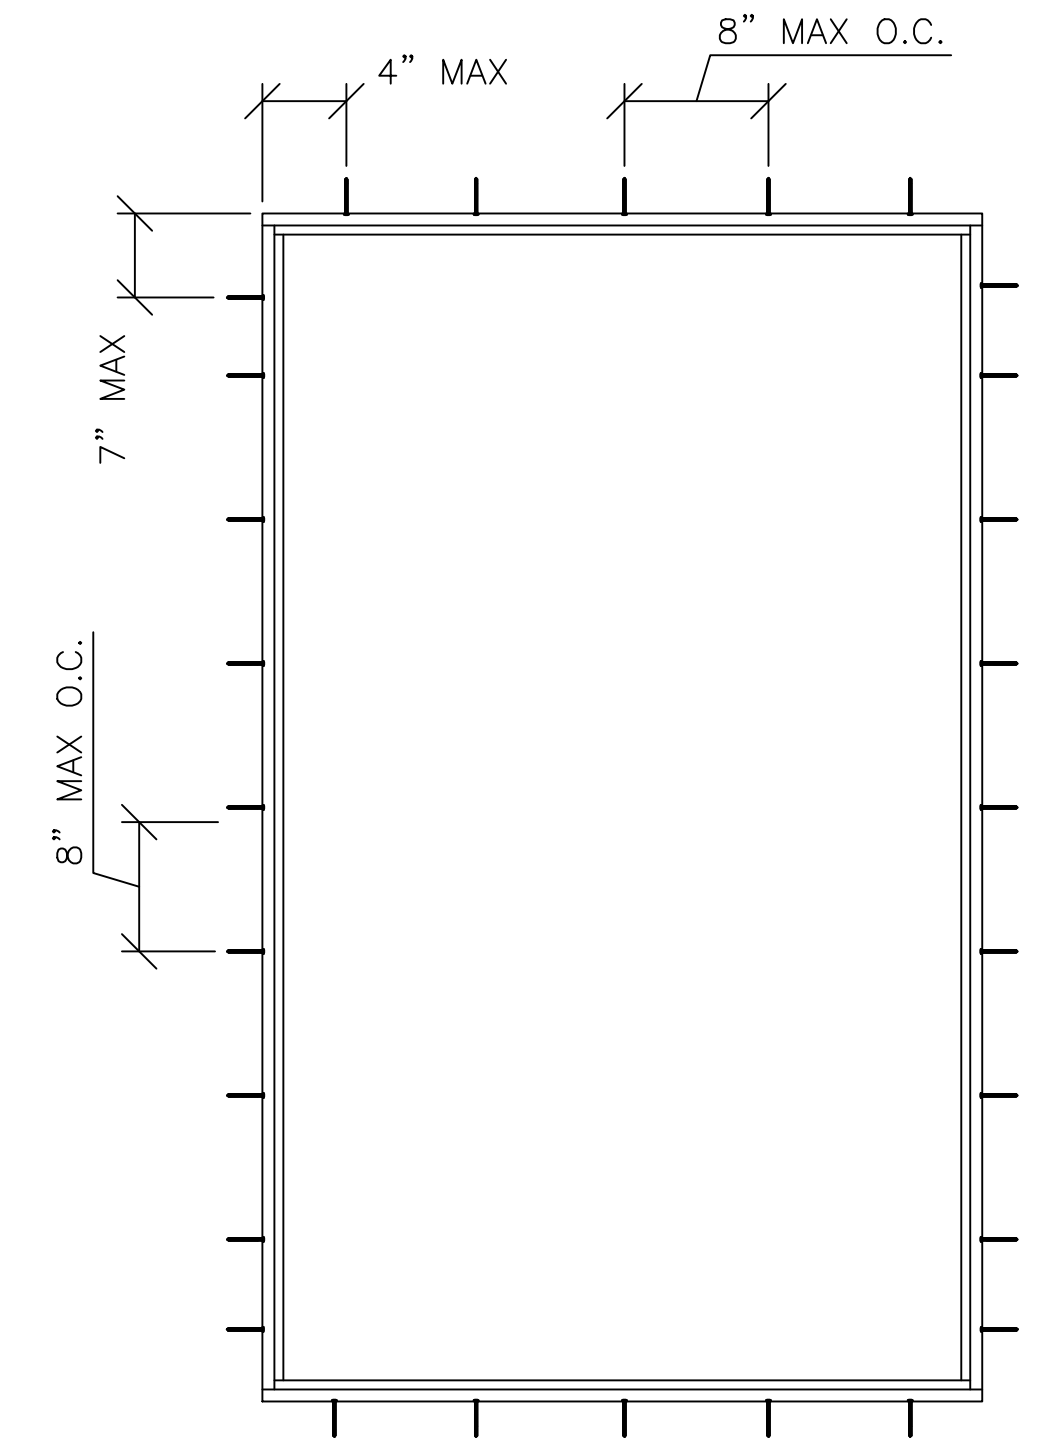

**ANCHOR LAYOUT**

GENERAL NOTES	
SERIES	E2500 FIXED FRAME (1 LITE)
FINISH	ANY
PANELS	NONE
SCREENS	NONE
GLAZING	INSULATED GLASS (TEMPERED)

**CORNER CONSTRUCTION**

BUTT, SECURED WITH TWO (2) #8 X 1" PHILLIPS PAN HEAD CAD PLATED TYPE "A" SCREWS AND SEALED WITH SCHNEE-MOREHEAD 5504 SEALANT


**TEST REQUIREMENTS**

DESIGN PRESSURE +/- 100 PSF

TEST TYPE **STRUCTURAL**

NOTE: DRAWINGS TO SCALE ON 24 X 36 PAPER ONLY

NOTE: DRAWINGS TO SCALE ON 24 X 36 PAPER ONLY

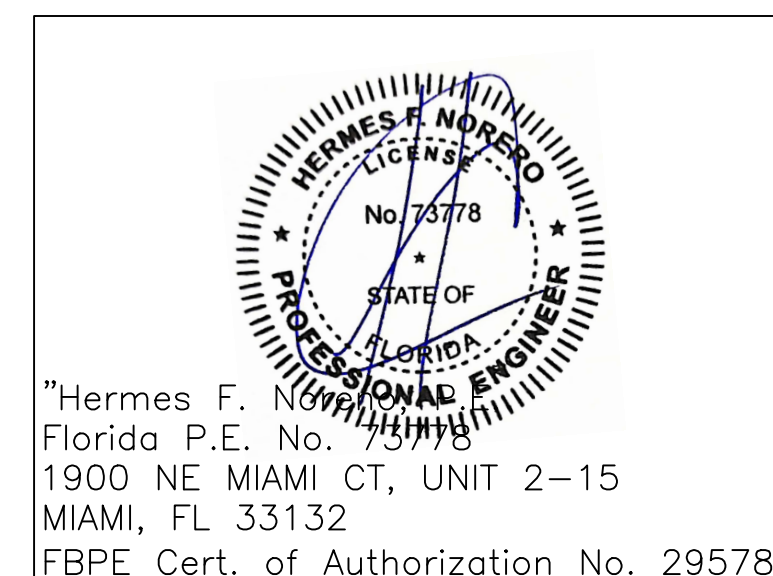





400 AMBASSADOR ROW  
LOMGVIEW, TX 756043  
PHONE: (979) 823-6557  
FAX: (979) 823-1005

MEMO NO.	8096-10
DESCRIPTION:	E2500/E3250/E4000 FIXED FRAME ELEVATIONS AW-100

REVISIONS		
A	EDITED DETAILS TO 2010	2/13/14
B	ADDED E3250 AND E4000	5/7/14
C	UPDATE NOTES	11/23/20
D	CHANGE ADDRESS	1/26/24

SCALE	DETAILS: FULL ELEV: 3/4" = 1"
DRAWN BY:	JKY
DATE DRAWN:	10/31/13
PAGE NO.	1 OF 6



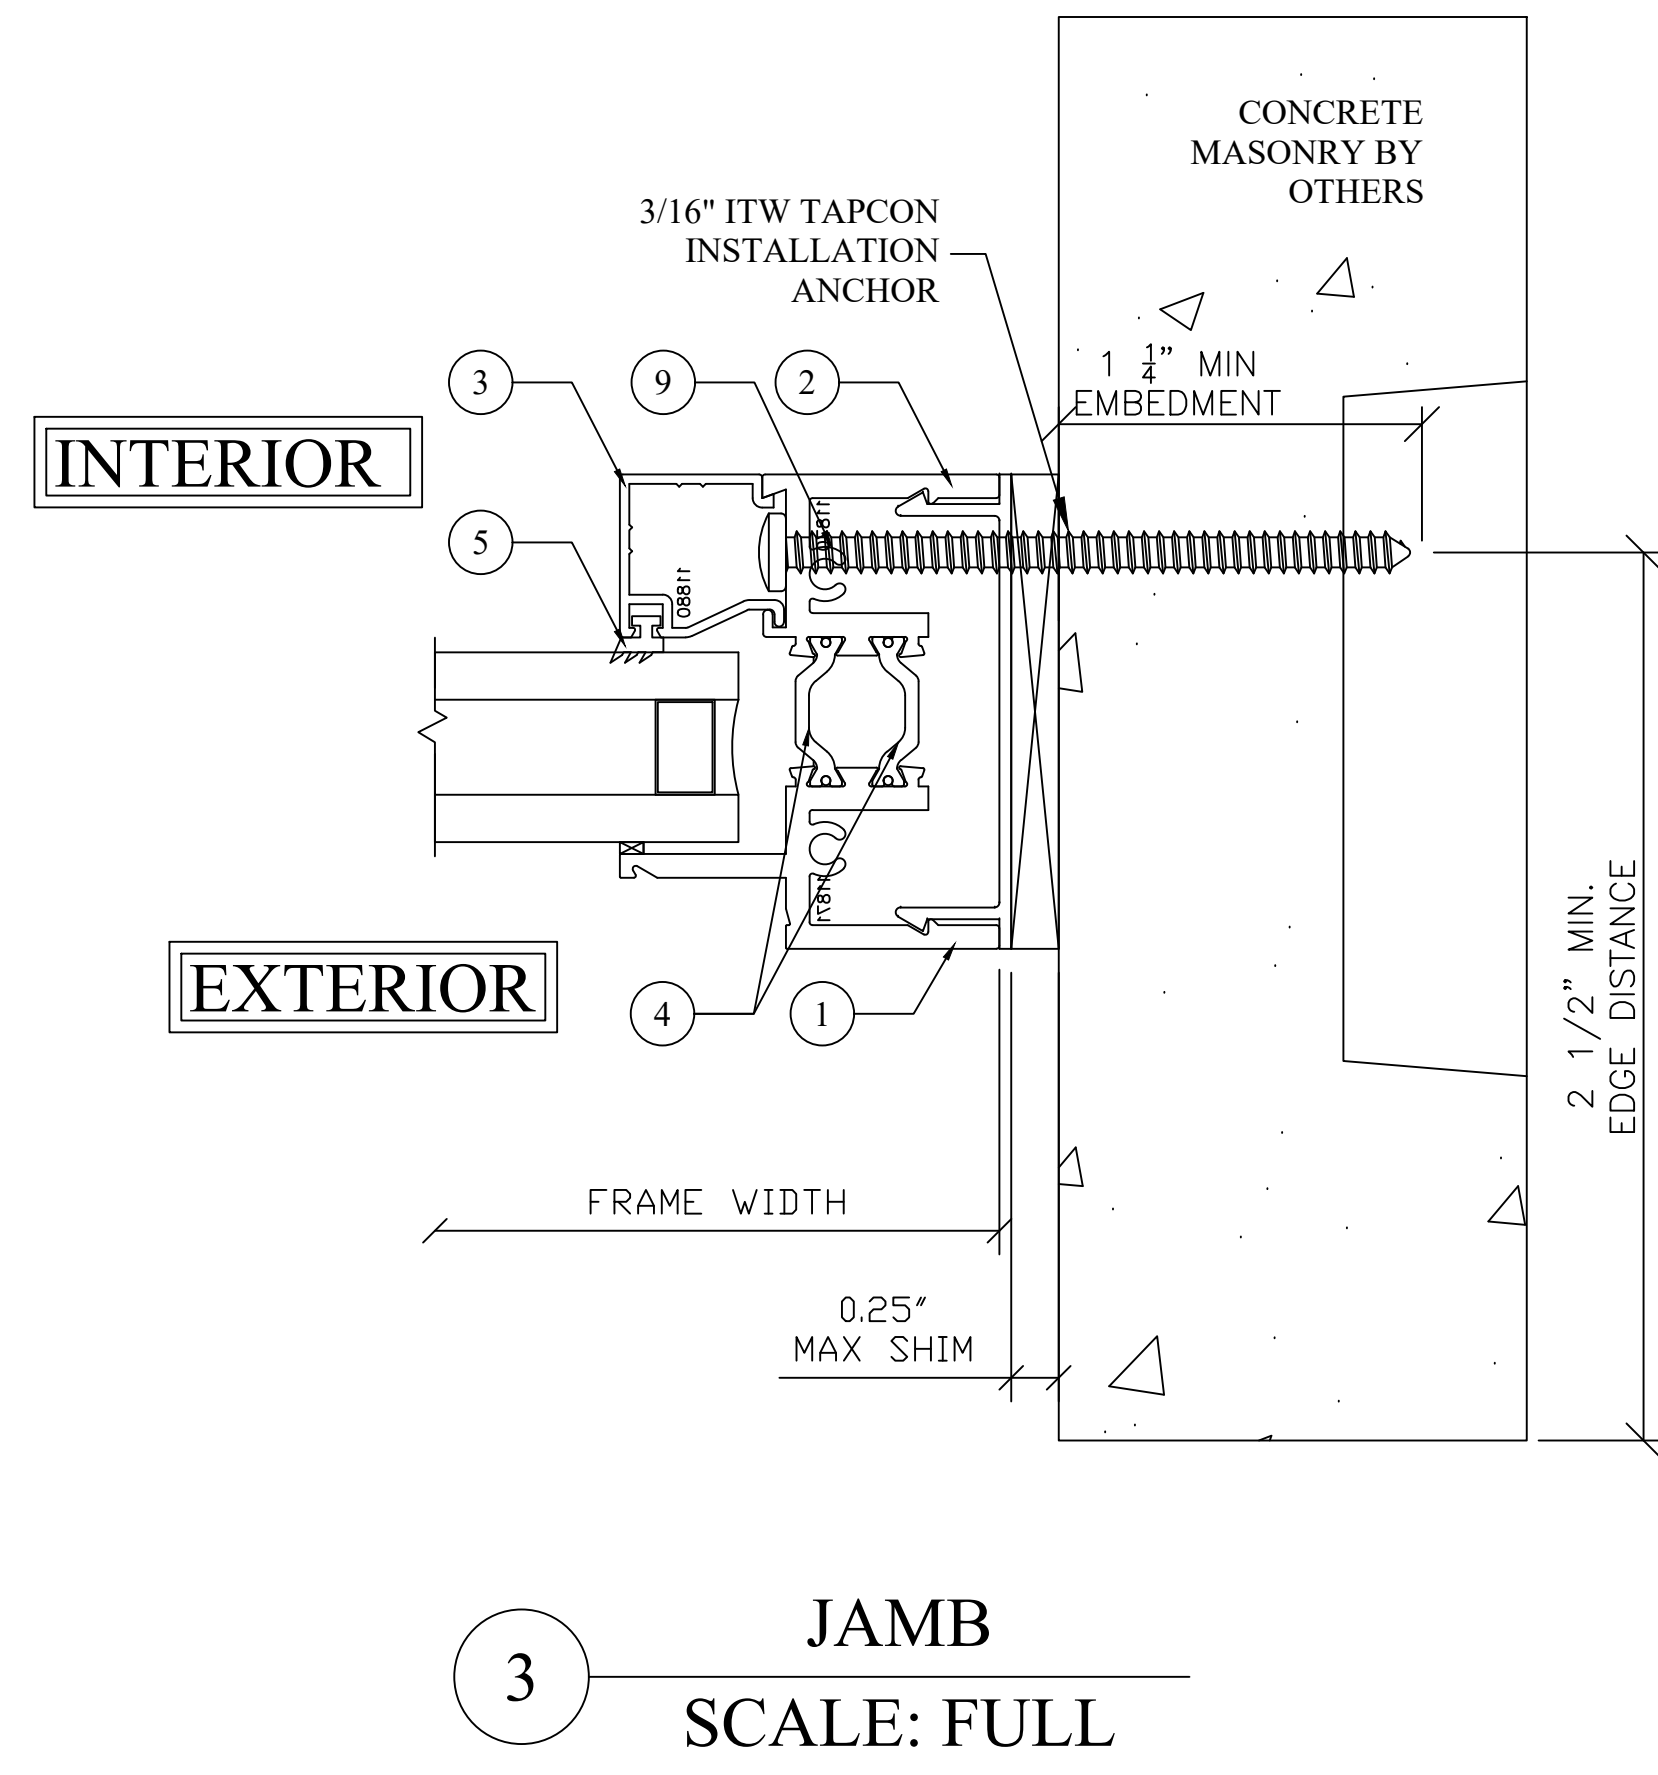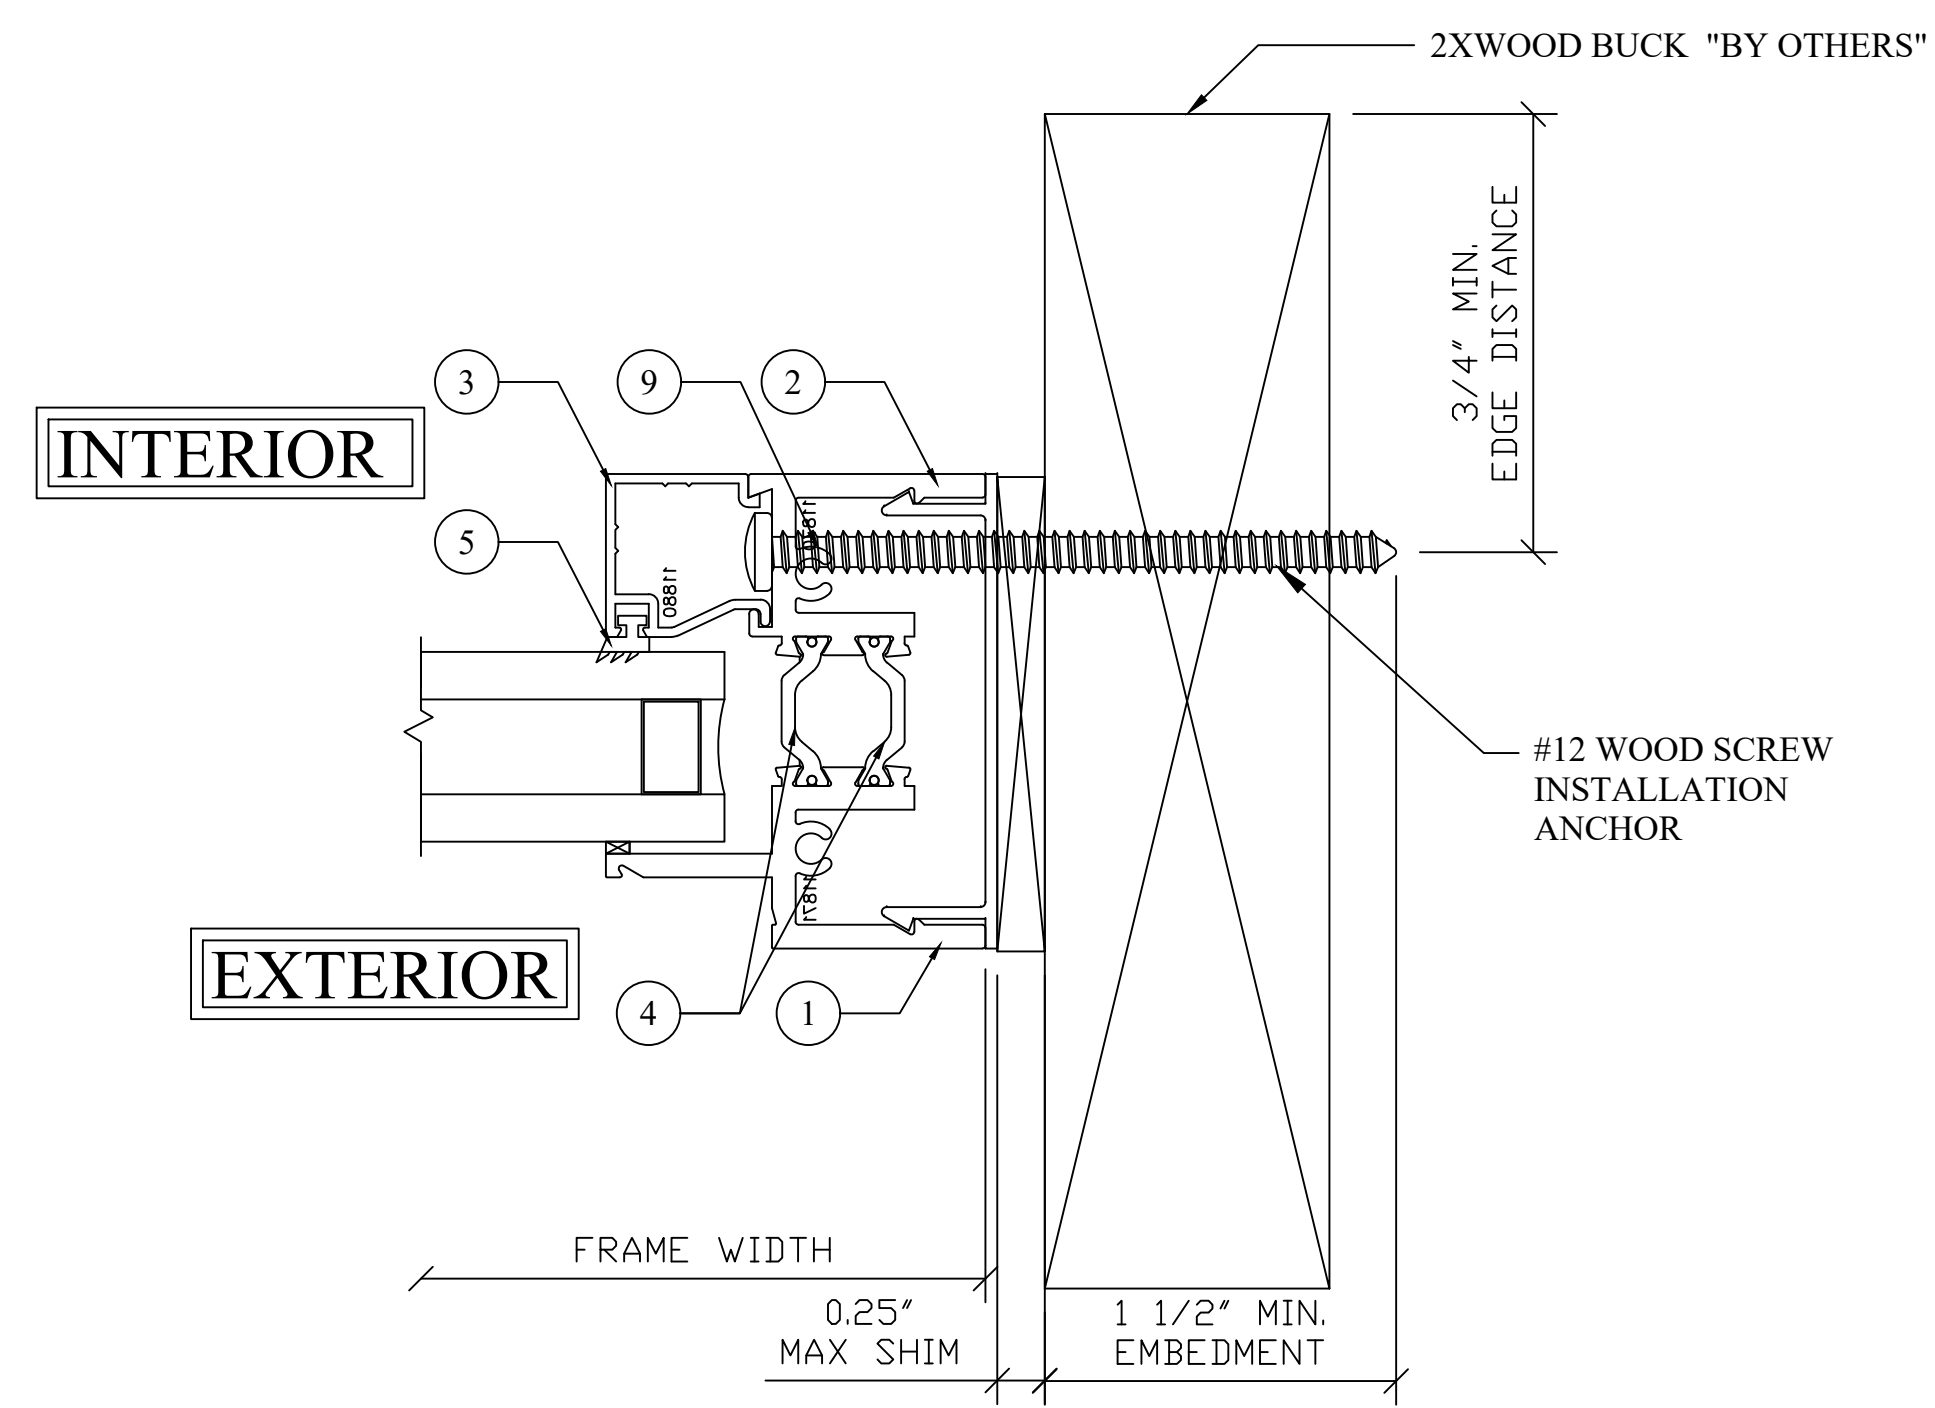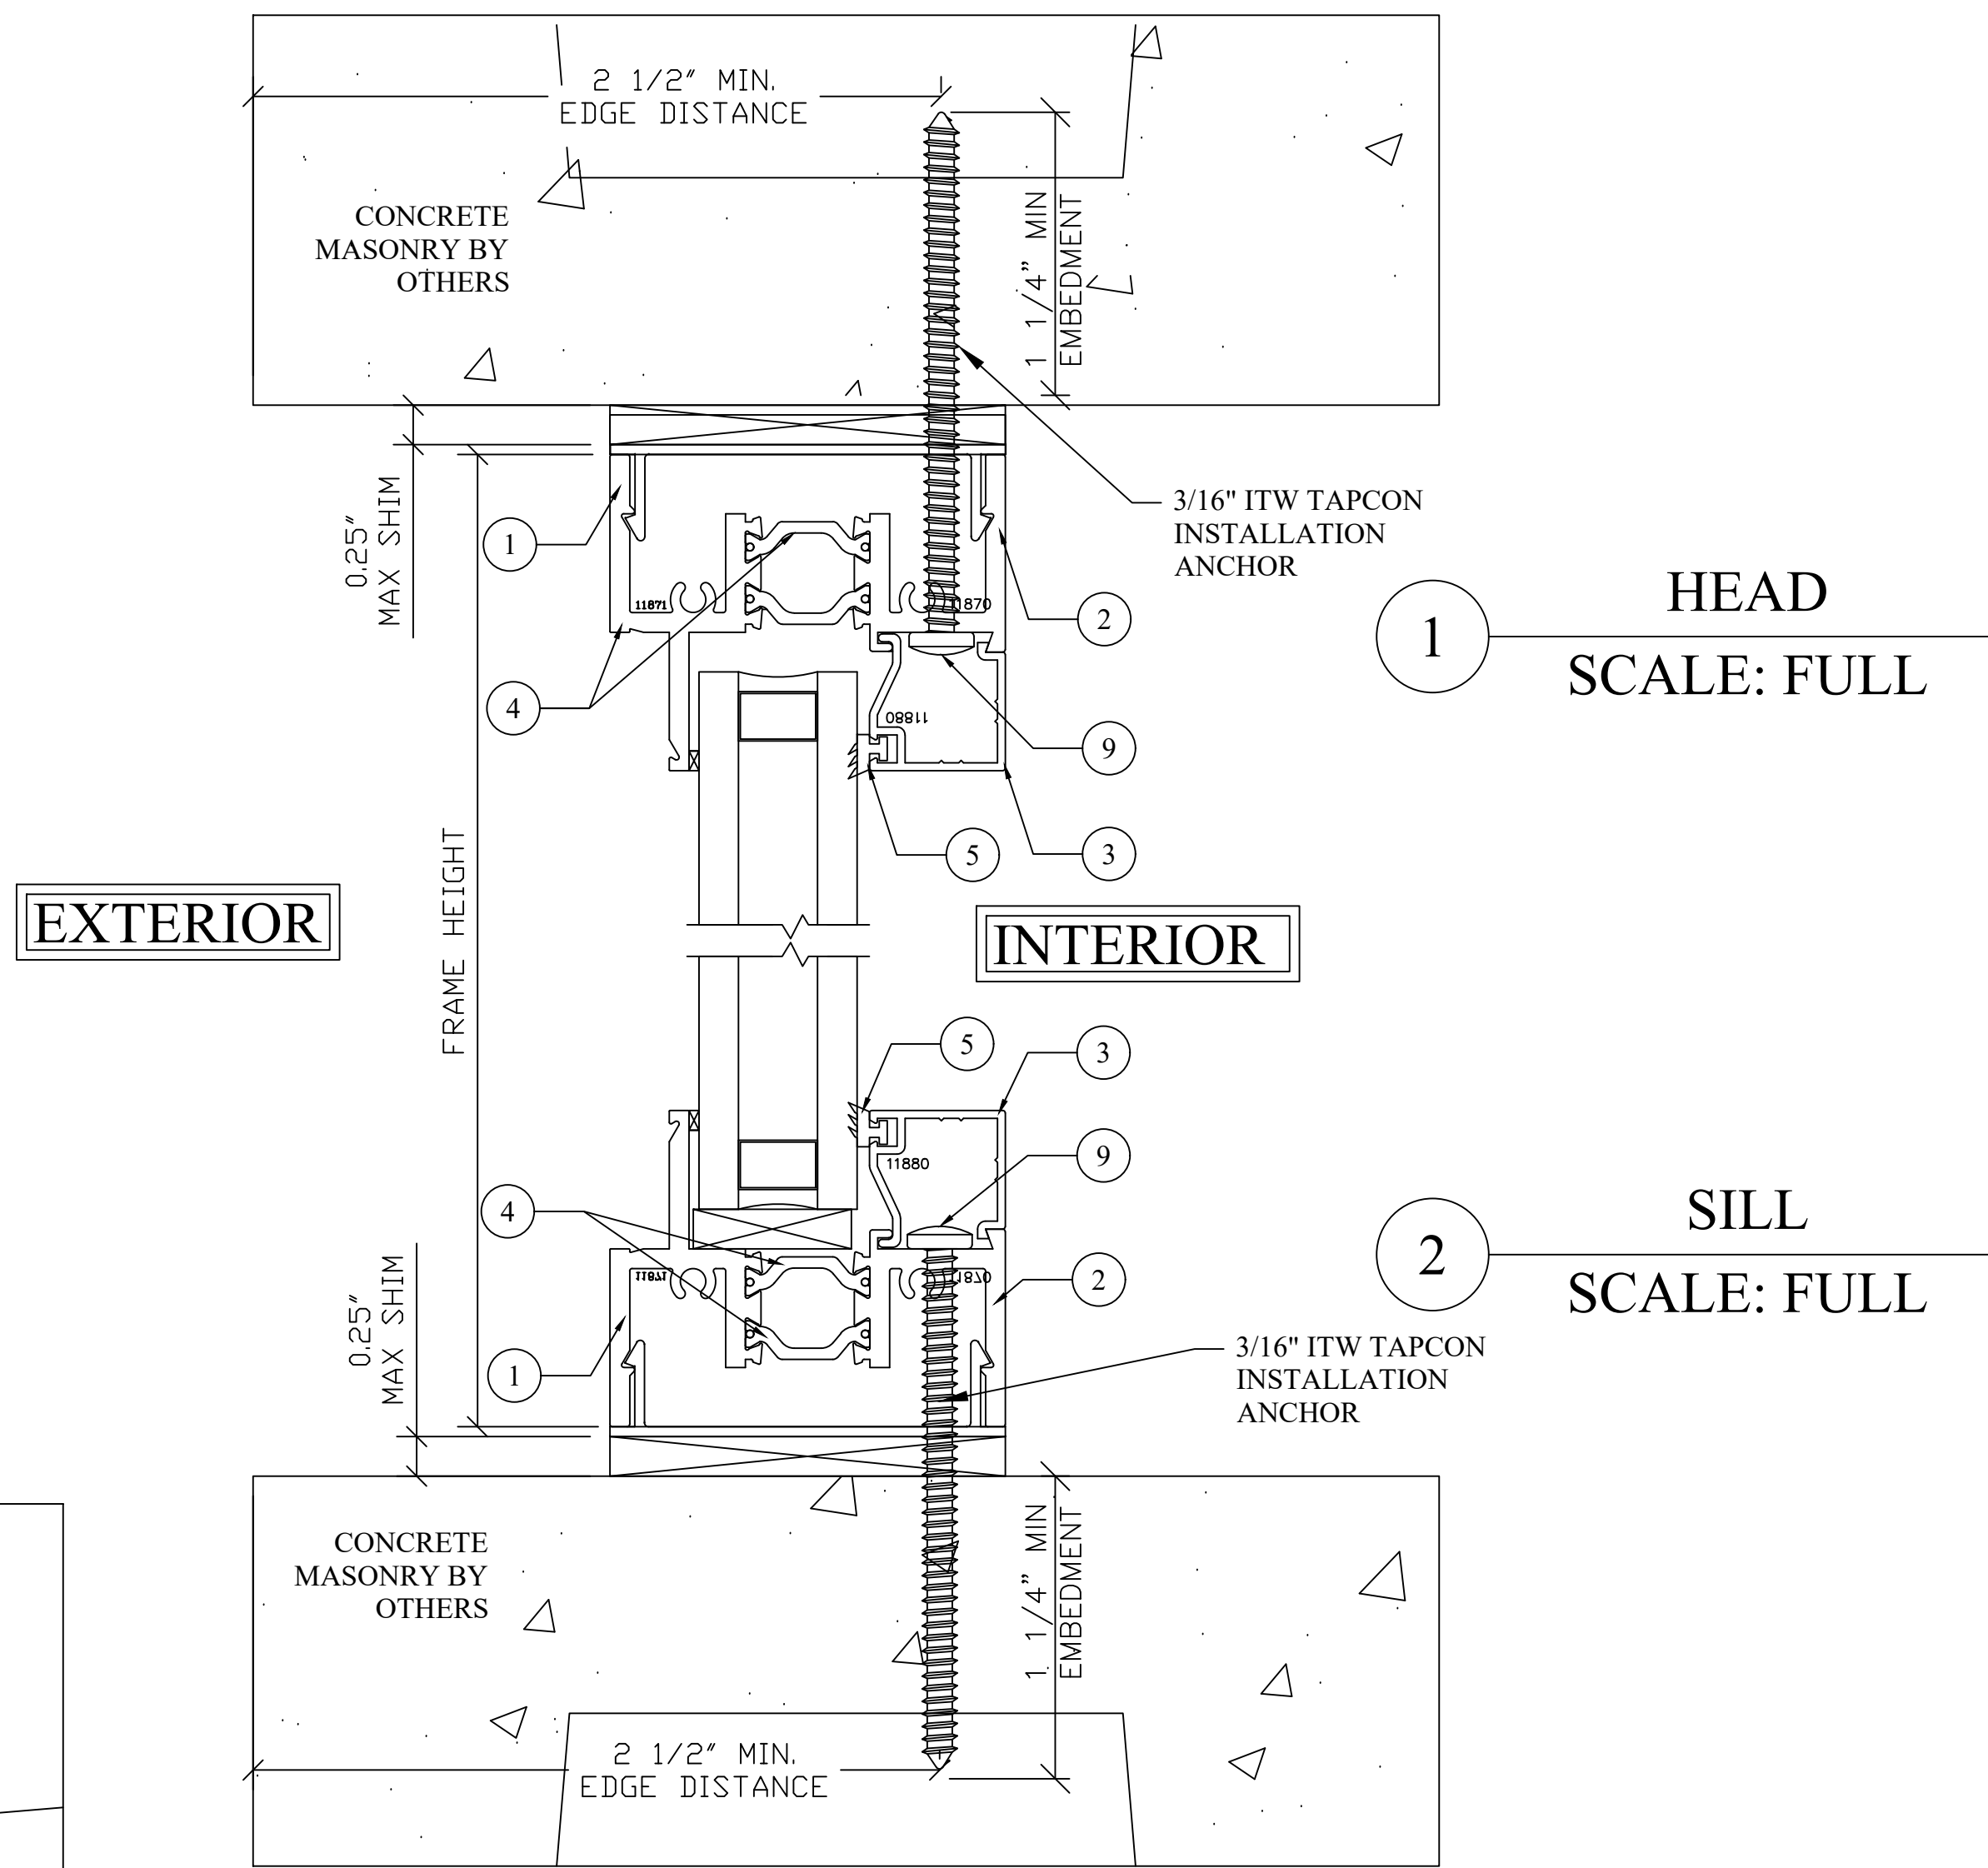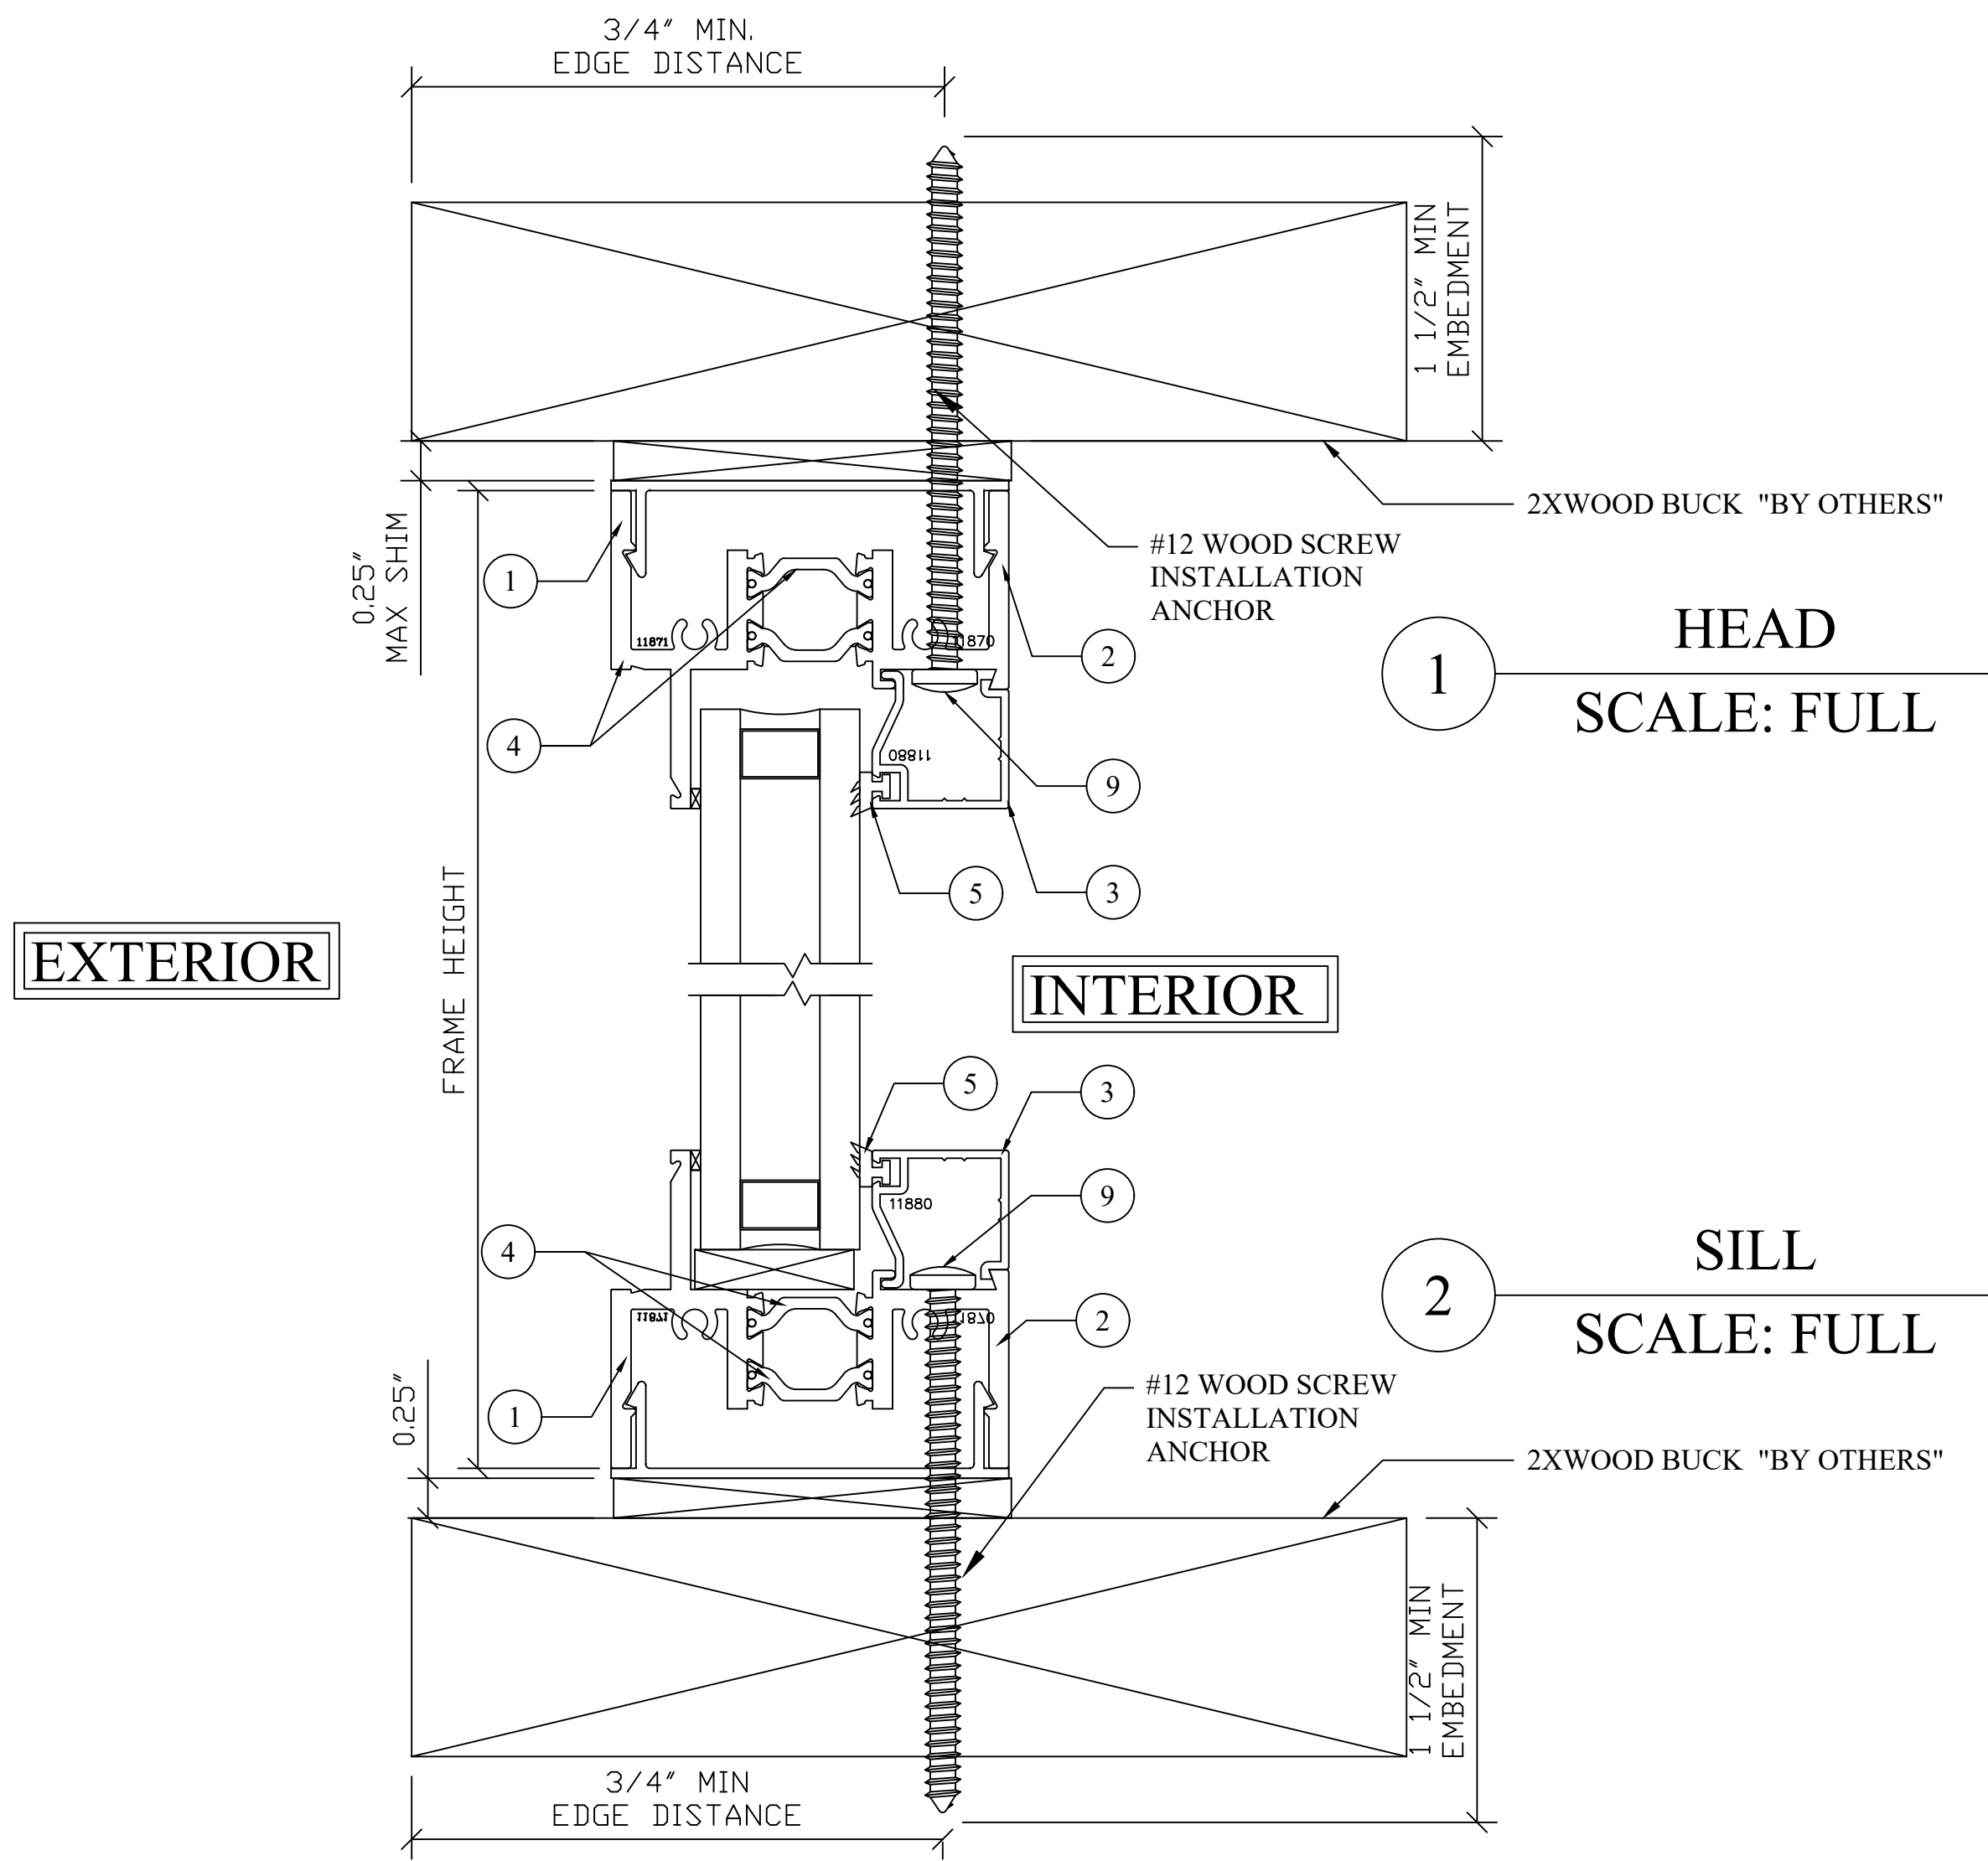

NOTE: DRAWINGS TO SCALE ON 24 X 36 PAPER ONLY


HERMES F. NORRIS  
 LICENSED PROFESSIONAL ENGINEER  
 No. 75778  
 STATE OF FLORIDA  
 "Hermes F. Norris  
 Florida P.E. No. 75778  
 1900 NE MIAMI CT, UNIT 2-15  
 MIAMI, FL 33132  
 FBPE Cert. of Authorization No. 29578"

**ALL SEASONS**  
 COMMERCIAL DIV.  
 400 AMBASSADOR ROW  
 LOMGVIEW, TX 756043  
 PHONE: (979) 823-6557  
 FAX: (979) 823-1005

MEMO NO. 8096-10  
 DESCRIPTION:  
 E2500/E3250/E4000 FIXED FRAME  
 WOOD AND MASONRY  
 DETAILS


REVISIONS		
A	EDITED DETAILS TO 2010	2/13/14
B	ADDED E3250 AND E4000	5/7/14
C	UPDATE NOTES	11/23/20
D	CHANGE ADDRESSES	1/26/24

SCALE DETAILS: FULL  
 ELEV: 3/4" = 1"  
 DRAWN BY: JKY  
 DATE DRAWN: 10/31/13  
 PAGE NO. 2 OF 6

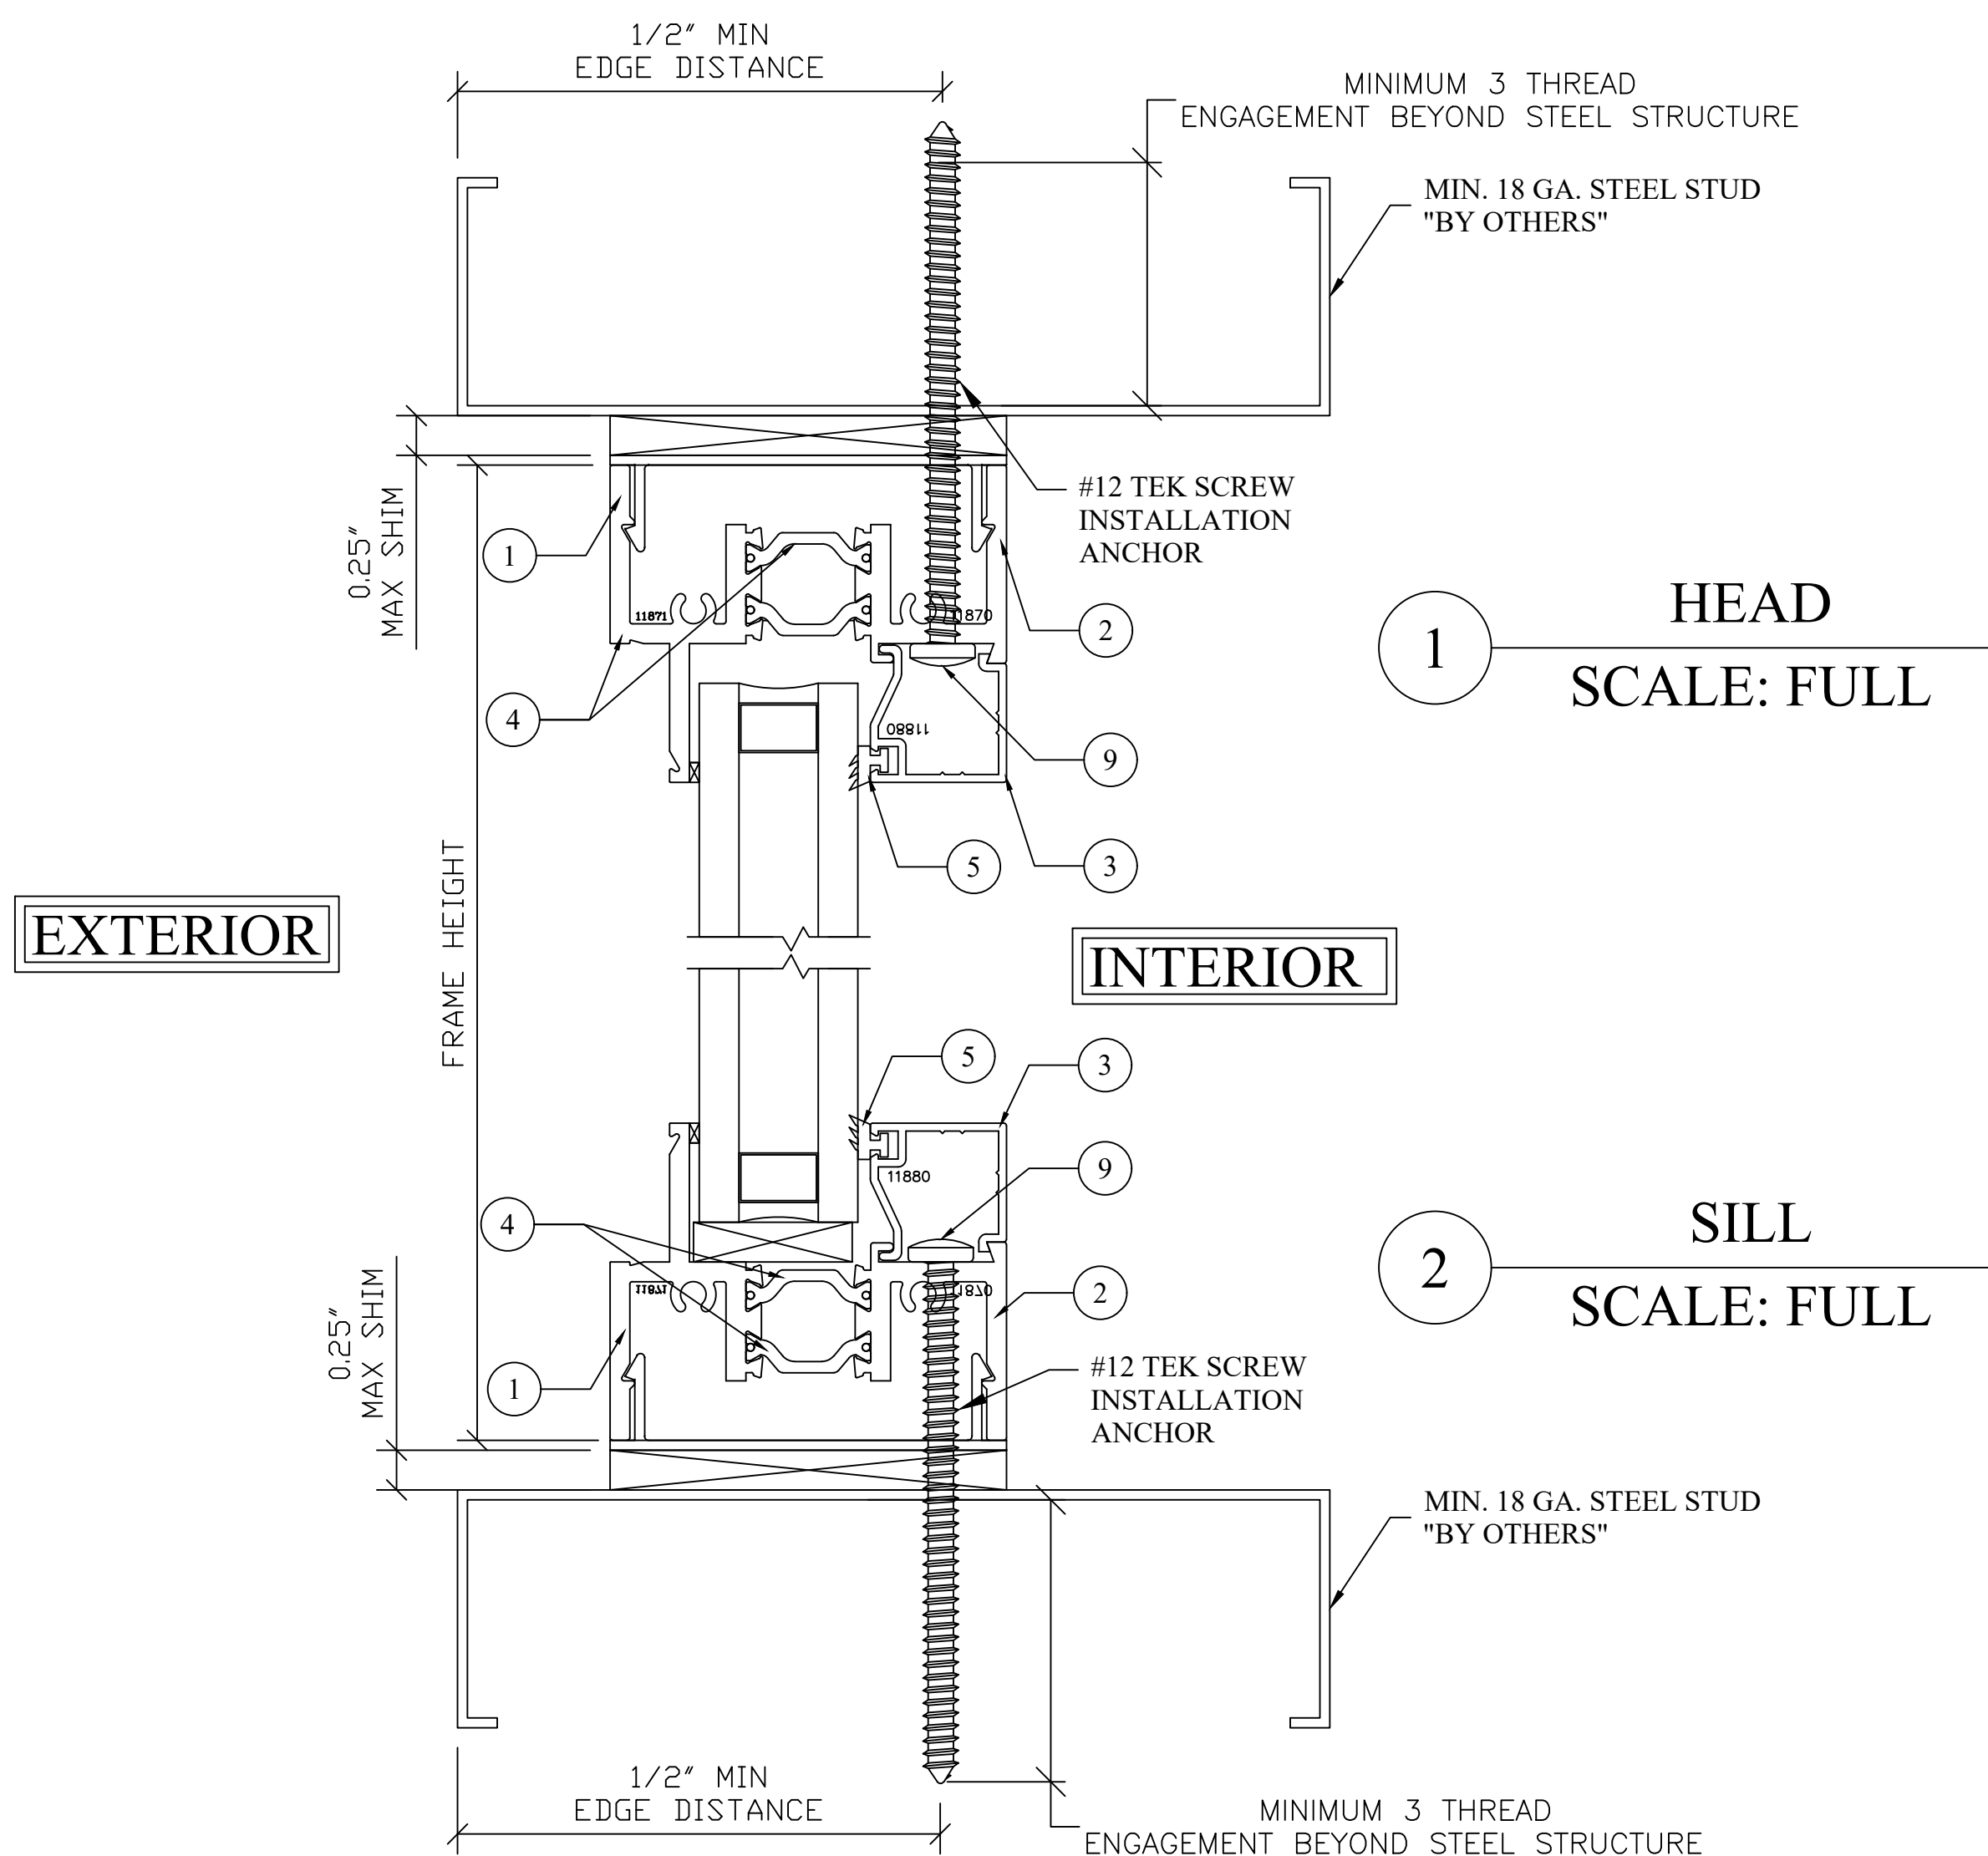

1 HEAD  
SCALE: FULL

2 SILL  
SCALE: FULL

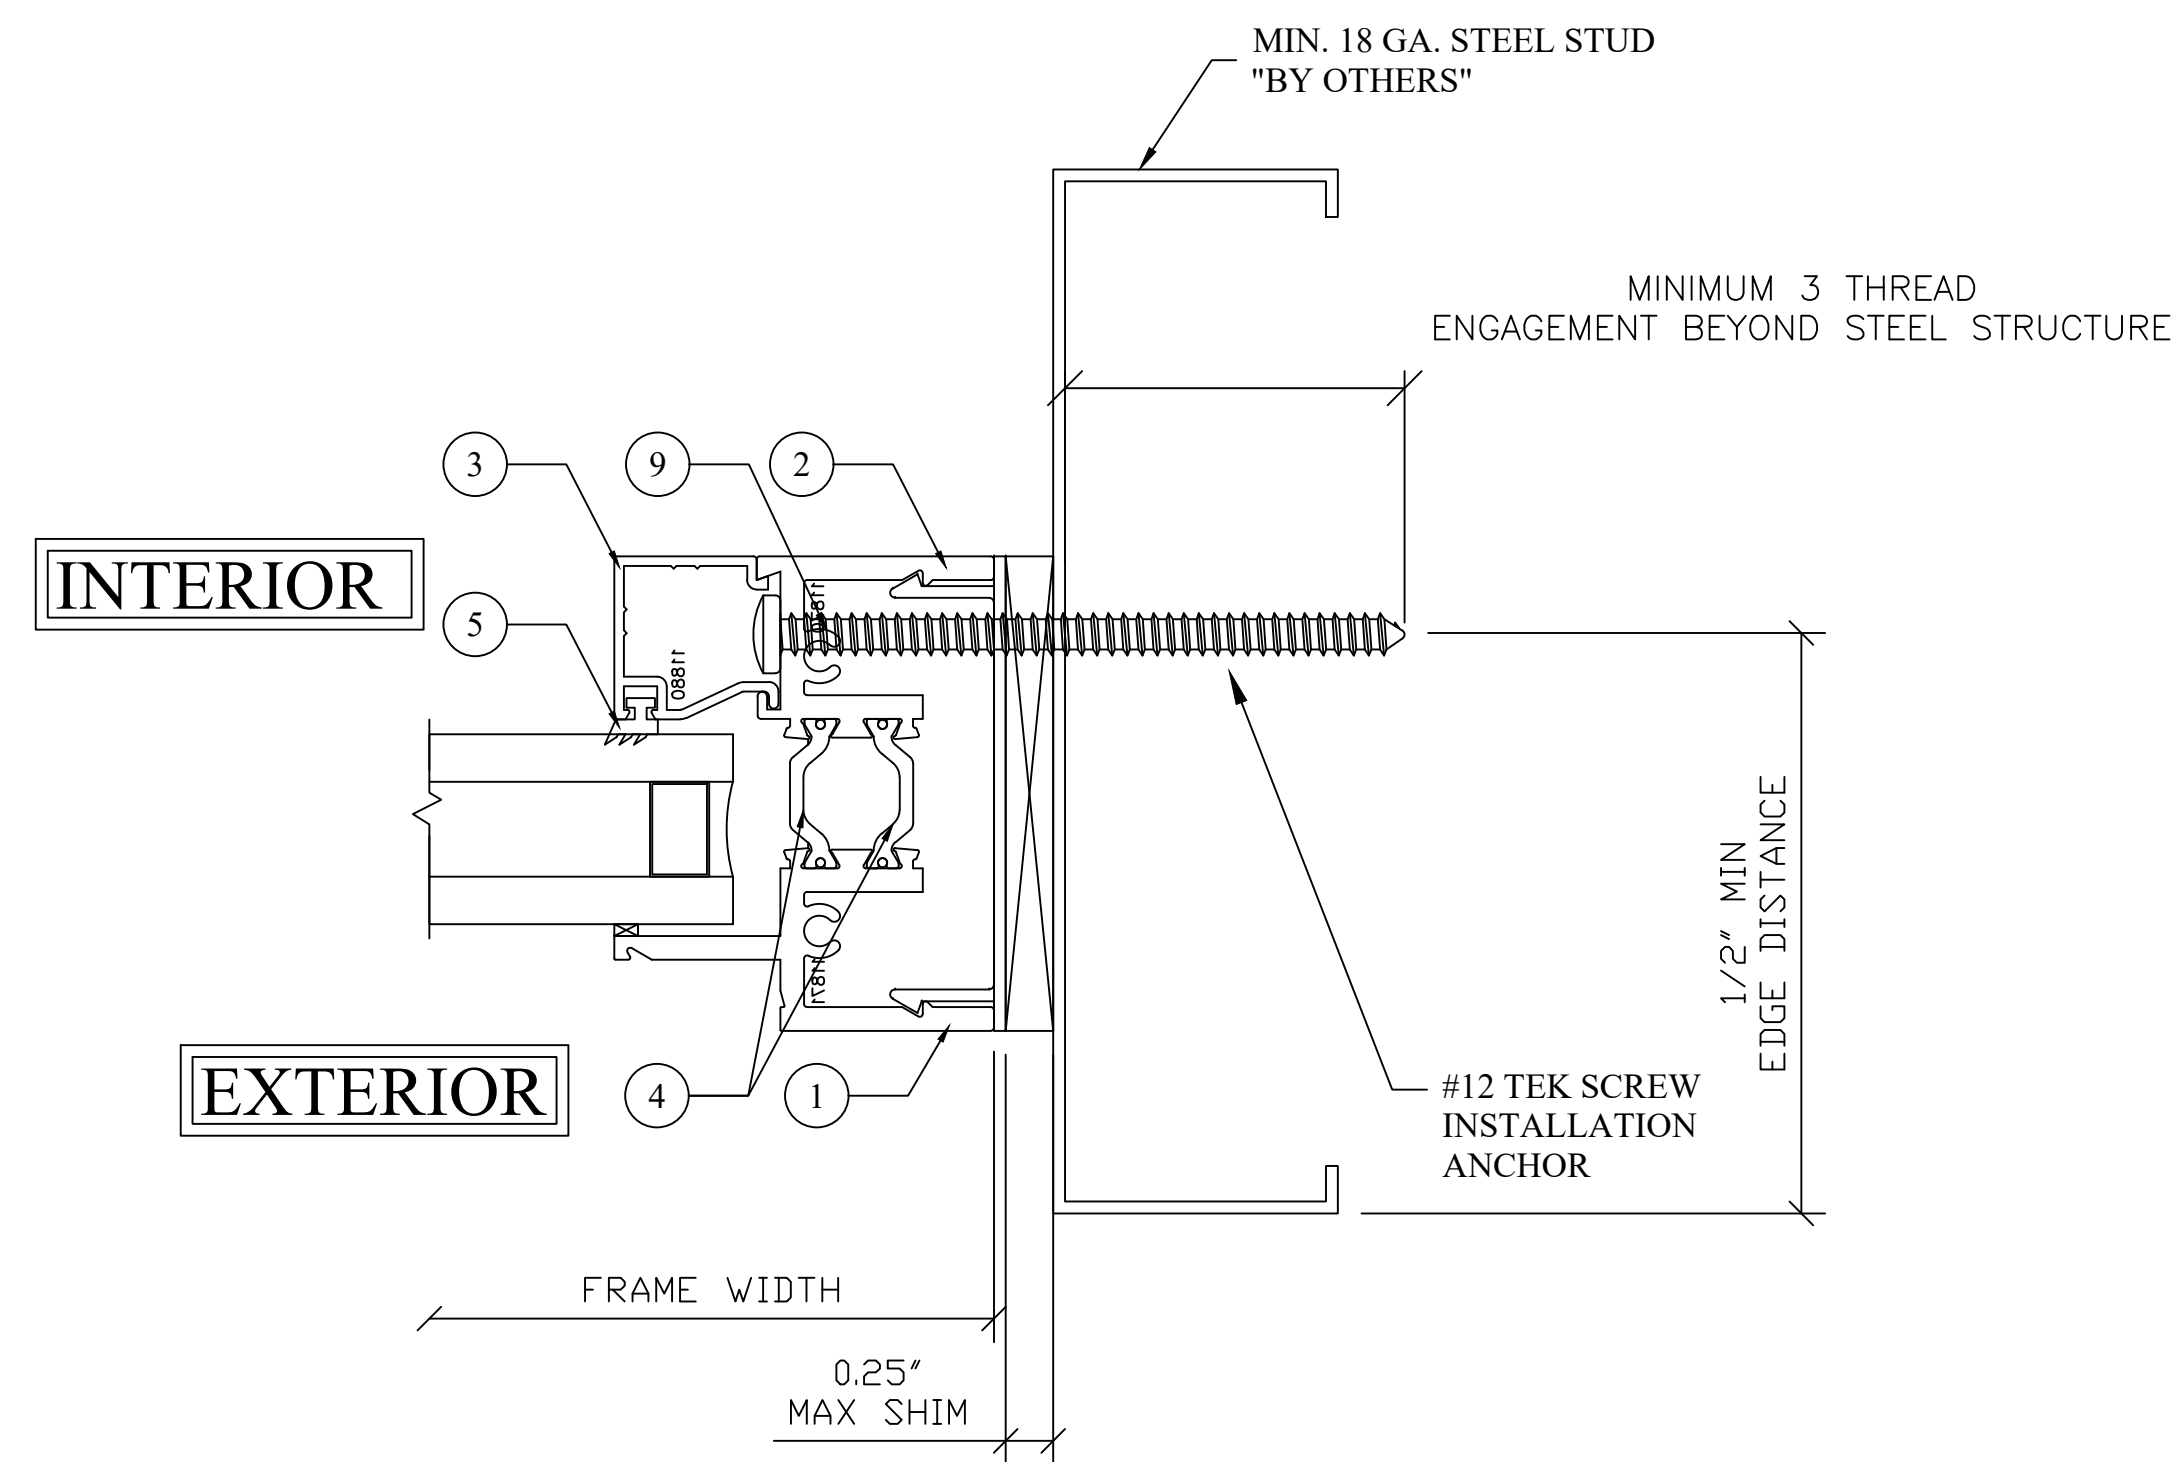

3 JAMB  
SCALE: FULL

NOTE: DRAWINGS TO SCALE ON 24 X 36 PAPER ONLY

Hermes F. Norredo  
Florida P.E. No. 75778  
1900 NE MIAMI CT, UNIT 2-15  
MIAMI, FL 33132  
FBPE Cert. of Authorization No. 29578"

**ALL SEASONS**  
**COMMERCIAL DIV.**

400 AMBASSADOR ROW  
LONGVIEW, TX 756043

PHONE: (979) 823-6557  
FAX: (979) 823-1005

MEMO NO. 8096-10







DESCRIPTION:  
E2500/E3250/E4000 FIXED FRAME  
STEEL DETAILS

REVISIONS		
A	EDITED DETAILS TO 2010	2/13/14
B	ADDED E3250 AND E4000	
C	UPDATE NOTES	11/23/20
D	CHANGE ADDRESSES	1/26/24


SCALE	DETAILS: FULL ELEV: 3/4" = 1"
DRAWN BY:	JKY
DATE DRAWN:	10/31/13
PAGE NO.	3 OF 6



ITEM#	PART#	ITEM DESCRIPTION	MANUFACTURER/NOTES
WINDOW PARTS			
1	11871	FRAME EXTERIOR	6063-T5 ALUMINUM
2	11870	FRAME INTERIOR	6063-T5 ALUMINUM
3	11880	GLAZING BEAD	6063-T5 ALUMINUM
4	66108802	20mm THERMAL STRUT	ENSINGER
5	V-414	GLAZING VINYL	SOFT PVC
9		SHEAR CLIP	6063-T5 ALUMINUM
SEALS & SEALANT			
6	----	SEAM SEALANT	SCHNEE MOREHEAD 5504
MISC. FASTENERS			
7	66103392	8-15 X 1" PH PN HD CAD	FRAME ASSEMBLY SCREW
8	----	#10 X 3" PH PN HD	INSTALLATION ANCHOR

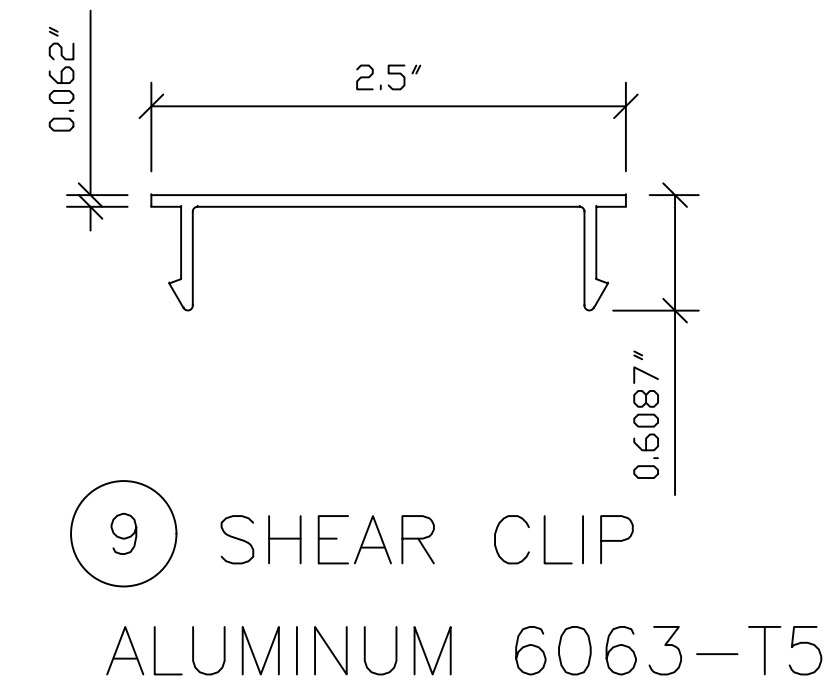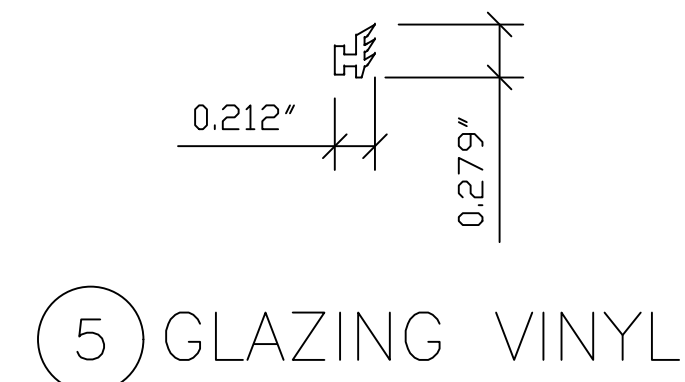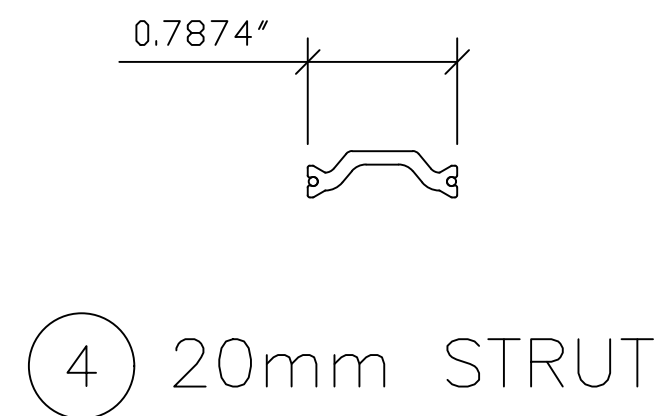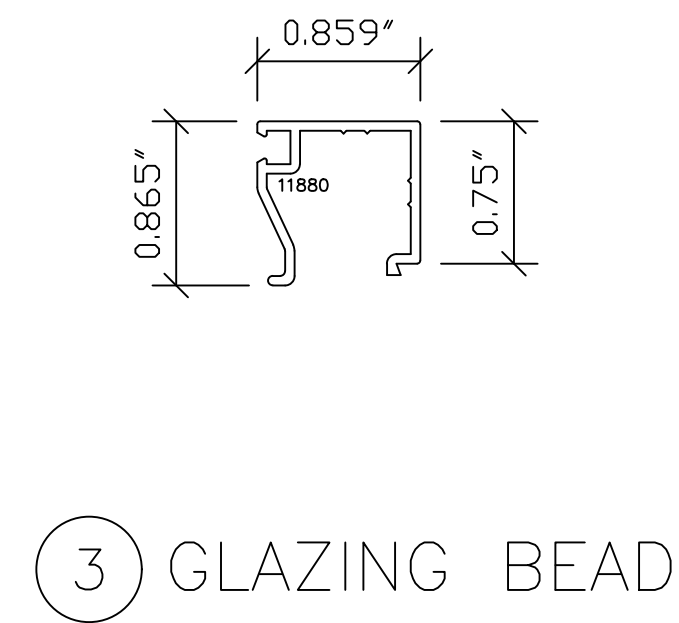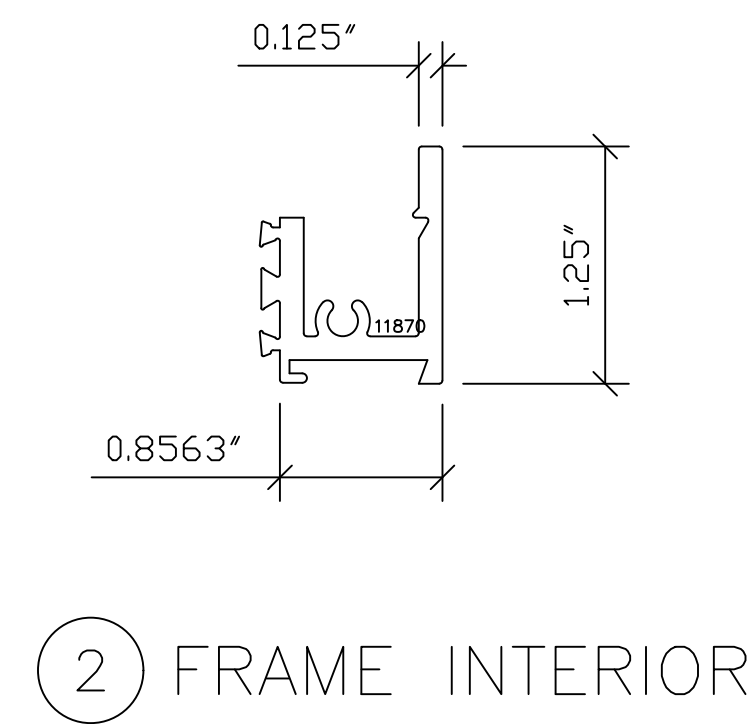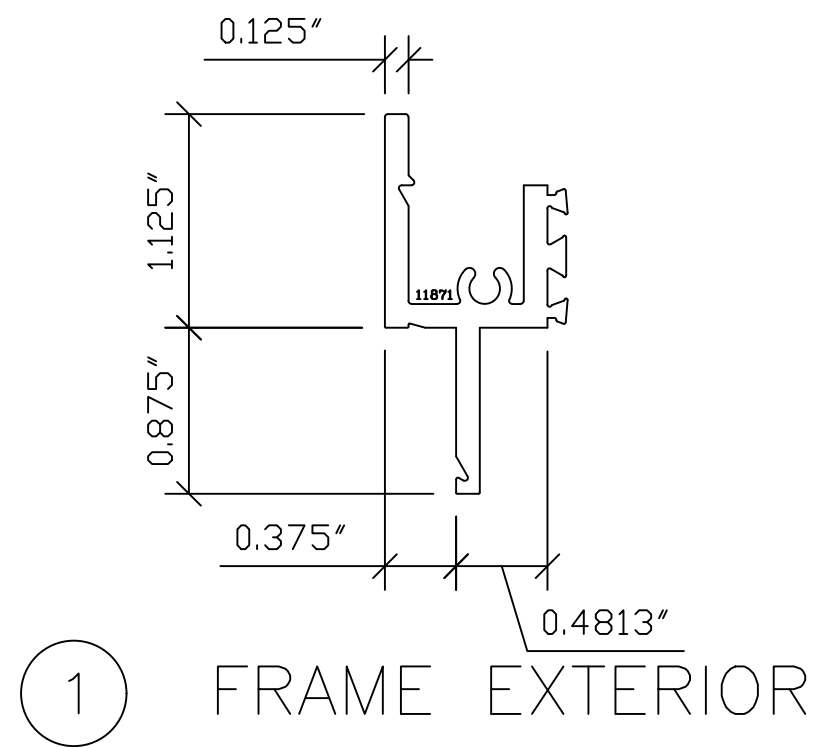

**GLAZING DETAIL:**

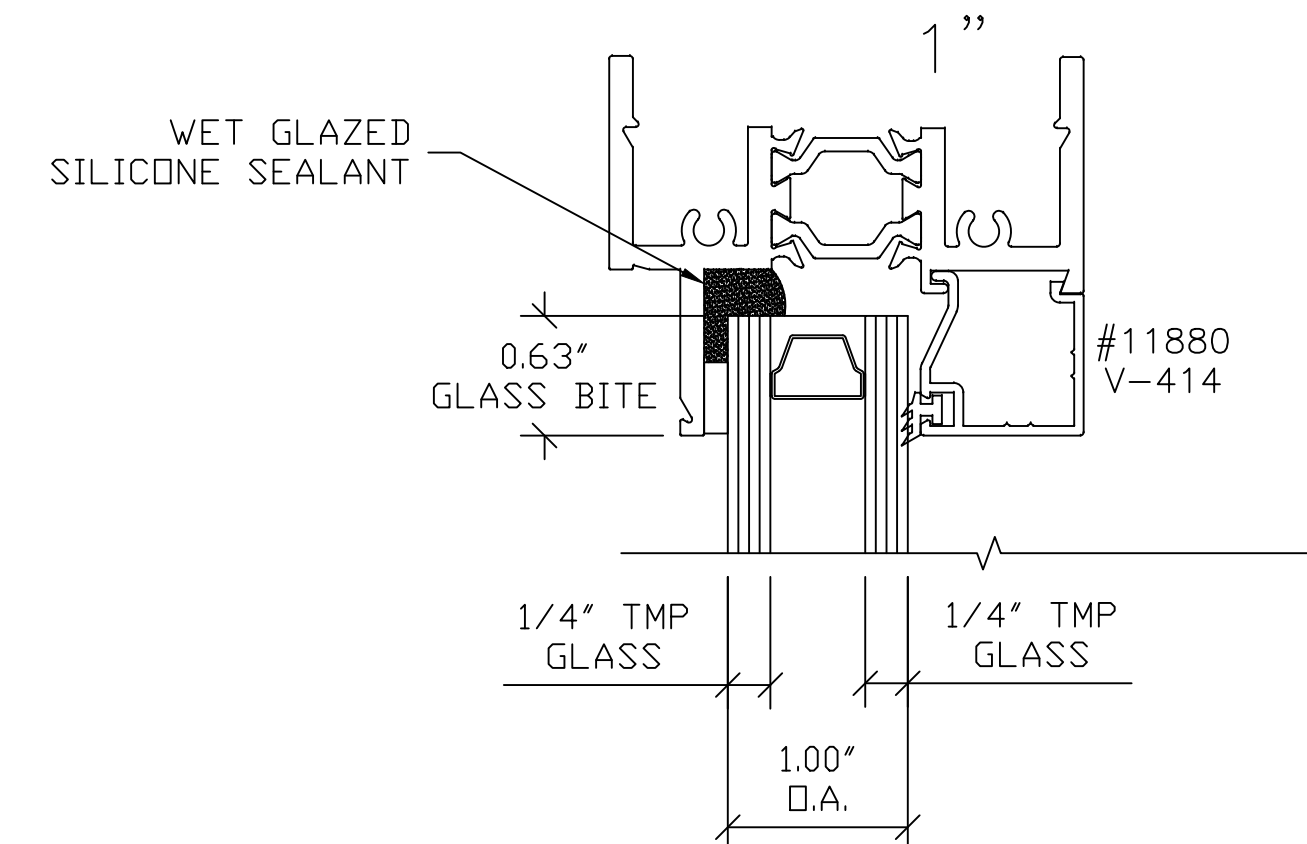

NOTE: "GLASS TYPE AND THICKNESS MAY VARY ACCORDING TO THE ASTM E1300 GLASS CHART REQUIREMENTS"

NOTE: DRAWINGS TO SCALE ON 24 X 36 PAPER ONLY

"Hermes F. Norberto  
Florida P.E. No. 75778  
1900 NE MIAMI CT, UNIT 2-15  
MIAMI, FL 33132  
FBPE Cert. of Authorization No. 29578"

**ALL SEASONS**  
COMMERCIAL DIV.


400 AMBASSADOR ROW  
LONGVIEW, TX 756043  
PHONE: (979) 823-6557  
FAX: (979) 823-1005

MEMO NO. 8096-10

DESCRIPTION:  
**E2500 FIXED FRAME  
BOM**


REVISIONS		
A	EDITED DETAILS TO 2010	2/13/14
B	ADDED E3250 ND E4000	5/7/14
C	UPDATE NOTES	11/23/20
D	CHANGE ADDRESSES	1/26/24


SCALE	DETAILS: FULL ELEV: 3/4" = 1"
DRAWN BY:	JKY
DATE DRAWN:	10/31/13
PAGE NO.	<b>4 OF 6</b>

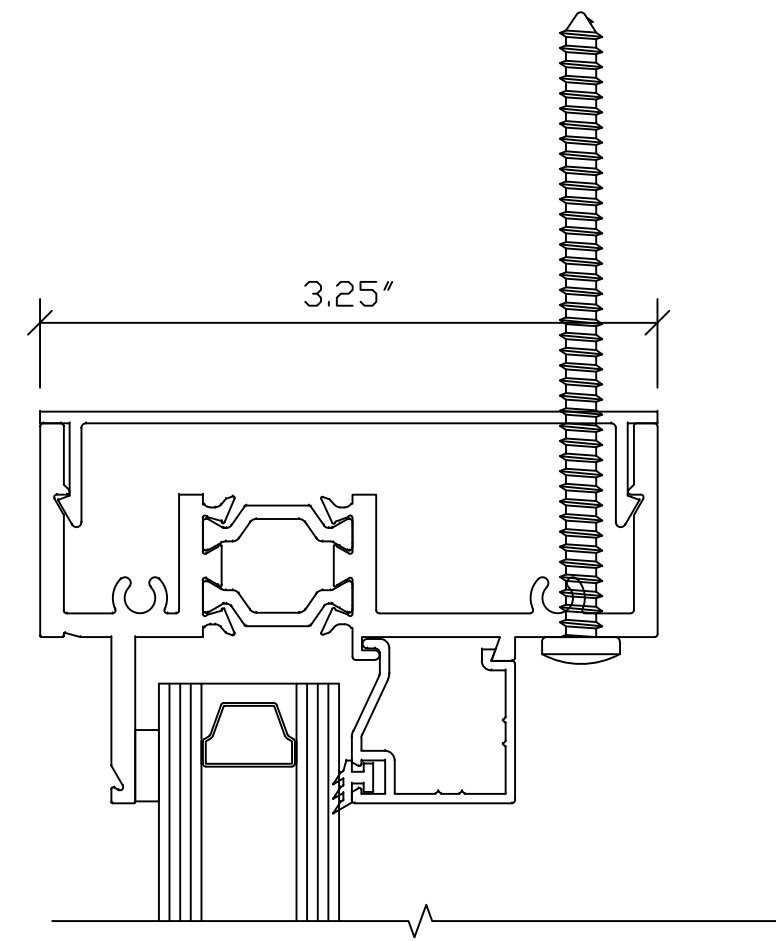

E3250 - 3/4" Frame window installation anchor placement shown. Reference previous pages for anchor type and spacing based on substrate installed into.

ITEM#	PART#	ITEM DESCRIPTION	MANUFACTURER/NOTES
WINDOW PARTS			
1	11871	FRAME EXTERIOR	6063-T5 ALUMINUM
2	12054	FRAME INTERIOR	6063-T5 ALUMINUM
3	11880	GLAZING BEAD	6063-T5 ALUMINUM
4	66108802	20mm THERMAL STRUT	ENSINGER
5	V-414	GLAZING VINYL	SOFT PVC
9		SHEAR CLIP	6063-T5 ALUMINUM
SEALS & SEALANT			
6	----	SEAM SEALANT	SCHNEE MOREHEAD 5504
MISC. FASTENERS			
7	66103392	8-15 X 1" PH PN HD CAD	FRAME ASSEMBLY SCREW
8	----	#10 X 3" PH PN HD	INSTALLATION ANCHOR

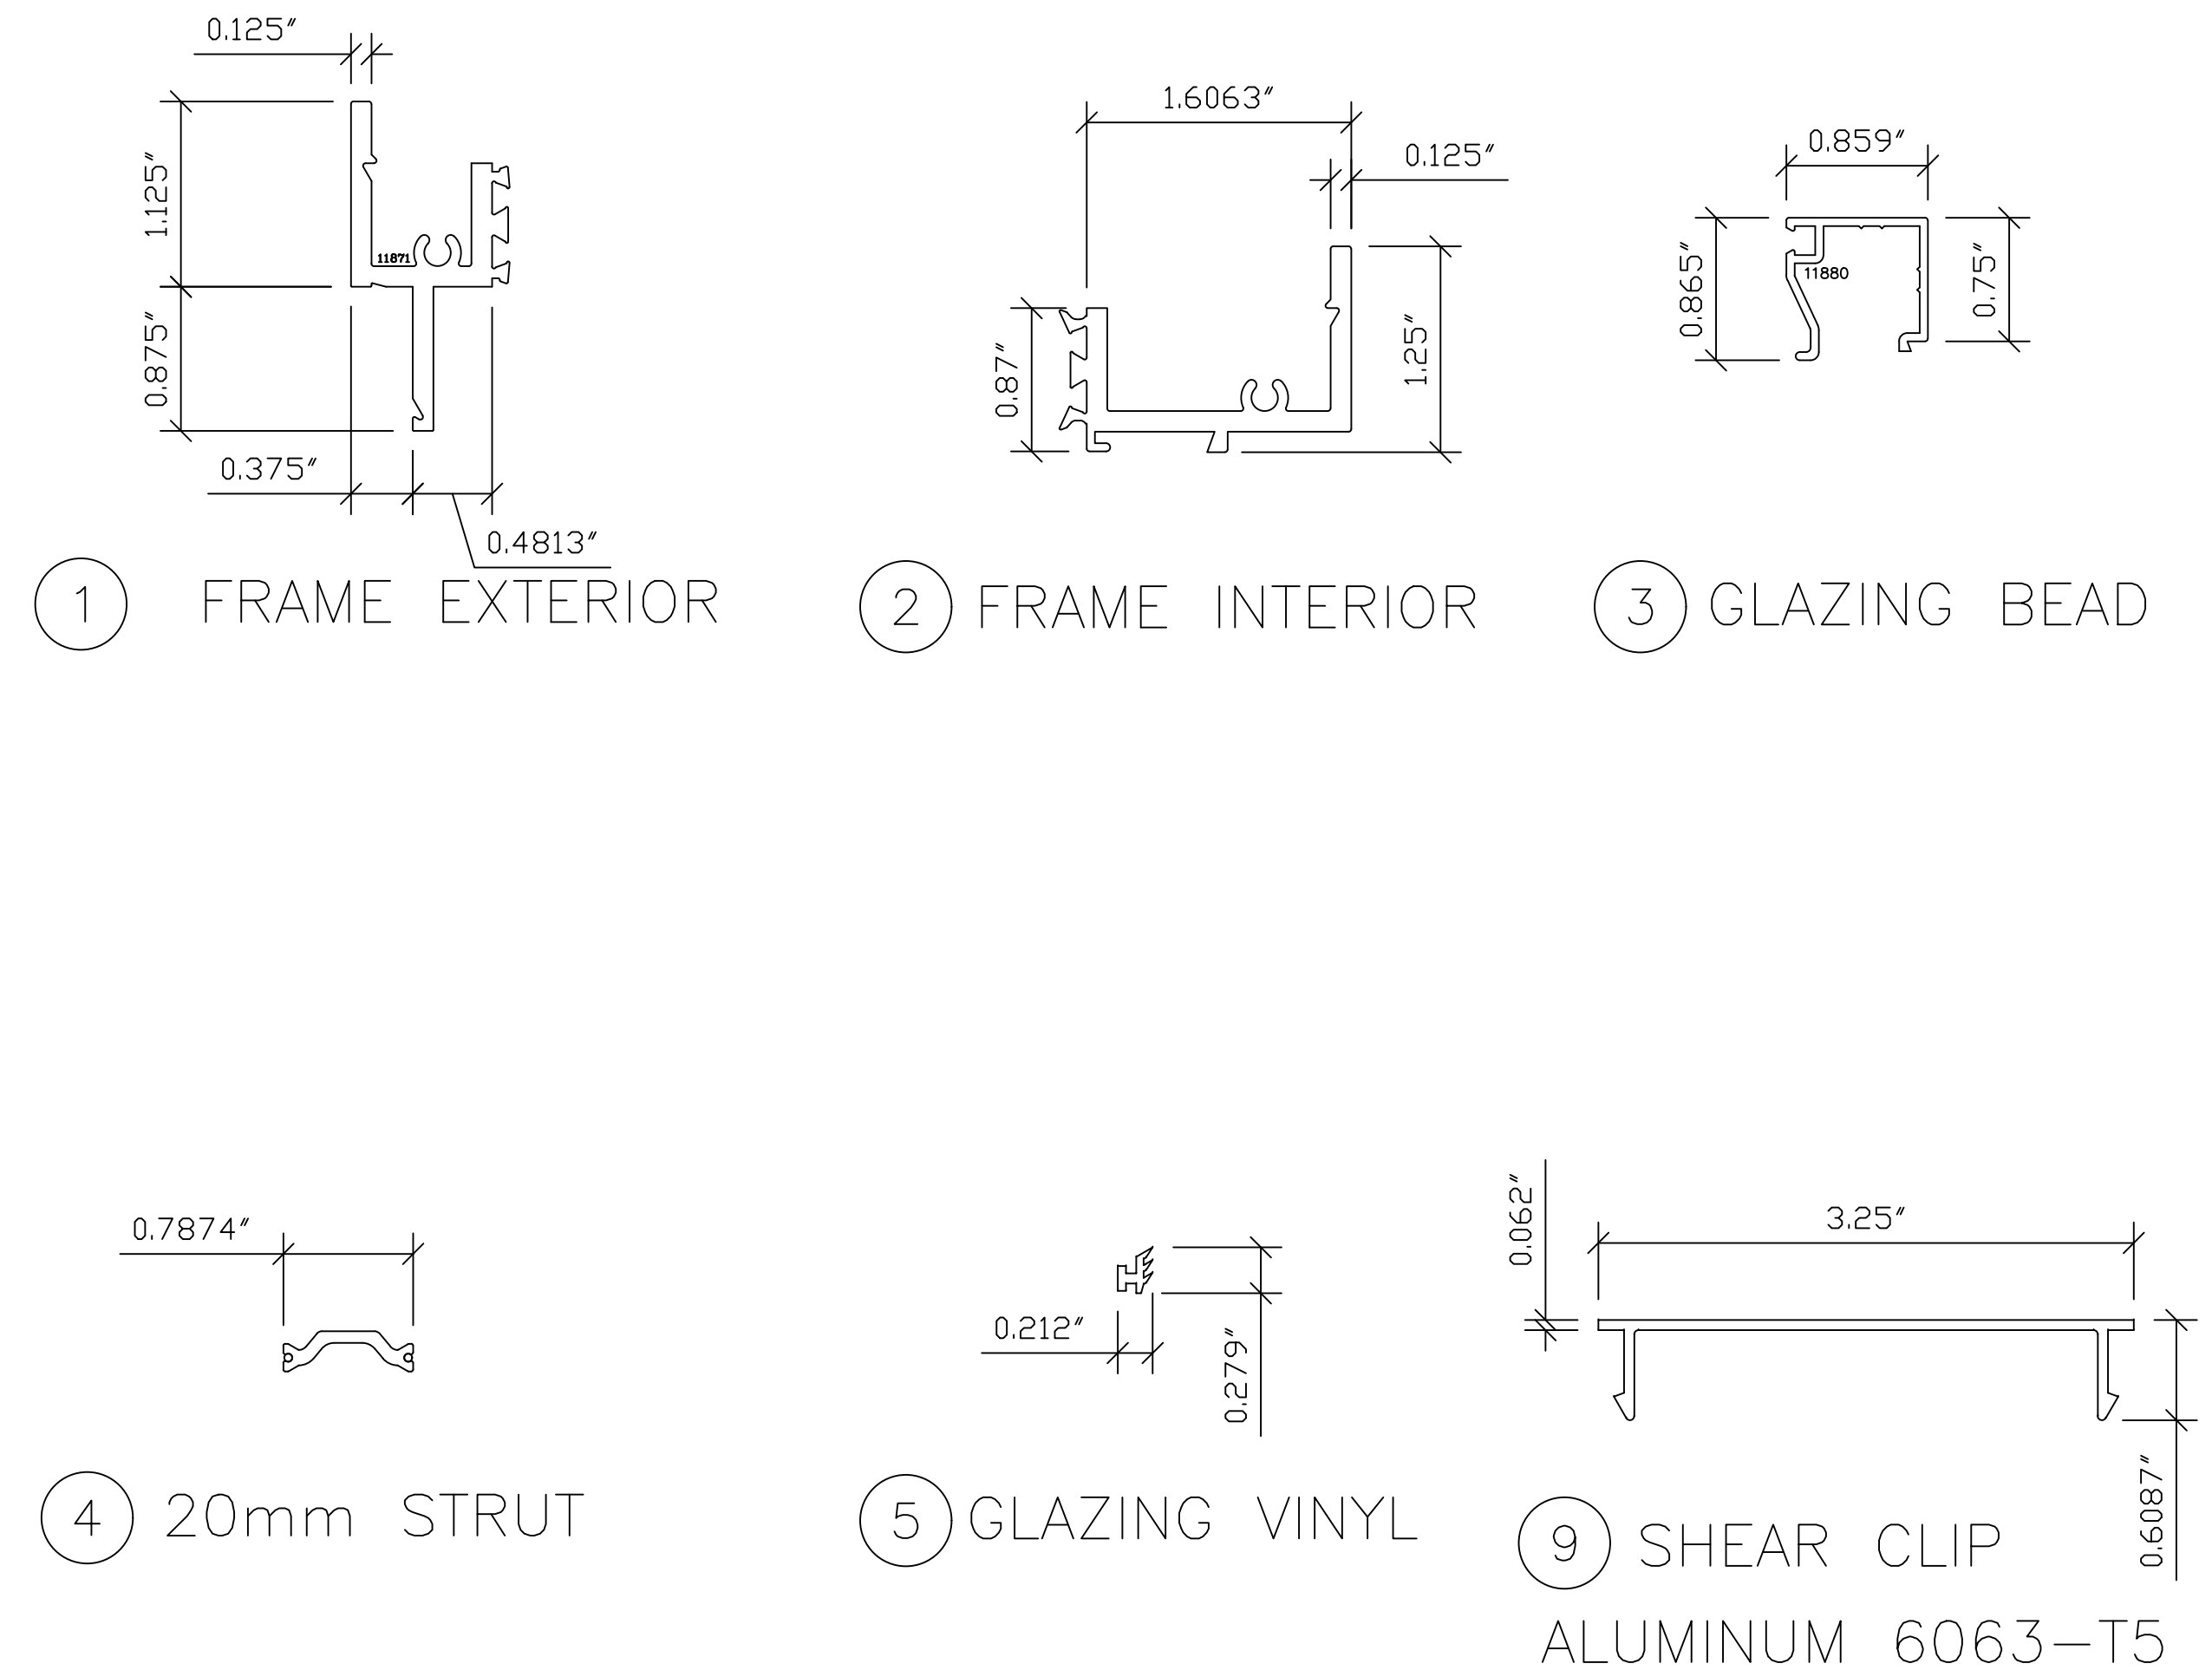

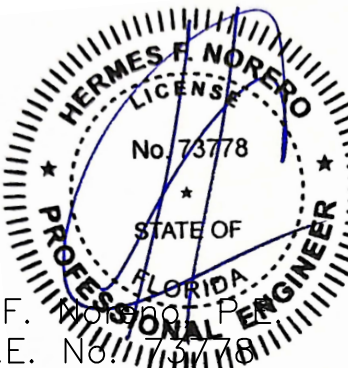  
 "Hermes F. Noroso  
 Florida P.E. No. 75778  
 1900 NE MIAMI CT, UNIT 2-15  
 MIAMI, FL 33132  
 FBPE Cert. of Authorization No. 29578"

  
**ALL SEASONS**  
**COMMERCIAL DIV.**

400 AMBASSADOR ROW      PHONE: (979) 823-6557  
 LOMGVIEW, TX 756043      FAX: (979) 823-1005

MEMO NO. 8096-10

DESCRIPTION:

**E3250 FIXED FRAME**  
**BOM**

REVISIONS

REVISION	DESCRIPTION	DATE
A	EDITED DETAILS TO 2010	2/13/14
B	ADDED E3250 AND E4000	5/7/14
C	UPDATE NOTES	11/23/20
D	CHANGE ADDRESSES	1/26/24


SCALE DETAILS: FULL ELEV: 3/4" = 1"

DRAWN BY: JKY

DATE DRAWN: 10/31/13


PAGE NO. 5 OF 6


NOTE: DRAWINGS TO SCALE ON 24 X 36 PAPER ONLY

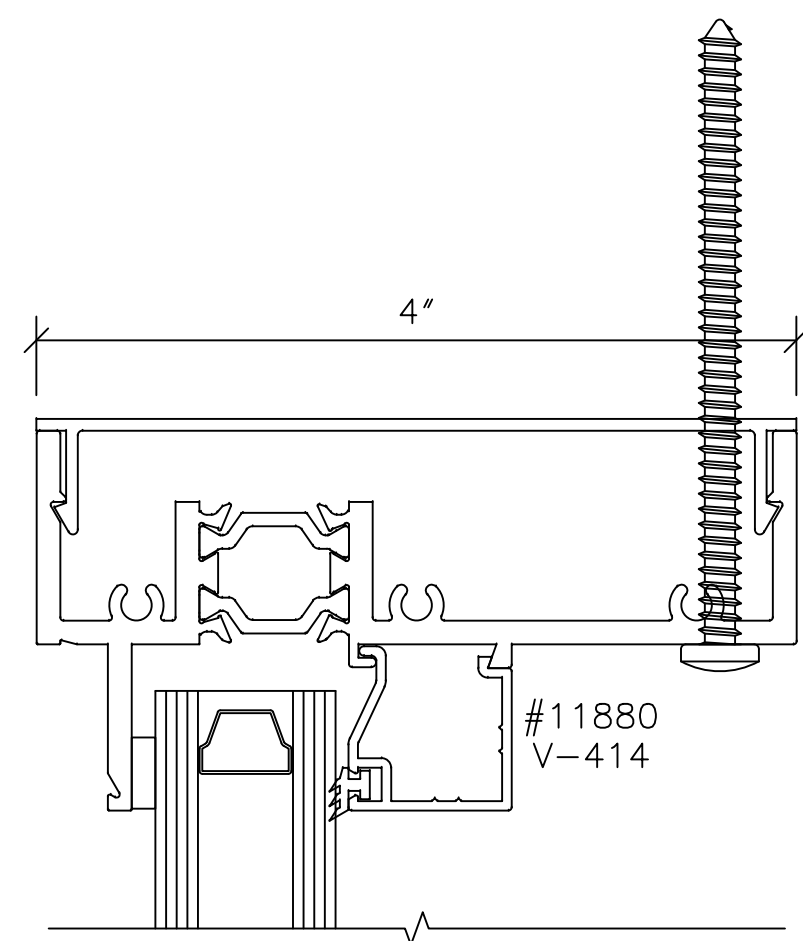

E4000 - 4" Frame window installation anchor placement shown. Reference previous pages for anchor type and spacing based on substrate installed into.

ITEM#	PART#	ITEM DESCRIPTION	MANUFACTURER/NOTES
WINDOW PARTS			
1	11871	FRAME EXTERIOR	6063-T5 ALUMINUM
2	12028	FRAME INTERIOR	6063-T5 ALUMINUM
3	11880	GLAZING BEAD	6063-T5 ALUMINUM
4	66108802	20mm THERMAL STRUT	ENSINGER
5	V-414	GLAZING VINYL	SOFT PVC
9		SHEAR CLIP	6063-T5 ALUMINUM
SEALS & SEALANT			
6	----	SEAM SEALANT	SCHNEE MOREHEAD 5504
MISC. FASTENERS			
7	66103392	8-15 X 1" PH PN HD CAD	FRAME ASSEMBLY SCREW
8	----	#10 X 3" PH PN HD	INSTALLATION ANCHOR

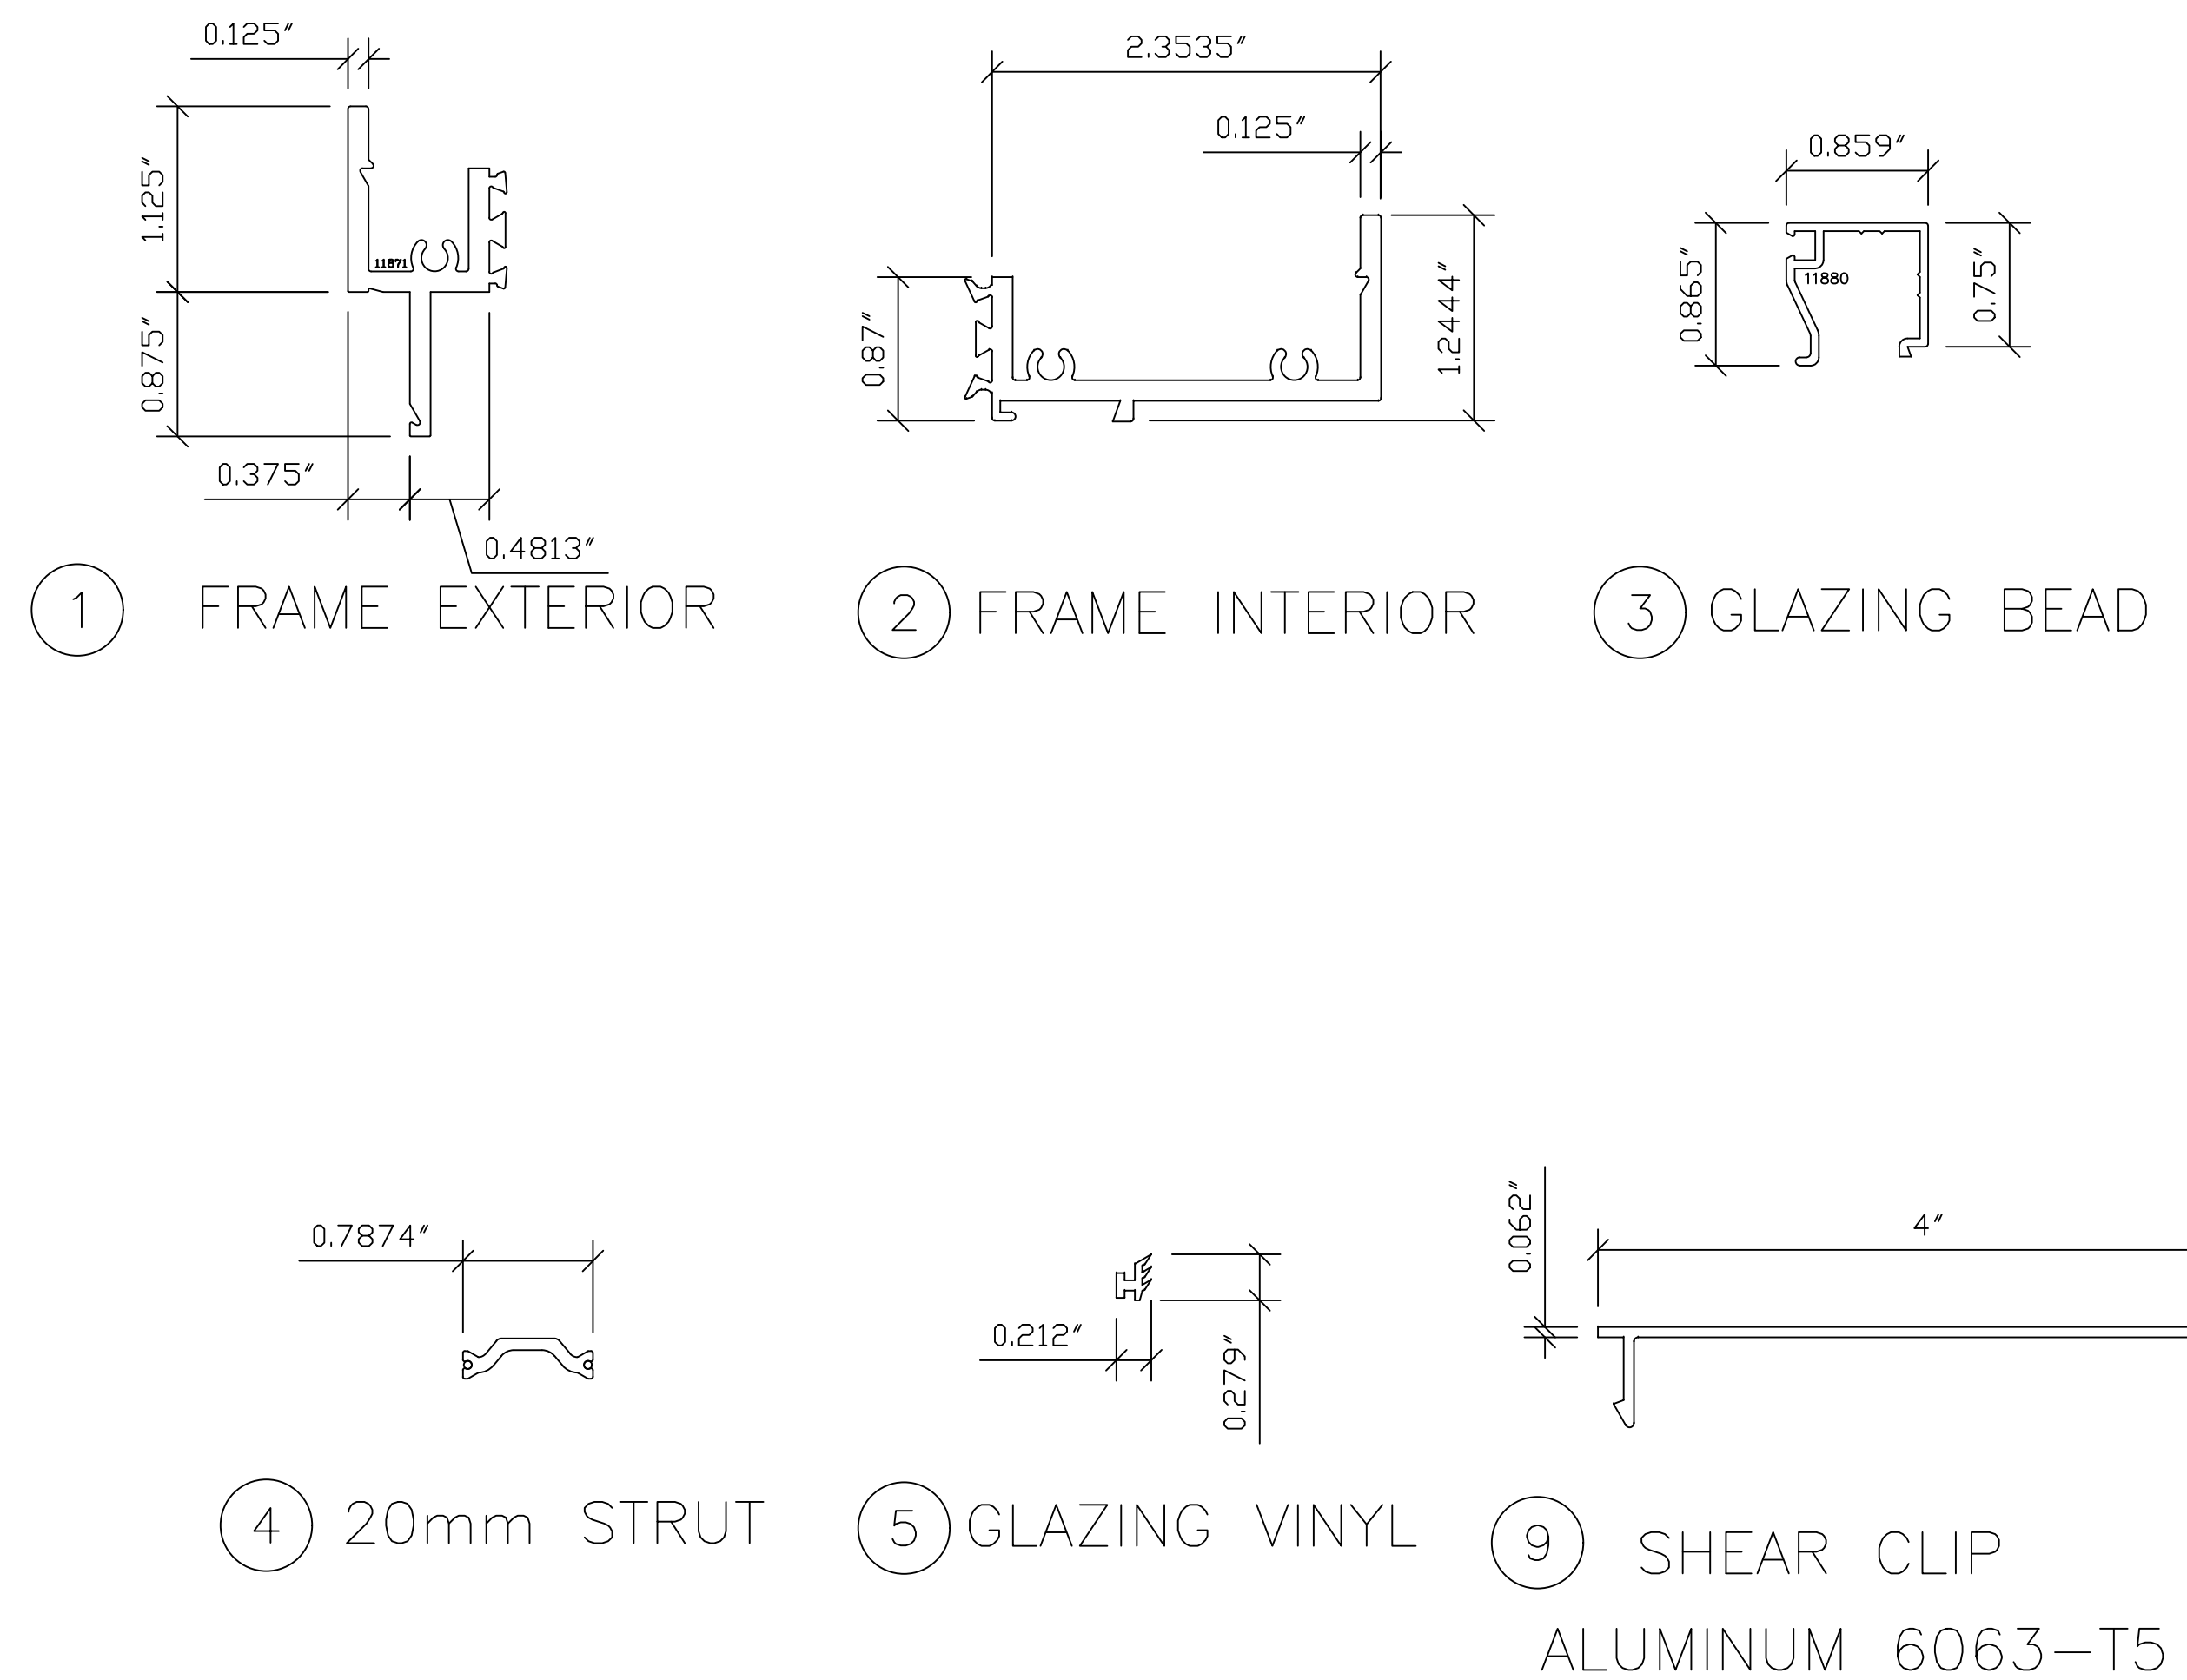

  
 "Hermes F. Norredo"  
 Florida P.E. No. 75778  
 1900 NE MIAMI CT, UNIT 2-15  
 MIAMI, FL 33132  
 FBPE Cert. of Authorization No. 29578"

**ALL SEASONS**  
**COMMERCIAL DIV.**

400 AMBASSADOR ROW      PHONE: (979) 823-6557  
 LOMGVIEW, TX 756043      FAX: (979) 823-1005

MEMO NO. 8096-10

DESCRIPTION:

**E4000 FIXED FRAME**  
**BOM**

REVISIONS

REVISION	DESCRIPTION	DATE
A	EDITED DETAILS TO 2010	2/13/14
B	ADDED E3250 AND E4000	5/7/14
C	UPDATE NOTES	11/23/20
D	CHANGE ADDRESSES	1/26/24

SCALE      DETAILS: FULL ELEV: 3/4" = 1"

DRAWN BY: JKY

DATE DRAWN: 10/31/13

PAGE NO. **6 OF 6**

NOTE: DRAWINGS TO SCALE ON 24 X 36 PAPER ONLY