


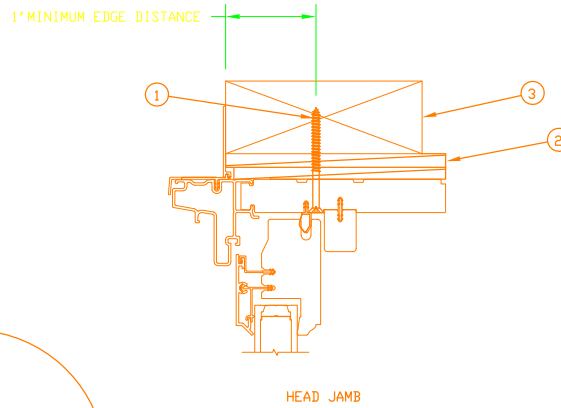
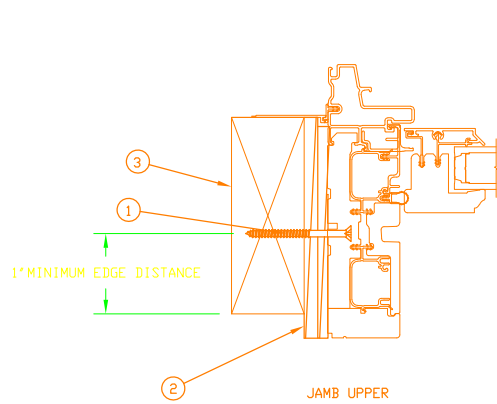
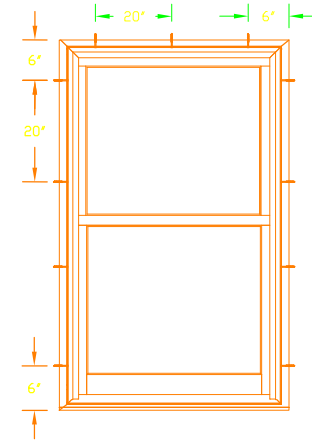


JAMB_SCREW_THROUGH_JAMB_INSTALLATION

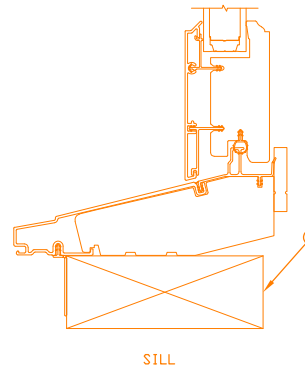

GLAZING DETAIL:
MEETS ASTM E1300

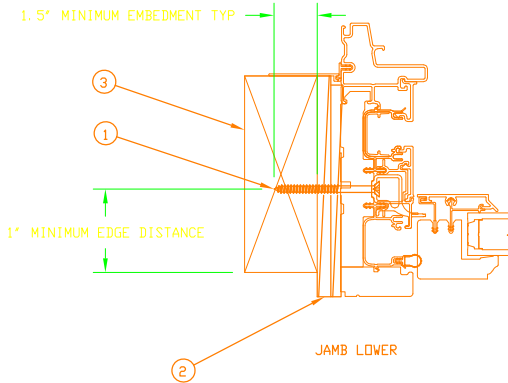

UNIT	MAX FRAME SIZE	DP RATING
UL DBLHNG G2	55 1/4 X 95 1/2	+35/-35

INSTALLATION METHOD:

- NON STRUCTURAL NAIL FIN OPTIONAL FOR PLACEMENT ONLY

NOTES:

- THIS PRINT IS FOR STRUCTURAL PERFORMANCE ONLY. FOR FLASHING & SEALING REQUIREMENTS, REFER TO THE INSTALLATION INSTRUCTIONS.
- SHIMS
- A SHIM MUST BE PLACED AT EACH SCREW LOCATION.
UNIT MUST NOT BE IN DIRECT CONTACT WITH EITHER CONCRETE OR TREATED BUCK MATERIAL.
- IF SHIM SPACE IS LESS THEN 1/4", WRAP THE UNIT ON ALL 4 SIDES WITH WINDOW FLASHING TAPE AS REQUIRED FOR A BARRIER BETWEEN THE UNIT AND CONCRETE OR TREATED LUMBER.
- IF CHEMICALLY TREATED LUMBER IS USED FOR BUCK MATERIAL, FASTENERS INTO THE BUCK MUST BE A MINIMUM OF 0.90 OZ/FT² ZINC HOT DIPPED GALVANIZED OR STAINLESS STEEL TYPE 304 OR 316.

CATEGORY:
DOUBLE HUNG

UNIT TYPE:
UDHG2

UNSPECIFIED TOLERANCES

DECIMALS: XX ± .03 XXX ± .012	ANGLE DEG: ± .5
LINEAL: + .125 - .000	FAB LINEAL: ± .125

MATERIAL:
NA

3	-----	2X WOOD BUCK BY OTHERS
2	-----	SHIM
1	-----	#8 X 3.000 WOOD SCREW
ITEM NO	REF NO	DESCRIPTION



RESEARCH & DEVELOPMENT

COLLECTION: ULTIMATE			
DWG TYPE: INSTALLATION		DESCRIPTION: SCREW THRU JAMB	
CHK:	SIZE: B	CLASS: MISC	DWG NO: 00130470
APP:	SCALE: NA	DATE: 11/16/2021	DWG BY: KOMPELIEN, SARA
			SHEET: 1 OF 1