




1. EVALUATED FOR USE IN LOCATIONS ADHERING TO THE FLORIDA BUILDING CODE AND WHERE PRESSURE REQUIREMENTS AS DETERMINED BY ASCE 7, MINIMUM DESIGN LOADS FOR BUILDINGS AND OTHER STRUCTURES, DOES NOT EXCEED THE DESIGN PRESSURES LISTED.
2. WHEN INSTALLED IN THE HIGH VELOCITY HURRICANE ZONE (HVHZ), HURRICANE PROTECTIVE SYSTEM (SHUTTERS) IS REQUIRED.
3. WHEN INSTALLED IN THE WIND-BORNE DEBRIS REGION, EXCLUDING THE HIGH VELOCITY HURRICANE ZONE (HVHZ), HURRICANE PROTECTIVE SYSTEM IS NOT REQUIRED ON PANELS WITH IMPACT GLASS, BUT IS REQUIRED ON PANELS WITH NON-IMPACT GLASS.
4. POLYURETHANE CORE FLAME SPREAD INDEX OF 50 AND SMOKE DEVELOPED INDEX OF 60 PER ASTM E84.

* COMPARATIVE TENSILE STRENGTH AFTER WEATHERING
4500 HOURS XENON ARC METHOD 1




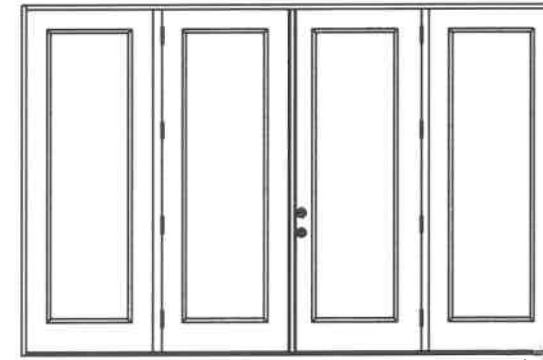


DOUBLE DOOR UNIT W/SIDELITES

		DESIGN PRESSURE RATING (1:1 OVERHANG OR WHERE NO WATER REQUIRED)		WHERE WATER INFILTRATION PERFORMANCE IS REQUIRED TO BE 15% OF DESIGN PRESSURE		
CONFIG	MAX WIDTH	INSWING	OUTSWING	BUMPER O/S	Z-SERIES O/S	HI DAM O/S
X	37.5"	+45.0 / -47.0	+47.0 / -47.0	+35.0 / -35.0	+40.0 / -40.0	+47.0 / -47.0
XX	74"	+45.0 / -47.0	+47.0 / -47.0	+35.0 / -35.0	+40.0 / -40.0	+47.0 / -47.0
OX or XO	75"	+45.0 / -47.0	+47.0 / -47.0	+35.0 / -35.0	+40.0 / -40.0	+47.0 / -47.0
OXO	112.5"	+45.0 / -47.0	+47.0 / -47.0	+35.0 / -35.0	+40.0 / -40.0	+47.0 / -47.0
OOXO	149"	+45.0 / -47.0	+47.0 / -47.0	+35.0 / -35.0	+40.0 / -40.0	+47.0 / -47.0

KURT BALTHAZOR
FLORIDA P.E.
#56533

DATE:	8/10/15
SCALE:	N.T.S.
DWG. BY:	SWS
CHK. BY:	
DRAWING NO.:	
DWG-MA-FL0183-15	
SHEET	1 OF 4

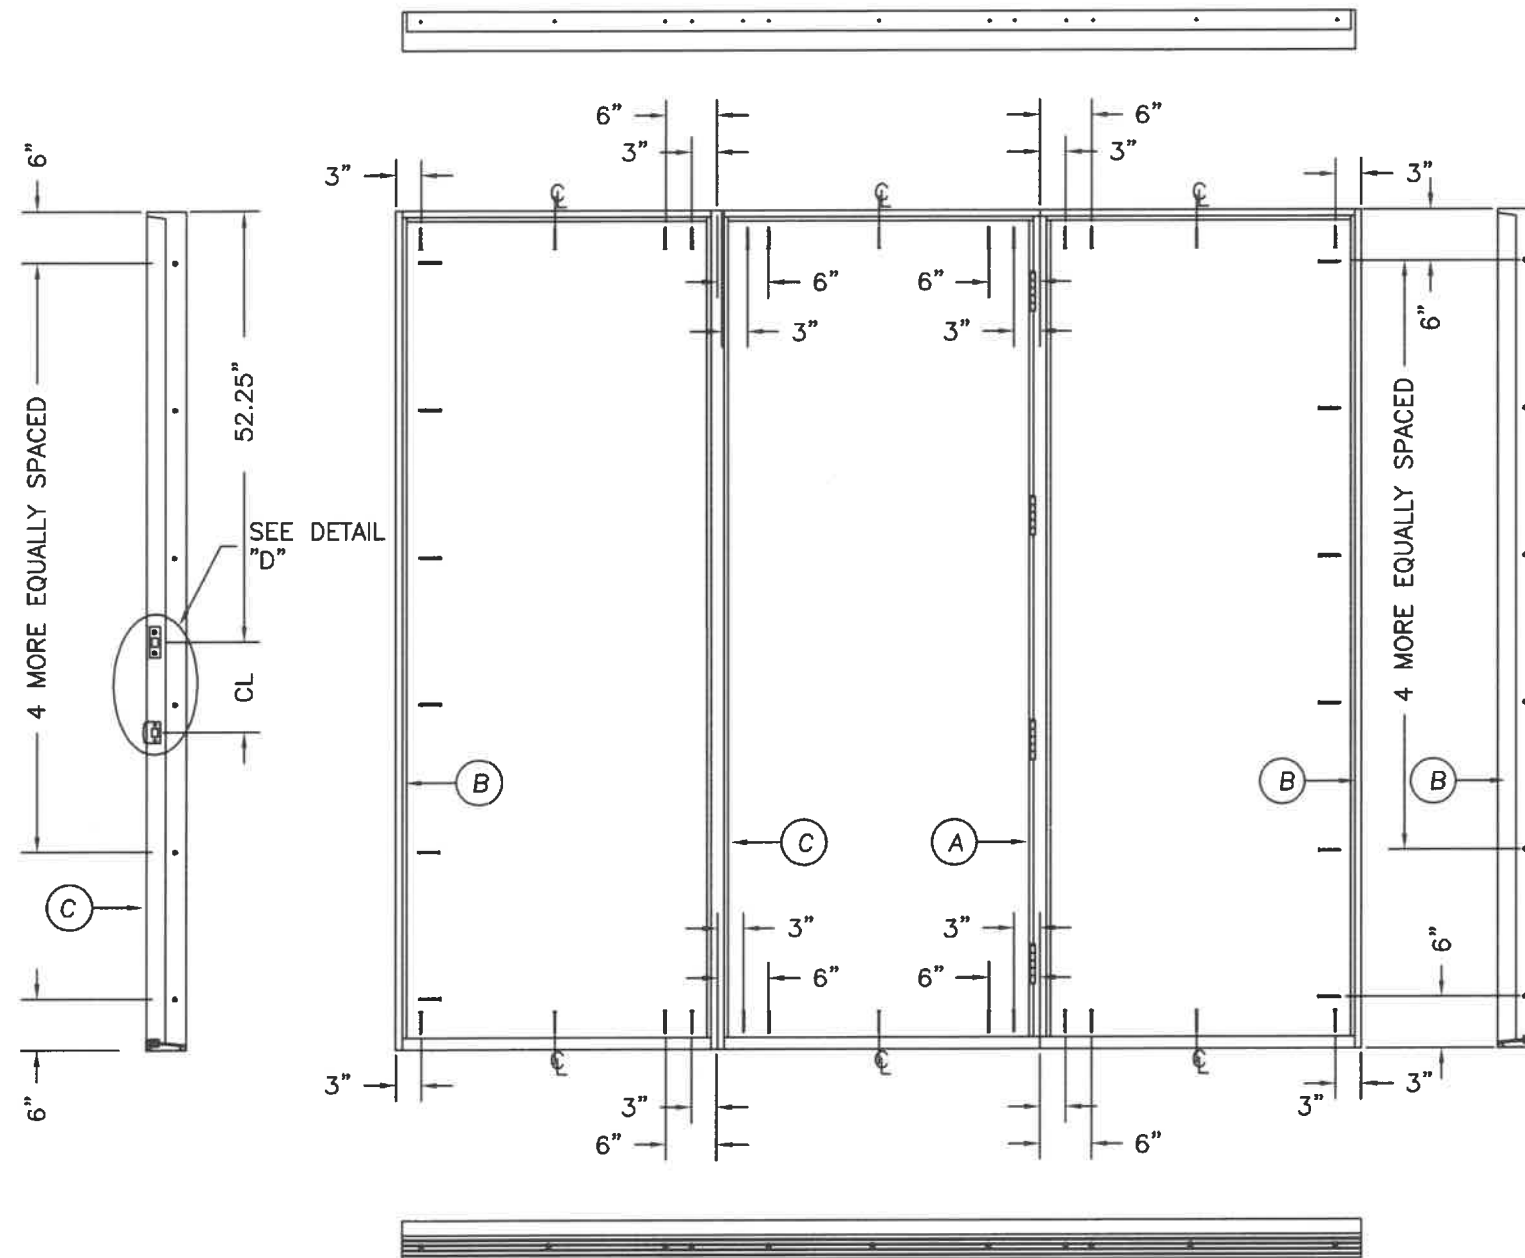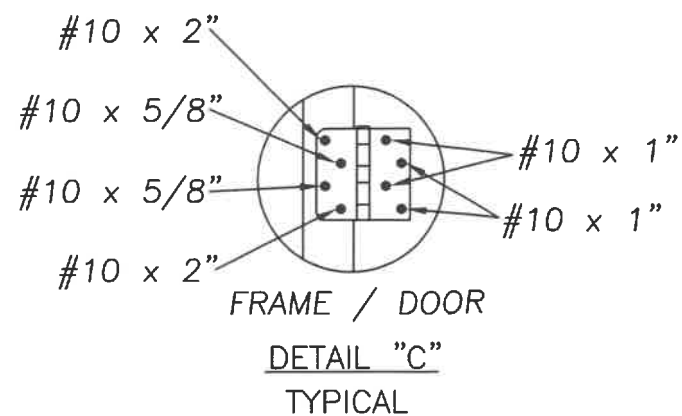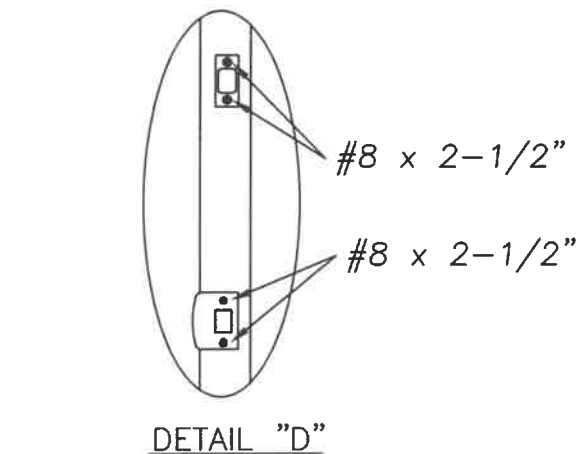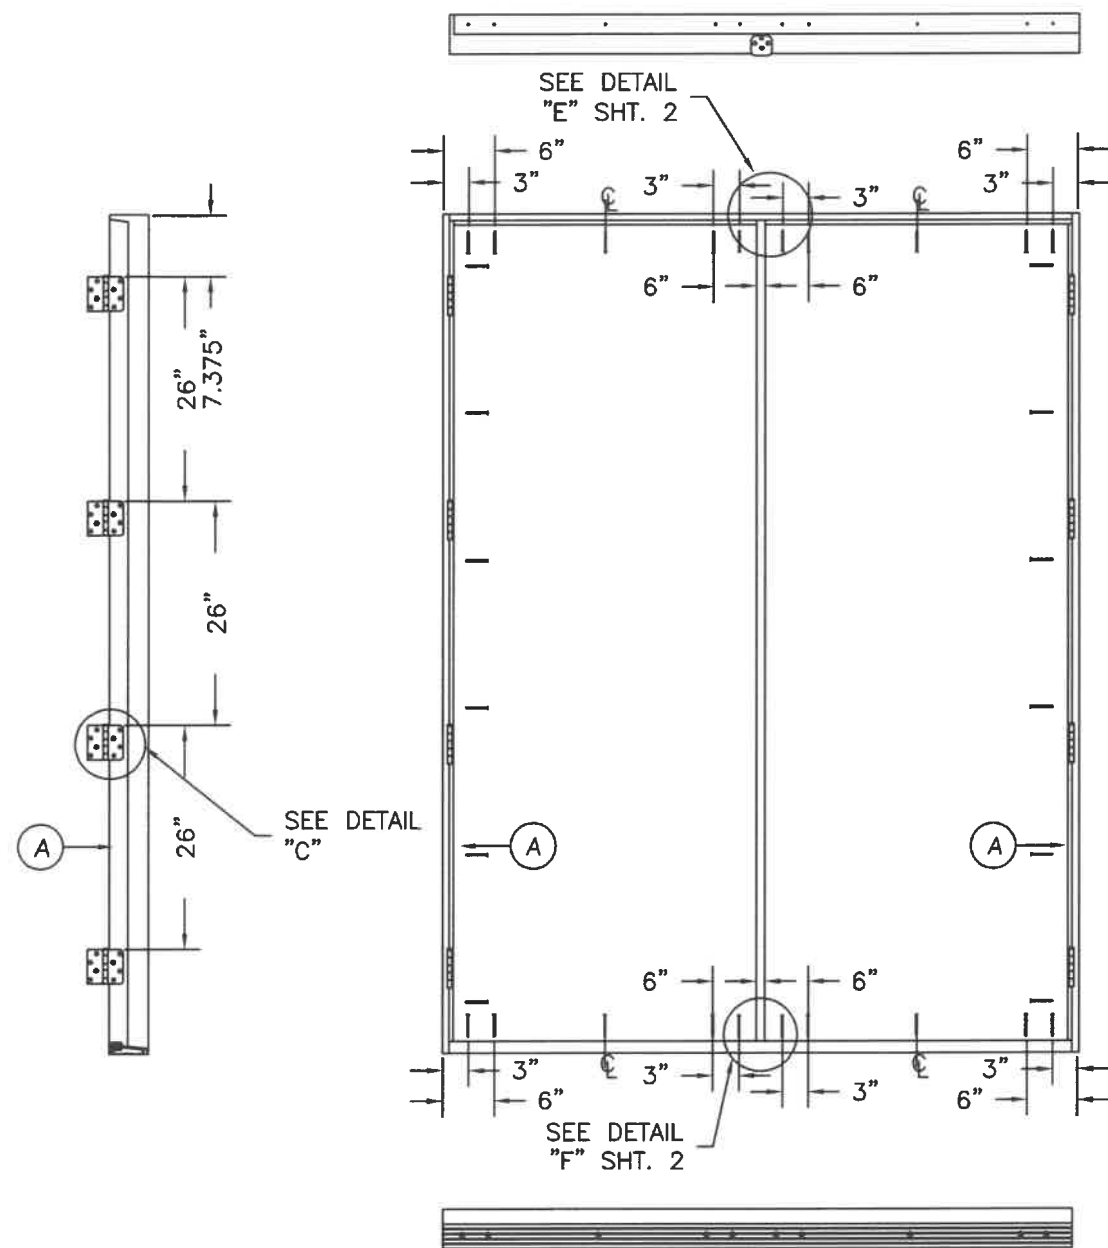

MASONITE INTERNATIONAL CORP. 1955 POWIS RD. WEST CHICAGO, IL 60185		PRODUCT: "EXTERIOR DOOR PRODUCT" 8'0" FIBERGLASS GLAZED DOUBLE DOOR UNIT	
		PART OR ASSEMBLY: ANCHORING LOCATIONS & DETAILS	
D C B A NO.	11/21/23 10/31/22 7/18/20 12/1/17 DATE	SWS SWS SWS SWS BY	REVISIONS
	INNERLAYER NOA TEXT CORRECTIONS ANCHOR CORRECTION MISC UPDATES	SWS SWS SWS SWS	REVISIONS
	11/21/23 10/31/22 7/18/20 12/1/17 DATE	SWS SWS SWS SWS	REVISIONS
	11/21/23 10/31/22 7/18/20 12/1/17 DATE	SWS SWS SWS SWS	REVISIONS
	11/21/23 10/31/22 7/18/20 12/1/17 DATE	SWS SWS SWS SWS	REVISIONS
DATE: 8/10/15 SCALE: N.T.S. DWG. BY: SWS CHK. BY: DRAWING NO.: DWG-MA-FL0183-15 SHEET 3 OF 4			

