

Max Frame	DP	IMPACT
60" X 72"	+50/-65	YES

- Installed Fastener Schedule:**
1. Seal flange/frame to substrate.
 2. Use #8 PH or greater fasteners through nail fin with sufficient length to penetrate a minimum of 1 1/2" into the wood framing. For 2X wood frame substrate (min. S.G. = 0.42).
 3. Host structure (wood buck, stud framing and opening) to be designed and anchored to properly transfer all loads to the structure. The host structure is the responsibility of the architect or engineer of record for the project of installation.

- General Notes:**
1. The product shown herein is designed, tested and manufactured to comply with the wind load criteria of the adopted International Building Code (IBC), the International Residential Code (IRC), the Florida Building Code (FBC) and the industry standard requirement for the stated conditions.
 2. Buck, framing and masonry by others and is responsibility of architect or engineer of record.
 3. All glazing shall conform to ASTM E1300.
 4. At minimum, glazing shall be 5.6mm annealed - 10mm airspace - 2.9mm annealed - 2.2mm SGP Interlayer by Dupont - 2.9mm annealed insulating glass.




This schedule addresses only the fasteners required to anchor the window to achieve the rated design pressure up to the size limitations noted. It is not intended as a guide to the installation process and does not address the sealing consideration that may arise in different wall conditions. For the complete installation procedure, see the instructions packaged with the window or go to www.jeld-wen.com.

DISCLAIMER:

This drawing and its contents are confidential and are not to be reproduced or copied in whole or in part or used or disclosed to others except as authorized by JELD-WEN Inc.

PROJECT ENGINEER:	DATE:	09/30/2015
DRAWN BY:	SCALE:	NTS
D. Vezo	TITLE:	Stiteline Clad Casement Fixed Window
CHECKED BY:		
K. Campbell		
APPROVED BY:		
D. Stokes		
PART/PROJECT No.:		
D009404		
IDENTIFIER No.:	PLANT NAME AND LOCATION:	
3JW2015-126		
	CAD DWG. No.:	
	REV.:	00
	SHEET:	

JELD-WEN 3737 LAKEPORT BLVD.
KLAMATH FALLS OR, 97601
PHONE: (800) 535-3936

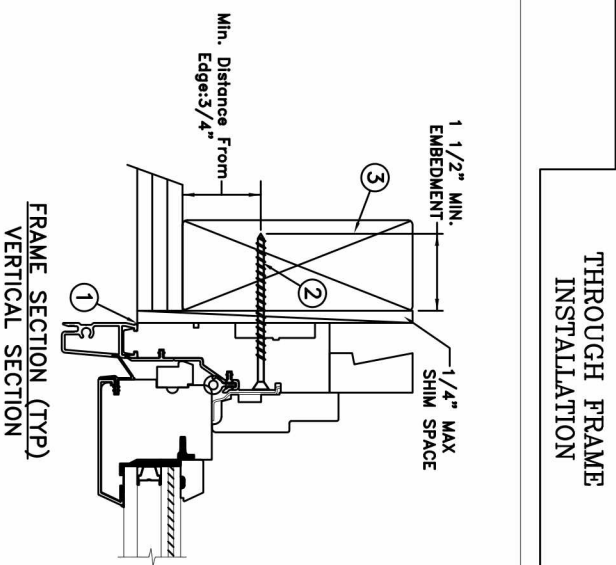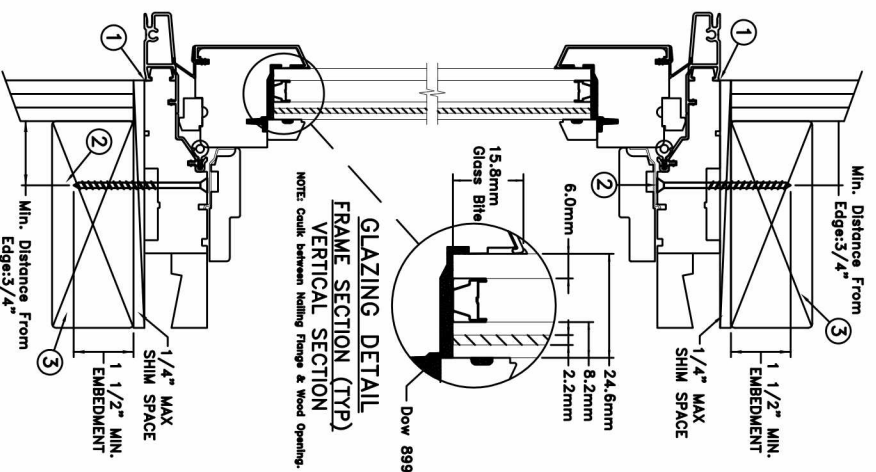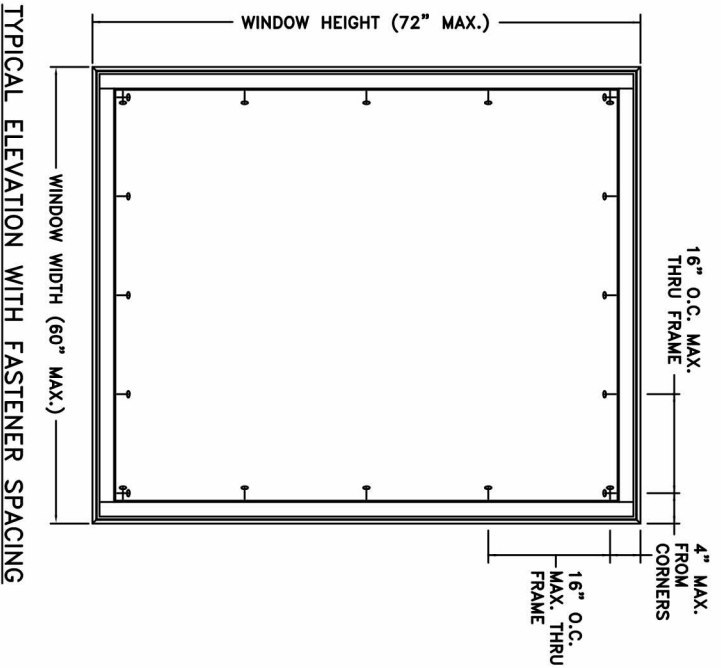

Max Frame	DP	IMPACT
60" X 72"	+50/-65	YES

Installed Fastener Schedule:

1. Seal flange/frame to substrate.
2. Use #8 PH or greater fasteners through nail fin with sufficient length to penetrate a minimum of 1 1/2" into the wood framing. For 2X wood frame substrate (min. S.G. = 0.42).
3. Host structure (wood buck, stud framing and opening) to be designed and anchored to properly transfer all loads to the structure. The host structure is the responsibility of the architect or engineer of record for the project of installation.

General Notes:

1. The product shown herein is designed, tested and manufactured to comply with the wind load criteria of the adopted International Building Code (IBC), the International Residential Code (IRC), the Florida Building Code (FBC) and the industry standard requirement for the stated conditions.
2. Buck, framing and masonry by others and is responsibility of architect or engineer of record.
3. All glazing shall conform to ASTM E1300.
4. At minimum, glazing shall be 6.0mm annealed - 10.41mm airspace - 3.0mm annealed - 2.2mm SGP Interlayer by Dupont - 3.0mm annealed insulating glass.

This schedule addresses only the fasteners required to anchor the window to achieve the rated design pressure up to the size limitations noted. It is not intended as a guide to the installation process and does not address the sealing consideration that may arise in different wall conditions. For the complete installation procedure, see the instructions packaged with the window or go to www.jeld-wen.com.


DISCLAIMER:

This drawing and its contents are confidential and are not to be reproduced or copied in whole or in part or used or disclosed to others except as authorized by JELD-WEN Inc.



PROJECT ENGINEER:	DATE:	09/30/2015
DRAWN BY:	SCALE:	NTS
D. Vezo	TITLE:	Stiline Clad Casement Fixed Window
CHECKED BY:		
K. Campbell		
APPROVED BY:		
D. Stokes		
PART/PROJECT No.:		
D009404		
IDENTIFIER No.:	PLANT NAME AND LOCATION:	
3JW2015-126		
	CAD DWG. No.:	
	REV:	00
	SHEET	

JELD-WEN

3737 LAKEPORT BLVD.
KLAMATH FALLS OR, 97601
PHONE: (800) 535-3936

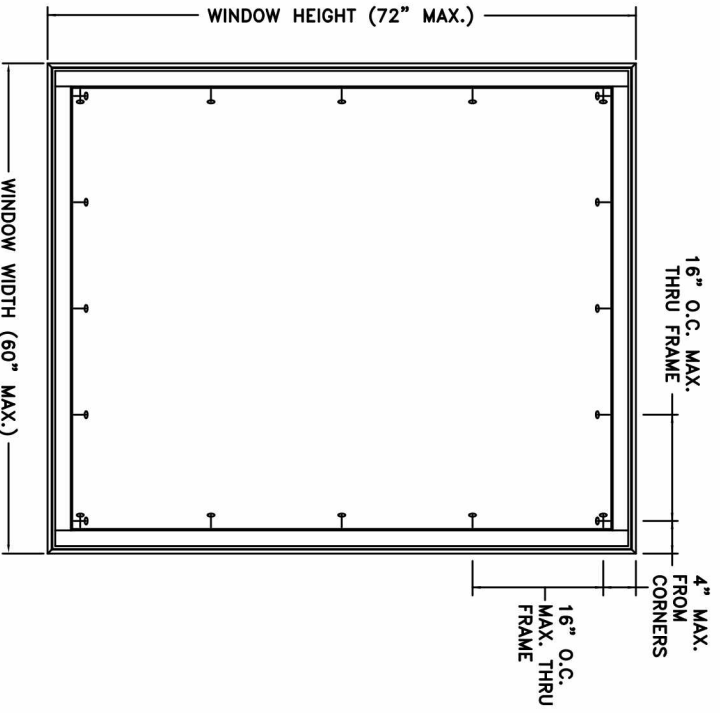

TYPICAL ELEVATION WITH FASTENER SPACING

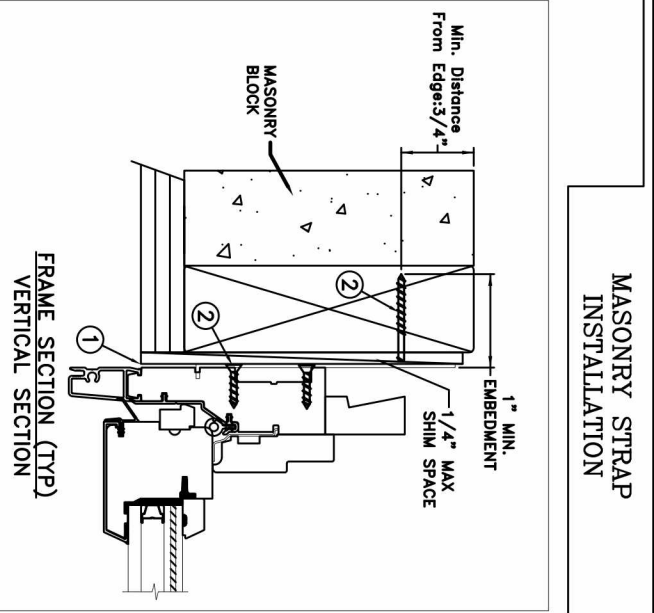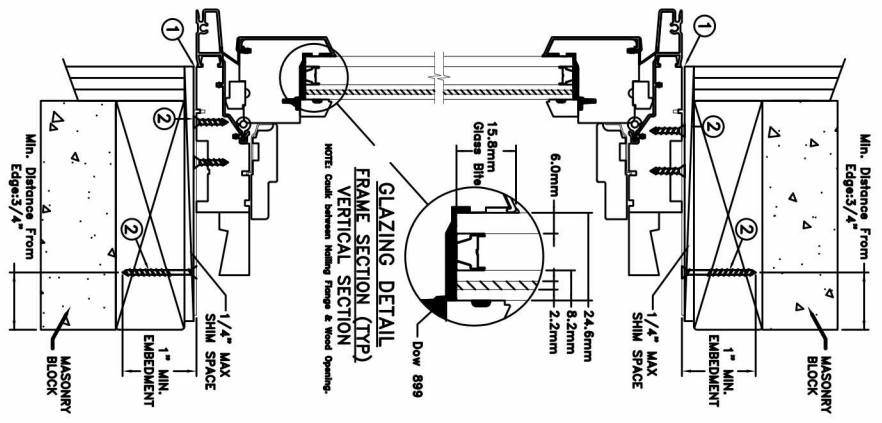

Max Frame	DP	IMPACT
60" X 72"	+50/-65	YES

- Installed Fastener Schedule:**
1. Seal flange/frame to substrate.
 2. Install masonry straps to wood frame using #8 corrosion resistant fasteners no more than 4" from each corner and 16" o.c. along the jambs and head. Bend straps around buck and secure with #8 fastener thru masonry strap into buck. Fasteners must be long enough to penetrate at least 1" into framing members.
 3. Host structure (wood buck, stud framing and opening) to be designed and anchored to properly transfer all loads to the structure. The host structure is the responsibility of the architect or engineer of record for the project of installation.

- General Notes:**
1. The product shown herein is designed, tested and manufactured to comply with the wind load criteria of the adopted International Building Code (IBC), the International Residential Code (IRC), the Florida Building Code (FBC) and the industry standard requirement for the stated conditions.
 2. Buck, framing and masonry by others and is responsibility of architect or engineer of record.
 3. All glazing shall conform to ASTM E1300.
 4. At minimum, glazing shall be 6.0mm annealed - 10.41mm airspace - 3.0mm annealed - 2.2mm SGP Interlayer by Dupont - 3.0mm annealed insulating glass.

This schedule addresses only the fasteners required to anchor the window to achieve the rated design pressure up to the size limitations noted. It is not intended as a guide to the installation process and does not address the sealing consideration that may arise in different wall conditions. For the complete installation procedure, see the instructions packaged with the window or go to www.jeld-wen.com.

DISCLAIMER:
This drawing and its contents are confidential and are not to be reproduced or copied in whole or in part or used or disclosed to others except as authorized by JELD-WEN Inc.

PROJECT ENGINEER:	DATE:	09/30/2015
DRAWN BY:	SCALE:	NTS
D. Vezo	TITLE:	
CHECKED BY:	PART/PROJECT No.:	
K. Campbell	D009404	
APPROVED BY:	PLANT NAME AND LOCATION:	
D. Stokes	CAD DWG. No.:	
IDENTIFIER No.:	REV:	00
SIW2015-126	SHEET	

JELD-WEN 3737 LAKEPORT BLVD.
KLAMATH FALLS OR, 97601
PHONE: (541) 882-3451

Steline Clad Casement Fixed Window