

Max Frame	DP	IMPACT
75 1/4 X 95 1/2	+50/-55	YES

General Notes:

- The product shown herein is designed, tested and manufactured to comply with the wind load criteria of the adopted International Building Code (IBC), the International Residential Code (IRC), the Florida Building Code (FBC) and the industry standard requirement for the stated conditions.
- Buck, framing and masonry by others and its responsibility of architect or engineer of record.
- All glazing shall conform to ASTM E1300.
- At minimum, glazing shall be 4.0mm tempered - 13.0mm airspace - 3.0mm annealed - 2.29mm PVB Interlayer by Dupont - 3.0mm annealed glass.

Installation Notes:

- Seal flange/frame to substrate. Sill shall be set on a continuous serpentine bead of structural grade silicone caulk (typ.).
- Use #8 PH or greater fastener through the nailfin on head jamb and side jambs with sufficient length to penetrate a minimum of 1 1/2" into the wood framing. For 2x wood frame substrate (min. S.G. = 0.42)
- Host structure (wood buck, masonry, steel) to be designed and anchored to properly transfer all loads to the structure. The host structure is the responsibility of the architect or engineer of record for the project of installation.




This schedule addresses only the fasteners required to anchor the window to achieve the rated design pressure and impact performance (where applicable) up to the size limitations noted. It is not intended as a guide to the installation process and does not address he sealing consideration that may arise in different wall conditions. For the complete installation procedure, see the instructions packaged with the window or go to www.jeld-wen.com.

DISCLAIMER:

This drawing and its contents are confidential and are not to be reproduced or copied in whole or in part or used or disclosed to others except as authorized by JELD-WEN Inc.

PROJECT ENGINEER:	DATE:	6/30/2016		3737 Lakeport Blvd Klamath Falls, OR, 97601 Phone: (800) 535-3936
DRAWN BY:	SCALE:	NTS		
CHECKED BY:	TITLE:	Site/line Clad Outswing 2 Panel Patio Door		
APPROVED BY:	PART/PROJECT No.:	D011241		
IDENTIFIER NO.:	PLANT NAME AND LOCATION:	Hawkins, WI		
	CAD DWG. No.:	Site/lineOSCLSPD Cert		
	REV.:	A		
	SHEET:			

'AS TESTED'

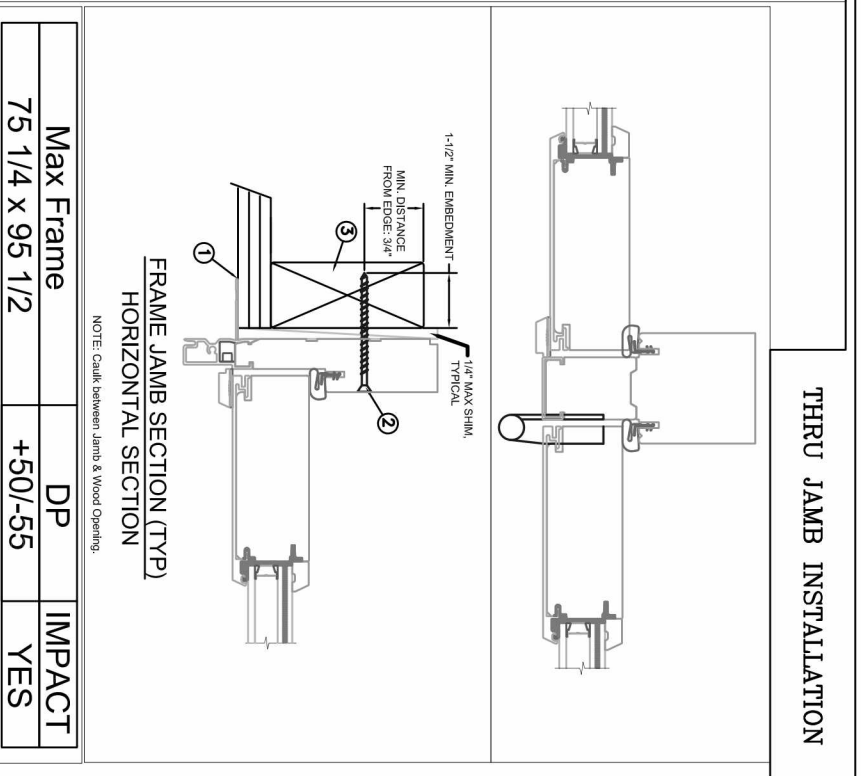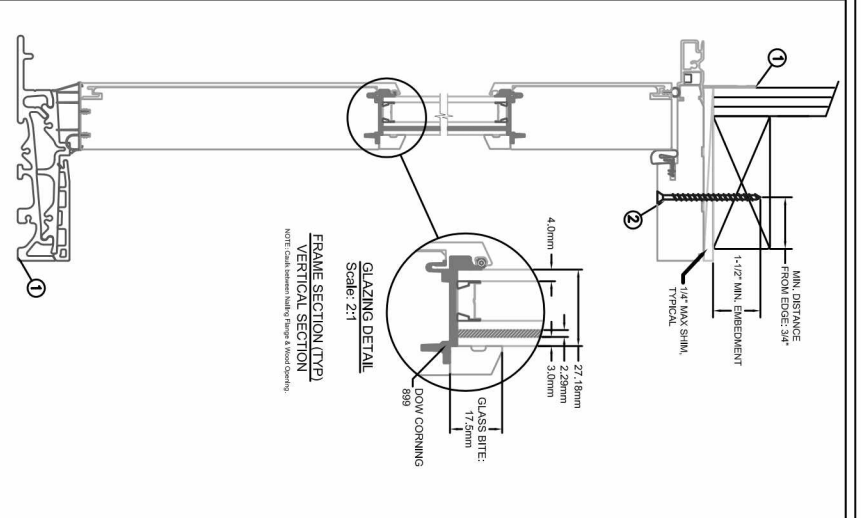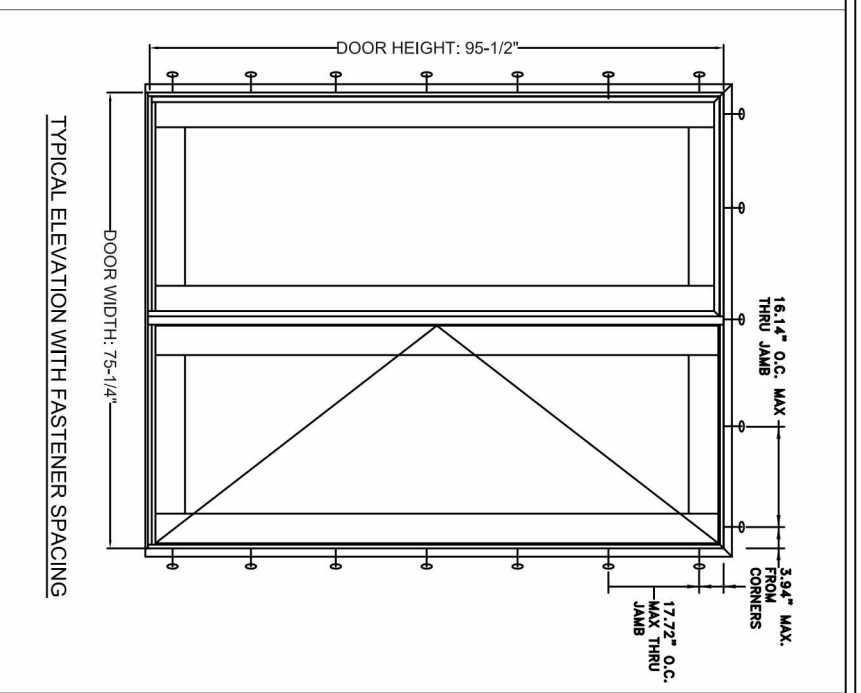

Max Frame	DP	IMPACT
75 1/4 X 95 1/2	+50/-55	YES

- Installation Notes:**
1. Seal flange/frame to substrate. Sill shall be set on a continuous serpentine bead of structural grade silicone caulk (typ.).
 2. Use #8 PH or greater fastener through the head & side jambs with sufficient length to penetrate a minimum of 1 1/2" into the wood framing. For 2x wood frame substrate (min. S.G. = 0.42)
 3. Host structure (wood buck, masonry, steel) to be designed and anchored to properly transfer all loads to the structure. The host structure is the responsibility of the architect or engineer of record for the project of installation.




- General Notes:**
1. The product shown herein is designed, tested and manufactured to comply with the wind load criteria of the adopted International Building Code (IBC), the International Residential Code (IRC), the Florida Building Code (FBC), and the Industry standard requirement for the stated conditions.
 2. Buck, framing and masonry by others and is responsibility of architect or engineer of record.
 3. All glazing shall conform to ASTM E1300.
 4. At minimum, glazing shall be 4.0mm tempered - 13.0mm annealed - 3.0mm annealed - 2.29mm PVB Interlayer by Dupont - 3.0mm annealed glass.

This schedule addresses only the fasteners required to anchor the window to achieve the rated design pressure and impact performance (where applicable) up to the size limitations noted. It is not intended as a guide to the installation process and does not address he sealing consideration that may arise in different wall conditions. For the complete installation procedure, see the instructions packaged with the window or go to www.jeld-wen.com.

DISCLAIMER:

This drawing and its contents are confidential and are not to be reproduced or copied in whole or in part or used or disclosed to others except as authorized by JELD-WEN Inc.

PROJECT ENGINEER:	DATE:	6/30/2016		3737 Lakeport Blvd Klamath Falls, OR, 97601 Phone: (800) 535-3936
DRAWN BY:	SCALE:	NTS		
J.HAWKINS	TITLE:	Site/line Clad OutSwing 2 Panel Patio Door		
CHECKED BY:	APPROVED BY:	D.STOKES	CAD DWG. NO.:	REV.:
C.GRAETSCH	D.STOKES		Site/lineOSCLSPD Cert	A
PART/PROJECT No.:	IDENTIFIER NO.			
D011241	Hawkins, WI			
'AS TESTED'				

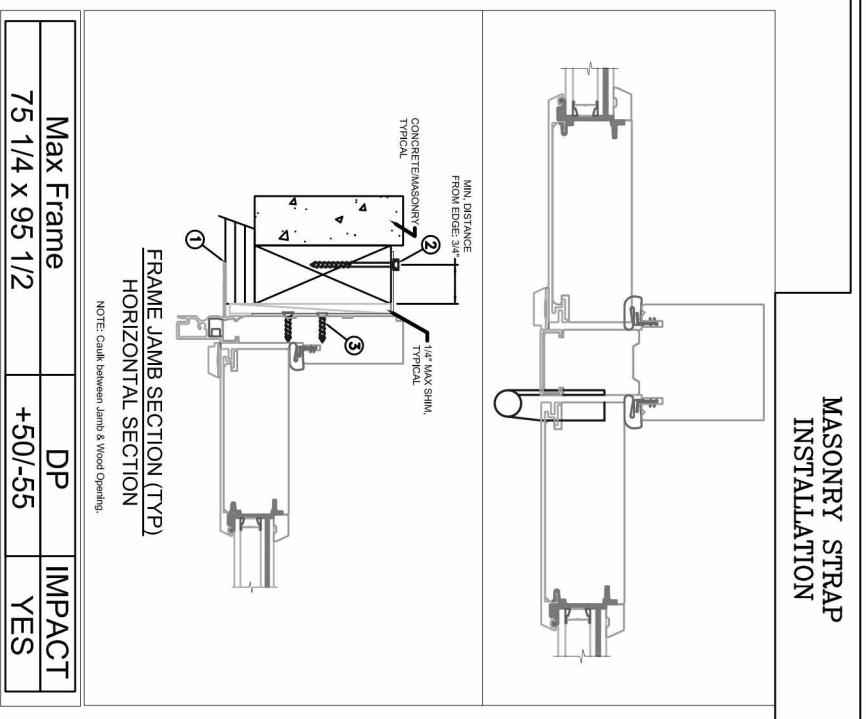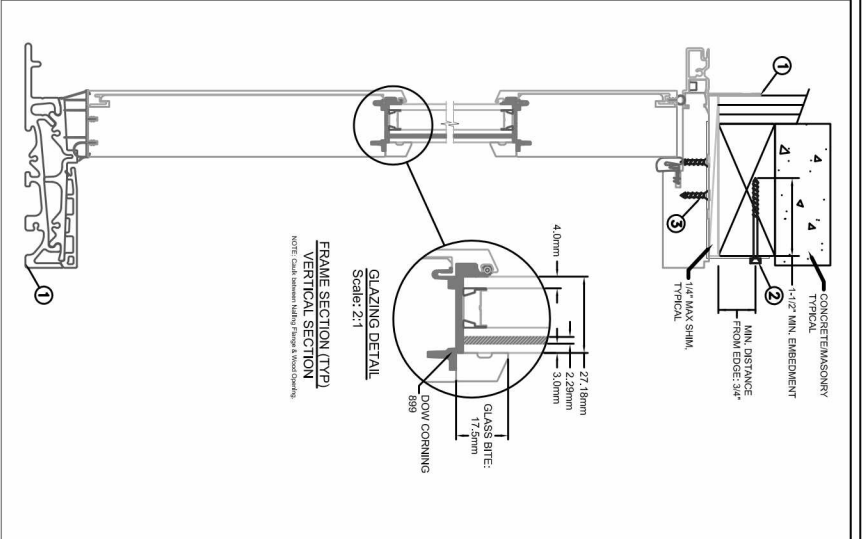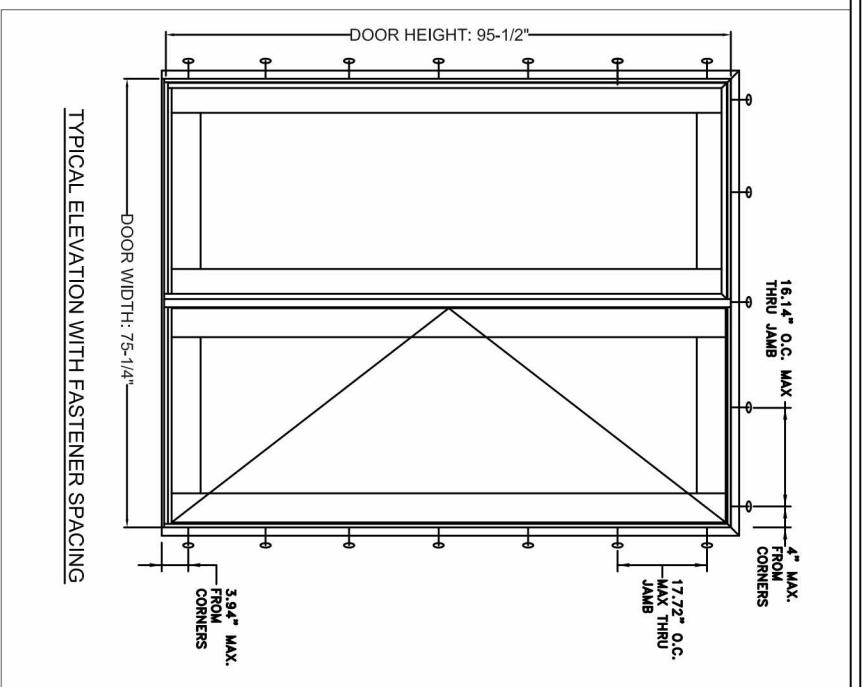

- Installation Notes:**
1. Seal flange/frame to substrate. Sill shall be set on a continuous serpentine bead of structural grade silicone caulk (typ.).
 2. Use #8 PFH or larger fasteners through masonry strap with sufficient length to penetrate a minimum of 1 1/2" into the masonry or buck.. For wood (min. S.G. = 0.42).
 3. Use #8 PFH or larger fasteners through masonry strap into jamb without penetrating through the jamb into product causing visibility or collateral damage to product.
 4. Host structure (wood buck, masonry, steel) to be designed and anchored to properly transfer all loads to the structure. The host structure is the responsibility of the architect or engineer of record for the project of installation.

- General Notes:**
1. The product shown herein is designed, tested and manufactured to comply with the wind load criteria of the adopted International Building Code (IBC), the International Residential Code (IRC), the Florida Building Code (FBC) and the industry standard requirement for the stated conditions.
 2. Buck, framing and masonry by others and its responsibility of architect or engineer of record.
 3. All glazing shall conform to ASTM E1300.
 4. At minimum, glazing shall be 4.0mm tempered - 13.0mm airspace - 3.0mm annealed - 2.29mm PVB Interlayer by Dupont - 3.0mm annealed glass.

This schedule addresses only the fasteners required to anchor the window to achieve the rated design pressure and impact performance (where applicable) up to the size limitations noted. It is not intended as a guide to the installation process and does not address the sealing consideration that may arise in different wall conditions. For the complete installation procedure, see the instructions packaged with the window or go to www.jeld-wen.com.

DISCLAIMER:
This drawing and its contents are confidential and are not to be reproduced or copied in whole or in part or used or disclosed to others except as authorized by JELD-WEN Inc.

PROJECT ENGINEER: J.HAWKINS	DATE: 6/30/2016	JELD-WEN	3737 Lakeport Blvd Klamath Falls, OR, 97601 Phone: (800) 535-3936
DRAWN BY: C.GRAETSCH	SCALE: NTS		
CHECKED BY: D.STOKES	TITLE: Site/line Clad Outswing 2 Panel Patio Door		
APPROVED BY: D011241			
PART/PROJECT NO.:			
IDENTIFIER NO.:			
PLANT NAME AND LOCATION: Hawkins, WI		CAD DWG. NO.:	REV.:
		Site/lineOSCLSPD Cert	A
			SHEET

'AS TESTED'