
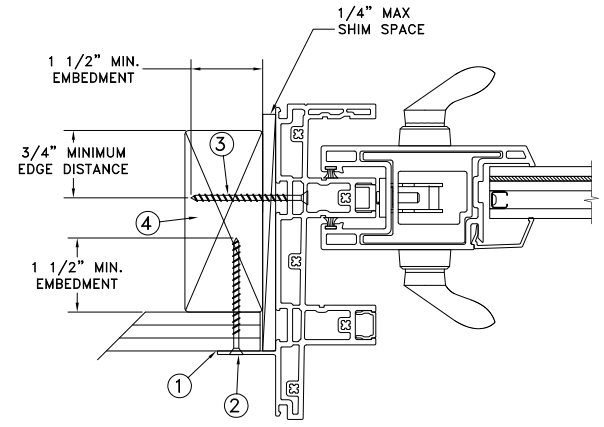
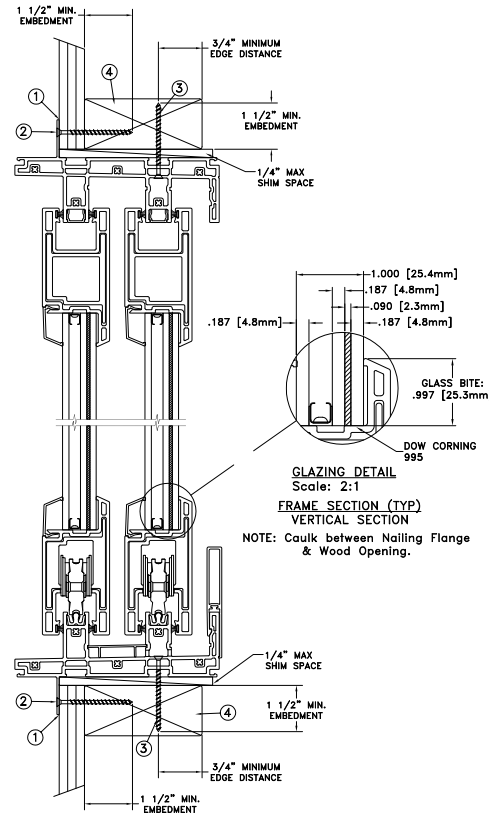


NAILFIN / THRU JAMB
INSTALLATION

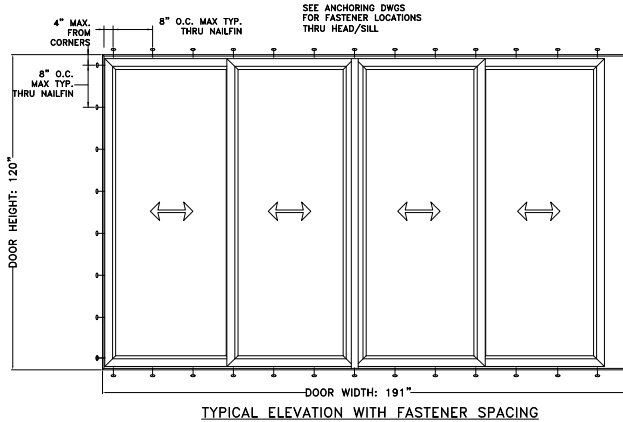

FRAME JAMB SECTION (TYP)
HORIZONTAL SECTION
NOTE: Caulk between Nailing Flange
& Wood Opening.

Max Frame	DP	IMPACT
191 x 120	+/- 60	YES

Installation Notes:

1. Seal flange/frame to substrate.
2. Use #8 PH or greater fastener through the nailfin with sufficient length to penetrate a minimum of 1 1/2" into the wood framing. For 2x wood frame substrate (min. S.G. = 0.42)
3. Use #8 PH or greater fastener through the pre-drilled holes in the head/sill tracks at the center (2) towers with sufficient length to penetrate a minimum of 1 1/2" into the wood framing. See additional details for location and spacing.
4. Host structure (wood buck, masonry, steel) to be designed and anchored to properly transfer all loads to the structure. The host structure is the responsibility of the architect or engineer of record for the project of installation.


General Notes:

1. The product shown herein is designed, tested and manufactured to comply with the wind load criteria of the adopted International Building Code (IBC), the International Residential Code (IRC), the Florida Building Code (FBC) and the industry requirement for the stated conditions.
2. All glazing shall conform to ASTM E1300.
3. At minimum, glazing is 4.8mm tempered - 10.0mm airspace - 4.8mm annealed - 2.3mm SGP Interlayer by Dupont - 4.8mm annealed insulating glass.
4. Use structural or composite shims where required.



This schedule addresses only the fasteners required to anchor the unit to achieve the rated design pressure and impact performance (where applicable) up to the size limitations noted. It is not intended as a guide to the installation process and does not address the sealing consideration that may arise in different wall conditions. For the complete installation procedure, see the instructions packaged with the unit or go to www.jeld-wen.com/resources/installation.

DISCLAIMER:


This drawing and its contents are confidential and are not to be reproduced or copied in whole or in part or used or disclosed to others except as authorized by JELD-WEN Inc.

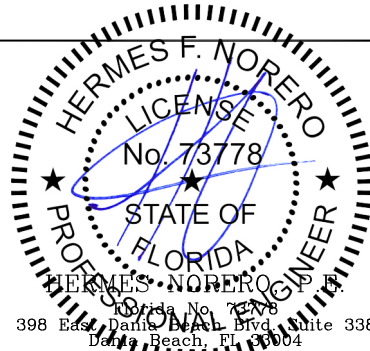

PROJECT ENGINEER:	DATE:	JELD WEN 3737 LAKEPORT BLVD. KLAMATH FALLS OR, 97601 PHONE: (800) 535-3936		
DRAWN BY:	SCALE:			
CHECKED BY:	TITLE:	Premium Vinyl Multi-Slide Patio Door - HVHZ 4-Panel 2-Track XXXP Jamb		
APPROVED BY:				
PART/PROJECT No.:				
IDENTIFIER No.	PLANT NAME AND LOCATION:	CAD DWG. No.:	REV:	SHEET
G6547.02	Venice-FL	PremVinylMTSLDR2 Cert	A	

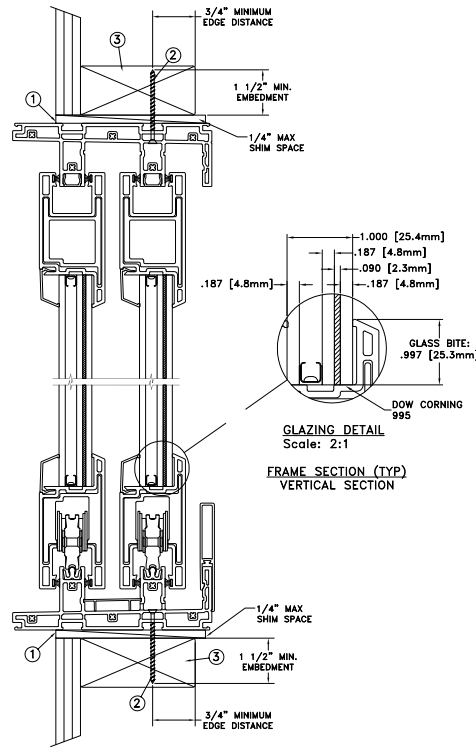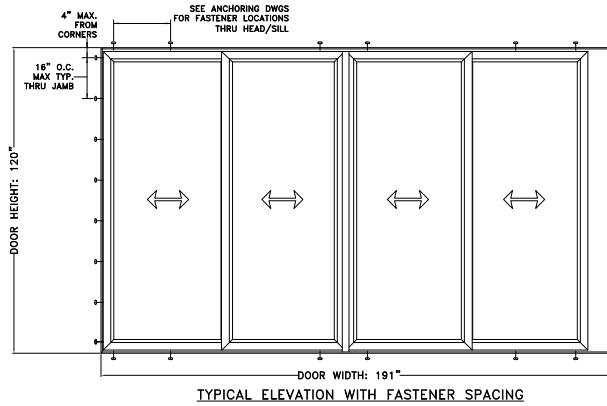

THRU JAMB INSTALLATION

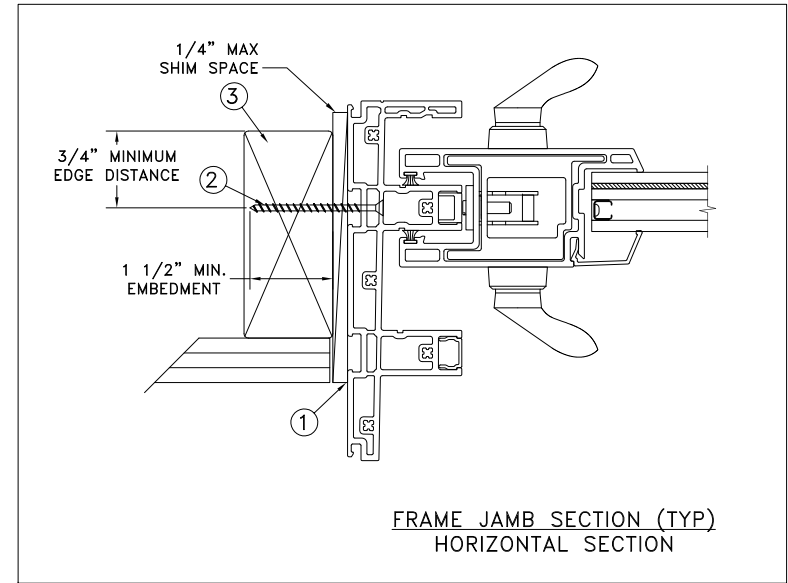

Max Frame	DP	IMPACT
191 x 120	+/- 60	YES

Installation Notes:

1. Seal flange/frame to substrate.
2. Use #8 PH or greater fastener through the pre-drilled holes in the head/sill tracks at the center (2) towers with sufficient length to penetrate a minimum of 1 1/2" into the wood framing. See additional details for location and spacing. For 2X wood frame substrate (min. SG = 0.42)
3. Host structure (wood buck, masonry, steel) to be designed and anchored to properly transfer all loads to the structure. The host structure is the responsibility of the architect or engineer of record for the project of installation.


General Notes:

1. The product shown herein is designed, tested and manufactured to comply with the wind load criteria of the adopted International Building Code (IBC), the International Residential Code (IRC), the Florida Building Code (FBC) and the industry requirement for the stated conditions.
2. All glazing shall conform to ASTM E1300.
3. At minimum, glazing is 4.8mm tempered - 10.0mm airspace - 4.8mm annealed - 2.3mm SGP Interlayer by Dupont - 4.8mm annealed insulating glass.
4. Use structural or composite shims where required.

This schedule addresses only the fasteners required to anchor the unit to achieve the rated design pressure and impact performance (where applicable) up to the size limitations noted. It is not intended as a guide to the installation process and does not address the sealing consideration that may arise in different wall conditions. For the complete installation procedure, see the instructions packaged with the unit or go to www.jeld-wen.com/resources/installation.




DISCLAIMER:

This drawing and its contents are confidential and are not to be reproduced or copied in whole or in part or used or disclosed to others except as authorized by JELD-WEN Inc.

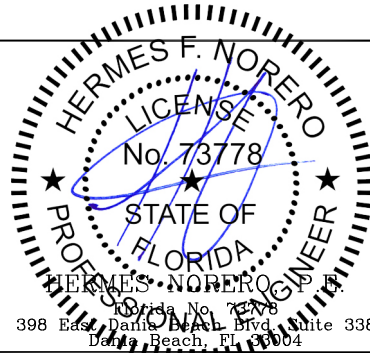

PROJECT ENGINEER:	DATE:	3737 LAKEPORT BLVD.	
	07/24/2017	KLAMATH FALLS OR, 97601	
DRAWN BY:	SCALE:	PHONE: (800) 535-3936	
J.HAWKINS	NTS		
CHECKED BY:	TITLE:	Premium Vinyl Multi-Slide Patio Door - HVHZ 4-Panel 2-Track XXXP Jamb	
D.CROWELL			
APPROVED BY:			
J.GOOSSEN			
PART/PROJECT No.:			
D014682			
IDENTIFIER No.	PLANT NAME AND LOCATION:	CAD DWG. No.:	REV:
G6547.02	Venice-FL	PremVinylMTSLDR2 Cert	A
			SHEET

CONCRETE/MASONRY
INSTALLATION

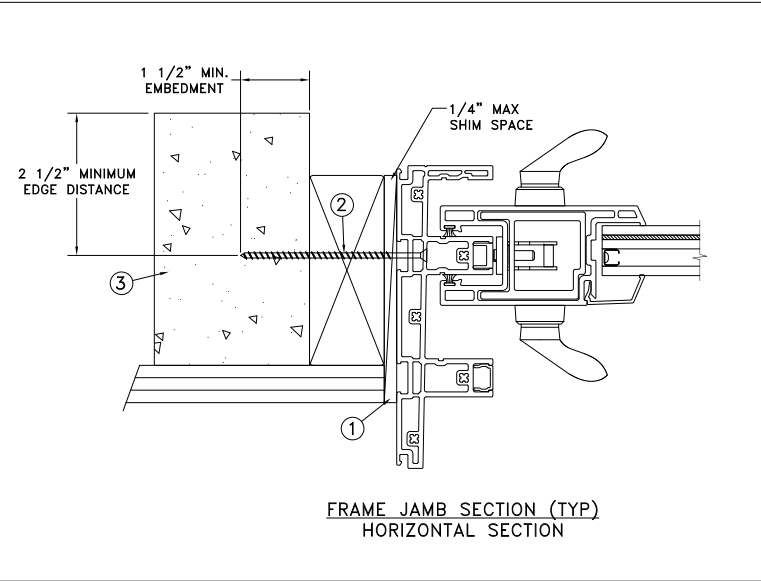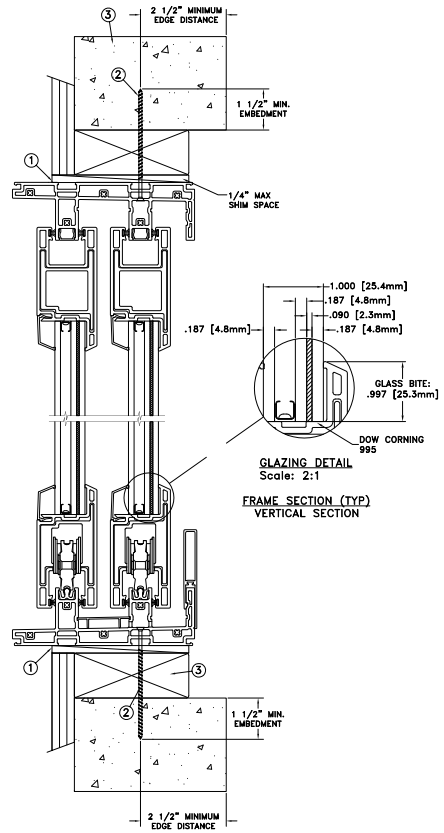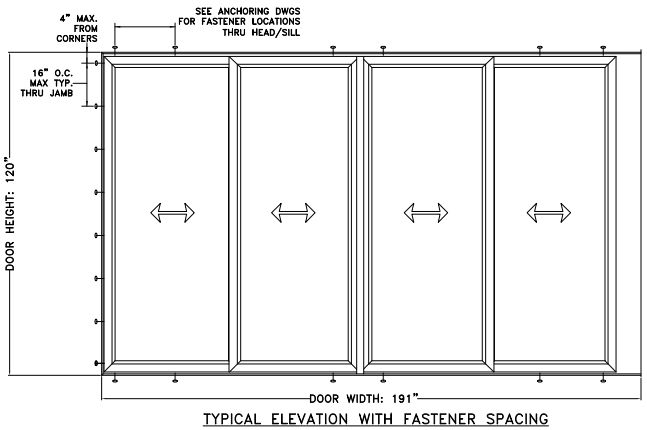

Max Frame	DP	IMPACT
191 x 120	+/- 60	YES

Installation Notes:


1. Seal flange/frame to substrate.
2. Use 3/16" Tapcon or equivalent fasteners through the pre-drilled holes in the head/sill tracks at the center (2) towers with sufficient length to penetrate a minimum of 1 1/2" into concrete or masonry at each location with a 2 1/2" min. from edge distance. For concrete (min. fc = 3000 psi) or masonry substrate (CMU shall adhere to ASTM C90).
3. Host structure (wood buck, masonry, steel) to be designed and anchored to properly transfer all loads to the structure. The host structure is the responsibility of the architect or engineer of record for the project of installation.

General Notes:



1. The product shown herein is designed, tested and manufactured to comply with the wind load criteria of the adopted International Building Code (IBC), the International Residential Code (IRC), the Florida Building Code (FBC) and the industry requirement for the stated conditions.
2. All glazing shall conform to ASTM E1300.
3. At minimum, glazing is 4.8mm tempered - 10.0mm airspace - 4.8mm annealed - 2.3mm SGP Interlayer by Dupont - 4.8mm annealed insulating glass.
4. Use structural or composite shims where required.

This schedule addresses only the fasteners required to anchor the unit to achieve the rated design pressure and impact performance (where applicable) up to the size limitations noted. It is not intended as a guide to the installation process and does not address the sealing consideration that may arise in different wall conditions. For the complete installation procedure, see the instructions packaged with the unit or go to www.jeld-wen.com/resources/installation.


DISCLAIMER:
This drawing and its contents are confidential and are not to be reproduced or copied in whole or in part or used or disclosed to others except as authorized by JELD-WEN Inc.

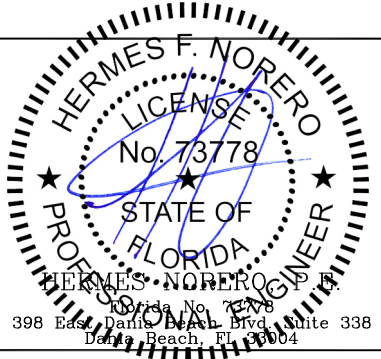

PROJECT ENGINEER:	DATE:	3737 LAKEPORT BLVD.	
	07/24/2017	KLAMATH FALLS OR, 97601	
DRAWN BY:	SCALE:	PHONE: (800) 535-3936	
J.HAWKINS	NTS		
CHECKED BY:	TITLE:	Premium Vinyl Multi-Slide Patio Door - HVHZ 4-Panel 2-Track XXXP Jamb	
D.CROWELL			
APPROVED BY:			
J.GOOSSEN			
PART/PROJECT No.:			
D014682			
IDENTIFIER No.	PLANT NAME AND LOCATION:	CAD DWG. No.:	REV:
G6547.02	Venice-FL	PremVinylMTSLDR2 Cert	A
			SHEET

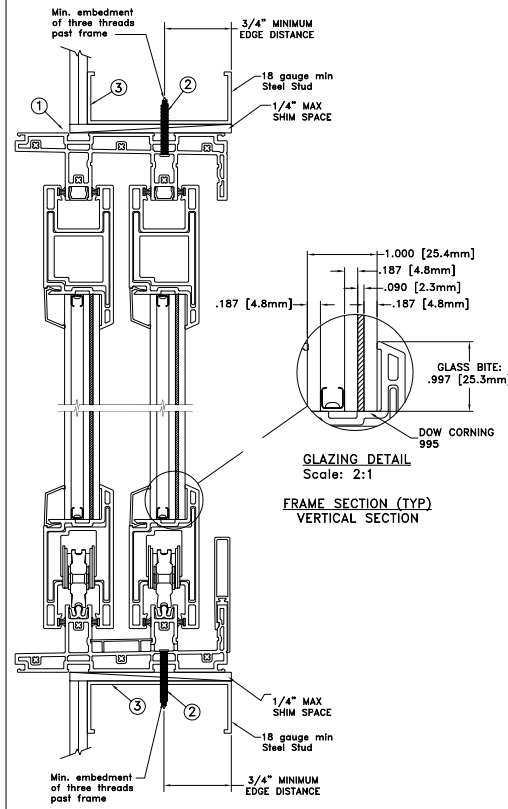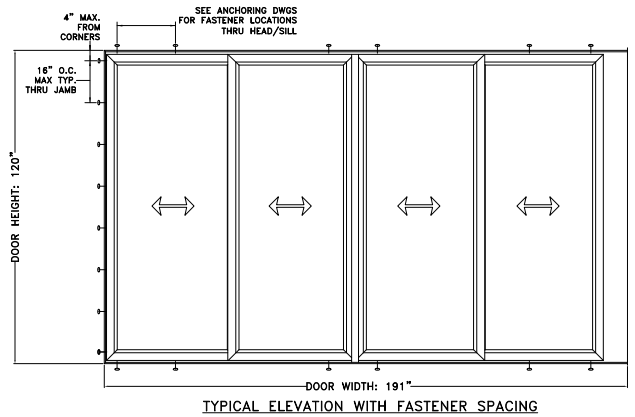

STEEL INSTALLATION

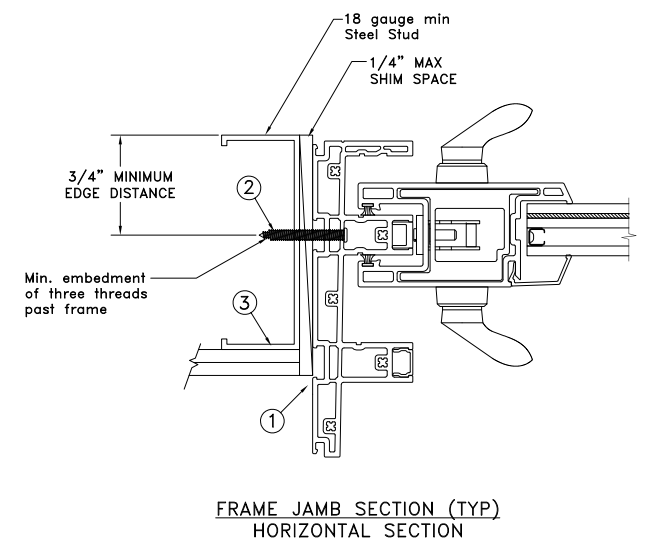

Max Frame	DP	IMPACT
191 x 120	+/- 60	YES

Installation Notes:


1. Seal flange/frame to substrate.
2. For anchoring into metal framing use #8 TEK Self-Tapping screws with sufficient length to achieve a minimum embedment of three threads past the frame thickness. Steel substrate min. 18ga., fy = 33 ksi.
3. Host structure (wood buck, masonry, steel) to be designed and anchored to properly transfer all loads to the structure. The host structure is the responsibility of the architect or engineer of record for the project of installation.

General Notes:

1. The product shown herein is designed, tested and manufactured to comply with the wind load criteria of the adopted International Building Code (IBC), the International Residential Code (IRC), the Florida Building Code (FBC) and the industry requirement for the stated conditions.
2. All glazing shall conform to ASTM E1300.
3. At minimum, glazing is 4.8mm tempered - 10.0mm airspace - 4.8mm annealed - 2.3mm SGP Interlayer by Dupont - 4.8mm annealed insulating glass.
4. Use structural or composite shims where required.

This schedule addresses only the fasteners required to anchor the unit to achieve the rated design pressure and impact performance (where applicable) up to the size limitations noted. It is not intended as a guide to the installation process and does not address the sealing consideration that may arise in different wall conditions. For the complete installation procedure, see the instructions packaged with the unit or go to www.jeld-wen.com/resources/installation.




DISCLAIMER:
This drawing and its contents are confidential and are not to be reproduced or copied in whole or in part or used or disclosed to others except as authorized by JELD-WEN Inc.

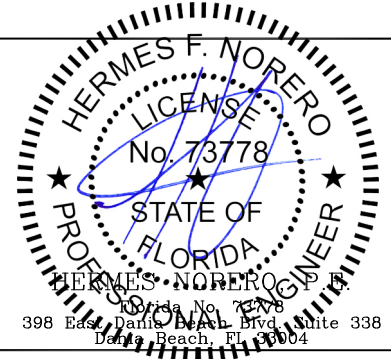

398 East Daniel Beach Blvd Suite 338
Daniel Beach, FL 32004

PROJECT ENGINEER:	DATE:	JELD WEN 3737 LAKEPORT BLVD. KLAMATH FALLS OR, 97601 PHONE: (800) 535-3936		
	07/24/2017			
DRAWN BY:	SCALE:	Premium Vinyl Multi-Slide Patio Door - HVHZ 4-Panel 2-Track XXXP Jamb		
J.HAWKINS	NTS			
CHECKED BY:	TITLE:			
D.CROWELL				
APPROVED BY:		PLANT NAME AND LOCATION: Venice-FL		
J.GOOSSEN				
PART/PROJECT No.:				
D014682		CAD DWG. No.:	REV:	SHEET
IDENTIFIER No.		PremVinylMTSLDR2 Cert	A	
G6547.02				

NAILFIN / THRU JAMB
INSTALLATION

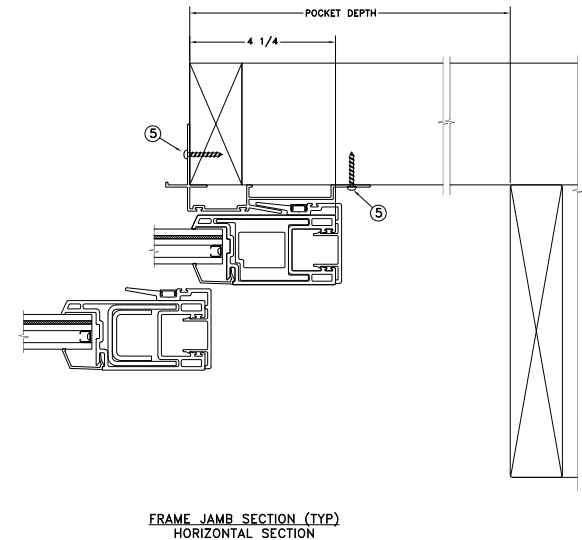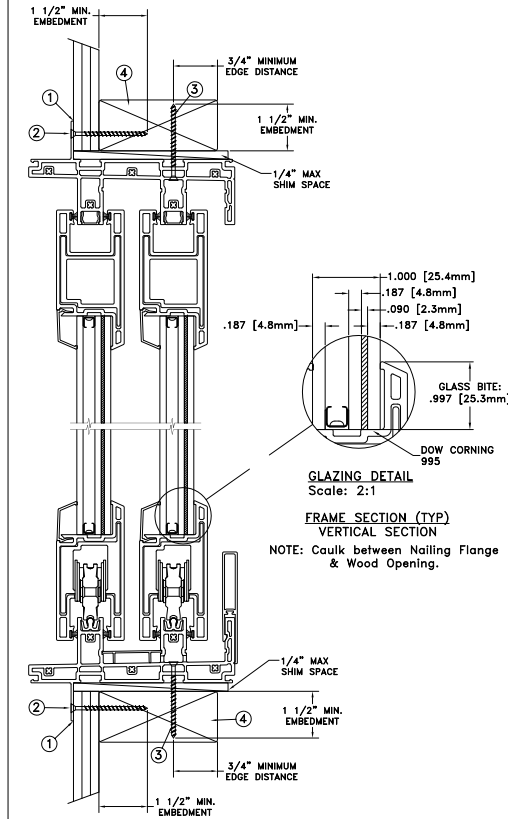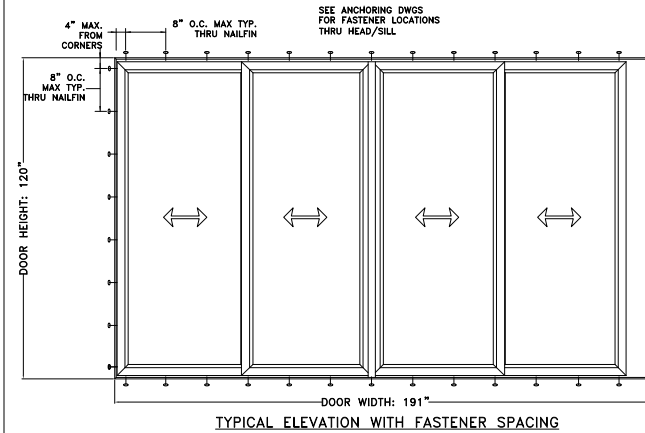

Max Frame	DP	IMPACT
191 x 120	+/- 60	YES

Installation Notes:

1. Seal flange/frame to substrate.
2. Use #8 PH or greater fastener through the nailfin with sufficient length to penetrate a minimum of 1 1/2" into the wood framing. For 2x wood frame substrate (min. S.G. = 0.42)
3. Use #8 PH or greater fastener through the pre-drilled holes in the head/sill tracks at the center (2) towers with sufficient length to penetrate a minimum of 1 1/2" into the wood framing. See additional details for location and spacing.
4. Host structure (wood buck, masonry, steel) to be designed and anchored to properly transfer all loads to the structure. The host structure is the responsibility of the architect or engineer of record for the project of installation.
5. Use #8 PH or greater fastener through hook strip 6" from ends and 12" on center.


General Notes:

1. The product shown herein is designed, tested and manufactured to comply with the wind load criteria of the adopted International Building Code (IBC), the International Residential Code (IRC), the Florida Building Code (FBC) and the industry requirement for the stated conditions.
2. All glazing shall conform to ASTM E1300.
3. At minimum, glazing is 4.8mm tempered - 10.0mm airspace - 4.8mm annealed - 2.3mm SGP Interlayer by Dupont - 4.8mm annealed insulating glass.
4. Use structural or composite shims where required.



This schedule addresses only the fasteners required to anchor the unit to achieve the rated design pressure and impact performance (where applicable) up to the size limitations noted. It is not intended as a guide to the installation process and does not address the sealing consideration that may arise in different wall conditions. For the complete installation procedure, see the instructions packaged with the unit or go to www.jeld-wen.com/resources/installation.

DISCLAIMER:


This drawing and its contents are confidential and are not to be reproduced or copied in whole or in part or used or disclosed to others except as authorized by JELD-WEN Inc.

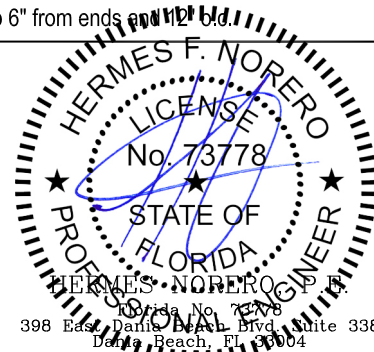

PROJECT ENGINEER:	DATE:	3737 LAKEPORT BLVD.	
	07/24/2017	KLAMATH FALLS OR, 97601	
DRAWN BY:	SCALE:	PHONE: (800) 535-3936	
J.HAWKINS	NTS		
CHECKED BY:	TITLE:	Premium Vinyl Multi-Slide Patio Door - HVHZ 4-Panel 2-Track XXXP Pocket	
D.CROWELL			
APPROVED BY:			
J.GOOSSEN			
PART/PROJECT No.:			
D014682			
IDENTIFIER No.	PLANT NAME AND LOCATION:	CAD DWG. No.:	REV:
G6547.02	Venice-FL	PremVinylMTSLDR2 Cert	A
			SHEET

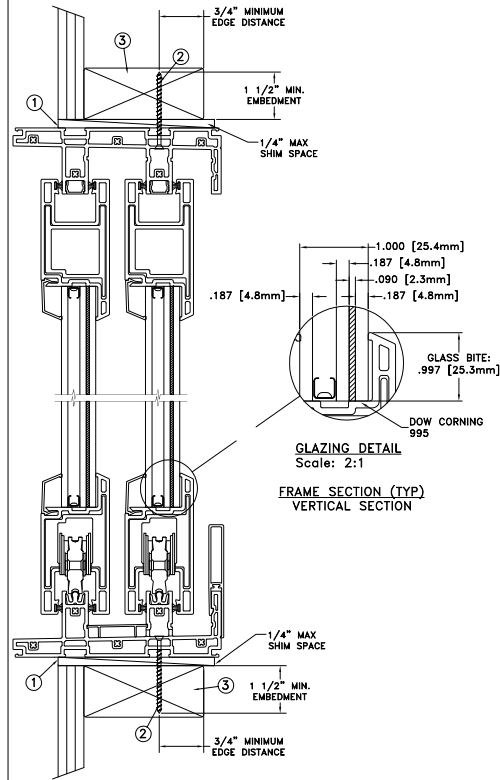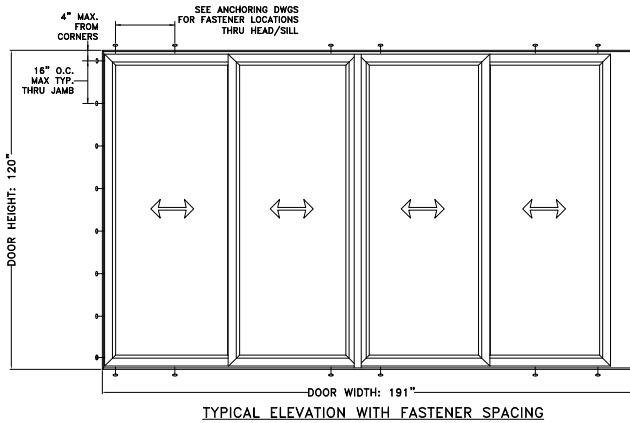

THRU JAMB INSTALLATION

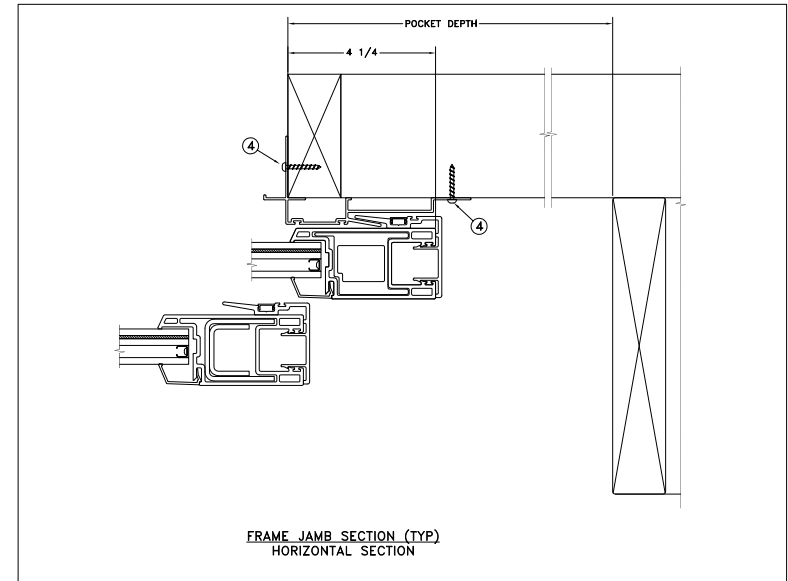

Max Frame	DP	IMPACT
191 x 120	+/- 60	YES

Installation Notes:

1. Seal flange/frame to substrate.
2. Use #8 PH or greater fastener through the pre-drilled holes in the head/sill tracks at the center (2) towers with sufficient length to penetrate a minimum of 1 1/2" into the wood framing. See additional details for location and spacing. For 2X wood frame substrate (min. SG = 0.42)
3. Host structure (wood buck, masonry, steel) to be designed and anchored to properly transfer all loads to the structure. The host structure is the responsibility of the architect or engineer of record for the project of installation.
4. Use #8 PH or greater fastener through hook strip 6" from ends and 12" o.c.


General Notes:

1. The product shown herein is designed, tested and manufactured to comply with the wind load criteria of the adopted International Building Code (IBC), the International Residential Code (IRC), the Florida Building Code (FBC) and the industry requirement for the stated conditions.
2. All glazing shall conform to ASTM E1300.
3. At minimum, glazing is 4.8mm tempered - 10.0mm airspace - 4.8mm annealed - 2.3mm SGP Interlayer by Dupont - 4.8mm annealed insulating glass.
4. Use structural or composite shims where required.



This schedule addresses only the fasteners required to anchor the unit to achieve the rated design pressure and impact performance (where applicable) up to the size limitations noted. It is not intended as a guide to the installation process and does not address the sealing consideration that may arise in different wall conditions. For the complete installation procedure, see the instructions packaged with the unit or go to www.jeld-wen.com/resources/installation.

DISCLAIMER:


This drawing and its contents are confidential and are not to be reproduced or copied in whole or in part or used or disclosed to others except as authorized by JELD-WEN Inc.

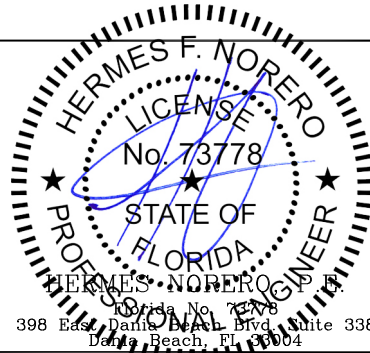

PROJECT ENGINEER:	DATE:	3737 LAKEPORT BLVD.	
	07/24/2017	KLAMATH FALLS OR, 97601	
DRAWN BY:	SCALE:	PHONE: (800) 535-3936	
J.HAWKINS	NTS		
CHECKED BY:	TITLE:	Premium Vinyl Multi-Slide Patio Door - HVHZ 4-Panel 2-Track XXXP Pocket	
D.CROWELL			
APPROVED BY:			
J.GOOSSEN			
PART/PROJECT No.:			
D014682			
IDENTIFIER No.	PLANT NAME AND LOCATION:	CAD DWG. No.:	REV:
G6547.02	Venice-FL	PremVinylMTSLDR2 Cert	A
			SHEET

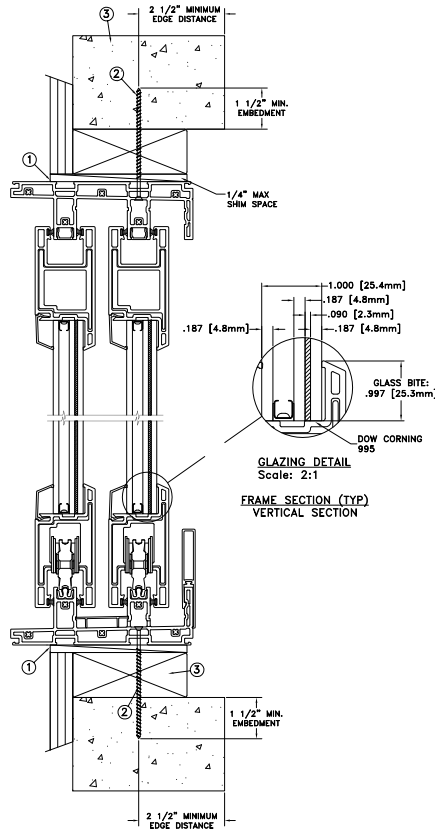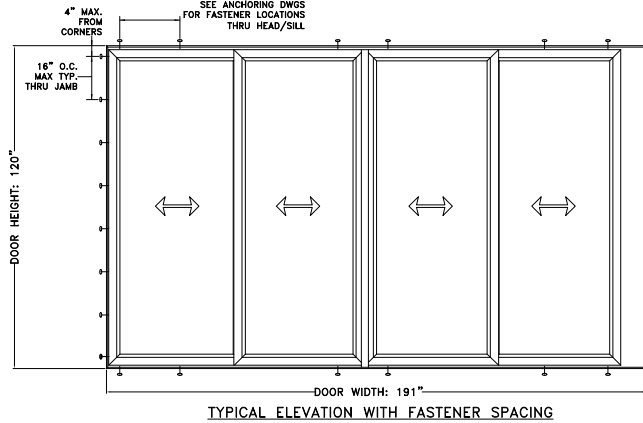

CONCRETE/MASONRY INSTALLATION

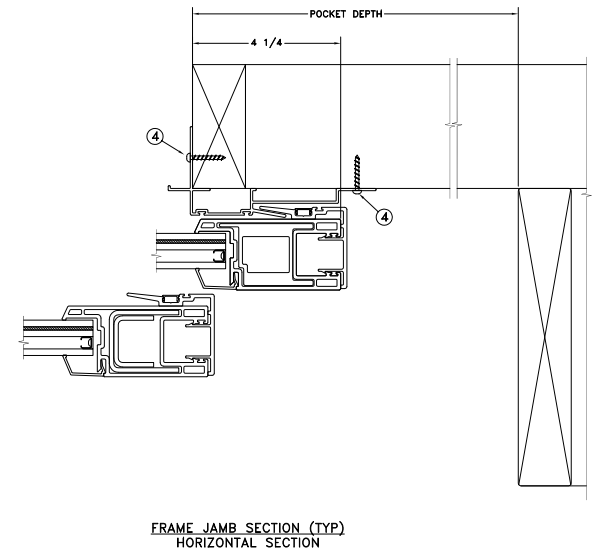

Max Frame	DP	IMPACT
191 x 120	+/- 60	YES

Installation Notes:

1. Seal flange/frame to substrate.
2. Use 3/16" Tapcon or equivalent fasteners through the pre-drilled holes in the head/sill tracks at the center (2) towers with sufficient length to penetrate a minimum of 1 1/2" into concrete or masonry at each location with a 2 1/2" min. from edge distance. For concrete (min. fc = 3000 psi) or masonry substrate (CMU shall adhere to ASTM C90).
3. Host structure (wood buck, masonry, steel) to be designed and anchored to properly transfer all loads to the structure. The host structure is the responsibility of the architect or engineer of record for the project of installation.
4. Use #8 PH or greater fastener through hook strip 6" from ends and 12" o.c.


General Notes:

1. The product shown herein is designed, tested and manufactured to comply with the wind load criteria of the adopted International Building Code (IBC), the International Residential Code (IRC), the Florida Building Code (FBC) and the industry requirement for the stated conditions.
2. All glazing shall conform to ASTM E1300.
3. At minimum, glazing is 4.8mm tempered - 10.0mm airspace - 4.8mm annealed - 2.3mm SGP Interlayer by Dupont - 4.8mm annealed insulating glass.
4. Use structural or composite shims where required.



This schedule addresses only the fasteners required to anchor the unit to achieve the rated design pressure and impact performance (where applicable) up to the size limitations noted. It is not intended as a guide to the installation process and does not address the sealing consideration that may arise in different wall conditions. For the complete installation procedure, see the instructions packaged with the unit or go to www.jeld-wen.com/resources/installation.

DISCLAIMER:


This drawing and its contents are confidential and are not to be reproduced or copied in whole or in part or used or disclosed to others except as authorized by JELD-WEN Inc.

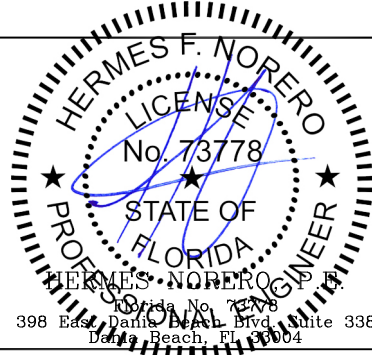

PROJECT ENGINEER:	DATE:	JELD WEN 3737 LAKEPORT BLVD. KLAMATH FALLS OR, 97601 PHONE: (800) 535-3936		
DRAWN BY:	SCALE:			
CHECKED BY:	TITLE:	Premium Vinyl Multi-Slide Patio Door - HVHZ 4-Panel 2-Track XXXP Pocket		
APPROVED BY:				
PART/PROJECT No.:				
IDENTIFIER No.	PLANT NAME AND LOCATION:	CAD DWG. No.:	REV:	SHEET
G6547.02	Venice-FL	PremVinylMTSLDR2 Cert	A	

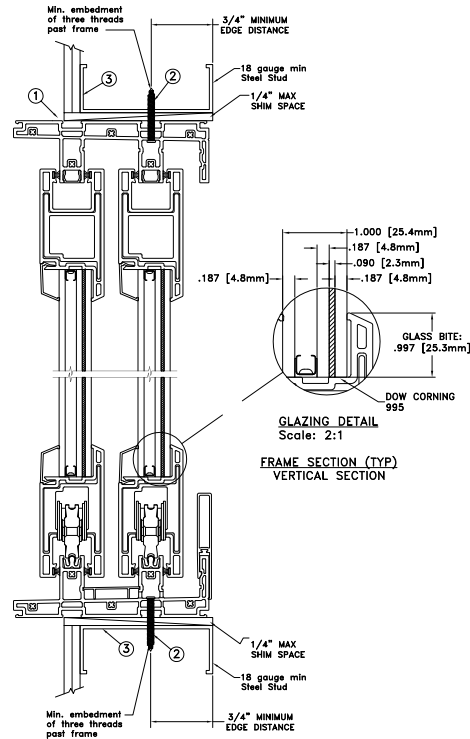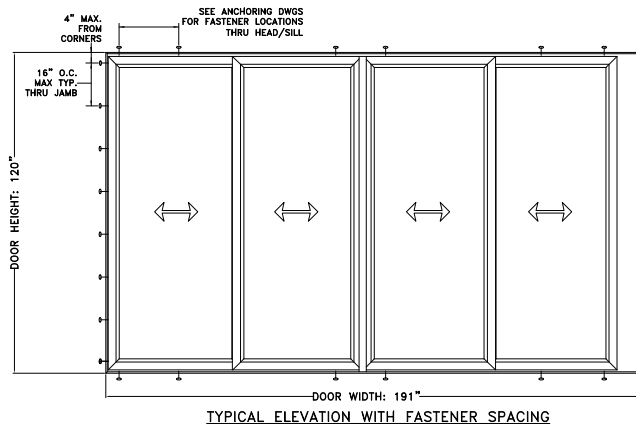

STEEL INSTALLATION

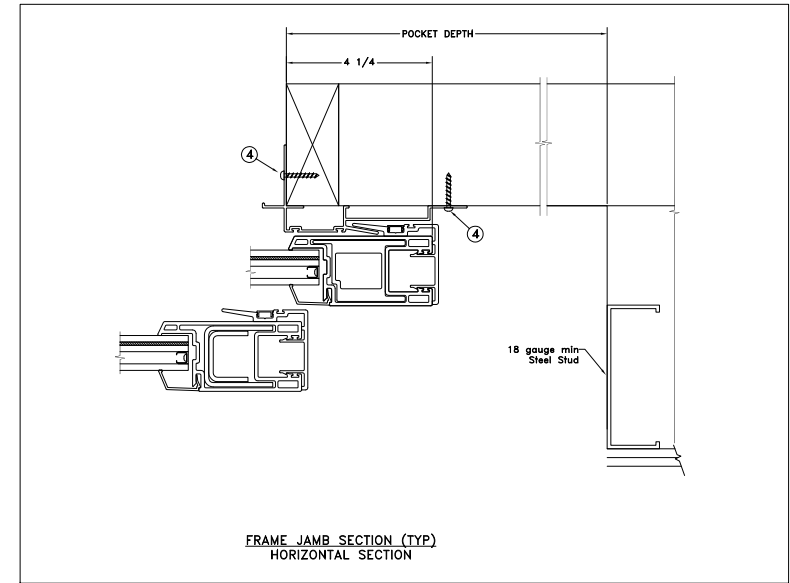

Max Frame	DP	IMPACT
191 x 120	+/- 60	YES

Installation Notes:


1. Seal flange/frame to substrate.
2. For anchoring into metal framing use #8 TEK Self-Tapping screws with sufficient length to achieve a minimum embedment of three threads past the frame thickness. Steel substrate min. 18ga., fy = 33 ksi.
3. Host structure (wood buck, masonry, steel) to be designed and anchored to properly transfer all loads to the structure. The host structure is the responsibility of the architect or engineer of record for the project of installation.
4. Use #8 PH or greater fastener through hook strip 6" from ends and 12" o.c.

General Notes:

1. The product shown herein is designed, tested and manufactured to comply with the wind load criteria of the adopted International Building Code (IBC), the International Residential Code (IRC), the Florida Building Code (FBC) and the industry requirement for the stated conditions.
2. All glazing shall conform to ASTM E1300.
3. At minimum, glazing is 4.8mm tempered - 10.0mm airspace - 4.8mm annealed - 2.3mm SGP Interlayer by Dupont - 4.8mm annealed insulating glass.
4. Use structural or composite shims where required.


This schedule addresses only the fasteners required to anchor the unit to achieve the rated design pressure and impact performance (where applicable) up to the size limitations noted. It is not intended as a guide to the installation process and does not address the sealing consideration that may arise in different wall conditions. For the complete installation procedure, see the instructions packaged with the unit or go to www.jeld-wen.com/resources/installation.

DISCLAIMER: This drawing and its contents are confidential and are not to be reproduced or copied in whole or in part or used or disclosed to others except as authorized by JELD-WEN Inc.

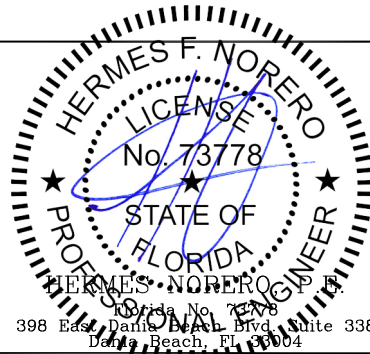


398 East Davis Beach Blvd Suite 338
 Daytona Beach, FL 32104

PROJECT ENGINEER:	DATE:	3737 LAKEPORT BLVD.	
	07/24/2017	KLAMATH FALLS OR, 97601	
DRAWN BY:	SCALE:	PHONE: (800) 535-3936	
J.HAWKINS	NTS		
CHECKED BY:	TITLE:	Premium Vinyl Multi-Slide Patio Door - HVHZ 4-Panel 2-Track XXXP Pocket	
D.CROWELL			
APPROVED BY:			
J.GOOSSEN			
PART/PROJECT No.:			
D014682			
IDENTIFIER No.	PLANT NAME AND LOCATION:	CAD DWG. No.:	REV:
G6547.02	Venice-FL	PremVinylMTSLDR2 Cert	A
			SHEET

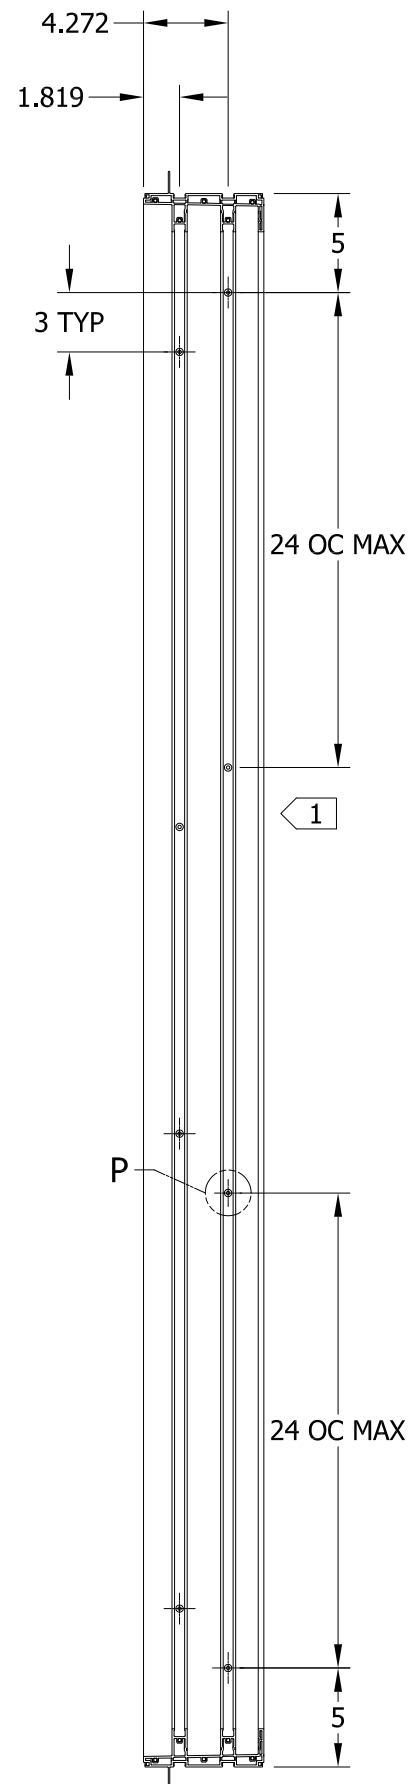


NOTES:

- 1. ANCHOR PATTERN LOCATED IN TRACKS 1 & 2 SHIFT AS DETAILED
- 1. HOLES TO BE OMITTED IF ON CENTER CALCULATIONS FALL WITHIN 2" OF KEEPER LOCATION
- 2. ALL HOLES IN ALL POSITIONS TO BE CENTERED WITHIN TRACK TOWERS IN JAMB
- 3. THRU FRAME INSTALLATION

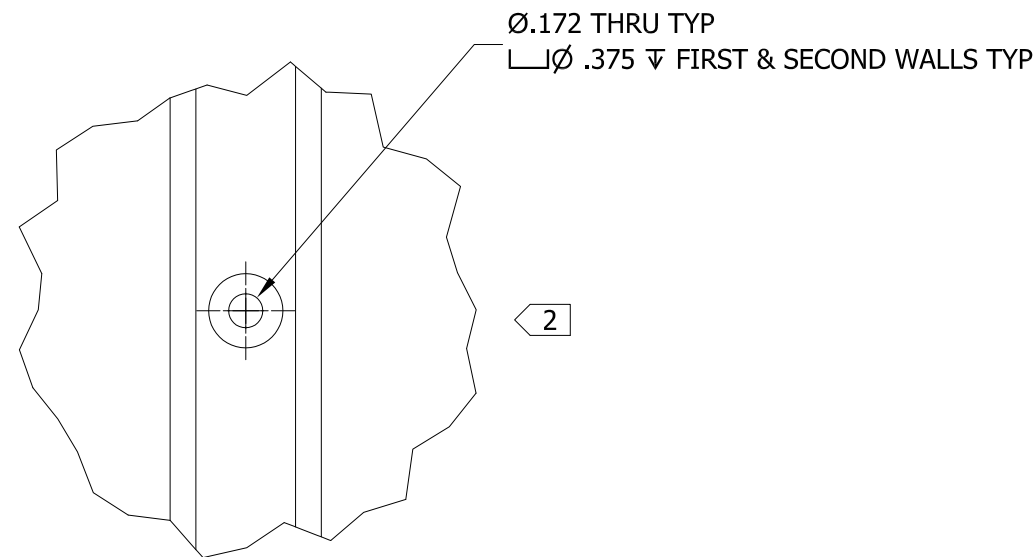

DETAIL P
SCALE 1 : 1

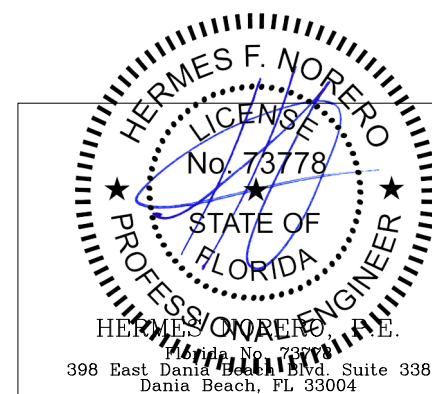

UNLESS SPECIFIED ALL DIMENSIONS IN INCHES
DO NOT SCALE DRAWING - REPORT ANY ERRORS

TOLERANCES (UNLESS SPECIFIED OTHERWISE)	
COMPONENT / PART TOLERANCES	
UNDER 10'-0" ± 1/32	.X ± .1
OVER 10'-0" ± 1/16	.XX ± .02
ANGULAR ± 1°	.XXX ± .006
UNIT ASSEMBLY TOLERANCES	
HEIGHT ± 1/16	WIDTH ± 1/16
MULLION ± 1/16	FRACTION ± 1/32

PROJECT ENGINEER:
N HERTZOG

DRAWN BY:
A BURWELL

CHECKED BY:
J JONES

APPROVED BY:
J JONES

IDENTIFIER No.

DATE:
9/11/2015

SCALE:
1:10

TITLE:
2-TRACK FRAME
MULTI-SLIDE PATIO DOOR
JAMB ANCHOR HOLE DETAIL


MODEL No.:
P012967-199.ipt

DRAWING No.:
P012967

© 2015 JELD-WEN, inc. ALL RIGHTS RESERVED. NO DUPLICATION OR
DISTRIBUTION PERMITTED. JELD-WEN, inc. CONFIDENTIAL AND PROPRIETARY.



REV: **B** SHEET



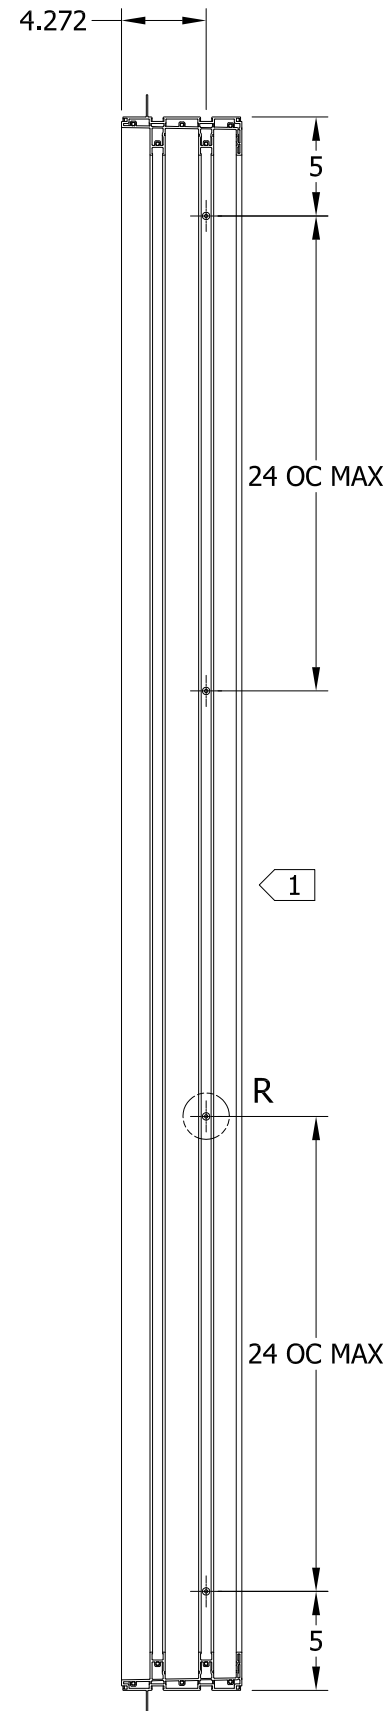

NOTES:

- 1. ANCHOR PATTERN LOCATED IN TRACK 1 SHIFT AS DETAILED
- 1. HOLES TO BE OMITTED IF ON CENTER CALCULATIONS FALL WITHIN 2" OF KEEPER LOCATION
- 2. ALL HOLES IN ALL POSITIONS TO BE CENTERED WITHIN TRACK TOWERS IN JAMB
- 3. NAIL FIN INSTALLATION

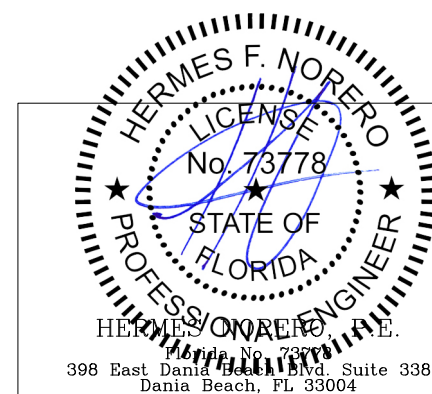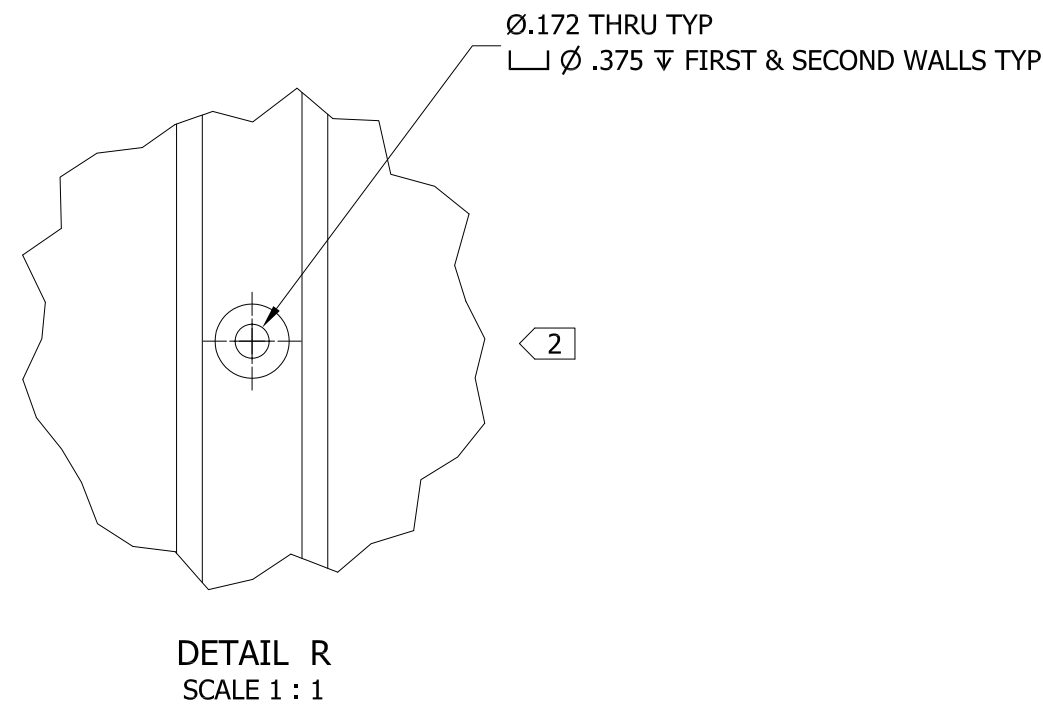

UNLESS SPECIFIED ALL DIMENSIONS IN INCHES DO NOT SCALE DRAWING - REPORT ANY ERRORS	
TOLERANCES (UNLESS SPECIFIED OTHERWISE)	
COMPONENT / PART TOLERANCES	
UNDER 10'-0" ± 1/32	.X ± .1
OVER 10'-0" ± 1/16	.XX ± .02
ANGULAR ± 1°	.XXX ± .006
UNIT ASSEMBLY TOLERANCES	
HEIGHT ± 1/16	WIDTH ± 1/16
MULLION ± 1/16	FRACTION ± 1/32

PROJECT ENGINEER: N HERTZOG
DRAWN BY: A BURWELL
CHECKED BY: J JONES
APPROVED BY: J JONES
IDENTIFIER No.


DATE: 9/11/2015
SCALE: 1 : 10




TITLE: 2-TRACK FRAME MULTI-SLIDE PATIO DOOR JAMB ANCHOR HOLES DETAIL	
MODEL No.: P012967-198.ipt	DRAWING No.: P012967
© 2015 JELD-WEN, inc. ALL RIGHTS RESERVED. NO DUPLICATION OR DISTRIBUTION PERMITTED. JELD-WEN, inc. CONFIDENTIAL AND PROPRIETARY.	
REV: B	SHEET

NOTES:

- 1 ALL HOLES IN ALL POSITIONS TO BE CENTERED WITHIN TRACK TOWERS AT HEAD OR SILL
- 2 TYP 1 ANCHOR PER PANEL LOCATED IN TRACK 1 TOWER AND ALIGNED WITH CENTER POINT OF EACH CLOSED POSITION PANEL
- 3 ANCHOR PATTERN LOCATED IN TRACK 1 & 2 TOWERS AT EACH INTERLOCK AREA
- 4 1 ANCHOR AT ENDS LOCATED IN TRACK 1 TOWER BOTH HEAD AND SILL
- 5 TYP 5 ANCHOR PATTERN LOCATED IN TRACK 1 & 2 TOWERS APPROXIMATE CENTER OF EACH CLOSED POSITION PANEL INTERLOCK AREA
- 6 CONFIGURATION FOR PG 60/65 DOORS WITH THRU FRAME INSTALL

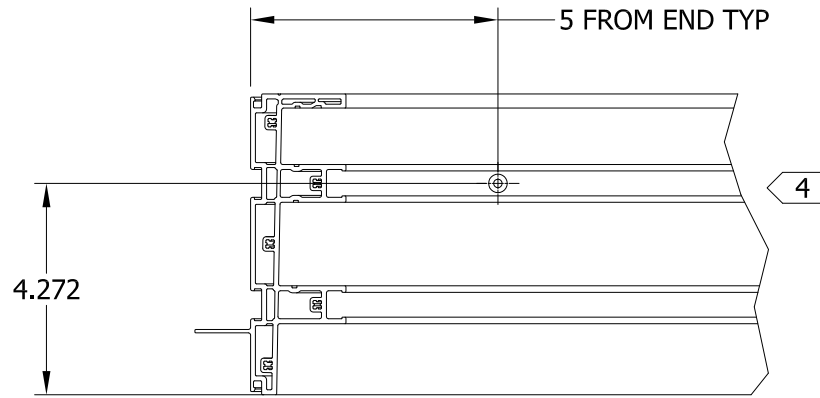


EXT ↓ DETAIL AA
SCALE 1 / 4

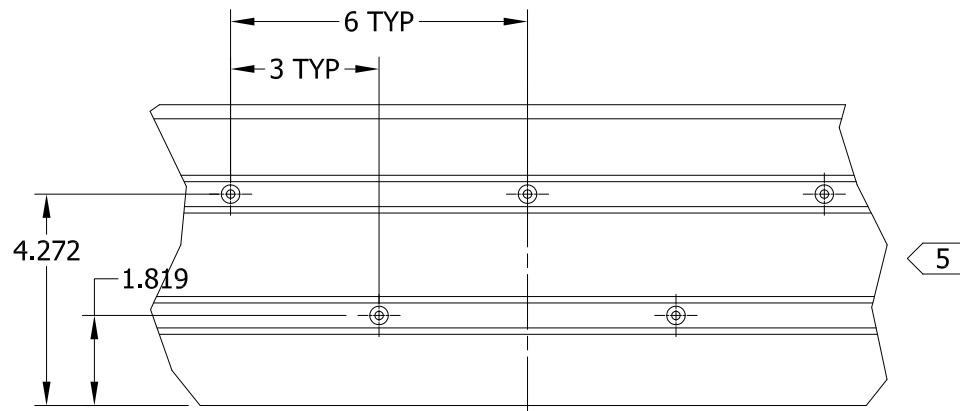



☺ PATTERN, SYM

EXT ↓ DETAIL AB
SCALE 1 / 4

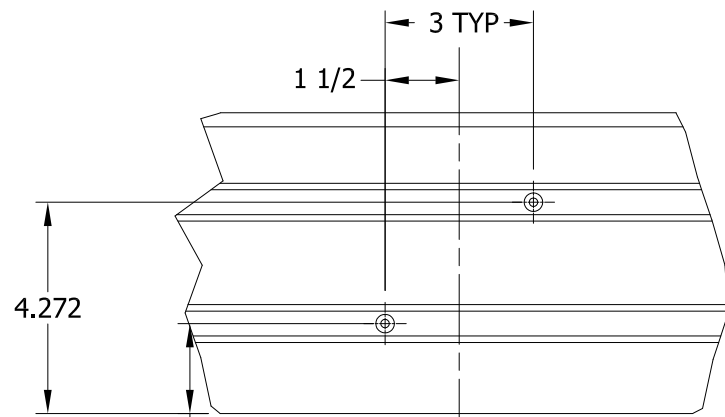


☺ PATTERN

EXT ↓ DETAIL AC
SCALE 1 / 4

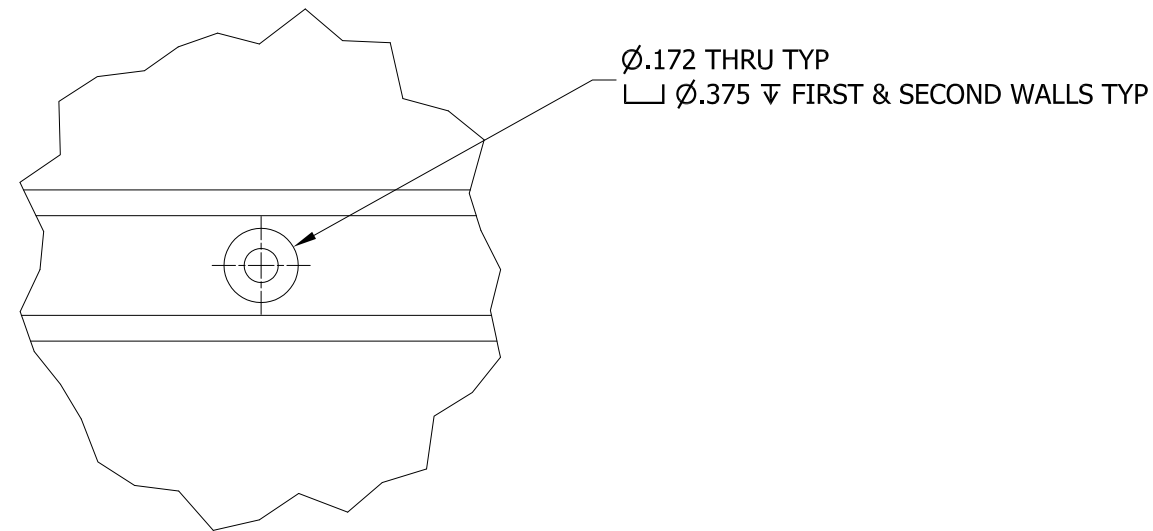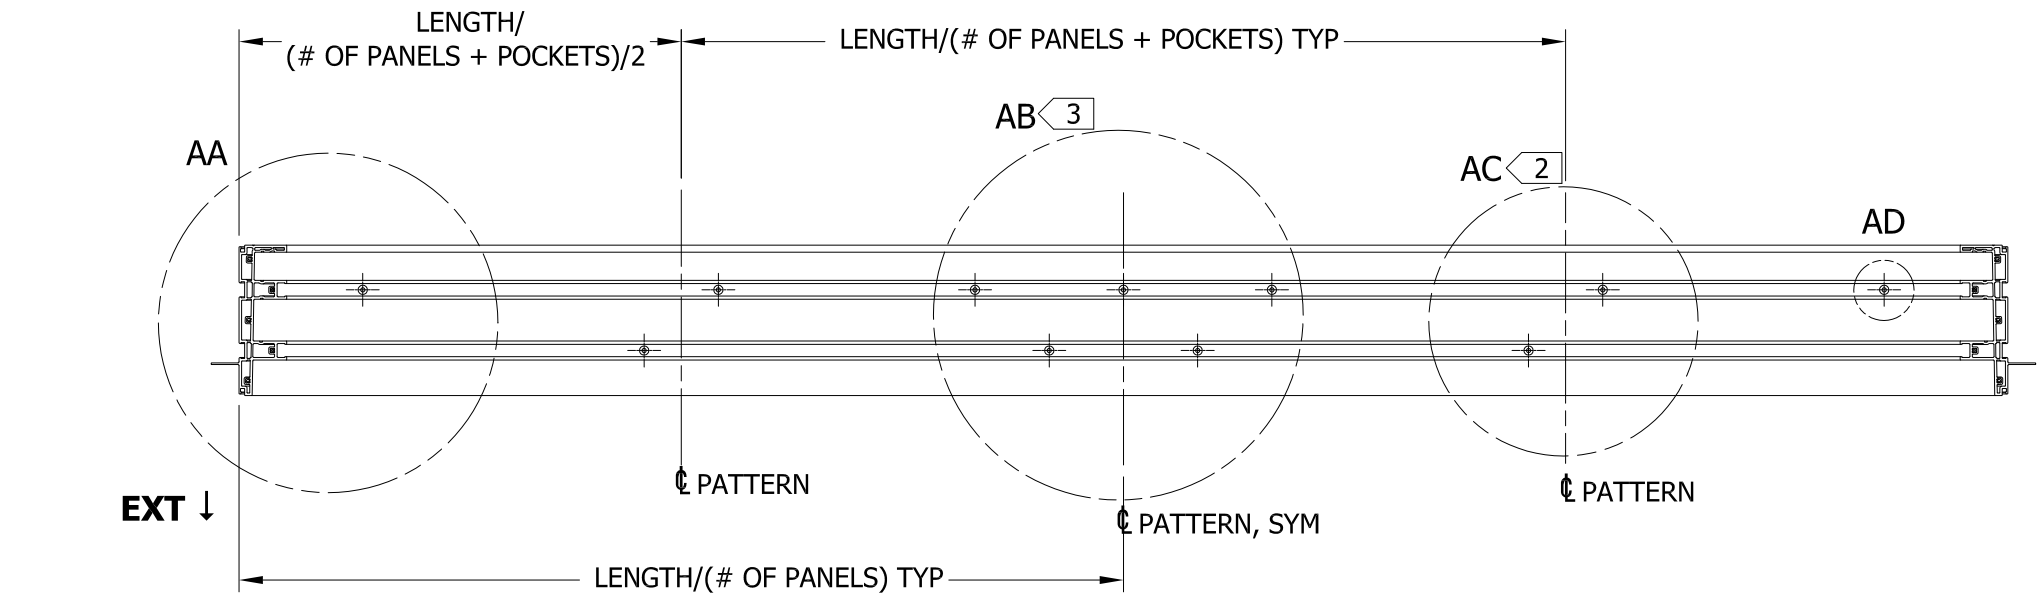

DETAIL AD TYPICAL HOLE
SCALE 1 / 1

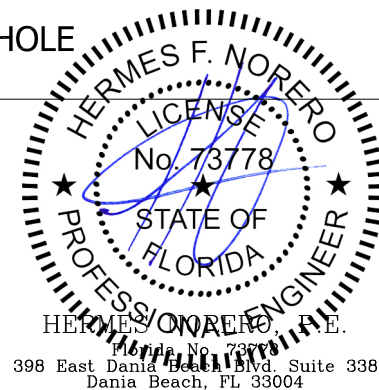

UNLESS SPECIFIED ALL DIMENSIONS IN INCHES
DO NOT SCALE DRAWING - REPORT ANY ERRORS

TOLERANCES (UNLESS SPECIFIED OTHERWISE)	
COMPONENT / PART TOLERANCES	
UNDER 10'-0" ± 1/32	.X ± .1
OVER 10'-0" ± 1/16	.XX ± .02
ANGULAR ± 1°	.XXX ± .006
UNIT ASSEMBLY TOLERANCES	
HEIGHT ± 1/16	WIDTH ± 1/16
MULLION ± 1/16	FRACTION ± 1/32

PROJECT ENGINEER:
N HERTZOG

DRAWN BY:
A BURWELL

CHECKED BY:
J JONES

APPROVED BY:
J JONES

IDENTIFIER No.

DATE:
9/11/2015

SCALE:
AS SHOWN

TITLE:

MODEL No.:

P012967-397.ipt



3737 Lakeport Blvd.
Klamath Falls, OR 97601
Phone: (541) 882-3451

2-TRACK FRAME
MULTI-SLIDE PATIO DOOR
6 SILL AND HEAD ANCHOR HOLES DETAIL


DRAWING No.: **P012967**

© 2015 JELD-WEN, inc. ALL RIGHTS RESERVED. NO DUPLICATION OR DISTRIBUTION PERMITTED. JELD-WEN, inc. CONFIDENTIAL AND PROPRIETARY.


REV: **B** SHEET

NOTES:


- 1 ALL HOLES IN ALL POSITIONS TO BE CENTERED WITHIN TRACK TOWERS AT HEAD OR SILL
- 2 TYP 1 ANCHOR PER PANEL LOCATED IN TRACK 1 TOWER AND ALIGNED WITH CENTER POINT OF EACH CLOSED POSITION PANEL
- 3 ANCHOR PATTERN LOCATED IN TRACK 1 TOWER AT EACH INTERLOCK AREA
- 4 1 ANCHOR AT ENDS LOCATED IN TRACK 1 TOWER BOTH HEAD AND SILL
- 5 TYP 5 ANCHOR PATTERN LOCATED IN TRACK 1 TOWER APPROXIMATE CENTER OF EACH CLOSED POSITION PANEL INTERLOCK AREA
- 6 CONFIGURATION FOR PG 60/65 DOORS WITH NAIL FIN INSTALL

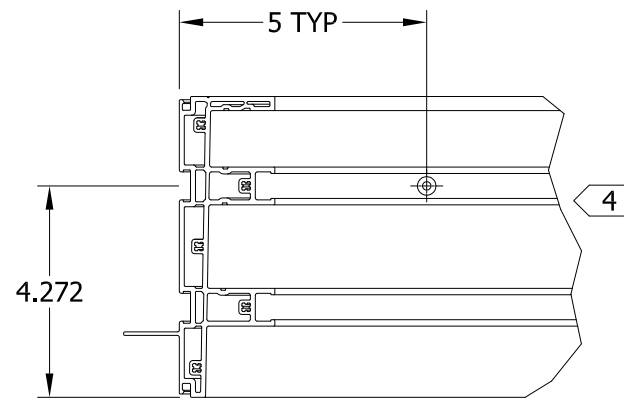


EXT ↓ DETAIL AE
SCALE 1 / 4

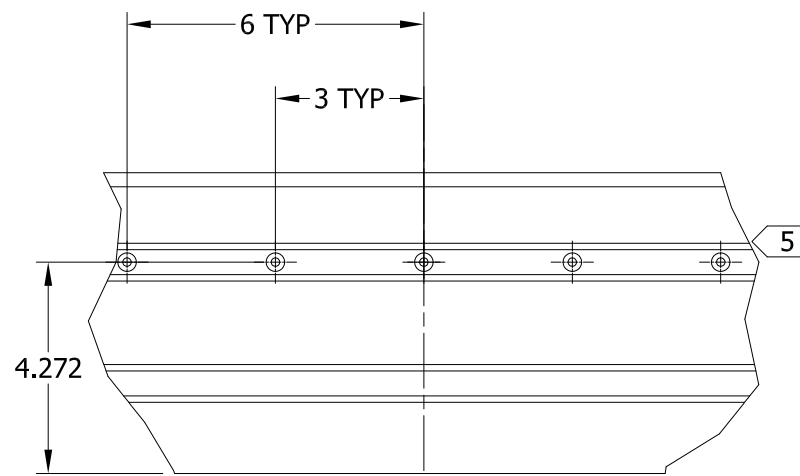


EXT ↓ DETAIL AF
SCALE 1 / 4

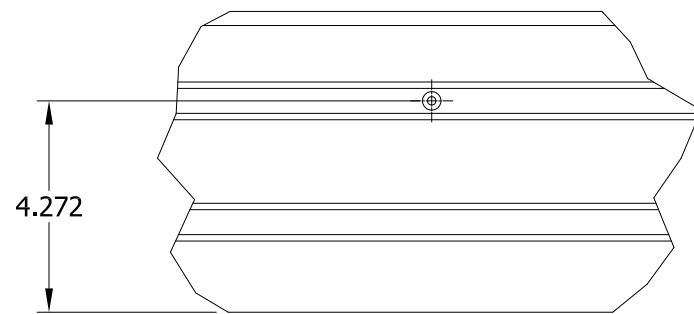


EXT ↓ DETAIL AG
SCALE 1 / 4

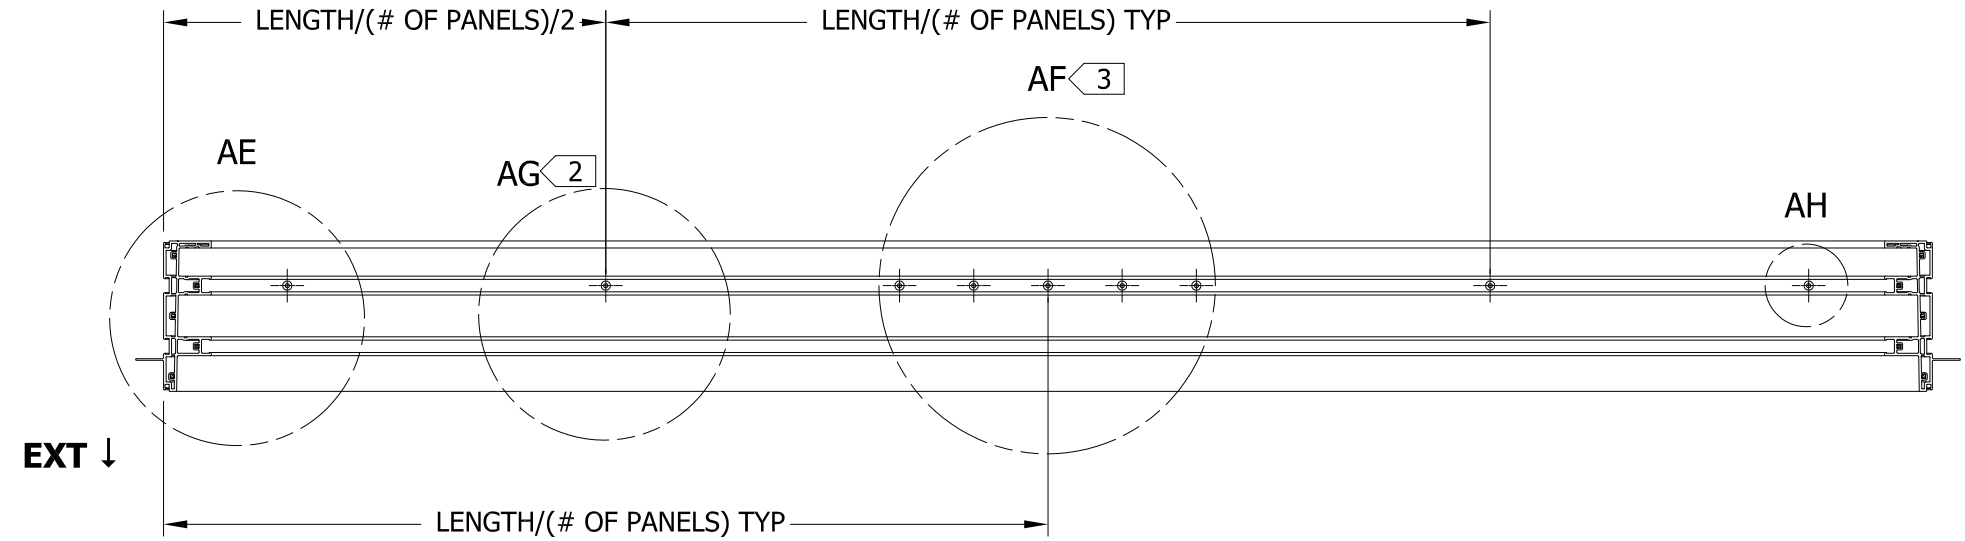

EXT ↓

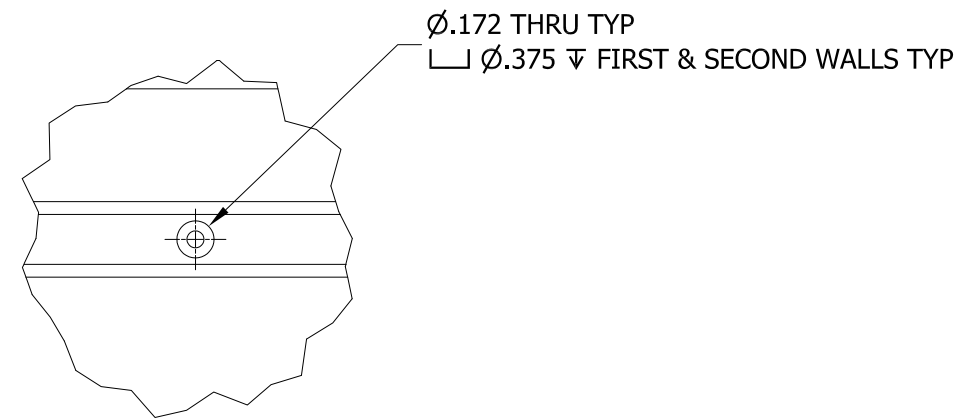

DETAIL AH TYPICAL HOLE
SCALE 1 / 2

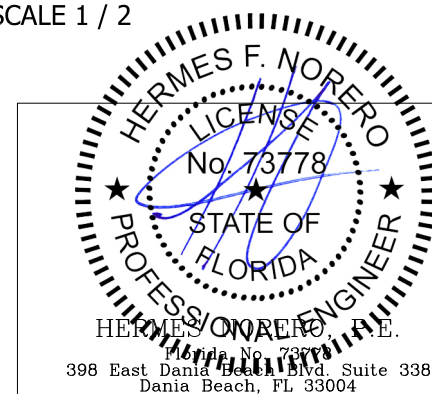

UNLESS SPECIFIED ALL DIMENSIONS IN INCHES
DO NOT SCALE DRAWING - REPORT ANY ERRORS

TOLERANCES (UNLESS SPECIFIED OTHERWISE)	
COMPONENT / PART TOLERANCES	
UNDER 10'-0" ± 1/32	.X ± .1
OVER 10'-0" ± 1/16	.XX ± .02
ANGULAR ± 1°	.XXX ± .006
UNIT ASSEMBLY TOLERANCES	
HEIGHT ± 1/16	WIDTH ± 1/16
MULLION ± 1/16	FRACTION ± 1/32

PROJECT ENGINEER:
N HERTZOG

DRAWN BY:
A BURWELL

CHECKED BY:
J JONES

APPROVED BY:
J JONES

IDENTIFIER No.

DATE:
9/11/2015

SCALE:
AS SHOWN

TITLE:

MODEL No.:

DRAWING No.:

© 2015 JELD-WEN, inc. ALL RIGHTS RESERVED. NO DUPLICATION OR DISTRIBUTION PERMITTED. JELD-WEN, inc. CONFIDENTIAL AND PROPRIETARY.



3737 Lakeport Blvd.
Klamath Falls, OR 97601
Phone: (541) 882-3451


2-TRACK FRAME
MULTI-SLIDE PATIO DOOR
SILL AND HEAD ANCHOR HOLES DETAIL

6


P012967-396.ipt

P012967


REV: **B** SHEET

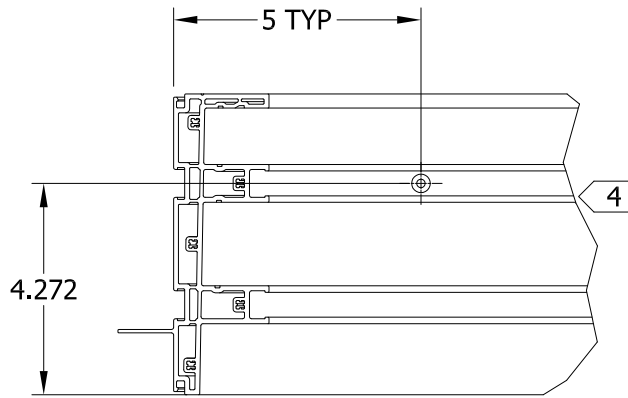

EXT ↓ DETAIL AN
SCALE 1 / 4

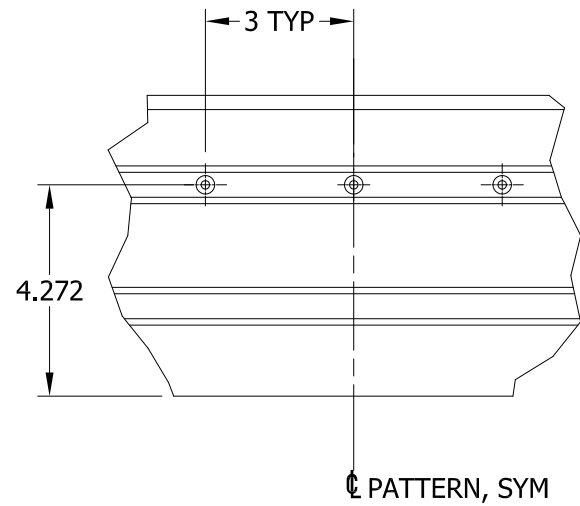


EXT ↓ DETAIL AP
SCALE 1 / 4

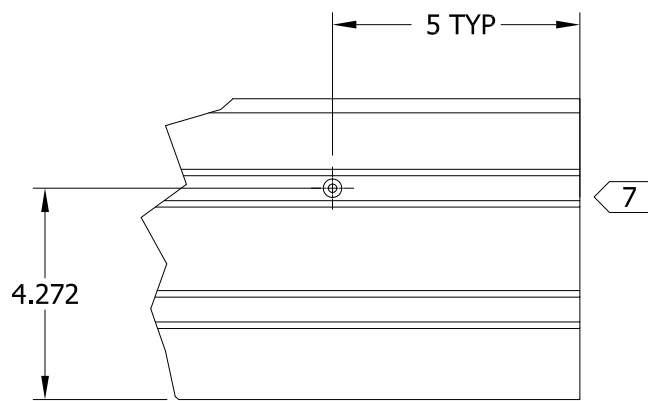


EXT ↓ DETAIL AR
SCALE 1 / 4

NOTES:


- 1 ALL HOLES IN ALL POSITIONS TO BE CENTERED WITHIN TRACK TOWERS AT HEAD OR SILL
- 2 TYP 1 ANCHOR PER PANEL LOCATED IN TRACK 1 TOWER AND ALIGNED WITH CENTER POINT OF EACH CLOSED POSITION PANEL
- 3 ANCHOR PATTERN LOCATED IN TRACK 1 TOWER AT EACH INTERLOCK AREA
- 4 1 ANCHOR AT ENDS LOCATED IN TRACK 1 TOWER BOTH HEAD AND SILL
- 5 TYP 3 ANCHOR PATTERN LOCATED IN TRACK 1 TOWER APPROXIMATE CENTER OF EACH CLOSED POSITION PANEL INTERLOCK AREA
- 6 CONFIGURATION FOR PG 60/65 POCKET DOORS WITH NAILFIN INSTALL
- 7 POCKET HEAD AND SILL END; MIRROR FOR 2-POCKET CONFIGURATIONS

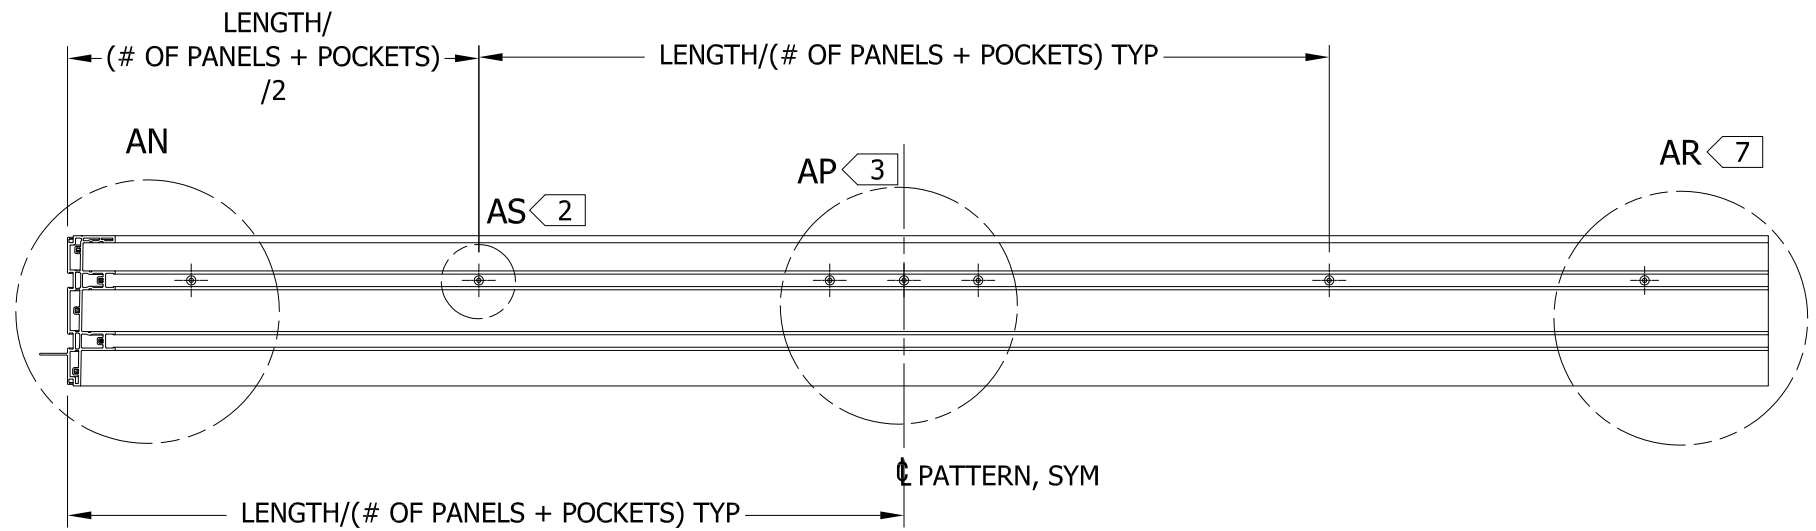

EXT ↓

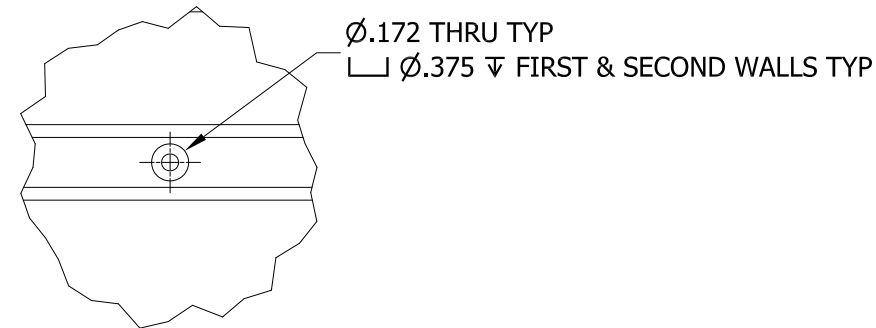

DETAIL AS TYPICAL HOLE
SCALE 1 / 2

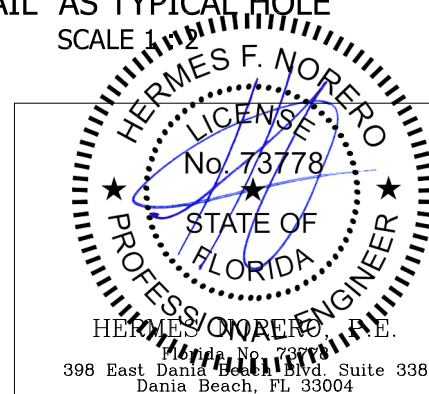

UNLESS SPECIFIED ALL DIMENSIONS IN INCHES
DO NOT SCALE DRAWING - REPORT ANY ERRORS

TOLERANCES (UNLESS SPECIFIED OTHERWISE)	
COMPONENT / PART TOLERANCES	
UNDER 10'-0" ± 1/32	.X ± .1
OVER 10'-0" ± 1/16	.XX ± .02
ANGULAR ± 1°	.XXX ± .006
UNIT ASSEMBLY TOLERANCES	
HEIGHT ± 1/16	WIDTH ± 1/16
MULLION ± 1/16	FRACTION ± 1/32

PROJECT ENGINEER:
N HERTZOG

DRAWN BY:
A BURWELL

CHECKED BY:
J JONES

APPROVED BY:
J JONES

IDENTIFIER No.

DATE:
9/11/2015

SCALE:
AS SHOWN



3737 Lakeport Blvd.
Klamath Falls, OR 97601
Phone: (541) 882-3451


TITLE: 2-TRACK FRAME MULTI-SLIDE PATIO DOOR SILL AND HEAD ANCHOR HOLES DETAIL	MODEL No.: P012967-324.ipt	DRAWING No.: P012967
---	-------------------------------	-------------------------

© 2015 JELD-WEN, inc. ALL RIGHTS RESERVED. NO DUPLICATION OR DISTRIBUTION PERMITTED. JELD-WEN, inc. CONFIDENTIAL AND PROPRIETARY.


REV: **B** SHEET

NOTES:


- 1 ALL HOLES IN ALL POSITIONS TO BE CENTERED WITHIN TRACK TOWERS AT HEAD OR SILL
- 2 TYP 2 ANCHORS PER PANEL LOCATED IN TRACK 1 & 2 AND ALIGNED WITH CENTER POINT OF EACH CLOSED POSITION PANEL
- 3 ANCHOR PATTERN LOCATED IN TRACK 1 & 2 TOWERS AT EACH INTERLOCK AREA
- 4 1 ANCHOR AT ENDS LOCATED IN TRACK 1 TOWER BOTH HEAD AND SILL
- 5 TYP 5 ANCHOR PATTERN LOCATED IN TRACK 1 & 2 TOWERS APPROXIMATE CENTER OF EACH CLOSED POSITION PANEL INTERLOCK AREA
- 6 CONFIGURATION FOR PG 60/65 POCKET DOORS WITH THRU FRAME INSTALL
- 7 POCKET HEAD AND SILL END; MIRROR FOR 2-POCKET CONFIGURATIONS

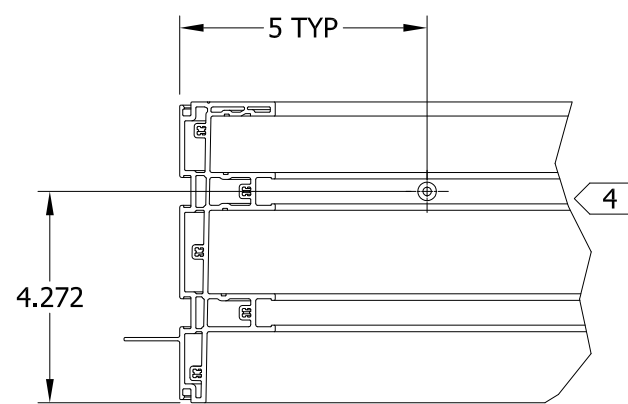


EXT ↓ DETAIL AU
SCALE 1 / 4

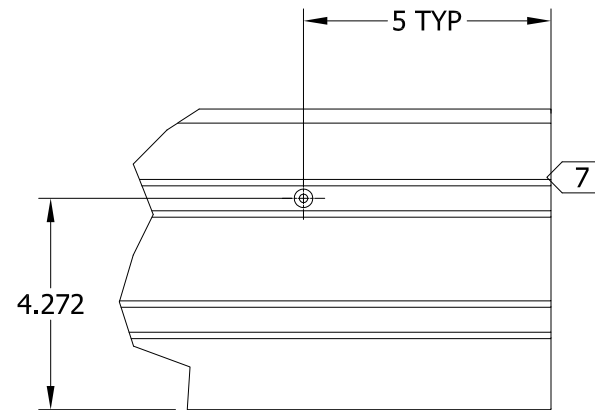


EXT ↓ DETAIL BA
SCALE 1 / 4

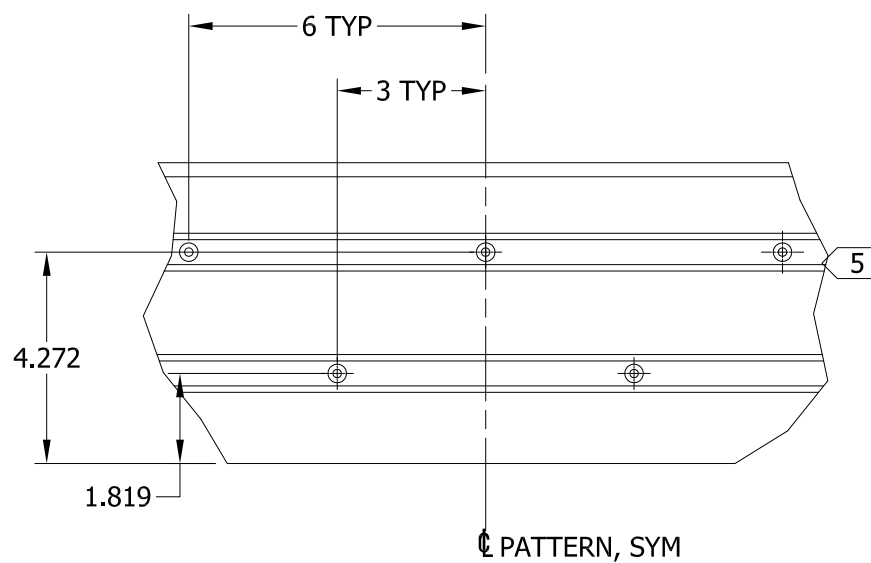

EXT ↓ DETAIL AV
SCALE 1 / 4

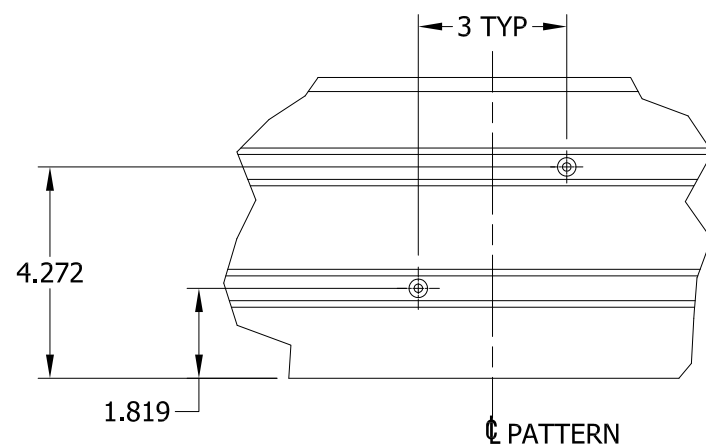


EXT ↓ DETAIL AW
SCALE 1 / 4

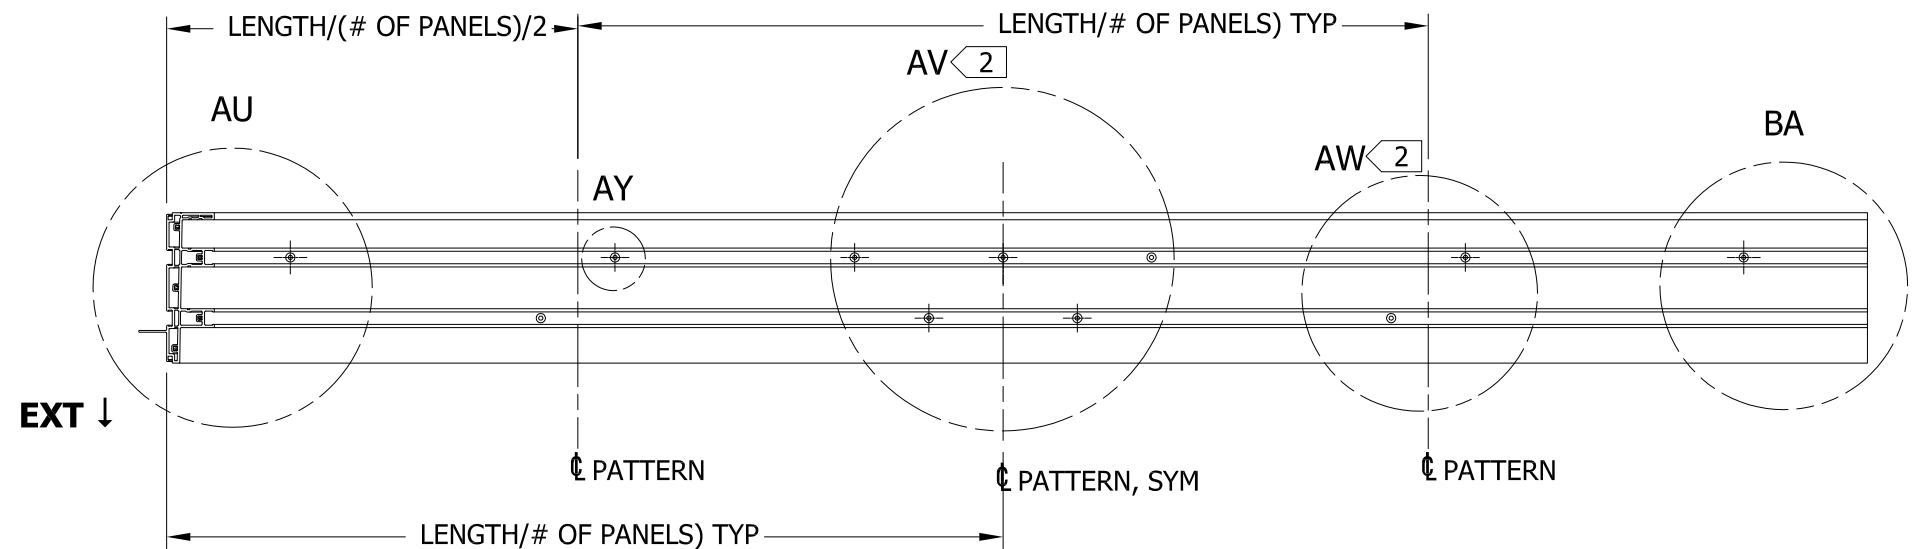

Ø.172 THRU TYP
└─┬─┘ Ø.375 ▽ FIRST & SECOND TYP

DETAIL AY TYPICAL HOLE
SCALE 1 / 2



HERMES F. NORERO
LICENSED PROFESSIONAL ENGINEER
No. 73778
STATE OF FLORIDA
HERMES F. NORERO, P.E.
398 East Dania Beach Blvd, Suite 338
Dania Beach, FL 33004

UNLESS SPECIFIED ALL DIMENSIONS IN INCHES
DO NOT SCALE DRAWING - REPORT ANY ERRORS

TOLERANCES (UNLESS SPECIFIED OTHERWISE) COMPONENT / PART TOLERANCES	
UNDER 10'-0" ± 1/32	.X ± .1
OVER 10'-0" ± 1/16	.XX ± .02
ANGULAR ± 1°	.XXX ± .006
UNIT ASSEMBLY TOLERANCES	
HEIGHT ± 1/16	WIDTH ± 1/16
MULLION ± 1/16	FRACTION ± 1/32

PROJECT ENGINEER:
N HERTZOG
DRAWN BY:
A BURWELL
CHECKED BY:
J JONES
APPROVED BY:
J JONES
IDENTIFIER No.


DATE:
9/11/2015
SCALE:
AS SHOWN

JELD-WEN
WINDOWS & DOORS
3737 Lakeport Blvd.
Klamath Falls, OR 97601
Phone: (541) 882-3451


TITLE: 2-TRACK FRAME MULTI-SLIDE PATIO DOOR SILL AND HEAD ANCHOR HOLES DETAIL	MODEL No.: P012967-334.ipt	DRAWING No.: P012967
© 2015 JELD-WEN, inc. ALL RIGHTS RESERVED. NO DUPLICATION OR DISTRIBUTION PERMITTED. JELD-WEN, inc. CONFIDENTIAL AND PROPRIETARY.		REV: B SHEET

NOTES:

- 1 ALL HOLES IN ALL POSITIONS TO BE CENTERED BETWEEN TRACK TOWERS AT SILL
- 2 TYP 1 ANCHOR PER PANEL LOCATED BETWEEN TRACK TOWERS AND ALIGNED WITH CENTER POINT OF EACH CLOSED POSITION PANEL
- 3 ANCHOR PATTERN LOCATED BETWEEN THE TRACK TOWERS AT EACH INTERLOCK AREA
- 4 1 ANCHOR AT ENDS LOCATED BETWEEN TRACK TOWERS ON SILL
- 5 TYP 5 ANCHOR PATTERN LOCATED BETWEEN TRACK TOWERS APPROXIMATE CENTER OF EACH CLOSED POSITION PANEL INTERLOCK AREA
- 6 CONFIGURATION FOR WELDED FRAME PG 60/65 DOORS WITH NAIL FIN OR THRU FRAME INSTALL
- 7 HEAD AND JAMB FOLLOW PG 60/65 FOR THRU FRAME OR NAIL FIN INSTALLATION

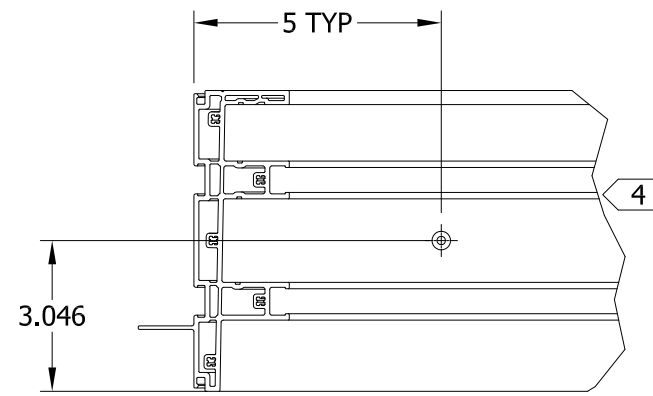


EXT ↓
DETAIL BD
SCALE 1 / 4

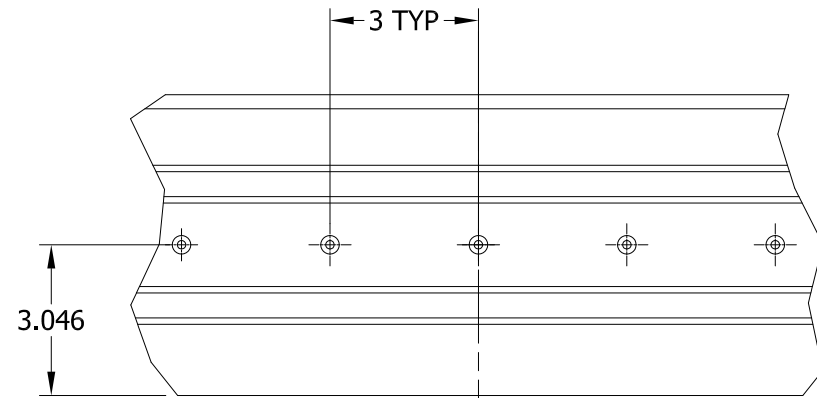


☺ PATTERN, SYM

EXT ↓
DETAIL BE
SCALE 1 / 4

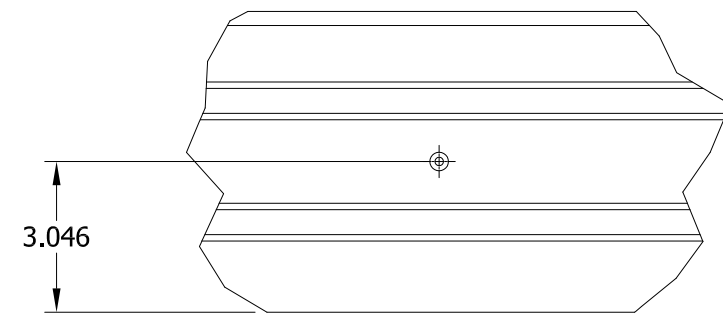


EXT ↓
DETAIL BF
SCALE 1 / 4

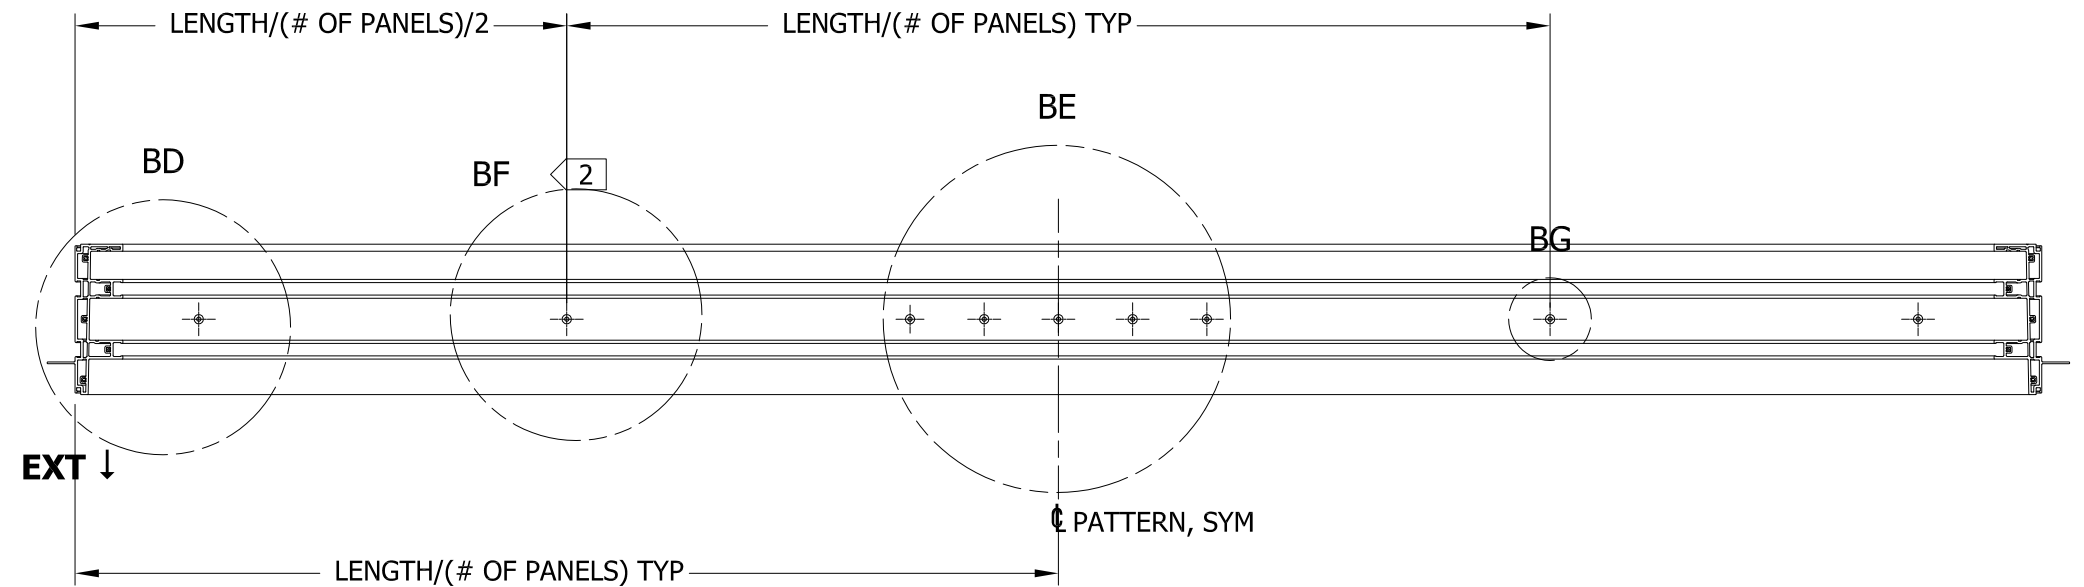

Ø.172 THRU TYP
└┘ Ø.375 ▽ SCREW BOSS TYP

DETAIL BG TYPICAL HOLE
SCALE 1 / 2

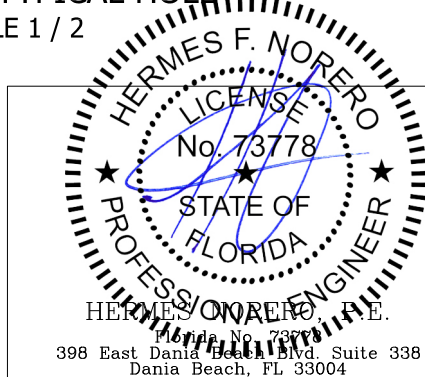

UNLESS SPECIFIED ALL DIMENSIONS IN INCHES
DO NOT SCALE DRAWING - REPORT ANY ERRORS

TOLERANCES (UNLESS SPECIFIED OTHERWISE)	
COMPONENT / PART TOLERANCES	
UNDER 10'-0" ± 1/32	.X ± .1
OVER 10'-0" ± 1/16	.XX ± .02
ANGULAR ± 1°	.XXX ± .006

UNIT ASSEMBLY TOLERANCES	
HEIGHT ± 1/16	WIDTH ± 1/16
MULLION ± 1/16	FRACTION ± 1/32

PROJECT ENGINEER:
N HERTZOG

DRAWN BY:
A BURWELL

CHECKED BY:
J JONES

APPROVED BY:
J JONES

IDENTIFIER No.

DATE:
9/11/2015

SCALE:
AS SHOWN

TITLE:

MODEL No.:

P012967-451.ipt



3737 Lakeport Blvd.
Klamath Falls, OR 97601
Phone: (541) 882-3451

2-TRACK FRAME
MULTI-SLIDE PATIO DOOR
6 SILL ANCHOR HOLES DETAIL

DRAWING No.: P012967

© 2015 JELD-WEN, inc. ALL RIGHTS RESERVED. NO DUPLICATION OR DISTRIBUTION PERMITTED. JELD-WEN, inc. CONFIDENTIAL AND PROPRIETARY. REV: B SHEET