

TIOGA DOORWAY SYSTEM TDS-S-KD-WS EXTERIOR VIEW

DESIGN PRESSURE RATING	IMPACT RATING	
±50PSF		
THIS SYSTEM WAS NOT TESTED FOR WATER INFILTRATION AND IS TO BE INSTALLED ONLY WHERE THE WATER REQUIREMENT IS NOT NEEDED	LARGE AND SMALL MISSILE IMPACT	


NOTES:

- 1) THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH REQUIREMENTS OF THE FLORIDA BUILDING CODE INCLUDING
- 2) STEEL FRAMING AND CONCRETE OPENING TO BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO STRUCTURE. FRAMING AND CONCRETE OPENING IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD
- 3) BUILDING GIRT AND OPTIONAL INTERMEDIATE BUILDING GIRT TO BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO STRUCTURE. BUILDING GIRT AND OPTIONAL INTERMEDIATE GIRT ARE THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.
- 4) ALLOWABLE STRESS INCREASE OF 1/3 WAS NOT USED IN THE DESIGN OF THE PRODUCT SHOWN HEREIN. WIND LOAD DURATION FACTOR Cd=1.6 WAS USED FOR WOOD ANCHOR CALCULATIONS.
- 5) FRAME MATERIAL: FORMED 16GA. (.053" MIN.) GALVANNEALED STEEL.
- 6) DOOR PANEL MATERIAL: FORMED 20GA. (.036" MIN.) GALVANNEALED STEEL.
- 7) APPROVED IMPACT PROTECTIVE SYSTEM IS NOT REQUIRED FOR THIS PRODUCT IN WIND BORNE DEBRIS REGIONS.
- 8) EACH PANEL IS FITTED WITH THREE HINGES LOCATED AT 6" MINIMUM UPTO 10" MAXIMUM FROM EACH END WITH ONE AT PANEL MIDSPAN.

HARDWARE SCHEDULE			
A. ML 1300 MORTISE LOCK BY TELL MANUFACTURING, INC.			
B. RIM PANIC DEVICE 9500 SERIES BY TELL MANUFACTURING, INC.			
C. CYLINDRICAL LOCK LC1200 SERIES BY TELL MANUFACTURING, INC.			
D. STEEL HINGES H4545 BY TELL MANUFACTURING, INC.			
E. ALUMINUM THRESHOLD 1/2" HIGH BY HOUSTON NON-FERROUS			

ITEMS A, B AND C ARE INTERCHANGEABLE

TABLE OF CONTENTS					
SHEET NO.	DESCRIPTION				
1	ELEVATION, ANCHORING LAYOUT AND NOTES				
2	DETAILS AND NOTES				
3	BILL OF MATERIALS AND CROSS SECTION				
4	CROSS SECTION				
5 - 6	INSTALLATION DETAILS				
7 - 8	COMPONENTS				



Phone: 321.690.1788 | Email: info@ptc-corp.com


DRAFTER DATE TELL DOORS & WINDOWS, LLC. 6535 GUHN RD, STE 100, HDUSTON, TX 77040 CHECKED DATE TITLE TIOGA DOORWAY SYSTEM TDS-S-KD-WS OS STEEL SINGLE DOOR - IMPACT DATE ENGINEER ELEVATION, ANCHORING LAYOUT AND NOTES 06/28/10 TJH APPROVED DATE 08-01020 R.J.A. 10/17/23 ELEASE STATE THIRD ANGLE PROJECTION FINAL SCALE NTS SHEET 1 OF 8


Spectrum

MFG


THIS DOCUMENT IS THE PROPERTY OF SPECTRUM BRANDS, INC AND/OR ITS AFFILIATES. THE CONTENTS OF THIS DOCUMENT ARE CONFIDENTIAL AND CONSTITUTE TRADE SCERETS PROPERETARY TO SPECTRUM BRANDS. NEITHER THIS DOCUMENT NOR ITS CONTENTS SHALL BE DISCLUSED TO ANY UNAUTHORIZED PERSON, CUPIED, OR PUBLISHED VITHOUT SPECTRUM BRANDS PRIOR VRITTEN CONSENT.


TELL MANUFACTURING, INC. 18 RICHARD DRIVE, LITITZ, PA 17543

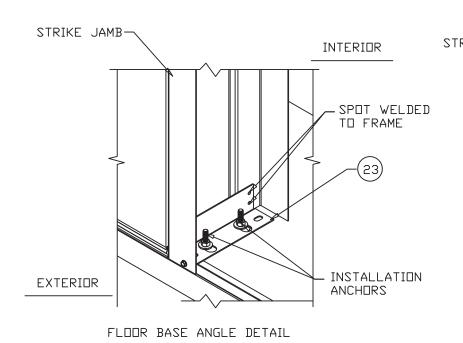

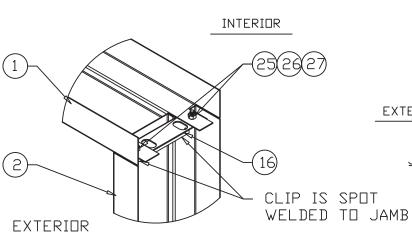


CORNER CONSTRUCTION DETAIL

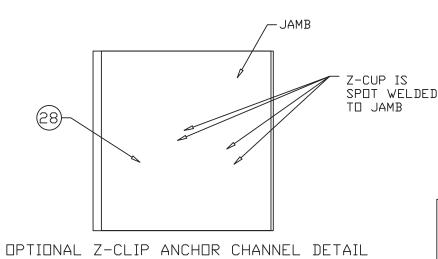

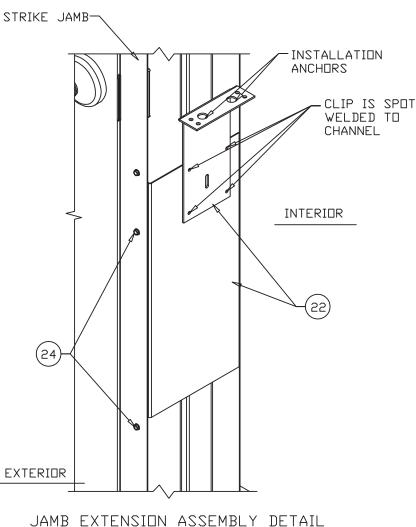


NOTE

- 1) FOR ANCHORING JAMB EXTENSION ASSEMBLY TO 16GA. (.060" MIN.) STEEL FRAMING USE 5/16"-18 BOLT WITH 5/16"-18 NUT AND 5/16" WASHER. BOLT TO BE OF SUFFICIENT LENGTH TO ACHIEVE 3-THREADS MINIMUM BEYOND NUT. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
- 2) FOR ANCHORING OPTIONAL Z-CLIP AND HI-HAT ANCHOR CHANNELS TO 16GA. (.060" MIN.) STEEL FRAMING USE (2) 5/16" SELF TAPPING SCREWS OR (4) #12 TEK SCREWS, BOTH OF SUFFICIENT LENGTH TO ACHIEVE 3-THREADS MINIMUM BEYOND ANCHOR CHANNELS. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS. SEE NOTE SHEET 6.
 3) FOR ANCHORING FLOOR BASE ANGLE INTO CONCRETE USE:
- 5/16" MINIMUM 90' L-BOLT SET IN CONCRETE WITH 5/16" NUT AND WASHER. BOLT TO BE OF SUFFICIENT LENGTH TO ACHIEVE 6" MINIMUM EMBEDMENT INTO CONCRETE AND 3-THREADS MINIMUM BEYOND NUT AND WASHER WITH 2 3/4" MINIMUM EDGE DISTANCE. 90' L-BOLT TO BE MINIMUM A36 STEEL.
- 3/8" HILTI KWIK BOLT 3 OF SUFFICIENT LENGTH TO ACHIEVE 2 1/2" MINIMUM EMBEDMENT INTO CONCRETE WITH 4 1/2" MINIMUM EDGE DISTANCE
- 3/8" WEDGE BOLT OF SUFFICIENT LENGTH TO ACHIEVE 2" MINIMUM EMBEDMENT INTO CONCRETE WITH 4 1/2" MINIMUM EDGE DISTANCE.
- 5/16" ITW TAPCON OF SUFFICIENT LENGTH TO ACHIEVE 1 3/4" MINIMUM EMBEDMENT INTO CONCRETE WITH 3 3/16" MINIMUM EDGE DISTANCE. LOCATE ALL ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
- 4) FOR ANCHORING THRESHOLD INTO CONCRETE USE 3/16" ITW TAPCONS WITH SUFFICIENT LENGTH TO ACHIEVE A 1 3/4" MINIMUM EMBEDMENT INTO SUBSTRATE WITH 2 1/4" MINIMUM EDGE DISTANCE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
- 5) FOR ANCHORING JAMB EXTENSION ASSEMBLY, FLOOR BASE ANGLE, OPTIONAL Z-CLIP ANCHOR CHANNEL OR OPTIONAL HI-HAT ANCHOR CHANNEL TO WOOD SUBSTRATE USE 5/16" LAG SCREW WITH MINIMUM EMBEDMENT OF 1-3/4", MINIMUM EDGE DISTANCE OF 1-1/4" AND MINIMUM SPACING OF 1-1/4". LOCATE ALL ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
- 6) WASHERS SHALL BE USED WHEN ANCHORS ARE INSTALLED IN OVERSIZE HOLES (CLIP HOLE DIAMETER 1/16" GREATER DIAMETER THAN ANCHOR DIAMETER).
- 7) MINIMUM 2 ANCHORS PER JAMB EXTENSION ASSEMBLY, FLOOR BASE ANGLE, OPTIONAL Z-CLIP ANCHOR CHANNEL OR OPTIONAL HI-HAT ANCHOR CHANNEL FOR ATTACHMENT TO SUPPORTING SUBSTRATE.
- 8) ALL FASTENERS TO BE CORROSION RESISTANT.
- 9) INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS, AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BELOW:
- A. WOOD MINIMUM SPECIFIC GRAVITY OF G=0.42 (NON-HVHZ) AND G=0.55 (HVHZ).
- B. CONCRETE MINIMUM COMPRESSIVE STRENGTH OF 3,192 PSI.
- C. STEEL FRAMING, 16GA. (.060" MIN.)

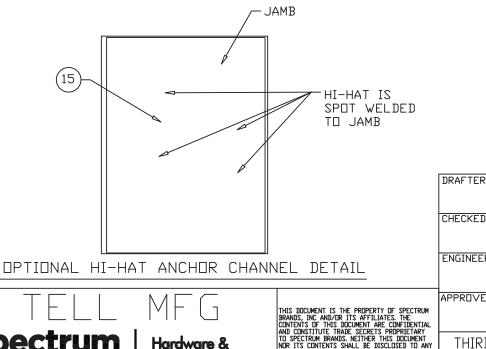


Home Improvement





TELL MANUFACTURING, INC.
18 RICHARD DRIVE, LITITZ, PA 17543

PTC PRODUCT DESIGN GROUP, LLC PO BOX 520775 | LONGWOOD, FLORIDA 32752 FBPE C.A. NO. 25935 Phone: 321.690.1788 | Email: info@ptc-corp.com

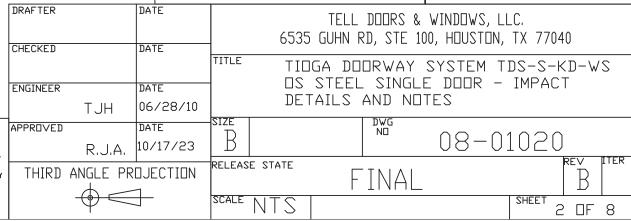

PARTS LIST				
N□.	PART NUMBER	DESCRIPTION	MANUFACTURER	MATERIAL
1	T-1.3.1	TIOGA KD HEAD JAMB 16GA.	TELL MANUFACT.	GALVANNEALED STEEL
2	T-1.2	TIOGA KD HINGE JAMB 16GA.	TELL MANUFACT.	GALVANNEALED STEEL
3	T-1.7	THESHOLD, 1/2" HIGH	HOUSTON NON-FER.	ALUMINUM 6063-T5
4	T-1.2.2	FRAME HINGE REINFORCEMENT 10GA.	DAYTON INDUSTRIES	GALVANNEALED STEEL
5	T-1.1.1	TIOGA BOTTOM DOOR SKIN 20GA.	TELL MANUFACT.	GALVANNEALED STEEL
6	T-1.1.2	TIOGA TOP DOOR SKIN 20GA.	TELL MANUFACT.	GALVANNEALED STEEL
7	T-1.1.3	TOP CAP DOOR CHANNEL 20GA.	TELL MANUFACT.	GALVANNEALED STEEL
8	T-1.1.4	TOP DOOR CHANNEL 16GA.	TELL MANUFACT.	GALVANNEALED STEEL
9	T-1.1.5	BOTTOM DOOR CHANNEL 16GA.	TELL MANUFACT.	GALVANNEALED STEEL
10	T-1.1.6	DOOR HINGE REINFORCEMENT 10GA.	DAYTON INDUSTRIES	GALVANNEALED STEEL
11	T-1.1.7	DOOR FOAM CORE 1 LB/FT DENSITY		POLYSIYRENE
12	T-1.1.8	DOOR CLOSER REINFORCEMENT 12GA.	TELL MANUFACT.	GALVANNEALED STEEL
13	T-1.1.10	MORTISE LOCK REINFORCEMENT 14GA.	TELL MANUFACT.	GALVANNEALED STEEL
14	T-1.4	TIOGA KD STRIKE JAMB 16GA.	TELL MANUFACT.	GALVANNEALED STEEL
15		HI HAT ANCHOR CHANNEL 16GA	TELL MANUFACT.	GALVANNEALED STEEL
16	T-1.2.3	HINGE JAMB CLIP 12GA	TELL MANUFACT.	GALVANNEALED STEEL
17	T-1.2.4	FRAME WEATHERSTRIPPING		FOAM
18	T-1.5	HINGES - H4545 SERIES	TELL MANUFACT.	STEEL
19	T-1.68	MORTISE LOCK ML 1300	TELL MANUFACT.	STEEL
20	T-1.6A	CYLINDRICAL LOCK LC1Z00 SERIEST	TELL MANUFACT.	
21	T-1.8	DOOR SWEEP, DT100101	TELL MANUFACT.	ALUMINUM 6063-T5
22	T-2	JAMB EXTENSION ASSEMBLY 16 / 12GA	TELL MANUFACT.	GALVANNEALED STEEL
23		FLOOR BASE ANGLE		GALVANNEALED STEEL
24	S1	#12-24 X 1 1/4" HEX HEAD TEK		STEEL
25	B1	5/16"-18 X 3/4" HEX CAP SCREW		STEEL
26	N1	HEX NUT 5/16"		STEEL
27	W1	FLAT WASHER 5/16"		STEEL
28		Z-CLIP ANCHOR CHANNEL 16GA	TELL MANUFACT.	STEEL
29	25	#14 X 1/2" PFH SMS		STEEL
30	T-1.4.3	STRIKE JAMB CLIP 12GA.	TELL MANUFACT.	GALVANNEALED STEEL
31	T.1.6C	RIM PANIC DEVICE 9500 SERIES	TELL MANUFACT.	
32	T-1.1.9	CYLNDRICAL LOCK REINFORCE, 16GA	TELL MANUFACT.	GALVANNEALED STEEL

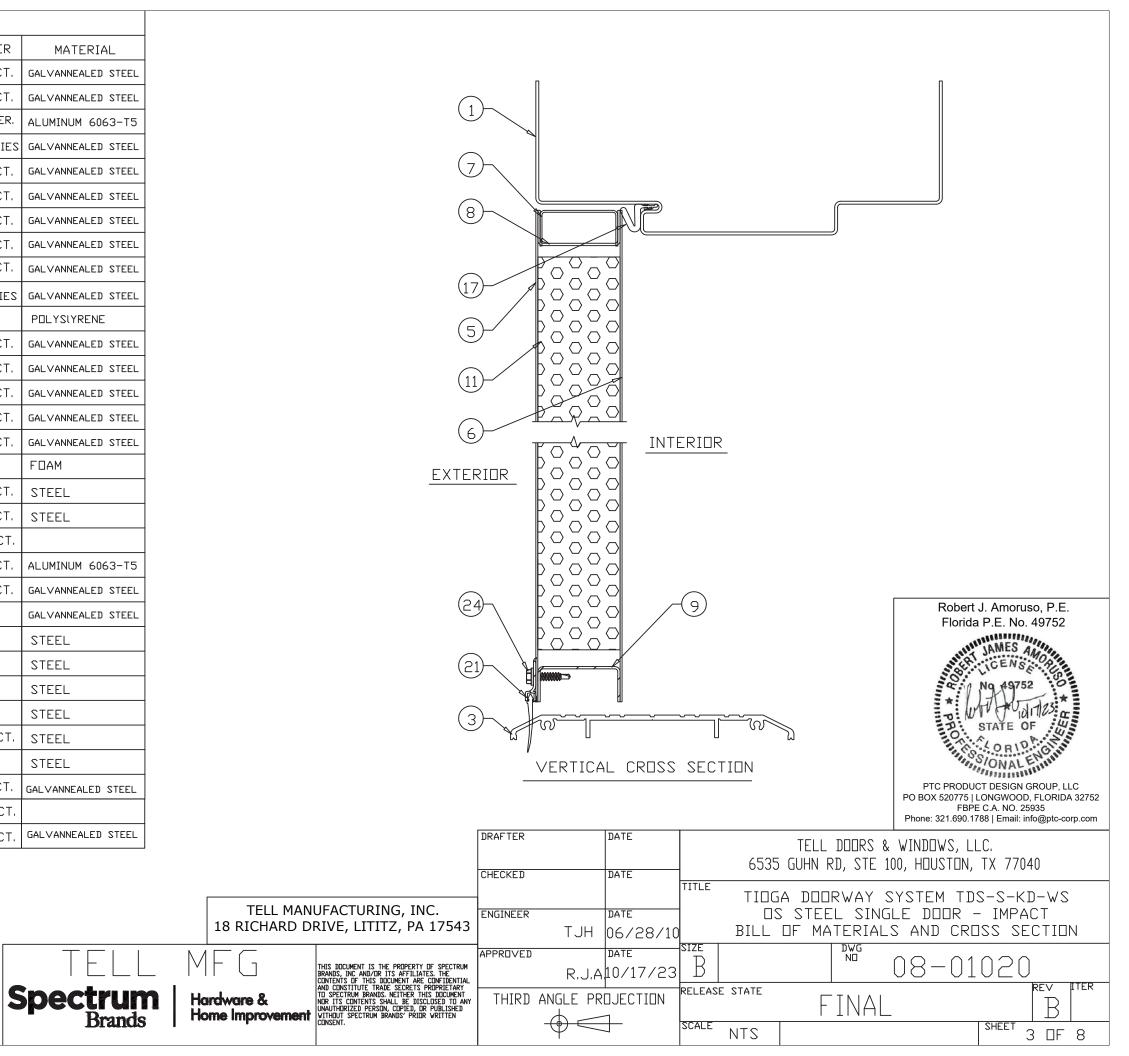

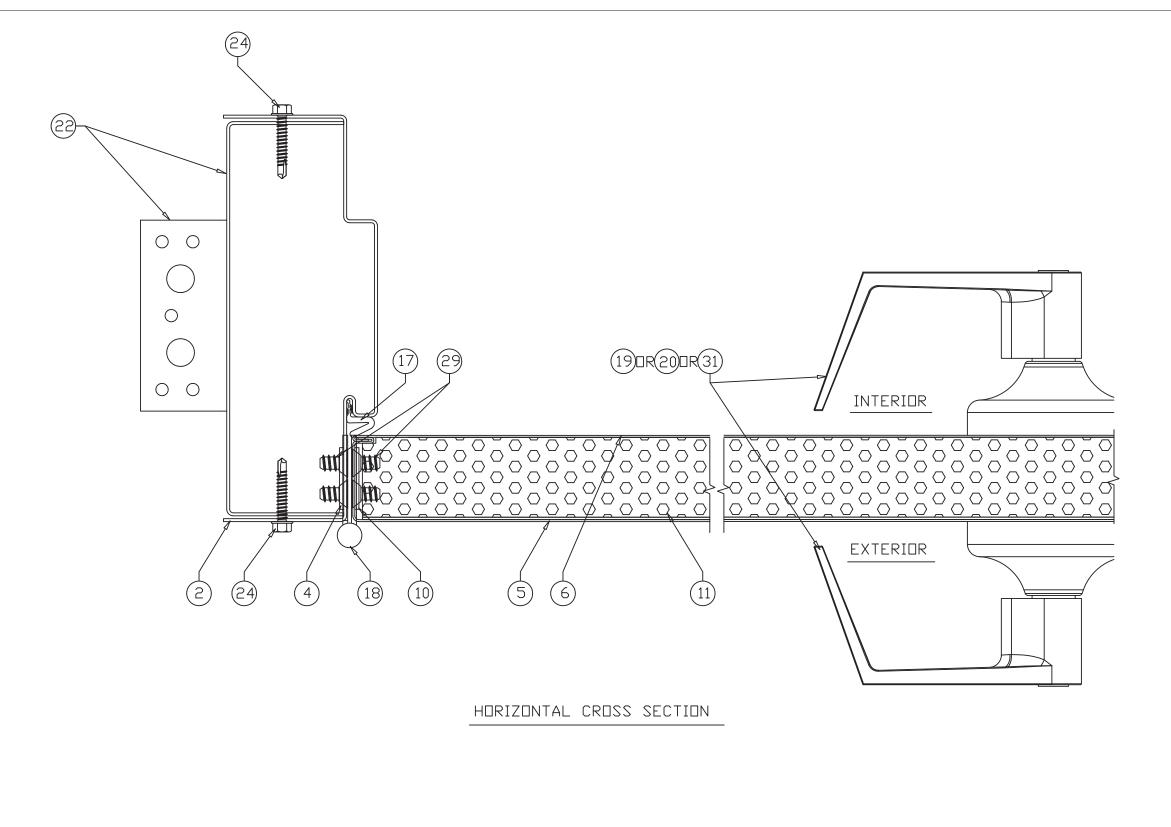

Robert J. Amoruso, P.E. Florida P.E. No. 49752



PTC PRODUCT DESIGN GROUP, LLC
PO BOX 520775 | LONGWOOD, FLORIDA 32752
FBPE C.A. NO. 25935
Phone: 321.690.1788 | Email: info@ptc-corp.com

DRAFTER DATE TELL DOORS & WINDOWS, LLC. 6535 GUHN RD, STE 100, HDUSTON, TX 77040 CHECKED DATE TIOGA DOORWAY SYSTEM TDS-S-KD-WS TELL MANUFACTURING, INC. 18 RICHARD DRIVE, LITITZ, PA 17543 OS STEEL SINGLE DOOR - IMPACT ENGINEER DATE CROSS SECTION TJH 06/28/10 DWG ND APPROVED 08-01020 THIS DOCUMENT IS THE PROPERTY OF SPECTRUM BRANDS, INC AND/OR ITS AFFILIATES. THE CONTENTS OF THIS DOCUMENT ARE CONFIDENTIAL AND CONSTITUTE TRADE SECRETS PROPRIETARY TO SPECTRUM BRANDS. NEITHER THIS DOCUMENT WOR ITS CONTENTS SHALL BE DISCLOSED TO ANY UNAUTHORIZED PERSON, COPIED, OR PUBLISHED VITHOUT SPECTRUM BRANDS' PRIOR VRITTEN CONSENT. R.J.A. 10/17/23 RELEASE STATE Spectrum Brands THIRD ANGLE PROJECTION FINAL SCALE NTS SHEET 4 DF 8

