






1. EVALUATED FOR USE IN LOCATIONS ADHERING TO THE FLORIDA BUILDING CODE, EXCLUDING THE HIGH VELOCITY HURRICANE ZONE AND WHERE PRESSURE REQUIREMENTS AS DETERMINED BY ASCE 7, MINIMUM DESIGN LOADS FOR BUILDINGS AND OTHER STRUCTURES, DOES NOT EXCEED THE DESIGN PRESSURES LISTED.
2. WHEN INSTALLED IN THE WIND-BORNE DEBRIS REGION, HURRICANE PROTECTIVE SYSTEM IS NOT REQUIRED.
3. MAXIMUM GLASS SIZES COMPLY WITH ASTM E1300 FOR THE DESIGN PRESSURES LISTED.

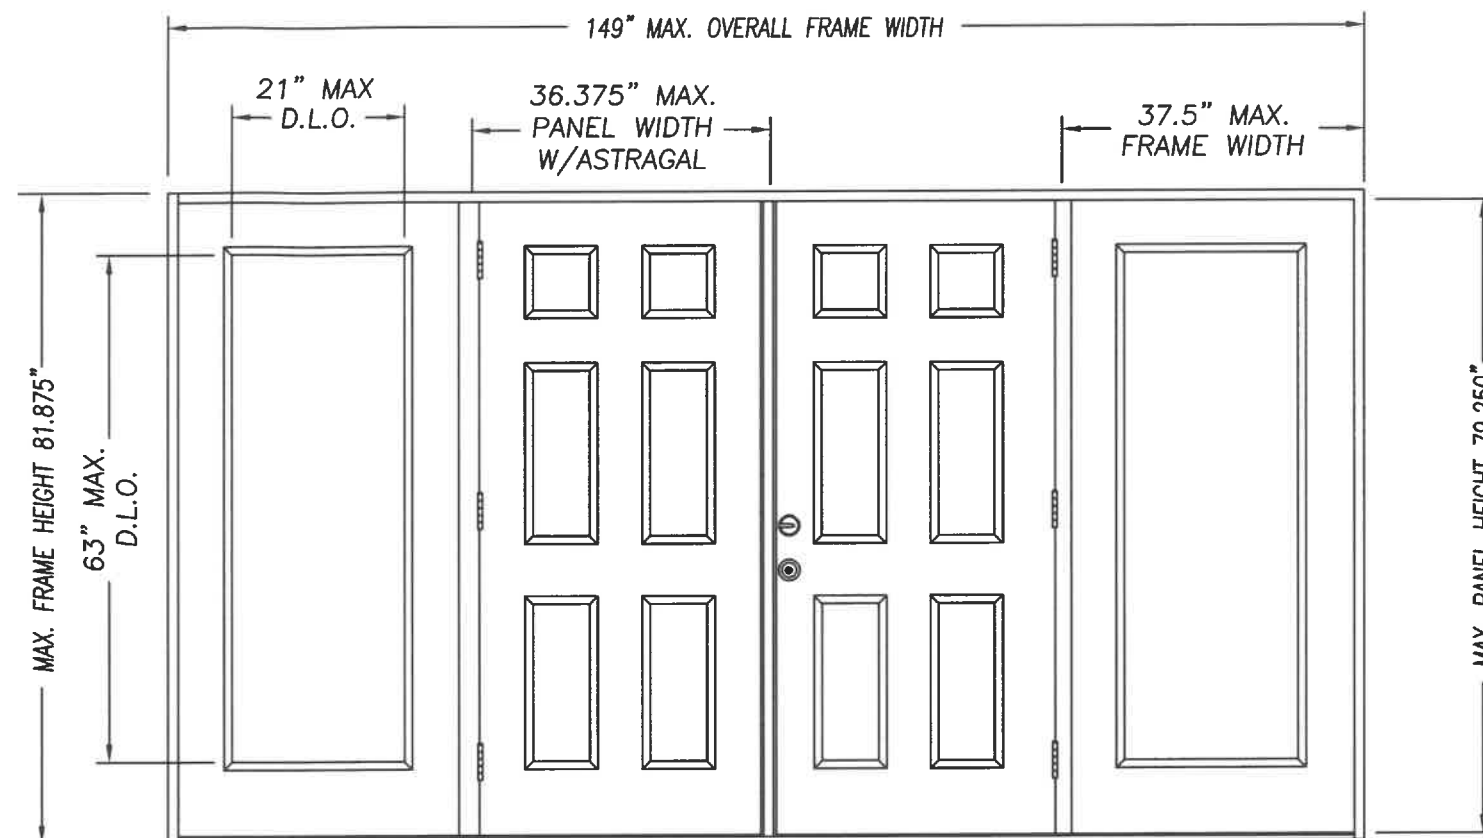


DOUBLE DOOR UNIT W/SIDELITES

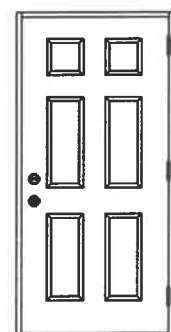


SINGLE DOOR UNIT

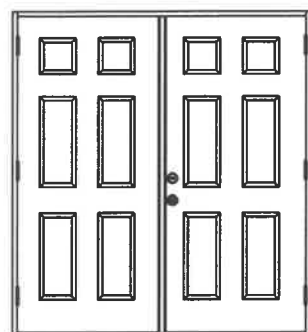


DOUBLE DOOR UNIT

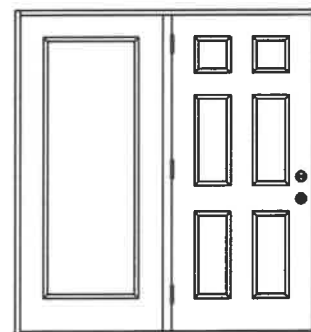


SINGLE DOOR UNIT
WITH SIDELITE

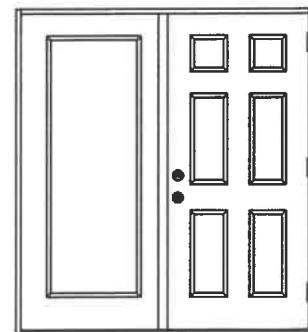

SINGLE DOOR UNIT
WITH SIDELITE

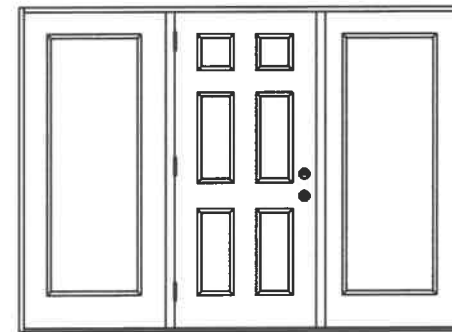


SINGLE DOOR UNIT W/SIDELITES

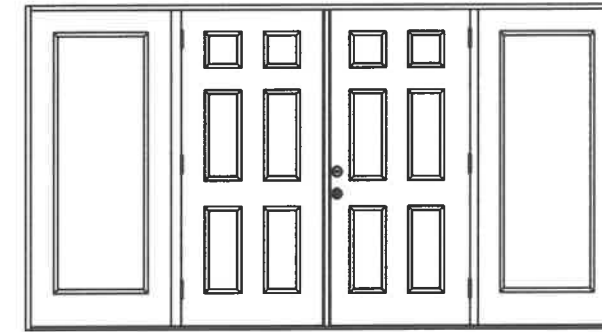

DOUBLE DOOR UNIT W/SIDELITES

		DESIGN PRESSURE RATING	
CONFIG	MAX WIDTH	INSWING	OUTSWING
X	37.5"	+60.0 / -65.0	+60.0 / -60.0
XX	74"	+50.0 / -50.0	+50.0 / -50.0
OX or XO	75"	+50.0 / -50.0	+50.0 / -50.0
OXO	112.5"	+50.0 / -50.0	+50.0 / -50.0
OOXO	149"	+50.0 / -50.0	+50.0 / -50.0

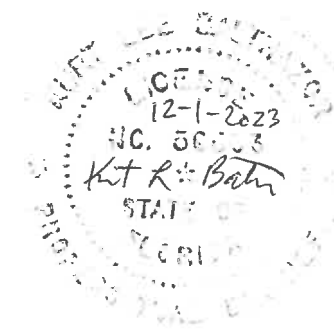

KURT BALTHAZOR
FLORIDA P.E.
#56533

TABLE OF CONTENTS	
SHEET #	DESCRIPTION
1	TYPICAL ELEVATIONS & GENERAL NOTES
2	ANCHORING LOCATIONS & DETAILS
3	ANCHORING LOCATIONS & DETAILS

DATE: 10/10/22										PRODUCT:	
SCALE: N.T.S.										"EXTERIOR DOOR PRODUCT"	
DWG. BY: SWS										DOUBLE 6'8" OPAQUE	
CHK. BY:										FIBERGLASS DOOR	
DRAWING NO.:										PART OR ASSEMBLY:	
DWG-MA-FLO255-2		A		11/21/23		INNERLAYER NOA		SWS		TYPICAL ELEVATIONS	
		NO.		DATE				BY		& GENERAL NOTES	
SHEET 1 OF 4											



DATE:	10/10/22
CALE:	N.T.S.
WG. BY:	SWS
HK. BY:	
DRAWING NO.:	
DWG-MA-FL0255-22	
SHEET	4 OF 4