




WOOD-EDGE STEEL DOOR UNIT
6'-8" DOUBLE DOOR WITH / WITHOUT SIDELITES

GENERAL NOTES

- EVALUATED FOR USE IN LOCATIONS ADHERING TO THE FLORIDA BUILDING CODE AND WHERE PRESSURE REQUIREMENTS AS DETERMINED BY ASCE 7, MINIMUM DESIGN LOADS FOR BUILDINGS AND OTHER STRUCTURES, DOES NOT EXCEED THE DESIGN PRESSURES LISTED.
- WHEN INSTALLED IN THE WIND-BORNE DEBRIS REGION OR THE HIGH VELOCITY HURRICANE ZONE (HVHZ), HURRICANE PROTECTIVE SYSTEM IS NOT REQUIRED ON OPAQUE PANELS, BUT IS REQUIRED ON SIDELITES.
- POLYURETHANE CORE FLAME SPREAD INDEX OF 50 AND SMOKE DEVELOPED INDEX OF 60 PER ASTM E84.
- PLASTICS TESTING:

TEST DESCRIPTION	DESIGNATION	LITE FRAME
SELF IGNITION TEMP	ASTM D1929	740 °F > 650 °F
RATE OF BURNING	ASTM D635	0.77 IN/MIN
SMOKE DENSITY	ASTM D2843	13.4%
TENSILE STRENGTH*	ASTM D638	7.1% DIFF


* COMPARATIVE TENSILE STRENGTH AFTER WEATHERING
4500 HOURS XENON ARC METHOD 1

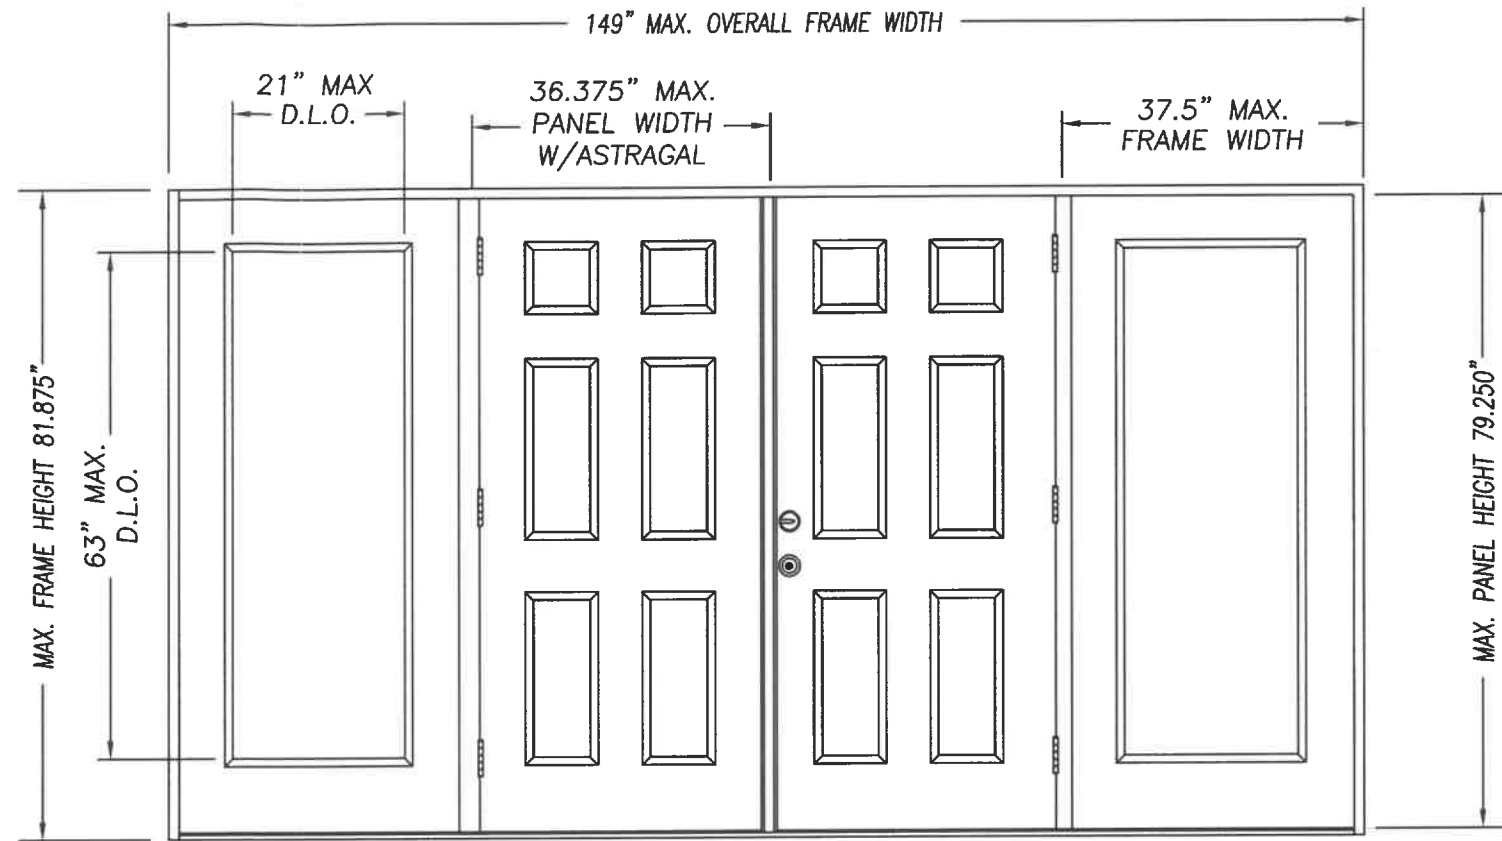


DOUBLE DOOR UNIT W/SIDELITES




SINGLE DOOR UNIT

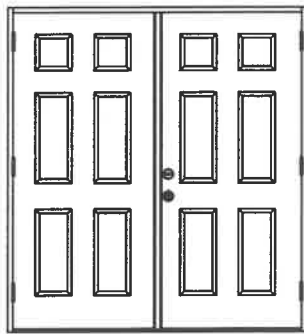


DOUBLE DOOR UNIT

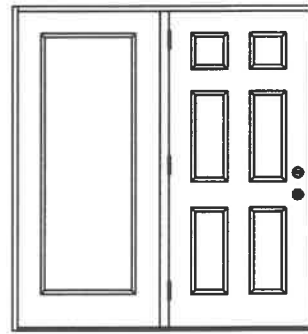


SINGLE DOOR UNIT
WITH SIDELITE

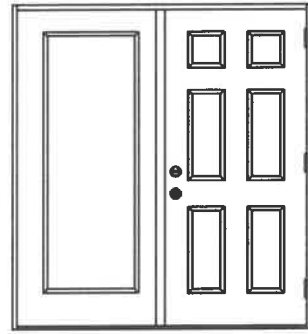

SINGLE DOOR UNIT
WITH SIDELITE

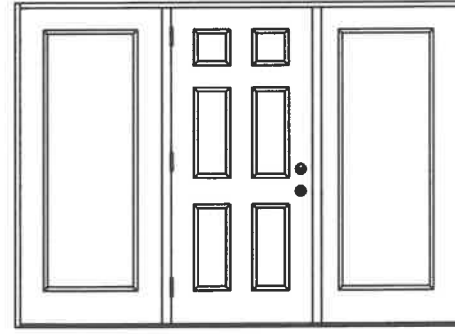


SINGLE DOOR UNIT W/SIDELITES

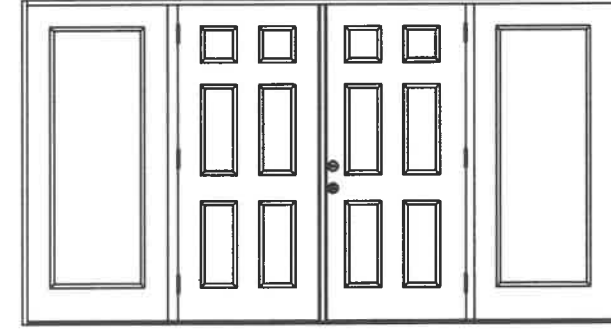

DOUBLE DOOR UNIT W/SIDELITES

CONFIG	MAX WIDTH	DESIGN PRESSURE RATING (1:1 OVERHANG OR WHERE NO WATER REQUIRED)		WHERE WATER INFILTRATION PERFORMANCE IS REQUIRED TO BE 15% OF DESIGN PRESSURE					
		INSWING	OUTSWING	BUMPER O/S	Z-SERIES O/S	HIGH DAM O/S	T4 O/S	HP BUMP O/S	
X	37.5"	+70.0 / -70.0	+70.0 / -70.0	+20.0 / -20.0	+30.0 / -30.0	+50.0 / -50.0	+50.0 / -50.0	+50.0 / -50.0	
XX	74"	+55.0 / -55.0	+55.0 / -55.0	+20.0 / -20.0	+30.0 / -30.0	+50.0 / -50.0	N/A	N/A	
OX or XO	75"	+55.0 / -55.0	+55.0 / -55.0	+20.0 / -20.0	+30.0 / -30.0	+50.0 / -50.0	N/A	N/A	
OXO	112.5"	+55.0 / -55.0	+55.0 / -55.0	+20.0 / -20.0	+30.0 / -30.0	+50.0 / -50.0	N/A	N/A	
OX XO	149"	+55.0 / -55.0	+55.0 / -55.0	+20.0 / -20.0	+30.0 / -30.0	+50.0 / -50.0	N/A	N/A	

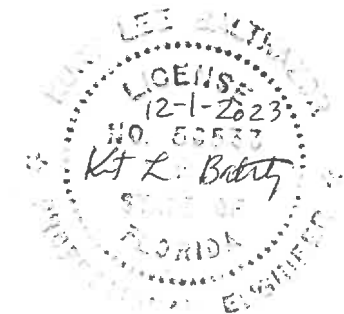

PRODUCT:
"EXTERIOR DOOR PRODUCT"
DOUBLE 6'8" OPAQUE
WOOD-EDGE STEEL DOOR

PART OR ASSEMBLY:
TYPICAL ELEVATIONS
& GENERAL NOTES

DATE	BY	REVISIONS
7/18/20	SWS	MISC EDITS
4/6/18	SWS	ADDED THRESHOLDS
DATE	BY	
NO.		

DATE: 5/26/17

SCALE: N.T.S.

DWG. BY: SWS

CHK. BY:

DRAWING NO.:



DWG-MA-FLO211-17

SHEET 1 OF 3


MASONITE INTERNATIONAL CORP.
1955 POWIS ROAD
WEST CHICAGO, IL 60185

TABLE OF CONTENTS


SHEET #	DESCRIPTION
1	TYPICAL ELEVATIONS & GENERAL NOTES
2	ANCHORING LOCATIONS & DETAILS
3	ANCHORING LOCATIONS & DETAILS

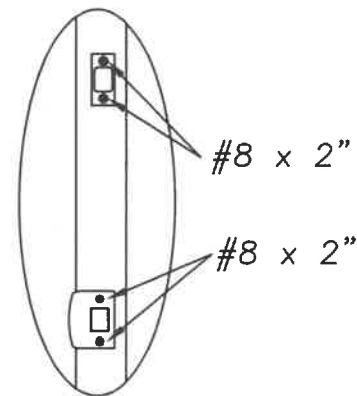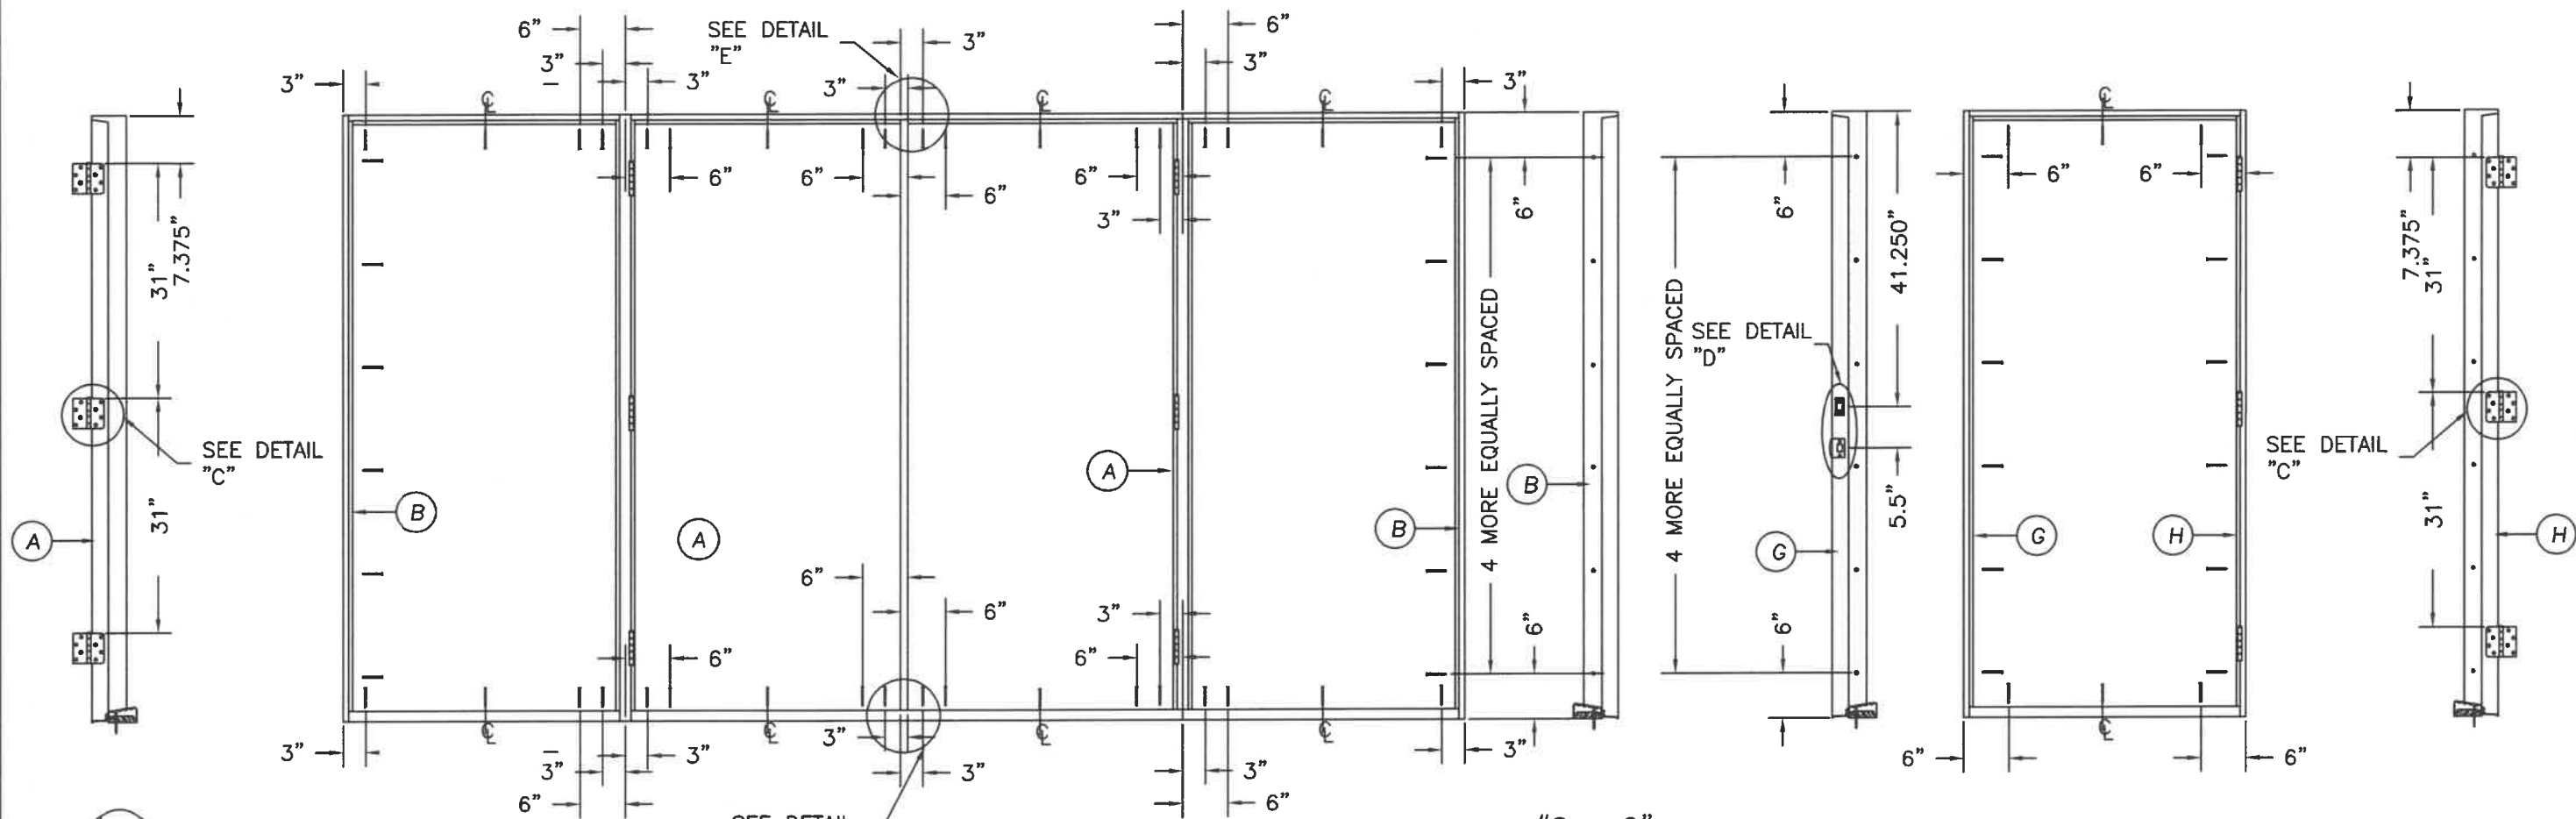


DETAIL "D"

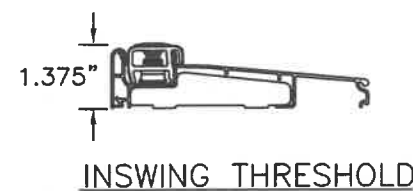


INSWING THRESHOLD

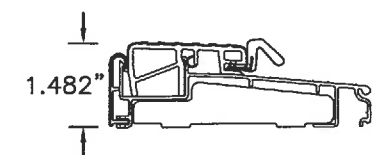


Z-SERIES O/S THRESHOLD

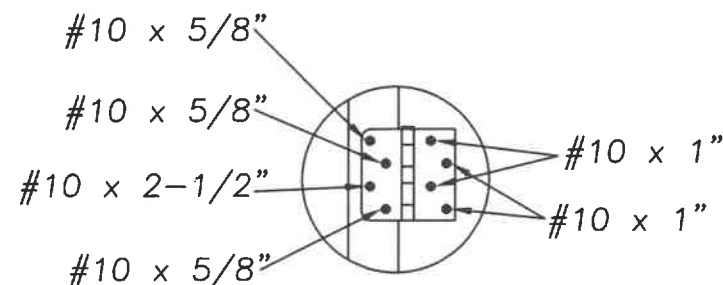


DETAIL "C"

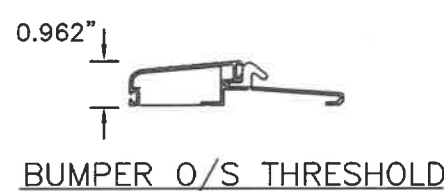


BUMPER O/S THRESHOLD

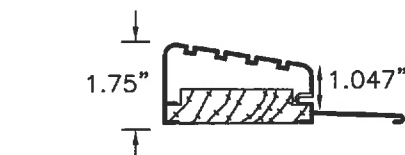


HIGH DAM O/S THRESHOLD

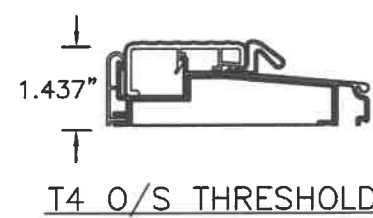


T4 O/S THRESHOLD

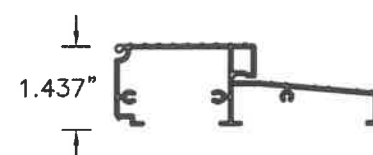

HP O/S THRESHOLD

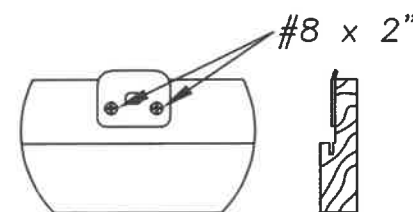


DETAIL "E" ASTRAGAL
ATTACH ASTRAGAL RETAINER BOLT
STRIKE PLATE TO FRAME
AS SHOWN.



DETAIL "F" ASTRAGAL

ASTRAGAL RETAINER BOLT HOLE
MUST BE DRILLED THROUGH
THE THRESHOLD & INTO THE
STRUCTURE DEEP ENOUGH
FOR A 1.375" THROW

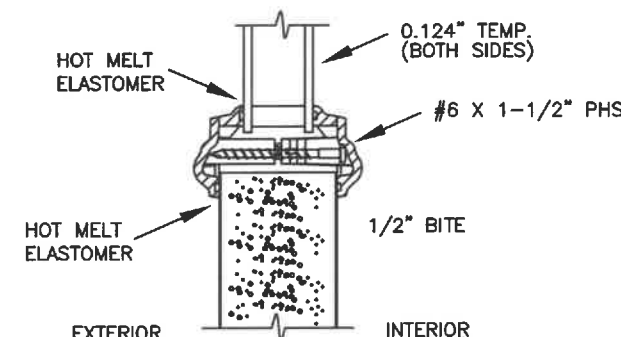

EXTERIOR INTERIOR
TYPICAL GLAZING DETAIL
NON-IMPACT GLASS

MAX GLASS SIZES COMPLY WITH ASTM E1300
FOR DESIGN PRESSURES LISTED ON PAGE 1

MASONITE INTERNATIONAL CORP. 1955 POWIS ROAD WEST CHICAGO, IL 60185			
PRODUCT: "EXTERIOR DOOR PRODUCT" 6'-8" WOOD-EDGE STEEL OPAQUE DOUBLE DOOR UNIT		PART OR ASSEMBLY: ANCHORING LOCATIONS & DETAILS	
		SWS	BY
		MISC EDITS	ADDED THRESHOLDS
		7/18/20	4/6/18
		B	A
		NO.	DATE
			REVISIONS
DATE: 5/26/17 SCALE: N.T.S. DWG. BY: SWS CHK. BY: DRAWING NO.: DWG-MA-FLO211-17 SHEET 2 OF 3			

PRODUCT:
"EXTERIOR DOOR PRODUCT"
6'-8" WOOD-EDGE STEEL OPAQUE
DOUBLE DOOR UNIT

PART OR ASSEMBLY:
ANCHORING LOCATIONS
& DETAILS

NO.	DATE	BY	SWS	SWS	BY
B	7/18/20	ANCHOR CORRECTION			
A	4/6/18	ADDED THRESHOLDS			
		REVISIONS			

DATE: 5/26/17

SCALE: N.T.S.


DWG. BY: SWS

CHK. BY:

DRAWING NO.:

DWG-MA-FL0211-17

SHEET 3 OF 3

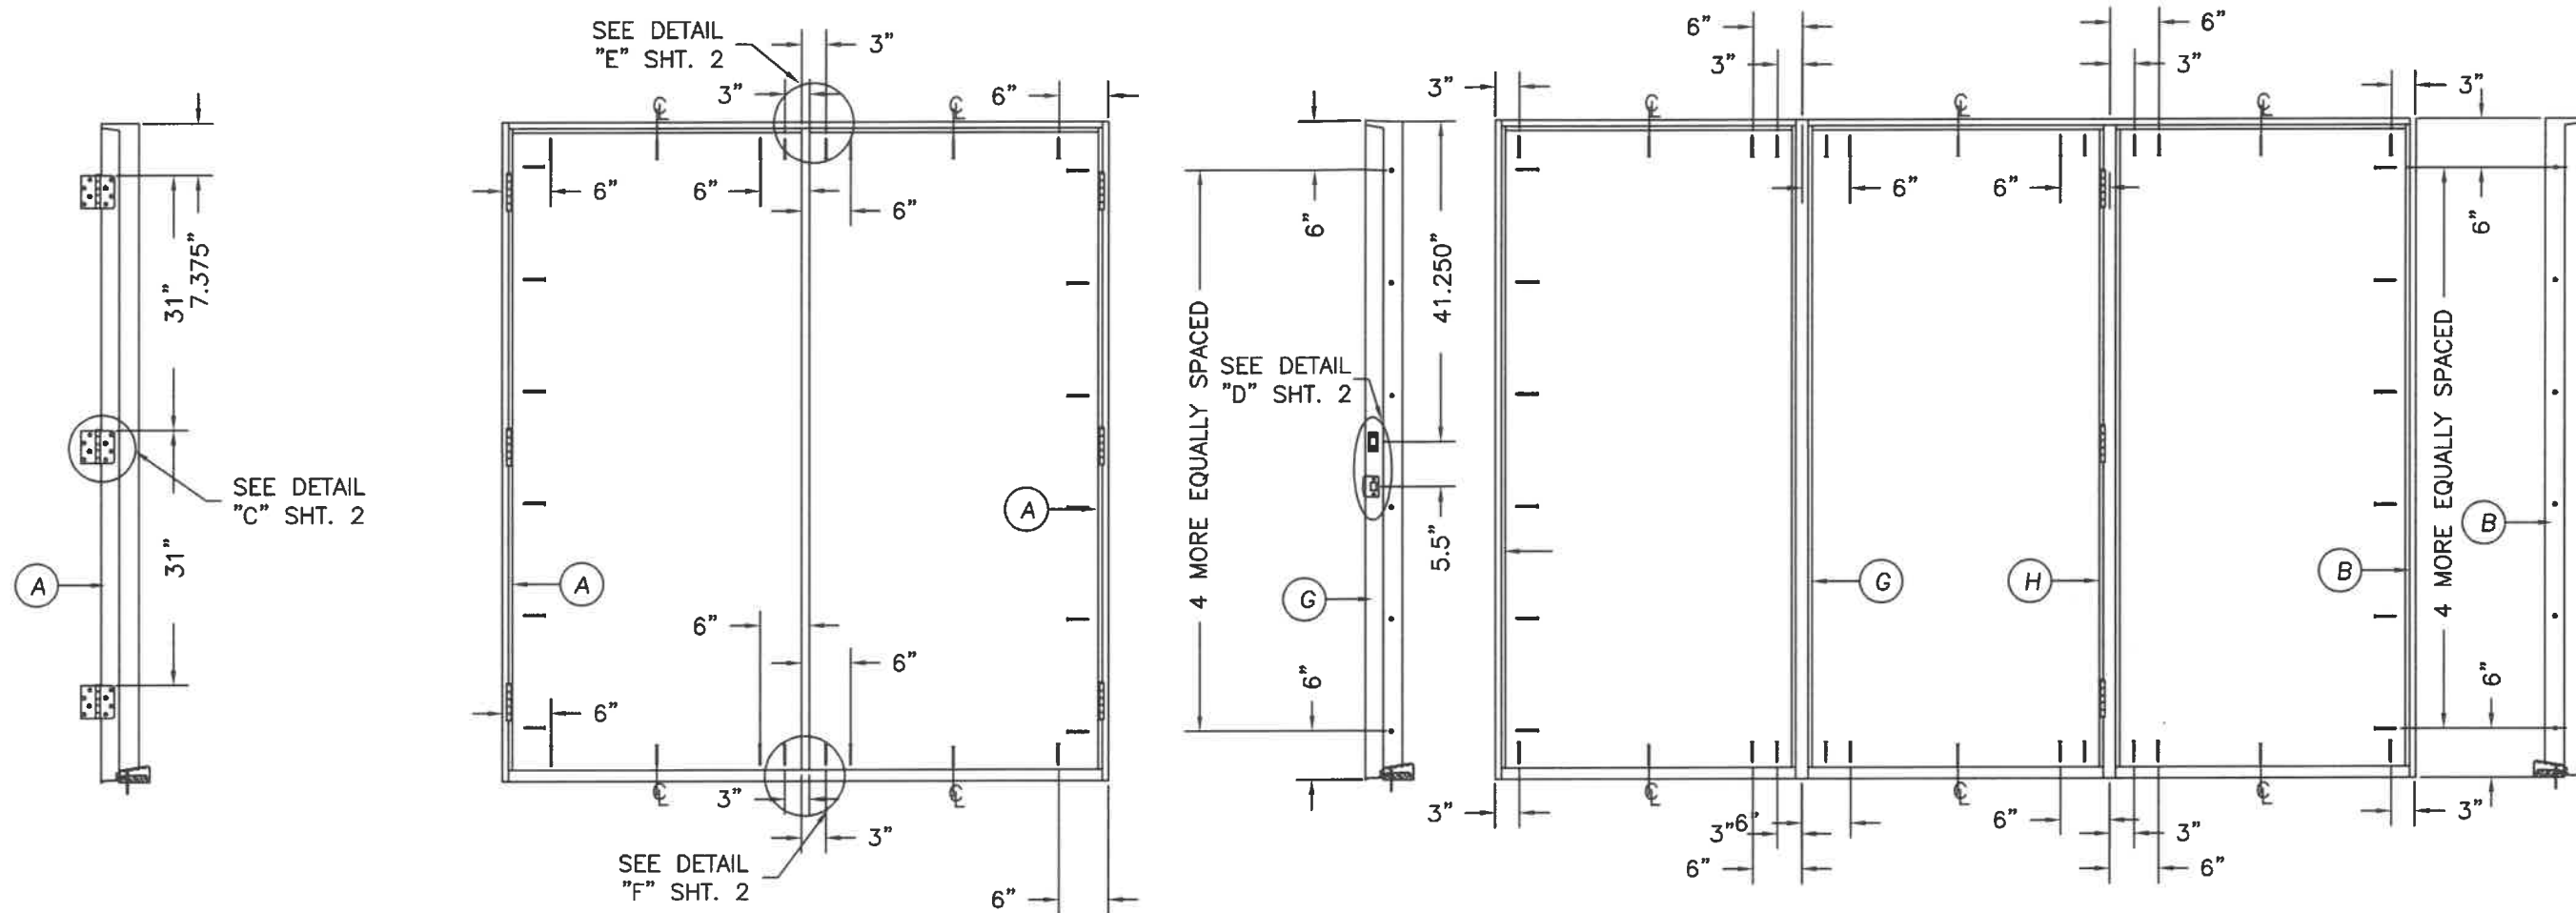


HARDWARE SCHEDULE


- KWIKSET SERIES 400 GRADE 3 CYLINDRICAL LATCH AND SERIES 980 GRADE 1 DEADLOCK HARDWARE TO BE INSTALLED AT 5-1/2" CENTERLINE.
- 4" X 4" FULL MORTISE BUTT HINGES.

ATTACHMENT DETAIL

- ANCHOR ANALYSIS FOR LOADING CONDITIONS PREPARED, SIGNED AND SEALED BY ROBERTO LOMAS, PE (FLORIDA #62514) WITH THE LOWEST (LEAST) FASTENER RATING FROM THE DIFFERENT FASTENERS BEING CONSIDERED FOR USE. JAMB, HEAD, AND THRESHOLD FASTENERS ANALYZED FOR THIS UNIT INCLUDE #10 WOOD SCREWS OR 1/4" TAPCONS. A PHYSICAL SHIM MUST BE PLACED IN SHIM SPACE AT EACH ANCHOR LOCATION. TAPCON EDGE DISTANCE MIN 2-1/2". WOOD SCREW EDGE DISTANCE MIN 3/4".
- THE WOOD SCREW SINGLE SHEAR DESIGN VALUES COME FROM ANSI/AF&PA NDA FOR SOUTHERN PINE LUMBER AND ACHIEVEMENT OF 1-1/2" MINIMUM EMBEDMENT. THE TAPCON MUST ACHIEVE MINIMUM EMBEDMENT OF 1-1/4".
- WOOD BUCKS BY OTHERS MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO STRUCTURE.
- MINIMUM DESIGN VALUE STRENGTH OF ANCHORS 155 LBS.

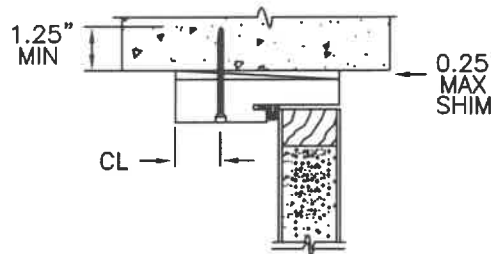


TYPICAL MASONRY ANCHOR INSTALLATION

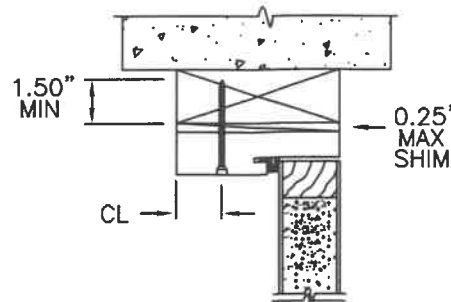

TYPICAL WOOD BUCK ANCHOR INSTALLATION

1"x1/2" CORRUGATED
3" FROM EACH END
AND 7" OC


#10X2" WOOD SCREW
6" FROM EACH END
AND 12" OC

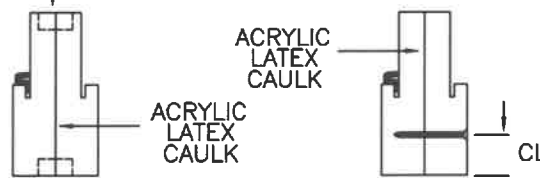

COMBINATION WOOD MULLION (BOXED)

COMBINATION WOOD MULLION (BOXED)

(3) #10X2-1/2"
WOOD SCREWS
EACH END



INTEGRAL WOOD MULLION (CHS)