




STEEL-EDGE STEEL DOOR UNIT
8'-0" DOUBLE DOOR WITH / WITHOUT SIDELITES

GENERAL NOTES


1. EVALUATED FOR USE IN LOCATIONS ADHERING TO THE FLORIDA BUILDING CODE AND WHERE PRESSURE REQUIREMENTS AS DETERMINED BY ASCE 7, MINIMUM DESIGN LOADS FOR BUILDINGS AND OTHER STRUCTURES, DOES NOT EXCEED THE DESIGN PRESSURES LISTED.
2. WHEN INSTALLED IN THE WIND-BORNE DEBRIS REGION OR THE HIGH VELOCITY HURRICANE ZONE (HVHZ), HURRICANE PROTECTIVE SYSTEM IS NOT REQUIRED ON OPAQUE PANELS, BUT IS REQUIRED ON SIDELITES.
3. POLYURETHANE CORE FLAME SPREAD INDEX OF 50 AND SMOKE DEVELOPED INDEX OF 60 PER ASTM E84.
4. PLASTICS TESTING:

TEST DESCRIPTION	DESIGNATION	LITE FRAME
SELF IGNITION TEMP	ASTM D1929	740 °F > 650 °F
RATE OF BURNING	ASTM D635	0.77 IN/MIN
SMOKE DENSITY	ASTM D2843	13.4%
TENSILE STRENGTH*	ASTM D638	7.1% DIFF


* COMPARATIVE TENSILE STRENGTH AFTER WEATHERING
4500 HOURS XENON ARC METHOD 1

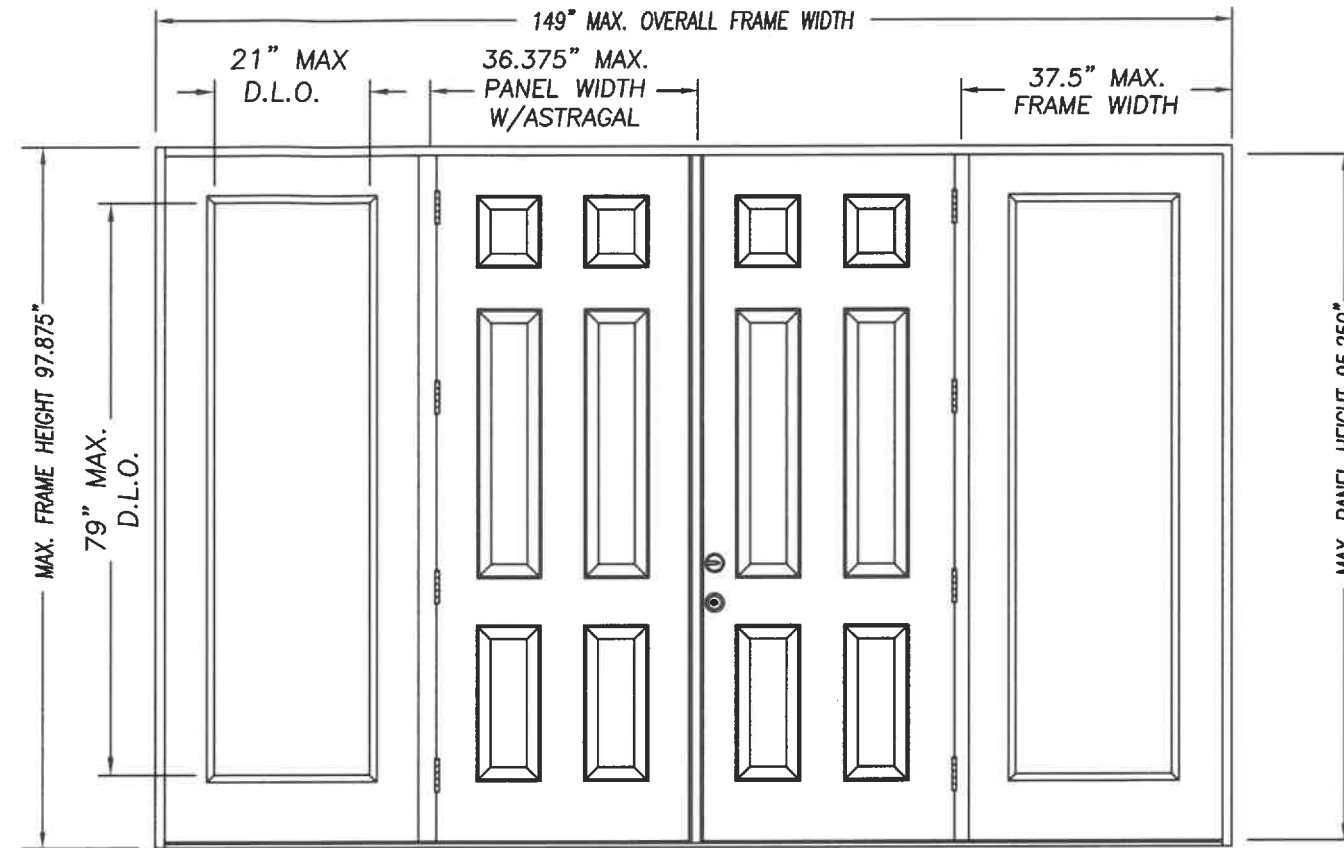


DOUBLE DOOR UNIT W/SIDELITES

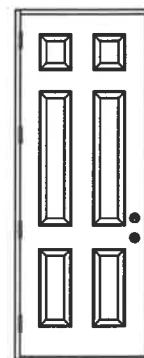


SINGLE DOOR UNIT

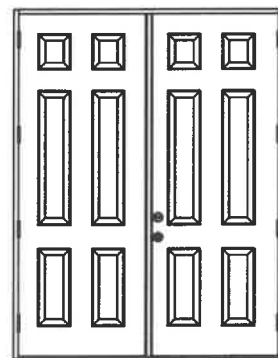


DOUBLE DOOR UNIT

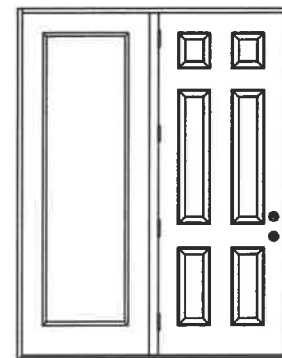


SINGLE DOOR UNIT
WITH SIDELITE

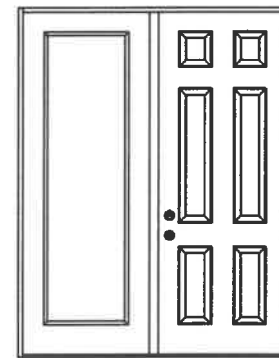

SINGLE DOOR UNIT
WITH SIDELITE

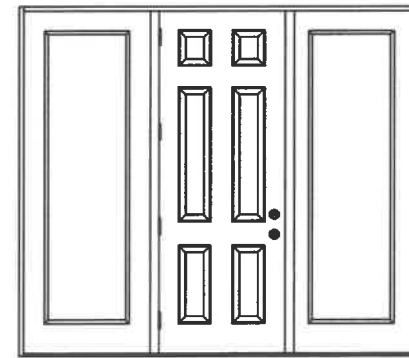

SINGLE DOOR UNIT W/SIDELITES

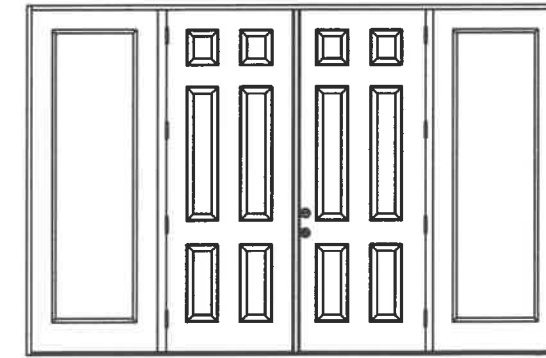


DOUBLE DOOR UNIT W/SIDELITES

TABLE OF CONTENTS

SHEET #	DESCRIPTION
1	TYPICAL ELEVATIONS & GENERAL NOTES
2	ANCHORING LOCATIONS & DETAILS
3	ANCHORING LOCATIONS & DETAILS

CONFIG	MAX WIDTH	DESIGN PRESSURE RATING (1:1 OVERHANG OR WHERE NO WATER REQUIRED)		WHERE WATER INFILTRATION PERFORMANCE IS REQUIRED TO BE 15% OF DESIGN PRESSURE		
		INSWING	OUTSWING	BUMPER O/S	Z-SERIES O/S	HIGH DAM O/S
X	37.5"	+48.0 / -48.0	+48.0 / -48.0	+25.0 / -25.0	+40.0 / -40.0	+48.0 / -48.0
XX	74"	+48.0 / -48.0	+48.0 / -48.0	+25.0 / -25.0	+40.0 / -40.0	+48.0 / -48.0
OX or XO	75"	+48.0 / -48.0	+48.0 / -48.0	+25.0 / -25.0	+40.0 / -40.0	+48.0 / -48.0
OXO	112.5"	+48.0 / -48.0	+48.0 / -48.0	+25.0 / -25.0	+40.0 / -40.0	+48.0 / -48.0
OX XO	149"	+48.0 / -48.0	+48.0 / -48.0	+25.0 / -25.0	+40.0 / -40.0	+48.0 / -48.0

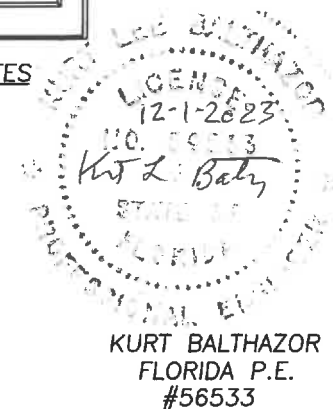




MASONITE INTERNATIONAL CORP.
1955 POWIS ROAD
WEST CHICAGO, IL 60185

PRODUCT:
"EXTERIOR DOOR PRODUCT"
DOUBLE 8'0" OPAQUE
STEEL-EDGE STEEL DOOR

PART OR ASSEMBLY:
TYPICAL ELEVATIONS
& GENERAL NOTES

NO.	DATE	REVISIONS
B	7/18/20	MISC EDITS
A	10/23/17	CORRECTED GLAZING

DATE:	6/21/17
SCALE:	N.T.S.
DWG. BY:	SWS
CHK. BY:	
DRAWING NO.:	DWG-MA-FL0224-17
SHEET	1 OF 3

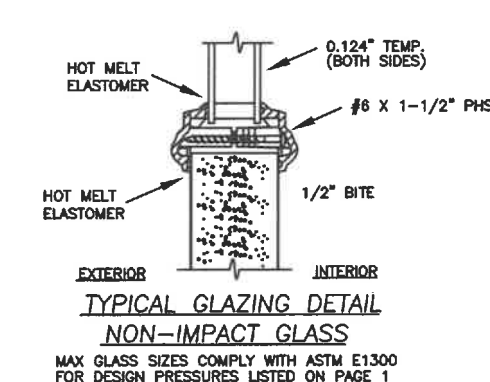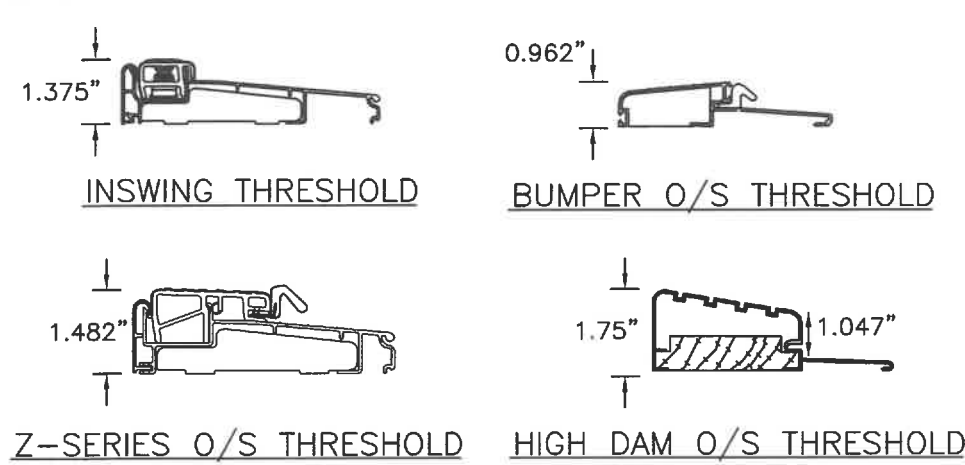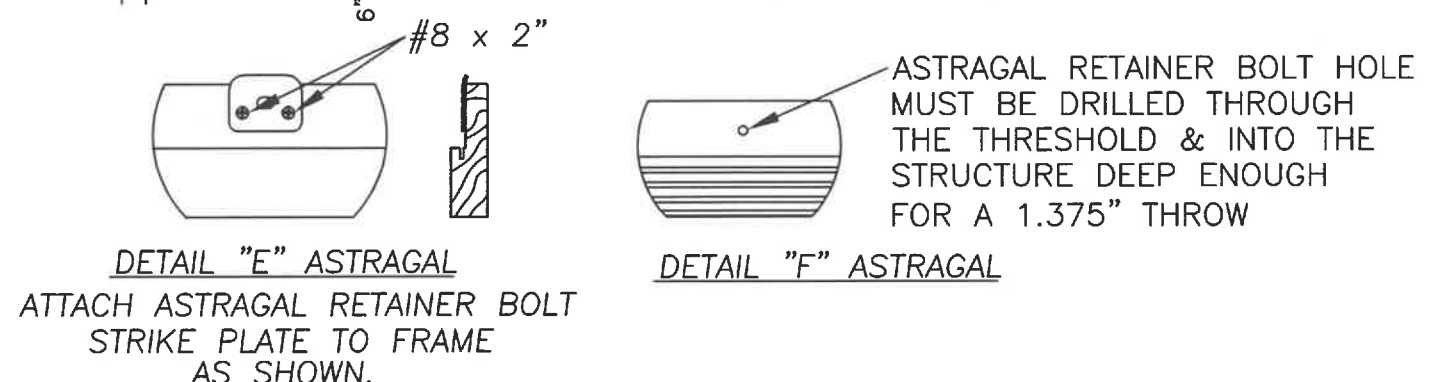

MASONITE INTERNATIONAL CORP.
1955 POWIS ROAD
WEST CHICAGO, IL 60185

DATE:	6/21/17
SCALE:	N.T.S.
DWG. BY:	SWS
CHK. BY:	
DRAWING NO.:	DWG-MA-FLO224-17
SHEET	2 OF 3

PRODUCT:
"EXTERIOR DOOR PRODUCT"
8'0" STEEL-EDGE STEEL OPAQUE
DOUBLE DOOR UNIT

PART OR ASSEMBLY:
ANCHORING LOCATIONS
& DETAILS

NO.	DATE	BY	REVISIONS	
			DESCRIPTION	DATE
B	7/18/20	SWS	MISC EDITS	
A	10/23/17	SWS	CORRECTED GLAZING	

DATE: 6/21/17

SCALE: N.T.S.




DWG. BY: SWS

CHK. BY:

DRAWING NO.:


DWG-MA-FLO224-17

SHEET 3 OF 3

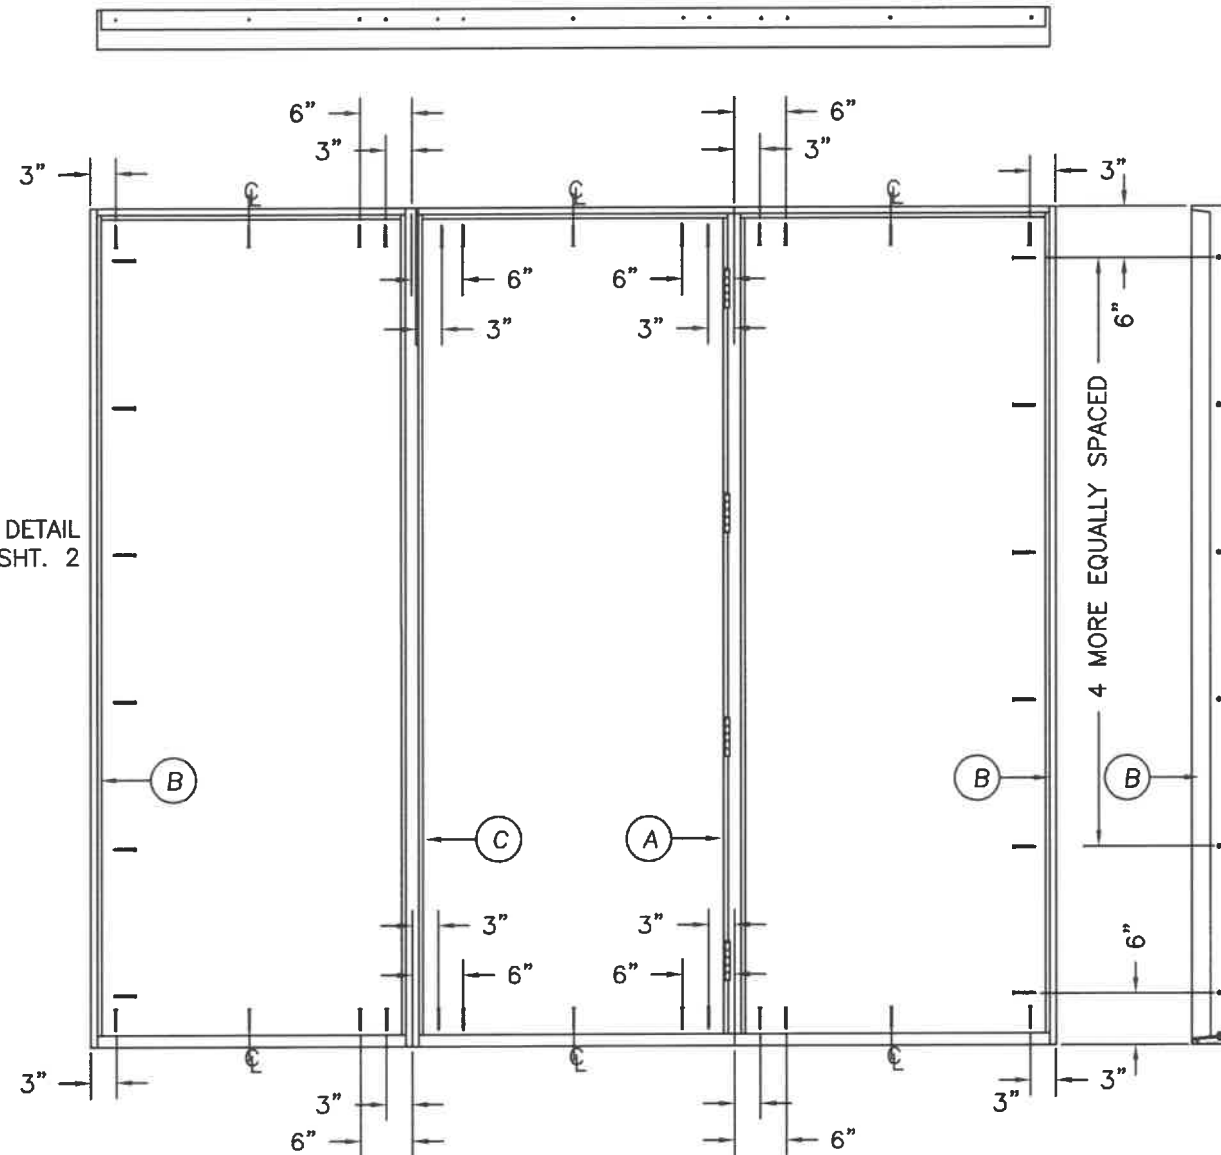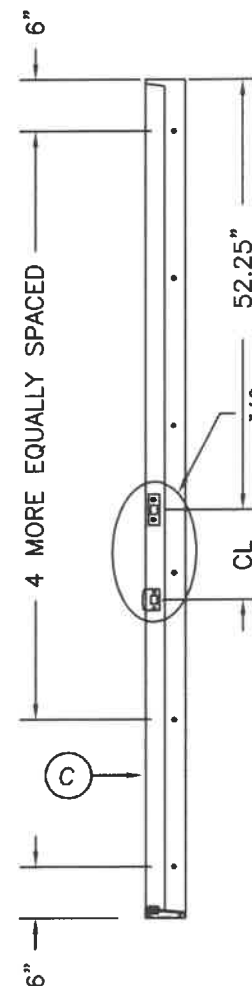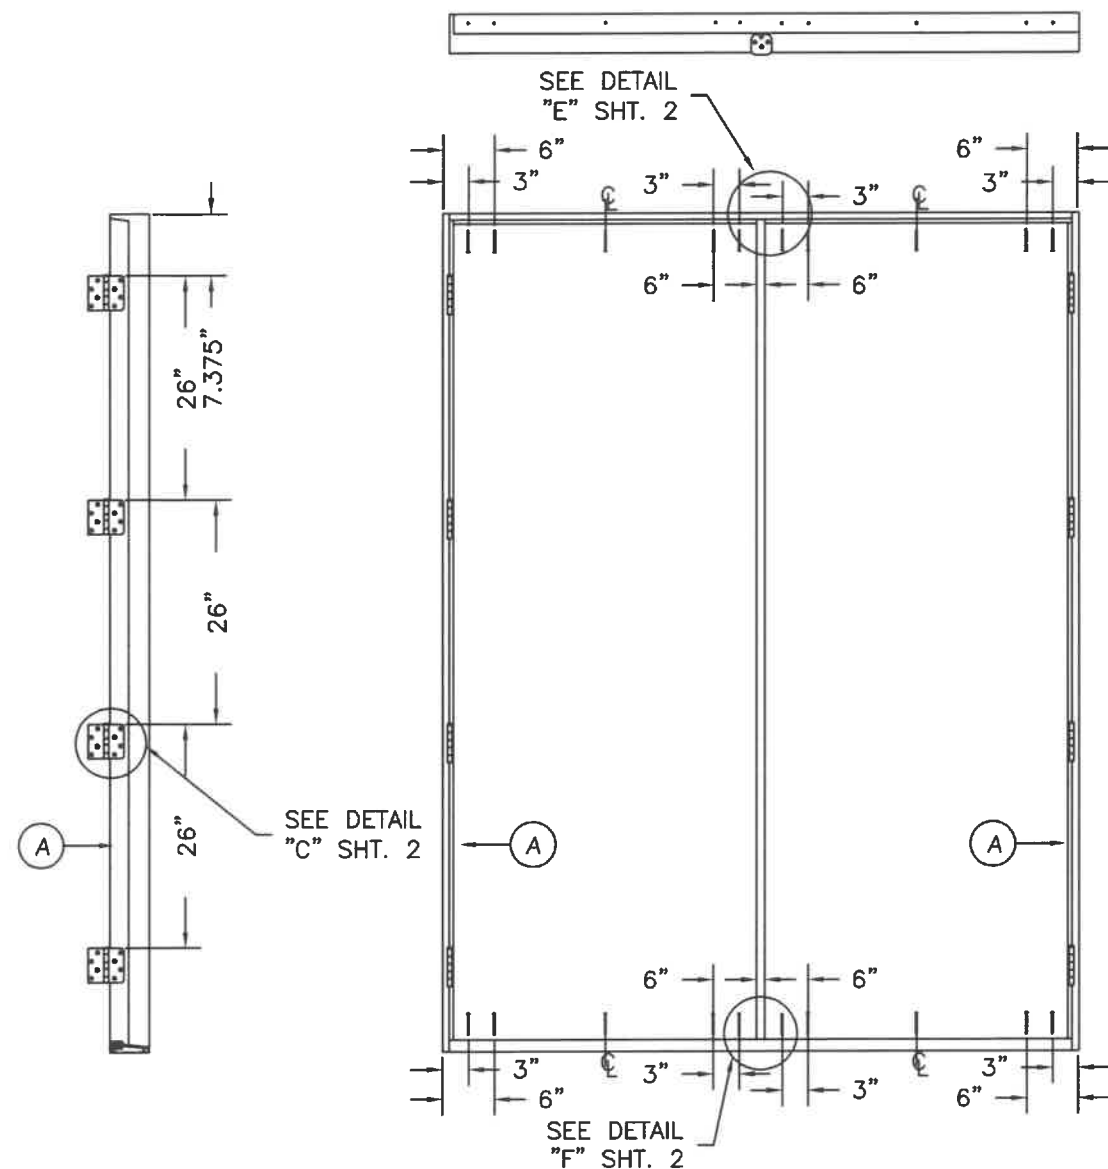


ATTACHMENT DETAIL

1. ANCHOR ANALYSIS FOR LOADING CONDITIONS PREPARED, SIGNED AND SEALED BY LUIS R. LOMAS, PE (FLORIDA #62514) WITH THE LOWEST (LEAST) FASTENER RATING FROM THE DIFFERENT FASTENERS BEING CONSIDERED FOR USE. JAMB, HEAD, AND THRESHOLD FASTENERS ANALYZED FOR THIS UNIT INCLUDE #10 WOOD SCREWS OR 1/4" TAPCONS. A PHYSICAL SHIM MUST BE PLACED IN SHIM SPACE AT EACH ANCHOR LOCATION. TAPCON EDGE DISTANCE MIN 2-1/2". WOOD SCREW EDGE DISTANCE MIN 3/4".
2. THE WOOD SCREW SINGLE SHEAR DESIGN VALUES COME FROM ANSI/AF&PA NDA FOR SOUTHERN PINE LUMBER AND ACHIEVEMENT OF 1-1/2" MINIMUM EMBEDMENT. THE TAPCON MUST ACHIEVE MINIMUM EMBEDMENT OF 1-1/4".
3. WOOD BUCKS BY OTHERS MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO STRUCTURE.
4. MINIMUM DESIGN VALUE STRENGTH OF ANCHORS 155 LBS.

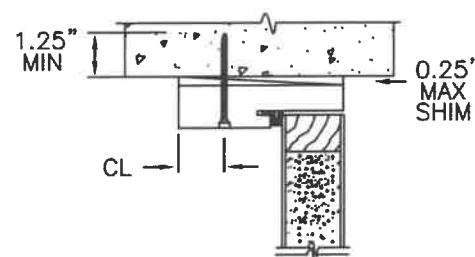

TYPICAL MASONRY ANCHOR INSTALLATION

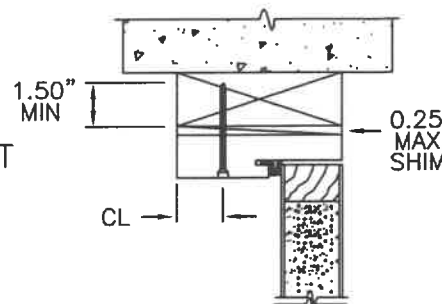


TYPICAL WOOD BUCK ANCHOR INSTALLATION

HARDWARE SCHEDULE

1. KWIKSET SERIES 400 GRADE 3 CYLINDRICAL LATCH AND SERIES 980 GRADE 1 DEADLOCK HARDWARE TO BE INSTALLED AT 10-1/2" CENTERLINE.
2. 4" X 4" FULL MORTISE BUTT HINGES.

1"x1/2" CORRUGATED
3" FROM EACH END
AND 7" OC




COMBINATION WOOD MULLION (BOXED)

#10X2" WOOD SCREW
6" FROM EACH END
AND 12" OC



COMBINATION WOOD MULLION (BOXED)

(3) #10X2-1/2"
WOOD SCREWS
EACH END



INTEGRAL WOOD MULLION (CHS)