



TYPICAL ELEVATION WITH FASTENER SPACING

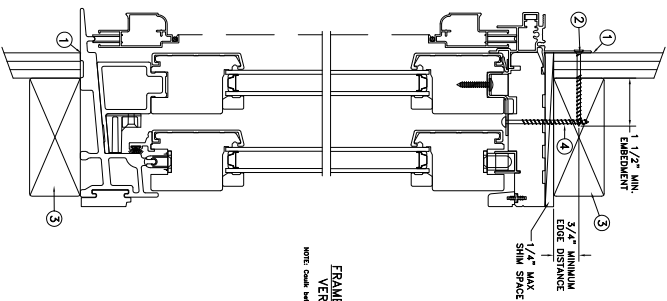

FRAME SECTION (TYP)
VERTICAL SECTION
NOTE: Caulk between Molding Flange & Wood Opening.

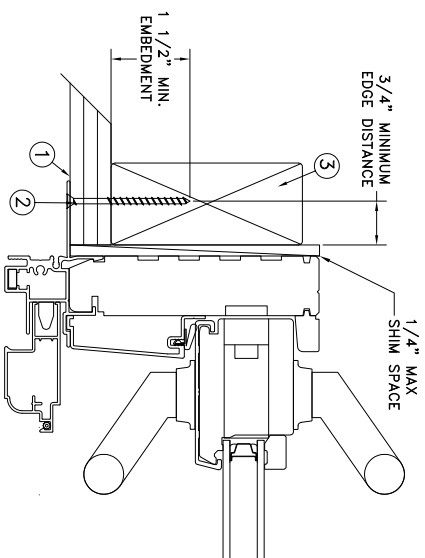

NAILPIN INSTALLATION

FRAME JAMB SECTION (TYP)
HORIZONTAL SECTION
NOTE: Caulk between Nailpin Flange & Wood Opening.

Max Frame	DP	IMPACT
145 7/16 x 98 1/2	+35/-35	NO

Installation Notes:

1. Seal flange/frame to substrate.
2. Use #8 PH or greater fastener through the nailfin head and sides with sufficient length to penetrate a minimum of 1 1/2" into the wood framing. For 2x wood frame substrate (min. S.G. = 0.42)
3. Host structure (wood buck, masonry, steel) to be designed and anchored to properly transfer all loads to the structure. The host structure is the responsibility of the architect or engineer of record for the project of installation.
4. Replace #8 x 1" fastener in stationary bracket with #8 x 2 1/2" PPH or greater fastener through stationary bracket and head jamb into wood framing.

General Notes:

1. The product shown herein is designed, tested and manufactured to comply with the wind load criteria of the adopted International Building Code (IBC), the International Residential Code (IRC), the Florida Building Code (FBC) and the Industry requirement for the stated conditions.
2. All glazing shall conform to ASTM E1300.
3. At minimum, glazing shall be tempered (3.1mm) insulating glass.
4. Use structural or composite shims where required.


This schedule addresses only the fasteners required to anchor the window to achieve the rated design pressure and impact performance (where applicable) up to the size limitations noted. It is not intended as a guide to the installation process and does not address the sealing considerations that may arise in different wall conditions. For the complete installation procedure, see the instructions packaged with the window or go to www.jeld-wen.com/resources/installation.

DISCLAIMER:


This drawing and its contents are confidential and are not to be reproduced or copied in whole or in part or used or disclosed to others except as authorized by JELD-WEN Inc.

PROJECT ENGINEER:		DATE: 7/31/2016	
DRAWN BY: J.HAWKINS		SCALE: NTS	
CHECKED BY: C.GRAETSCH		TITLE: EpicVue Clad Narrow Gliding Patio Door	
APPROVED BY: D.STOKES			
PART/PROJECT No.: D014241		PLANT NAME AND LOCATION: Bend-OR	
IDENTIFIER No. --		CAD DWG. No.: CURJCLNGPD Cert	REV: A SHEET

JELD-WEN 3737 LAKEPORT BLVD.
KLAMATH FALLS OR, 97601
PHONE: (800) 535-3936

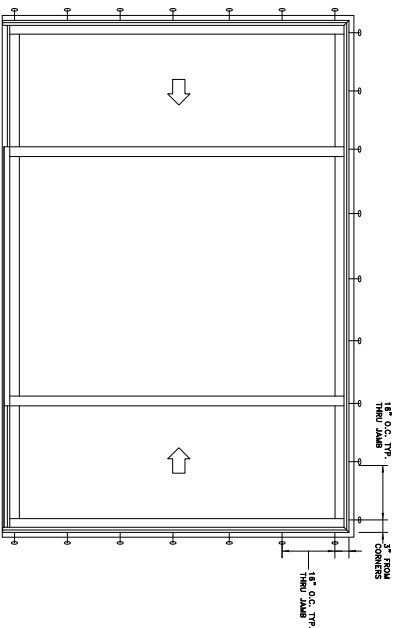


TYPICAL ELEVATION WITH FASTENER SPACING

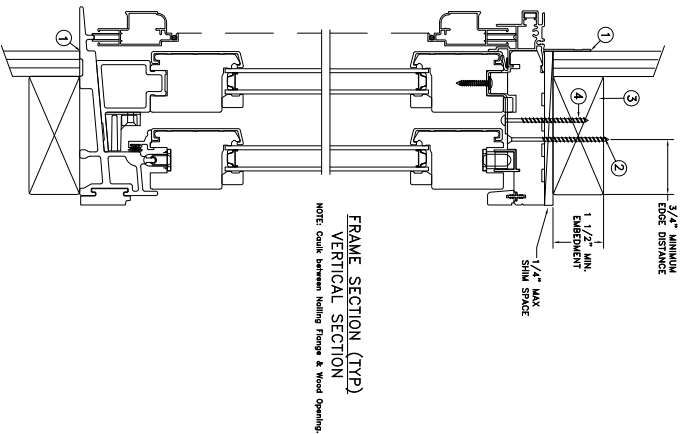

FRAME SECTION (TYP)
VERTICAL SECTION

NOTE: Caulk between Nailing Flange & Wood Opening.

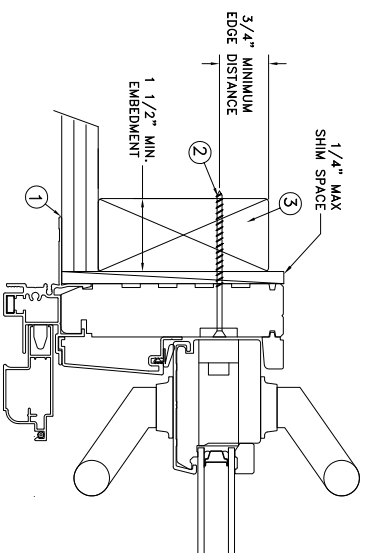

FRAME JAMB SECTION (TYP)
HORIZONTAL SECTION

NOTE: Caulk between Nailing Flange & Wood Opening.

THROUGH FRAME
INSTALLATION

Max Frame	DP	IMPACT
145 7/16 x 98 1/2	+35/-35	NO

Installation Notes:

1. Seal flange/frame to substrate.
2. Use #8 PH or greater fastener through the head and side jambs with sufficient length to penetrate a minimum of 1 1/2" into the wood framing. For 2x wood frame substrate (min. S.G. = 0.42)
3. Host structure (wood buck, masonry, steel) to be designed and anchored to properly transfer all loads to the structure. The host structure is the responsibility of the architect or engineer or record for the project of installation.
4. Replace #8 x 1" fastener in stationary bracket with #8 x 2 1/2" PPH or greater fastener through stationary bracket and head jamb into wood framing.

General Notes:

1. The product shown herein is designed, tested and manufactured to comply with the wind load criteria of the adopted International Building Code (IBC), the International Residential Code (IRC), the Florida Building Code (FBC) and the industry requirement for the stated conditions.
2. All glazing shall conform to ASTM E1300.
3. At minimum, glazing shall be tempered (3.1mm) insulating glass.
4. Use structural or composite shims where required.

This schedule addresses only the fasteners required to anchor the window to achieve the rated design pressure and impact performance (where applicable) up to the size limitations noted. It is not intended as a guide to the installation process and does not address the sealing consideration that may arise in different wall conditions. For the complete installation procedure, see the instructions packaged with the window or go to www.jeld-wen.com/resources/installation.


DISCLAIMER:

This drawing and its contents are confidential and are not to be reproduced or copied in whole or in part or used or disclosed to others except as authorized by JELD-WEN Inc.


PROJECT ENGINEER:		DATE: 7/31/2016	
DRAWN BY: J.HAWKINS		SCALE: NTS	
CHECKED BY: C.GRAEFSCH		TITLE: EpicVue Clad Narrow Gliding Patio Door	
APPROVED BY: D.STOKES		PLANT NAME AND LOCATION: Bend-OR	
PART/PROJECT No.: D014241		CAD DWG. No.: CURJCLNGPD.Cad	
IDENTIFIER No. --		REV: A	
		SHEET	

JELD-WEN 3737 LAKEPORT BLVD.
KLAMATH FALLS OR, 97601
PHONE: (800) 535-3936


MASONRY STRAP
INSTALLATION

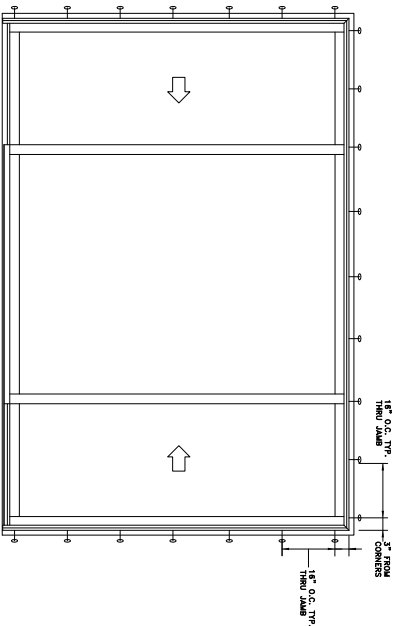

TYPICAL ELEVATION WITH FASTENER SPACING

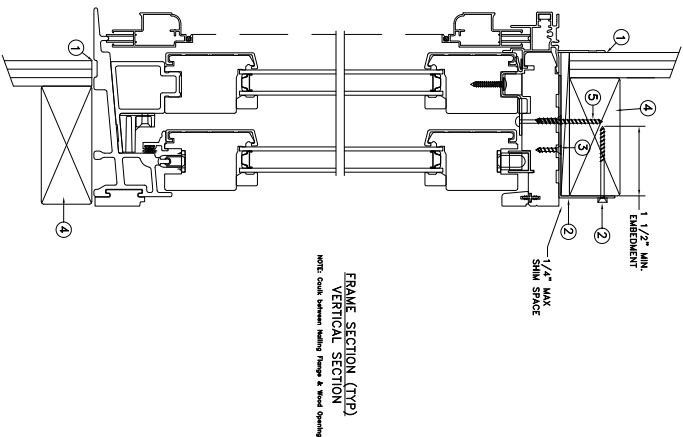

FRAME SECTION (TYP)
VERTICAL SECTION
NOTE: CAULK BETWEEN MASONRY FLANGE & WINDOW OPENING.

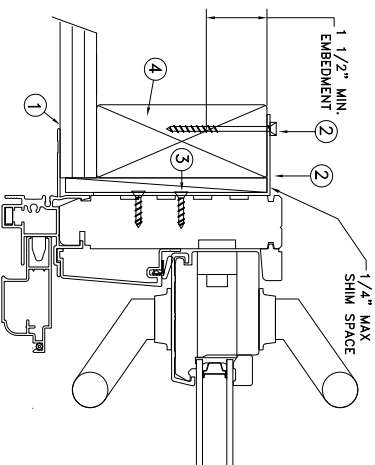

FRAME JAMB SECTION (TYP)
HORIZONTAL SECTION

NOTE: CAULK BETWEEN NAILING FLANGE & WINDOW OPENING.

Max Frame	DP	IMPACT
145 7/16 x 98 1/2	+35/-35	NO

Installation Notes:

1. Seal flange/frame to substrate.
2. Use #8 PPH or larger fasteners through masonry strap with sufficient length to penetrate a minimum of 1 1/2" into the masonry or buck.. For concrete (min. fc = 3000 psi) or masonry substrate (CMU) shall adhere to ASTM C90).
3. Use #8 PPH or larger fasteners through masonry strap into jamb without penetrating through the jamb into product causing visability or collateral damage to product.
4. Host structure (wood buck, masonry, steel) to be designed and anchored to properly transfer all loads to the structure. The host structure is the responsibility of the architect or engineer or record for the project of installation.
5. Replace #8 x 1" fastener in stationary bracket with #8 x 2 1/2" PPH or greater fastener through stationary bracket and head jamb into wood framing.

General Notes:

1. The product shown herein is designed, tested and manufactured to comply with the wind load criteria of the adopted International Building Code (IBC), the International Residential Code (IRC), the Florida Building Code (FBC) and the Industry requirement for the stated conditions.
2. All glazing shall conform to ASTM E1300.
3. At minimum, glazing shall be tempered (3.1mm) insulating glass.
4. Use structural or composite shims where required.

This schedule addresses only the fasteners required to anchor the window to achieve the rated design pressure and impact performance (where applicable) up to the size limitations noted. It is not intended as a guide to the installation process and does not address the sealing consideration that may arise in different wall conditions. For the complete installation procedure, see the instructions packaged with the window or go to www.jeld-wen.com/resources/installation.

DISCLAIMER:

This drawing and its contents are confidential and are not to be reproduced or copied in whole or in part or used or disclosed to others except as authorized by JELD-WEN Inc.

PROJECT ENGINEER:	DATE:	7/31/2016
DRAWN BY:	SCALE:	NTS
J.HAWKINS		
CHECKED BY:	TITLE:	EpicVue Clad Narrow Gliding Patio Door
C.GRAETSCH		
APPROVED BY:		
D.STOKES		
PART/PROJECT No.:	PLANT NAME AND LOCATION:	CAD DWG. No.:
D014241	Bend-OR	CJSCJLNGPD Cert
IDENTIFIER No.:	REV:	A
--	SHEET	

JELD-WEN 3737 LAKEPORT BLVD.
KLAMATH FALLS OR, 97601
PHONE: (800) 535-3936