
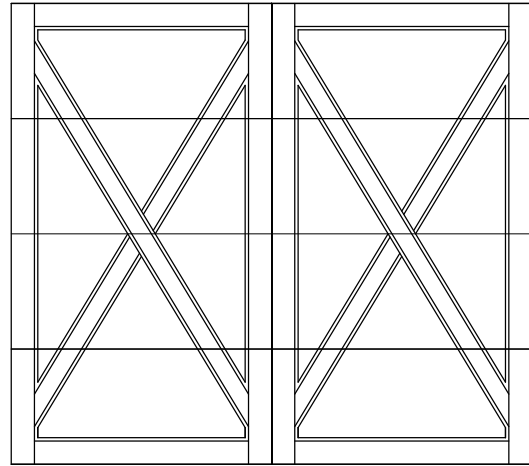


TYPICAL TRACK INSTALLATION
NORMAL HEADROOM TRACK SHOWN, LOW HEADROOM, LIFT CLEARANCE AND VERTICAL LIFT TRACK AVAILABLE


DOORS TESTED PER ANSI/DASMA 108 FOR STATIC AIR PRESSURE

MAXIMUM DOOR WIDTH	DESIGN LOAD (PSF)	
8' - 0"	34.5	-39.0
9' - 0"	30.7	-34.7
10' - 0"	27.6	-31.2


SCALE: NONE	TITLE: SPEC, WIND LOAD ROCKCREEKE	
DRAWN BY: G. WEDEKIND	 1101 EAST RIVER ROAD DIXON, IL 61021	
CHECKED BY: G. WEDEKIND		
DATE: 7/18/17	NO. P-2346	SHEET 1 OF 3
ECO: 7512.03	REV. A	



EXTERIOR ELEVATION
 FLUSH SECTION WITH DECORATIVE TRIM
 BOARDS. ARRANGMENT OF BOARDS
 WILL VARY BASED ON DESIGN, CROSS
 BUCKS SHOWN

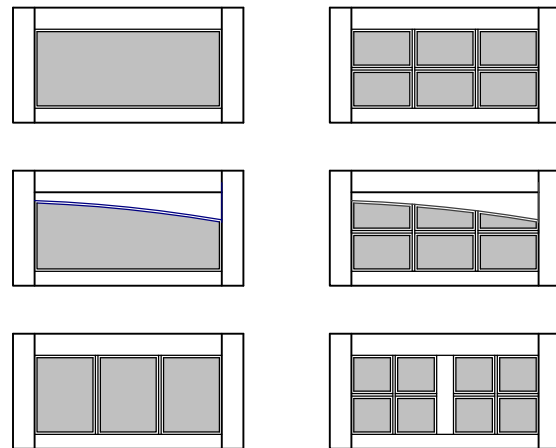


WINDOW OPTIONS
 AVAILABLE IN TOP SECTION ONLY
 1/8" DSB
 1/2" INSULATED DSB UNIT
 3/16" WATER GLASS
 1/2" INSULATED WATER GLASS UNIT














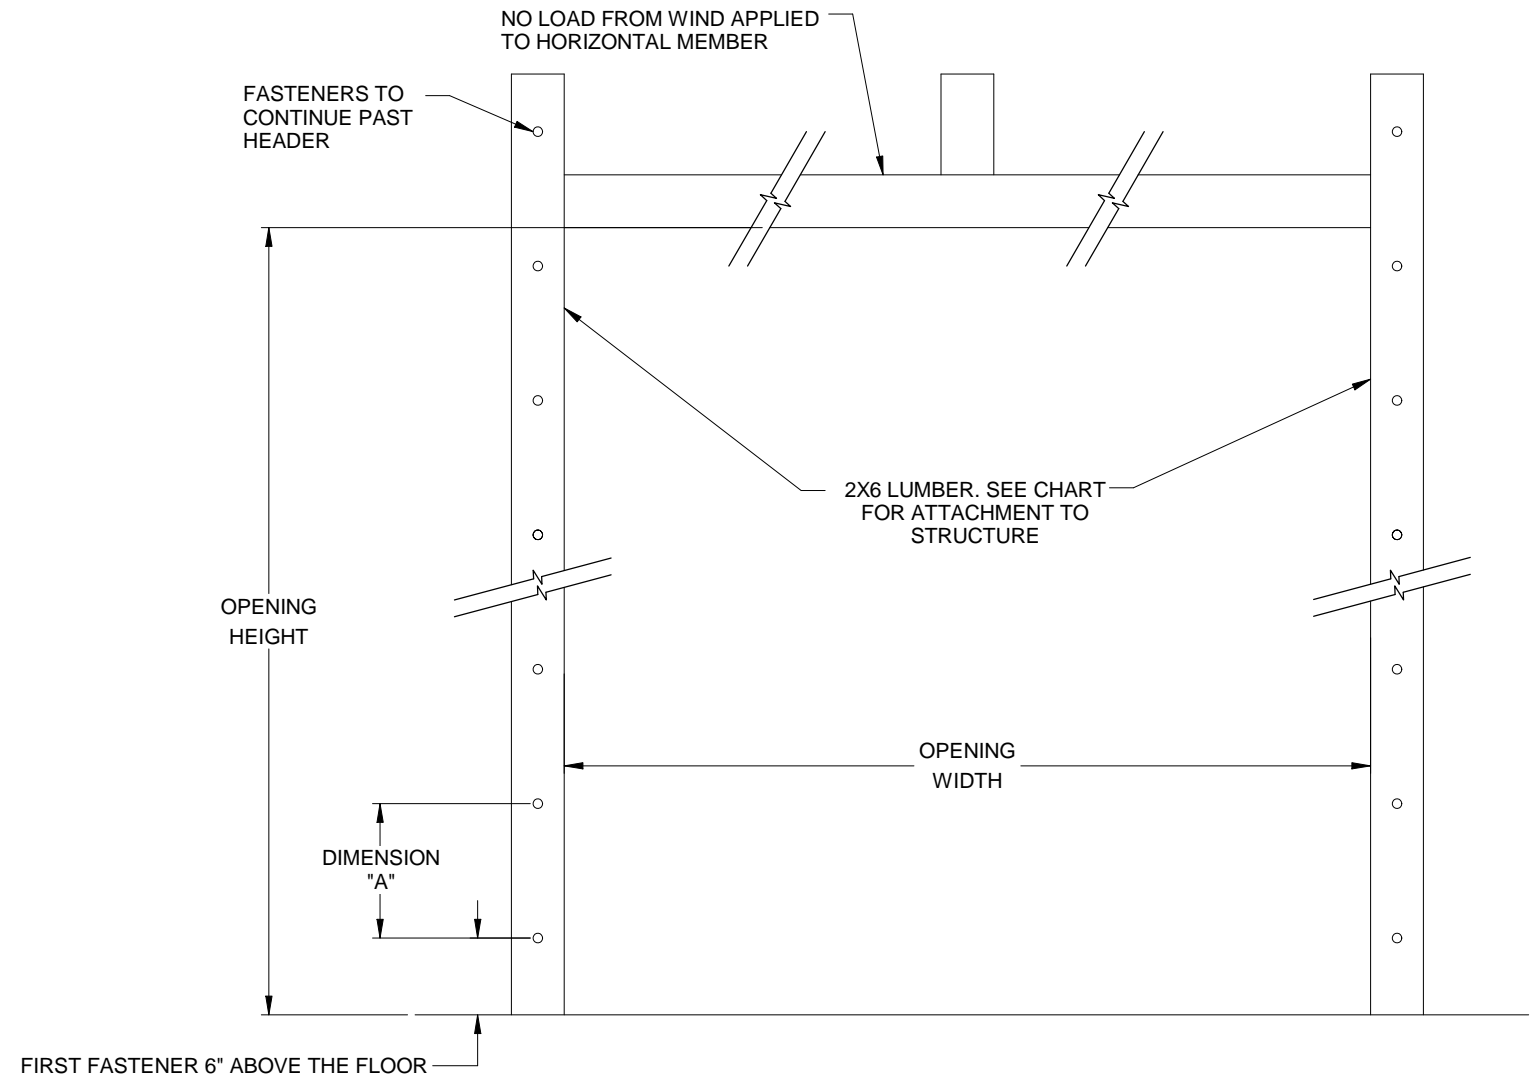


JAMB ATTACHMENT NOTES

1. MAXIMUM POSITIVE LOAD PER JAMB = (10' X 27.6 PSF) / 2 = 138 LBS PER FOOT
2. MAXIMUM NEGATIVE LOAD PER JAMB = (10' X 31.2 PSF) / 2 = 156 LBS PER FOOT.
3. DESIGN OF THE SUPPORTING STRUCTURE SHALL BE THE SOLE RESPONSIBILITY OF THE BUILDING DESIGNER AND SHALL BE DESIGNED FOR THE JAMB LOADS LISTED IN NOTES 1 AND 2.
4. ALTERNATE JAMB ATTACHMENTS MAY BE USED IF APPROVED BY A REGISTERED PROFESSIONAL ENGINEER.
5. DASMA TECHNICAL DATA SHEET TDS-161 MAY BE USED FOR ALTERNATE JAMB ATTACHMENTS.

2X6 ATTACHMENT TO STRUCTURE					
STRUCTURE TYPE	FASTENER TYPE	MINIMUM EMBEDMENT	MINIMUM EDGE DISTANCE	DIMENSION A (MAXIMUM ON CENTER SPACING)	ALLOWABLE TENSION LOAD
2500 PSI MIN. CONCRETE	1/4" TAPCON+ (PLUS) WITH 1-1/8" OD WASHER	2"	2.5	24"	691
SOUTHERN PINE	3/8" X 3" LAG WITH 1-1/8" OD WASHER	1.50"	1.50"	24"	620
SPRUCE PINE FIR	3/8" X 3" LAG WITH 1-1/8" OD WASHER	1.50"	1.50"	24"	482

SCALE: NONE	 1101 EAST RIVER ROAD DIXON, IL. 61021	TITLE: SPEC, WIND LOAD ROCKCREEKE	
DRAWN BY: G. WEDEKIND		NO. P-2346	SHEET 2 OF 3
CHECKED BY: G. WEDEKIND			
DATE: 7/18/17			
ECO: 7512.03			

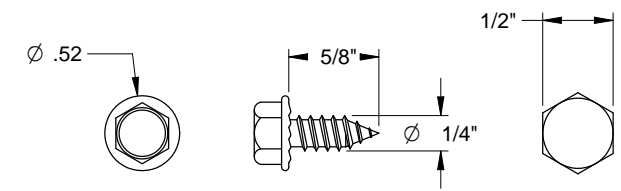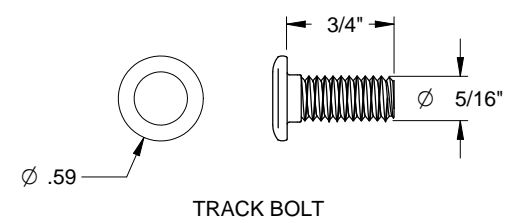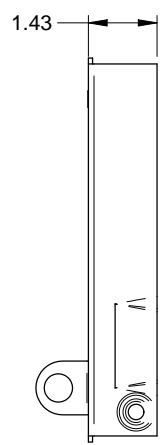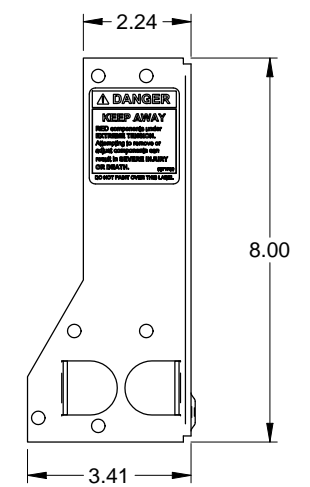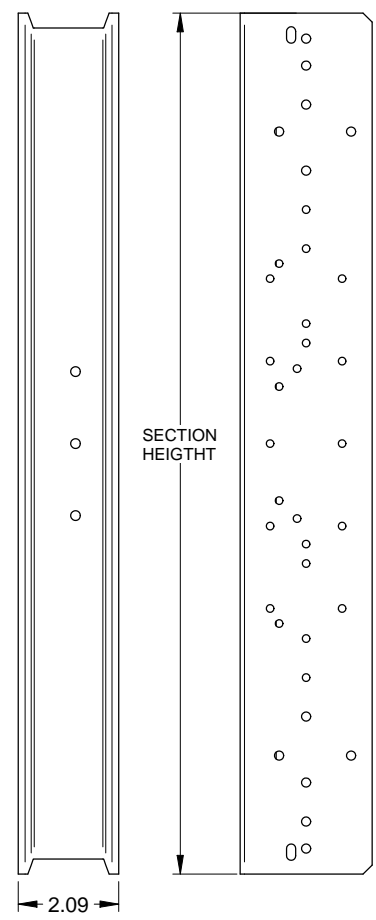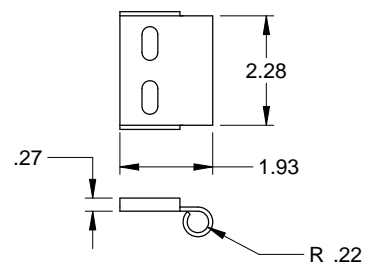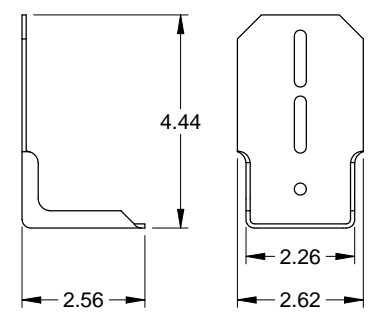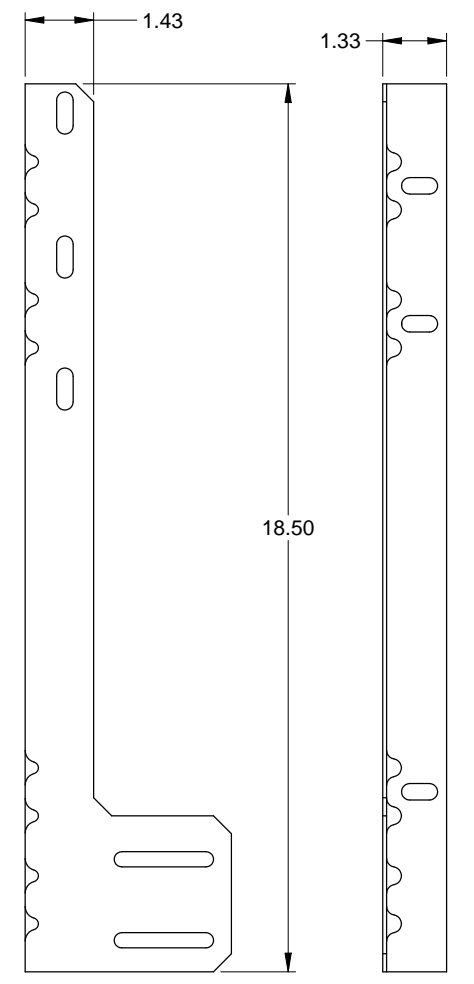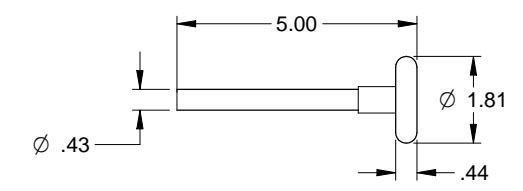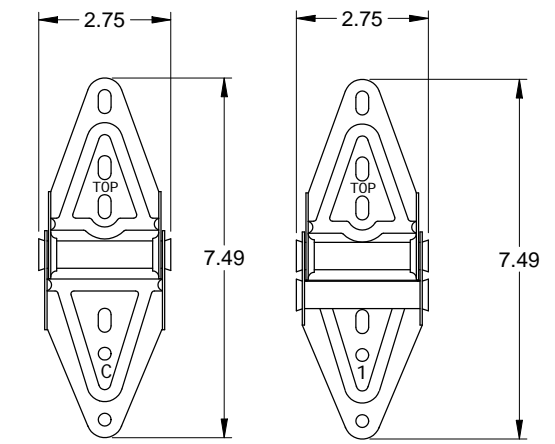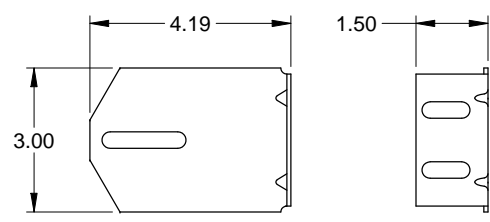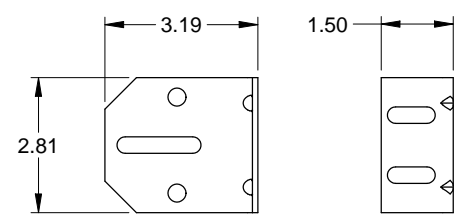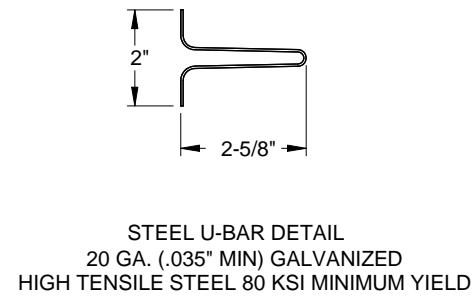

SCALE: NONE	 1101 EAST RIVER ROAD DIXON, IL 61021	TITLE: SPEC, WIND LOAD ROCKCREEKE	
DRAWN BY: G. WEDEKIND		NO. P-2346	SHEET 3 OF 3
CHECKED BY: G. WEDEKIND			
DATE: 7/18/17			
ECO: 7512.03			