ANCHOR LOAD CAPACITY - PSF								
ANCHOR	ANCHOR TYPE ANCHORS 'A', 'B', C' & 'D'							
SHIM S	PACE	3/8" SHIM	AX. SHIM					
	DOOR FRAME		6 ANCHORS AT MTG. STILE ENDS	8 ANCHORS AT MTG. STILE ENDS				
PANEL WIDTH INCHES	HEIGHT INCHES	EXT. (+) INT. (-)	EXT. (+) INT. (-)	EXT. (+) INT. (-)				
42		100.0	100.0	100.0				
48		100.0	100.0	100.0				
54		100.0	100.0	100.0				
60	00 7/0	100.0	100.0	100.0				
66	82-7/8	75.0	75.0	75.0				
72		75.0	75.0	75.0				
78		75.0	75.0	75.0				
84		75.0	73.5	75.0				
42		100.0	100.0	100.0				
48		100.0	100.0	100.0				
54		100.0	100.0	100.0				
60		100.0	100.0	100.0				
62	84	75.0	75.0	75.0				
66		75.0	75.0	75.0				
72		75.0	75.0	75.0				
78		75.0	75.0	75.0				
84		75.0	72.5	75.0				
42	90	100.0	100.0	100.0				
48		100.0	100.0	100.0				
54 60		100.0	100.0	100.0				
62		100.0	100.0	100.0				
66		75.0	75.0	75.0				
72		75.0 75.0	75.0 75.0	75.0 75.0				
78		75.0 75.0	75.0	75.0				
80		75.0	71.0	75.0				
42		100.0	100.0	100.0				
48		100.0	100.0	100.0				
54		100.0	98.7	100.0				
60		100.0	88.8	100.0				
62	96	75.0	75.0	75.0				
66	:	75.0	75.0	75.0				
72		75.0	74.0	75.0				
74		75.0	72.0	75.0				
42		100.0	100.0	100.0				
48		100.0	100.0	100.0				
50		100.0	100.0	100.0				
52		100.0	96.4	100.0				
54	102	100.0	92.9	100.0				
56		100.0	89.5	100.0				
60		75.0	75.0	75.0				
62		75.0	75.0	75.0				
66		75.0	75.0	75.0				
70		75.0	71.6	75.0				
42		100.0	100.0	100.0				
48 50	ļ	100.0	98.7	100.0				
60	108	100.0	94.7	100.0				
62	}	75.0 75.0	75.0	75.0 75.0				
66		75.0	75.0 71.6					
		75.0	71.6	75.0				

	ANCHOR LOAD CAPACITY - PSF								
	ANCHOR	TYPE	ANCHORS 'A', 'B', C' & 'D'						
	SHIM S	PACE	3/8" SHIM	1/2" MAX. SHIM					
5		DOOR FRAME	6 ANCHORS AT MTG. STILE ENDS	6 ANCHORS AT MTG. STILE ENDS	AT MTG.				
	PANEL WIDTH INCHES		EXT. (+) INT. (-)	EXT. (+) INT. (-)	EXT. (+) INT. (-)				
	42		100.0	100.0	100.0				
	48		100.0	93.5	100.0				
	50	114	100.0	89.7	100.0				
	60		75.0	74.8	75.0				
	62		75.0	72.4	75.0				
	42		100.0	100.0	100.0				
	48	120	100.0	88.8	100.0				
	50	120	75.0	75.0	75.0				
	60		75.0	71.0	75.0				
1									

INSTRUCTIONS:

USE CHARTS AS FOLLOWS.

STEP 1 DETERMINE DESIGN WIND LOAD REQUIREMENT BASED ON WIND VELOCITY, BLDG. HEIGHT, WIND ZONE USING APPLICABLE ASCE 7 STANDARD.

STEP 2 DETERMINE DOOR CAPACITY FROM TABLE ON SHEET 1.1 FOR THE GLASS TYPE USED.

USING CHARTS ABOVE SELECT ANCHOR OPTION WITH DESIGN RATING MORE THAN DESIGN LOAD SPECIFIED

STEP 4 THE LOWEST VALUE RESULTING FROM STEPS 2 AND 3 SHALL APPLY TO ENTIRE SYSTEM.

STEP 5 SEE SHEET 8 TO DETERMINE MIN. AND MAX. GAP DIMENSIONS FOR UNANCHORED JAMBS.

THESE DOORS ARE RATED FOR LARGE & SMALL MISSILE IMPACT. SHUTTERS ARE NOT REQUIRED.

SERIES 1100 (L.M.I.) ALUMINUM SLIDING GLASS DOOR

THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE REQUIREMENTS OF THE 2020 (7TH EDITION) FLORIDA BUILDING CODE INCLUDING HIGH VELOCITY HURRICANE ZONE (HVHZ).

1BY OR 2BY WOOD BUCKS & BUCK FASTENERS BY OTHERS, MUST BE DESIGNED AND INSTALLED ADEQUATELY TO TRANSFER APPLIED PRODUCT LOADS TO THE BUILDING STRUCTURE.

ANCHORS SHALL BE CORROSION RESISTANT, SPACED AS SHOWN ON DETAILS AND INSTALLED PER MANUF'S INSTRUCTIONS. SPECIFIED EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.

A LOAD DURATION INCREASE IS USED IN DESIGN OF ANCHORS INTO WOOD ONLY.

ALL SHIMS TO BE HIGH IMPACT, NON-METALLIC AND NON-COMPRESSIBLE.

MATERIALS INCLUDING BUT NOT LIMITED TO STEEL/METAL SCREWS, THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF THE 2020 FLORIDA BLDG. CODE & ADOPTED STANDARDS.

THIS PRODUCT APPROVAL IS GENERIC AND DOES NOT PROVIDE INFORMATION FOR A SITE SPECIFIC PROJECT, i.e. LIFE SAFETY OF THIS PRODUCT, ADEQUACY OF STRUCTURE RECEIVING THIS PRODUCT AND SEALING AROUND OPENING FOR WATER INFILTRATION RESISTANCE ETC.

CONDITIONS NOT SHOWN IN THIS DRAWING ARE TO BE ANALYZED SEPARATELY, AND TO BE REVIEWED BY BUILDING OFFICIAL.

DESIGN LOADS SHOWN ARE BASED ON 'ALLOWABLE STRESS DESIGN (ASD)'.

MANUFACTURER'S LABEL SHALL BE LOCATED ON A READILY VISIBLE LOCATION IN ACCORDANCE WITH SECTION 1709.9.3 OF FLORIDA BUILDING CODE. LABELING TO COMPLY WITH SECTION 1709.9.2.

> Sealed: 04/20/2021 FL #25959.1

> > STATE OF

. FLORIDA

- A- CONTRACTOR TO BE RESPONSIBLE FOR THE SELECTION, PURCHASE AND INSTALLATION OF THIS PRODUCT BASED ON THIS PRODUCT EVALUATION PROVIDED HE/SHE DOES NOT DEVIATE FROM THE CONDITIONS DETAILED ON THIS DOCUMENT
- B-THIS PRODUCT EVALUATION DOCUMENT WILL BE CONSIDERED INVALID IF ALTERED BY ANY MEANS.
- SITE SPECIFIC PROJECTS SHALL BE PREPARED BY A FLORIDA REGISTERED ENGINEER OR ARCHITECT WHICH WILL BECOME THE ENGINEER OF RECORD (E.O.R.) FOR THE PROJECT AND WHO WILL BE RESPONSIBLE FOR THE PROPER USE OF THE P.E.D. ENGINEER OF RECORD, ACTING AS A DELEGATED ENGINEER TO THE P.E.D. ENGINEER SHALL SUBMIT TO THIS LATTER THE SITE SPECIFIC DRAWINGS FOR REVIEW.
- D- THIS P.E.D. SHALL BEAR THE DATE AND ORIGINAL SEAL AND SIGNATURE OF THE PROFESSIONAL ENGINEER OF RECORD THAT PREPARED IT.



CORPORATION
DUCT DEVELOPMENT (C.A.N. 5 FAX. (305) 262-4 AL-FAROOQ CORPOR/
ENGINEERS & PRODUCT DEVELOPI 9360 SUNSET DRIVE, SUITE 220 MIAMI, FLORIDA 33173 (C.A TEL. (305) 264-8100 FAX. (305)

MANUFACTURING,

DOOR

GLASS

SLIDING

ALUM

MR-GLASS DOORS & WINDOWS M 8051 N.W. 79th Place Medley, FL. 33166 Tel. (305) 764-3963 Fax.

SERIES by description
UPDATED TO 2020
POCKETS OPTION /


date 08.05.20 в A 0 је TARIQ ь ў: ď.

drawing 18-06F

sheet **1** of **11**

		STD. INT		STD. INTERLOCK WITH OR WITHOUT STD. ASTRAGAL				STD. INTERLOCK WITH OR WITHOUT REINF. ASTRAGAL GLASS TYPES 'A' & 'A1'	
AVERAGE PANEL WIDTH	DOOR FRAME HEIGHT	GLASS TYPES 'A' & 'A1'		GLASS TYPES 'A' & 'A1'		GLASS TYPES 'B' & 'B1' 'C' & 'C1'			
INCHES	INCHES	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)
42		65.0	75.0	80.0	100.0	80.0	80.0	80.0	100.0
48		65.0	75.0	80.0	100.0	80.0	80.0	80.0	100.0
54		65.0	75.0	71.1	88.9	71.1	80.0	80.0	88.9
60		65.0	75.0	64.0	80.0	_	_	64.0	80.0
66	82-7/8	65.0	75.0	_	_	_	_	_	_
72		65.0	75.0				_	_	_
78		65.0	75.0				_	_	_
84		65.0	75.0			_	_		_
42		65.0	75.0	80.0	100.0	80.0	80.0	80.0	100.0
48									
		65.0	75.0	80.0	100.0	80.0	80.0	80.0	100.0
54		65.0	75.0	71.1	88.9	71.1	80.0	71.1	88.9
60		65.0	75.0	64.0	80.0		-	64.0	80.0
62	84	65.0	75.0		_	-		_	
66	J 1	65.0	75.0	_		_	_	-	
72		65.0	75.0				_		_
78		65.0	75.0		-	_	_		
84		65.0	75.0	_	-	_	_		_
42		65.0	75.0	80.0	100.0	80.0	80.0	80.0	100.0
48		65.0	75.0	80.0	100.0	80.0	80.0	80.0	100.0
54		65.0	75.0	71.1	88.9	-	_	71.1	88.9
60		65.0	75.0			_	_	64.0	80.0
62	90	65.0	75.0	_	_	-	_	_	<u> </u>
66	50	65.0	75.0	_			_	_	_
72		65.0	75.0	_				_	_
78		65.0	75.0						
80		65.0	75.0		_	_	_	_	
42		65.0	75.0	80.0	100.0	80.0	80.0	80.0	100.0
48		65.0	75.0	80.0	100.0	80.0	80.0	80.0	100.0
54		65.0	75.0	71.1	88.9	-	_	71.1	88.9
60	96	65.0	75.0	_	_		_	64.0	80.0
62		65.0	75.0	. -	-	-	-	_	_
66		65.0	75.0		-				_
72		65.0	75.0	_	_	_	_		_
74		65.0	75.0	_	_	_	_		_
42		65.0	75.0	80.0	100.0			80.0	100.0
48		65.0	75.0	80.0	100.0			80.0	100.0
50		65.0	75.0		_	_	_	76.8	96.0
52		65.0	75.0			_		73.8	92.3
54		65.0	75.0					71.1	88.9
56	102	65.0	75.0	_	_		_	68.6	85.7
60		65.0	75.0	_		-	_	_	_
62		65.0	75.0		_	_			_
66		65.0	75.0	_	_	_	_	_	_
70		65.0	75.0	····	_	••••	_		_
42		65.0	75.0	80.0	100.0	_	_	80.0	100.0
48		65.0	75.0	80.0	100.0		_	80.0	100.0
50	108	65.0	75.0	-	_			76.8	96.0
60		65.0	75.0				-	73.8	92.3
62		65.0	75.0	_	_	_	_	_	_

	DOOR DESIGN LOAD CAPACITY - PSF									
,				TERLOCK ASTRAGAL	STD. INTERLOCK WITH OR WITHOUT STD. ASTRAGAL				STD. INTERLOCK WITH OR WITHOUT REINF. ASTRAGAL	
	AVERAGE DOOR FRAME PANEL WIDTH HEIGHT		GLASS 'A' &	TYPES: 'A1'	GLASS TYPES 'A' & 'A1'		GLASS TYPES 'B' & 'B1' 'C' & 'C1'		GLASS TYPES 'A' & 'A1'	
	INCHES	INCHES	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)
	42		65.0	75.0	_	_ '	_	_	80.0	100.0
	48		65.0	75.0	-	-	_		80.0	100.0
	50	114	65.0	75.0	_	-		-	76.8	96.0
	60		65.0	75.0	_	-	_			-
	62		65.0	75.0	-		NAMES A	_	•••	-
	42		65.0	75.0	_	_	_		80.0	100.0
	48		65.0	75.0	_			_	80.0	100.0
	50	120	65.0	75.0	-			***		
7	60		65.0	75.0	AMIN	-	_	-	-	

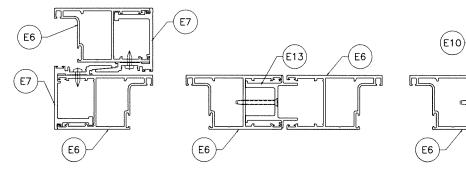



STD. ASTRAGAL

REINF. ASTRAGAL


NOTE: GLASS CAPACITIES ON THIS SHEET ARE BASED ON ASTM E1300-09 (3 SEC. GUSTS) AND FLORIDA BUILDING COMMISSION DECLARATORY STATEMENT DCA05-DEC-219

FL #25959.1

FOR INSTALLATIONS WHERE WATER INFILTRATION RESISTANCE IS REQUIRED LIMIT ALL EXTERIOR(+) LOADS TO +76.7 PSF FOR 2-13/16" SILL HEIGHTS SEE SHEET 5 FOR DETAILS

REINF. ASTRAGAL ONLY IN CONFIGURATIONS THAT REQUIRE ASTRAGAL.

DOOR FRAME WIDTH AVERAGE PANEL WIDTH = NUMBER OF PANELS





AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173 (C.A.N. 3538)
TEL. (305) 264-8100 FAX. (305) 262-6978

by description


lo lo <u>ئ</u>ا: drawing no. 18-06F

sheet **1.1** of **11**

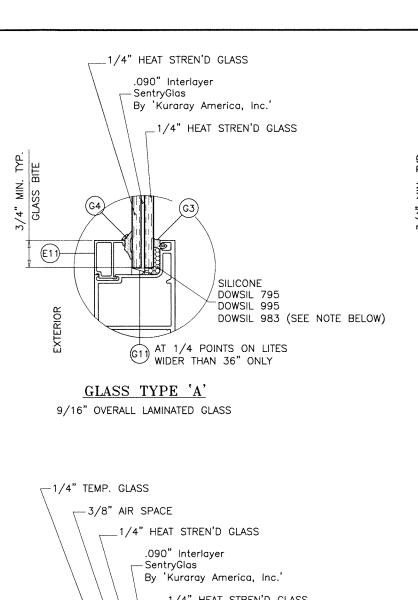

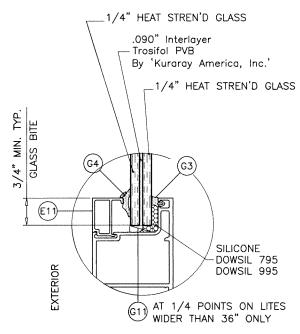


GLASS TYPE 'B'
9/16" OVERALL LAMINATED GLASS

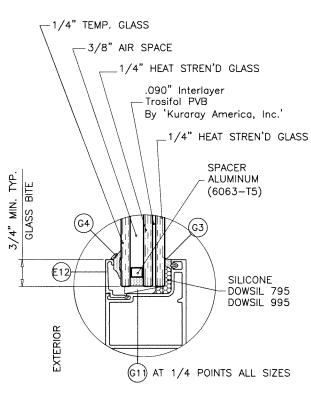


GLASS TYPE 'BI'
1-3/16" OVERALL INSUL. LAM. GLASS


GLAZING OPTIONS

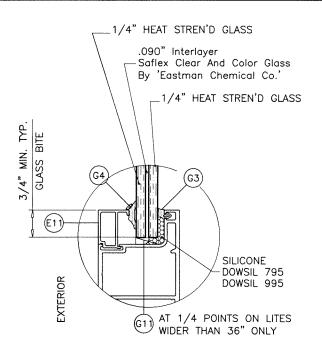

GLASS TYPE 'C'
9/16" OVERALL LAMINATED GLASS

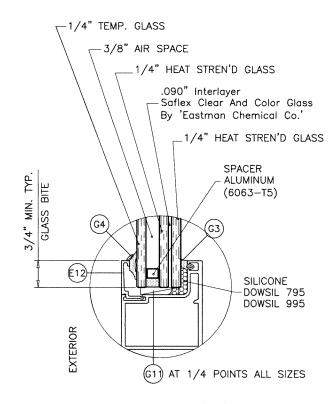

GLASS TYPE 'CI'
1-3/16" OVERALL INSUL. LAM. GLASS

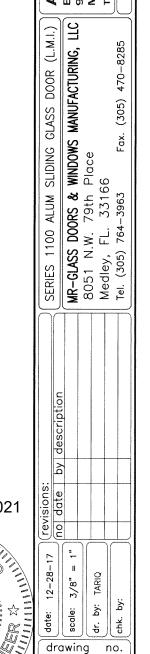

18-06F

sheet 2 of 11

U

O


 AL-FAROOQ CORPORATION

 ENGINEERS & PRODUCT DEVELOPMENT

 9360 SUNSET DRIVE, SUITE 220

 MIAMI, FLORIDA 33.173
 (C.A.N. 3538)


 TEL. (305) 264-8100
 FAX. (305) 262-6978

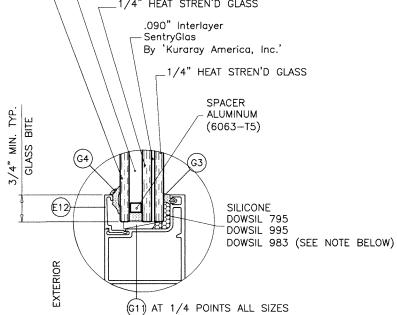



GLASS TYPE 'AI'
1-3/16" OVERALL INSUL. LAM. GLASS


NOTE: FOR DOWSIL 983 SILICONE LIMIT MAX. DESIGN LOADS TO +65, -75.0 PSF FAROUS FAROUS NO. 81223


STATE OF TORIDA FAROUS FAR

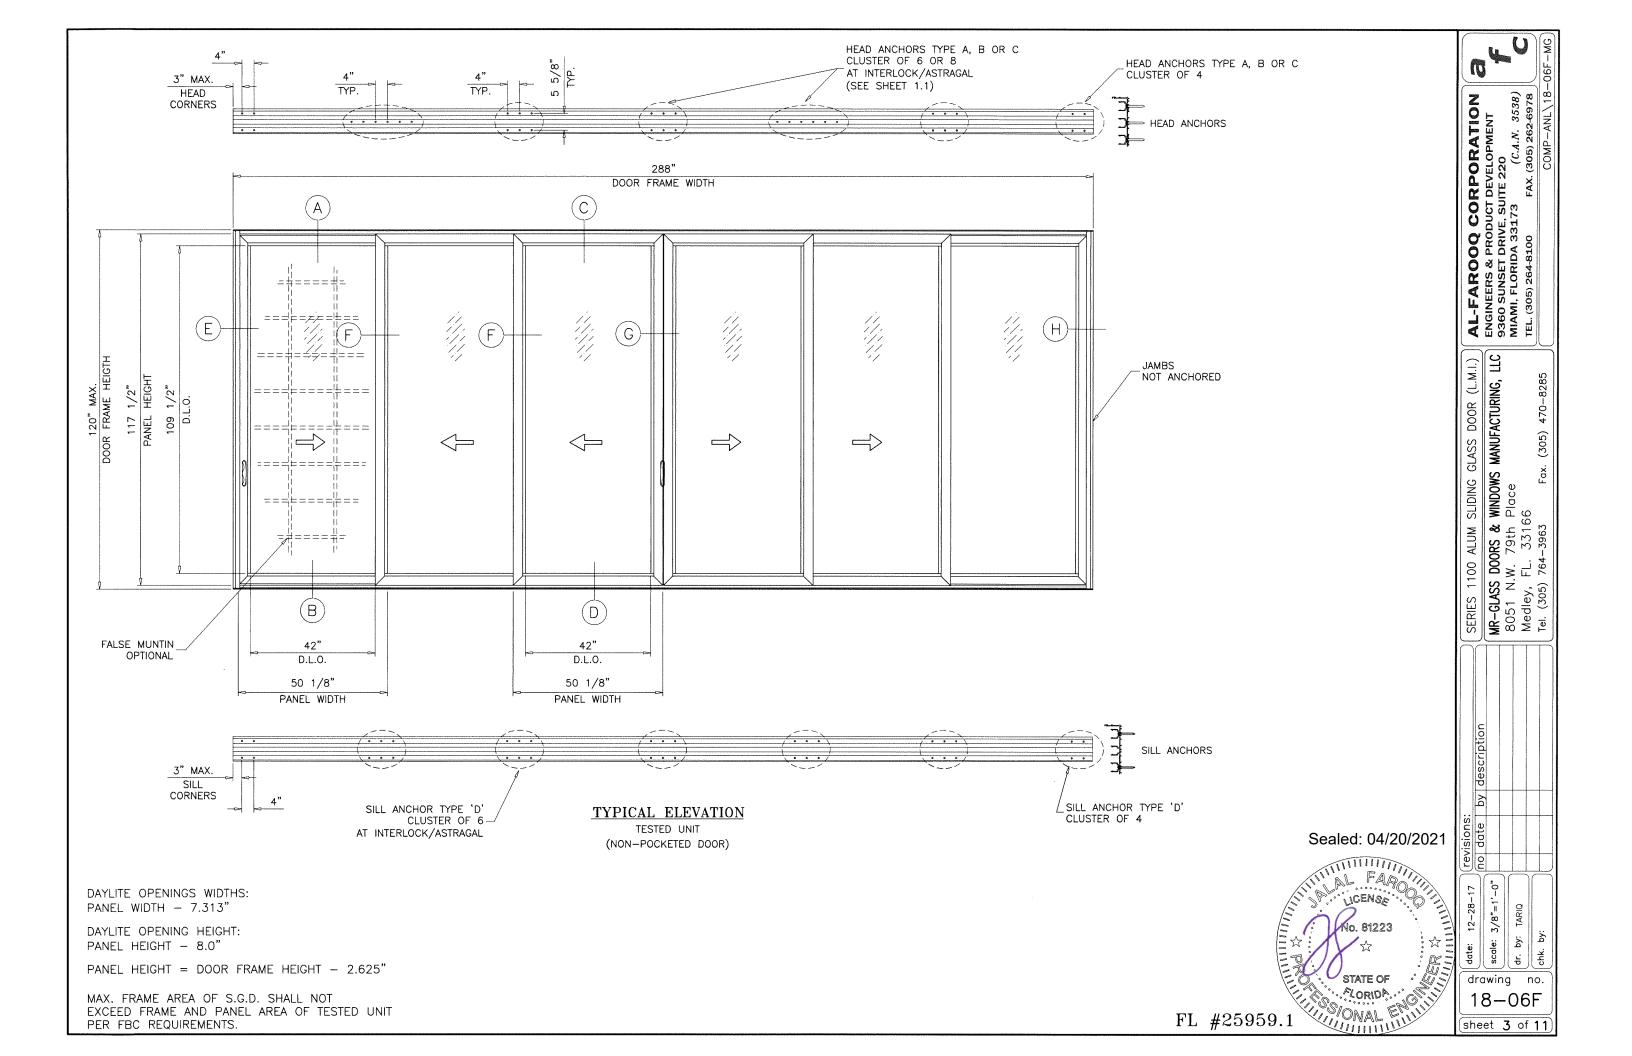

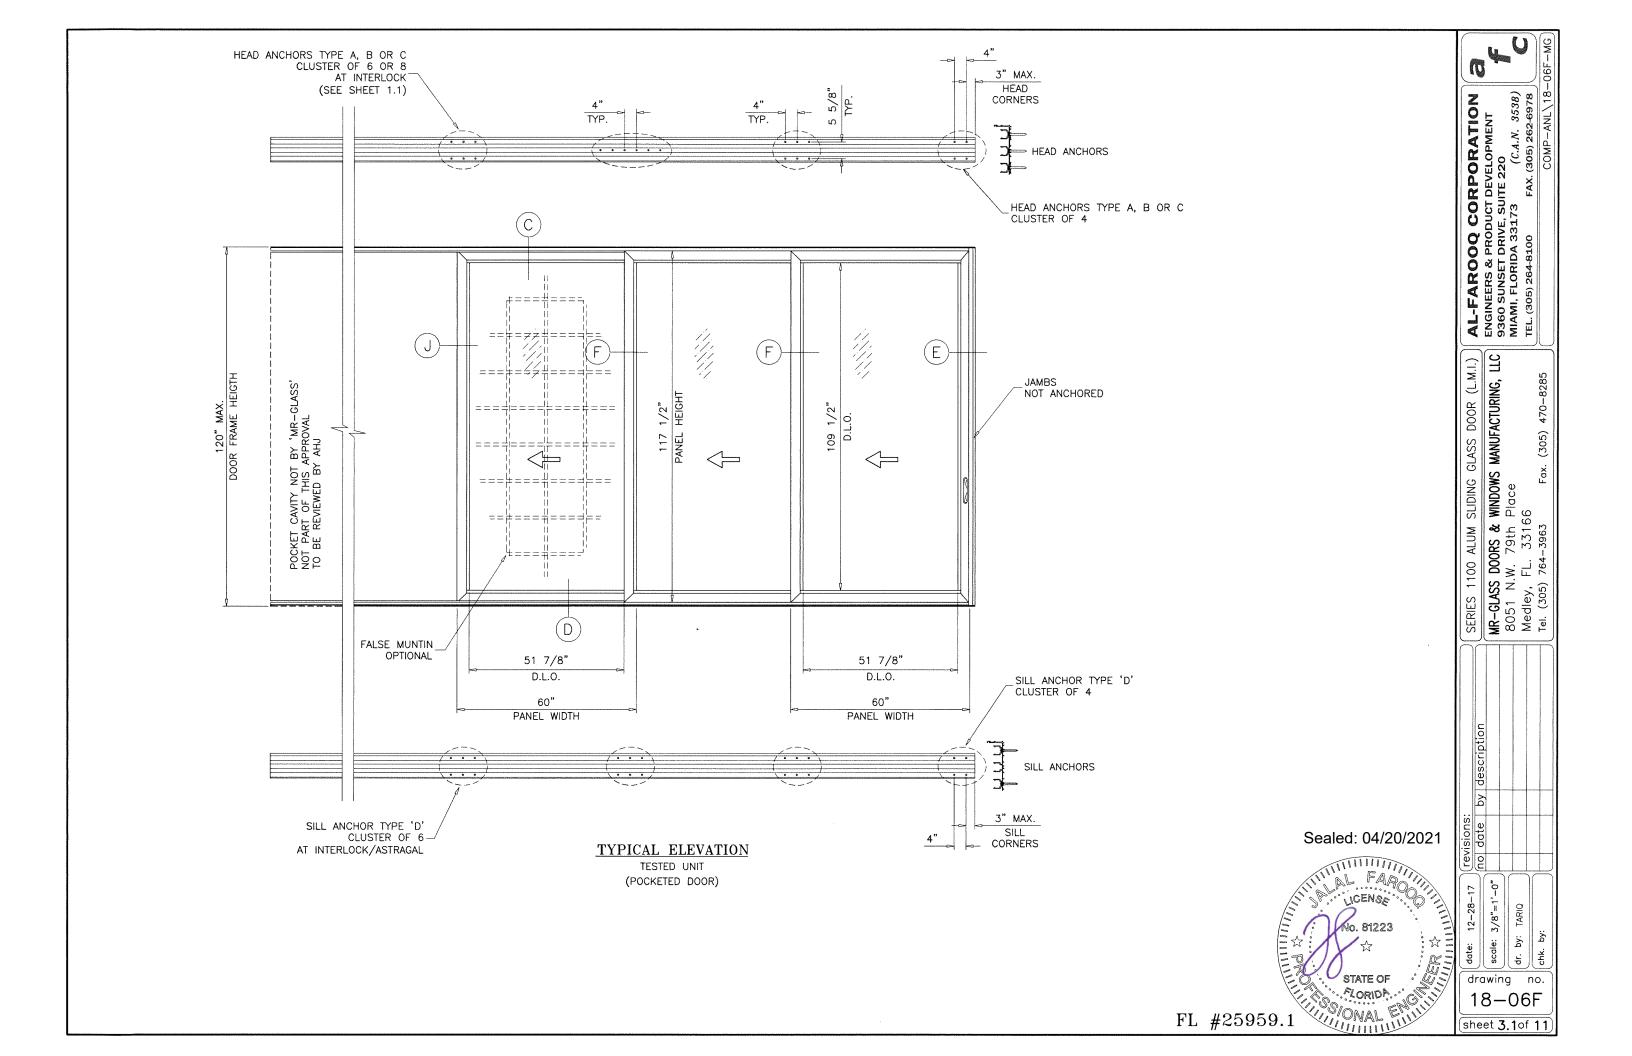




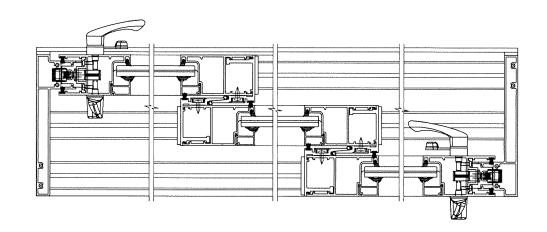



XXX-O (SHOWN & REVERSE) O-XXX

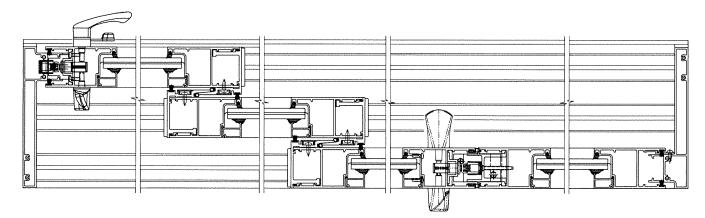




XXX—XXO (SHOWN & REVERSE) OXX—XXX

xxx-xxxoxx-xxo

APPROVED CONFIGURATIONS NON-POCKETED DOORS

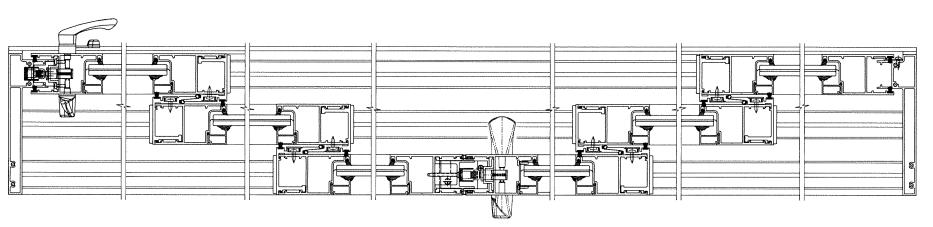

NOTE:

- 1. CONFIGURATIONS SHOWN FOR ILLUSTRATION PURPOSES ONLY.
- 2. FOR APPLICABLE DESIGN PRESSURES SEE INSTRUCTIONS IN SHEET 1.
- 3. FOR ANCHOR DETAILS SEE SHEETS 5 AND 6.
- 4. DOOR CONFIGURATIONS SHOWN WITH STD. ASTRAGAL ONLY. USE REINF. ASTRAGAL AS REQUIRED SEE SHEET 1 FOR CAPACITY AND SHEET 7 FOR DETAIL.

U

(C.A.N. 3538) FAX. (305) 262-6978

 AL-FAROOQ CORPORATION

 ENGINEERS & PRODUCT DEVELOPMENT

 9360 SUNSET DRIVE, SUITE 220

 MIAMI, FLORIDA 33173
 (C.A.N. 3538)

 TEL. (305) 264-8100
 FAX. (305) 262-6978

SERIES 1100 ALUM SLIDING GLASS DOOR (L.M.I.)

MR-GLASS DOORS & WINDOWS MANUFACTURING, LLC


8051 N.W. 79th Place
Medley, FL. 33166
Tel. (305) 764-3963 Fax. (305) 470-8285


by description


Sealed: 04/20/2021 no re TARIQ dr. by: 18-06F


drawing no.


FL #25959.1 sheet 4 of 11

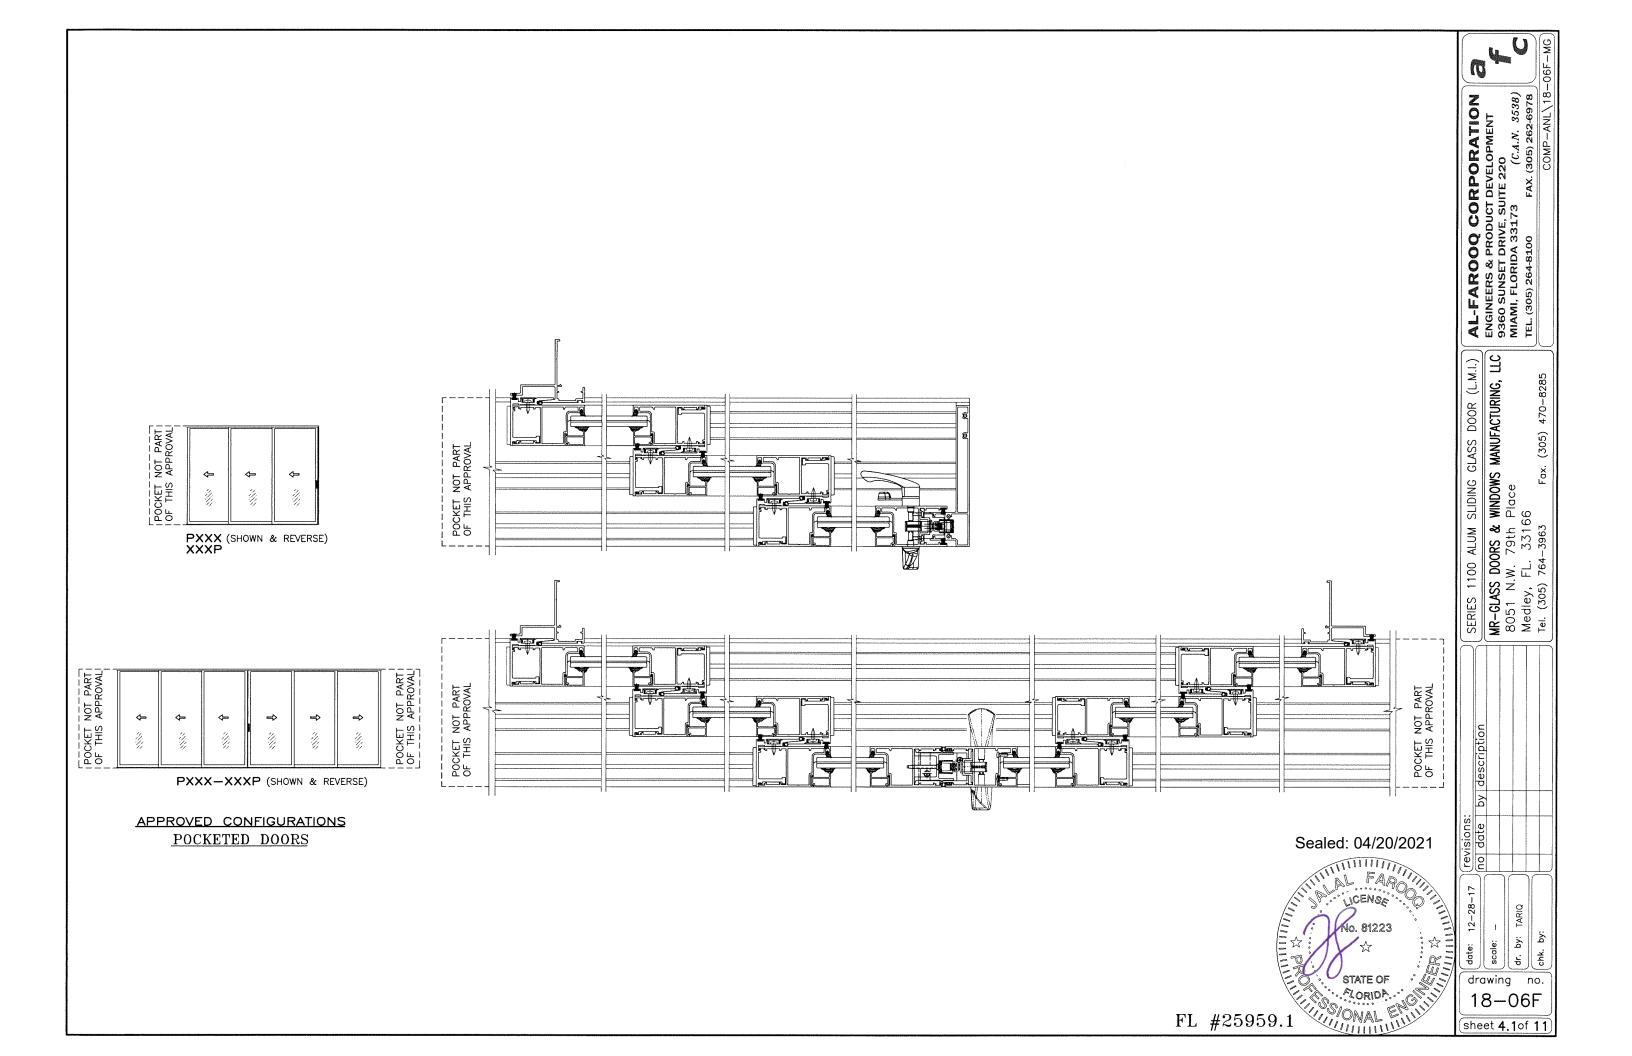

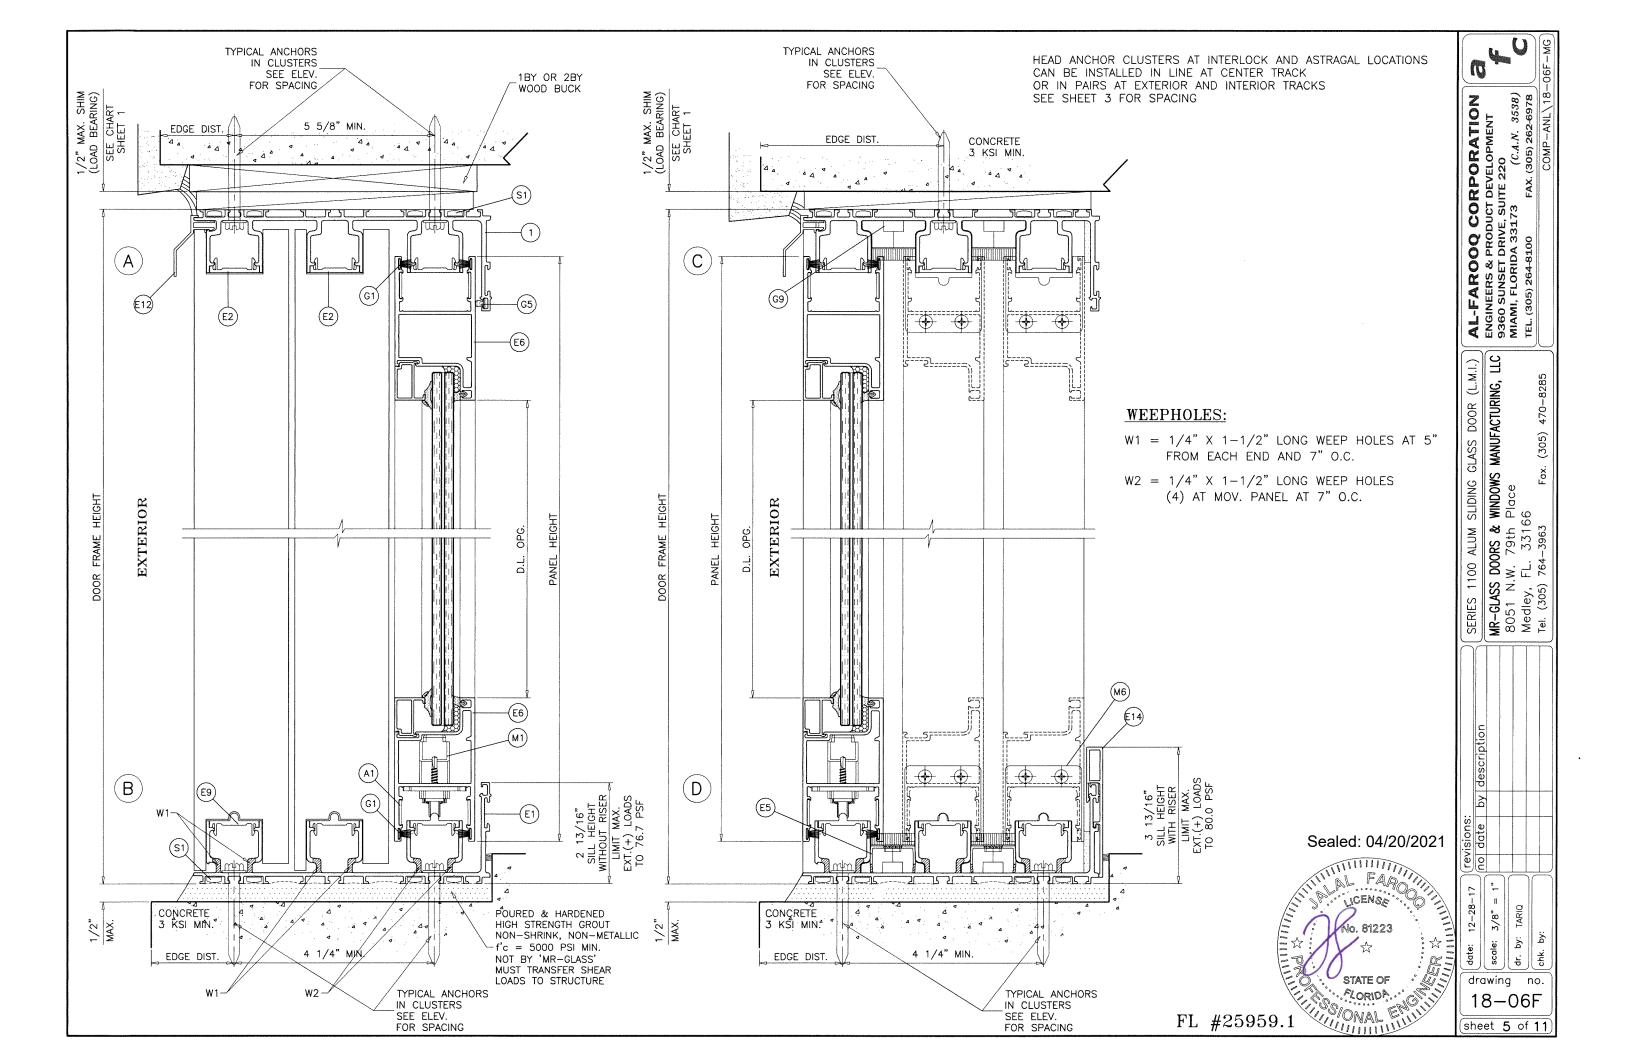

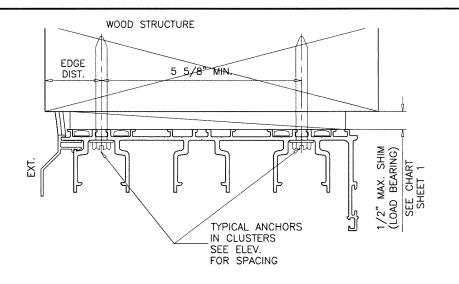

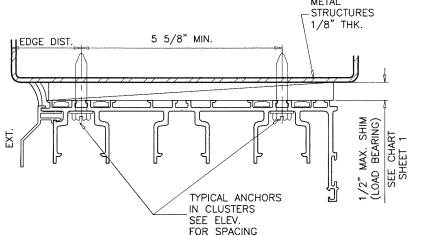

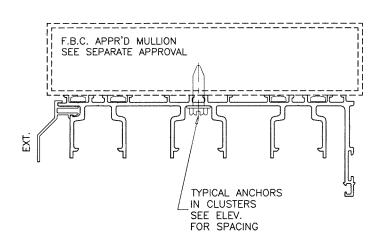

1BY OR 2BY WOOD BUCKS AND METAL STRUCTURE NOT BY 'MR-GLASS' MUST SUSTAIN LOADS IMPOSED BY GLAZING SYSTEM AND TRANSFER THEM TO THE BUILDING STRUCTURE.

TYPICAL ANCHORS: SEE ELEV. FOR SPACING

- AT HEAD

TYPE 'A'- 5/16" X 2-3/4" ULTRACON BY 'DEWALT' (Fu=177 KSI, Fy=155 KSI)

INTO WOOD STRUCTURES

1-7/8" MIN. PENETRATION INTO WOOD

THRU 1BY OR 2BY BUCKS INTO CONCRETE 1-1/2" MIN. EMBED INTO CONCRETE

TYPE 'B'- 5/16" X 2-3/4" ULTRACON BY 'DEWALT' (Fu=177 KSI, Fy=155 KSI)

DIRECTLY INTO CONCRETE 1-3/4" MIN. EMBED

TYPE 'C'- 5/16" DIA. TEKS SELF DRILLING SCREWS (GRADE 5 CRS)

INTO F.B.C. APPROVED MULLIONS

INTO METAL STRUCTURES

(3) THREADS MIN. TO EXTEND BEYOND METAL THICKNESS

ALUMINUM: 1/8" THK. MIN. (6063-T5 MIN.)

STEEL: 1/8" THK. MIN. (Fy = 36 KSI MIN.)

(STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

TYPE 'D'- 5/16" DIA. ULTRACON BY 'DEWALT' (Fu=177 KSI, Fy=155 KSI)

DIRECTLY INTO CONCRETE 1-3/4" MIN. EMBED

ANCHOR EDGE DISTANCES

INTO CONCRETE AT HEAD/SILL = 1-3/4" MIN. INTO WOOD STRUCTURE = 1-1/4" MIN. INTO METAL STRUCTURE = 3/4" MIN.

WOOD AT HEAD SG = 0.55 MIN. CONCRETE AT HEAD, SILL f'c = 3000 PSI MIN. HEAD ANCHOR CLUSTERS AT INTERLOCK AND ASTRAGAL LOCATIONS CAN BE INSTALLED IN LINE AT CENTER TRACK OR IN PAIRS AT EXTERIOR AND INTERIOR TRACKS SEE SHEET 3 FOR SPACING

Sealed: 04/20/2021



by description isions: date جَ <u>a</u>

drawing no. 18-06F


sheet 6 of 11


(C.A.N. 3538) FAX. (305) 262-6978

CORPORATION

AL-FAROOQ CORPOF ENGINEERS & PRODUCT DEVELO 9360 SUNSET DRIVE, SUITE 220 MIAMI, FLORIDA 33173 (C

MR-GLASS DOORS & WINDOWS MANUFACTURING, LLC 8051 N.W. 79th Place Medley, FL. 33166
Tel. (305) 764-3963

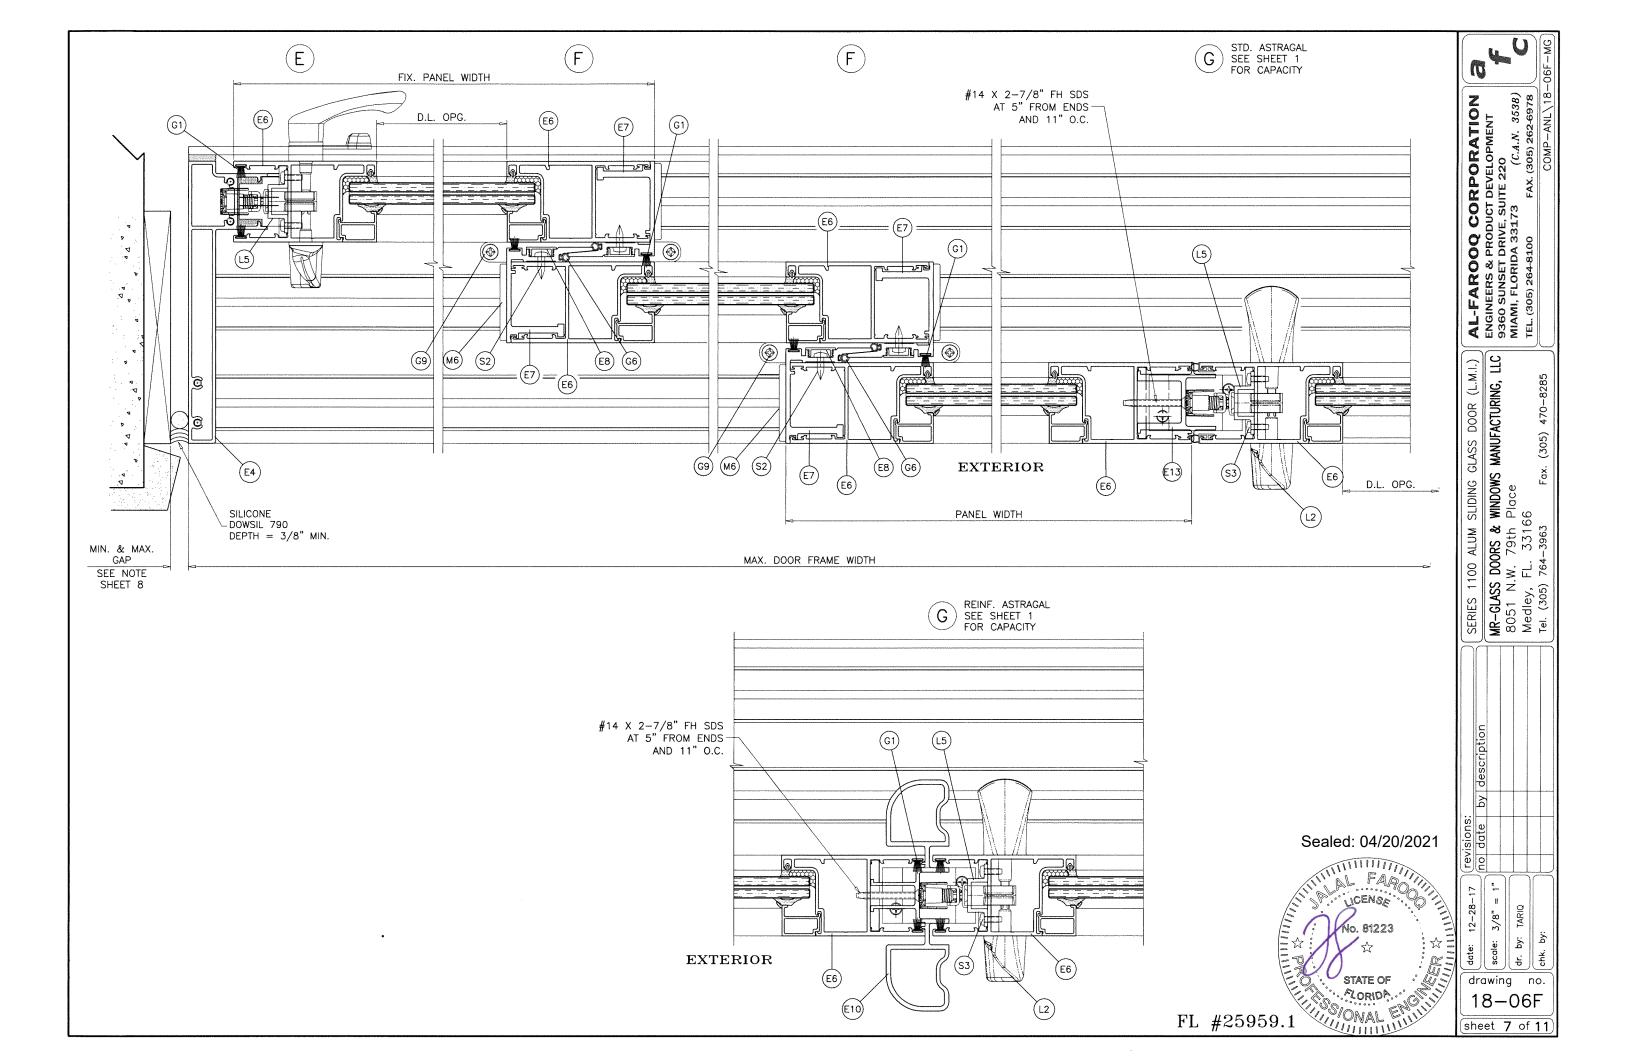

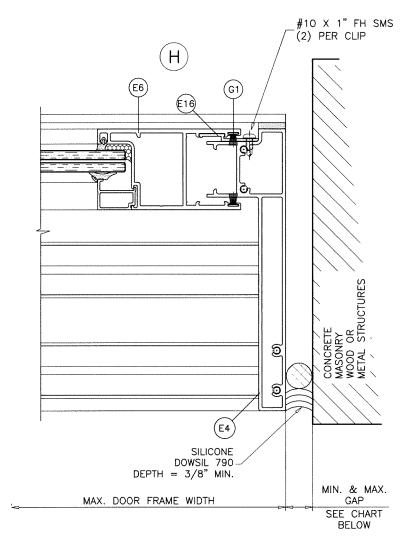

MAX. FRAME	GAP			
HEIGHT	MIN.	MAX.		
96"	5/16"	3/4"		
108"	3/8"	3/4"		
120"	7/16"	3/4"		

NOTE:
MAX. MOVEMENT CONSIDERED=100% STRETCH.
PLEASE REFER TO SEALANT MANUFACTURER'S DATA AND APPLICATION
MANUAL FOR COMPATABILITY OF SEALANT TO SUBSTRATE & WINDOWALL
MATERIAL/FINISH AND COMPLIANCE FOR WARRANTY.
REFER TO ACI-117-10 FOR CONSTRUCTION TOLERANCES.

ALTERNATE SEALANTS AT JAMB GAPS CAN BE DESIGNED BY ENGINEER OF RECORD BASED ON MANUFACTURER GUIDE LINES.

GAPS LESS THAN 1/4" MAY BE DESIGNED BY ENGINEER OF RECORD BY THE USE OF BOND BREAKER TAPE OR 15% OF GAP ALLOWED MOVEMENT.

Sealed: 04/20/2021

FARO

No. 81223

STATE OF

TORIDA

FL #25959.1

AL-FAROOQ CORPORATION

ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173 (C.A.N. 3538)

TEL. (305) 264-8100 FAX. (305) 262-6978

SERIES 1100 ALUM SLIDING CLASS DOOR (L.M.I.)


MR-GLASS DOORS & WINDOWS MANUFACTURING, LLC

8051 N.W. 79th Place
Medley, FL. 33166
Tel. (305) 764-3963 Fax. (305) 470-8285 revisions: 3/8" = TARIQ

drawing no.

18-06F

sheet **8** of **11**

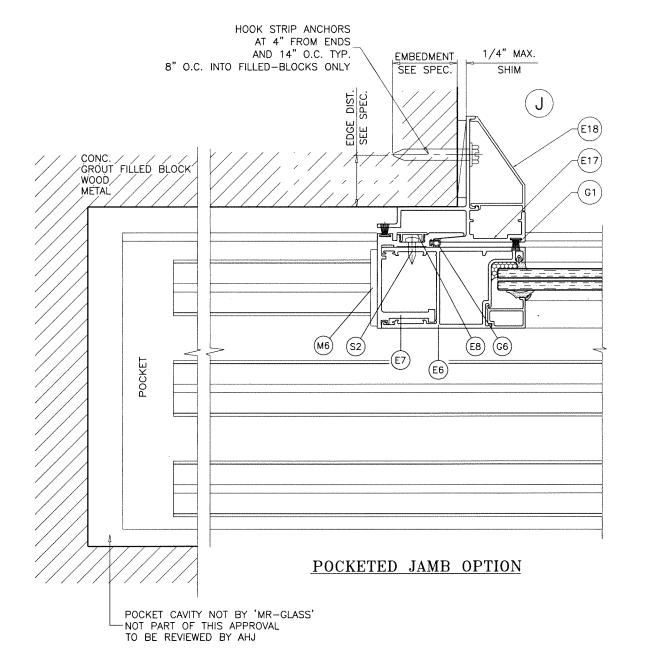

HOOK STRIP ANCHORS:

5/16" DIA. ULTRACON BY 'DEWALT' (Fu=177 KSI, Fy=155 KSI) INTO 2BY WOOD BUCKS OR WOOD STRUCTURES 1-1/2" MIN. PENETRATION INTO WOOD

5/16" DIA. ULTRACON BY 'DEWALT' (Fu=177 KSI, Fy=155 KSI) THRU 1BY BUCKS INTO CONC. OR FILLED BLOCKS 1-3/4" MIN. EMBED INTO CONC. OR FILLED BLOCKS

DIRECTLY INTO CONC. OR FILLED BLOCKS 1-3/4" MIN. EMBED INTO CONC. OR FILLED BLOCKS


5/16" DIA. TEKS OR SELF DRILLING SCREWS(GRADE 5 CRS)

INTO METAL STRUCTURES (3) THREADS MIN. PENETRATION BEYOND SUBSTRATE ALUMINUM: 1/8" THK. MIN. (6063-T5 MIN.) STEEL: 1/8" THK. MIN. (Fy = 36 KSI MIN.) (STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

ANCHOR EDGE DISTANCES

INTO CONCRETE OR BLOCKS = 1-1/4" MIN. INTO WOOD STRUCTURE = 1" MIN. INTO METAL STRUCTURE = 3/4" MIN.

WOOD AT JAMBS SG = 0.55 MIN. CONCRETE AT JAMBS f'c = 3000 PSI MIN. C-90 GROUT FILLED BLOCK AT JAMBS f'm = 2000 PSI MIN.



(C.A.N. 5) FAX. (305) 262-

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173 (C.A.N. 3538)

MR-GLASS DOORS & WINDOWS MANUFACTURING, LLC 8051 N.W. 79th Place Medley, FL. 33166 Fax. (305) 470-8785


SERIES 1100 ALUM SLIDING GLASS DOOR (L.M.I.)

by description visions: date no 12-28-17 3/8" by:

ģ. drawing no.

18-06F sheet **8.1**of **11**

FL #25959.1

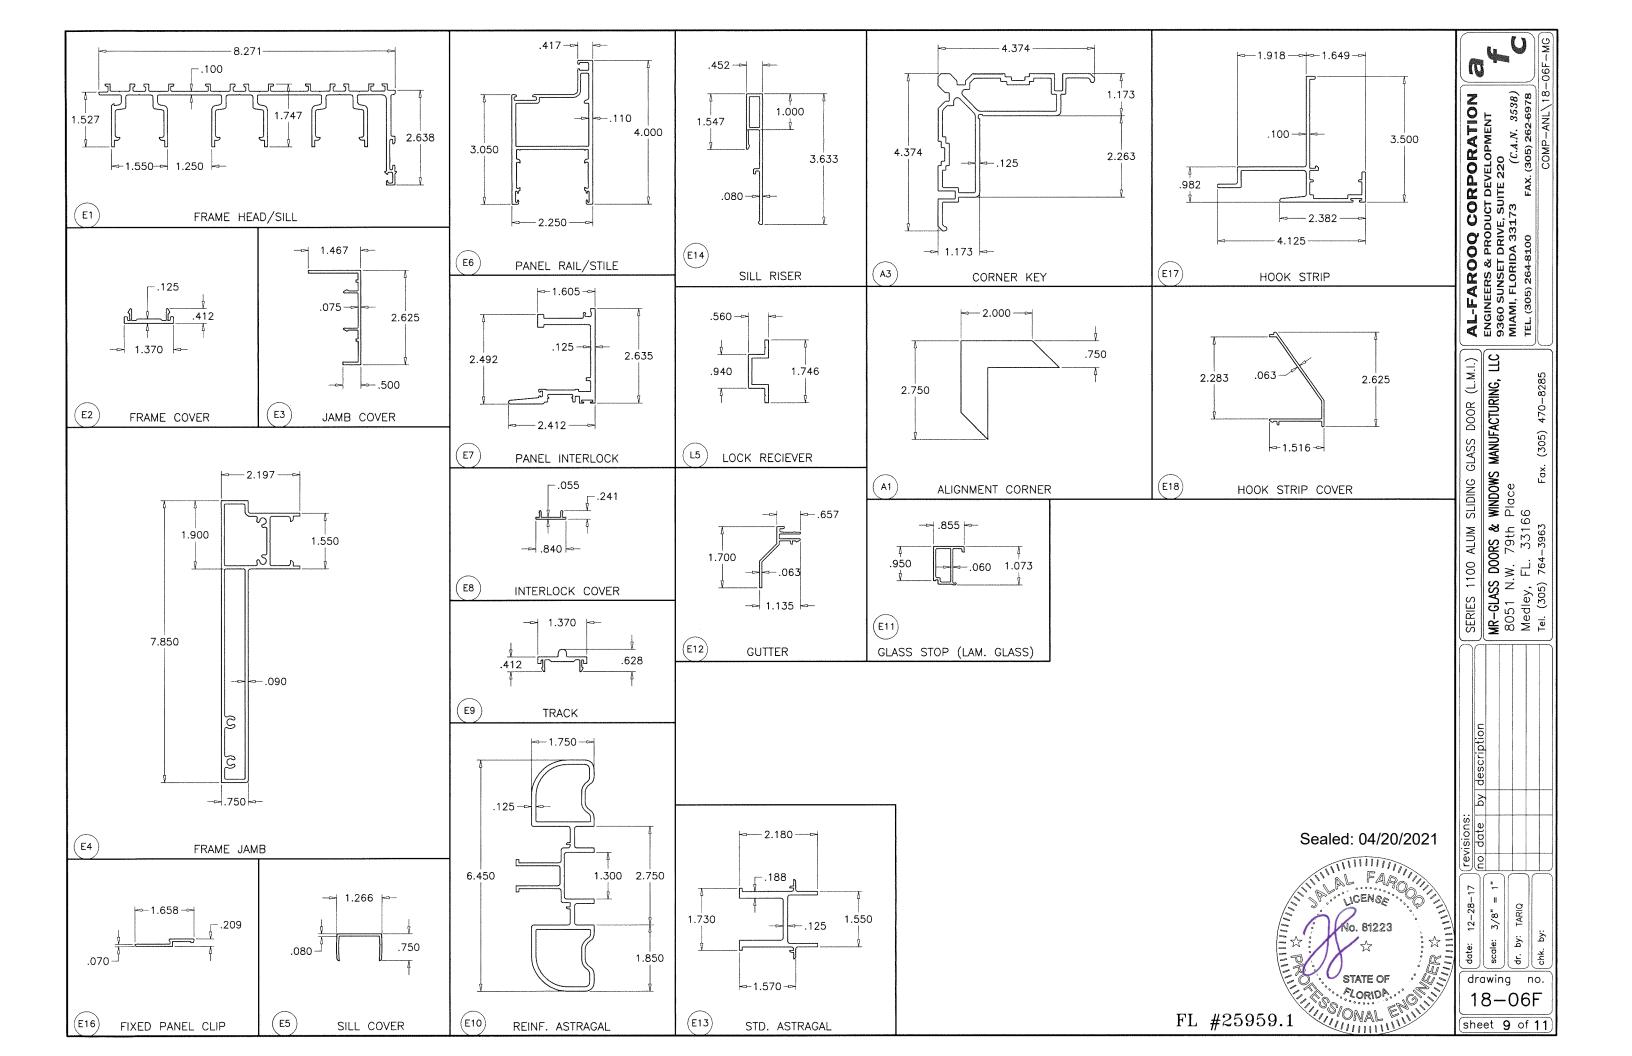

ITEM #	PART #	QUANTITY	DESCRIPTION	MATERIAL	MANF./SUPPLIER/REMARKS
E1	E-1101	2	FRAME HEAD/SILL	6063-T6	
E2	E-1008	AS REQD.	FRAME COVER	6063-T5	_
E3		AS REQD.	JAMB COVER	6063-T5	-
E4	E-1102	2	FRAME JAMB	6063-T6	-
E5	E-9006	AS REQD.	SILL COVER	6063-T5	
E6	E-1010	AS REQD.	PANEL RAIL/STILE	6005-T5	-
E7	E-1011	AS REQD.	PANEL INTERLOCK	6005-T5	
E8	E-1018	AS REQD.	INTERLOCK COVER	6063-T5	_
E9	E-1007	1/ MOV. PANEL	TRACK	6063-T5	_
E10	E-1013	AS REQD.	REINF. ASTRAGAL	6005-T5	-
E11	E-9001	4/ PANEL	GLASS STOP (LAM. GLASS)	6063-T6	_
E12	E-1016	AS REQD.	GUTTER	6063-T5	
E13	E-1012	AS REQD.	STD. ASTRAGAL	6005-T5	_
E14	E-1014	AS REQD.	3-5/8" SILL RISER	6063-T6	_
E16	E-1021	3/ PANEL	FIXED PANEL CLIP, AT 17" FROM ENDS & 40" O.C.	6063-T5	EACH FASTENED WITH (2) #10 X 1" FH SMS
E17	E-1022	AS REQD.	HOOK STRIP	6063-T6	_
E18	E-9008	AS REQD.	HOOK STRIP COVER	6063-T6	-
G1	W71325NK	AS REQD.	TRI FIN PILE W'STRIPPING		ULTRAFAB
G2	-	AS REQD.	COMPRESSION GASKET	EPDM	DUROMETER 70±5 SHORE A
G3	G10-03	AS REQD.	OFFSET GLAZING GASKET	SANTOPRENE	DUROMETER 70±5 SHORE A
G4	G10-04	AS REQD.	WEDGE GASKET	EPDM	DUROMETER 70±5 SHORE A
G5	G10-06	AS REQD.	AIR SEAL GASKET	SANTOPRENE	ULTRAFAB
G6	G10-06	AS REQD.	INTERLOCK GASKET	POLYPROPYLENE	ULTRAFAB
G8		_	1/4" THK. FOAM PAD	POLYETHYLENE	_
G9	G10-09	_	AIR SEAL BRIDGE AT INTERLOCK	POLYAMIDE	
G10		-	AIR SEAL BRIDGE AT MTG. STILE	POLYAMIDE	_
G11		AS REQD.	SETTING BLOCKS	EPDM	DUROMETER 80±5 SHORE A
A1	A10-01	_	ALIGNMENT CORNER	6063-T5	_
A3	E-9005	_	CORNER KEY	6063-T6	_
L1	L10-01	-	2 POINT MORTISE LOCK & HANDLE	-	INTERLOCK
L2	PS01-7102	_	2 POINT MORTISE LOCK & HANDLE	-	INTERLOCK
L3	PS01-1005	_	ADJUSTABLE STRIKER	-	INTERLOCK
L5	E-1017	-	LOCK RECIEVER	6063-T5	_
М1	M10-10A	2 PANEL	ROLLER ASSEMBLY AT 9" FROM ENDS	ST. STEEL/ACETAL	FASTENED WITH (2) 12-24 X 3/4" PH MS
М6	M10-06	AS REQD.	PANEL GUIDES	NYLON	_
M7	M10-07	AS REQD.	PANEL GUIDES	NYLON	
S1	#12 X 1 1/2"	4/ CORNER	FRAME ASSEMBLY FASTENERS	ST. STEEL	HWH SDS
S2	10-24 X 1/2"	AS REQD.	INTERLOCK FASTENERS, AT 6" FROM ENDS AND 12" O.C.	ST. STEEL	PH TC MS
S3	#8-18 X 1/2"	AS REQD.	LOCK RECIEVER FASTENERS	AISI 304	PHILIP PH SMS
S4	#10 X 1/2"	AS REQD.	PANEL ASSEMBLY FASTENERS	ST. STEEL	FH SMS

SEALANT:

ALL JOINTS AND FRAME CONNECTIONS SEALED WITH WHITE/ALUMINUM COLORED SILICONE.

LOCKS:

SURFACE MOUNT METALLIC THREE PLY DUAL HOOK LOCK AT 38-1/2" FROM BOTTOM FASTENED TO LOCK STILE WITH (2) 10-24 X 1/2" FH TC MS

SURFACE MOUNT METALLIC HANDLE AT 38-1/2" FROM BOTTOM FASTENED TO LOCK STILE WITH (2) 8-32 X 2-5/8" FH MS

SURFACE MOUNT METALLIC KEEPER FACING LOCK AT 38 1/2" FROM BOTTOM FASTENED WITH

- (1) #14 X 2-7/8" FH SDS AND (1) 12-24 X 1/2" PH MS

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173 (C.A.N. 3538)
TEL. (305) 264-8100 FAX. (305) 262-6978

SERIES 1100 ALUM SLIDING GLASS DOOR (L.M.I.)

MR-GLASS DOORS & WINDOWS MANUFACTURING, LLC
8051 N.W. 79th Place
Medley, FL. 33166
Tel. (305) 764-3963 Fax. (305) 470-8285

by description visions: date no re

Sealed: 04/20/2021



drawing no. 18-06F sheet 10 of 11

by: scale:

ch ch

12-28-17 3/8" =

