| REVISIONS | | | | | | |
|-----------|-------------|------|----------|--|--|--|
| REV | DESCRIPTION | DATE | APPROVED | | | |

NOTES:

- 1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH REQUIREMENTS OF THE FLORIDA BUILDING CODE.
- 2. WOOD FRAMING AND MASONRY OPENING TO BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO STRUCTURE. FRAMING AND MASONRY OPENING IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.
- 3. 1X BUCK OVER MASONRY/CONCRETE IS OPTIONAL.
- 4. WHERE SHIM OR BUCK THICKNESS IS LESS THAN 1-1/2" UNITS MUST BE ANCHORED THROUGH THE FRAME IN ACCORDANCE WITH MANUFACTURER'S PUBLISHED INSTALLATION INSTRUCTIONS. ANCHORS SHALL BE SECURELY FASTENED DIRECTLY INTO MASONRY, CONCRETE OR OTHER STRUCTURAL SUBSTRATE MATERIAL.
- 5. WHERE WOOD BUCK THICKNESS IS 1-1/2" OR GREATER, BUCK SHALL BE SECURELY FASTENED TO MASONRY, CONCRETE OR OTHER STRUCTURAL SUBSTRATE. UNITS MAY BE ANCHORED THROUGH FRAME TO SECURED WOOD BUCK IN ACCORDANCE WITH MANUFACTURER'S PUBLISHED INSTALLATION INSTRUCTIONS.
- 6. WHERE 1X BUCK IS NOT USED DISSIMILAR MATERIALS MUST BE SEPARATED WITH APPROVED COATING OR MEMBRANE. SELECTION OF COATING OR MEMBRANE IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.
- 7. BUCKS SHALL EXTEND BEYOND UNIT FRAME INTERIOR FACE SO THAT FULL FRAME SUPPORT IS PROVIDED.
- 8. FOR FIN INSTALLATION SHIM AS NEEDED. FOR FRAME INSTALLATION SHIM AS REQUIRED AT EACH ANCHOR LOCATION WITH LOAD BEARING SHIM. SHIM WHERE SPACE OF 1/16" OR GREATER OCCURS. MAXIMUM ALLOWABLE SHIM STACK TO BE 1/4".
- 9. SHIMS SHALL BE LOCATED, APPLIED AND MADE FROM MATERIALS AND THICKNESS CAPABLE OF SUSTAINING APPLICABLE LOADS.
- 10. WIND LOAD DURATION FACTOR Cd=1.6 WAS USED FOR WOOD ANCHOR CALCULATIONS.
- 11. FRAME MATERIAL: ALUMINUM 6063-T5
- 12. UNITS MUST BE GLAZED PER ASTM E1300-04/09, SEE SHEET 2 FOR GLASS DETAIL.
- 13. APPROVED IMPACT PROTECTIVE SYSTEM <u>IS NOT REQUIRED</u> FOR THIS PRODUCT IN WIND BORNE DEBRIS REGIONS.
- 14. FOR ANCHORING THROUGH FIN INTO WOOD FRAMING OR 2X BUCK USE #6 WOOD SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE A 1 1/4" MINIMUM EMBEDMENT INTO SUBSTRATE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.

- 15. FOR ANCHORING THROUGH FRAME INTO WOOD FRAMING OR 2X BUCK USE #12 WOOD SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE A 1 1/4" MINIMUM EMBEDMENT INTO SUBSTRATE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
- 16. FOR ANCHORING THROUGH FRAME INTO MASONRY/CONCRETE USE 1/4" TAPCONS WITH SUFFICIENT LENGTH TO ACHIEVE A 1 1/4" MINIMUM EMBEDMENT INTO SUBSTRATE WITH 2" MINIMUM EDGE DISTANCE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
- 17. FOR ANCHORING THROUGH FRAME INTO METAL STRUCTURE USE #12 SMS OR SELF DRILLING SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE 3 THREADS MINIMUM BEYOND STRUCTURE INTERIOR WALL. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
- 18. ALL FASTENERS TO BE CORROSION RESISTANT.
- 19. INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR
 MANUFACTURER'S INSTALLATION INSTRUCTIONS AND ANCHORS SHALL NOT BE USED IN
 SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BELOW:
 - A. WOOD: MINIMUM SPECIFIC GRAVITY OF G=0.42
 - B. CONCRETE: MINIMUM COMPRESSIVE STRENGTH OF 2,000 PSI.
 - C. MASONRY: HOLLOW/FILLED BLOCK PER ASTM C90 WITH Fm=2,000PSI MINIMUM.
 - D. METAL STRUCTURE: STEEL 18GA (.048") FY=33KSI/FU=52KSI OR ALUMINUM 6063-T5 FU=30KSI .048" THICK MINIMUM

SIGNED: 08/27/2018

ALL SEASONS COMMERCIAL 1293 NORTH HARVEY MITCHELL PARKWAY BRYAN, TX 77803

SERIES 3250 ALUMINUM FIXED WINDOW 48" X 96" LARGE AND SMALL MISSILE IMPACT NOTES

TABLE OF CONTENTS SHEET NO. DESCRIPTION DRAWN: DWG NO. NOTES 08-03275 1 A.R. SCALE NTS DATE 07/13/18 ELEVATION AND COMPONENTS OF 7 2 L. ROBERTO LOMAS P.E. INSTALLATION DETAILS 3 - 6

L. ROBERTO LOMAS P.E. 1432 WOODFORD RD LEWISVILLE, NC 27023 434-688-0609 rllomas@lrlomaspe.com




Luis R. Lomas P.E. FL No.: 62514




COMPONENTS

REVISIONS

REV DESCRIPTION DATE APPROVED

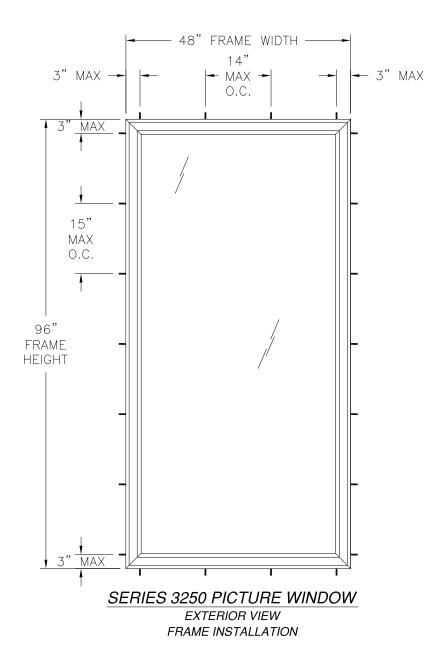

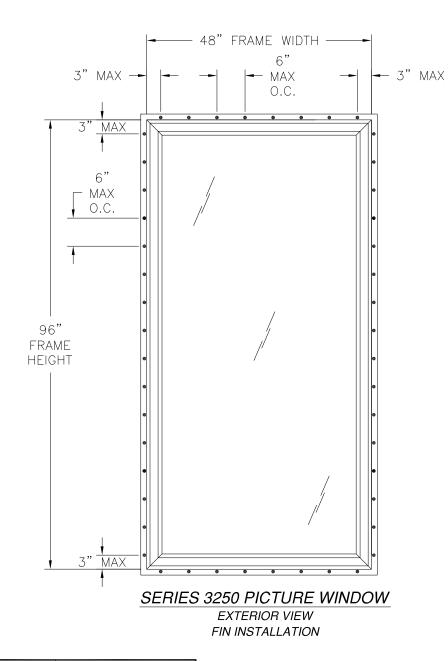

1"

1/4" ANN

CARDINAL GLASS
STAINLESS STEEL
SPACER SYSTEM

5/8" BITE

GLASS DETAIL

1/8" ANN

VINYL GASKET

GLAZING BEAD

(12972)

NOVAGARD M400
SILICONE

DESIGN PRESSURE RATING

+75.0/-80.0 PSF

LARGE AND SMALL
MISSILE IMPACT

48" X 96" UNIT SHOWN. OTHER SIZES APPROVED AS LONG AS FRAME AREA DOES NOT EXCEED 32.0 FT²

NOTES:

1. MAXIMUM D.L.O.: 44 1/4" x 92 1/4"

ALL SEASONS COMMERCIAL 1293 NORTH HARVEY MITCHELL PARKWAY BRYAN, TX 77803

SERIES 3250 ALUMINUM FIXED WINDOW 48" X 96" LARGE AND SMALL MISSILE IMPACT ELEVATIONS AND GLAZING DETAIL


DRAWN:
A.R.

DWG NO.

08-03275


COMBRET 2 OF 7


L. ROBERTO LOMAS P.E. 1432 WOODFORD RD LEWISVILLE, NC 27023 434-688-0609 rllomas@lrlomaspe.com



SIGNED: 08/27/2018

| | REVISIONS | | | | | | |
|-----|-------------|------|----------|--|--|--|--|
| REV | DESCRIPTION | DATE | APPROVED | | | | |

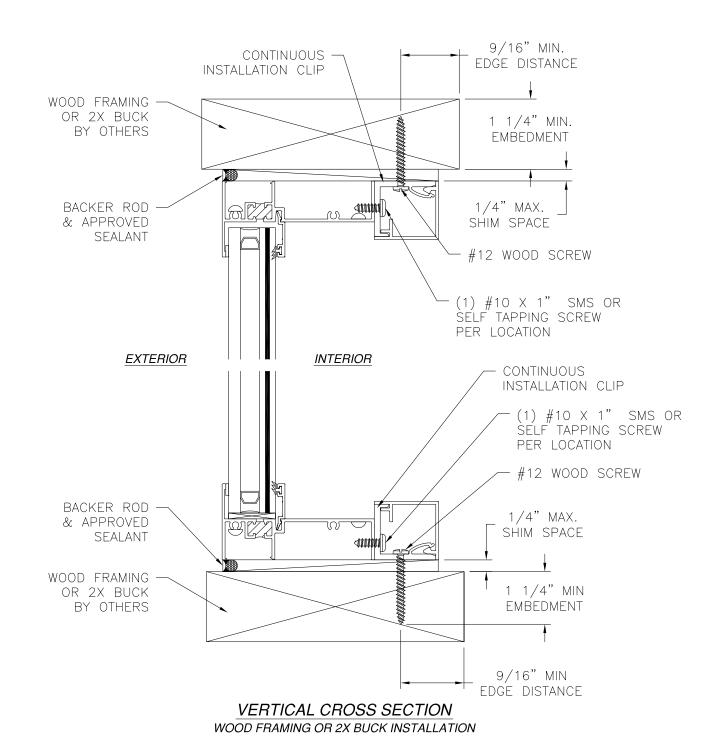

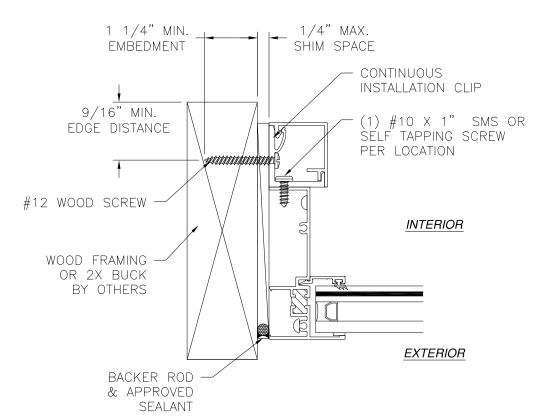

JAMB INSTALLATION DETAIL
WOOD FRAMING OR 2X BUCK INSTALLATION


NOTES:


- 1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
- 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112



REVISIONS


REV DESCRIPTION DATE APPROVED

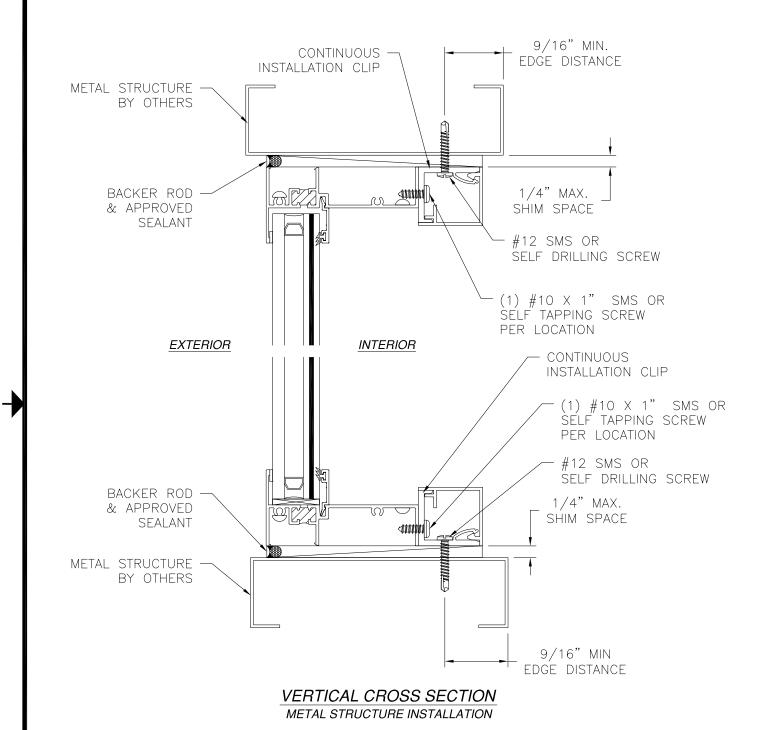

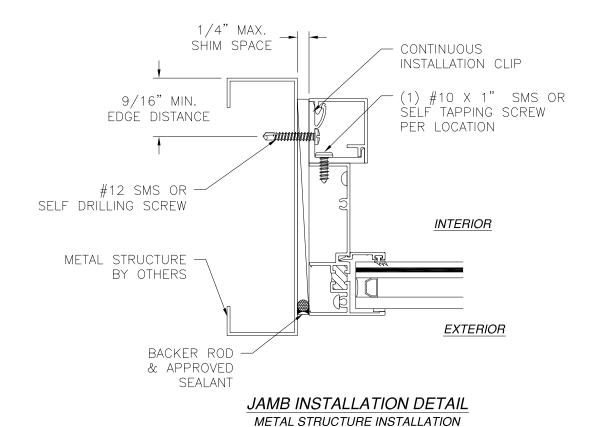


NOTES:

- 1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
- 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

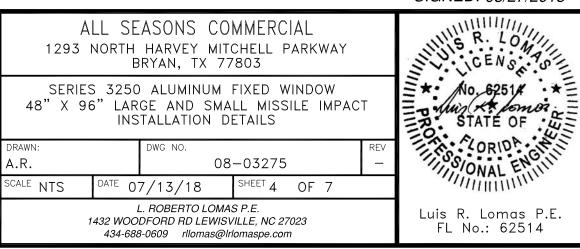




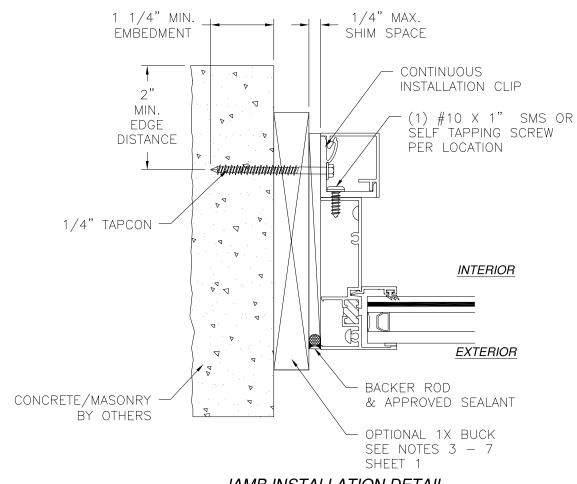


JAMB INSTALLATION DETAIL CONCRETE/MASONRY INSTALLATION


NOTES:


- 1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
- 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

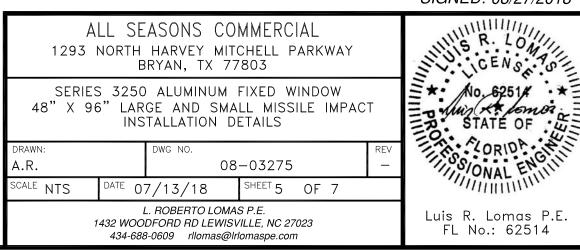

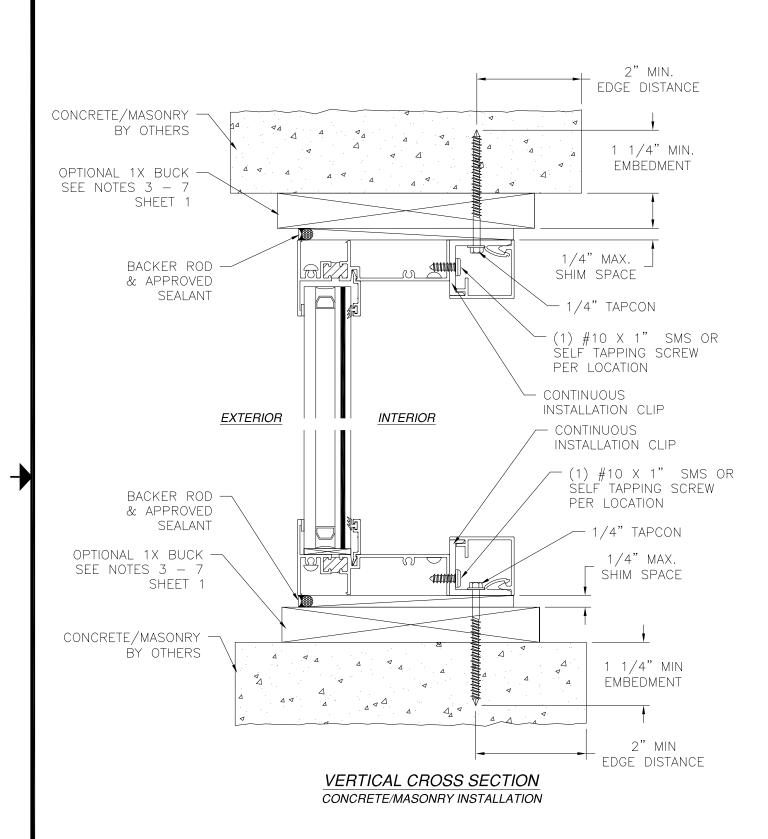



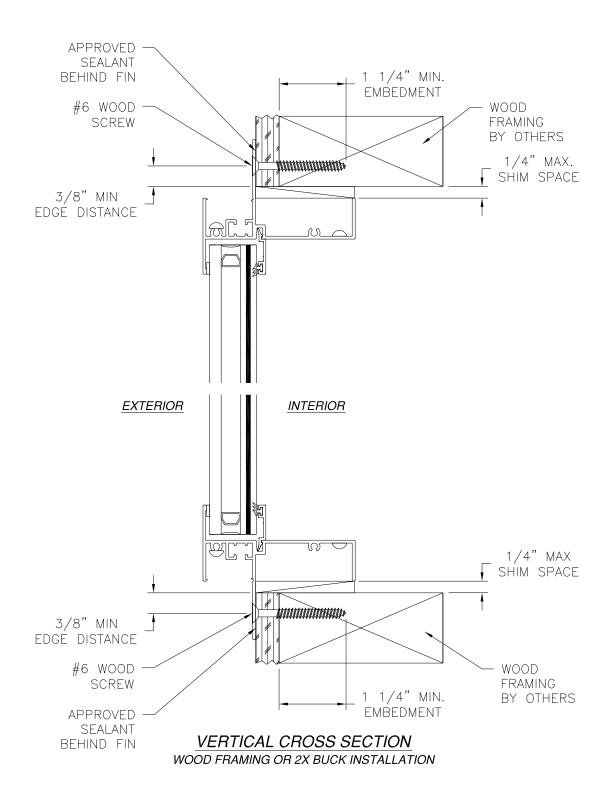

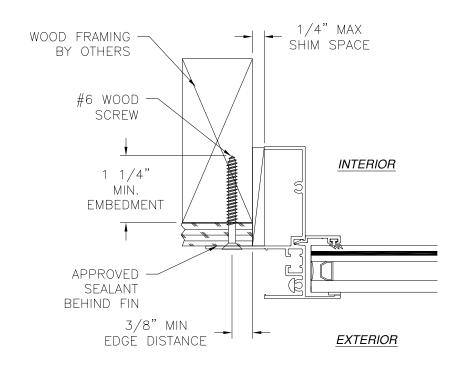


JAMB INSTALLATION DETAIL
WOOD FRAMING OR 2X BUCK INSTALLATION

NOTES:

- 1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
- 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112


| | | | | | 81414EB: 00/21/2010 |
|-------------------------------------|-------------------------------------|---------|------|--------------|---------------------|
| ALL SE 1293 north E | ILIUS R. LONA | | | | |
| SERIES 3250 48" X 96" LAR INS | No. 62514 *= | | | | |
| DRAWN: | DWG NO. | | | REV | CORIDA |
| A.R. | 08-03275 - | | | MONAL ENGLIS | |
| SCALE NTS DATE 0 | 7/13/18 | SHEET 6 | OF 7 | | Millimin |
| 1432 WOC 434-68 | Luis R. Lomas P.E. FL No.: 62514 | | | | |

REVISIONS REV DESCRIPTION DATE APPROVED

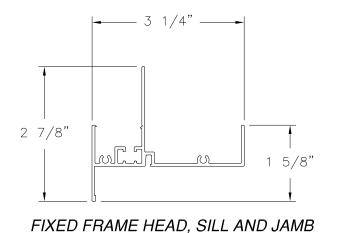


FIN INSTALLATION

ALUMINUM 6063-T5 (12964)



FIXED FRAME HEAD, SILL AND JAMB FRAME INSTALLATION ALUMINUM 6063-T5 (12964)







SIGNED: 08/27/2018

ALL SEASONS COMMERCIAL 1293 NORTH HARVEY MITCHELL PARKWAY BRYAN, TX 77803

SERIES 3250 ALUMINUM FIXED WINDOW 48" X 96" LARGE AND SMALL MISSILE IMPACT COMPONENTS

DRAWN: DWG NO. A.R. 08-03275 SCALE NTS DATE 07/13/18 SHEET 7 OF 7

> L. ROBERTO LOMAS P.E. 1432 WOODFORD RD LEWISVILLE, NC 27023 434-688-0609 rllomas@lrlomaspe.com

