	REVISIONS		
REV	DESCRIPTION	DATE	APPROVED
F	ADDED COMPONENTS & REVISED GLASS	08/02/23	R.L.

#### NOTES:

- 1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH REQUIREMENTS OF THE FLORIDA BUILDING CODE.
- 2. WOOD FRAMING AND MASONRY OPENING TO BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO STRUCTURE. FRAMING AND MASONRY OPENING IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.
- 3. WHERE SHIM OR BUCK THICKNESS IS LESS THAN 1-1/2" WINDOW UNITS MUST BE ANCHORED THROUGH THE FRAME IN ACCORDANCE WITH MANUFACTURER'S PUBLISHED INSTALLATION INSTRUCTIONS. ANCHORS SHALL BE SECURELY FASTENED DIRECTLY INTO MASONRY, CONCRETE OR OTHER STRUCTURAL SUBSTRATE MATERIAL.
- 4. WHERE WOOD BUCK THICKNESS IS 1-1/2" OR GREATER, BUCK SHALL BE SECURELY FASTENED TO MASONRY, CONCRETE OR OTHER STRUCTURAL SUBSTRATE. WINDOW UNITS MAY BE ANCHORED THROUGH FRAME TO SECURED WOOD BUCK IN ACCORDANCE WITH MANUFACTURER'S PUBLISHED INSTALLATION INSTRUCTIONS.
- 5. WHERE 1X BUCK IS NOT USED DISSIMILAR MATERIALS MUST BE SEPARATED WITH APPROVED COATING OR MEMBRANE. SELECTION OF COATING OR MEMBRANE IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.
- 6. BUCKS SHALL EXTEND BEYOND WINDOW INTERIOR FACE SO THAT FULL FRAME SUPPORT IS PROVIDED.
- 7. SHIM AS REQUIRED AT EACH ANCHOR LOCATION WITH LOAD BEARING SHIM. SHIM WHERE SPACE OF 1/16" OR GREATER OCCURS. MAXIMUM ALLOWABLE SHIM STACK TO BE 1/4".
- 8. SHIMS SHALL BE LOCATED, APPLIED AND MADE FROM MATERIALS AND THICKNESS CAPABLE OF SUSTAINING APPLICABLE LOADS.
- 9. WIND LOAD DURATION FACTOR Cd=1.6 WAS USED FOR WOOD ANCHOR CALCULATIONS.
- 10. FRAME MATERIAL: COMPOSITE.
- 11. UNITS MUST BE GLAZED PER ASTM E1300, SEE SHEET 16 FOR GLASS DETAILS.
- 12. APPROVED IMPACT PROTECTIVE SYSTEM <u>IS NOT REQUIRED</u> FOR THIS PRODUCT IN WIND BORNE DEBRIS REGIONS.


- 13. FOR ANCHORING INTO WOOD FRAMING OR 2X BUCK USE #10 WOOD SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE A 1 1/4" MINIMUM EMBEDMENT INTO SUBSTRATE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
- 14. FOR ANCHORING INTO MASONRY/CONCRETE USE 1/4" TAPCONS WITH SUFFICIENT LENGTH TO ACHIEVE A 1 3/4" MINIMUM EMBEDMENT INTO SUBSTRATE WITH 1 1/2" MINIMUM EDGE DISTANCE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
- 15. FOR ANCHORING INTO METAL STRUCTURE USE #10 SMS OR SELF DRILLING SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE 3 THREADS MINIMUM BEYOND STRUCTURE INTERIOR WALL. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
- 16. ALL FASTENERS TO BE CORROSION RESISTANT.
- 17. INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BELOW:
- 17.A. WOOD MINIMUM SPECIFIC GRAVITY OF G=0.42
- 17.B. CONCRETE MINIMUM COMPRESSIVE STRENGTH OF 3,192 PSI.
- 17.C. MASONRY STRENGTH CONFORMANCE TO ASTM C-90, GRADE N, TYPE 1 (OR GREATER), GROUT FILLED.
- 17.D. METAL STRUCTURE: STEEL 18GA, 33KSI OR ALUMINUM 6063-T5 1/8" THICK MINIMUM
- 18. APPROVED CONFIGURATIONS: X, X/O, O/X, OX, XO, OX/O, XO/O, XX, XX/O, O/XX, OOX, O/OX, OO/X, OXX, XXO, OXX/O, O/XXO, OXXO AND O/XX/O SEE SHEETS 2, 3 AND 4.
- 19. SIDELITES ARE ASSEMBLED TO FRAME WITH #10 X 3" WOOD SCREWS LOCATED 4" FROM EACH END AND 23 1/8" MAX O.C. THEREAFTER AT JAMBS AND 4" FROM EACH END AND ONE AT MIDSPAN AT HEAD AND SILL.

SIGNED: 08/11/2023

TABLE OF CONTENTS			NAN YA PLASTICS CORPORATION U.S.A.			۹.
SHEET NO.	DESCRIPTION	8989 NORTH LOOP EAST				
1	NOTES	HOUSTON, TX 77029				
2 - 3	ELEVATIONS	SERIES SLPS LITE GLAZED FIBERGLASS OUTSWING SIDE—HINGED DOOR W/SIDELITES — IMPACT				
4	APPROVED CONFIGURATIONS	NOTES				
5 – 6	ANCHORING LAYOUTS	DRAWN:	DRAWN: DWG NO.			REV
7 – 15	INSTALLATION DETAILS	A.R.		08	3-03449	F
16	GLAZING DETAILS	SCALE NTS DATE 06/25/19 SHEET 1 OF 19				
17 - 18	COMPONENTS	L. ROBERTO LOMAS P.E. - 400 S. PALM AVE, INDIALANTIC, FL 32903 434-688-0609 rllomas@lrlomaspe.com				
19	APPROVED PANEL CONFIGURATIONS					



Luis R. Lomas P.E. FL No.: 62514

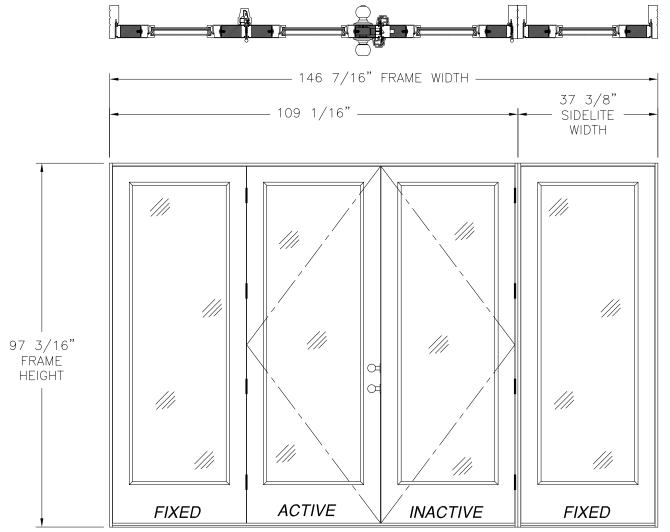

# SERIES SLPS OUT-SWING SIDE-HINGED DOOR W/SIDELITES (OXX/O)

EXTERIOR VIEW FULL LITE PANELS

## KWIKSET OR SCHLAGE SYSTEMS

DESIGN PRESSURE RATING	IMPACT RATING	
±50.0PSF	LARGE & SMALL MISSILE IMPACT	

ENDURA SYSTEM

DESIGN PRESSURE RATING	IMPACT RATING
±45.0PSF	LARGE & SMALL MISSILE IMPACT

MISSILE LEVEL D, WIND ZONE 4

MISSILE LEVEL D, WIND ZONE 4

(4) PANELS SHOWN, UNLIMITED NUMBER OF PANELS IN UNLIMITED CONFIGURATIONS ARE APPROVED AS LONG AS INDIVIDUAL PANEL AREA DOES NOT EXCEED 23.64 FT<sup>2</sup>

	HARDWARE SCHEDULE				
A.	HANDLE SETS AT ACTIVE PANEL				
B.	STAINLESS STEEL FLUSH BOLT BAR WITH KEEPER AT PASSIVE PANEL				
C.	FLUSH BOLT MECHANISM (DIE CAST, STEEL, POM) AT PASSIVE PANEL				
D.	STEEL DEADBOLT WITH KEEPER AT ACTIVE PANEL				
	STEEL LATCH WITH KEEPER AT ACTIVE PANEL				
F.	(4) 4X4 DOOR HINGE AT STILE OF ACTIVE AND PASSIVE PANEL				
	ALUMINUM REINFORCEMENT (A) AT ASTRAGAL				
Н.	ALUMINUM MULLION REINFORCEMENT (B) AT INTEGRAL MULLION				
l.	STEEL REINFORCEMENT AT ALL VERTICAL STILES				
J.	WOOD REINFORCEMENT (A) AT BOTH FIXED, STATIONARY AND ACTIVE PANEL TOP RAILS				
K.	WOOD REINFORCEMENT (B) AT PASSIVE PANEL LOCK STILE				
Ĺ.	WOOD REINFORCEMENT (C) AT HINGE STILES ON ACTIVE AND INACTIVE STILES ON SIDELITE AND MULLED SIDELITE				
M.	WOOD REINFORCEMENT (D) AT BOTTOM RAIL				

	REVISIONS					
REV	DESCRIPTION	DATE	APPROVED			
F	ADDED COMPONENTS & REVISED GLASS	08/02/23	R.L.			

#### NOTES:

- 1. PANEL SIZE: 35 3/4" X 95 1/4"
- 2. D.L.O.: 25 " X 79"

#### APPROVED HARDWARE

MANUFACTURER	R MODEL	
KWIKSET	KNOB:	SIGNATURE SERIES
KWIKOLI	DEADBOLT:	SIGNATURE SERIES (980)
SCHLAGE	KNOB:	F SERIES
SCHLAGE	DEADBOLT:	B SERIES
ENDURA	MULTI-POINT	3000

SIGNED: 08/11/2023

B989 NORTH LOOP EAST HOUSTON, TX 77029

SERIES SLPS LITE GLAZED FIBERGLASS OUTSWING SIDE—HINGED DOOR W/SIDELITES — IMPACT FULL LITE PANELS ELEVATION

DRAWN:
A.R.


DWG NO.
A.R.


DATE 06/25/19


SHEET 2 OF 19

NAN YA PLASTICS CORPORATION U.S.A.

L. ROBERTO LOMAS P.E. 400 S. PALM AVE, INDIALANTIC, FL 32903 434-688-0609 rllomas@lrlomaspe.com





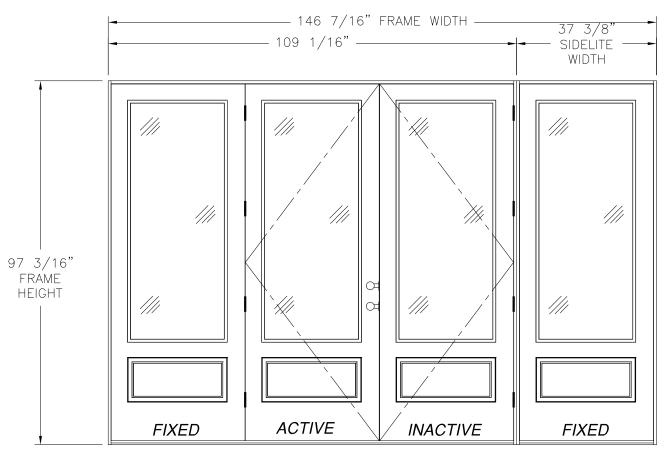

# SERIES SLPS OUT-SWING SIDE-HINGED DOOR W/SIDELITES (OXX/O)

EXTERIOR VIEW 3/4 LITE PANELS

KWIKSET OR SCHLAGE SYSTEMS

ENDURA SYSTEM

DESIGN PRESSURE RATING	IMPACT RATING
±50.0PSF	LARGE & SMALL MISSILE IMPACT

DESIGN PRESSURE RATINGIMPACT RATING±45.0PSFLARGE & SMALL<br/>MISSILE IMPACT

MISSILE LEVEL D, WIND ZONE 4

MISSILE LEVEL D, WIND ZONE 4

(4) PANELS SHOWN, UNLIMITED NUMBER OF PANELS IN UNLIMITED CONFIGURATIONS ARE APPROVED AS LONG AS INDIVIDUAL PANEL AREA DOES NOT EXCEED 23.64 FT<sup>2</sup>

	HARDWARE SCHEDULE				
A.	HANDLE SETS AT ACTIVE PANEL				
В.	STAINLESS STEEL FLUSH BOLT BAR WITH KEEPER AT PASSIVE PANEL				
C.	FLUSH BOLT MECHANISM (DIE CAST, STEEL, POM) AT PASSIVE PANEL				
D.	STEEL DEADBOLT WITH KEEPER AT ACTIVE PANEL				
E.	STEEL LATCH WITH KEEPER AT ACTIVE PANEL				
F.	(4) 4X4 DOOR HINGE AT STILE OF ACTIVE AND PASSIVE PANEL				
G.	ALUMINUM REINFORCEMENT (A) AT ASTRAGAL				
Н.	ALUMINUM MULLION REINFORCEMENT (B) AT INTEGRAL MULLION				
I.	STEEL REINFORCEMENT AT ALL VERTICAL STILES				
J.	WOOD REINFORCEMENT (A) AT BOTH FIXED, STATIONARY AND ACTIVE PANEL TOP RAILS				
K.	WOOD REINFORCEMENT (B) AT PASSIVE PANEL LOCK STILE				
Ĺ.	WOOD REINFORCEMENT (C) AT HINGE STILES ON ACTIVE AND INACTIVE STILES ON SIDELITE AND MULLED SIDELITE				
М	WOOD REINFORCEMENT (D) AT BOTTOM RAII				

REVISIONS					
REV	DESCRIPTION	DATE	APPROVED		
F	ADDED COMPONENTS & REVISED GLASS	08/02/23	R.L.		


#### NOTES:


- 1. PANEL SIZE: 35 3/4" X 95 1/4"
- 2. D.L.O.: 25 " X 79"


### APPROVED HARDWARE


MANUFACTURER		MODEL
KWIKSET	KNOB:	SIGNATURE SERIES
KWIKSET	DEADBOLT:	SIGNATURE SERIES (980)
SCHLAGE	KNOB:	F SERIES
SCHLAGE	DEADBOLT:	B SERIES
ENDURA	MULTI-POINT	3000

NAN YA	NAN YA PLASTICS CORPORATION U.S.A. 8989 NORTH LOOP EAST HOUSTON, TX 77029								
SERIES SLPS LITE GLAZED FIBERGLASS OUTSWING SIDE—HINGED DOOR W/SIDELITES — IMPACT 3/4 LITE PANELS ELEVATION									
DRAWN:		DWG NO.			REV				
A.R.		08	-03449		F				
SCALE NTS	SCALE NTS DATE 06/25/19 SHEET 3 OF 19								
L. ROBERTO LOMAS P.E. 400 S. PALM AVE, INDIALANTIC, FL 32903 434-688-0609 rllomas@lrlomaspe.com									




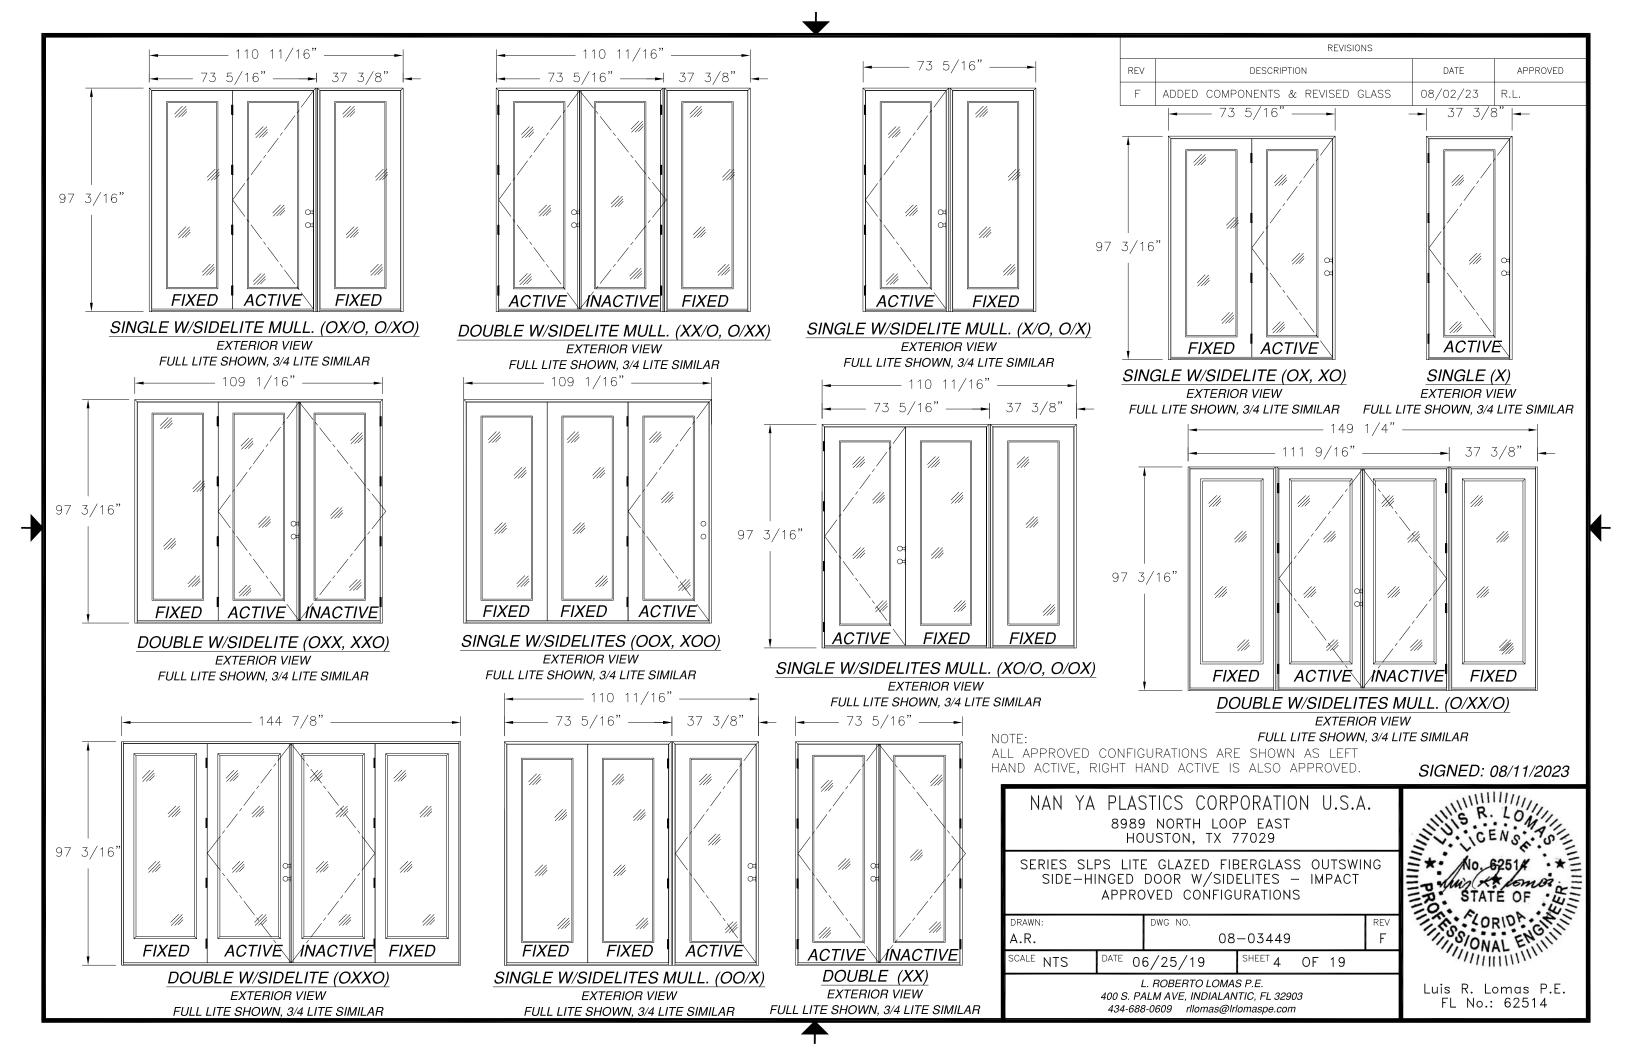

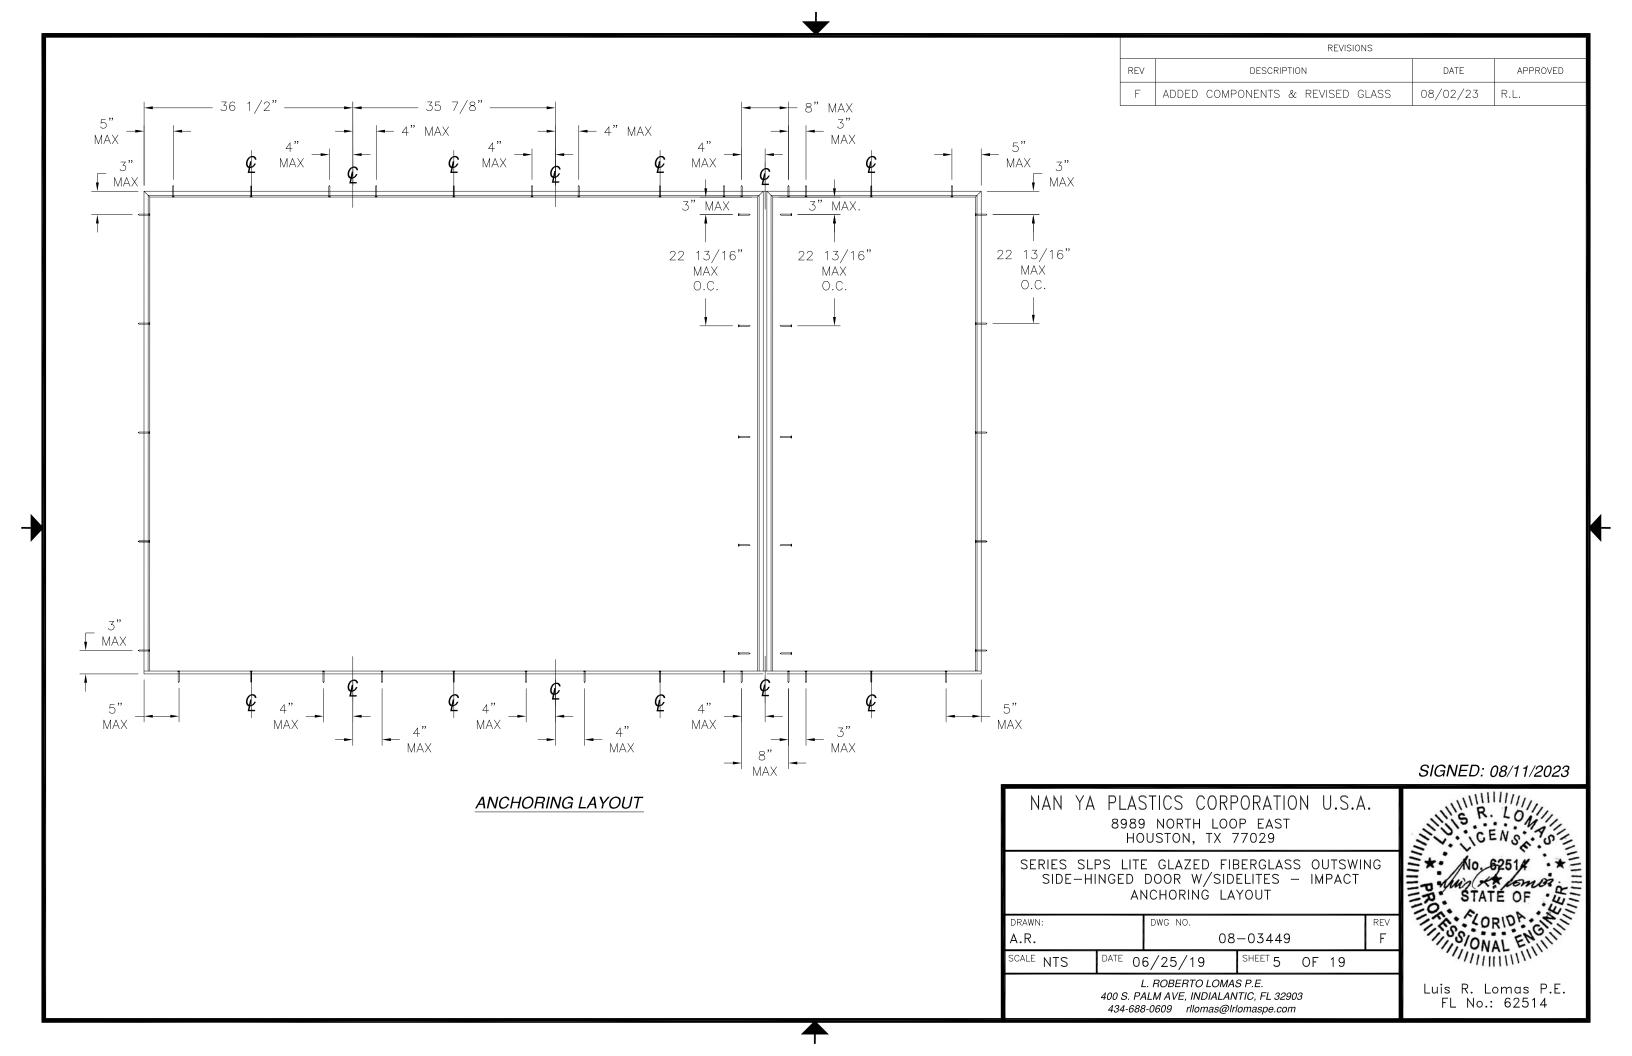

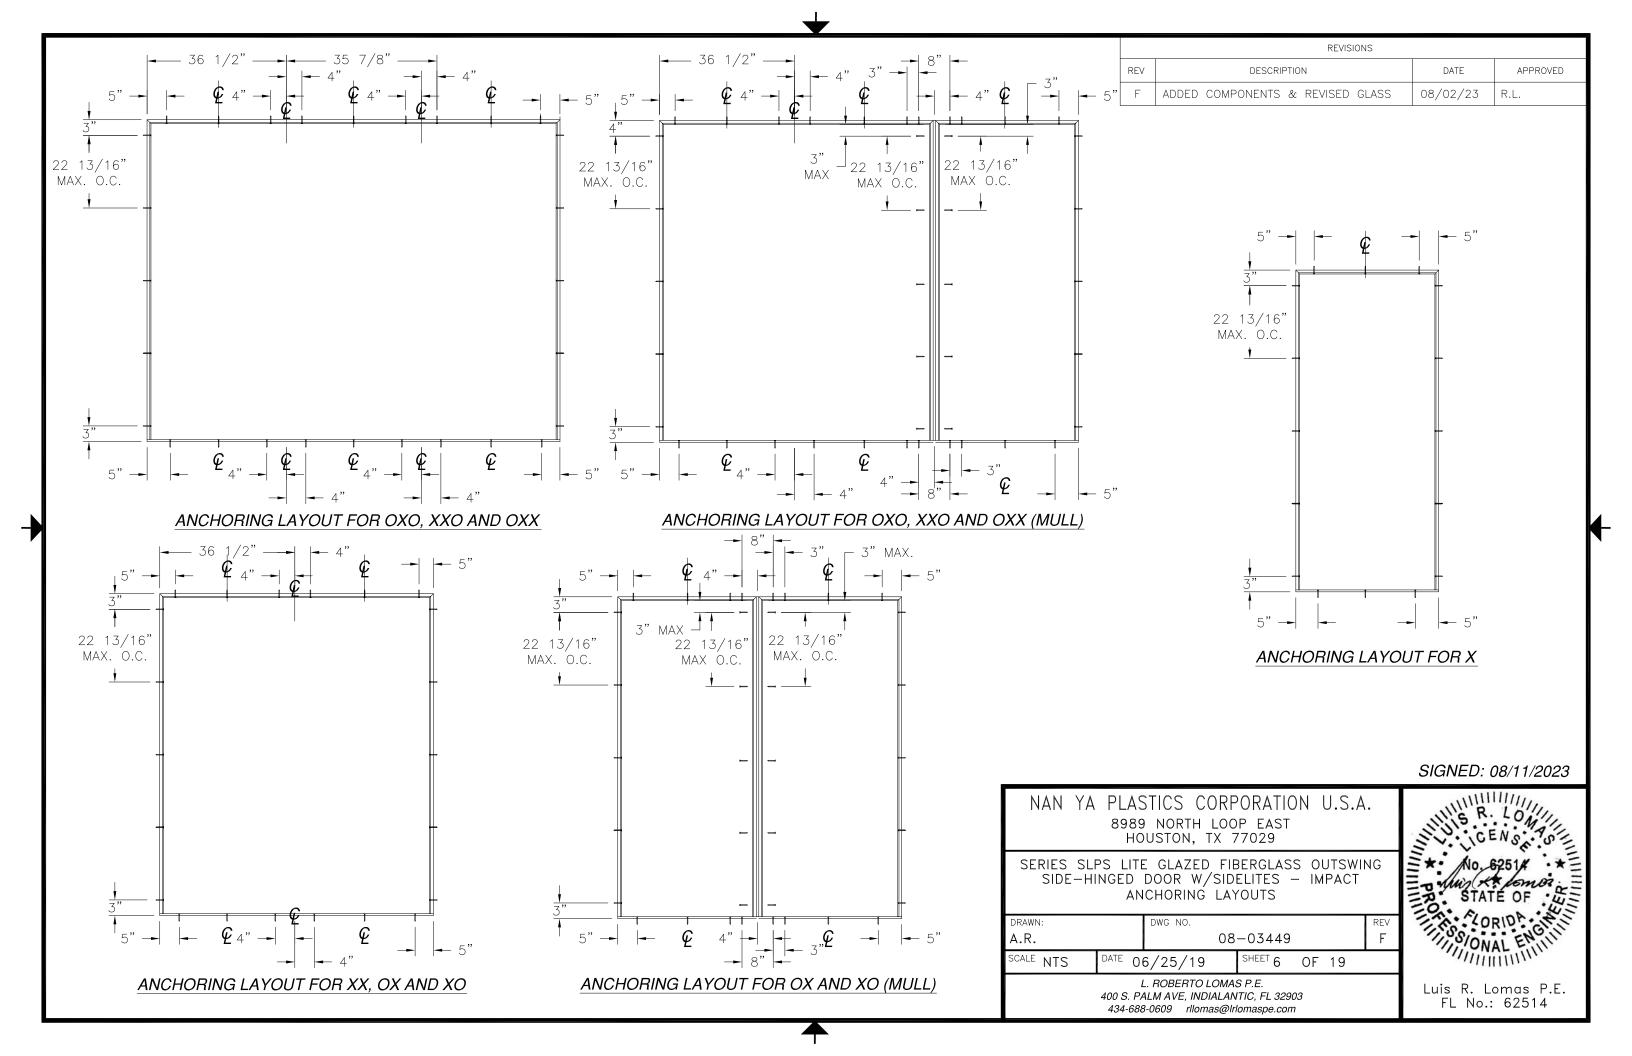



REVISIONS					
REV	DESCRIPTION	DATE	APPROVED		
F	ADDED COMPONENTS & REVISED GLASS	08/02/23	R.L.		

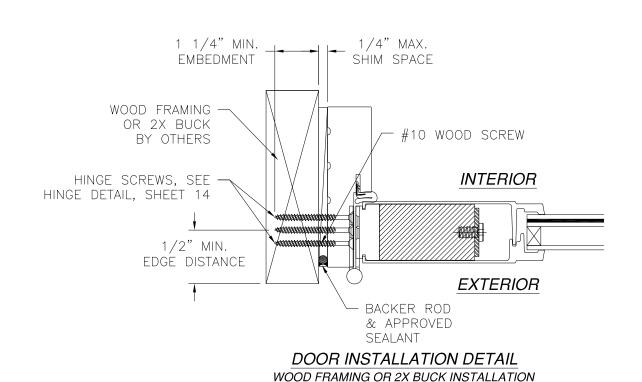


#### NOTES:

- 1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
- 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

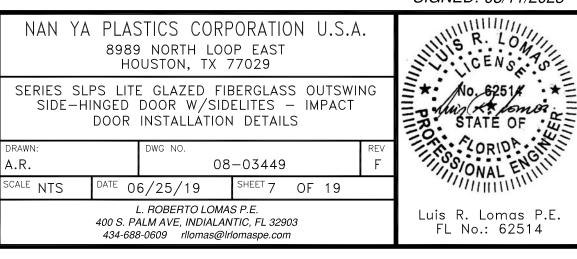

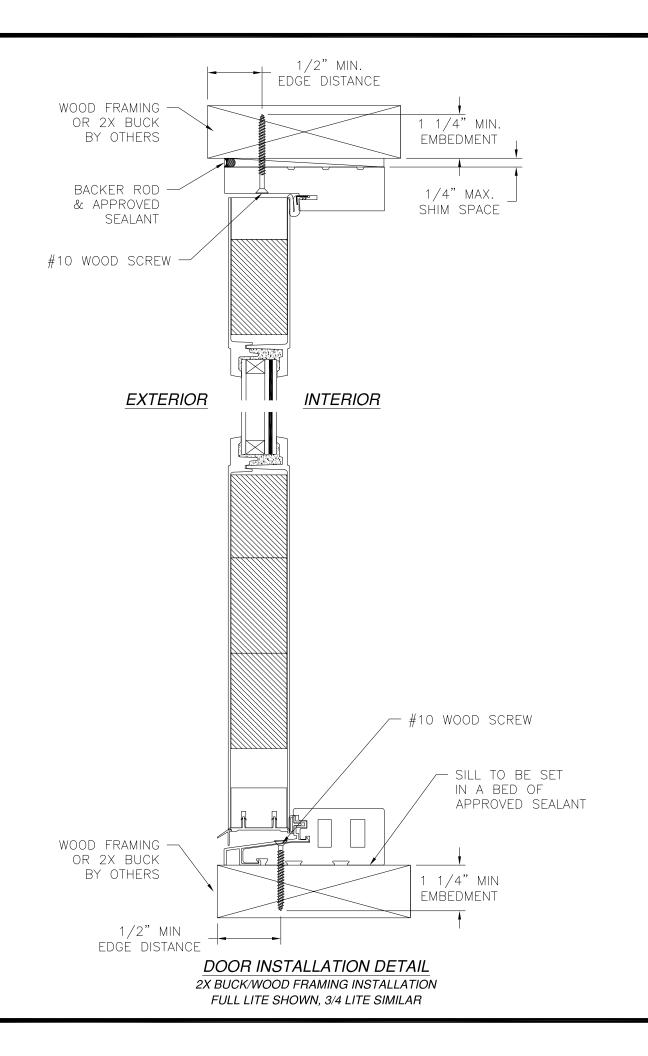


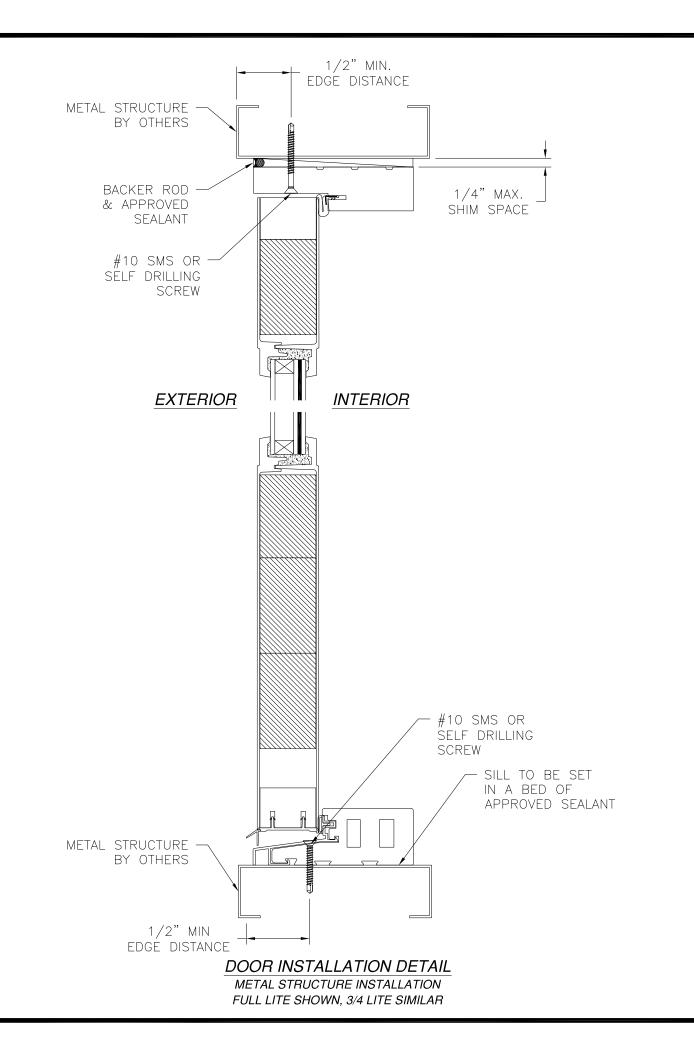

REVISIONS

REV DESCRIPTION DATE APPROVED


F ADDED COMPONENTS & REVISED GLASS 08/02/23 R.L.

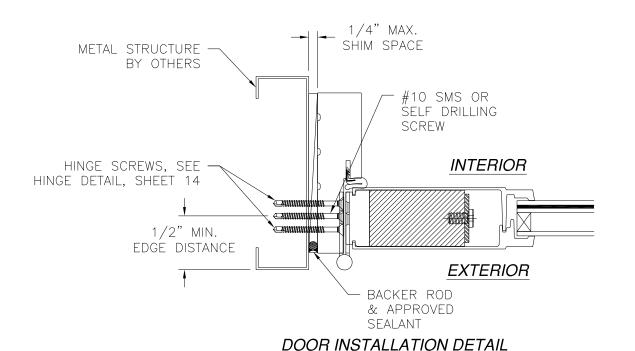



METAL STRUCTURE INSTALLATION

#### NOTES:

- 1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
- 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

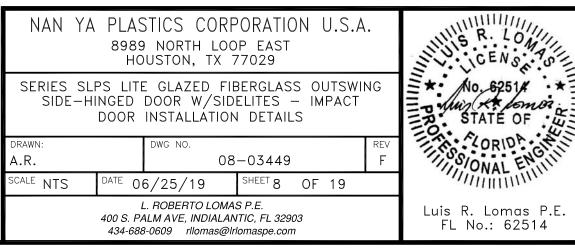



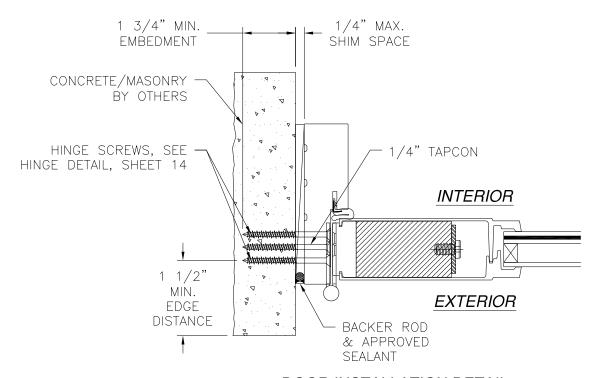



# DOOR INSTALLATION DETAIL


CONCRETE/MASONRY WITHOUT 1X BUCK INSTALLATION FOR CONCRETE/MASONRY INSTALLATION WITH 1X BUCK REFER TO HEAD AND SILL INSTALLATION DETAILS


#### NOTES:

- 1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
- 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

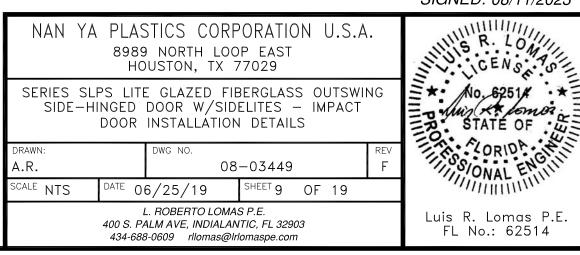

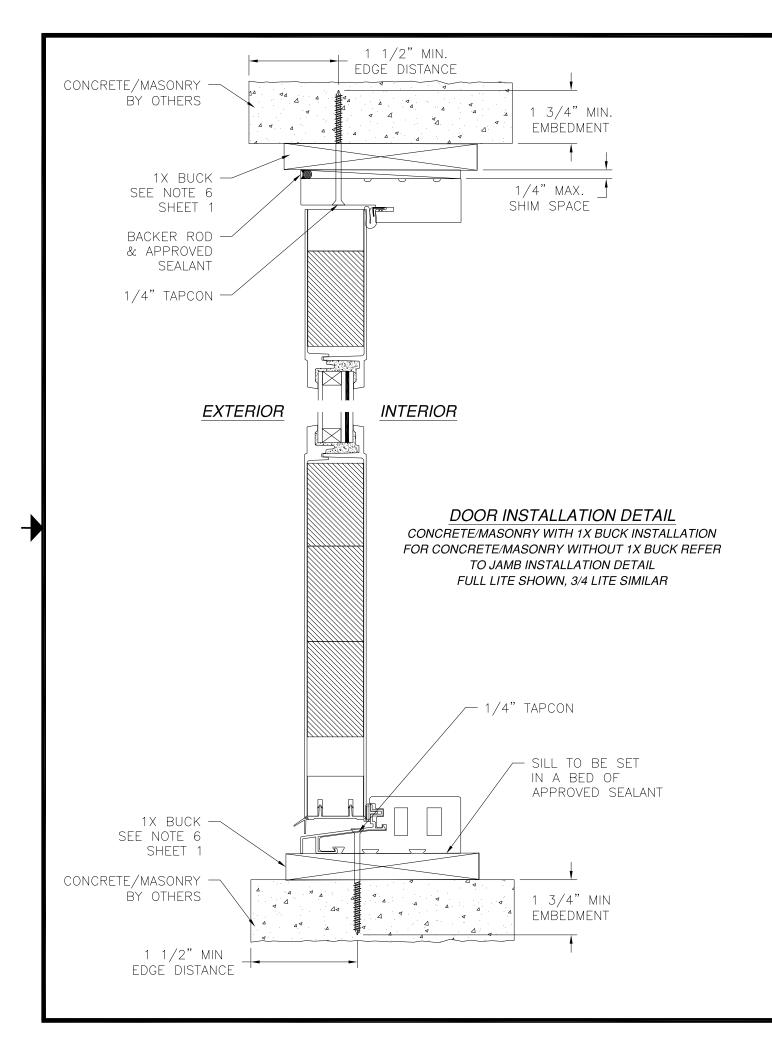




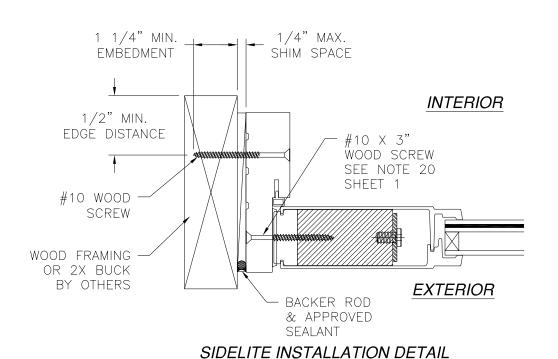


WOOD FRAMING OR 2X BUCK INSTALLATION


#### NOTES:

- 1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
- 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

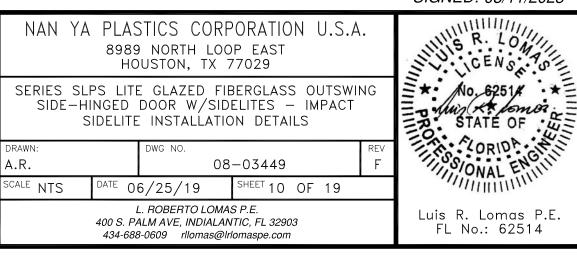

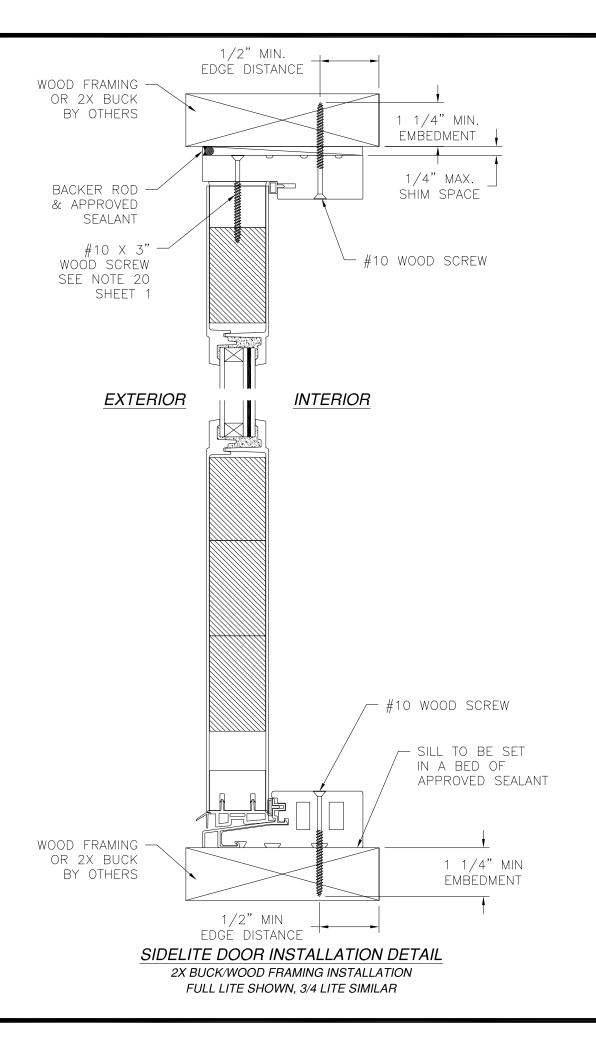

REVISIONS					
REV	DESCRIPTION	DATE	APPROVED		
F	ADDED COMPONENTS & REVISED GLASS	08/02/23	R.L.		

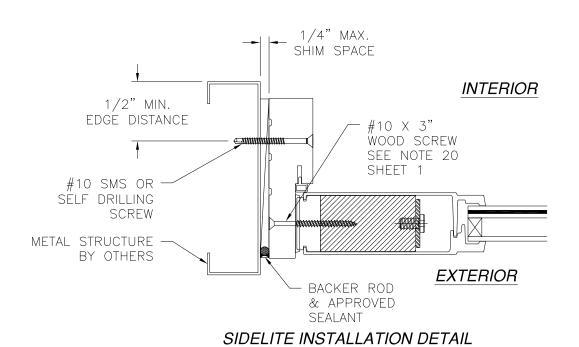



METAL STRUCTURE INSTALLATION


#### NOTES:

- 1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
- 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112



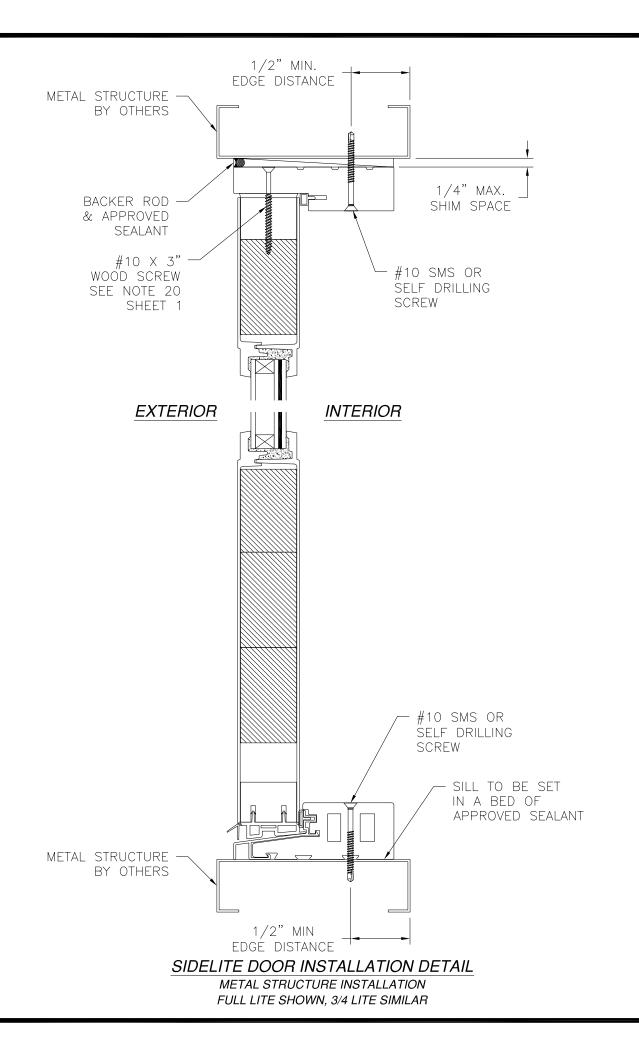

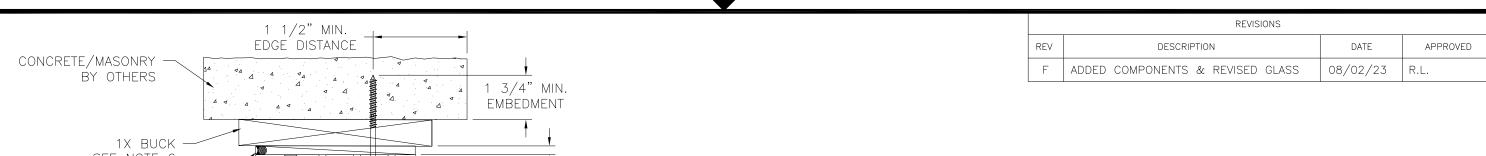

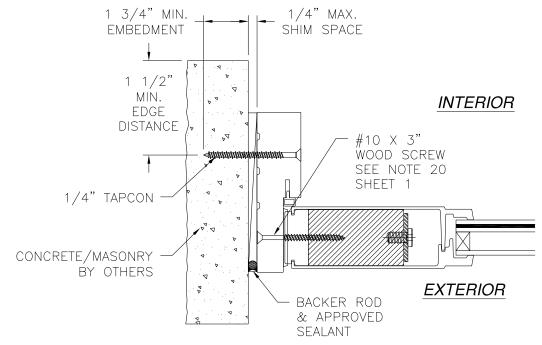



### SIDELITE INSTALLATION DETAIL

CONCRETE/MASONRY WITHOUT 1X BUCK INSTALLATION FOR CONCRETE/MASONRY INSTALLATION WITH 1X BUCK REFER TO HEAD AND SILL INSTALLATION DETAILS

#### NOTES:


- 1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
- 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

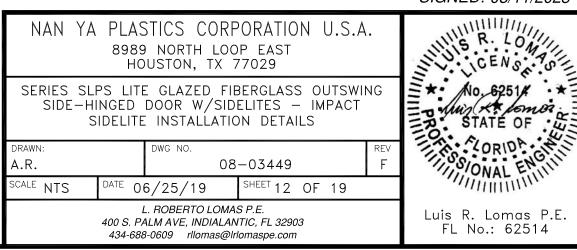


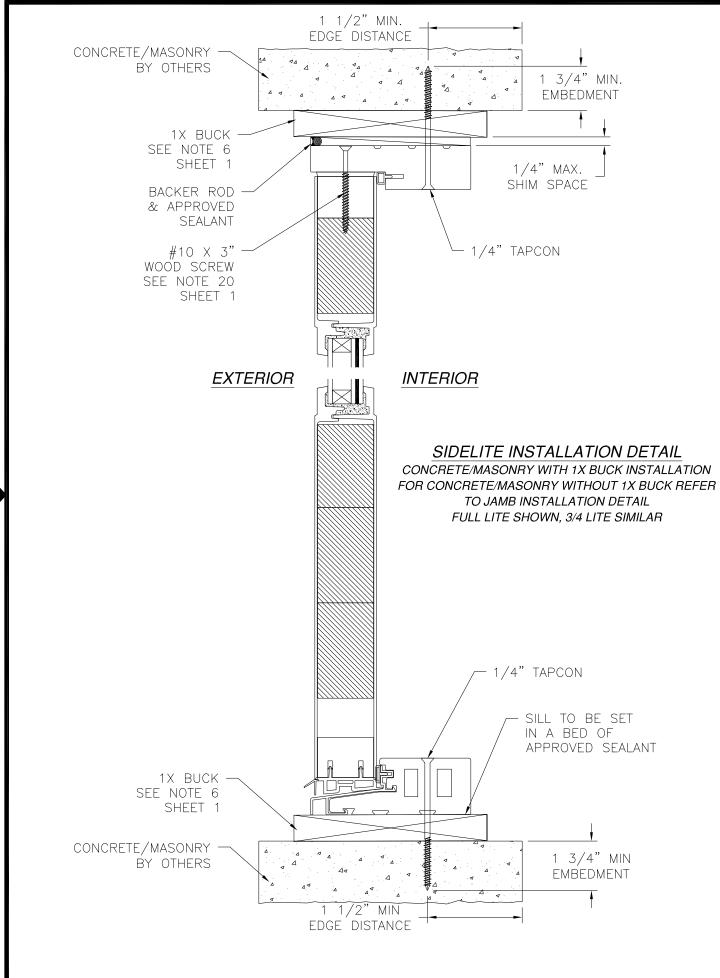


# SILLS ANCHORS LOCATIONS

FOR ANCHOR TYPE, EMBEDMENT, EDGE DISTANCE AND SUBSTRATE REFER TO SHEETS 7 - 12
SILLS TO BE SET IN A BED OF APPROVED SEALANT

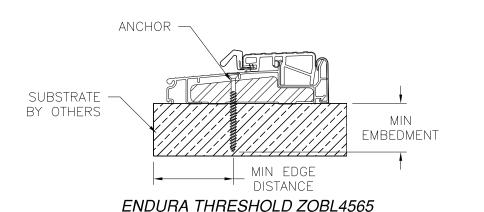

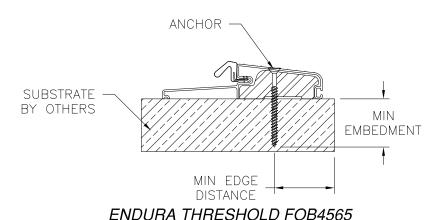

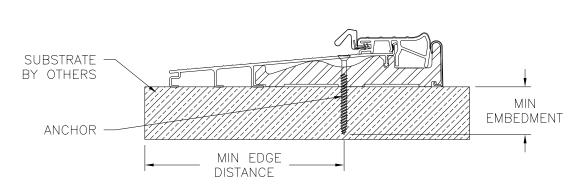

DESCRIPTION

ADDED COMPONENTS & REVISED GLASS




**REVISIONS** 


DATE


08/02/23

APPROVED


R.L.

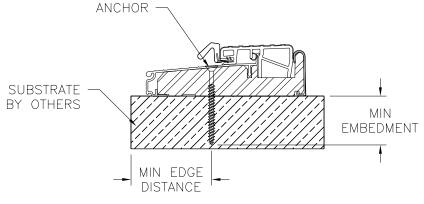


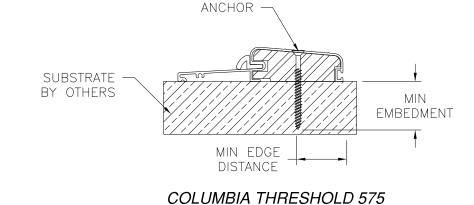

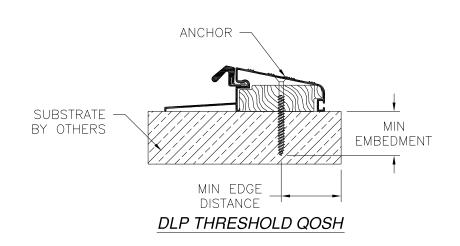

ENDURA THRESHOLD ZOB4565FN

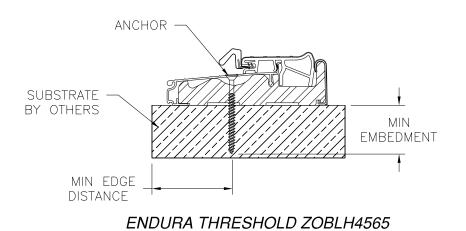

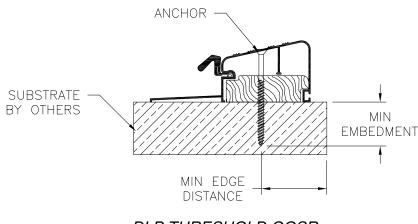

NAN YA PLASTICS CORPORATION U.S.A.

8989 NORTH LOOP EAST
HOUSTON, TX 77029

SERIES SLPS LITE GLAZED FIBERGLASS OUTSWING
SIDE-HINGED DOOR W/SIDELITES - IMPACT

DRAWN:

SCALE NTS

A.R.

INSTALLATION DETAILS

L. ROBERTO LOMAS P.E.

400 S. PALM AVE, INDIALANTIC, FL 32903

434-688-0609 rllomas@lrlomaspe.com


08-03449

SHEET 13 OF 19


DWG NO.

DATE 06/25/19

REV




DLP THRESHOLD QOSR

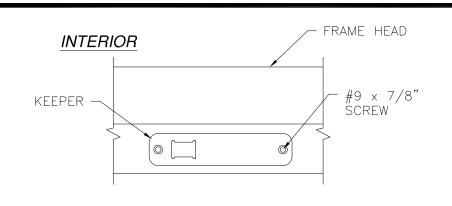


## **EXTERIOR**

## HEAD KEEPER DETAIL

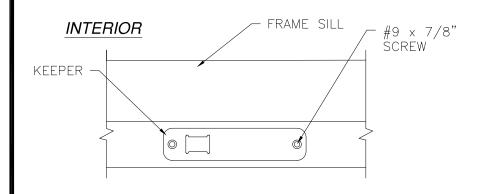


# **EXTERIOR**


# SILL KEEPER DETAIL





# DEADBOLT KEEPER DETAIL

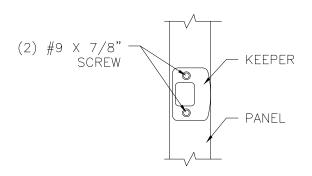

LATCH KEEPER DETAIL

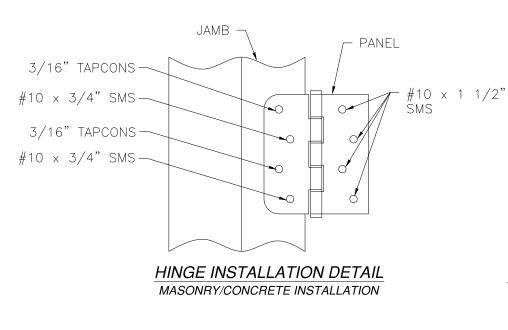

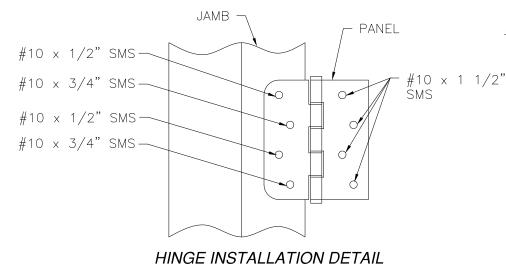


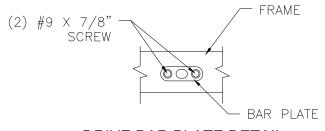

WOOD AND METAL INSTALLATION

DRIVE BAR PLATE DETAIL

REVISIONS REV DESCRIPTION APPROVED ADDED COMPONENTS & REVISED GLASS 08/02/23 R.L.

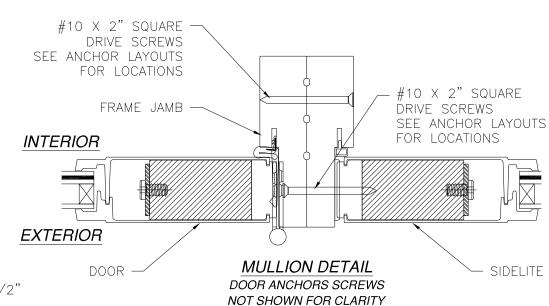


SIGNED: 08/11/2023

NAN YA PLASTICS CORPORATION U.S.A. 8989 NORTH LOOP EAST HOUSTON, TX 77029


SERIES SLPS LITE GLAZED FIBERGLASS OUTSWING SIDE-HINGED DOOR W/SIDELITES - IMPACT INSTALLATION DETAILS & COMPONENTS

DRAWN: DWG NO. A.R. 08-03449 SCALE NTS DATE 06/25/19 SHEET 14 OF 19 L. ROBERTO LOMAS P.E. 400 S. PALM AVE, INDIALANTIC, FL 32903 434-688-0609 rllomas@lrlomaspe.com





Luis R. Lomas P.E. FL No.: 62514




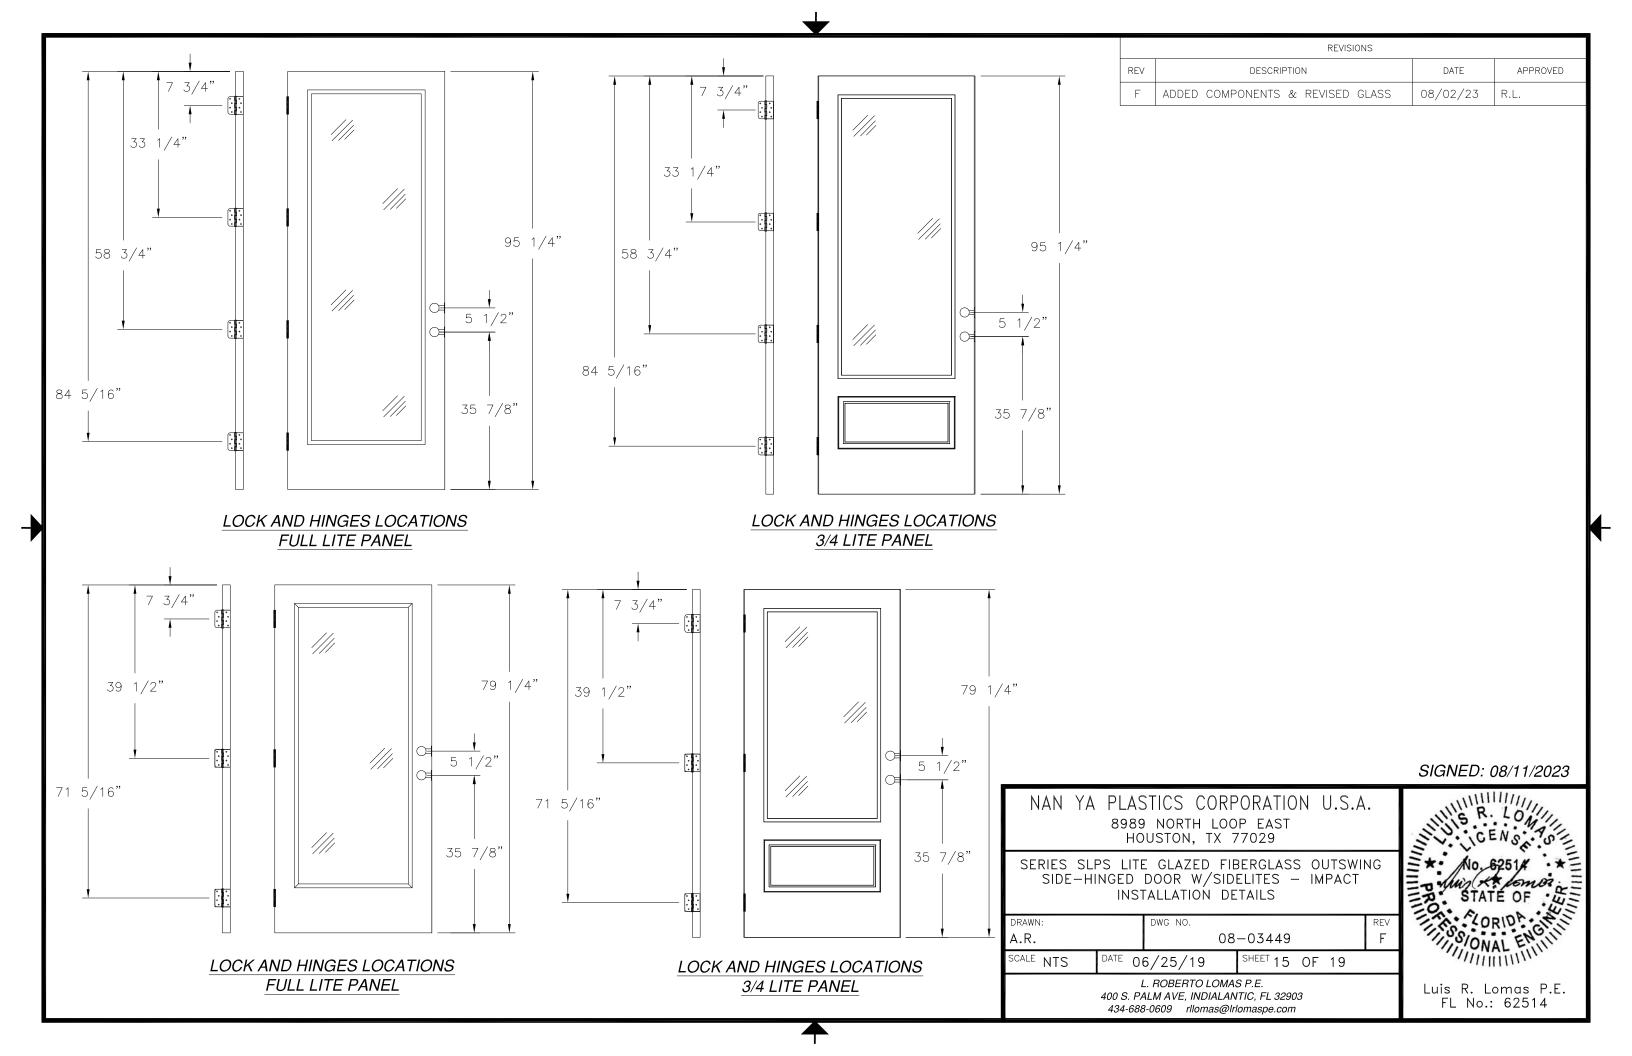


REVISIONS				
REV	DESCRIPTION	DATE APPROVED		
F	ADDED COMPONENTS & REVISED GLASS	08/02/23	R.L.	

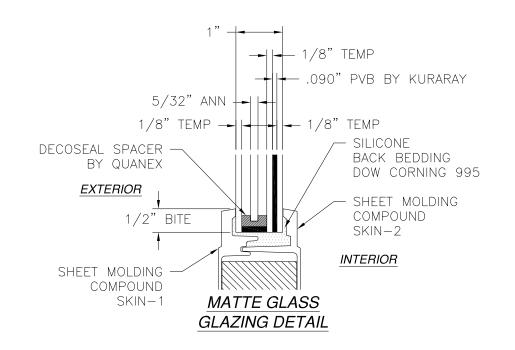


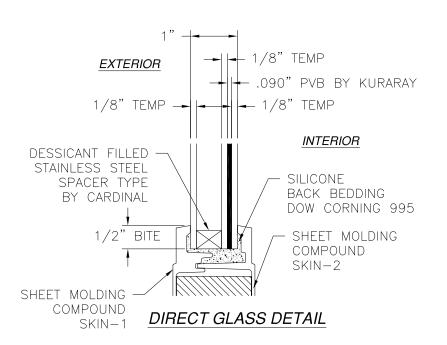


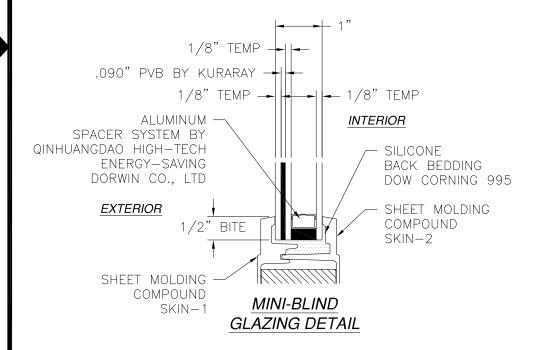

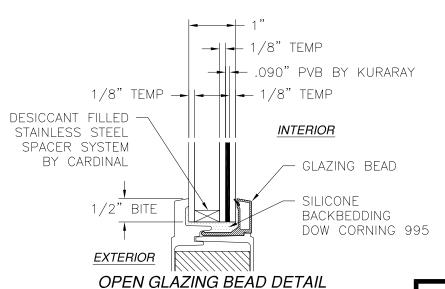



SIGNED: 08/11/2023

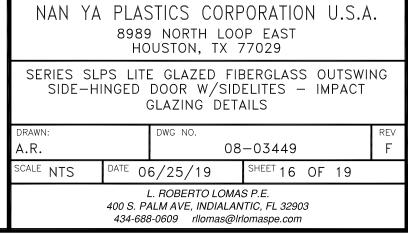





Luis R. Lomas P.E. FL No.: 62514

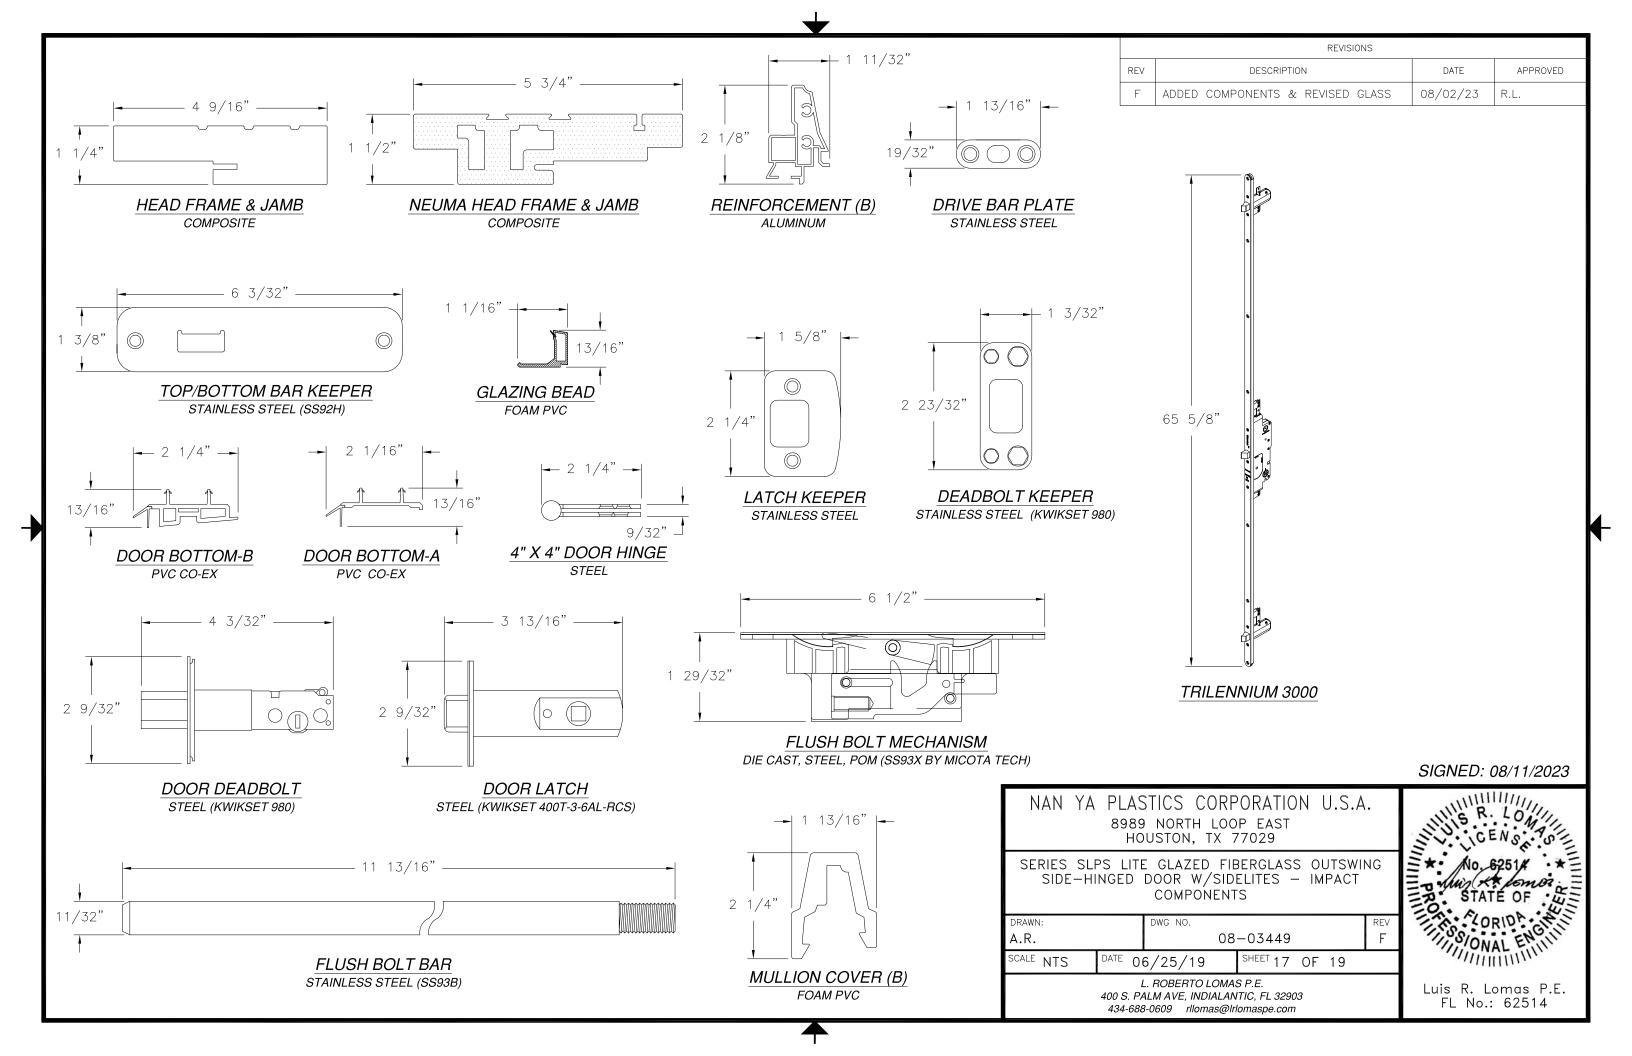

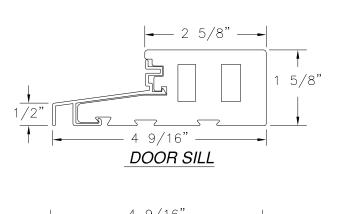


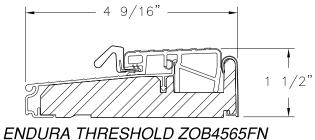




ALTERNATE


ENDURA THRESHOLD FOB4565 ALTERNATE

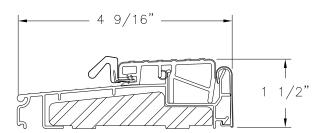


ENDURA THRESHOLD ZOBL4565 ALTERNATE

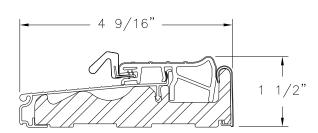



ENDURA THRESHOLD ZOBLH4565 ALTERNATE




COLUMBIA THRESHOLD 575 ALTERNATE

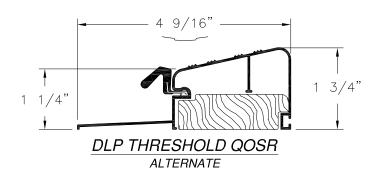

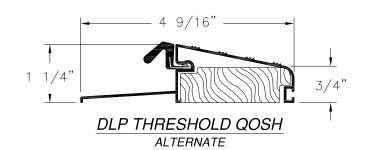

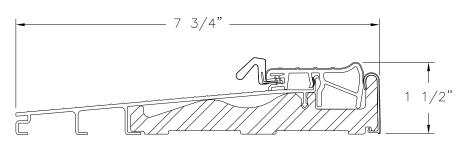


ENDURA THRESHOLD ZOBLH7815 ALTERNATE

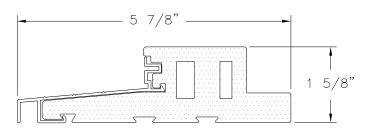


NEUMA SILL ALTERNATE







T-ASTRAGAL RIGID PVC



ENDURA ULTIMATE PUSH BUTTON **ASTRAGAL** ALTERNATE



DLP ASTRAGAL ALTERNATE




COLUMBIA T-ASTRAGAL 060" THICKNESS, ALUMINUM 6063-T5 ALTERNATE

SIGNED: 08/11/2023

# NAN YA PLASTICS CORPORATION U.S.A. 8989 NORTH LOOP EAST HOUSTON, TX 77029

SERIES SLPS LITE GLAZED FIBERGLASS OUTSWING SIDE-HINGED DOOR W/SIDELITES - IMPACT COMPONENTS

OCIMI CIVELVIO						
DRAWN:		DWG NO.			REV	
A.R.		08-03449			F	
SCALE NTS	DATE 0	6/25/19	SHEET 18	OF	19	
L. ROBERTO LOMAS P.E. 400 S. PALM AVE, INDIALANTIC, FL 32903 434-688-0609 rllomas@lrlomaspe.com						



Luis R. Lomas P.E. FL No.: 62514



