



THROUGH FRAME INSTALLATION

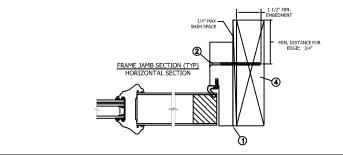

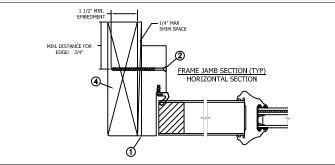

Max Frame	DP Rating	Impact
149 1/4" x 96 7/8"	+50/-50	YES

Installed Fastener Schedule:

- Seal flange/frame to substrate.
- Use #12 PH or greater fasteners through frame with sufficient length to penetrate a minimum of 1 1/2" into the wood framing. For 2X wood frame substrate (min. S.G. = 0.42).
- Install corrosion resistant 2-#8 X 2" screws through each strike plate into rough opening.
- Host structure (wood buck, stud framing and opening) to be designed and anchored to properly transfer all angine.

 MESIF NO. 7

 MERICA ST. MO. 7 loads to the structure. The host structure is the responsibility of the architect or engineer of record for the project of installation.

General Notes:

- The product shown herein is designed, tested and manufactured to comply with the wind load criteria of the adopted International Building Code (IBC), the International Residential Code (IRC), the Florida Building Code (FBC) excluding HVHZ and the industry standard requirement for the stated conditions.
- Buck, framing and masonry by others and is responsibility of architect or engineer of record.
- All glazing shall conform to ASTM E1300.

This schedule addresses only the fasteners required to anchor the window to achieve the rated design pressure up to the size limitations noted. It is not intended as a guide to the installation process and does not address the sealing consideration that may arise in different wall conditions. For the complete installation procedure, see the instructions packaged with the door or go to www.jeld-wen.com.

DISCLAIMER:

This drawing and its contents are confidential and are not to be reproduced or copied in whole or in part or used or disclosed to others except as authorized by JELD-WEN Inc.

PROJECT ENGINEER: 11/02/2017 DRAWN BY: SCALE: NTS D Vezo CHECKED BY: TITLE: J. Hawkins APPROVED BY: D. Vezo


3737 Lakeport Blvd Klamath Falls, OR. 97601 Phone: (800) 535-3936


Architectural Fiberglass Impact Outswing OXXO Door **CHS Sidelites**

D014776 IDENTIFIER No.
TEL 01681715 PLANT NAME AND LOCATION:

CAD DWG. No.:

1 of 6

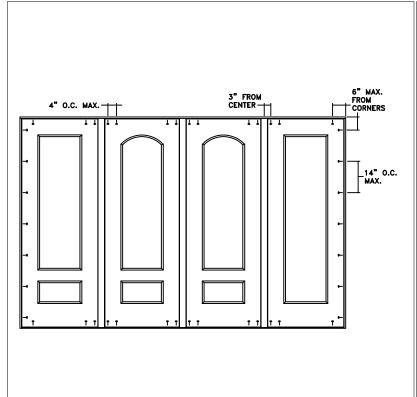

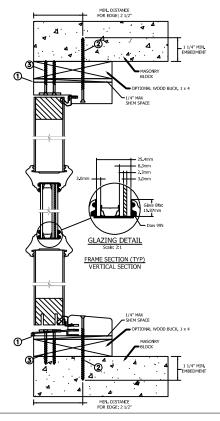

INSTALLATION FRAME JAMB SECTION (TYP)

THROUGH FRAME

Max Frame	DP Rating	Impact
149 1/4" x 96 7/8"	+50/-50	YES

FRAME JAMB SECTION (TYP)

3737 Lakeport Blvd

2 of 6

Installed Fastener Schedule:

- Seal flange/frame to substrate.
- Use 3/16" Tapcon or equivalent fasteners through frame with sufficient length to penetrate a minimum of 1 1/4" into concrete or masonry at each location with a 2 1/2" min. from edge distance. For concrete (min. fc = 3000 psi) or masonry substrate (min fc = 2000 psi) (CMU shall adhere to ASTM C90).
- Install corrosion resistant 2-#8 X 2" screws through each strike plate into rough opening.
- ed to μ .
 engineer of recommendations

 No. 7.2

 HERICAL STREET OF THE RESTREET OF THE RESTREE Host structure (wood buck, stud framing and opening) to be designed and anchored to properly transfer all loads to the structure. The host structure is the responsibility of the architect or engineer of record for the project of installation.

This schedule addresses only the fasteners required to anchor the window to achieve the rated design pressure up to the size limitations noted. It is not intended as a guide to the installation process and does not address the sealing consideration that may arise in different wall conditions. For the complete installation procedure, see the instructions packaged with the door or go to www.jeld-wen.com.

DISCLAIMER:

This drawing and its contents are confidential and are not to be reproduced or copied in whole or in part or used or disclosed to others except as authorized by JELD-WEN Inc.

General Notes:

DDOTECT ENGINEED

IDENTIFIER No.
TEL 01681715


The product shown herein is designed, tested and manufactured to comply with the wind load criteria of the adopted International Building Code (IBC), the International Residential Code (IRC), the Florida Building Code (FBC) excluding HVHZ and the industry standard requirement for the stated conditions.


CAD DWG. No.:


- Buck, framing and masonry by others and is responsibility of architect or engineer of record.
- All glazing shall conform to ASTM E1300.

	11/	02/2017	TET TO SATERI	3737 Lakeport Blvd			
DRAWN BY: D. Vezo	SCALE:	NTS	JELD-WEN	Klamath Falls, OR. 97601 Phone: (800) 535-3936			
CHECKED BY: J. Hawkins	TITLE:	A 1.11					
APPROVED BY: D. Vezo]	Archited	ctural Fiberglass Impact Outswing OXXO Door CHS Sidelites				
PART/PROJECT No.: D014776			CHS Sidelites				

PLANT NAME AND LOCATION:

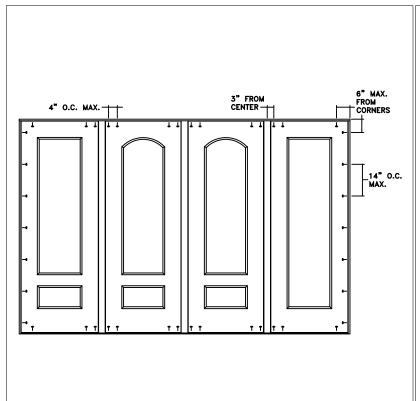

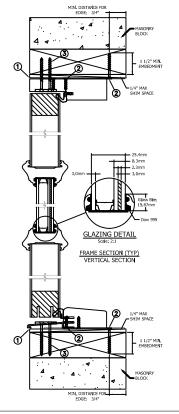

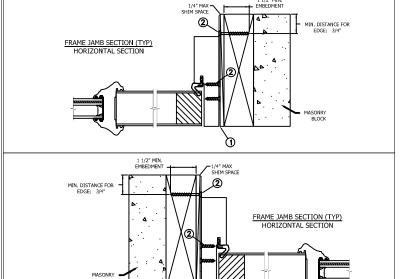

Max Frame	DP Rating	Impact
149 1/4" x 96 7/8"	+50/-50	YES

Installed Fastener Schedule:

- Seal flange/frame to substrate.
- Install masonry straps to wood frame using #10 corrosion resistant fasteners no more then 6" from each corner and 14" o.c. along the jambs and head. Bend straps around buck and secure with #8 fastener thru masonry strap into buck. Fasteners must be long enough to penetrate at least 1" into framing members.
- Install corrosion resistant 2-#8 X 2" screws through each strike plate into rough opening.
- Host structure (wood buck, stud framing and opening) to be designed and anchored to properly transfer all loads to the structure. The host structure is the responsibility of the architect or engineer of record for the project of installation.

This schedule addresses only the fasteners required to anchor the window to achieve the rated design pressure up to the size limitations noted. It is not intended as a guide to the installation process and does not address the sealing consideration that may arise in different wall conditions. For the complete installation procedure, see the instructions packaged with the door or go to www.jeld-wen.com.

DISCLAIMER:

This drawing and its contents are confidential and are not to be reproduced or copied in whole or in part or used or disclosed to others except as authorized by JELD-WEN Inc.

General Notes:

- The product shown herein is designed, tested and manufactured to comply with the wind load criteria of the adopted International Building Code (IBC), the International Residential Code (IRC), the Florida Building Code (FBC) excluding HVHZ and the industry standard requirement for the stated conditions.
- Buck, framing and masonry by others and is responsibility of architect or engineer of record.
- All glazing shall conform to ASTM E1300.



3737 Lakeport Blvd Klamath Falls, OR. 97601 Phone: (800) 535-3936

Architectural Fiberglass Impact Outswing OXXO Door **CHS Sidelites**


D014776 IDENTIFIER No.
TEL 01681715


D. Vezo


PLANT NAME AND LOCATION:

CAD DWG. No.:

3 of 6

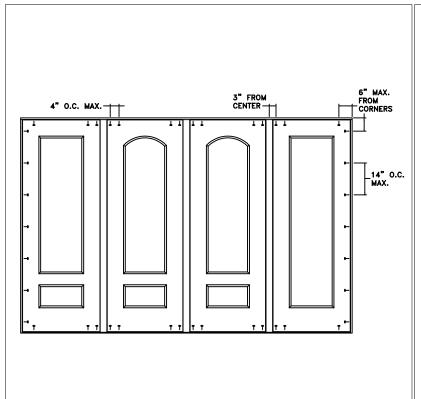

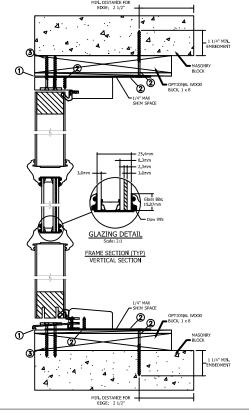

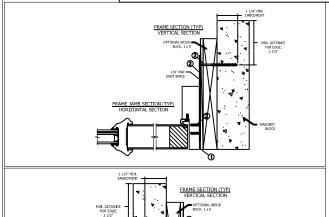

			F
[
	Max Frame	DP Rating	Impact
	149 1/4" x 96 7/8"	+50/-50	YES

Installed Fastener Schedule:

- Seal flange/frame to substrate.
- Use 3/16" Tapcon or equivalent fasteners through strap with sufficient length to penetrate a minimum of 1 1/4" into concrete or masonry at each location with a 2 1/2" min. from edge distance. 2-#8 x 1/2" PH screws through the strap into frame. For concrete (min. fc = 3000 psi) or masonry substrate (min fc = 2000 psi) (CMU shall adhere to ASTM C90).
- Install corrosion resistant 2-#8 X 2" screws through each strike plate into rough opening.
- Host structure (wood buck, stud framing and opening) to be designed and anchored to properly transfer all loads to the structure. The host structure is the responsibility of the architect or engineer of record for the project of installation.

This schedule addresses only the fasteners required to anchor the window to achieve the rated design pressure up to the size limitations noted. It is not intended as a guide to the installation process and does not address the sealing consideration that may arise in different wall conditions. For the complete installation procedure, see the instructions packaged with the door or go to www.jeld-wen.com.

DISCLAIMER:


This drawing and its contents are confidential and are not to be reproduced or copied in whole or in part or used or disclosed to others except as authorized by JELD-WEN Inc.


General Notes:


DDOJECT ENGINEED

- The product shown herein is designed, tested and manufactured to comply with the wind load criteria of the adopted International Building Code (IBC), the International Residential Code (IRC), the Florida Building Code (FBC) excluding HVHZ and the industry standard requirement for the stated conditions.
- Buck, framing and masonry by others and is responsibility of architect or engineer of record.
- All glazing shall conform to ASTM E1300.

	11/02/2017	IELDWEN	T	3737 Lakeport Blvd		
Drawn BY: D. Vezo	SCALE: NTS	July Wil	Pho	ath Falls, OR. 97601 ne: (800) 535-3936		
CHECKED BY: J. Hawkins	TITLE:					
APPROVED BY: D. Vezo	Architectural Fiberglass Impact Outswing OXXO Door CHS Sidelites					
PART/PROJECT No.: D014776		CH3 Sidelites				
IDENTIFIER No. TEL 01681715	PLANT NAME AND LOCA	TION: CAD DWG. No.:	REV:	SHEET 4 of 6		

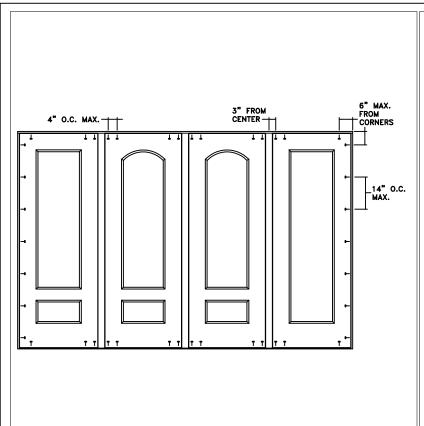

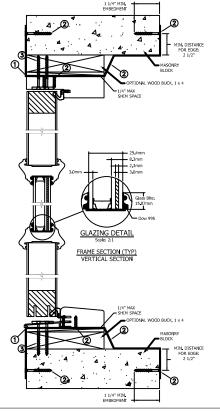

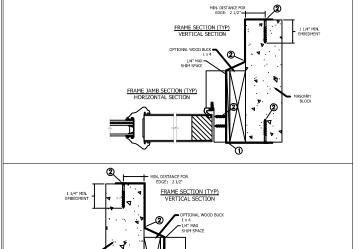

Max Frame	DP Rating	Impact
Max Frame	Dr Kaulig	Impact
149 1/4" x 96 7/8"	+50/-50	YES

Installed Fastener Schedule:

- Seal flange/frame to substrate.
- Use 3/16" Tapcon or equivalent fasteners through the interior and exterior of the strap with sufficient length to penetrate a minimum of 1 1/4" into concrete or masonry at each location with a 2 1/2" min. from edge distance. 2-#8 x 1/2" PH screws through the strap into frame. For concrete (min. fc = 3000 psi) or masonry substrate (min fc = 2000 psi) (CMU shall adhere to ASTM C90).
- Install corrosion resistant 2-#8 X 2" screws through each strike plate into rough opening.
- red to prope.

 or engineer of record

 No. 73

 HERM

 398 Host structure (wood buck, stud framing and opening) to be designed and anchored to properly transfer all loads to the structure. The host structure is the responsibility of the architect or engineer of record for the project of installation.

This schedule addresses only the fasteners required to anchor the window to achieve the rated design pressure up to the size limitations noted. It is not intended as a guide to the installation process and does not address the sealing consideration that may arise in different wall conditions. For the complete installation procedure, see the instructions packaged with the door or go to www.jeld-wen.com.

DISCLAIMER:


This drawing and its contents are confidential and are not to be reproduced or copied in whole or in part or used or disclosed to others except as authorized by JELD-WEN Inc.


General Notes:


Florida, No. 13778 398 East Dania Beach Blvd. Suite 338 Danis Beach, FL, 33004


- The product shown herein is designed, tested and manufactured to comply with the wind load criteria of the adopted International Building Code (IBC), the International Residential Code (IRC), the Florida Building Code (FBC) excluding HVHZ and the industry standard requirement for the stated conditions.
- Buck, framing and masonry by others and is responsibility of architect or engineer of record.
- All glazing shall conform to ASTM E1300.

	PROJECT ENGINEER:	11/02/2017	Tet	DWE!	T	3737 Lakeport Blvd
	Drawn by: D. Vezo	SCALE: NTS	JEL	IS WEL		ath Falls, OR. 97601 ne: (800) 535-3936
	CHECKED BY: J. Hawkins	Architectural Fiberglass Impact Outswing OXXO Door CHS Sidelites				
	APPROVED BY: D. Vezo					
	PART/PROJECT No.: D014776			CHS Sidelites		
	IDENTIFIER No. TEL 01681715	PLANT NAME AND LOCAT	TION:	CAD DWG. No.:	REV:	SHEET 5 of 6

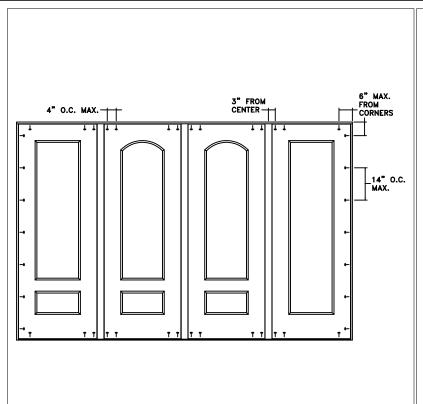

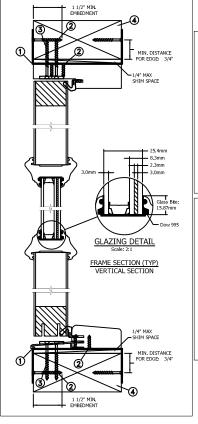

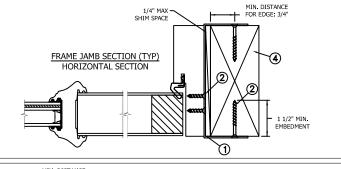

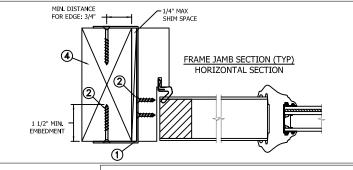

Max Frame	DP Rating	Impact
149 1/4" x 96 7/8"	+50/-50	YES

2727 Labour at Divis

Installed Fastener Schedule:

- Seal flange/frame to substrate.
- Install masonry straps to wood frame using #10 corrosion resistant fasteners no more then 6" from each corner and 14" o.c. along the jambs and head. Bend straps around buck to the interior and exterior, and secure with #8 fastener thru masonry strap into buck. Fasteners must be long enough to penetrate at least 1 1/2" into framing members. Minimum specific gravity = (Min. S.G. = 0.42).
- Install corrosion resistant 2-#8 X 2" screws through each strike plate into rough opening.
- d to proper.
 engineer of record

 No. 7 Host structure (wood buck, stud framing and opening) to be designed and anchored to properly transfer all loads to the structure. The host structure is the responsibility of the architect or engineer of record for the project of installation.

This schedule addresses only the fasteners required to anchor the window to achieve the rated design pressure up to the size limitations noted. It is not intended as a guide to the installation process and does not address the sealing consideration that may arise in different wall conditions. For the complete installation procedure, see the instructions packaged with the door or go to www.jeld-wen.com.

DISCLAIMER:

This drawing and its contents are confidential and are not to be reproduced or copied in whole or in part or used or disclosed to others except as authorized by JELD-WEN Inc.

General Notes:

PROJECT ENGINEER:

Florida, No. 13778 398 East Dania Beach Blvd. Suite 338 Danis Beach, FL, 33004

- The product shown herein is designed, tested and manufactured to comply with the wind load criteria of the adopted International Building Code (IBC), the International Residential Code (IRC), the Florida Building Code (FBC) excluding HVHZ and the industry standard requirement for the stated conditions.
- Buck, framing and masonry by others and is responsibility of architect or engineer of record.
- All glazing shall conform to ASTM E1300.

DATE:

	11/02/2017	TET	DWEN	T	3/3/ Lakeport Blvd
D. Vezo	SCALE: NTS	JÆL	TA AA TTI		ath Falls, OR. 97601 ne: (800) 535-3936
CHECKED BY: J. Hawkins	TITLE:))((() D
APPROVED BY: D. Vezo	Archited	cturai Fibei	glass Impact Ou CHS Sidelites	tswing C	DXXO Door
PART/PROJECT No.: D014776			Cris sidelites		
IDENTIFIER No. TEL 01681715	PLANT NAME AND LOCAT	TION:	CAD DWG. No.:	REV:	SHEET 6 of 6