


SINGLE HUNG - NON-IMPACT

(SHOWN w/DIFFERENT OPTIONS)

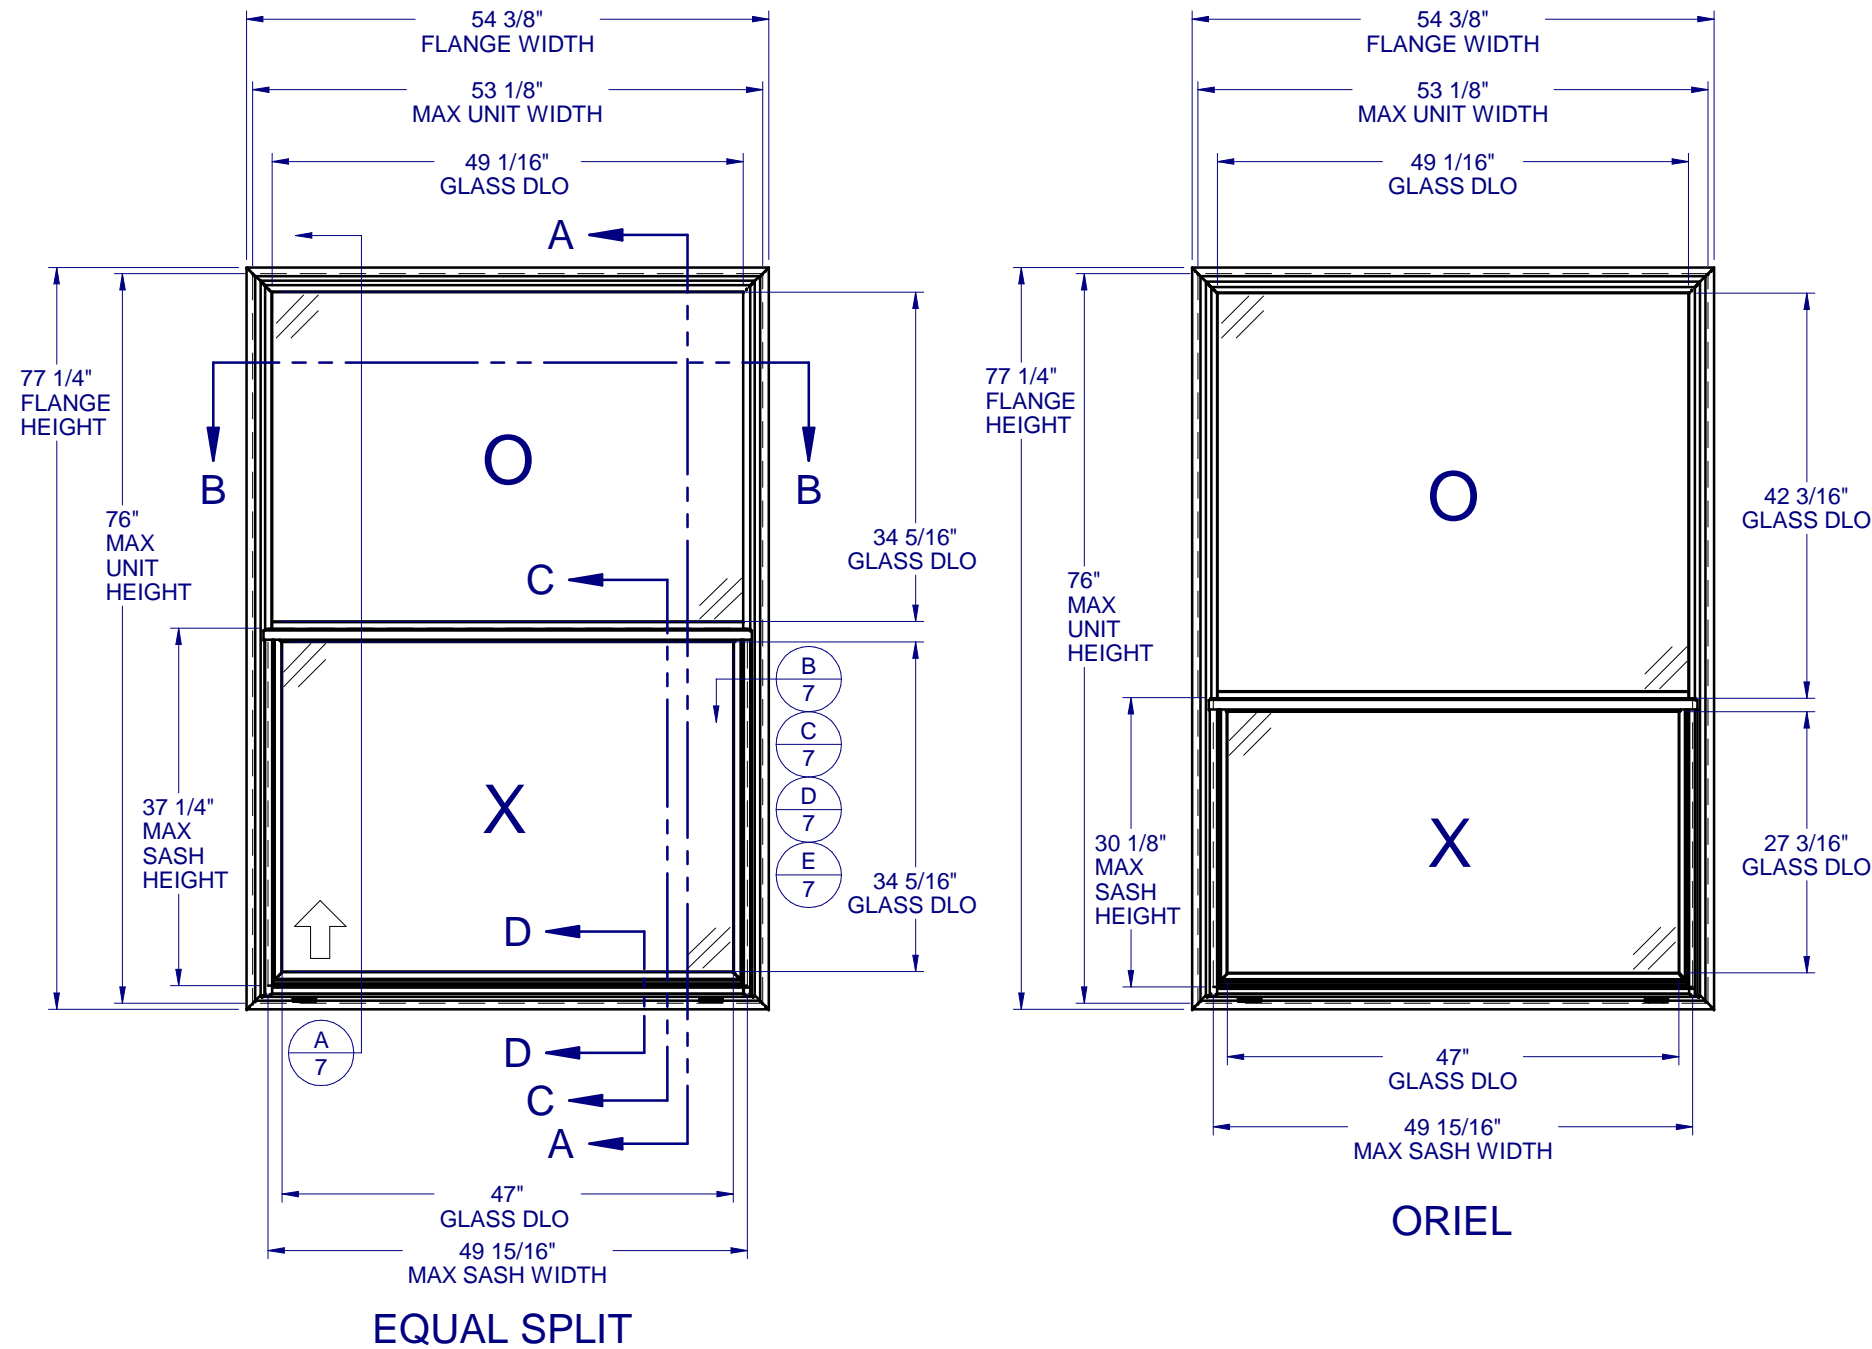

GENERAL NOTES:

1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE FLORIDA BUILDING CODE (FBC), CURRENT EDITION.
2. GLAZING OPTIONS: (SEE SHEET 3)
3. CONFIGURATIONS: "O/X".
4. DESIGN PRESSURE RATING (SEE SHEET 2):
 -NEGATIVE DESIGN LOADS BASED ON, TESTED PRESSURE AND GLASS TABLES ASTM E-1300-04e01/09.
 -POSITIVE DESIGN LOADS BASED ON, TESTED PRESSURE, WATER INFILTRATION TEST PRESSURE AND GLASS TABLES ASTM E-1300-04e01/09.
5. ANCHORAGE: THE 33 1/3% STRESS INCREASE HAS NOT BEEN USED IN THE DESIGN OF THIS PRODUCT. SEE SHEET 7 FOR ANCHOR DETAILS. WINDLOAD DURATION FACTOR Cd=1.6 WAS USED FOR WOOD ANCHOR CALCULATIONS.
6. NOT APPROVED FOR IMPACT RESISTANCE. IMPACT PROTECTIVE SYSTEM IS REQUIRED IN WIND BORNE DEBRIS REGION.
7. ALL FRAMES AND VENTS FULLY WELDED. SMALL JOINT SEAM SEALANT USED AT FIXED MEETING RAIL AND JAMB.
8. SERIES / MODEL DESIGNATION SH-610.
9. THE DESIGNATION X AND O STAND FOR THE FOLLOWING:
 X = OPERABLE SASH, O = FIXED SASH
10. SECTION CALLOUTS APPLY TO ALL ELEVATIONS IN A SIMILAR LOCATION.
11. EXTERNAL WEEP SLOT = 1/4 x 1-1/2" LOCATED 5" FROM BOTH ENDS.



410 PVC SINGLE HUNG NON-IMPACT

PROPRIETARY AND CONFIDENTIAL
 THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF CUSTOM WINDOW SYSTEMS, INC. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT THE WRITTEN PERMISSION OF CUSTOM WINDOW SYSTEMS, INC IS PROHIBITED.

FLORIDA APPROVAL NO.:
33429



10/2/2023

LUCAS A. TURNER, P.E.
 FL PE # 58201
 Turner Engineering & Consulting, Inc.
 2428 Old Natchez Trc Trl
 Camden, TN 38320
 PH. 941-380-1574

SHEET DESCRIPTION:

GENERAL NOTES AND ELEVATIONS

DRAWN BY: MCS	DATE: 9/20/2023
DWG #: PEL-935	REV.: A
SCALE: 1:20	SHEET 1 OF 7

TABLE OF CONTENTS

GENERAL NOTES & ELEVATIONS.....1
 DP CHARTS.....2
 GLAZING DETAILS.....3
 SECTION VIEWS.....4
 BOM & EXTRUSIONS.....5
 ANCHOR SCHEDULE & NOTES.....6
 INSTALLATION DETAIL.....7

CONFIG.	MAX. UNIT SIZE	EXTERNAL REINFORCEMENT	DESIGN PRESSURE RATING	IMPACT RATING
EQUAL	37" x 76"	NONE	SEE COMPARATIVE ANALYSIS CHART, SHEET 2	NONE
EQUAL	53-1/8" x 76"	* 2011		
5 HI ORIEL				

* ONLY REQUIRED WITH H-6137 FIXED MEETING RAIL & SCREW-ON INTERLOCK, S-2001 - SEE SHEET 4 FOR DETAILS.

Design Pressures (PSF) for Equal Split Configuration with Glass Types A, B, C, or D											
Unit	Unit Widths (in.)										
Heights (in.)	23 1/2	27 1/2	29 1/2	31 1/2	35 1/2	39 1/2	41 1/2	43 1/2	47 1/2	51 1/2	53 1/8
35 1/2	+50.0/-75.0	+50.0/-75.0	+50.0/-75.0	+50.0/-75.0	+50.0/-75.0	+50.0/-75.0	+50.0/-75.0	+50.0/-75.0	+50.0/-75.0	+50.0/-75.0	+50.0/-75.0
39 1/2	+50.0/-75.0	+50.0/-75.0	+50.0/-75.0	+50.0/-75.0	+50.0/-75.0	+50.0/-75.0	+50.0/-75.0	+50.0/-75.0	+50.0/-75.0	+50.0/-75.0	+50.0/-75.0
41 1/2	+50.0/-75.0	+50.0/-75.0	+50.0/-75.0	+50.0/-75.0	+50.0/-75.0	+50.0/-75.0	+50.0/-75.0	+50.0/-75.0	+50.0/-75.0	+50.0/-75.0	+50.0/-73.1
43 1/2	+50.0/-75.0	+50.0/-75.0	+50.0/-75.0	+50.0/-75.0	+50.0/-75.0	+50.0/-75.0	+50.0/-75.0	+50.0/-75.0	+50.0/-75.0	+50.0/-73.4	+50.0/-70.6
47 1/2	+50.0/-75.0	+50.0/-75.0	+50.0/-75.0	+50.0/-75.0	+50.0/-75.0	+50.0/-75.0	+50.0/-75.0	+50.0/-75.0	+50.0/-75.0	+50.0/-68.9	+50.0/-66.2
51 1/2	+50.0/-75.0	+50.0/-75.0	+50.0/-75.0	+50.0/-75.0	+50.0/-75.0	+50.0/-75.0	+50.0/-75.0	+50.0/-75.0	+50.0/-72.7	+50.0/-65.2	+50.0/-62.6
53 1/2	+50.0/-75.0	+50.0/-75.0	+50.0/-75.0	+50.0/-75.0	+50.0/-75.0	+50.0/-75.0	+50.0/-75.0	+50.0/-75.0	+50.0/-71.0	+50.0/-63.6	+50.0/-61.0
55 1/2	+50.0/-75.0	+50.0/-75.0	+50.0/-75.0	+50.0/-75.0	+50.0/-75.0	+50.0/-75.0	+50.0/-75.0	+50.0/-75.0	+50.0/-69.5	+50.0/-62.1	+50.0/-59.5
59 1/2	+50.0/-75.0	+50.0/-75.0	+50.0/-75.0	+50.0/-75.0	+50.0/-75.0	+50.0/-75.0	+50.0/-75.0	+50.0/-75.0	+50.0/-66.8	+50.0/-59.5	+50.0/-57.0
63 1/2	+50.0/-75.0	+50.0/-72.9	+50.0/-72.0	+50.0/-71.6	+50.0/-71.6	+50.0/-71.6	+50.0/-71.6	+50.0/-71.6	+50.0/-64.6	+50.0/-57.3	+50.0/-54.8
65 1/2	+50.0/-73.2	+50.0/-69.1	+50.0/-68.0	+50.0/-67.4	+50.0/-67.3	+50.0/-67.3	+50.0/-67.3	+50.0/-67.3	+50.0/-63.6	+50.0/-56.4	+50.0/-53.9
67 1/2	+50.0/-69.8	+50.0/-65.6	+50.0/-64.4	+50.0/-63.7	+50.0/-63.4	+50.0/-63.4	+50.0/-63.4	+50.0/-63.4	+50.0/-62.7	+50.0/-55.5	+50.0/-53.0
71 1/2	+50.0/-64.0	+50.0/-59.7	+50.0/-58.3	+50.0/-57.3	+50.0/-56.5	+50.0/-56.5	+50.0/-56.5	+50.0/-56.5	+50.0/-56.5	+50.0/-53.9	+50.0/-51.5
74 3/4	+50.0/-59.9	+50.0/-55.6	+50.0/-54.1	+50.0/-53.0	+50.0/-51.8	+50.0/-51.7	+50.0/-51.7	+50.0/-51.7	+50.0/-51.7	+50.0/-51.7	+50.0/-50.4
76	+50.0/-58.5	+50.0/-54.1	+50.0/-52.6	+50.0/-51.5	+50.0/-50.2	+50.0/-50.0	+50.0/-50.0	+50.0/-50.0	+50.0/-50.0	+50.0/-50.0	+50.0/-50.0

Design Pressures (PSF) for Oriel Configuration with Glass Types A, B, C, or D in the Sash, and Glass Types C or D in the Fixed											
Unit	Unit Widths (in.)										
Heights (in.)	23 1/2	27 1/2	29 1/2	31 1/2	35 1/2	39 1/2	41 1/2	43 1/2	47 1/2	51 1/2	53 1/8
35 1/2	+50.0/-75.0	+50.0/-75.0	+50.0/-75.0	+50.0/-75.0	+50.0/-75.0	+50.0/-75.0	+50.0/-75.0	+50.0/-75.0	+50.0/-75.0	+50.0/-75.0	+50.0/-75.0
39 1/2	+50.0/-75.0	+50.0/-75.0	+50.0/-75.0	+50.0/-75.0	+50.0/-75.0	+50.0/-75.0	+50.0/-75.0	+50.0/-75.0	+50.0/-75.0	+50.0/-75.0	+50.0/-74.1
41 1/2	+50.0/-75.0	+50.0/-75.0	+50.0/-75.0	+50.0/-75.0	+50.0/-75.0	+50.0/-75.0	+50.0/-75.0	+50.0/-75.0	+50.0/-75.0	+50.0/-74.2	+50.0/-71.3
43 1/2	+50.0/-75.0	+50.0/-75.0	+50.0/-75.0	+50.0/-75.0	+50.0/-75.0	+50.0/-75.0	+50.0/-75.0	+50.0/-75.0	+50.0/-75.0	+50.0/-71.6	+50.0/-68.9
47 1/2	+50.0/-75.0	+50.0/-75.0	+50.0/-75.0	+50.0/-75.0	+50.0/-75.0	+50.0/-75.0	+50.0/-75.0	+50.0/-75.0	+50.0/-74.8	+50.0/-67.2	+50.0/-64.6
51 1/2	+50.0/-69.0	+50.0/-68.4	+50.0/-68.4	+50.0/-68.4	+50.0/-68.1	+50.0/-67.4	+50.0/-67.4	+50.0/-67.4	+50.0/-67.4	+50.0/-63.6	+50.0/-61.1
53 1/2	+50.0/-64.4	+50.0/-63.4	+50.0/-63.4	+50.0/-63.4	+50.0/-62.4	+50.0/-61.2	+50.0/-61.1	+50.0/-61.1	+50.0/-61.1	+50.0/-61.1	+50.0/-59.5
55 1/2	+50.0/-60.3	+50.0/-58.9	+50.0/-58.9	+50.0/-58.9	+50.0/-57.6	+50.0/-56.1	+50.0/-55.7	+50.0/-55.6	+50.0/-55.6	+50.0/-55.6	+50.0/-55.6
59 1/2	+50.0/-53.6	+50.0/-51.6	+50.0/-51.3	+50.0/-51.3	+50.0/-51.3	+50.0/-51.0	+50.0/-50.5	+50.0/-50.1	+50.0/-50.0	+50.0/-50.0	+50.0/-50.0
63 1/2	+50.0/-52.5	+50.0/-50.4	+50.0/-50.0	+50.0/-50.0	+50.0/-50.0	+50.0/-50.0	+50.0/-50.0	+50.0/-50.0	+50.0/-50.0	+50.0/-50.0	+50.0/-50.0
65 1/2	+50.0/-52.5	+50.0/-50.4	+50.0/-50.0	+50.0/-50.0	+50.0/-50.0	+50.0/-50.0	+50.0/-50.0	+50.0/-50.0	+50.0/-50.0	+50.0/-50.0	+50.0/-50.0
67 1/2	+50.0/-52.5	+50.0/-50.4	+50.0/-50.0	+50.0/-50.0	+50.0/-50.0	+50.0/-50.0	+50.0/-50.0	+50.0/-50.0	+50.0/-50.0	+50.0/-50.0	+50.0/-50.0
71 1/2	+50.0/-52.5	+50.0/-50.4	+50.0/-50.0	+50.0/-50.0	+50.0/-50.0	+50.0/-50.0	+50.0/-50.0	+50.0/-50.0	+50.0/-50.0	+50.0/-50.0	+50.0/-50.0
74 3/4	+50.0/-52.5	+50.0/-50.4	+50.0/-50.0	+50.0/-50.0	+50.0/-50.0	+50.0/-50.0	+50.0/-50.0	+50.0/-50.0	+50.0/-50.0	+50.0/-50.0	+50.0/-50.0
76	+50.0/-52.5	+50.0/-50.4	+50.0/-50.0	+50.0/-50.0	+50.0/-50.0	+50.0/-50.0	+50.0/-50.0	+50.0/-50.0	+50.0/-50.0	+50.0/-50.0	+50.0/-50.0

NOTE:

IF SIZE INTENDED IS NOT SHOWN, USE NEXT LARGER SIZE.



**410 PVC
SINGLE HUNG
NON-IMPACT**

PROPRIETARY AND CONFIDENTIAL
THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF CUSTOM WINDOW SYSTEMS, INC. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT THE WRITTEN PERMISSION OF CUSTOM WINDOW SYSTEMS, INC IS PROHIBITED.

FLORIDA APPROVAL NO.:
33429



10/2/2023

LUCAS A. TURNER, P.E.
FL PE # 58201
Turner Engineering & Consulting, Inc.
2428 Old Natchez Trc Trl
Camden, TN 38320
PH. 941-380-1574

SHEET DESCRIPTION:


**DESIGN PRESSURE
CHARTS**

DRAWN BY: MCS	DATE: 9/20/2023
DWG #: PEL-935	REV.: A
SCALE: 1:1	SHEET 2 OF 7

**410 PVC
 SINGLE HUNG
 NON-IMPACT**

PROPRIETARY AND CONFIDENTIAL
 THE INFORMATION CONTAINED IN
 THIS DRAWING IS THE SOLE
 PROPERTY OF CUSTOM WINDOW
 SYSTEMS, INC. ANY
 REPRODUCTION IN PART OR AS A
 WHOLE WITHOUT THE WRITTEN
 PERMISSION OF CUSTOM WINDOW
 SYSTEMS, INC IS PROHIBITED.

FLORIDA APPROVAL NO.:
 33429

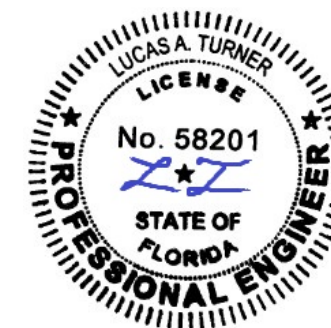


10/2/2023

LUCAS A. TURNER, P.E.
 FL PE # 58201
 Turner Engineering &
 Consulting, Inc.
 2428 Old Natchez Trc Trl
 Camden, TN 38320
 PH. 941-380-1574


SHEET DESCRIPTION:

GLAZING DETAILS


DRAWN BY: MCS	DATE: 9/20/2023
DWG #: PEL-935	REV.: A
SCALE: 1:1	SHEET 3 OF 7

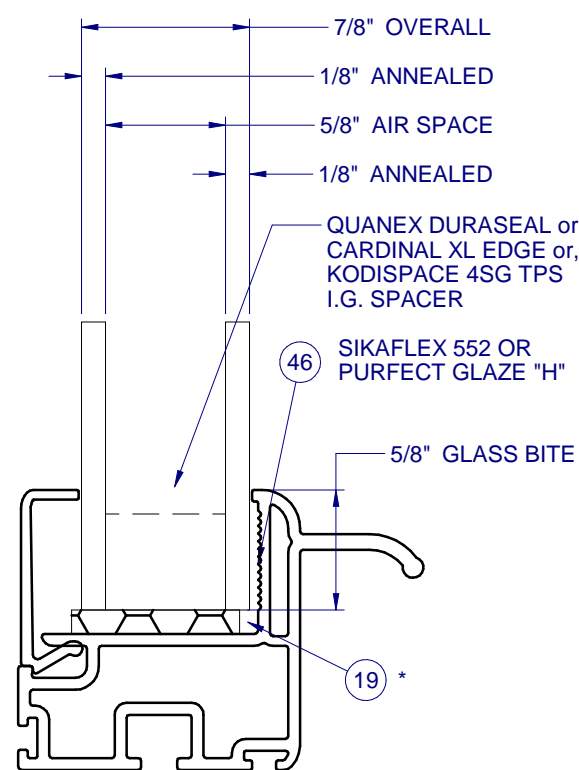


GLASS TYPE A

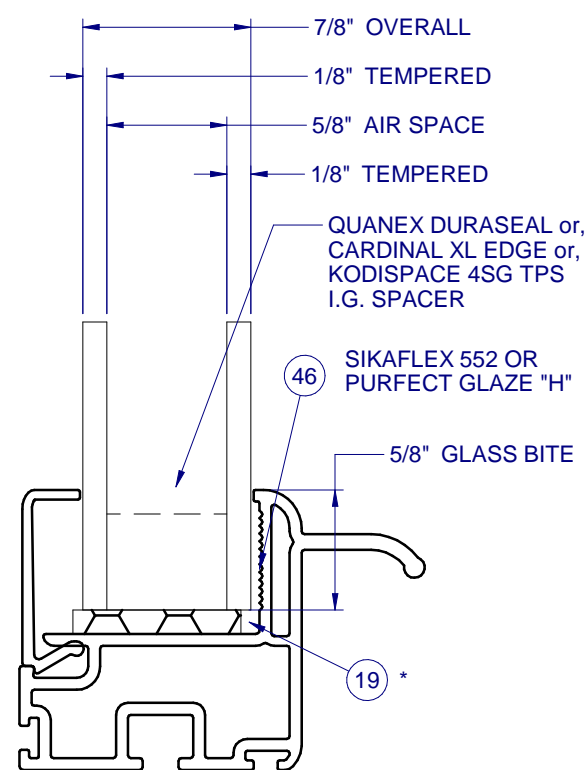

GLASS TYPE B

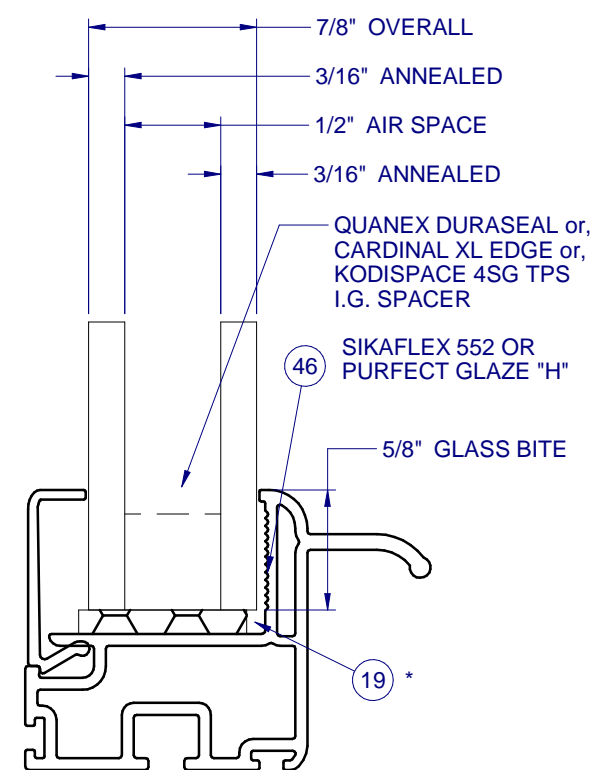

GLASS TYPE C

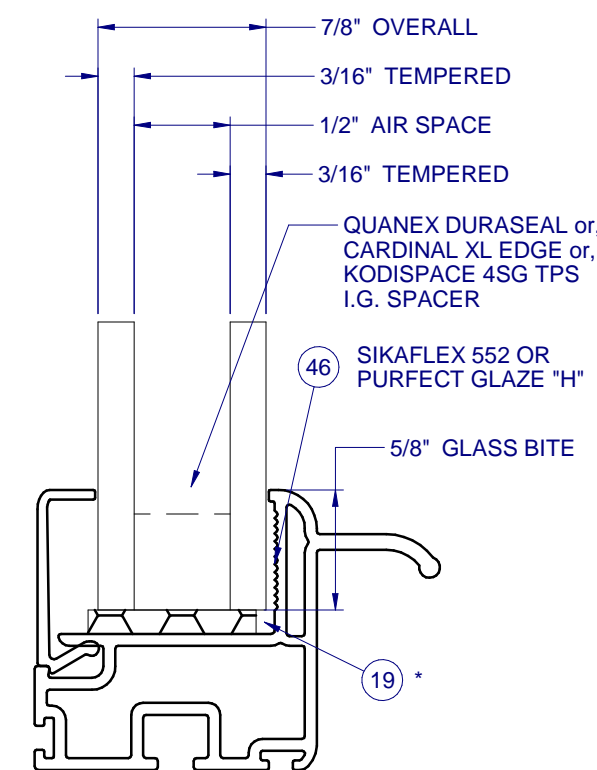


GLASS TYPE D

* SETTING BLOCKS PER FBC 2411.3.3.1

**410 PVC
 SINGLE HUNG
 NON-IMPACT**

PROPRIETARY AND CONFIDENTIAL
 THE INFORMATION CONTAINED IN
 THIS DRAWING IS THE SOLE
 PROPERTY OF CUSTOM WINDOW
 SYSTEMS, INC. ANY
 REPRODUCTION IN PART OR AS A
 WHOLE WITHOUT THE WRITTEN
 PERMISSION OF CUSTOM WINDOW
 SYSTEMS, INC IS PROHIBITED.

FLORIDA APPROVAL NO.:
 33429

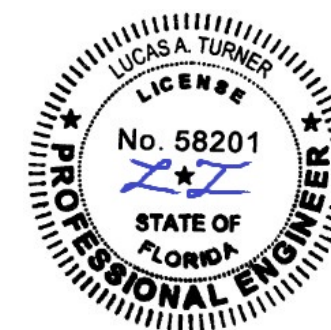


10/2/2023
 LUCAS A. TURNER, P.E.
 FL PE # 58201
 Turner Engineering &
 Consulting, Inc.
 2428 Old Natchez Trc Trl
 Camden, TN 38320
 PH. 941-380-1574

SHEET DESCRIPTION:


SECTION VIEWS

DRAWN BY:	DATE:
MCS	9/20/2023
DWG #:	REV.:
PEL-935	A
SCALE:	SHEET
1:2	4 OF 7


INTERIOR

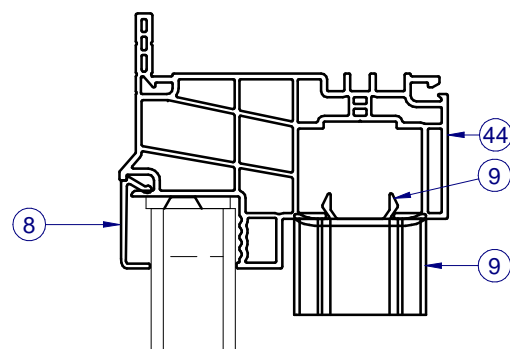


SECTION A-A

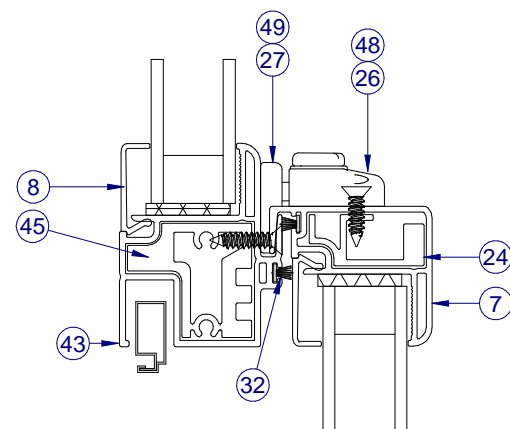


INTERIOR

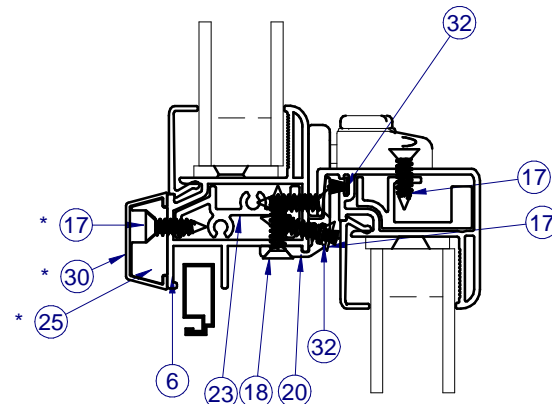


SECTION C-C
 ALTERNATE MTG RAIL
 AND SLOPE SILL

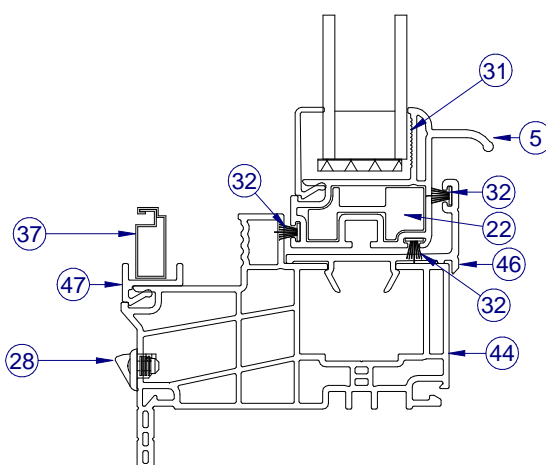

SECTION A-A


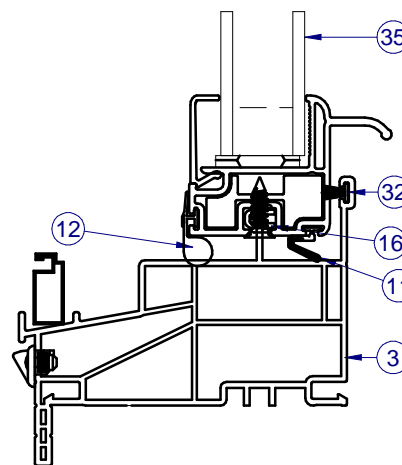


SECTION D-D
 ALT 562 POCKET UNI-FRAME

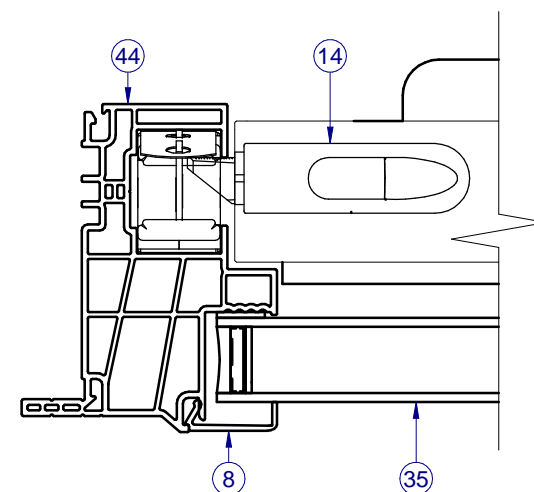

SECTION B-B

NOTE: LEFT SIDE SHOWS FIXED SECTION VIEW,
 RIGHT SIDE SHOWS SASH SECTION VIEW.

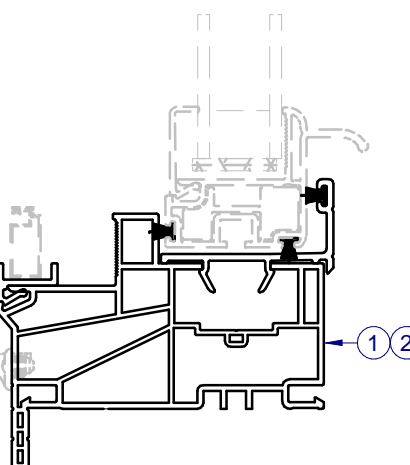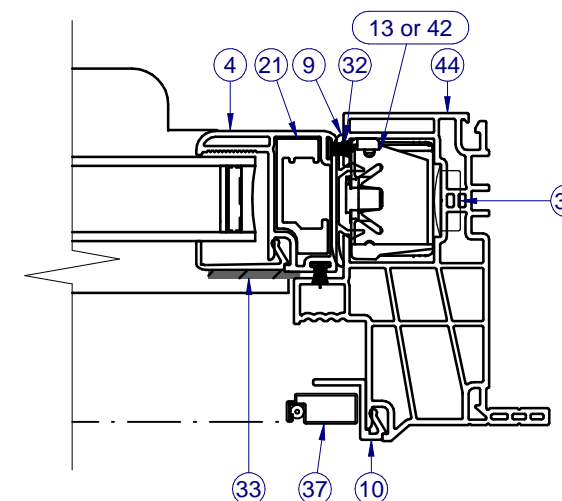


SECTION D-D
 ALT 562 POCKET UNI-FRAME


- NOTES:
- FIN FRAME AVAILABLE FOR BOTH UNI-FRAME AND STANDARD FRAME TYPES.
 - 880 BALANCERS AND DEEP POCKET UNI-FRAME (H-6193) REQUIRED FOR LARGER SASHES.
 - * EXTERNAL REINFORCEMENT REQUIRED ON UNIT WIDTHS OVER 37" WITH THE H-6137 FIXED MEETING RAIL AND SCREW-ON INTERLOCK, S-2001.

NOTE: ITEMS NOT SHOWN FOR CLARITY: 38-41


ITEM	PART	DESCRIPTION	MATERIAL
1	H-6125	HEAD, OUTERFRAME	PVC
2	H-6125	JAMBS, OUTERFRAME	PVC
3	H-6126	SILL, OUTERFRAME	PVC
4	H-6132	SASH SIDE RAIL	PVC
5	H-6136	SASH BOTTOM RAIL	PVC
6	H-6137	FIXED MEETING RAIL	PVC
7	H-6138	SASH TOP RAIL	PVC
8	S-6141	GLAZING BEAD	PVC
9	S-5592	SASH STOP, ADEPT, SH/DH, CROSSOVER, 3.	PVC
10	S-6143	SCREEN ADAPTOR	PVC
11	P-5085	WSTP, QLON BULB VINYL	
12	P-5086	WSTP, QLON BULB VINYL	
13		BALANCERS - CONSTANT FORCE RT 562	
14	P-5392	SASH TILT LATCH	NYLON
15	P-5393	PIVOT CARRIER	NYLON
16	P-5396	PIVOT BAR	SS
17	P-3515	#8 x 5/8 PHIL FLAT WHITE SMS	STEEL
18	P-4146	#8 X 3/4 PHIL FLAT tek	STEEL
19	P-5612	SETTING BLOCK, .12 x 1 x 2	RUBBER
20	S-2001	INTERLOCK RAIL	ALUM
21	S-2006	REINF, SASH SIDE RAIL, HD	ALUM
22	S-2007	REINF, BOTTOM RAIL	ALUM
23	S-2008	REINF, FMR	ALUM
24	S-2009	REINF, TOP RAIL	ALUM
26	P-5388	CAM LOCKS	NYLON
27	P-5389	CAM KEEPERS	NYLON
28	P-5420	WEEP HOLE COVER (crossover)	NYLON
31		SIKA FLEX 552 OR PURFECT GLAZE 'H'	SILICONE
32	P-3305	WSTP., .270 X 187, SOFT TOUCH FIN	
33	P-5425	WSTP, .200 X 5/8" X 5/8" DUST PLUG	
34	P-5588	HOLE PLUG	NYLON
35	GLASS	SEE SHEET 2	
36	P-4638	#8 X 2-1/2 PHIL TRUSS tek	STEEL
37	P-3218	SCREEN FRAME	ALUM
38	P-4754	SCREEN CORNER KEY	NYLON
39	P-5576	Screen Spline, .125" Black PE Ribbed	
40	P-4755	SCREEN CORNER KEY (Rollform scrn 1" off)	
41	P-3195	SPRING, NO HOLE TENSION C-8400	
42		BALANCERS - CONSTANT FORCE RT 880	
43	H-6157	HD FIXED MEETING RAIL	PVC
44	H-6193	UNI-FRAME, 880 BALANCERS	PVC
45	H-2115	REINF, HD FMR	ALUM
46	S-6239	UNI-FRAME SILL POCKET INSERT	PVC
47	S-6217	UNI-FRAME SCREEN RETAINER	PVC

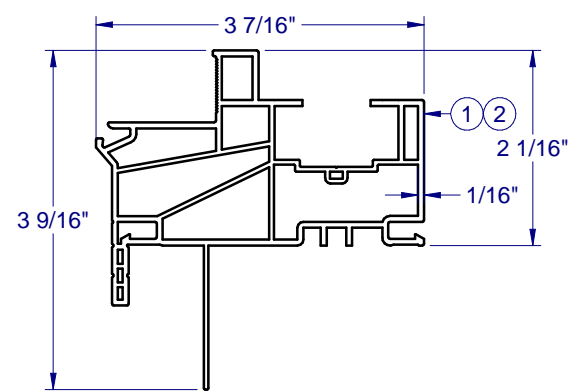


PVC FRAME HEAD & JAMB
H-6125

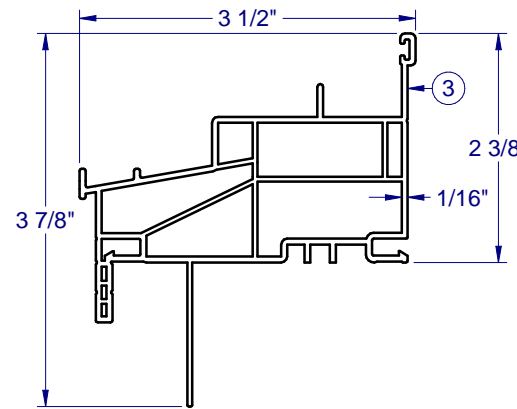


PVC FRAME SILL
H-6126

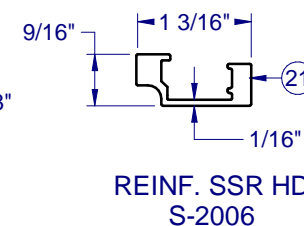


REINF. SSR HD
S-2006




INTERLOCK
S-2001




PVC GLAZING BEAD
S-6141

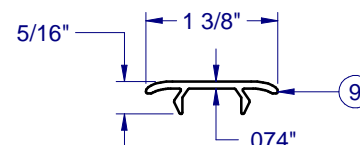


PVC SASH STOP
S-5592




PVC SCREEN ADAPTOR
S-6143

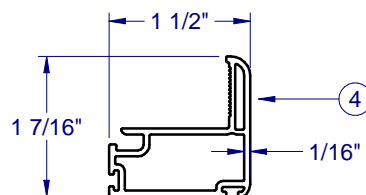


PVC SIDE RAIL
H-6132

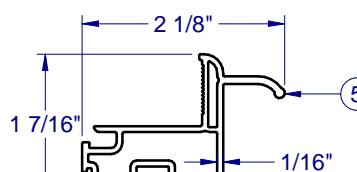


PVC SASH BTM RAIL
H-6136

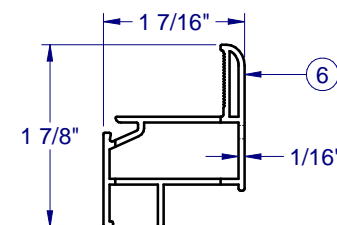


PVC SASH FMR
H-6137

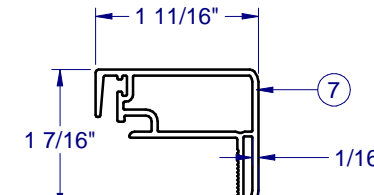


PVC SASH TOP RAIL
H-6138

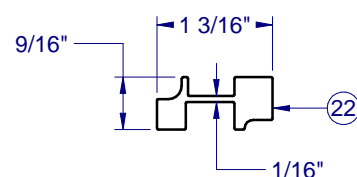


REINF. BTM RAIL
S-2007

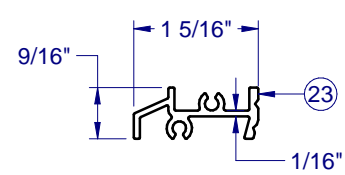


REINF. FMR
S-2008

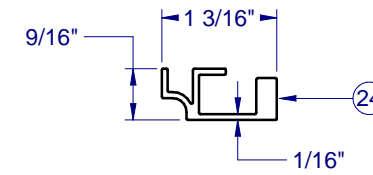


REINF. TOP RAIL
S-2009




REINF. EXTERNAL
S-2011

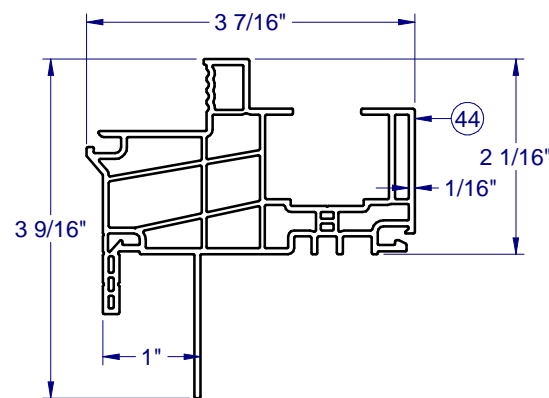


PVC FRAME
H-6193

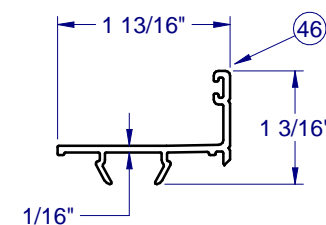


PVC SILL POCKET INSERT
S-6239

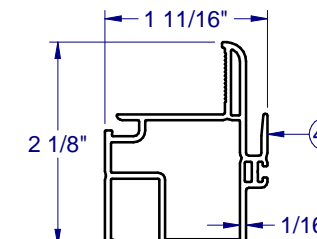

PVC HD FMR
H-6157




REINF. HD FMR
H-2115
6005A-T5




PVC SCREEN RETAINER
S-6217

FRAME CORNER CONSTRUCTION



CORNER WELD (ALL SIDES)
1:8

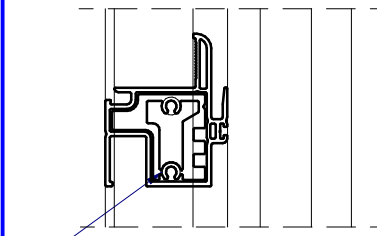

FIXED MEETING RAIL
SCREWED TOGETHER WITH
OUTERFRAME
1:8




Pella Corporation
102 Main Street
Pella, IA 50219
www.pella.com

410 PVC
SINGLE HUNG
NON-IMPACT

PROPRIETARY AND CONFIDENTIAL
THE INFORMATION CONTAINED IN
THIS DRAWING IS THE SOLE
PROPERTY OF CUSTOM WINDOW
SYSTEMS, INC. ANY
REPRODUCTION IN PART OR AS A
WHOLE WITHOUT THE WRITTEN
PERMISSION OF CUSTOM WINDOW
SYSTEMS, INC IS PROHIBITED.

FLORIDA APPROVAL NO.:
33429

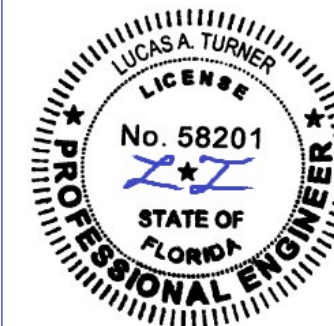

10/2/2023

LUCAS A. TURNER, P.E.
FL PE # 58201
Turner Engineering &
Consulting, Inc.
2428 Old Natchez Trc Trl
Camden, TN 38320
PH. 941-380-1574

SHEET DESCRIPTION:

BOM AND EXTRUSIONS


DRAWN BY:	DATE:
MCS	9/20/2023
DWG #:	REV.:
PEL-935	A
SCALE:	SHEET
1:2	5 OF 7

NOTE: ALL ALUMINUM EXTRUSIONS ARE 6063-T6 UNLESS OTHERWISE NOTED.

**410 PVC
 SINGLE HUNG
 NON-IMPACT**

PROPRIETARY AND CONFIDENTIAL
 THE INFORMATION CONTAINED IN
 THIS DRAWING IS THE SOLE
 PROPERTY OF CUSTOM WINDOW
 SYSTEMS, INC. ANY
 REPRODUCTION IN PART OR AS A
 WHOLE WITHOUT THE WRITTEN
 PERMISSION OF CUSTOM WINDOW
 SYSTEMS, INC IS PROHIBITED.

FLORIDA APPROVAL NO.:
 33429

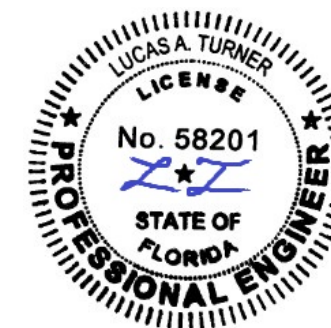


10/2/2023

LUCAS A. TURNER, P.E.
 FL PE # 58201
 Turner Engineering &
 Consulting, Inc.
 2428 Old Natchez Trc Trl
 Camden, TN 38320
 PH. 941-380-1574

SHEET DESCRIPTION:
**ANCHOR SCHEDULE AND
 NOTES**

DRAWN BY:	DATE:
MCS	9/20/2023
DWG #:	REV.:
PEL-935	A
SCALE:	SHEET
1:20	6 OF 7

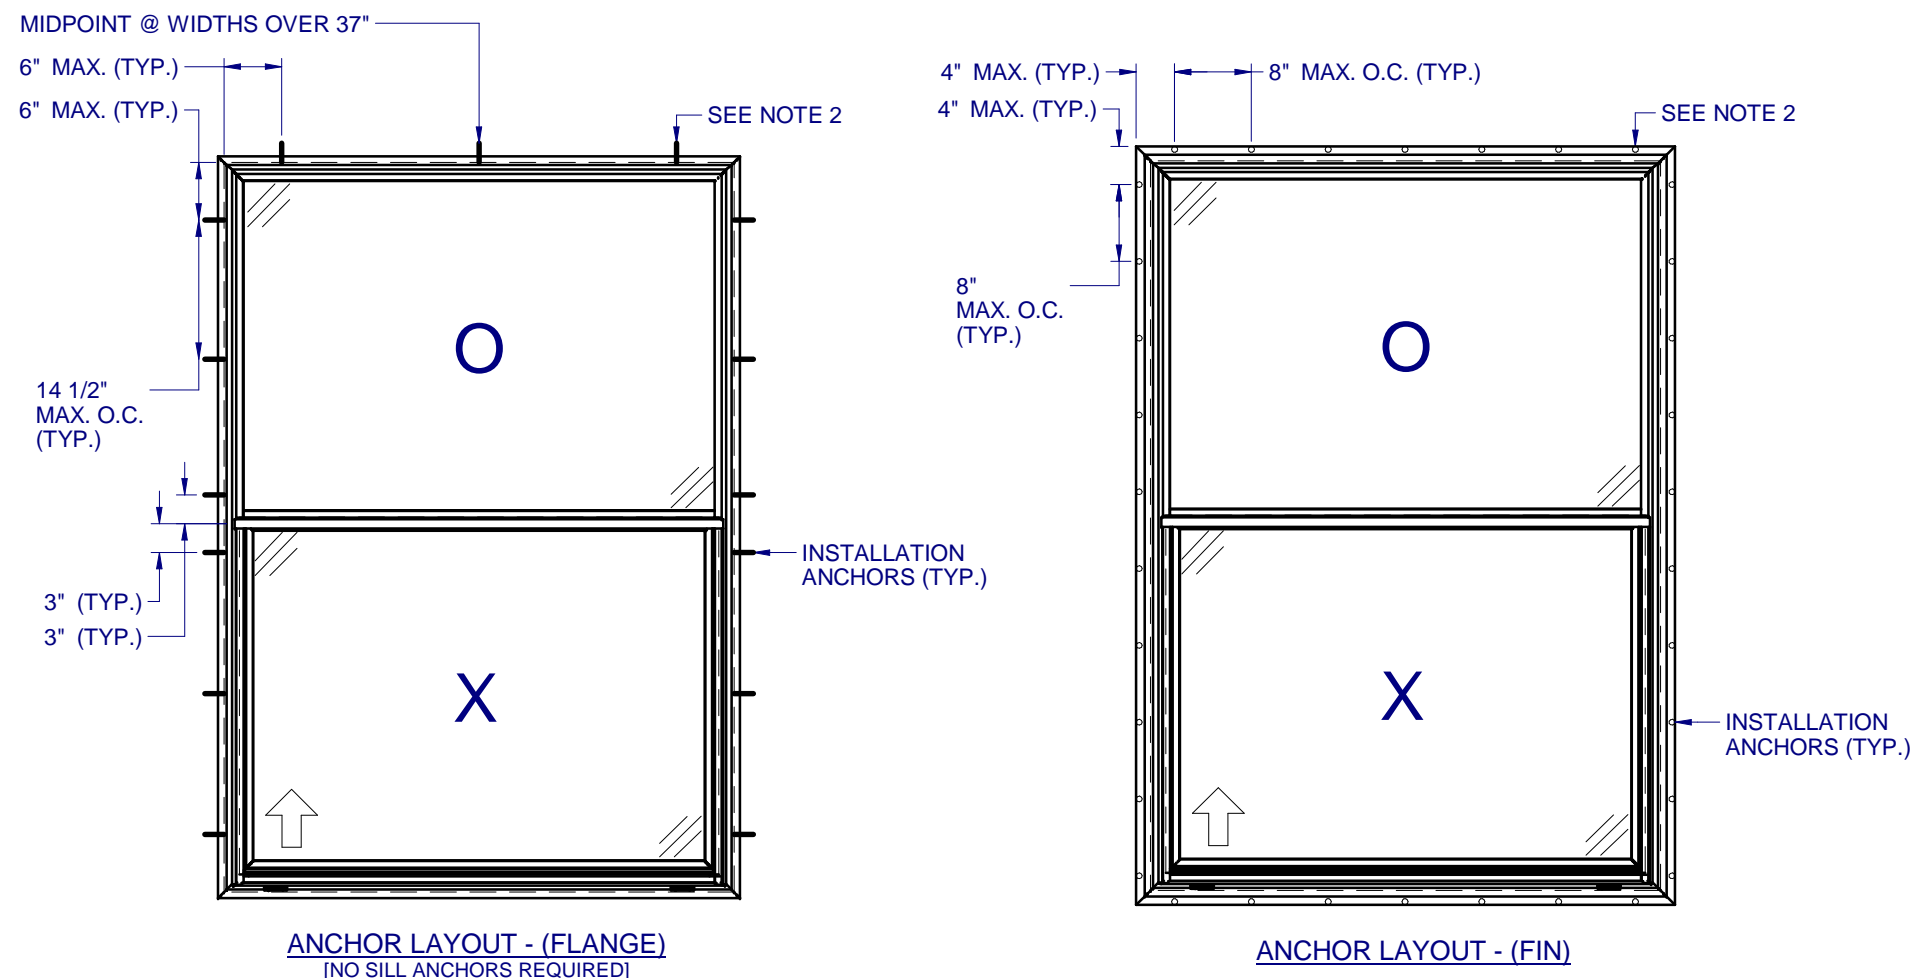

NOTES:

1. INSTALL ONE ANCHOR AT EACH INSTALLATION LOCATION. SILL ANCHOR SPACING SAME AS HEAD.
2. SHIM AS REQ AT EACH INSTALLATION ANCHOR USING LOAD BEARING SHIMS. MAX. ALLOWABLE SHIM STACK TO BE 1/4". USE SHIMS WHERE SPACE GREATER THAN 1/16" IS PRESENT. LOAD BEARING SHIMS SHALL BE CONSTRUCTED OF HIGH DENSITY PLASTIC OR BETTER. WOOD SHIMS ARE NOT ALLOWED.
3. ANCHOR TYPE, SIZE, SPACING AND EMBEDMENT SHALL BE AS SPECIFIED IN THESE DRAWINGS, SEE TABLE 1, SHEET 7.
4. ALL INSTALLATION ANCHORS MUST BE MADE OF OR PROTECTED WITH A CORROSION RESISTANT MATERIAL OR COATING. DISSIMILAR METALS OR MATERIALS IN CONTACT WITH PRESSURE TREATED WOOD MUST BE PROTECTED TO PREVENT REACTION.
5. INSTALLATION ANCHORS SHALL BE IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS, AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM SPECIFIED IN TABLE 1, SHEET 7.
6. ANCHOR EMBEDMENT TO SUBSTRATE SHALL BE BEYOND WALL DRESSING OR STUCCO. FOR CONCRETE/CMU OPENINGS, EMBEDMENT SHALL BE BEYOND WOOD BUCKS, IF USED, INTO SUBSTRATE - 1X BUCKS ARE OPTIONAL.
7. A MINIMUM CENTER-TO-CENTER SPACING SHALL BE MAINTAINED BETWEEN ALL FASTENERS: 3" FOR MASONRY, 1" FOR WOOD AND METAL.
8. WOOD OR MASONRY OPENINGS, BUCKS AND BUCK FASTENERS SHALL BE PROPERLY DESIGNED BY THE ARCHITECT OR ENGINEER OF RECORD AND INSTALLED TO TRANSFER WIND LOADS TO THE STRUCTURE. SUBSTRATES SHALL MEET THE MINIMUM STRENGTH REQUIREMENTS AS SHOWN IN TABLE 1, SHEET 7. CONCRETE AND MASONRY SUBSTRATES MAY NOT BE CRACKED.
9. SEALING AND FLASHING STRATEGIES FOR OVERALL WATER RESISTANCE OF INSTALLATION SHALL BE DONE BY OTHERS FOLLOWING THE CURRENT VERSION OF THE REFERENCE DOCUMENTS: FMA/AAMA 100(FIN WINDOWS), FMA/AAMA 200(FLANGE WINDOWS), FMA/WDMA 250(BOX WINDOWS), FMA/AAMA/WDMA 300(EXTERIOR DOORS)

**410 PVC
 SINGLE HUNG
 NON-IMPACT**

PROPRIETARY AND CONFIDENTIAL
 THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF CUSTOM WINDOW SYSTEMS, INC. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT THE WRITTEN PERMISSION OF CUSTOM WINDOW SYSTEMS, INC IS PROHIBITED.

FLORIDA APPROVAL NO.:
 33429




10/2/2023
 LUCAS A. TURNER, P.E.
 FL PE # 58201
 Turner Engineering & Consulting, Inc.
 2428 Old Natchez Trc Trl
 Camden, TN 38320
 PH. 941-380-1574


SHEET DESCRIPTION:

INSTALLATION DETAILS


DRAWN BY: MCS	DATE: 9/20/2023
DWG #: PEL-935	REV.: A
SCALE: 1:2	SHEET 7 OF 7

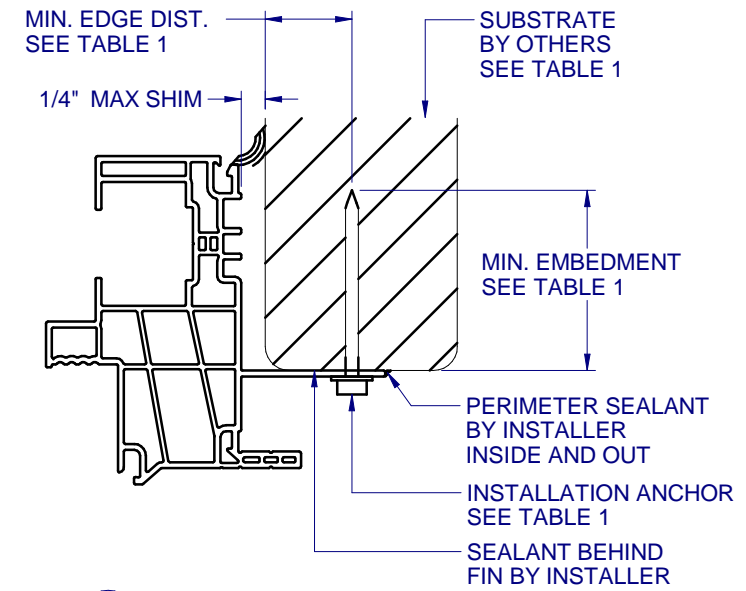


C HORIZONTAL SECTION
 7 TYPICAL FIN ANCHORAGE
 HEAD AND SILL SIMILAR FOR FIN INSTALLATION

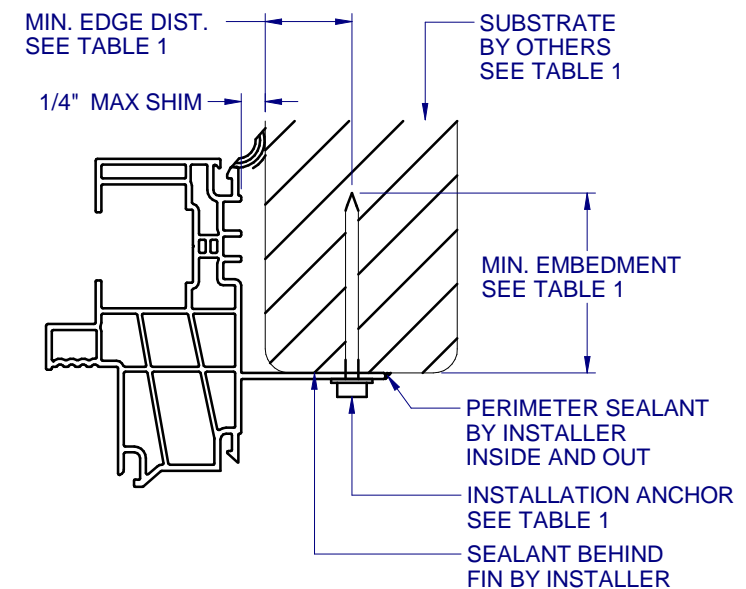


E HORIZONTAL SECTION
 7 TYPICAL FIN ANCHORAGE
 HEAD AND SILL SIMILAR FOR FIN INSTALLATION

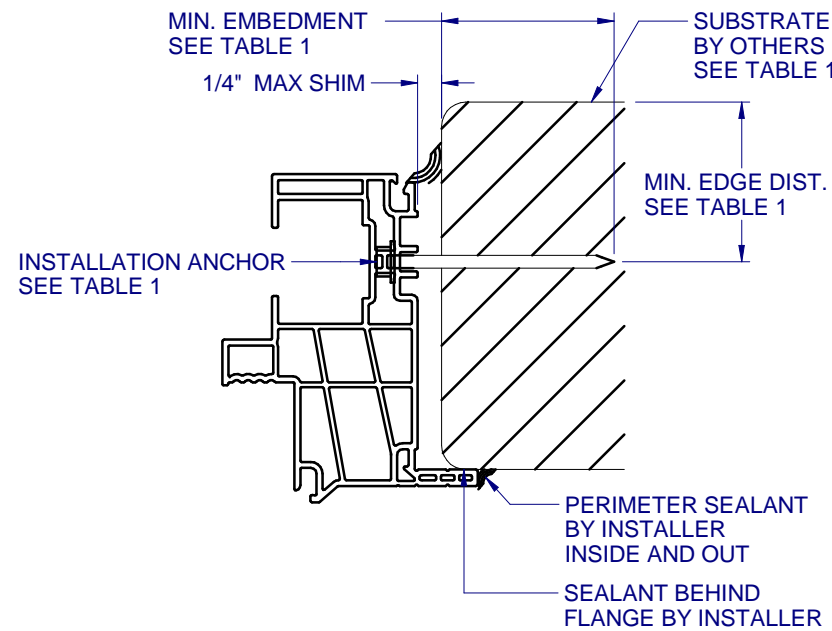


B HORIZONTAL SECTION
 7 TYPICAL JAMB ANCHORAGE

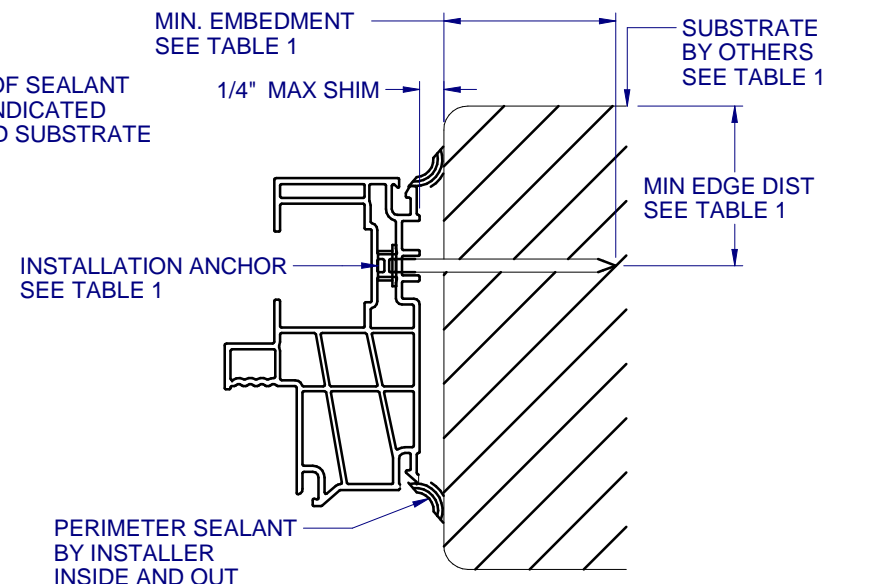

D HORIZONTAL SECTION
 7 BOX FRAME INSTALLATION
 SIMILAR FOR SILL AND JAMBS FOR BOX INSTALLATION

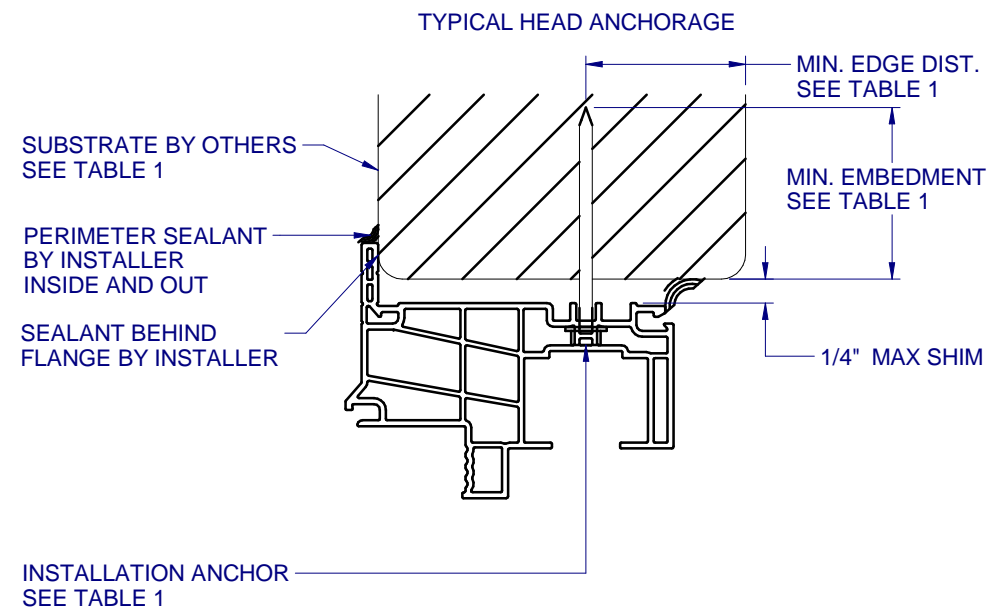

A VERTICAL SECTION
 7 TYPICAL SILL ANCHORAGE
 NO SILL ANCHORS REQUIRED

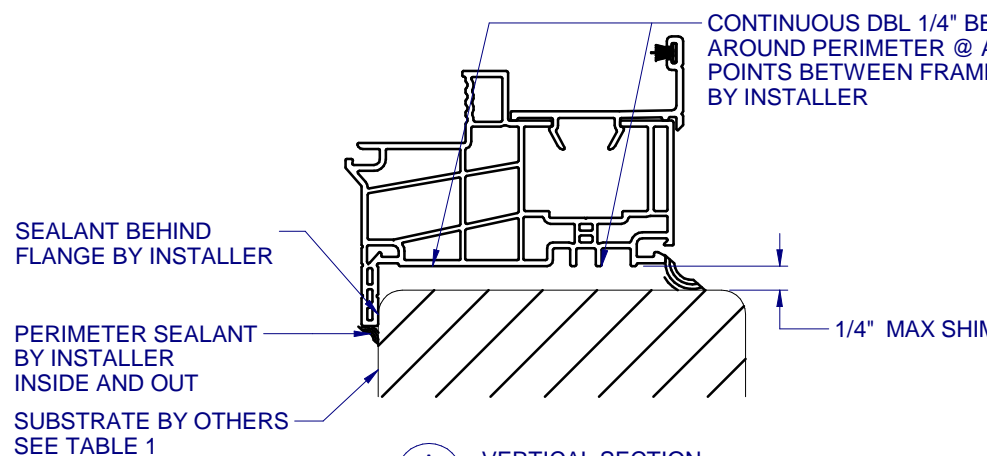

FRAME TYPE	SUBSTRATE TYPE	ANCHOR TYPE	MIN. EMBEDMENT	MIN. EDGE DIST.
FLANGE	CONCRETE (2.0 KSI MIN.)	3/16" ITW TAPCON	1"	1-1/8"
FLANGE	HOLLOW OR GROUT-FILLED CMU (117 PCF MIN.)	3/16" ITW TAPCON	1"	2"
FLANGE	CONCRETE (3.05 KSI MIN.)	3/16" DEWALT ULTRACON+	1-3/4"	1"
FLANGE	HOLLOW OR GROUT-FILLED CMU (ASTM C-90)	3/16" DEWALT ULTRACON+	1-1/4"	2-1/2"
FLANGE	2X MIN. SOUTHERN PINE (G=0.55)	3/16" ITW TAPCON OR DEWALT ULTRACON+	1-3/8"	7/8"
FLANGE	2X MIN. SOUTHERN PINE (G=0.55)	#10 WOOD SCREW	1-3/8"	7/8"
FLANGE	16 GAUGE (0.060") MIN. STEEL STUD (33 KSI YIELD MIN)	#10-16 HILTI KWIK-FLEX OR ITW TEKS SELF-DRILLING SCREW	FULL THREAD THRU 0.060"	7/16"
FLANGE	1/8" ALUM. (6063-T5 MIN.) OR 1/8" STEEL (33 KSI MIN.)	#10 GRADE 5 SELF-TAPPING / DRILLING SCREW	FULL THREAD THRU 0.125"	7/16"
FIN	2X MIN. SOUTHERN PINE (G=0.55)	#10 WOOD SCREW	1-1/2"	1/2"

NOTE: SLOPE SILL FRAME OPTION NOT SHOWN.

FLANGE REMOVAL NOTE: PARTIALLY OR FULLY REMOVING THE FLANGE, UP TO AND INCLUDING A BOX-FRAME APPLICATION IS ACCEPTABLE PROVIDED:

- MIN. 1/4" FILLET OF CONSTRUCTION-GRADE ADHESIVE CAULK IS APPLIED INSIDE AND OUT, FULL PERIMETER, BY INSTALLER.
- PRODUCT ANCHORAGE IS IN ACCORDANCE WITH REQUIREMENTS AS SHOWN FOR FLANGE WINDOWS.