



WOOD-#12 (0.216" DIAMETER) WOOD SCREWS, SERIES 300 STAINLESS STEEL, MIN. 2-1/2" PENETRATION, AND MINIMUM BENDING YIELD STRESS OF 80,000 PSI.  
 STEEL-1/4" DIAMETER SELF DRILLING SCREWS, SERIES 300 STAINLESS STEEL, WITH MINIMUM BENDING YIELD STRESS OF 70,000 PSI, INTO 1/4" THICK MINIMUM STEEL SUBSTRATE.  
 MASONRY BLOCK-1/4" DIAMETER ITW BUILDDEX SCOTS TAPCONS, WITH MINIMUM 1-1/4" EMBEDMENT, MINIMUM EDGE DISTANCE 4".  
 CONCRETE-1/4" DIAMETER ITW BUILDDEX SCOTS TAPCONS, WITH MINIMUM 1" EMBEDMENT, MINIMUM EDGE DISTANCE 4", INTO MINIMUM STRENGTH CONCRETE OF 2,000 PSI.

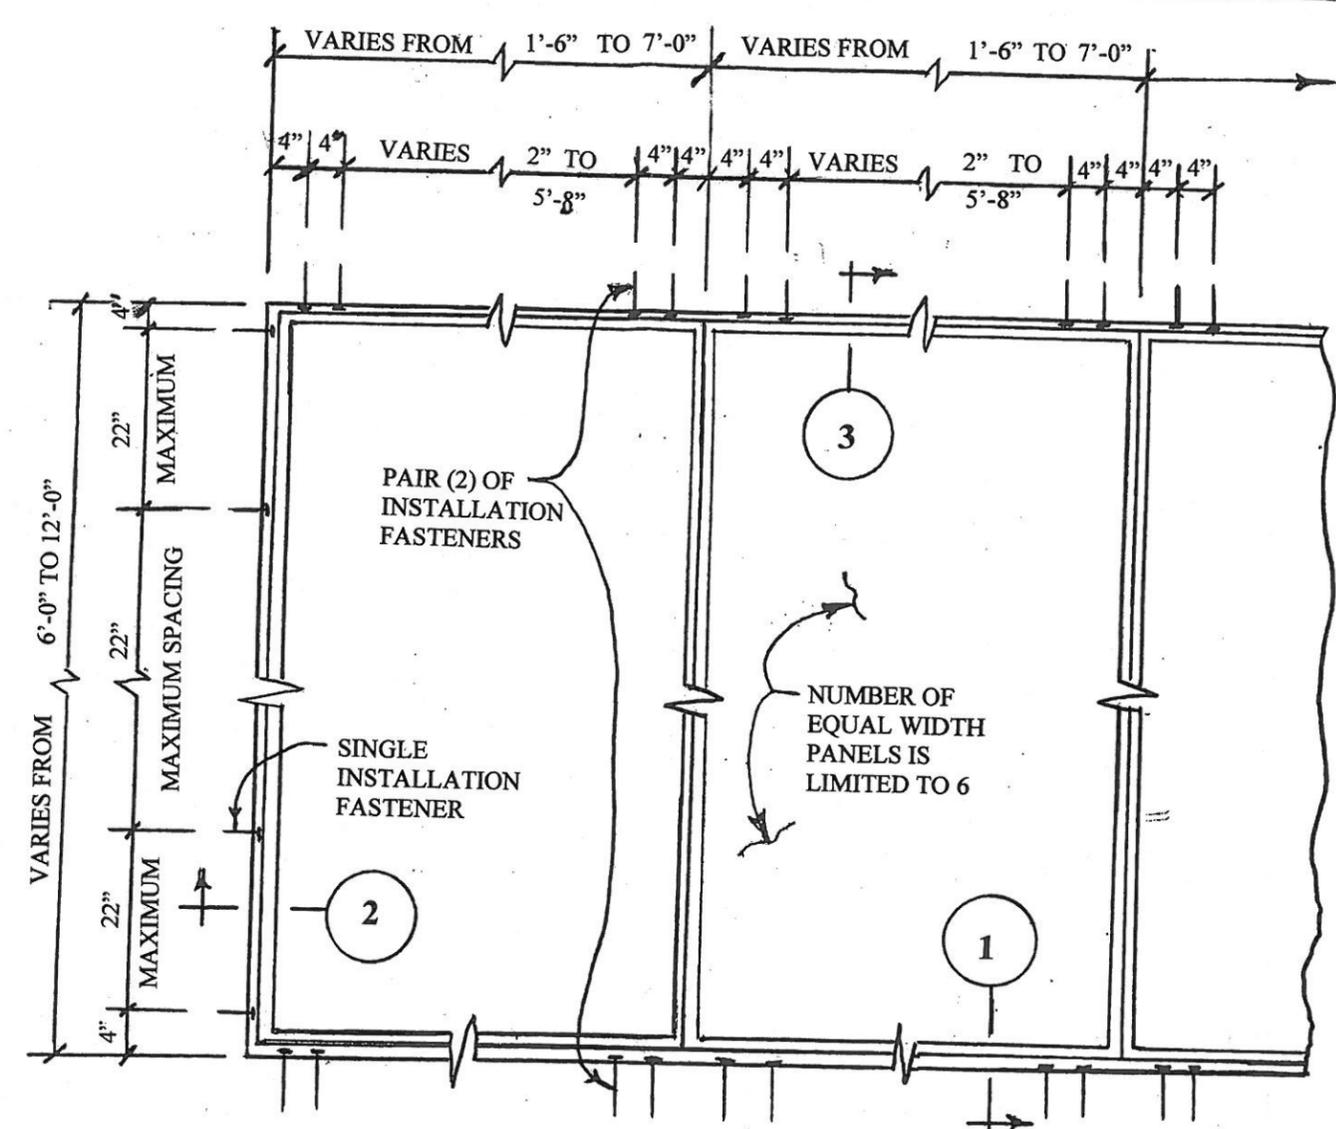

**ELEVATION VIEW - CERO II SYSTEM INSTALLATION**

**GENERAL NOTES**

- 1 FASTENER INSTALLATIONS SHOWN ON THIS SHEET ARE CAPABLE OF WITHSTANDING THE DESIGN WIND PRESSURES SHOWN ON THE CURVES IN THE FLORIDA EVALUATION REPORT WITH APPROPRIATE FACTORS OF SAFETY.
- 2 IF THE ROUGH OPENING IS GREATER THAN 3/8", SOLID WOOD BLOCKING MUST BE PROVIDED.

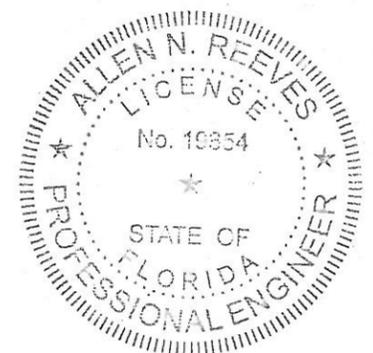

*Allen N. Reeves*  
5 MAR. 2021

Allen N. Reeves, P.E.	Structural Engineer	Florida License #19354
<b>HR Engineering, Inc.</b>	REV. 24 FEB 2021 DATE: 31 OCTOBER 2018	21020005 PROJECT NO. 18020002 SHEET 1 OF 1
CLIENT: NANA WALL SYSTEMS	BY: A. REEVES	PROJECT NAME: CERO II SYSTEM