

11/15/2021 2:58 PM

PH TECH CORP


S-8385 SLIDING PATIO DOOR (NON-HVHZ)(NON-IMPACT)



PH TECH CORP.
724 BRICKWORKS DRIVE
LEETSDALE, PA 15056
418-833-3231

GENERAL NOTES:

1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE CURRENT FLORIDA BUILDING CODE (FBC), **EXCLUDING** HVHZ AND HAS BEEN EVALUATED ACCORDING TO THE FOLLOWING:
 - AAMA/WDMA/CSA 101/I.S.2/A440-08/11/17
2. ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE/MASONRY, 2X AND METAL STUD FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
3. 1X AND 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
4. THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.
5. APPROVED IMPACT PROTECTIVE SYSTEM **IS REQUIRED** TO PROTECT THIS PRODUCT IN AREAS REQUIRING IMPACT RESISTANCE.
6. FRAME MATERIAL: UPVC
7. GLASS SHALL MEET THE REQUIREMENTS OF ASTM E1300. SEE GLAZING DETAILS ON SHEET 1.
8. DESIGNATIONS "X", "O" STAND FOR THE FOLLOWING:
X: OPERABLE PANEL
O: FIXED PANEL

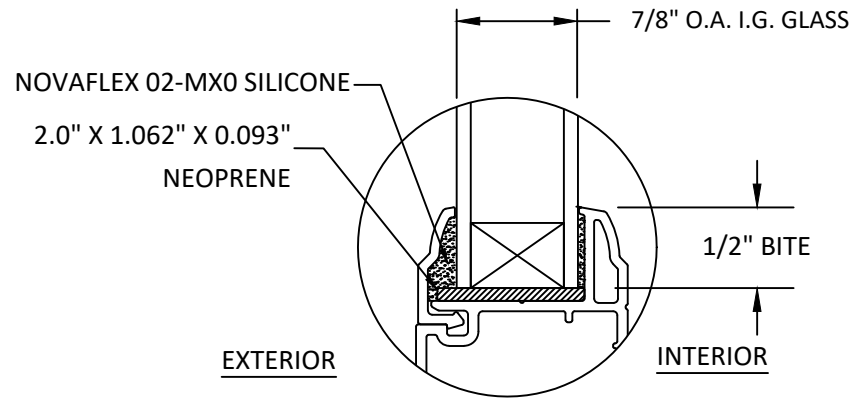

GLAZING DETAIL A

TABLE OF CONTENTS	
SHEET	SHEET DESCRIPTION
1	GENERAL NOTES AND GLAZING DETAILS
2	ELEVATION AND ANCHOR LAYOUT
3	VERTICAL SECTIONS
4	HORIZONTAL SECTIONS
5	ANCHOR DETAILS, ANCHOR SCHEDULE AND INSTALLATION NOTES

DESIGN PRESSURE TABLE			
CONFIGURATION	DESIGN PRESSURE	FRAME SIZES	MISSILE IMPACT RATING
XXO,OXX	+70/-70 PSF	117.5" x 81.875"	NON-IMPACT
XXO,OXX	+55/-55 PSF	143.5" x 95.5"	NON-IMPACT

- GLAZING NOTES:**
1. GLASS TYPE SHALL COMPLY WITH ASTM E1300 & FBC SAFETY REQUIREMENTS.
 2. SETTING BLOCKS TO BE LOCATED AT 1/4 SPAN LENGTH FOR GLASS WIDER THAN 36" AS PER FBC CHAPTER 24.
 3. SETTING BLOCK DUROMETER HARDNESS OF 70-90 (SHORE A) AS REFERENCED IN FBC CHAPTER 24.
 4. GLASS TYPE SHALL COMPLY WITH APPLICABLE GLAZING REQUIREMENTS PER CHAPTER 24 OF THE FBC

TITLE: PH TECH CORP
S-8385 SLIDING PATIO DOOR
(NON-HVHZ)(NON-IMPACT)
GENERAL NOTES AND GLAZING DETAILS

PREPARED BY: BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

HERMES F. NORERO, P.E.
FLORIDA P.E. No 73778
BUILDING DROPS, INC
398 E. DANIA BEACH BLVD. # 338
DANIA BEACH, FL 33004
FBPE CERT. OF AUTHORIZATION No. 29578

FL40259

DATE: 10.01.21

DWG. BY: AC	CHK. BY: SM
-------------	-------------

SCALE: NTS

DWG. #: PHT008

SHEET


1

OF 5


s:\projects\ph_tech_incl\fb-21-0908-fbc-submittal - s-7500_s-8750.dwg series s-8385\pht008.dwg



PH TECH CORP.
 724 BRICKWORKS DRIVE
 LEETSDALE, PA 15056
 418-833-3231

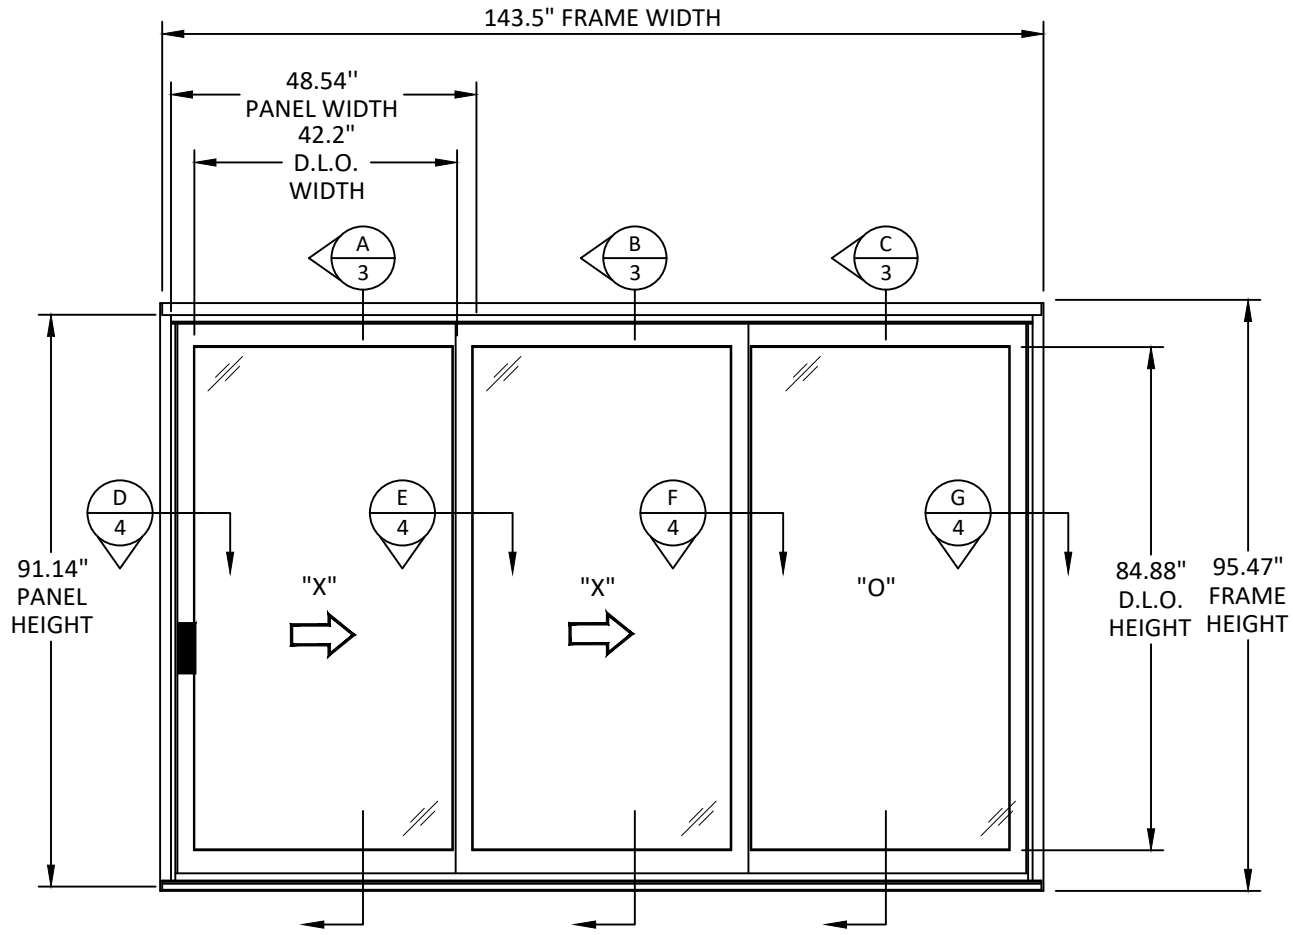

ELEVATION
 SLIDING DOOR

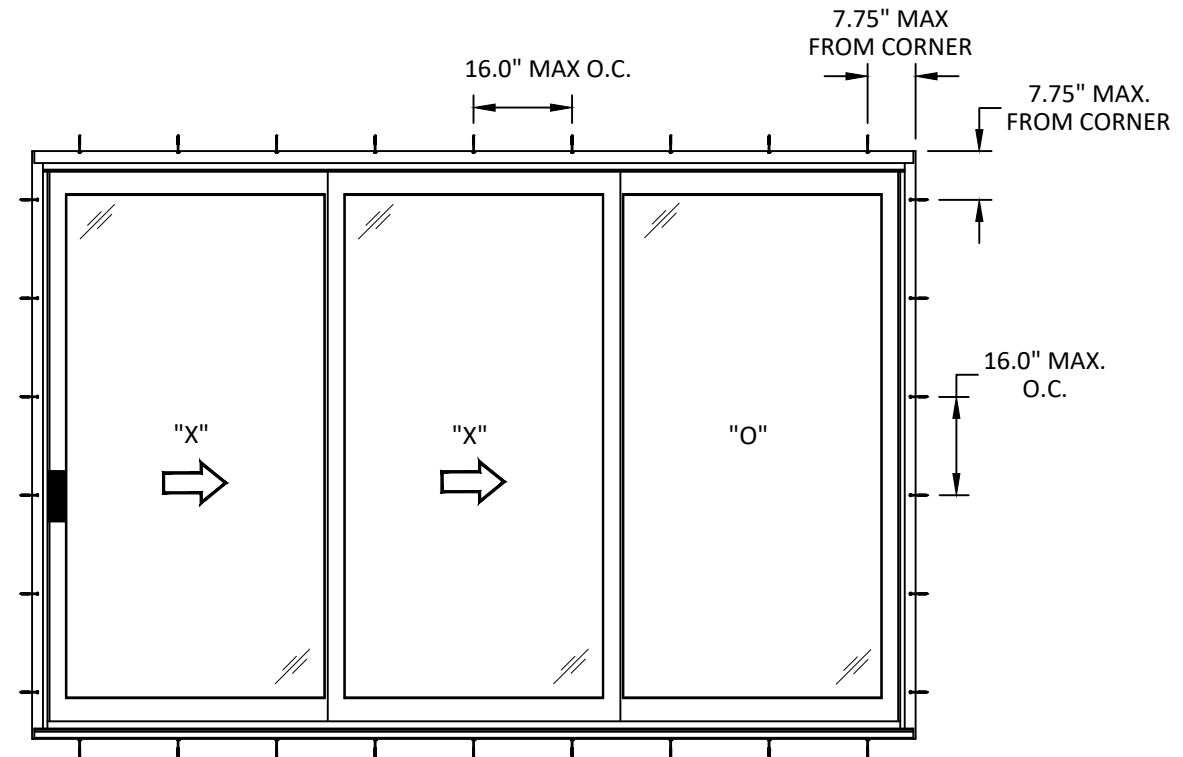

ANCHOR LAYOUT
 SLIDING DOOR
 THROUGH FRAME
 (OR STRAP ANCHOR AT SILL)
 (OR SEALANT AT SILL)

NOTE:

FOR MORE ANCHOR INFORMATION (INSTALLATION TYPE, SPACING, QUANTITY, ANCHOR TYPE, QUALIFIED SUBSTRATES) SEE SHEET 5.

TITLE: PH TECH CORP
 S-8385 SLIDING PATIO DOOR
 (NON-HVHZ)(NON-IMPACT)
 ELEVATION AND ANCHOR LAYOUT


PREPARED BY: BUILDING DROPS, INC.

398 E. DANIA BEACH BLVD., STE. 338
 DANIA BEACH, FL 33004
 PH: (954)399-8478
 FAX: (954)744-4738
 WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

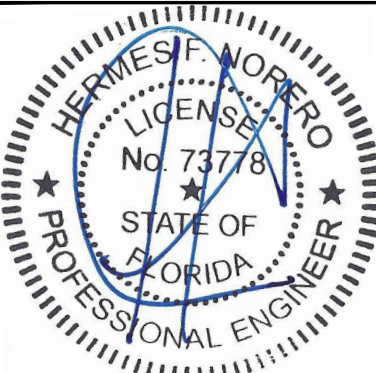

HERMES F. NORERO, P.E.
 FLORIDA P.E. No 73778
 BUILDING DROPS, INC
 398 E. DANIA BEACH BLVD. # 338
 DANIA BEACH, FL 33004
 FBPE CERT. OF AUTHORIZATION No. 29578

FL40259
DATE: 10.01.21
DWG. BY: AC
CHK. BY: SM
SCALE: NTS
DWG. #: PHT008

SHEET
 2
 OF 5

s:\projects\ph_tech\inc\fbcr-21-0908-fbc submittal - s-7500, s-8750, 8770, s-8375, s-8385, s-8500, s-8500, s-8500, s-8750, dwgs\series s-8385\pht008.dwg 11/15/2021 2:58 PM




PH TECH CORP.
724 BRICKWORKS DRIVE
LEETSDALE, PA 15056
418-833-3231

TITLE: PH TECH CORP
S-8385 SLIDING PATIO DOOR
(NON-HVHZ)(NON-IMPACT)
VERTICAL SECTIONS



PREPARED BY: BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE



THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

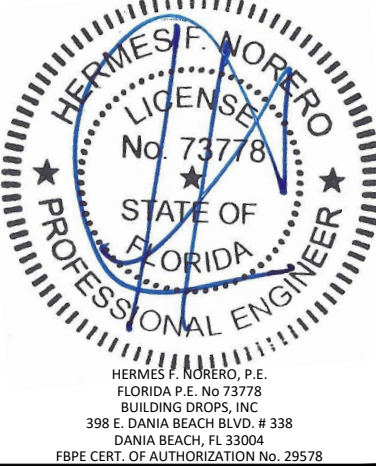



FL40259	
DATE:	10.01.21
DWG. BY:	AC
CHK. BY:	SM
SCALE:	NTS
DWG. #:	PHT008
SHEET	3

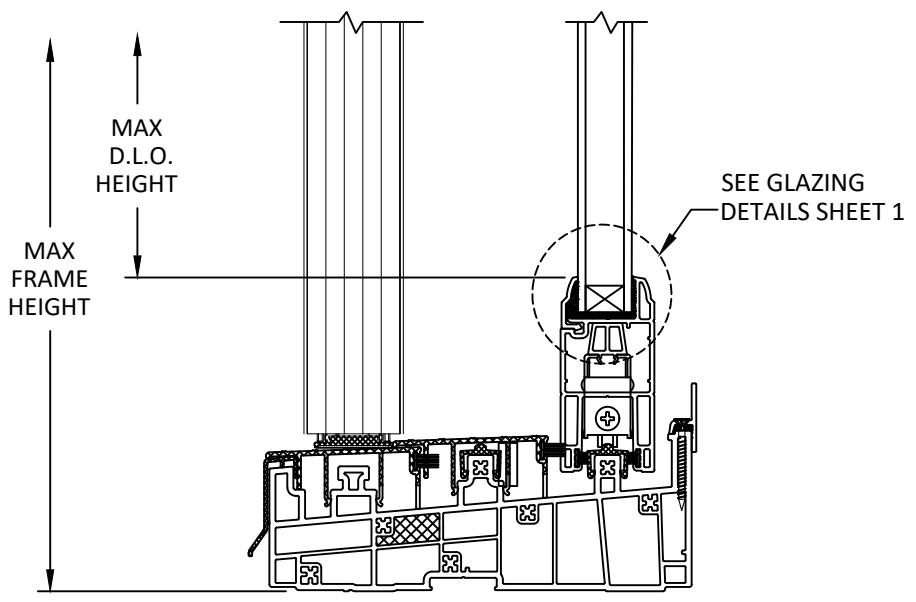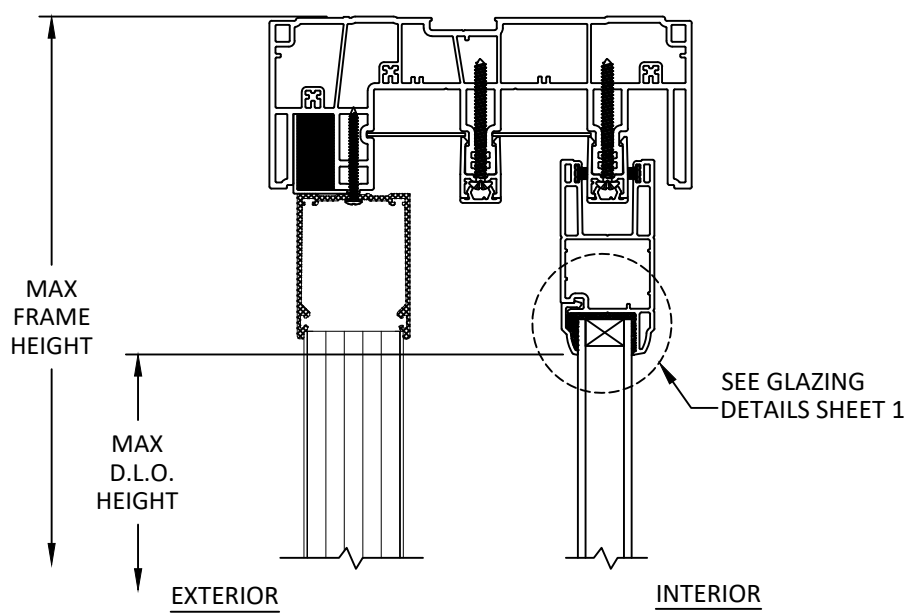

A
3 VERTICAL SECTION
OPERABLE PANEL

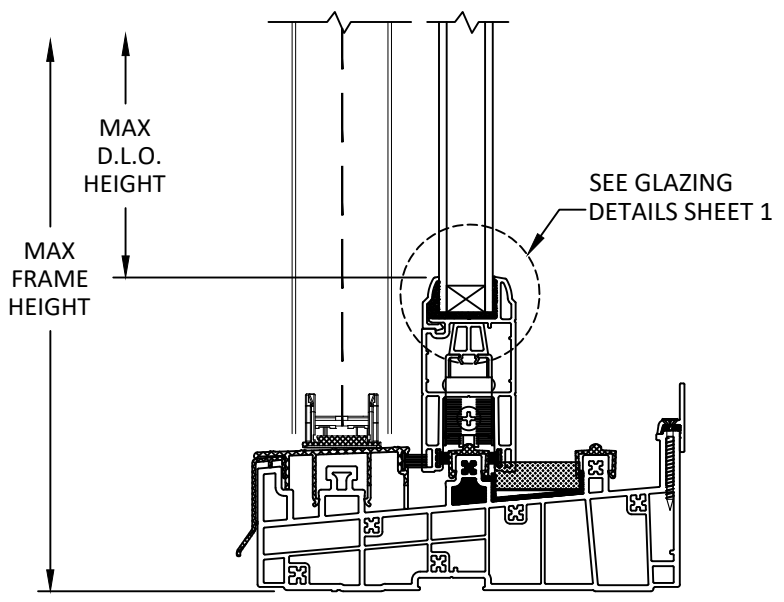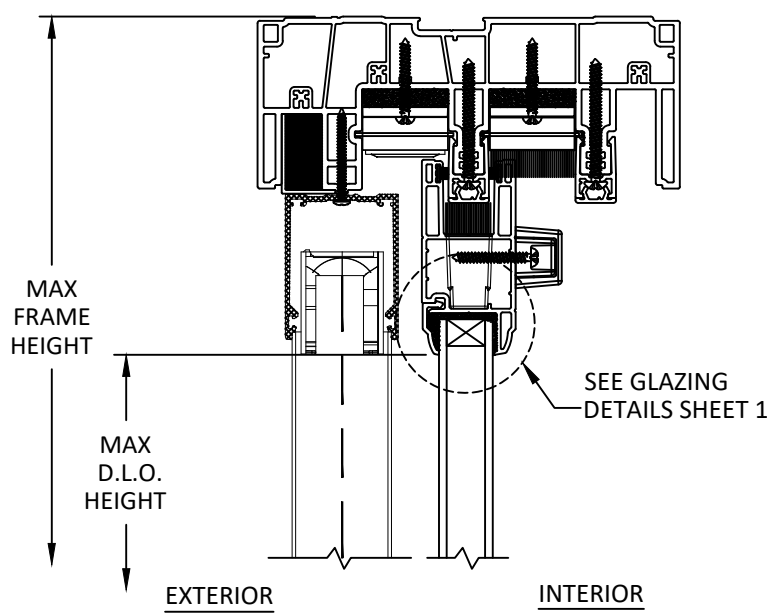


B
3 VERTICAL SECTION
OPERABLE PANEL

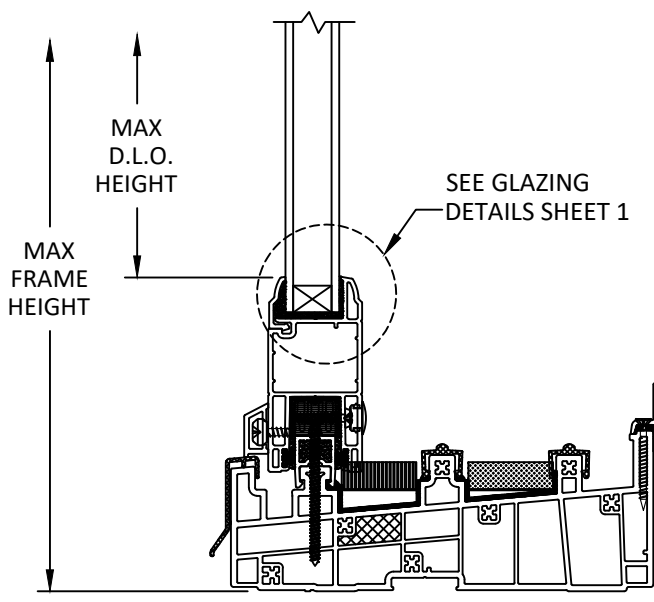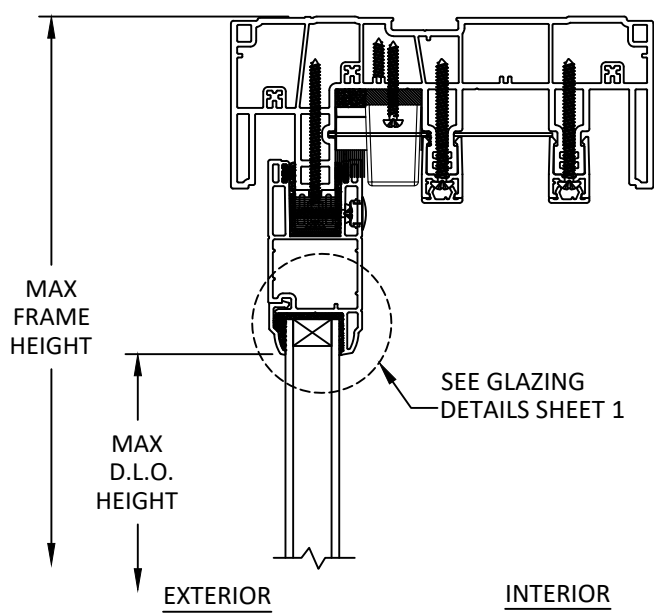


C
3 VERTICAL SECTION
FIXED PANEL

11/15/2021 2:58 PM
s:\projects\ph_tech_inc\fbz-21-0908_fbc_submittal - s-7500_s-8750.dwg\series s-8385\pht008.dwg


11/15/2021 2:58 PM

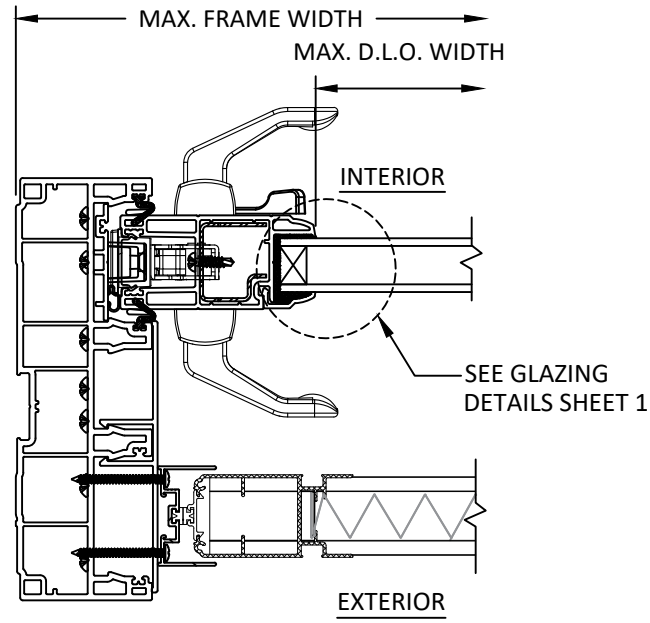


D
4 **HORIZONTAL SECTION**
LOCK JAMB

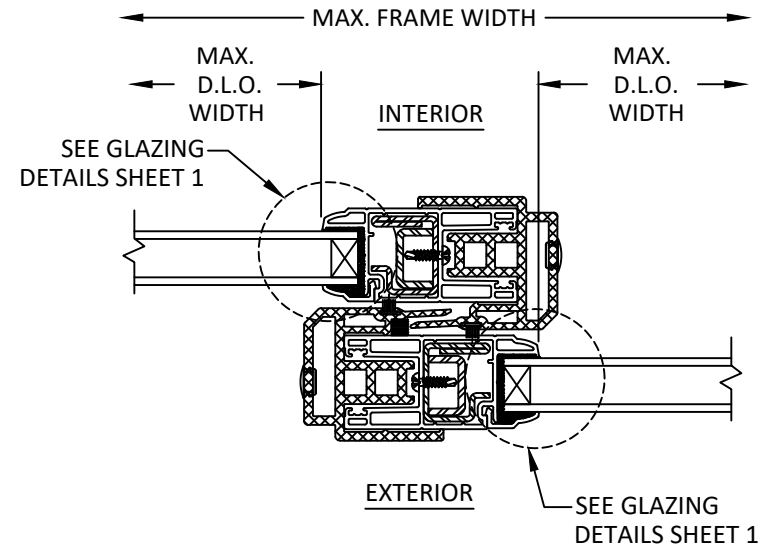

E
4 **HORIZONTAL SECTION**
INTERLOCK

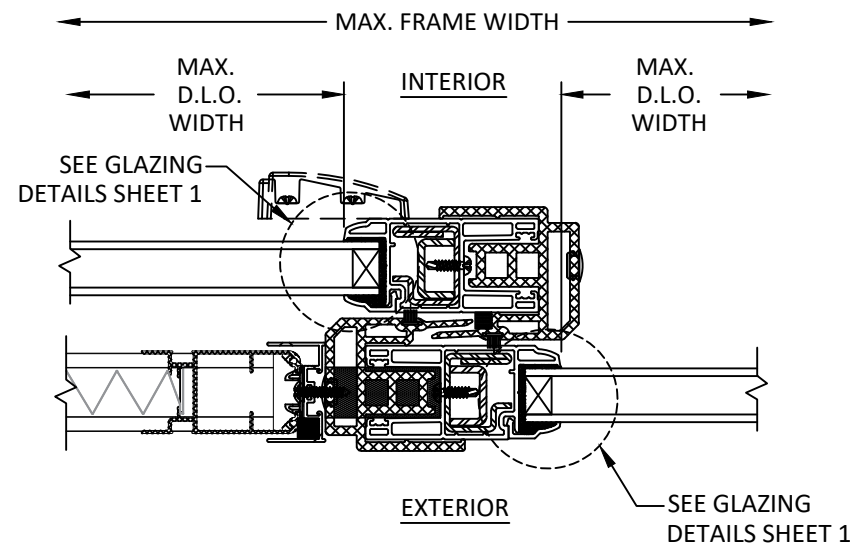

F
4 **HORIZONTAL SECTION**
INTERLOCK

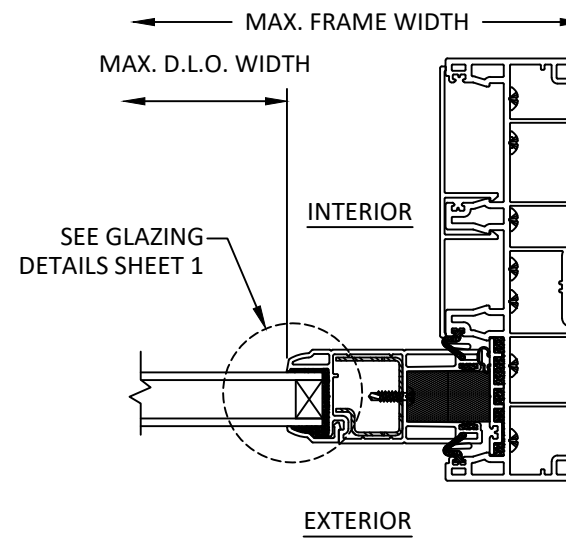

G
4 **HORIZONTAL SECTION**
FIXED JAMB




PH TECH CORP.
724 BRICKWORKS DRIVE
LEETSDALE, PA 15056
418-833-3231

TITLE: PH TECH CORP
S-8385 SLIDING PATIO DOOR
(NON-HVHZ)(NON-IMPACT)
HORIZONTAL SECTIONS

PREPARED BY:
BD
BUILDING DROPS
BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

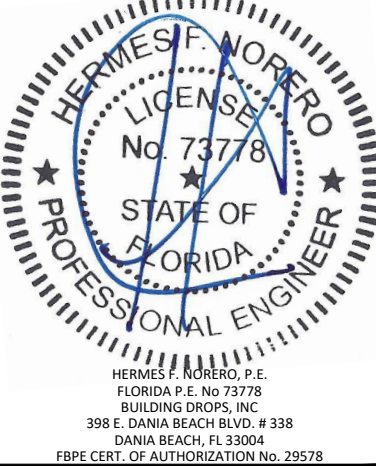


FL40259	
DATE:	10.01.21
DWG. BY:	AC
CHK. BY:	SM
SCALE:	NTS
DWG. #:	PHT008
SHEET	


4

s:\projects\ph_tech_incl\fbz-21-0908_fbc_submittal - s-7500_s-8750.dwg\series s-8385\pht008.dwg


11/15/2021 2:58 PM

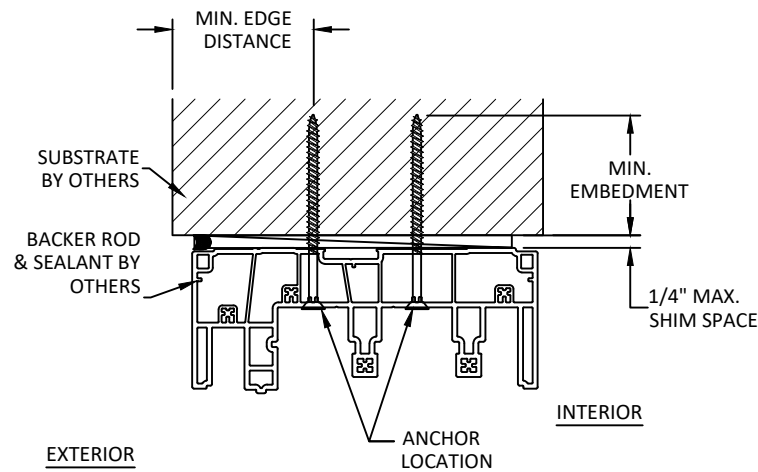


A
5
ANCHOR DETAIL
THROUGH FRAME

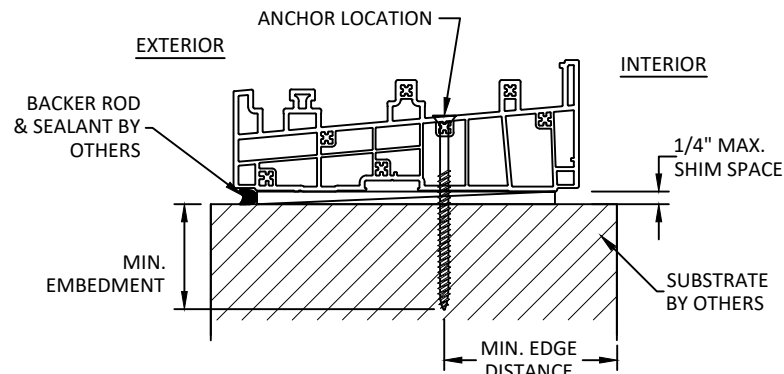


B
5
ANCHOR DETAIL
THROUGH FRAME

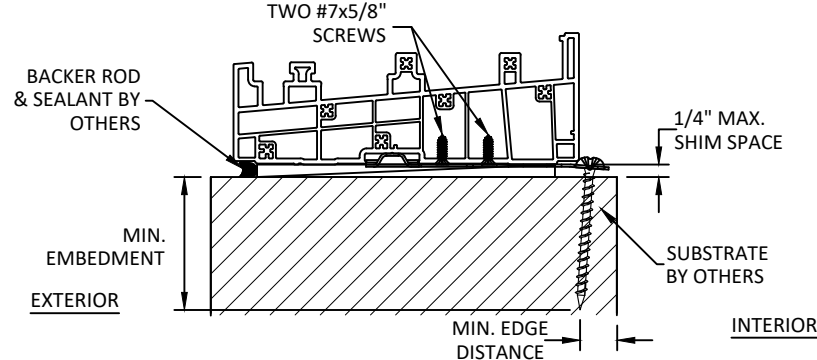

D
5
ANCHOR DETAIL
STRAP ANCHOR

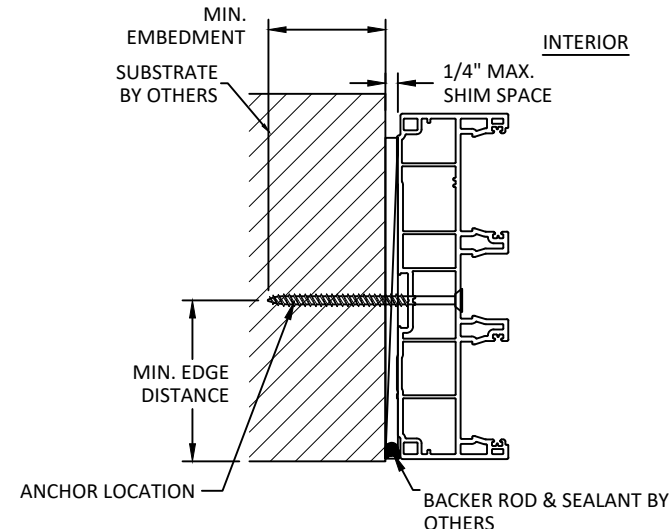

C
5
ANCHOR DETAIL
THROUGH FRAME

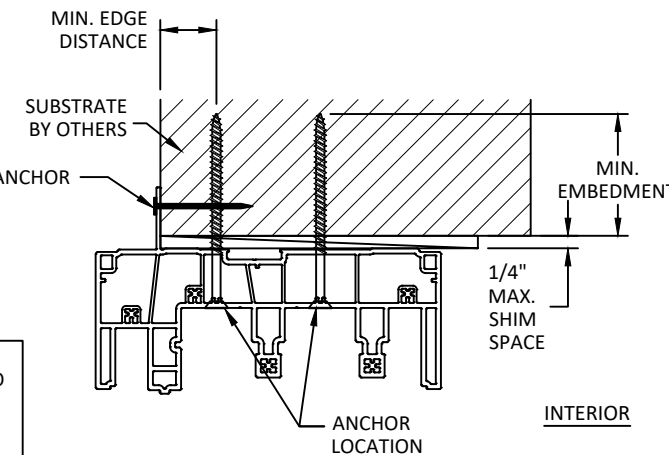

E
5
ANCHOR DETAIL
OPTIONAL NAIL FIN

NOTE :
NAIL FIN IS OPTIONAL IN ADDITION TO THE THROUGH OR STRAP ANCHOR

FOR NAIL FIN INSTALLATION:
USE #11 GALVANIZED STEEL NAILS,
#6D GALVANIZED STEEL NAILS, OR
#6 WOOD SCREWS
8\"/>

INSTALLATION NOTES:

- TWO (2) INSTALLATION ANCHORS ARE REQUIRED SHOWN AT HEAD .
- ONE (1) INSTALLATION ANCHOR IS REQUIRED AS SHOWN AT JAMB & SILL.
- FOR MASONRY OR CONCRETE OPENINGS, A 1X WOOD BUCK MAY BE USED (OPTIONAL) AS LONG AS THE MINIMUM EMBEDMENT AND EDGE DISTANCE REQUIREMENTS ARE STILL MET WITHIN THE CORRESPONDING HOST SUBSTRATE. SEE GENERAL NOTE #3 ON SHEET 1 FOR MORE INFORMATION.
- THE NUMBER OF INSTALLATION ANCHORS DEPICTED IS THE MINIMUM NUMBER OF ANCHORS TO BE USED FOR PRODUCT INSTALLATION OF THE MAXIMUM SIZE LISTED.
- INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF ±1/2 INCH THE DEPICTED LOCATION & SPACING IN THE ANCHOR LAYOUT DETAILS (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
- SHIM AS REQUIRED AT EACH ANCHOR LOCATION WHERE SPACE BETWEEN PRODUCT AND STRUCTURE IS 1/16 INCH OR GREATER. MAXIMUM ALLOWABLE SHIM STACK IS NOT TO EXCEED 1/4 INCH. ALL SHIMS ARE TO BE LOADED BEARING, HIGH DENSITY PLASTIC OR BETTER.
- MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES, INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICK VENEER, AND SIDING.
- INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING.
- FOR HOLLOW BLOCK AND GROUT FILLED BLOCK, DO NOT INSTALL INSTALLATION ANCHORS INTO MORTAR JOINTS. EDGE DISTANCE IS MEASURED FROM FREE EDGE OF BLOCK OR EDGE OF MORTAR JOINT INTO FACE SHELL OF BLOCK.
- INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS, AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BY THE ANCHOR MANUFACTURER.

ANCHOR SCHEDULE				
METHOD	SUBSTRATE	ANCHOR	MIN. EMBEDMENT	MIN. EDGE DISTANCE
THROUGH FRAME	2X WOOD MIN. S.G.= 0.55	#10 WOOD SCREW	1.500	0.750
	GROUT FILLED CMU PER ASTM C-90 W/ MIN. f'c=2,000 PSI	3/16 ITW TAPCON (CARBON OR STAINLESS STEEL)	1.000	2.500
	CONCRETE W/ MIN. f'c = 3,000 PSI		1.250	2.500
	METAL: 18 GAUGE STEEL, MIN. Fy = 33 KSI	#10-24 GR. 5 SMS OR SELF-DRILLING SCREW	3 THREADS MIN PENETRATION BEYOND METAL	0.750
ANCHOR STRAP	2X WOOD MIN. S.G.= 0.55	#10 WOOD SCREW	1.500	0.750
	CONCRETE W/ MIN. f'c = 3,000 PSI	3/16 ITW TAPCON (CARBON OR STAINLESS STEEL)	1.250	2.500



PH TECH CORP.
724 BRICKWORKS DRIVE
LEETSDALE, PA 15056
418-833-3231


TITLE: PH TECH CORP
S-8385 SLIDING PATIO DOOR
(NON-HVHZ)(NON-IMPACT)
ANCHOR DETAILS, ANCHOR SCHEDULE AND
INSTALLATION NOTES

PREPARED BY:
BD
BUILDING DROPS

BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

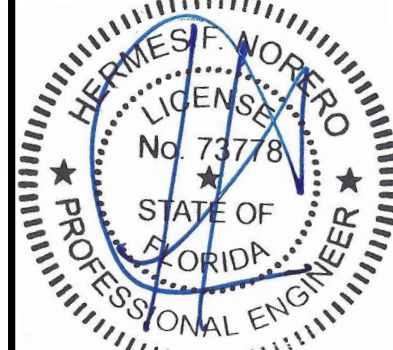

HERMES F. NORERO, P.E.
FLORIDA P.E. No 73778
BUILDING DROPS, INC
398 E. DANIA BEACH BLVD. # 338
DANIA BEACH, FL 33004
FBPE CERT. OF AUTHORIZATION No. 29578

FL40259

DATE: **10.01.21**

DWG. BY: **AC** CHK. BY: **SM**

SCALE: **NTS**

DWG. #: **PHT008**

SHEET
5
OF 5