Locke Bowden, P.E.

Dixieland Metals of Alabama

9450 Alysbury Place

Montgomery, AL 36117

378 Eastland Road Dothan, Alabama 36304

FL 4149

Quality Assurance Program: PRI/CMT Category: Roofing Sub-Category: Metal Roofing Method 1-D

Code: FBC 2017 6th ed.; Sections: 1504, 1506.6, 1507

Description	Substrate	Design Uplift Pressure*		Fasteners		
PBR	Min. 15/32" APA Plywood	-56.75psf	1 ¼" rib	Corrosion Resistant: Fastener #9-15 x 1 ½" HWH		
26GA	@ 24" o.c.	fastening pattern 12"-	height @	Woodgrip w/ sealing washing or equal.		
36" width	Non-structural	12"-12" @ 24" o.c.	12" o.c.	1/2-14 x 7/8" Lap screw w/ sealing washer @24" o.c. in		
80.0 ksi	Plywood fasten to supports @		thru	panel side laps. Paint finish optional. ¼" min. penetration		
Non-HVHZ	24" o.c.		fastened	through plywood. Min. Slope shall comply with FBC 2017.		
	Underlayment-see Limitations			Slopes less than 3:12, sealant must be used in side laps.		
1 ¾" Snap Lock	Min. 15/32" APA Plywood	-64.25psf @24" O.C,	1-3/4" rib	Corrosion Resistant: Fastener (2) #10-13GP Concealer		
26GA	fasten to supports @ 24" o.c.	2 fasteners per clip	height	Clip: name DMP 175.SL FIXED Paint finish optional.		
14" width	Standing seam Non-structural	@ 24" o.c.		"x" min. penetration through plywood. Min. Slope shall		
50.0 ksi	Plywood over supports 24" o.c.			comply with FBC 2017. Slopes less than 3:12, sealant must		
Non-HVHZ	Underlayment-see Limitations			be used in side laps.		
TUFF Rib	Min. 15/32" APA Plywood@	-86.75psf fastening pattern	¾" rib	Corrosion Resistant: Fastener #10-16 HWH Woodgrip		
26GA	24" o.c.	9"-9"-9"-9"@ 24"o.c.	height	w/sealing washer. ¼" min. penetration through		
36" width	Non-structural	-146 psf fastening pattern	@9"o.c.	plywood. Paint finish optional. Min. Slope shall comply		
80 ksi	Plywood faten to supports	6.5"-2.5"-6.5"-2.5"-6.5"-	thru	with FBC 2017. For slopes less than 3:12, sealant must		
Non HVHZ	@24" o.c.	2.5"-6.5"@12" o.c.	fastened	be used in side laps.		
	Underlayment-see Limitations			Install per manufacturer instructions		
Tuff Rib	Over 1x4 SYP wood purlins over	-45 psf @ 24"o.c.	¾" rib thru	Corrosion Resistant: Fastener #10-16 HWH Woodgrip		
min. 29GA	one layer of asphalt shingles		fastened	w/sealing washer. ¼" min. penetration through		
over 1x 4 wood purlins	(optional) over min 7/16" OSB	-157.5 psf @12"o.c.		plywood.		
Min 80 ksi	or min 15/32" APA plywood			Paint finish optional. Min. Slope shall comply with FBC		
Non HVHZ	fasten to supports @ 24" o.c.			2017. For slopes less than 3:12, sealant must be used in		
	Underlayments-see Limitations			side laps. Install per manufacturer instructions		
7/8" Nailstrip 24GA		-56.0psf, 15 9/16"o.c.	Female Rib:	Corrosion Resistant: Fastener: (1) #10-9 x 1"		
16" Coverage 50ksi	15/32" APA Plywood, Plywood	spacing	7/8" tall snap	Concealor Ultra Low Profile Type A		
Non-Structural	fasten to supports at max	-108.5psf 5 3/16"o.c.	lock rib	3/16" min penetration thru plywood		
NON HVHZ	24"o.c. spacing	spacing	male Rib: ¾"			
0.0	Underlayment-see Limitations		tall rib w/slot			
			strip			
			5-3/16" o.c.			

*Design Pressures includes margin of safety - 2.1

Dasg. Tressures moraces margin of sujety 212					
Reference Entities	Report #	Standard Year			
Force Engineering & Testing (TST-5328)	#92-0348T-06L	UL 580-941/1897-982) (20061/20122)			
Force Engineering & Testing (TST-5328)	#92-0348T-06G	UL 580-94 ¹ /1897-98 ²) (2006 ¹ /2012 ²)			
Force Engineering & Testing (TST-5328)	#92-0348T-06A, E	UL 580-94 ¹ /1897-98 ²) (2006 ¹ /2012 ²)			
PRI Construction Material Technologies (TST5878)	# FAE-019-02-01	UL580-06/UL1897-042)(2004/20122)			
Force Engineering & Testing (TST-5328)	#383-0076T-10 C, D	UL 580-941/1897-98 ²) (2006 ¹ /2012 ²)			

- 1. The UL580-94 test standards are equivalent to the UL580-06 test standard.
- The UL1897-98, 04 test standards are equivalent to the UL1897-12 test standard.
- The FM 4471-95 test standards are equivalent to the FM 4471-1992 test standard.

Limitations:


- Underlayment to be compliance with current Florida Building Code 2017, Chapter 15 Chart 1507.1.1 1.
- Minimum slope compliant with Florida Building Code 2017, and in accordance with Manufacturer's recommendations.
- Products are compliant for State of Florida product approval per Rule 61G20-3 Compliance Method: 1-D
- Fire classification is not part of this acceptance. Shear diaphragm values are outside this report.
- Installation details attached herein.
- 6. All support framing compliant with Florida Building Code 2017, Chapter 22 Steel, Chapter 23 Wood and Chapter 16 Structural Loading.
- 7. This report does not imply warranty, installation, recommended product use outside of this report.

Compliance Statement: These products herein evaluated by Locke Bowden, P.E. have demonstrated compliance with the Florida Building Code 2017 with referenced documents submitted.

Certificate of Independence

Locke Bowden, P.E. does not have, not will acquire a financial interest in any company manufacturing or distributing products under this Locke Bowden, P.E. is not owned, operated or controlled by any company manufacturing or distributing products under this the


> Locke Bowden: P.E. Florida Reg. No. 49704



Dixieland Metals of Alabama Install Details per specifications

All Fasteners Must Be Corrosion Resistant In Compliance w/FBC 2017

For Metal Roofing Category use Fastener:# 10-16 HWH Woodgrip w/sealing Washer



29GA Tuff RIB

-45 psf @ 24"o.c.

-157.5 psf @12"o.c.

Side laps fastened together w/ 1/4-14 x 7/8" HWH SD w/ sealer washer at 24" o.c.

26GA Tuff Rib

-86.75psf fastening pattern 9"-9"-9"-9"@ 24"o.c.

-146 psf fastening pattern @9"o.c. 6.5"-2.5"-6.5"-2.5"-6.5"-2.5"-6.5"


For Roof Deck Category USE Fastener: #12-14 HWH SD w/sealing washer

<u> 26GA</u>

-96.8psf fastening pattern 9"-9"-9"-9" @ 2'-0" o.c. *

29GA

-84.3psf fastening pattern 9"-9"-9"-9" @ 2'-0" o.c. *

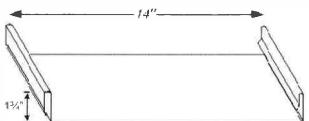


Metal Roofing USE (2) # 10-13GP Concealer

-64.25psf @24" O.C, 2 fasteners per clip @ 24" o.c.

Clips: DMP 175.SL Fixed

Snap Lock 26GA 1.75

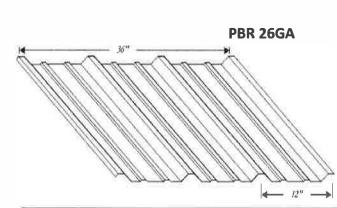

- 36" PBR

Roof Deck USE #12-14 HWH SD w/sealing washer

-47.5psf fastening pattern 12"-12"-12" @ 5'-0" o.c.

+60.0psf fastening pattern 12"-12"-12" @ 5'-0" o.c.

Metal Roofing USE #9-15 Woodgrip w/sealing washer

-56.75psf

fastening pattern 12"-12"-12" @ 24" o.c.

Side laps fastened together w/ 1/4 - 14 x 7/8" HWH SD w/ sealer washer at 20" o.c.

$\frac{7}{8}$ " NAILSTRIP 24 GA. 16" WIDE OVER MINIMUM $\frac{15}{32}$ " PLYWOOD

main field fastening 15- 9/16" perimeter and corner 5-3/16"

