



RECORD U.S.A. INC.
4324 PHIL HARGETT COURT
P.O. BOX 3099
MONROE, NC 28111
PHONE: 1-866-237-2687

RECORD
WINDCORD 5400/5500 SLIDING DOOR SYSTEM
BI-PARTING AND SINGLE SLIDING
FIXED SIDELITE

Revisions			
Rev	Description	Date	Approved
1	Initial Release		CBG

GENERAL NOTES:

1. THIS PRODUCT HAS BEEN TESTED PER TAS 201, 202, & 203. IT MEETS ALL OF THE REQUIREMENTS OF THE CURRENT EDITION OF THE FLORIDA BUILDING CODE FOR USE OUTSIDE OF THE HIGH VELOCITY HURRICANE ZONE. GLASS TYPE 1 IS LARGE AND SMALL MISSILE IMPACT RESISTANT. GLASS TYPES 4 & 5 ARE NON-IMPACT AND REQUIRE AN IMPACT RESISTANT SHUTTER SYSTEM IN WINDBORNE DEBRIS REGIONS.
2. MAX. DESIGN PRESSURES ARE LISTED ON SHEET 4.
3. THIS DOOR SYSTEM IS NOT TESTED OR RATED FOR WATER INFILTRATION RESISTANCE. IT IS INTENDED FOR USE ONLY IN LOCATIONS WHERE WATER INFILTRATION RESISTANCE IS NOT REQUIRED OR WHERE IT IS PROTECTED BY AN OVERHANG MEETING THE REQUIREMENTS OF FBC SECTION 1709.5.1.
4. OPENING SUBSTRATES, WOOD BUCKS (OPTIONAL), AND WOOD BUCK FASTENERS ARE BY OTHERS AND MUST BE DESIGNED AND INSTALLED PER FBC REQUIREMENTS TO SAFELY TRANSFER THE LOADS FROM THIS SYSTEM TO THE BUILDING STRUCTURE. SUBSTRATES SHALL MEET THE MINIMUM STRENGTH REQUIREMENTS LISTED IN THE ANCHOR CHART ON SHEET 13.
5. ANCHOR TYPE, SIZE, SPACING, AND EMBEDMENT SHALL BE AS LISTED IN THE ANCHOR CHART ON SHEET 13, AND AS DETAILED IN THESE DRAWINGS. ANCHOR EMBEDMENT IN SUBSTRATE SHALL BE BEYOND WALL DRESSING OR STUCCO.
6. ALL FASTENERS PENETRATING INTO PRESSURE TREATED WOOD SHALL BE CAPABLE OF PREVENTING CORROSION DUE TO REACTION WITH PRESSURE TREATMENT CHEMICALS.
7. THE 4/3 INCREASE IN ALLOWABLE STRESS FOR SHORT-TERM LOADING HAS NOT BEEN USED IN THE DESIGN OF THIS SYSTEM. THE 1.6 Cd FACTOR HAS BEEN USED IN THE ANALYSIS OF WOOD SCREWS ONLY.
8. DISSIMILAR MATERIALS THAT COME INTO CONTACT SHALL BE PROTECTED TO PREVENT GALVANIC REACTIONS IN ACCORDANCE WITH FBC CHAPTERS 20 AND 23.

SYSTEM NOTES:

9. ALL ALUMINUM PARTS SHALL BE 6063-T5 ALUMINUM ALLOY AND TEMPER, UNLESS OTHERWISE NOTED.
10. FOR GLAZING DETAILS, SEE SHEET 5.
11. THE GLAZING MATERIALS IN BOTH FIXED AND SLIDING PANELS OF ALL SLIDING DOORS MUST COMPLY WITH THE REQUIREMENTS IN THE PERFORMANCE SPECIFICATIONS AND METHODS OF TEST FOR SAFETY GLAZING MATERIALS USED IN BUILDINGS, PER FBC REQUIREMENTS.
12. THIS SYSTEM HAS NOT BEEN TESTED PER ANSI Z97.1.

CORNER CONSTRUCTION:

13. FRAME CORNERS ARE SQUARE CUT AND MECHANICALLY FASTENED AT THE HEAD WITH M6x30 SCREWS USING A BEAM END PLATE (SEE SHEET 12),
14. PANEL CORNERS ARE SQUARE CUT AND MECHANICALLY FASTENED AT EACH CORNER USING ANTI-TWIST BRACKETS, THEN REINFORCED WITH (2) FULL WIDTH 3/8" THREADED TIE IN THE TOP AND BOTTOM RAILS.


Sheet

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14
- 15
- 16

Description

- General Notes
- Bi-Part Elevation, Jamb Anchoring Locations
- Single Slide Elevation, Jamb Anchoring Locations
- Design Pressure Charts
- Glazing Details
- Bi-Part Section Views
- Bi-Part Head and Sill Anchoring Locations
- Single Slide Section Views
- Single Slide Head and Sill Anchoring Locations
- Door Connections and Head Section Views
- Muntin Details, Locking Details
- Frame Connection Details
- Threshold Anchoring Details, Installation Anchor Table
- Head and Jamb Anchoring Details
- Profiles
- Bill of Materials


DESIGN PRESSURE	IMPACT RATING
SEE TABLES ON SHEET 4	SEE TABLES ON SHEET 4 AND GLAZING DETAILS ON SHEET 5

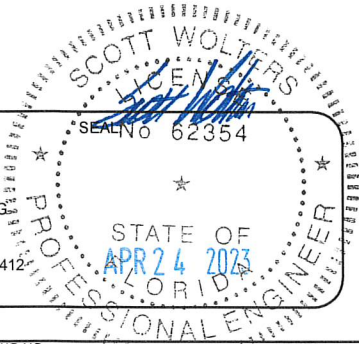


SCOTT WOLTERS
FL PE# 62354

WOLTERS ENGINEERING
(COA# 27194)
15211 97TH ROAD N
WEST PALM BEACH, FL 33412
PH/FAX: (561) 225-1982

	DWG NO.	1023671
	DRAWN BY	DBN
	DATE	4/24/23
	SHEET DESCRIPTION	SHEET NO. 1 OF 16



Revisions			
Rev	Description	Date	Approved
1	Initial Release		CBG

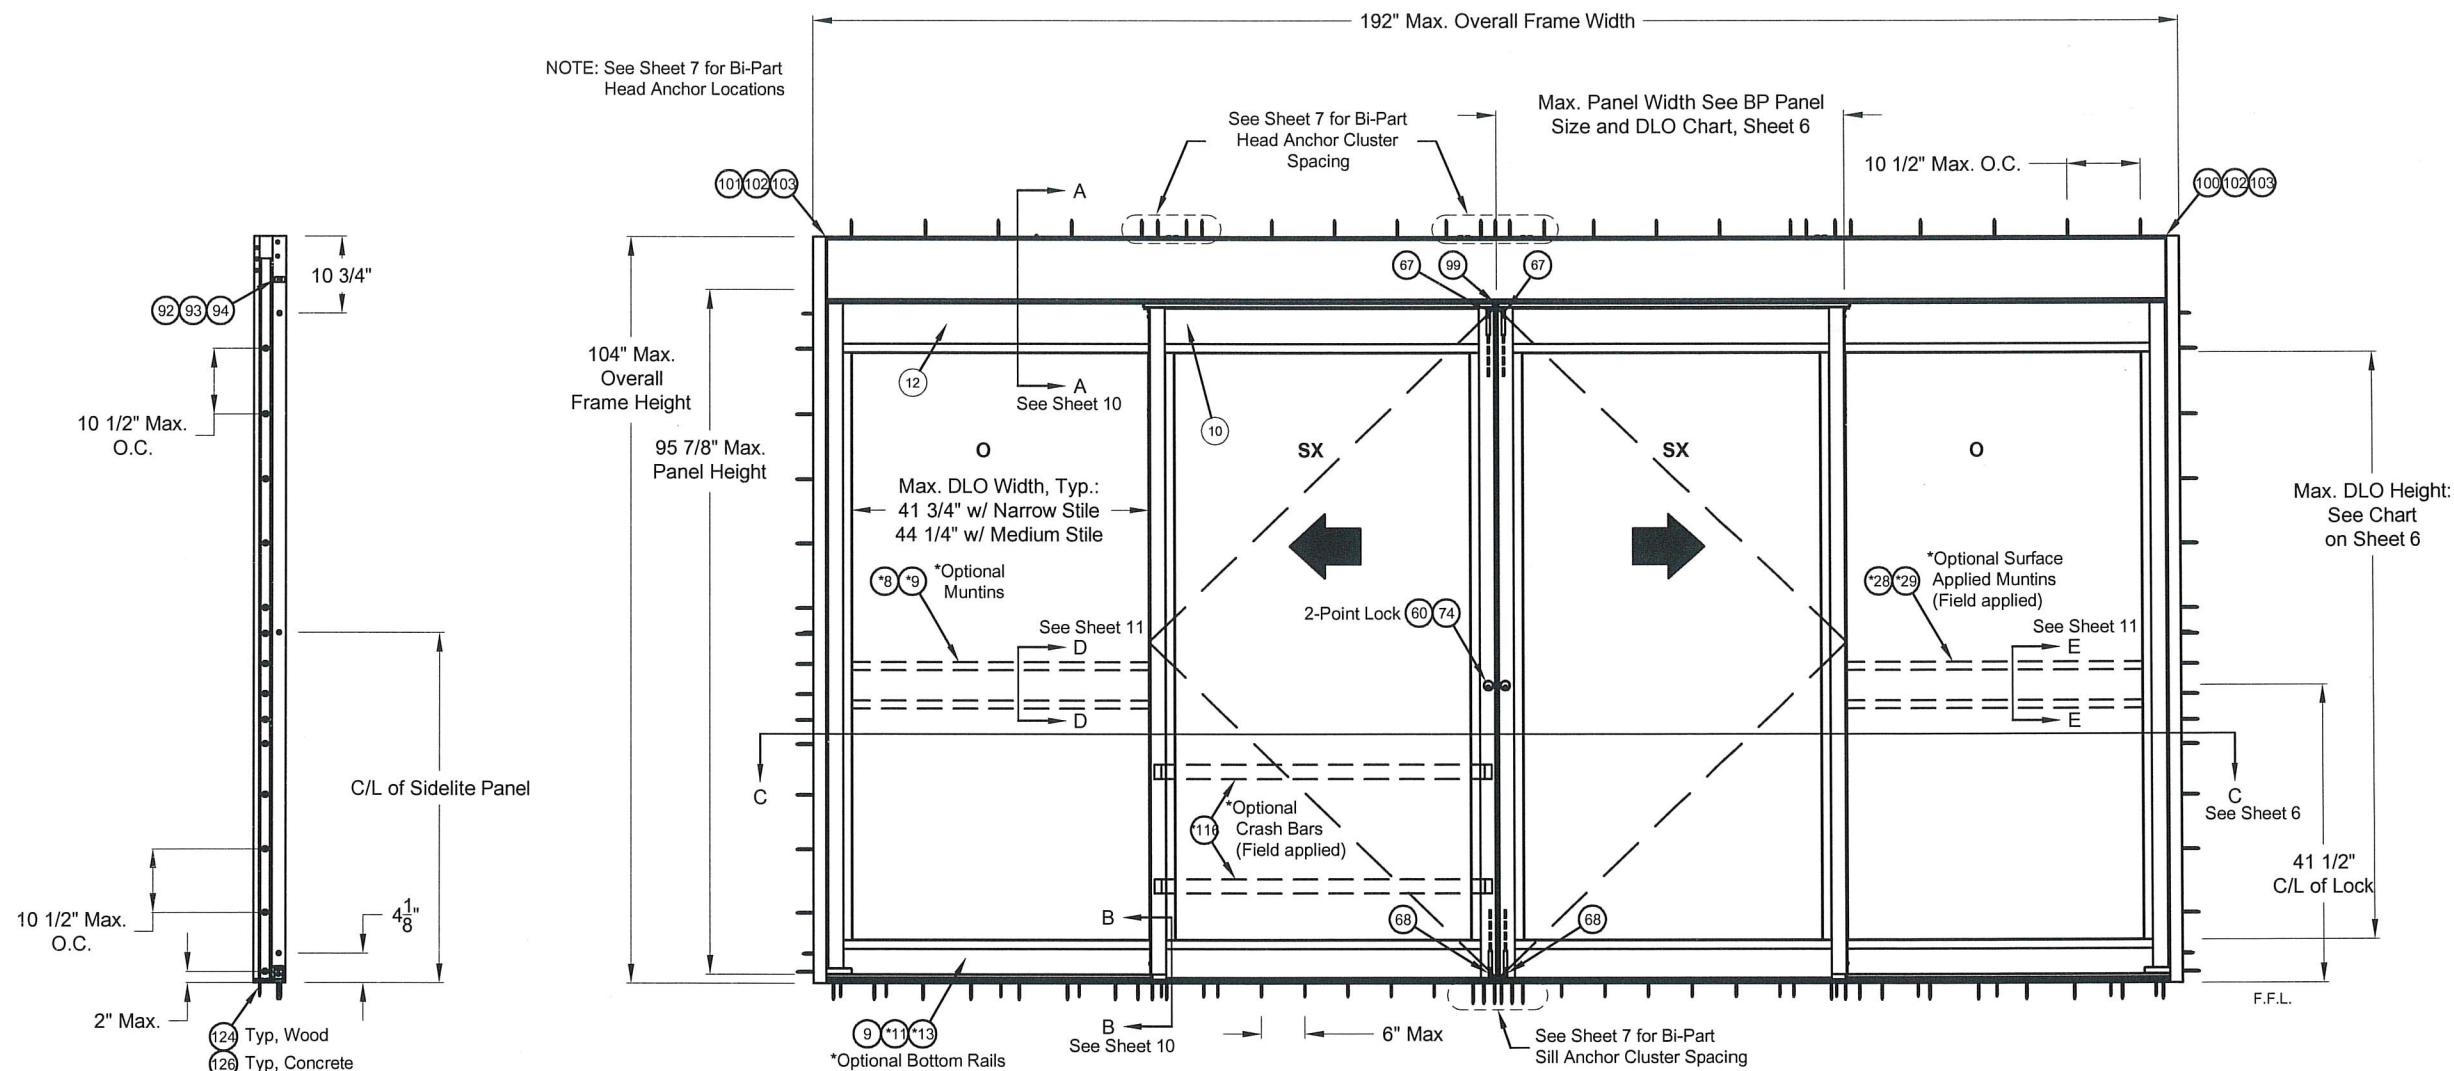


SIDELITE JAMB
(Typ. both Jambs)

BP FSL (4 PANELS, BI-PART FIXED SIDELITE)

Daylight Opening (DLO) Width Formulas	
Narrow Stile	Panel Width - 7"
Medium Stile	Panel Width - 10 1/2"

Daylight Opening (DLO) Height Formulas	
4" Bottom Rail	OFH - 21 5/8"
7" Bottom Rail	OFH - 24 5/8"
10" Bottom Rail	OFH - 27 5/8"

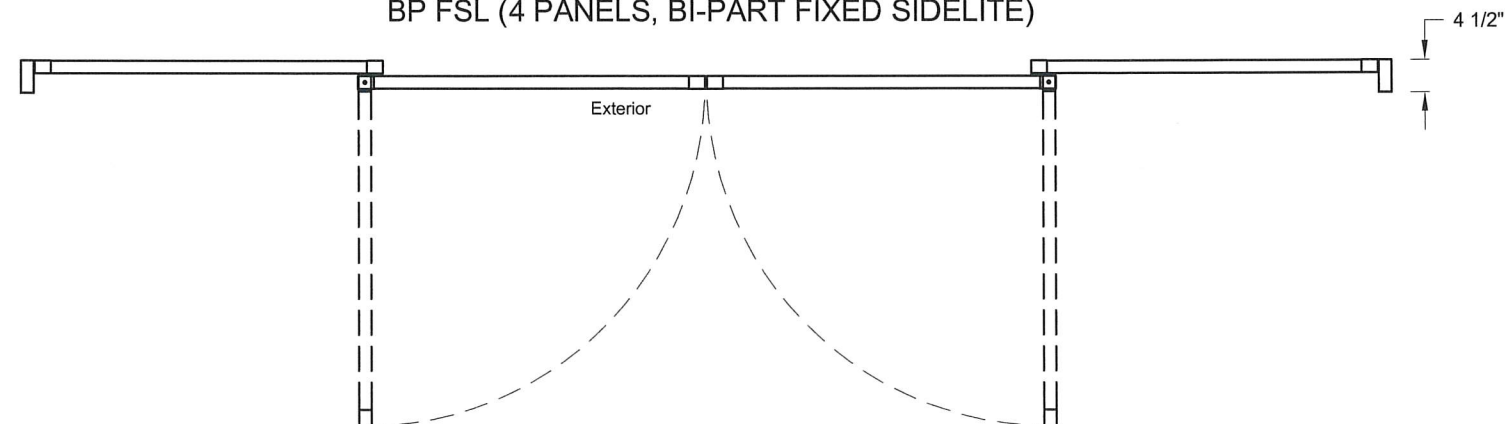

SCOTT WOLTERS
FL PE# 62354

WOLTERS ENGINEERING
(COA# 27194)
15211 97TH ROAD N
WEST PALM BEACH, FL 33412
PH/FAX:(561) 225-1982

SCOTT WOLTERS
 LICENSED PROFESSIONAL ENGINEER
 SEAL
 No 62354
 STATE OF FLORIDA
 APR 24 2023


DWG NO.		1023671
DRAWN BY DBN		DATE 4/24/23
SHEET DESCRIPTION		SHEET NO. 2 OF 16




RECORD U.S.A. INC.
4324 PHIL HARGETT COURT
P.O. BOX 3099
MONROE, NC 28111
PHONE: 1-866-237-2687

RECORD
WINDCORD 5400/5500 SLIDING DOOR SYSTEM
BI-PARTING AND SINGLE SLIDING
FIXED SIDELITE

Revisions			
Rev	Description	Date	Approved
1	Initial Release		CBG

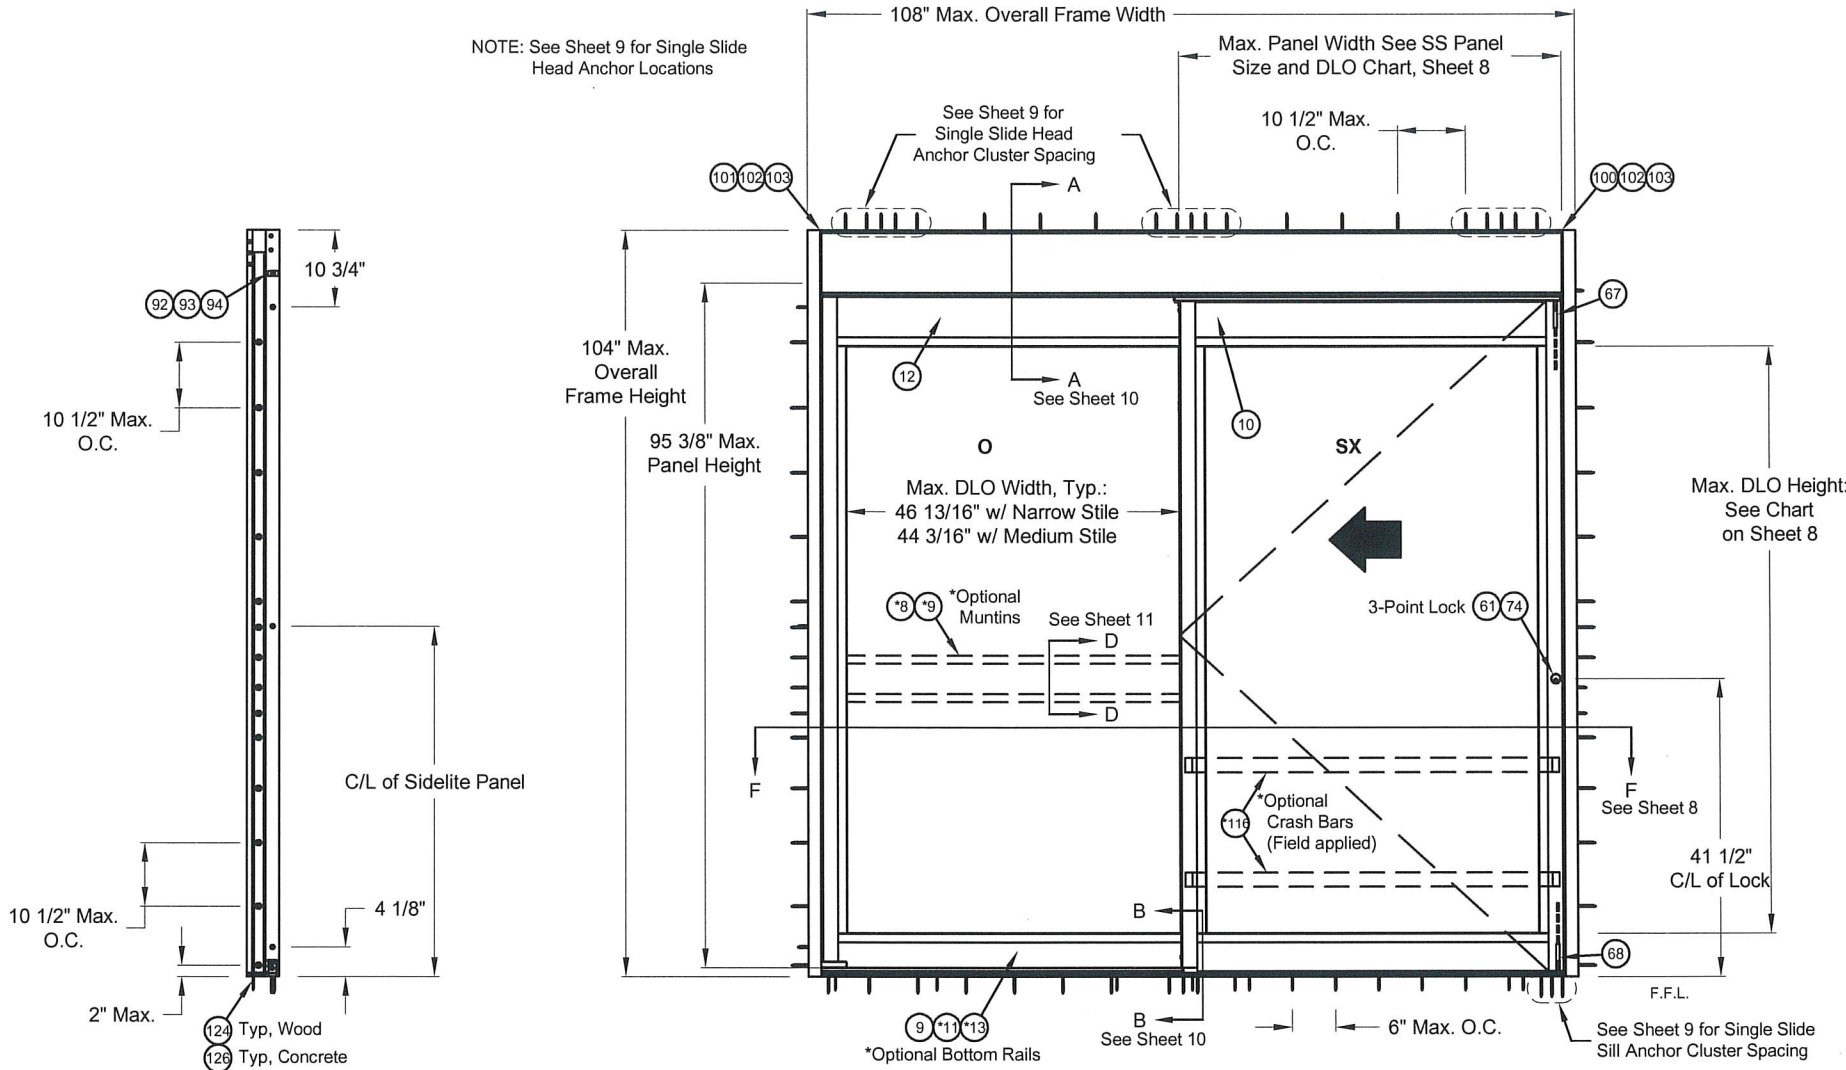


SIDELITE JAMB

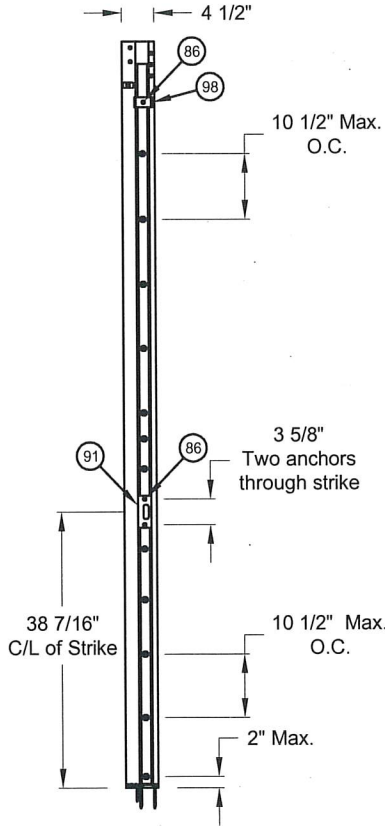

ACTIVE JAMB

LH FSL (2 PANELS, LEFT-HAND FIXED SIDELITE)

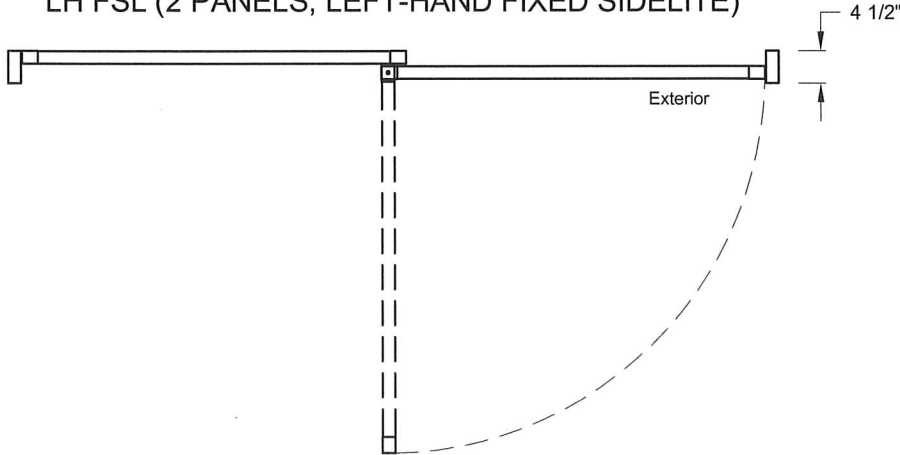

Daylight Opening (DLO) Width Formulas	
Narrow Stile	Panel Width - 7"
Medium Stile	Panel Width - 10 1/2"

Daylight Opening (DLO) Height Formulas	
4" Bottom Rail	OFH - 21 5/8"
7" Bottom Rail	OFH - 24 5/8"
10" Bottom Rail	OFH - 27 5/8"

SCOTT WOLTERS
FL PE# 62354

WOLTERS ENGINEERING
(COA# 27194)
15211 97TH ROAD N
WEST PALM BEACH, FL 33412
PH/FAX:(561) 225-1982

SCOTT WOLTERS
LICENSED PROFESSIONAL ENGINEER
STATE OF FLORIDA
APR 24 2023

DWG NO.	1023671
DRAWN BY	DBN
DATE	4/24/23
SHEET DESCRIPTION	
SHEET NO.	3 OF 16



RECORD U.S.A. INC.
4324 PHIL HARGETT COURT
P.O. BOX 3099
MONROE, NC 28111
PHONE: 1-866-237-2687

RECORD
WINDCORD 5400/5500 SLIDING DOOR SYSTEM
BI-PARTING AND SINGLE SLIDING
FIXED SIDELITE

Revisions			
Rev	Description	Date	Approved
1	Initial Release		CBG

SINGLE SLIDE -MAXIMUM DESIGN PRESSURE				
GLASS TYPE	IMPACT RATING	LOCKING HARDWARE	MAX. FRAME SIZE (W x H)	MAX. DESIGN PRESSURE (psf)
GLASS TYPE 1	LMI - MISSILE D	3 PT. LOCK	108" x 104"	75
GLASS TYPES 4 & 5	NON-IMPACT**	3 PT. LOCK	108" x 104"	75

**SHUTTERS ARE REQUIRED FOR WINDBORNE DEBRIS REGIONS

BI-PARTING -MAXIMUM DESIGN PRESSURE				
GLASS TYPE	IMPACT RATING	LOCKING HARDWARE	MAX. FRAME SIZE (W x H)	MAX. DESIGN PRESSURE (psf)
GLASS TYPE 1	LMI - MISSILE D	4 PT. LOCK	192" x 104"	70
GLASS TYPES 4 & 5	NON-IMPACT**	4 PT. LOCK	192" x 104"	70

**SHUTTERS ARE REQUIRED FOR WINDBORNE DEBRIS REGIONS

SCOTT WOLTERS
FL PE# 62354

WOLTERS ENGINEERING
(COA# 27194)
15211 97TH ROAD N
WEST PALM BEACH, FL 33412
PH/FAX:(561) 225-1982

SCOTT WOLTERS
FL PE# 62354

STATE OF
FLORIDA
APR 24 2023

	DWG NO.	1023671
	DRAWN BY	DBN
	DATE	4/24/23
SHEET DESCRIPTION		SHEET NO. 4 OF 16



RECORD U.S.A. INC.
4324 PHIL HARGETT COURT
P.O. BOX 3099
MONROE, NC 28111
PHONE: 1-866-237-2687


RECORD
WINDCORD 5400/5500 SLIDING DOOR SYSTEM
BI-PARTING AND SINGLE SLIDING
FIXED SIDELITE

Revisions			
Rev	Description	Date	Approved
1	Initial Release		CBG

Glass Type 1
9/16" LAMINATED GLASS

9/16" Laminated 'D' Impact Glass
(.590" actual)

1/4" Heat Strengthened Glass
.090" Sentryglas Interlayer
by Kuraray
1/4" Heat Strengthened Glass

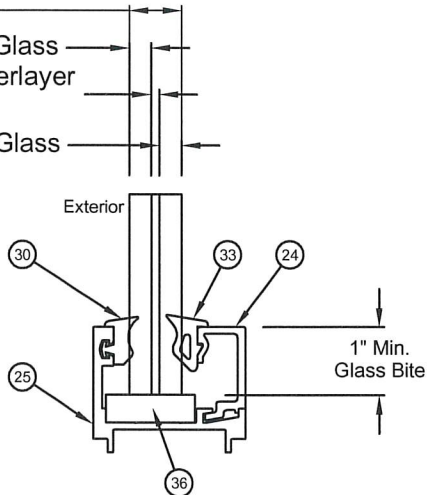


FBC 2411.3.3.1
Compliant Setting Blocks
80 Durometer Neoprene
2 per Glass Edge

LEVEL D
LARGE AND SMALL MISSILE IMPACT

Glass Type 4
1/4" TEMPERED GLASS

1/4" Fully Tempered
(.250" actual)

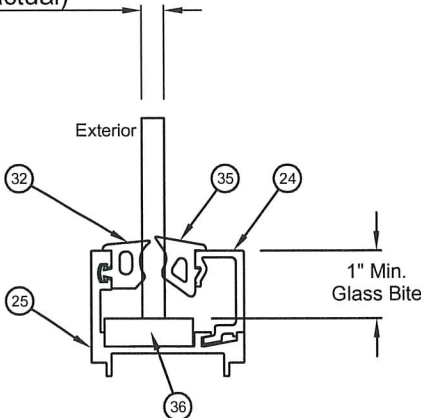


FBC 2411.3.3.1
Compliant Setting Blocks
80 Durometer Neoprene
2 per Glass Edge

Glass Type 5
1" INSULATED TEMPERED GLASS

1" O.A. Insulated Glass
(1" actual)

1/4" Tempered Glass
1/2" Air Gap with Low Profile
Aluminum Ramapo Spacer
1/4" Tempered Glass

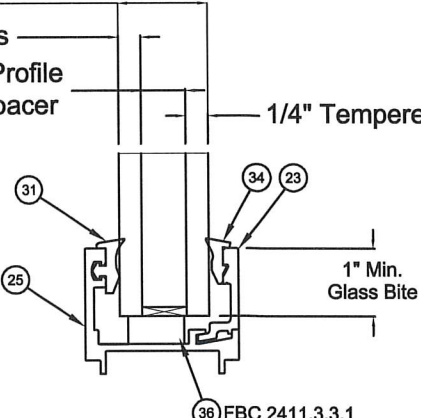

FBC 2411.3.3.1
Compliant Setting Blocks
80 Durometer Neoprene
2 per Glass Edge

NON-IMPACT

NOTE: GLASS TYPES 4 & 5 ARE NOT IMPACT RESISTANT. AN IMPACT RESISTANT
SHUTTER SYSTEM IS REQUIRED FOR USE IN WINDBORNE DEBRIS REGIONS.

SCOTT WOLTERS
FL PE# 62354

WOLTERS ENGINEERING
(COA# 27194)
15211 97TH ROAD N
WEST PALM BEACH, FL 33412
PH/FAX: (561) 225-1982

SEAL: No 62354

STATE OF
APR 24 2023


DWG NO.	1023671
DRAWN BY	DBN
DATE	4/24/23
SHEET DESCRIPTION	SHEET NO. 5 OF 16




RECORD U.S.A. INC.
4324 PHIL HARGETT COURT
P.O. BOX 3099
MONROE, NC 28111
PHONE: 1-866-237-2687

RECORD
WINDCORD 5400/5500 SLIDING DOOR SYSTEM
BI-PARTING AND SINGLE SLIDING
FIXED SIDELITE

Revisions			
Rev	Description	Date	Approved
1	Initial Release		CBG

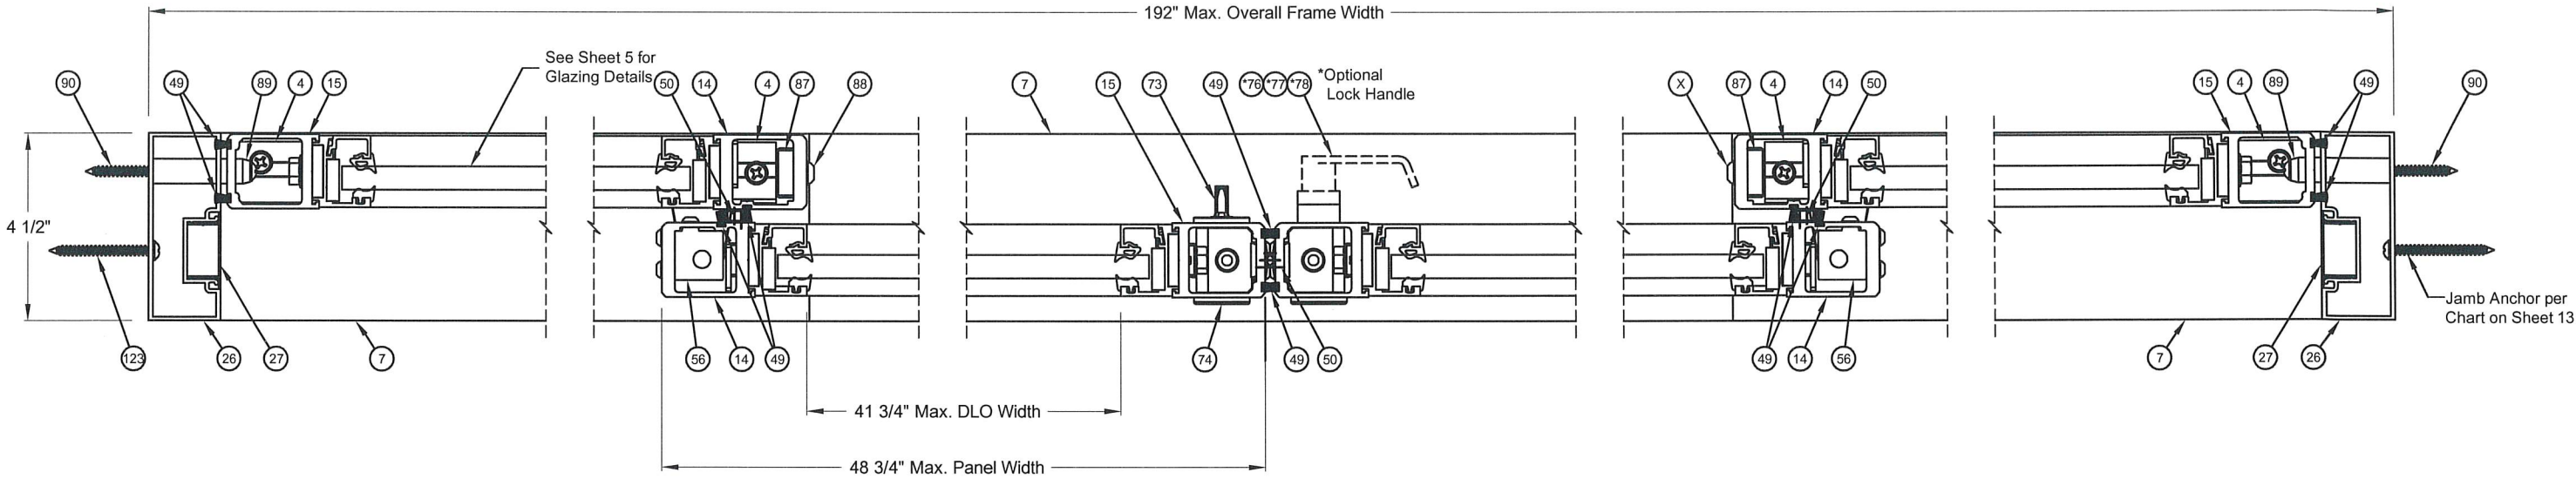

Section C-C, Narrow Stile
BI-PARTING FIXED SIDELITE SHOWN

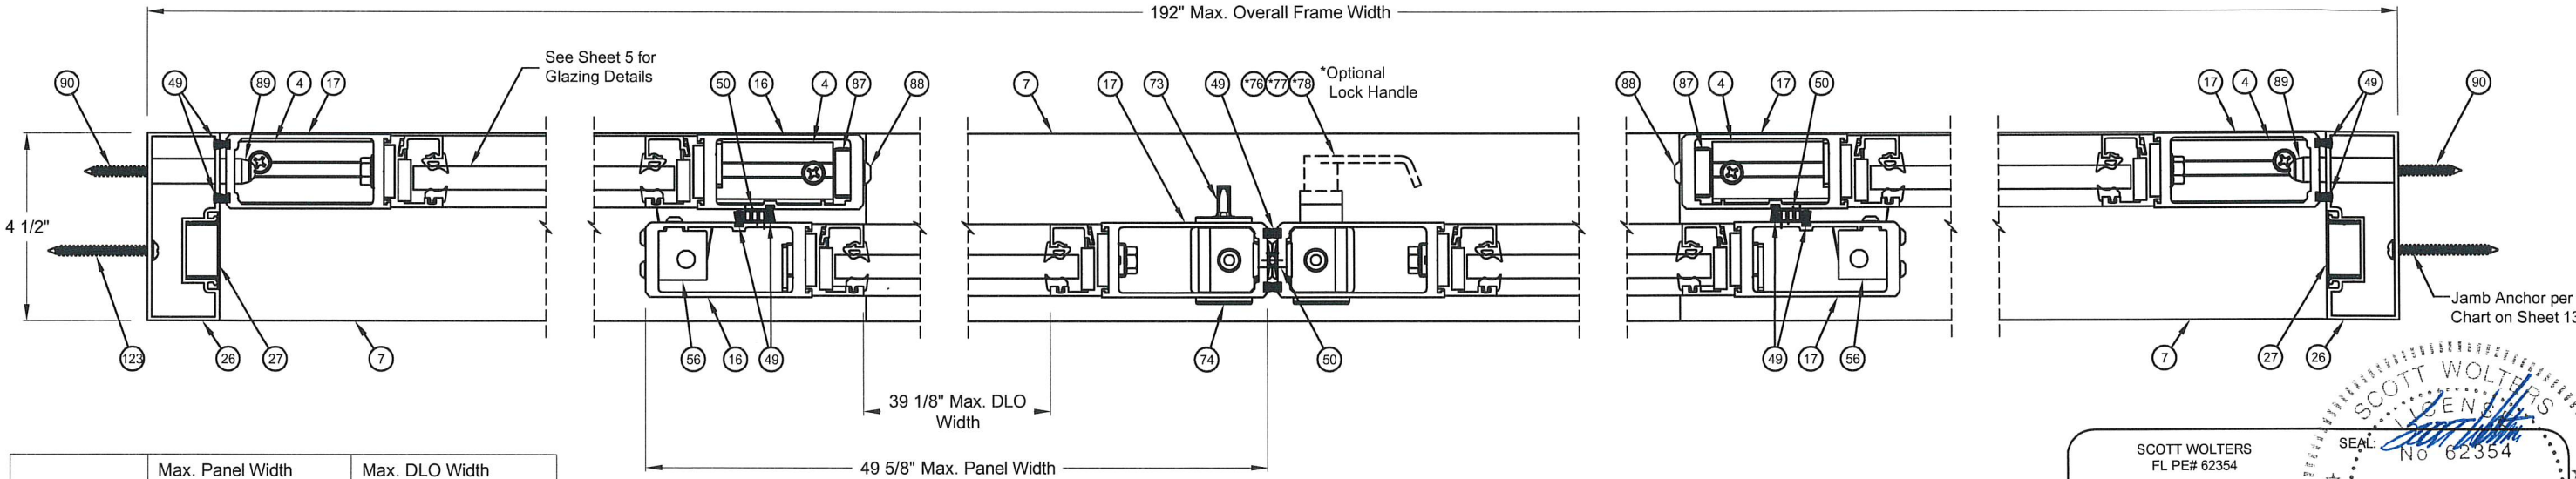

	Max. Panel Width	Max. DLO Width
Narrow Stile	48 3/4"	41 3/4"
Medium Stile	49 5/8"	39 1/8"

	Max. Panel Height	Max. DLO Height
4" Bottom Rail	95 7/8"	81 7/8"
7" Bottom Rail	95 7/8"	78 7/8"
10" Bottom Rail	95 7/8"	75 7/8"

Section C-C, Medium Stile
BI-PARTING FIXED SIDELITE SHOWN

SCOTT WOLTERS
FL PE# 62354

WOLTERS ENGINEERING
(COA# 27194)
15211 97TH ROAD N
WEST PALM BEACH, FL 33412
PH/FAX: (561) 225-1982

SEAL: No 62354

STATE OF

APR 24 2023


DWG NO.	1023671
DRAWN BY	DBN
DATE	4/24/23
SHEET DESCRIPTION	SHEET NO. 6 OF 16



RECORD U.S.A. INC.
4324 PHIL HARGETT COURT
P.O. BOX 3099
MONROE, NC 28111
PHONE: 1-866-237-2687


RECORD
WINDCORD 5400/5500 SLIDING DOOR SYSTEM
BI-PARTING AND SINGLE SLIDING
FIXED SIDELITE

Revisions			
Rev	Description	Date	Approved
1	Initial Release		CBG

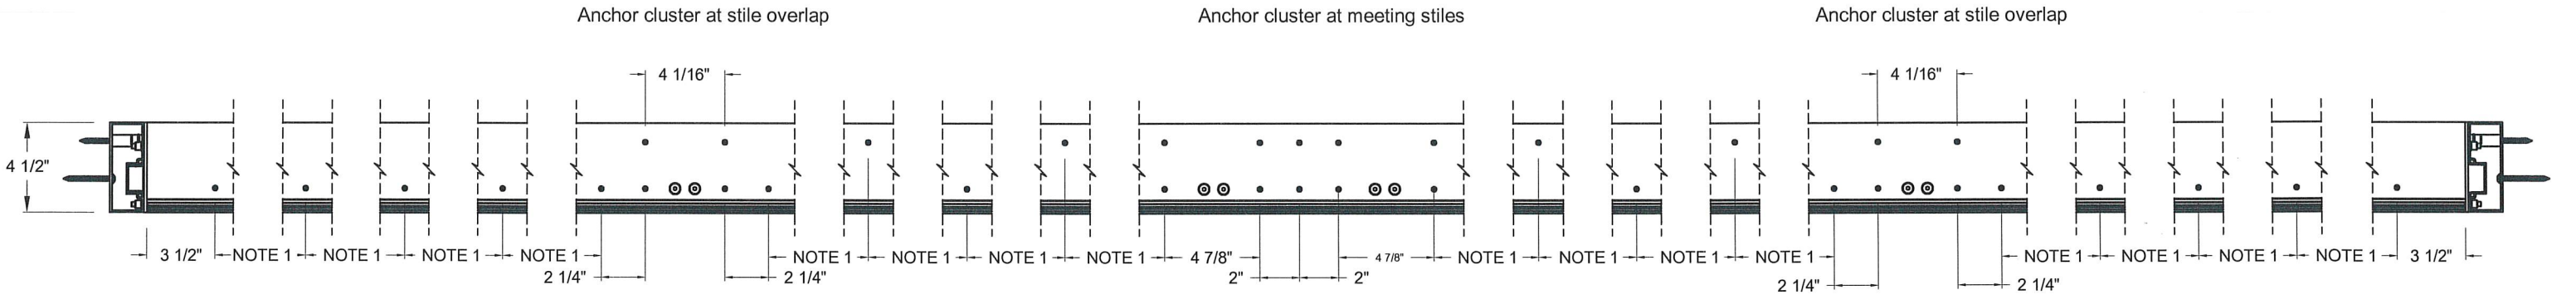

NOTE 1: 10 1/2" Max. O.C.

BI-PART HEADER ANCHOR LOCATIONS

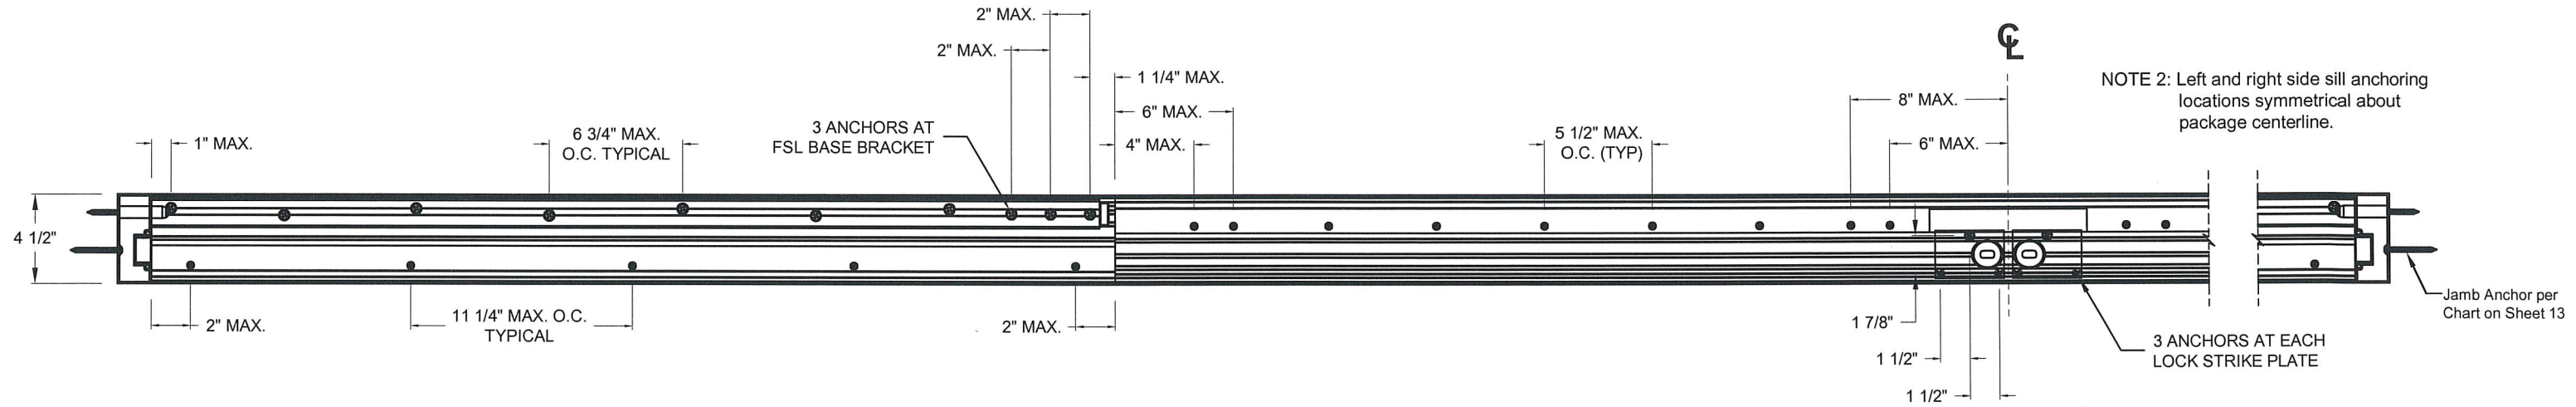

NOTE 2: Left and right side sill anchoring locations symmetrical about package centerline.

BI-PART SILL ANCHOR LOCATIONS

SCOTT WOLTERS
FL PE# 62354

WOLTERS ENGINEERING
(COA# 27194)
15211 97TH ROAD N
WEST PALM BEACH, FL 33412
PH/FAX:(561) 225-1982

SEAL
No 62354
STATE OF
FLORIDA
APR 24 2023
PROFESSIONAL ENGINEER


DWG NO.	1023671
DRAWN BY	DBN
DATE	4/24/23
SHEET DESCRIPTION	SHEET NO. 7 OF 16




RECORD U.S.A. INC.
4324 PHIL HARGETT COURT
P.O. BOX 3099
MONROE, NC 28111
PHONE: 1-866-237-2687

RECORD
WINDCORD 5400/5500 SLIDING DOOR SYSTEM
BI-PARTING AND SINGLE SLIDING
FIXED SIDELITE

Revisions			
Rev	Description	Date	Approved
1	Initial Release		CBG

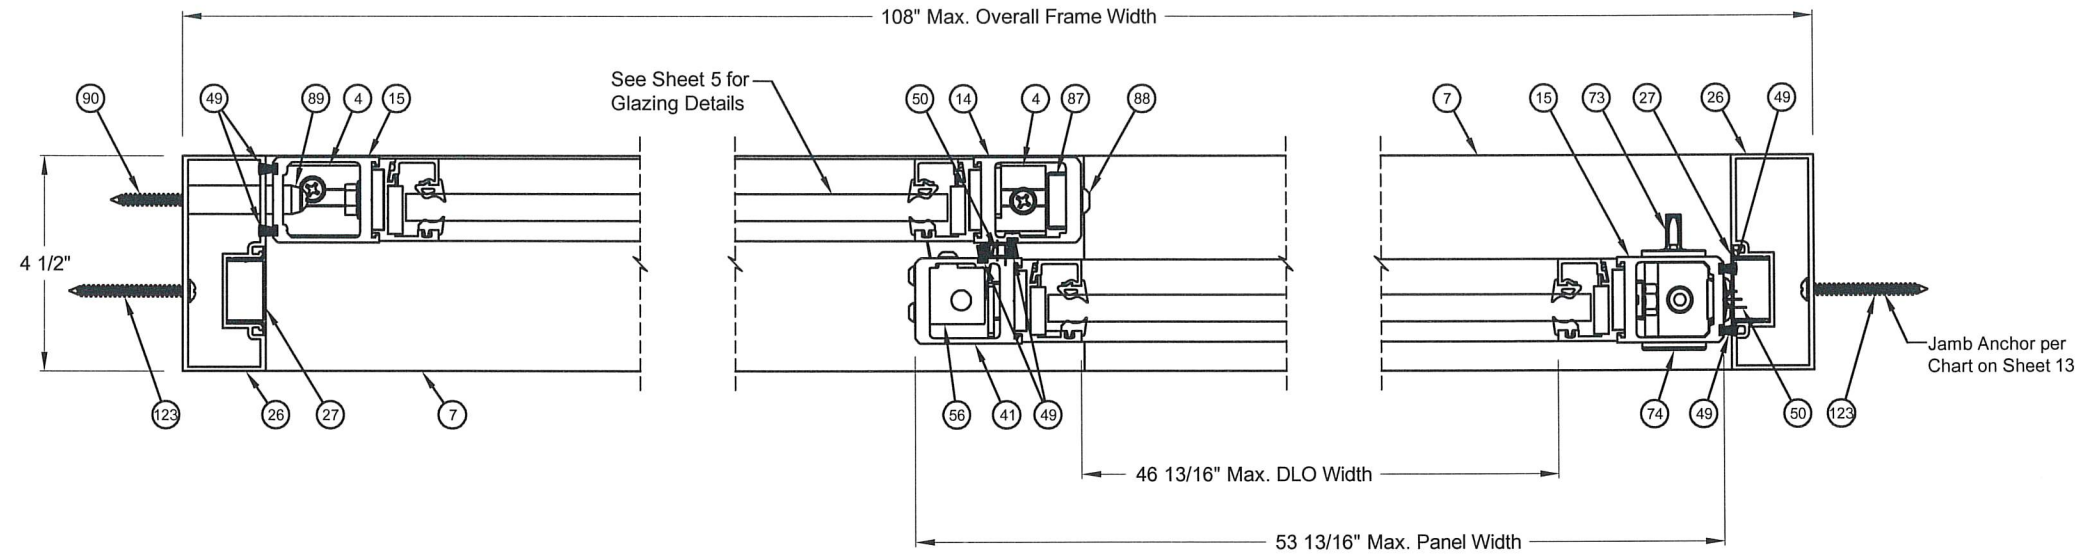

Section F-F, Narrow Stile
SINGLE SLIDE FIXED SIDELITE SHOWN

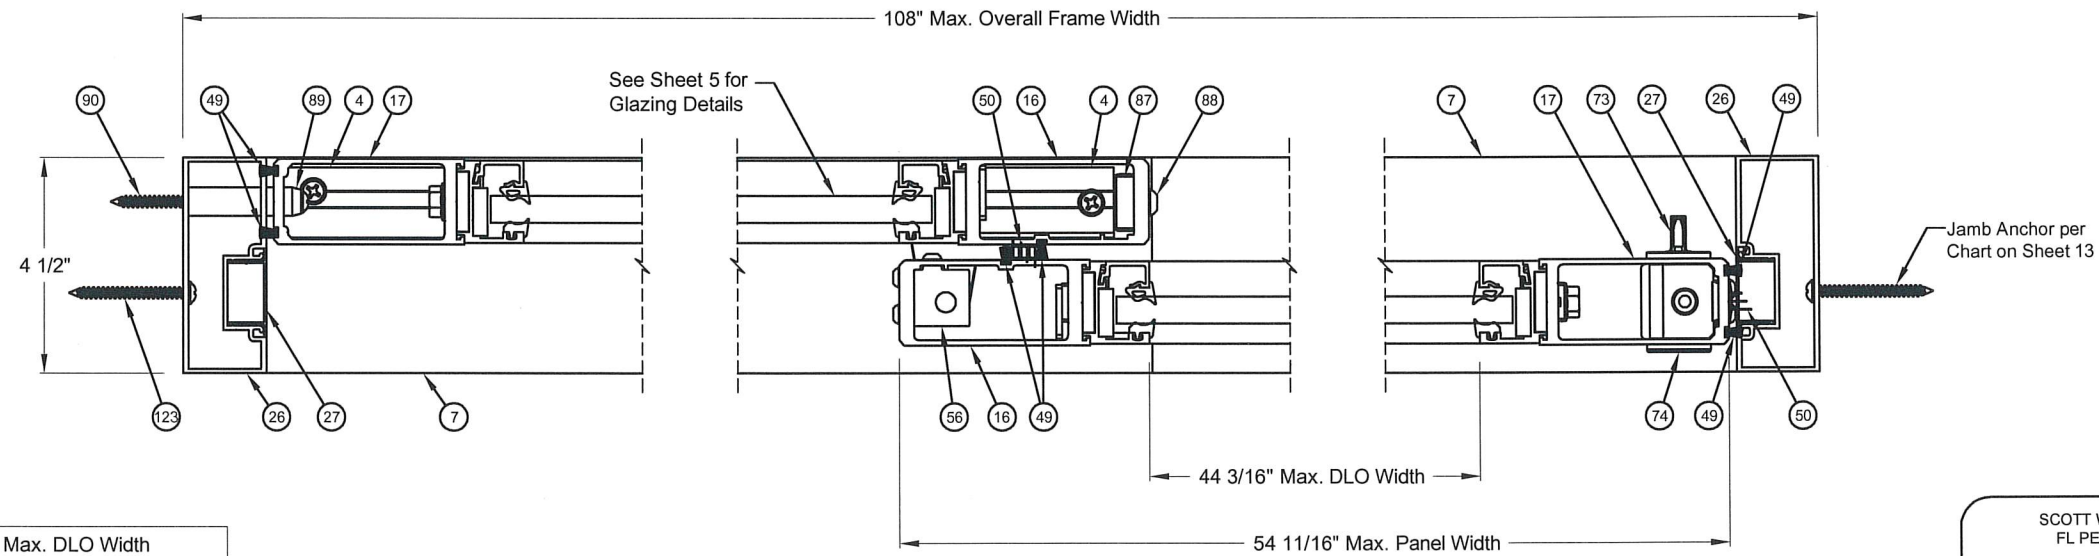

Section F-F, Medium Stile
SINGLE SLIDE FIXED SIDELITE SHOWN

	Max. Panel Width	Max. DLO Width
Narrow Stile	53 13/16"	46 13/16"
Medium Stile	54 11/16"	44 3/16"

	Max. Panel Height	Max. DLO Height
4" Bottom Rail	95 7/8"	81 7/8"
7" Bottom Rail	95 7/8"	78 7/8"
10" Bottom Rail	95 7/8"	75 7/8"

SCOTT WOLTERS
FL PE# 62354

WOLTERS ENGINEERING
(COA# 27194)
15211 97TH ROAD N
WEST PALM BEACH, FL 33412
PH/FAX: (561) 225-1982

SEAL No 62354

STATE OF FLORIDA
APR 24 2023
PROFESSIONAL ENGINEER


DWG NO.		1023671
DRAWN BY	DBN	DATE 4/24/23
SHEET DESCRIPTION		SHEET NO. 8 OF 16




RECORD U.S.A. INC.
4324 PHIL HARGETT COURT
P.O. BOX 3099
MONROE, NC 28111
PHONE: 1-866-237-2687

RECORD
WINDCORD 5400/5500 SLIDING DOOR SYSTEM
BI-PARTING AND SINGLE SLIDING
FIXED SIDELITE

Revisions			
Rev	Description	Date	Approved
1	Initial Release		CBG

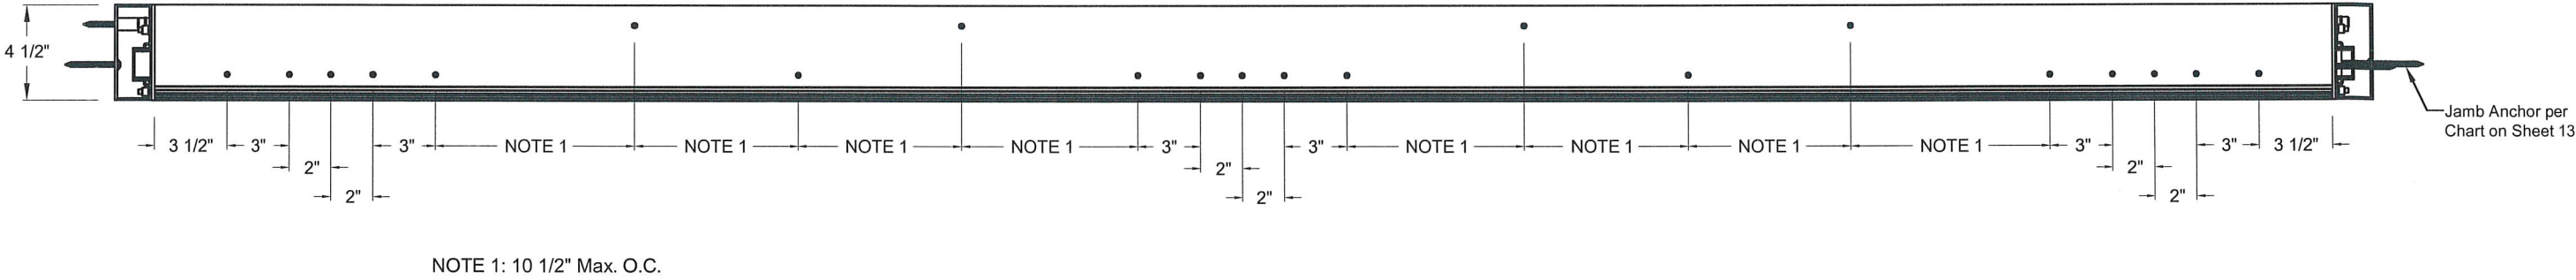


SINGLE SLIDE HEADER ANCHOR LOCATIONS

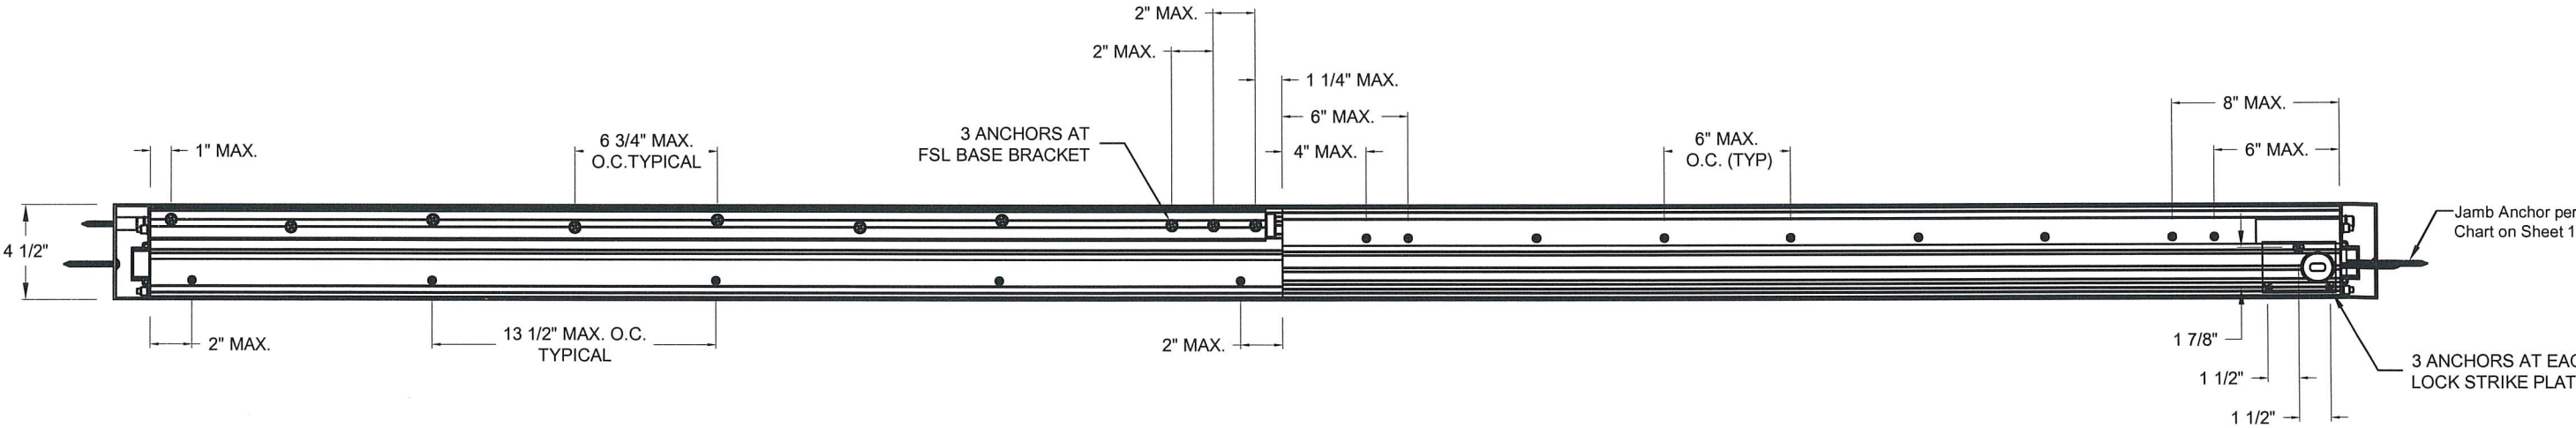

SINGLE SLIDE SILL ANCHOR LOCATIONS

SCOTT WOLTERS
FL PE# 62354

WOLTERS ENGINEERING
(COA# 27194)
15211 97TH ROAD N
WEST PALM BEACH, FL 33412
PH/FAX:(561) 225-1982

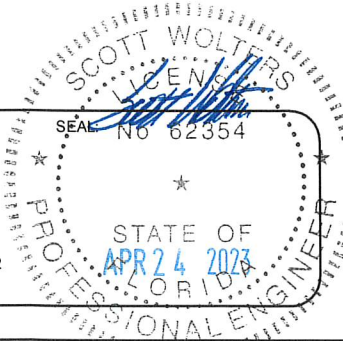


DWG NO.	1023671
DRAWN BY	DBN
DATE	4/24/23
SHEET DESCRIPTION	SHEET NO. 9 OF 16




RECORD U.S.A. INC.
4324 PHIL HARGETT COURT
P.O. BOX 3099
MONROE, NC 28111
PHONE: 1-866-237-2687

RECORD
WINDCORD 5400/5500 SLIDING DOOR SYSTEM
BI-PARTING AND SINGLE SLIDING
FIXED SIDELITE


Revisions			
Rev	Description	Date	Approved
1	Initial Release		CBG

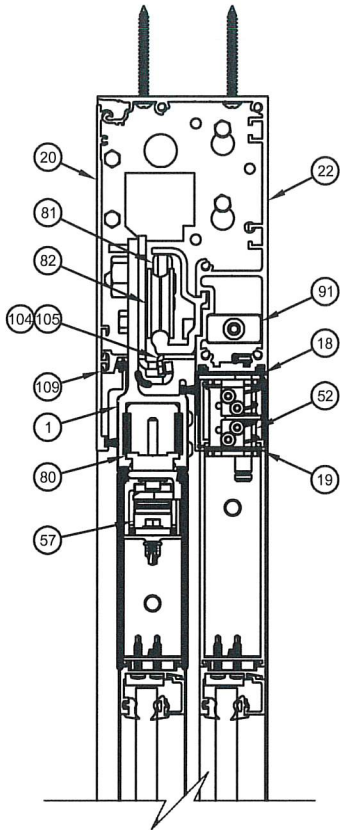


Section A-A

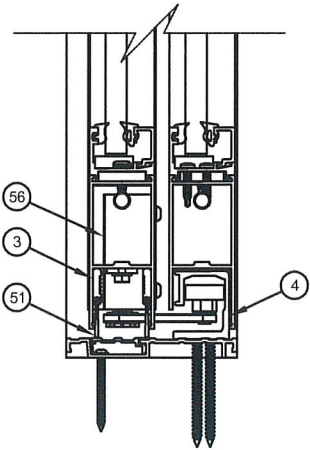


Section B-B

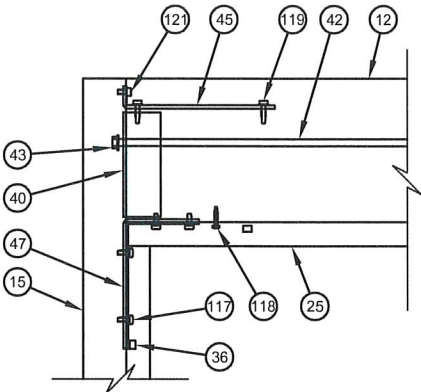


Sidelite
Top Jamb Corner

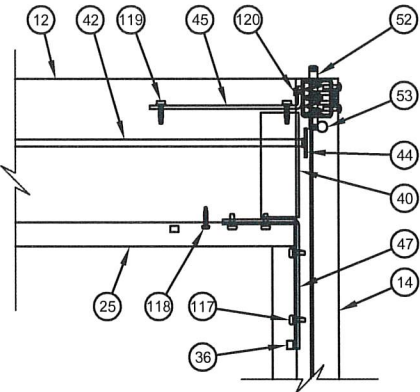


Sidelite
Top Lead Corner

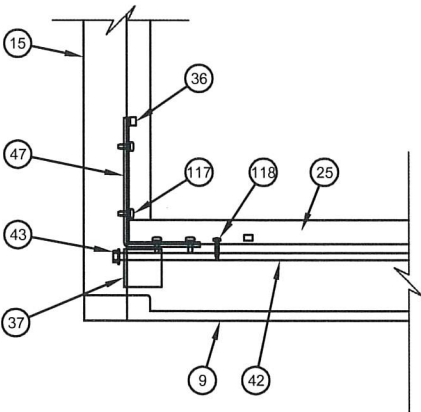


Sidelite
Bottom Jamb Corner

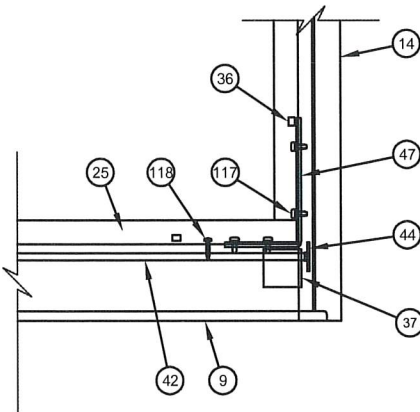


Sidelite
Bottom Lead Corner

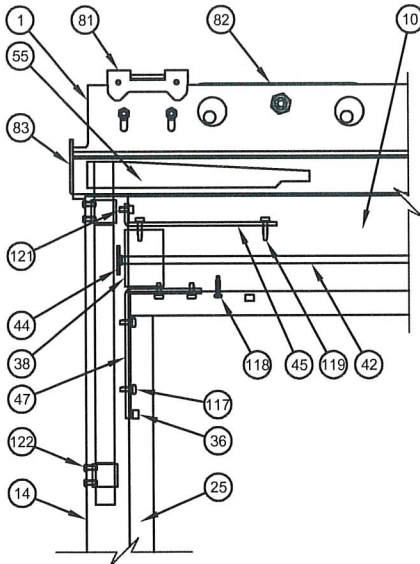


Active Leaf
Top Jamb Corner

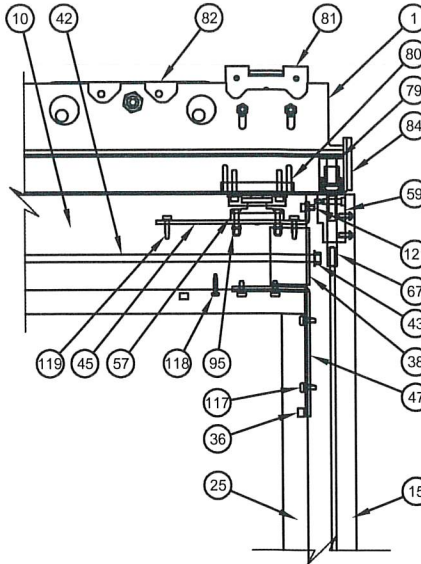


Active Leaf
Top Lead Corner

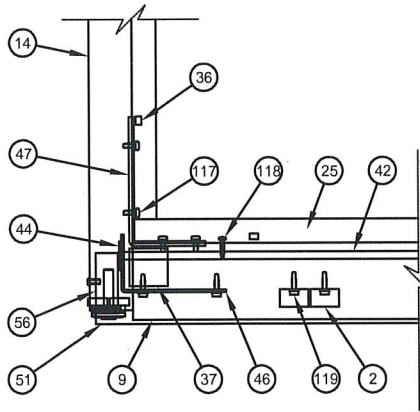

Active Leaf
Bottom Jamb Corner

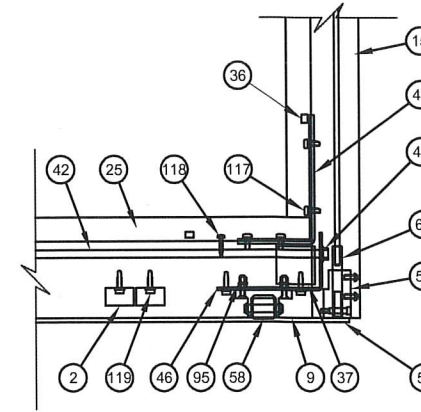

Active Leaf
Bottom Lead Corner

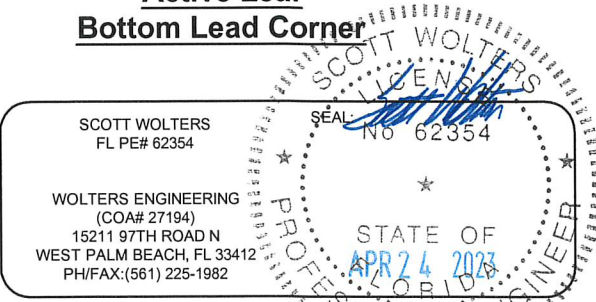

DWG NO. 1023671	
DRAWN BY DBN	DATE 4/24/23
SHEET DESCRIPTION	SHEET NO. 10 OF 16




RECORD U.S.A. INC.
4324 PHIL HARGETT COURT
P.O. BOX 3099
MONROE, NC 28111
PHONE: 1-866-237-2687


RECORD
WINDCORD 5400/5500 SLIDING DOOR SYSTEM
BI-PARTING AND SINGLE SLIDING
FIXED SIDELITE

Revisions


Rev	Description	Date	Approved
1	Initial Release		CBG

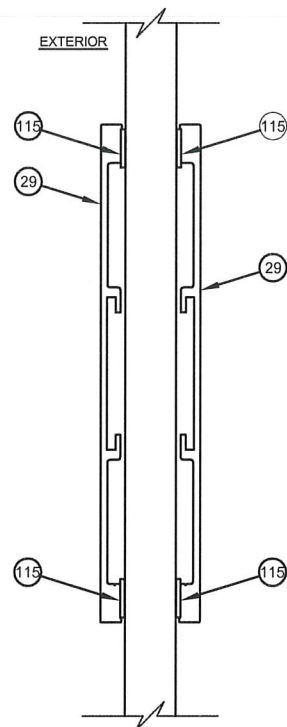


Section E-E
4" Surface
Applied Muntin

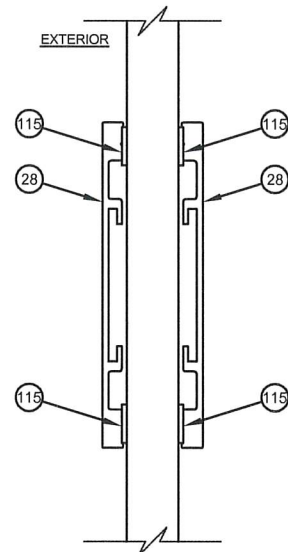


Section E-E
2" Surface
Applied Muntin

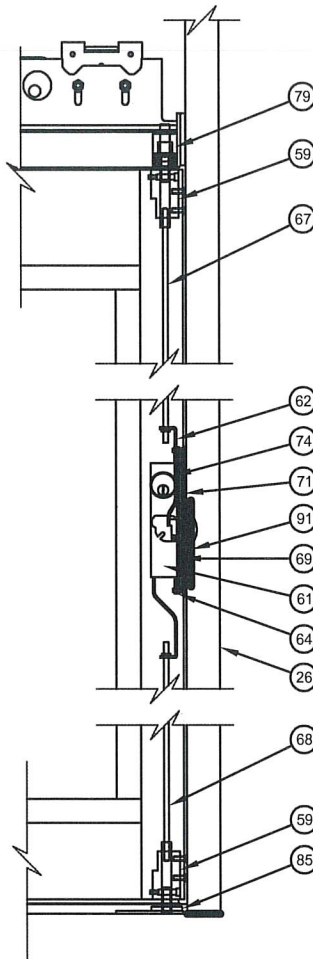


Single Slide
3-Point Lock

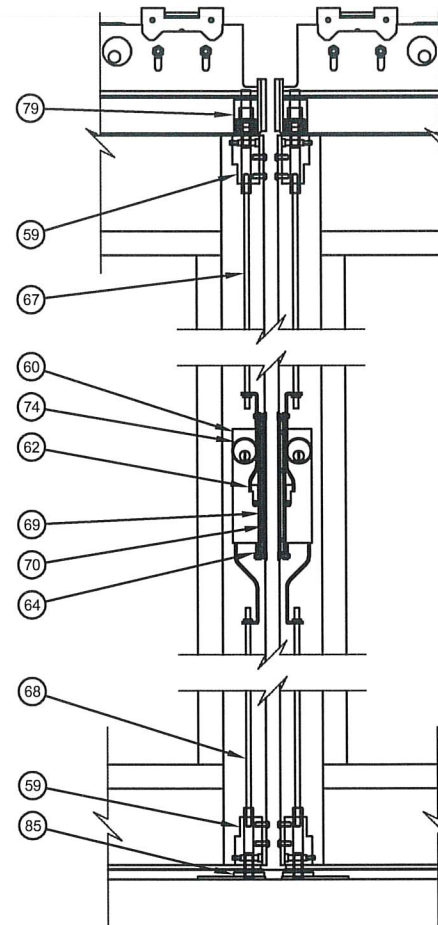


Bi-Part
4-Point Lock

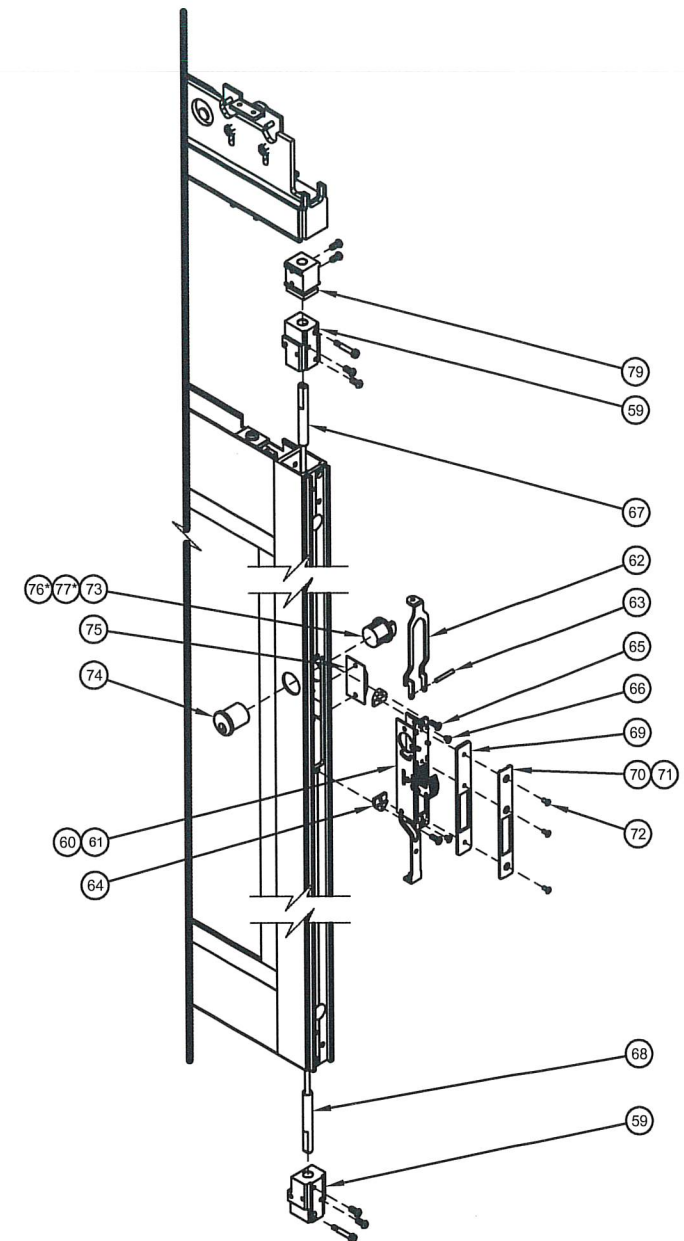


Locking System
(Single Slide shown)

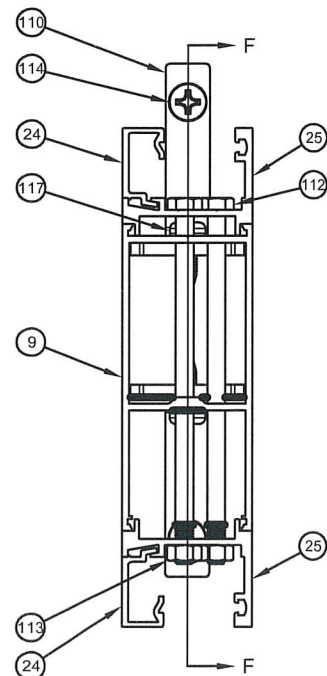


Section D-D
True Divided 4" Muntin

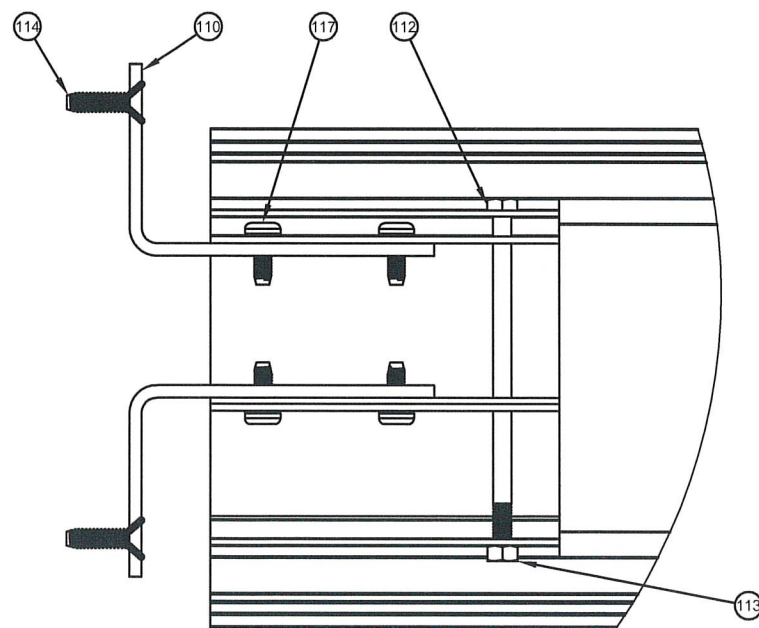

Section F-F
True Divided 4" Muntin

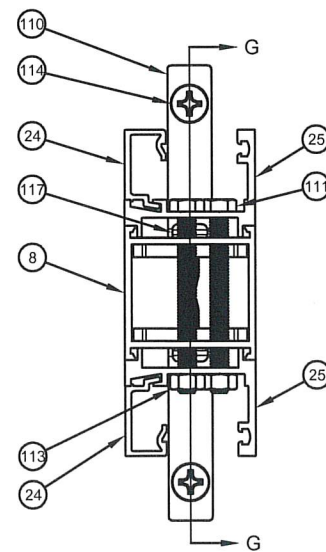

Section D-D
True Divided 2" Muntin

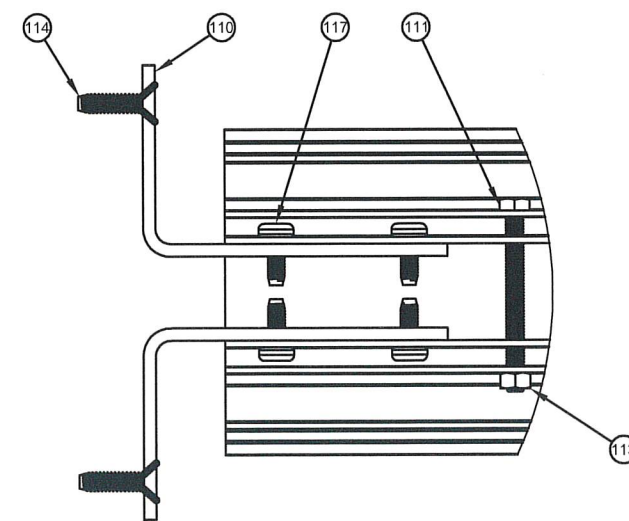

Section G-G
True Divided 2" Muntin

SCOTT WOLTERS
FL PE# 62354

WOLTERS ENGINEERING
(COA# 27194)
15211 97TH ROAD N
WEST PALM BEACH, FL 33412
PH/FAX: (561) 225-1982

SEAL
No 62354

STATE OF
FLORIDA
APR 24 2023
PROFESSIONAL ENGINEER


DWG NO.	1023671
DRAWN BY	DBN
DATE	4/24/23
SHEET DESCRIPTION	SHEET NO.
	11 OF 16




RECORD U.S.A. INC.
4324 PHIL HARGETT COURT
P.O. BOX 3099
MONROE, NC 28111
PHONE: 1-866-237-2687

RECORD
WINDCORD 5400/5500 SLIDING DOOR SYSTEM
BI-PARTING AND SINGLE SLIDING
FIXED SIDELITE


Revisions			
Rev	Description	Date	Approved
1	Initial Release		CBG

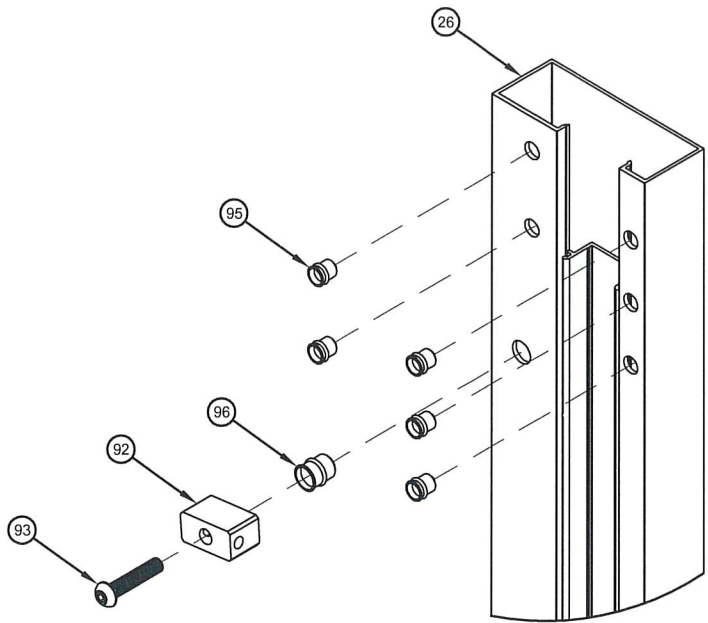



JAMB ASSEMBLY

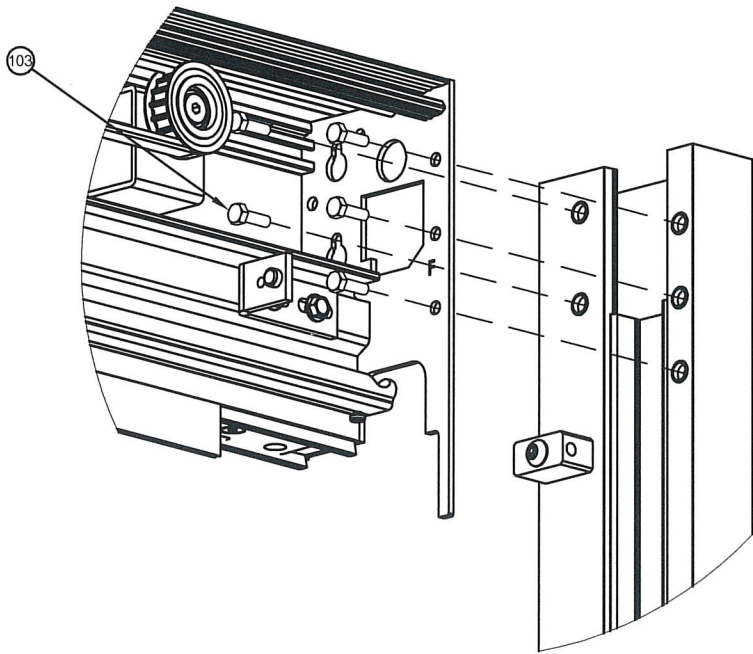

TYPICAL BEAM TO JAMB

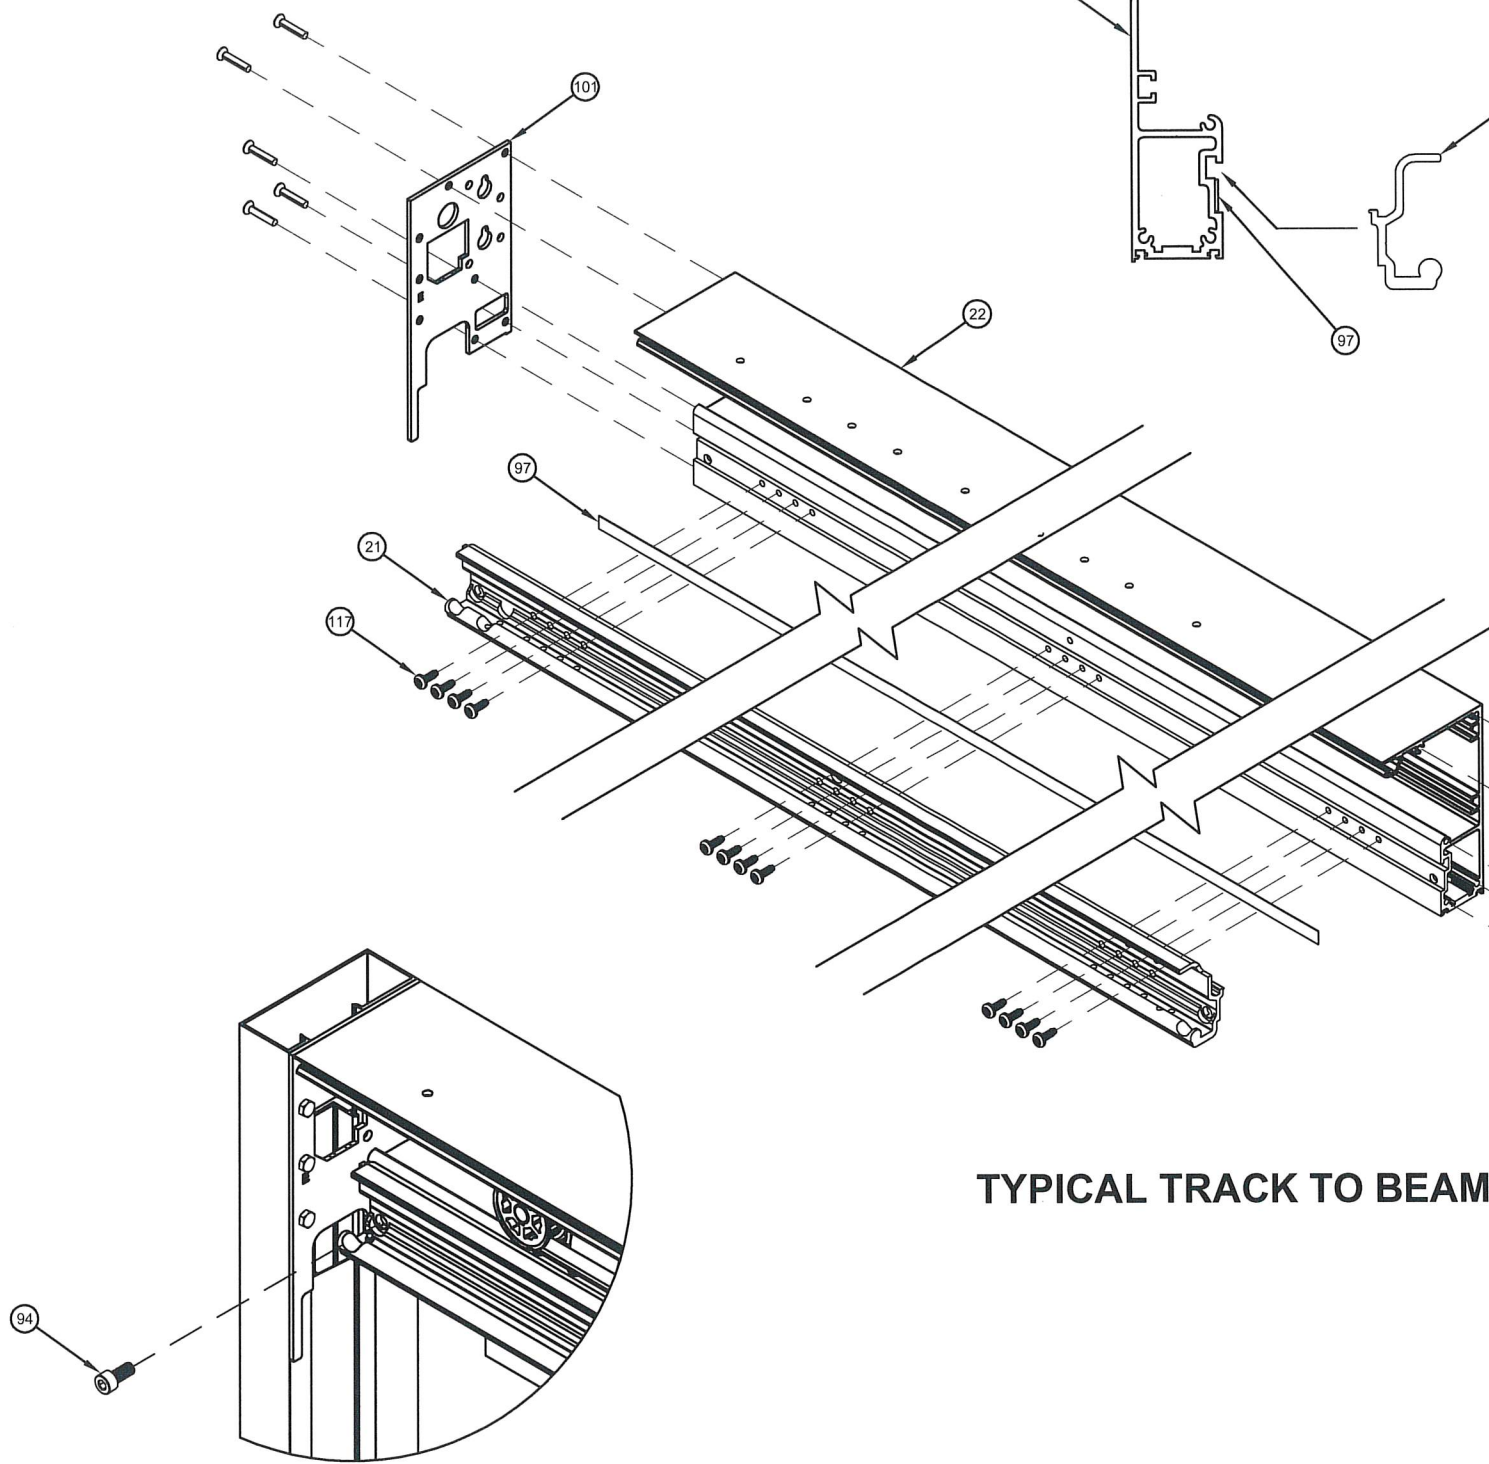


TYPICAL TRACK TO BEAM

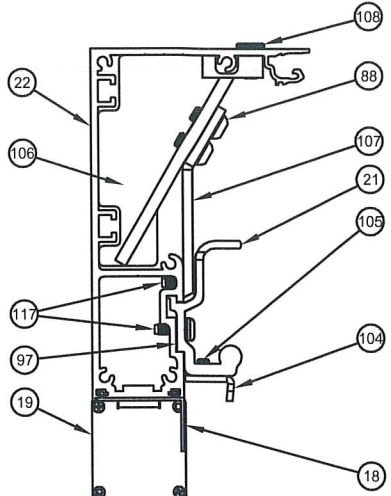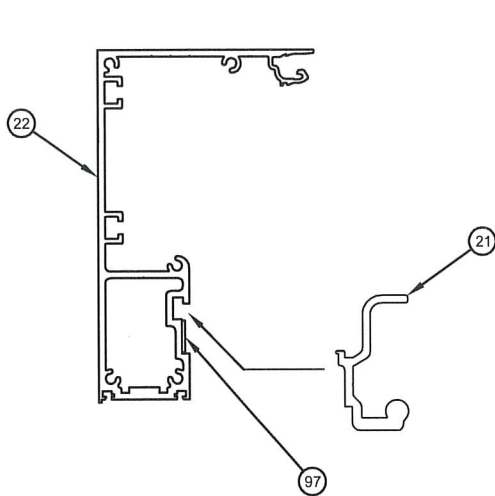

SCOTT WOLTERS
FL PE# 62354

WOLTERS ENGINEERING
(COA# 27194)
15211 97TH ROAD N
WEST PALM BEACH, FL 33412
PH/FAX: (561) 225-1982

SEAL: No 62354

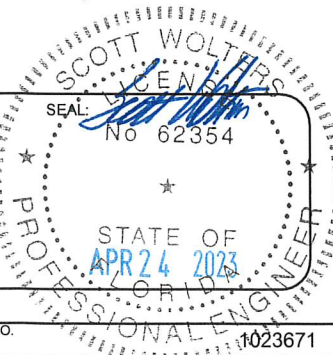




DWG NO.	1023671
DRAWN BY	DBN
DATE	4/24/23
SHEET DESCRIPTION	SHEET NO. 12 OF 16






RECORD U.S.A. INC.
4324 PHIL HARGETT COURT
P.O. BOX 3099
MONROE, NC 28111
PHONE: 1-866-237-2687

RECORD
WINDCORD 5400/5500 SLIDING DOOR SYSTEM
BI-PARTING AND SINGLE SLIDING
FIXED SIDELITE

TYPICAL SILL ANCHOR DETAILS IN CONCRETE

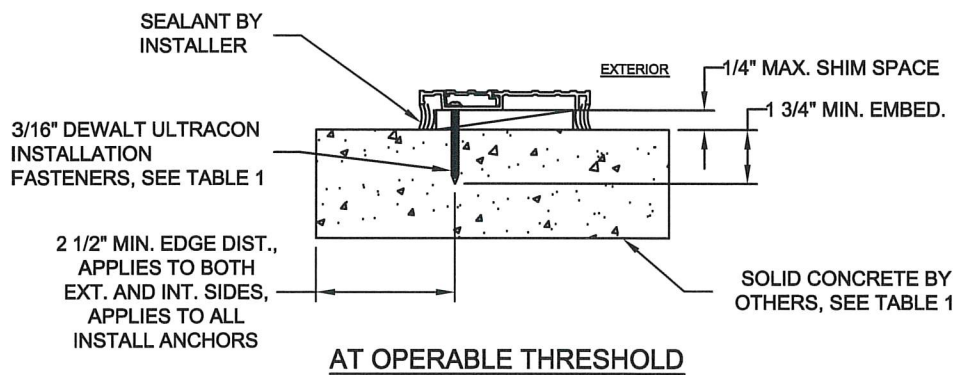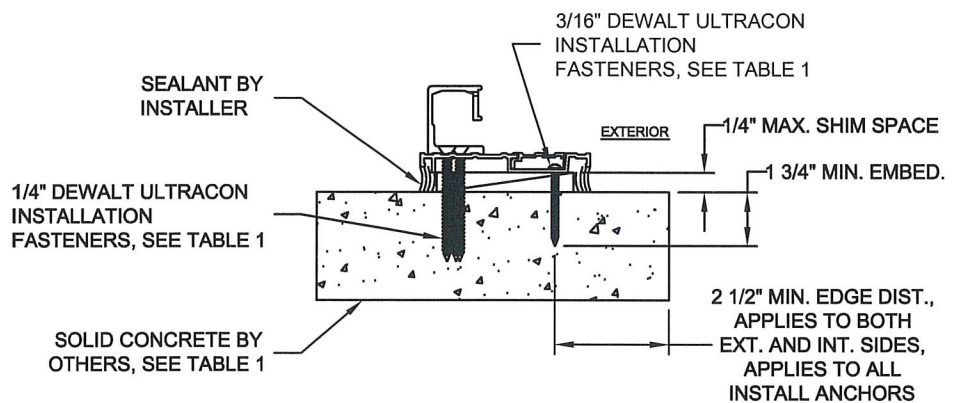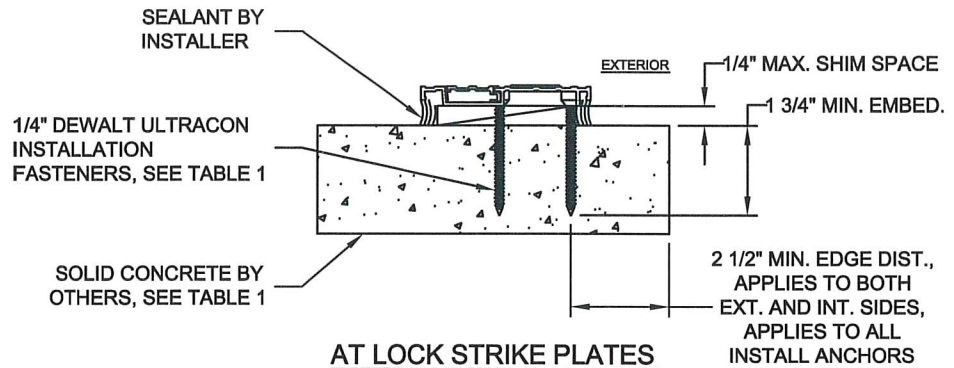

TYPICAL SILL ANCHOR DETAILS IN WOOD

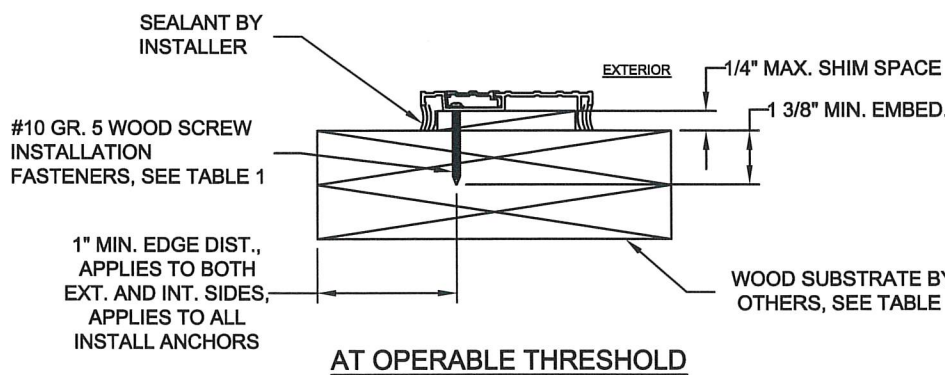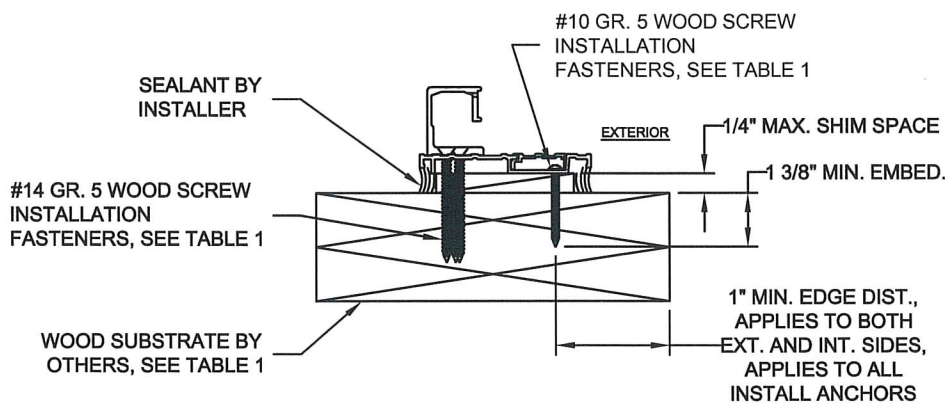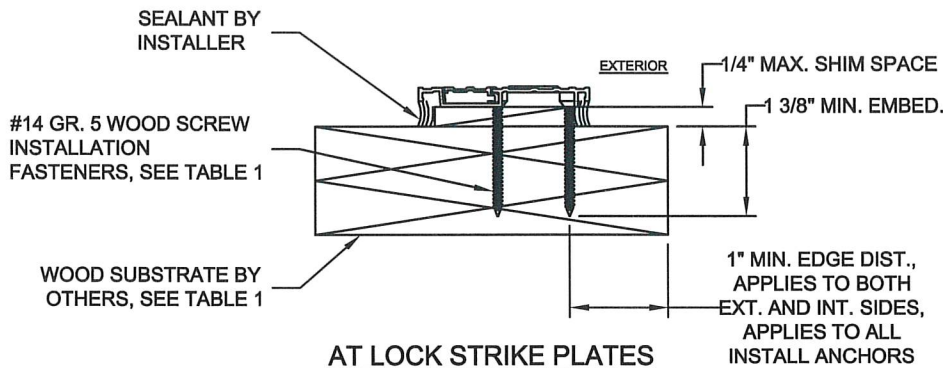

GENERAL ANCHOR NOTES:

1. INSTALL ANCHORS AS INDICATED IN DETAILS ON SHEETS 2 THRU 9.
2. INSTALL SHIMS AT EACH ANCHOR LOCATION WHERE A GAP OF 1/16" OR GREATER EXISTS BETWEEN PRODUCT FRAME AND SUBSTRATE.
3. 1/4" MAX. SHIMS SHALL BE LOAD-BEARING (PLASTIC OR METALLIC) AND CAPABLE OF TRANSFERRING LOADS TO SUBSTRATE.
4. SPECIFIED ANCHOR EMBEDMENT TO SUBSTRATE SHALL BE BEYOND WALL FINISH OR STUCCO, BY OTHERS. FOR ATTACHMENT TO METAL SUBSTRATES, ENSURE FULL THREAD ENGAGEMENT THROUGH METAL WALL WITH MIN. 3 THREADS BEYOND.
5. IN CMU (AT JAMBS ONLY) ENSURE 3" MIN. ON-CENTER SPACING BETWEEN ANY TWO INSTALLATION ANCHORS IN JAMB ANCHOR CLUSTERS (SEE VERTICAL SECTION DETAILS ON SHEETS 3 AND 4), AND 6" MIN. ON-CENTER ELSEWHERE AT CMU JAMBS. FOR ALL OTHER ANCHOR/SUBSTRATE TYPES (SEE TABLE 1) ENSURE 1 1/2" MIN. ON-CENTER SPACING BETWEEN ANY TWO INSTALLATION ANCHORS.
6. ANCHORS ARE FLATHEAD AT ALL PLATE/STRIKE LOCATIONS AND ROUND/PAN/HEX-WASHER HEAD ELSEWHERE.
7. CONCRETE ANCHORS THAT PENETRATE THE THRESHOLD ONLY ARE 3/16" DIA. DEWALT ULTRACONS. ANCHORS THAT PENETRATE DOOR HARDWARE OR STRIKE PLATES ARE 1/4" DIA. DEWALT ULTRACONS.

Revisions			
Rev	Description	Date	Approved
1	Initial Release		CBG

TABLE 1: INSTALLATION ANCHOR REQUIREMENTS

SUBSTRATE TYPE	ANCHOR TYPE	MINIMUM EMBEDMENT	MINIMUM EDGE DISTANCE
CONCRETE (2.85 ksi MIN)	1/4" DIA. ULTRACON (TYPICALLY)	1 3/4"	2 1/2"
	3/16" DIA. ULTRACON (AT THRESHOLD ONLY)	1 3/4"	2 1/2"
HOLLOW OR GROUT FILLED CMU (ASTM C90 MIN) (JAMBS ONLY)	1/4" DIA. ULTRACON	1 3/4"	2 1/2"
2X P.T. WOOD (S.G. = 0.55, MIN)	#14 GRADE 5 WOOD SCREW	1 3/8"	1"
	#10 GRADE 5 WOOD SCREW	1 3/8"	1"
STEEL STUD (16 Ga, 45 ksi MIN)	1/4" DIA. ITW TEKS SELF-DRILLING SCREW	FULL**	1/2"

**FULLY PENETRATES METAL WITH 3 THREADS BEYOND

SCOTT WOLTERS
FL PE# 62354

WOLTERS ENGINEERING
(COA# 27194)
15211 97TH ROAD N
WEST PALM BEACH, FL 33412
PH/FAX:(561) 225-1982

SEAL No 62354

STATE OF
FLORIDA
APR 24 2023
PROFESSIONAL ENGINEER

DWG NO.	1023671
DRAWN BY	DBN
DATE	4/24/23
SHEET DESCRIPTION	SHEET NO. 13 OF 16






RECORD U.S.A. INC.
4324 PHIL HARGETT COURT
P.O. BOX 3099
MONROE, NC 28111
PHONE: 1-866-237-2687



RECORD
WINDCORD 5400/5500 SLIDING DOOR SYSTEM
BI-PARTING AND SINGLE SLIDING
FIXED SIDELITE

Revisions			
Rev	Description	Date	Approved
1	Initial Release		CBG




TYPICAL HEADER ANCHOR DETAILS

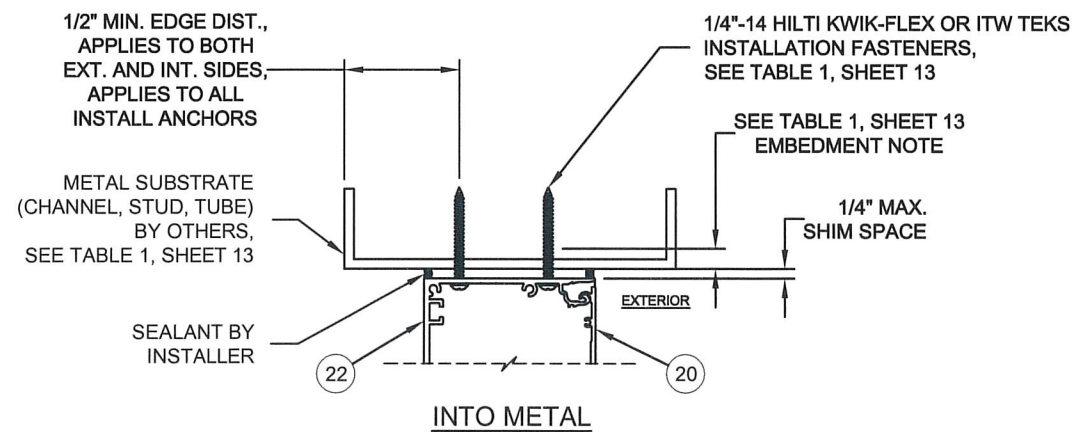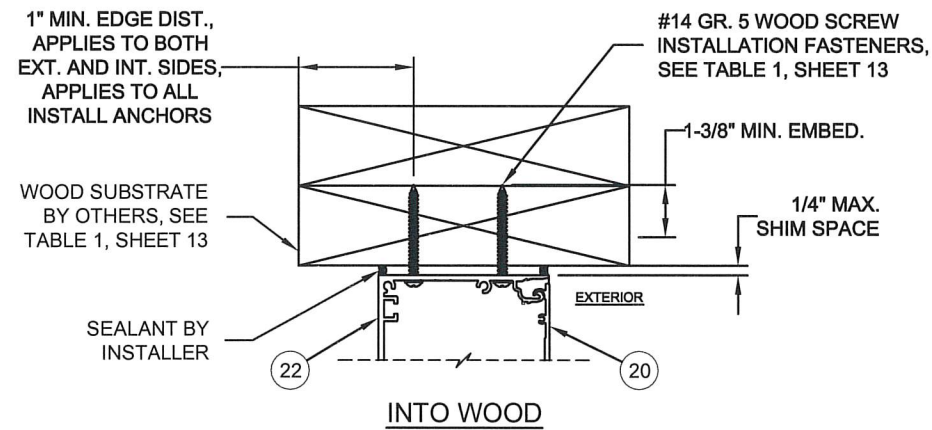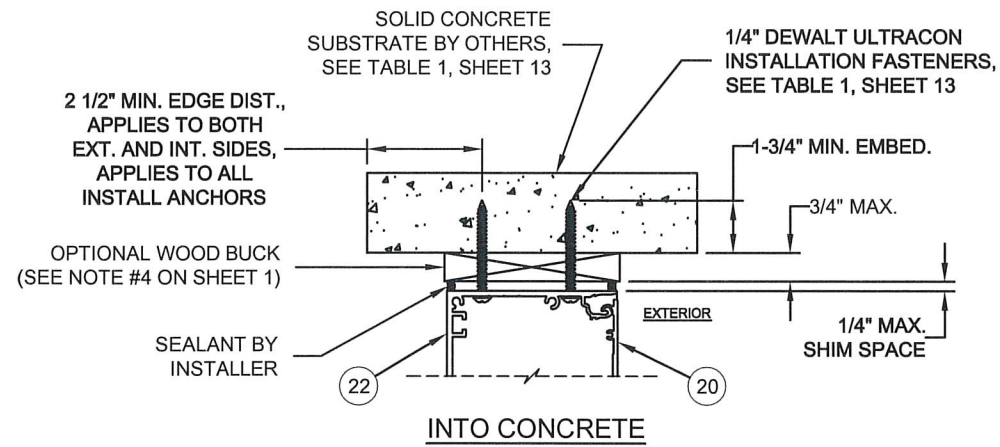

TYPICAL JAMB ANCHOR DETAILS

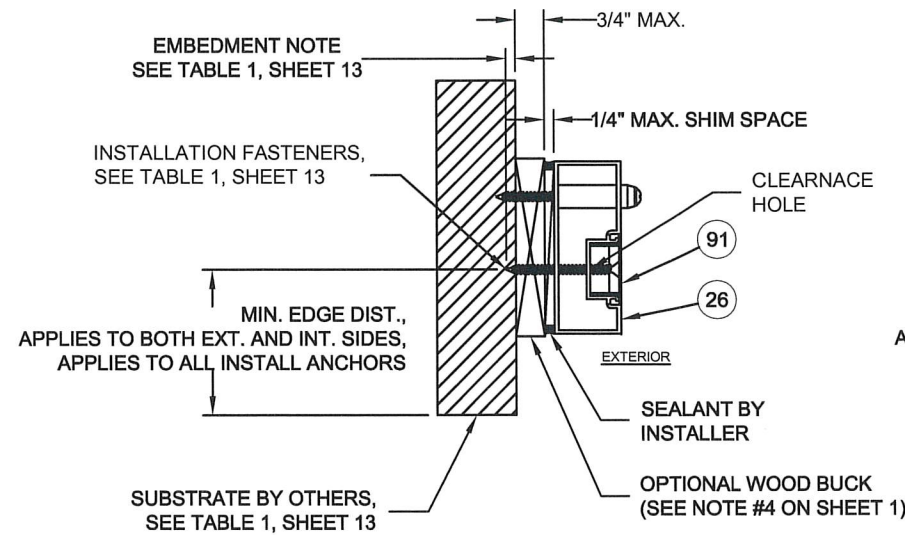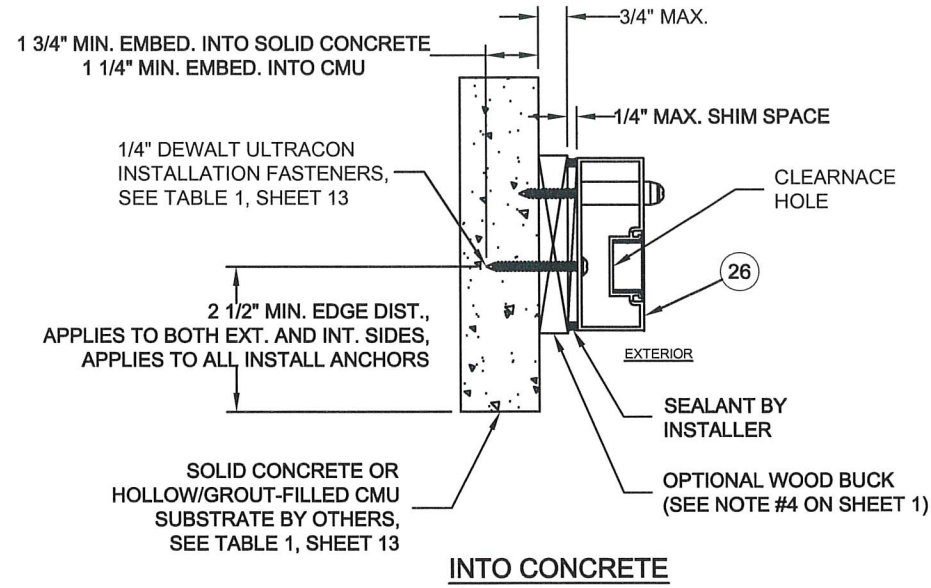

TYP. JAMB LOCK STRIKE INSTALLATION

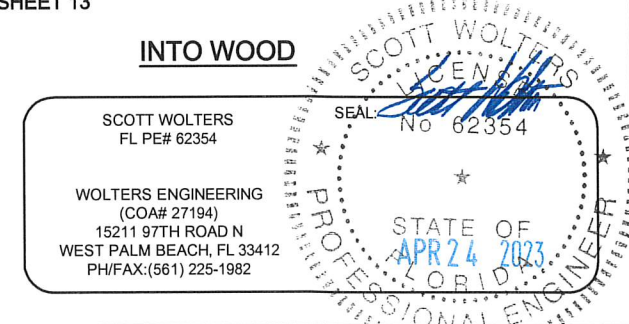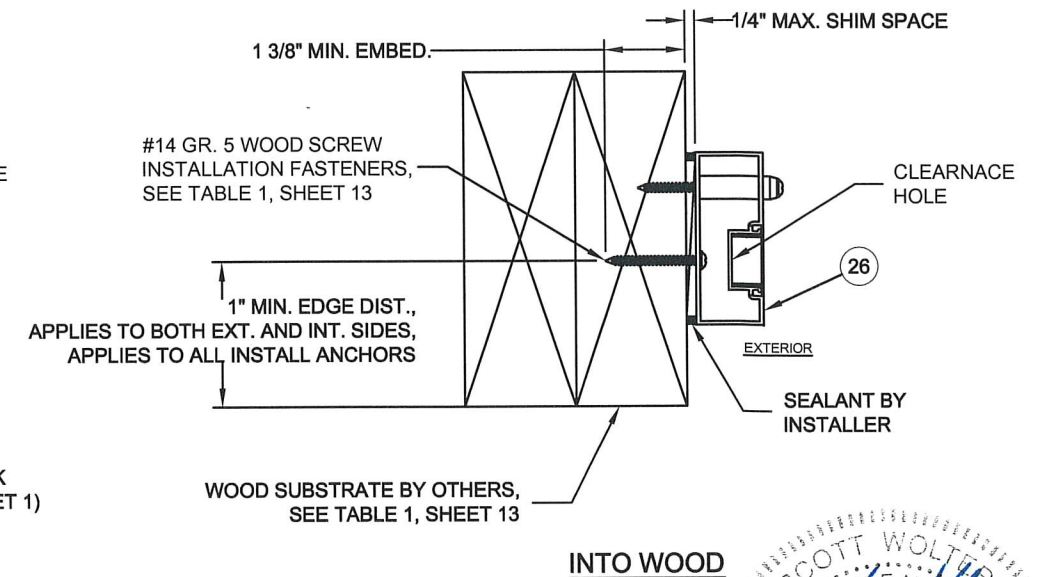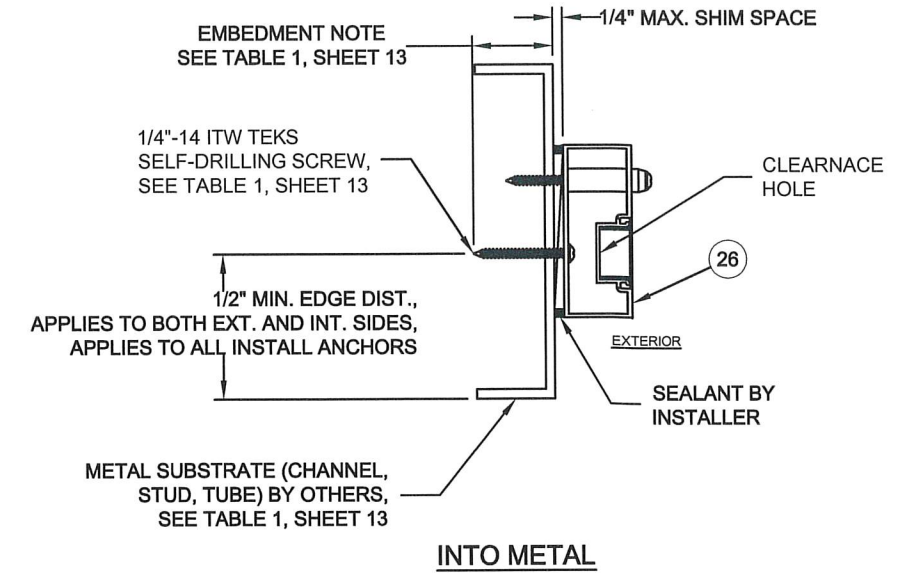


DWG NO.	1023671
DRAWN BY	DBN
DATE	4/24/23
SHEET DESCRIPTION	SHEET NO. 14 OF 16




RECORD U.S.A. INC.
4324 PHIL HARGETT COURT
P.O. BOX 3099
MONROE, NC 28111
PHONE: 1-866-237-2687

RECORD
WINDCORD 5400/5500 SLIDING DOOR SYSTEM
BI-PARTING AND SINGLE SLIDING
FIXED SIDELITE


Revisions			
Rev	Description	Date	Approved
1	Initial Release		CBG

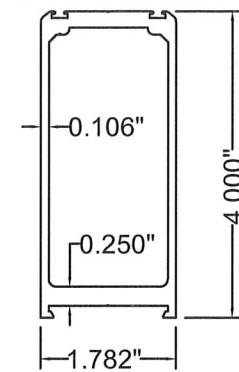


17 V1M
6063-T5

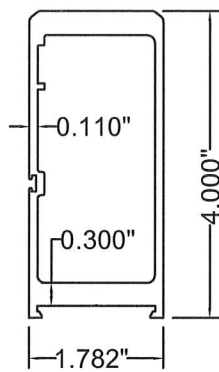


16 V2M
6063-T5




15 V1N
6063-T5

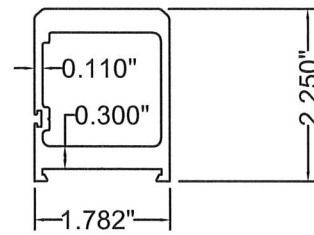


14 V2N
6063-T5




25 Gutter
6063-T5




24 9/16" Snap
6063-T5




23 1" Snap
6063-T6

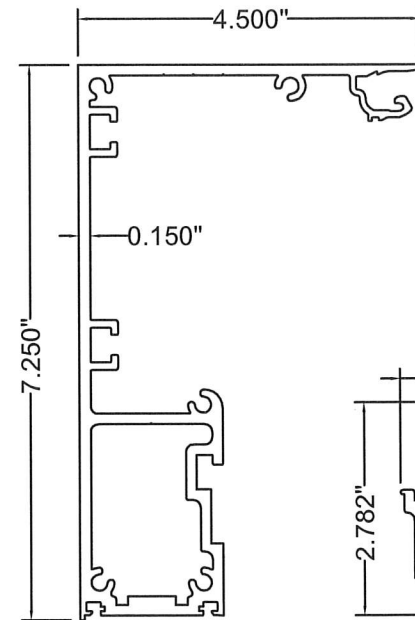


22 Record
Hurricane Beam
6063-T6




21 Resilience Track
6063-T5

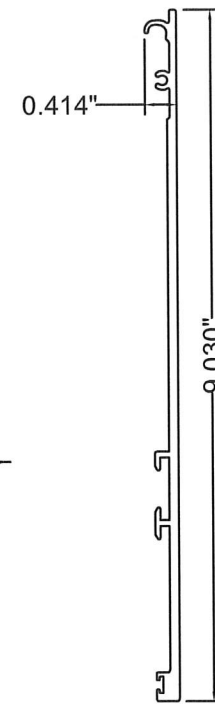


20 Record
Hurricane Cover
6063-T5




19 Record Hurricane
Sensor Cap
6063-T6




18 S/L Cap
6063-T5

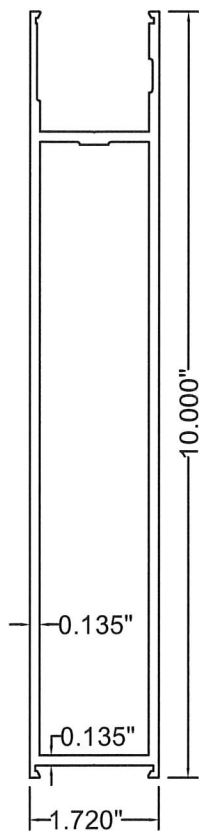


13 H10
6063-T5

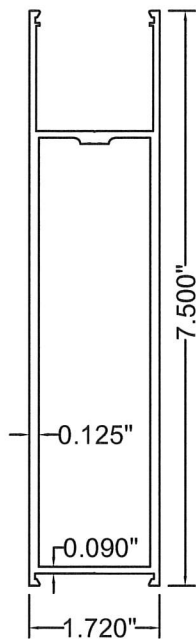


12 H7.5
6063-T6

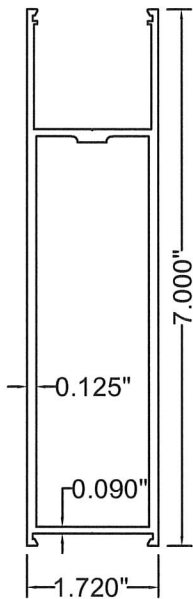


11 H7
6063-T5

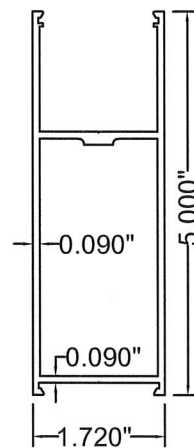


10 H5
6063-T5

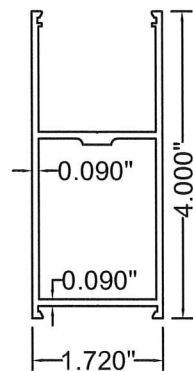


9 H4
6063-T5




8 H2
6063-T5

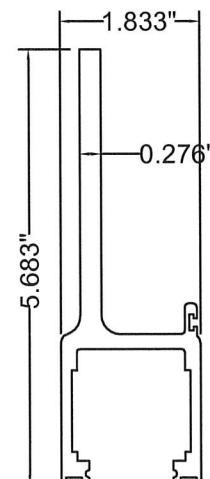


1 Carrier
6063-T6

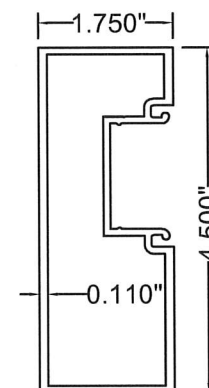


26 Jamb
6063-T6




27 Jamb Snap
6063-T6

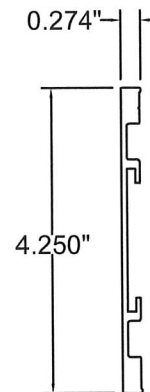


28 2" Surface
Applied Muntin
6063-T6

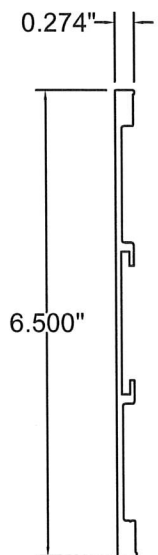


29 4" Surface
Applied Muntin
6063-T6

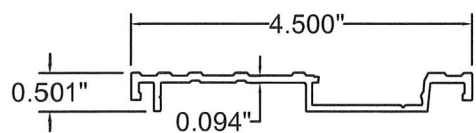


7 Threshold
6063-T6




6 Filler
6063-T5




5 Leadup
6063-T5




4 G-Channel
6063-T5



3 Sweep Housing
6063-T5



2 Sweep Clip
6063-T5

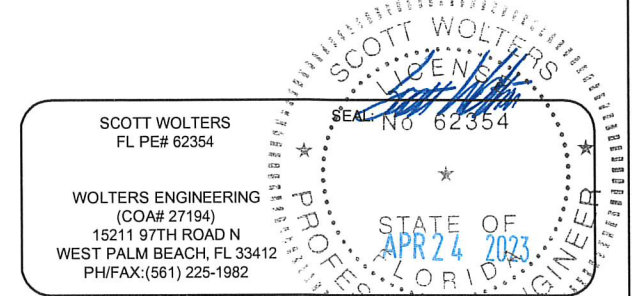

DWG NO.	1023671
DRAWN BY	DBN
DATE	4/24/23
SHEET DESCRIPTION	SHEET NO. 15 OF 16



RECORD U.S.A. INC.
4324 PHIL HARGETT COURT
P.O. BOX 3099
MONROE, NC 28111
PHONE: 1-866-237-2687


RECORD
WINDCORD 5400/5500 SLIDING DOOR SYSTEM
BI-PARTING AND SINGLE SLIDING
FIXED SIDELITE

Revisions			
Rev	Description	Date	Approved
1	Initial Release		CBG

POS.	DESCRIPTION	PART NO.
1	Carrier	1015669
2	Sweep Clip	1013780
3	Sweep Housing	US01-0685
4	Resilience G-Channel	1018598
5	Leadup	1013364
6	Filler	1018095
7	Threshold	1013363
8	H2 Muntin Rail	1012947
9	H4 Bottom Rail	1012942
10	H5 A/L Top Rail	1012944
11	H7 Bottom Rail	1012945
12	H7.5 S/L Top Rail	1016075
13	H10 Bottom Rail	1012946
14	V2N HD Rail	1018841
15	V1N HD Rail	1018840
16	V2M HD Rail	1018843
17	V1M HD Rail	1018842
18	Sidelite Cap Extrusion	1008138
19	Record Hurricane Sensor Cap	1022922
20	Record Hurricane Cover	1022921
21	XG Resilience Track	1015670
22	Record Hurricane Beam	1022920
23	XG Resilience 1" IG Snap	1015702
24	XG Resilience 9/16" Snap	1015701
25	Gutter	1015700
26	Jamb Tube	US01-0931
27	Jamb Snap	US01-0933
28	2" Surface Applied Muntin	1018855
29	4" Surface Applied Muntin	1018856
30	Fixed Seal (9/16" L.D. glass)	1703421
31	Fixed Seal (9/16" L.E. & 1" L.D. glass)	1703638
32	Fixed Seal (1/4" glass)	1703424
33	Wedge Seal (9/16" L.D. glass)	1703422
34	Wedge Seal (9/16" L.E. & 1" L.D. glass)	1703423
35	Wedge Seal (1/4" glass)	1703425
36	Glass Spacer Block	1016294
37	4" Anti-Twist Assembly Clip	1013803-2
38	5" Anti-Twist Assembly Clip	1013803-3
39	7" Anti-Twist Assembly Clip	1013897-2
40	7.5" Rail Clip	1016607
41	10" Anti-Twist Assembly Clip	1013897-1
42	Rod, Threaded, 3/8"	50-09-100
43	Nut, 3/8-16 Whiz flange zinc	50-09-132
44	Square Threaded Rod Nut	1016327
45	Anti-Twist Bracket	1016628
46	Anti-Twist, R96	1019248
47	XG Gutter Corner Bracket, Interlock Mount	1019594
48	Heyco Plug #4055, Black	1704108
49	Weather Strip, Tall Fuzz	US20-0905-01
50	Header Smoke Seal - 20' Length	US20-1658-02

POS.	DESCRIPTION	PART NO.
51	Sweep	US20-1627-02
52	Top Pivot Assembly	1012549
53	Locking Panel Plug, for 7/16" I.D. hole	1703680
54	Narrow Stile Eco Door Kit	1009225
55	XG PSA Arm Kit, HD	1017036
56	XG Resilience FSL Bottom Guide Assy	1019902
57	SL500 Resilience Ball Catch Kit	1017039
58	XG SL500R Bottom Roller Assy	1017854
59	XG Resilience HD Lock Pin Guide Kit	1019780
60	2 PT Lock	1703500
61	3 PT CVR Lock	1703501
62	Upper Arm 4016 lock AR 22-075	1703503
63	Upper Arm Pin 4016 lock	1703504
64	XG Lock Body Mounting Block	1019595
65	#10-32 x 1/2" Ultra Low Profile Socket Head Screw	1704073
66	Screw, PFU, 10-32x1/4", Znc nyloc	50-09-203
67	Lock Pin Assembly, Top	1016991
68	Lock Pin Assembly, Bottom	1016992
69	XG Faceplate Spacer, Resilience	1019518
70	Faceplate, Flush, CL/BK Fuzz	50-06-131/FB
71	Faceplate, CL, w/ BK Fuzz	50-06-102
72	#8-32 x 3/8" FHCS	1703507
73	Cylinder,Thumbturn, CL	50-06-106
74	Cylinder, Keyed-alike, CL	50-06-198KA
75	Indicator, Exit, 1-Pt, CL	50-06-161
76	Deadbolt Lever, AR4550, RH, CL	US05-0771-01
77	Deadbolt Lever, AR4550, LH, CL	US05-0771-03
78	#10-32 Steel Rivnut	US09-0852-01
79	XG Carrier Lock Strike Assy	1016637
80	Kit, Ball Catch, Carrier, CL	US05-1609-01
81	XG Blade Transmission Bracket Assy	1016644
82	XG Tandem Carriage Assembly	1016641
83	Carrier End Cap	1008415
84	Carrier End Cap Assembly	1008774
85	XG Lock Strike Plate	1016610
86	#14 x 3in FH sheetmetal screw	1703426
87	XG Resilience FSL Base Bracket	1019750
88	M8x14 BHCS	1703595
89	XG Resilience FSL Jamb Pin	1019749
90	#14 x 4in round head screw	1703494
91	Resilience Jamb Lock Strike	1017900
92	Resilience Sheer Block	1016612
93	M8x40mm BHCS Black	1703691
94	M8 x 18 SHCS	1703495
95	M6 Rivnut	US09-1560-01
96	M8 Steel Rivnut	1703429
97	Double-sided Tape (Track)	1010787
98	Carrier Positive Stop Bracket, Single Slide	1017002
99	Carrier Positive Stop Bracket, Bi-Part	1016615
100	Record Hurricane Beam End Plate F	1022929

POS.	DESCRIPTION	PART NO.
101	Record Hurricane Beam End Plate E	1022928
102	M6 x 30 Flathead, Posidrive Thread Forming Screw	1701704
103	Screw, HEX, m6x20, znc, CL8.8	93-09-723187
104	Beam Interlock Hook	1016622
105	M6x12, FHCS	50-09-153
106	Record Hurricane Support Bracket Assembly	1022927
107	Record Hurricane Support Bracket D	1022926
108	5/16-18 Low Profile Wafer Screws	1703593
109	Cover Latch Assembly	1008094
110	XG Muntin 'L' Bracket, Resilience	1019660
111	XG M6x60mm HHCS	1703666
112	XG M6x115mm HHCS, CL	1703710
113	M6 HEX NUT	04-09-726016
114	XG M6x25mm FHCS, Thread Former, Phillips Drive	1703679
115	Double-sided Tape (Surface Applied Muntin)	1704179
116	Resilience Crash Bar Kit	1017922
117	M6x16mm Trilobe BHCS	1703493
118	#10x1" PPH Tek Screw	70-09-216
119	Screw, HWH, 1/4-14x1"TEK	US09-1294-01
120	M5x8mm BHCS	1703508
121	M6x12mm SHCS BLK Zinc	1703632
122	M6x14mm BHCS	1703471-02
123	#14 x 2.5in BH sheetmetal screw	1703431
124	#10 x 2in PH sheetmetal screw	1703427
125	1/4"-14 x 2" HWH #3 Pt steel self drilling screw	1703633
126	1/4" x 3-1/4" PFH Elco Ultracon Conc. Anchor	1703634
127	3/16" x 1-3/4" HWH Elco Ultracon Conc. Anchor	1703635
128	1/4" x 1-3/4" HWH Elco Ultracon Conc. Anchor	1703636

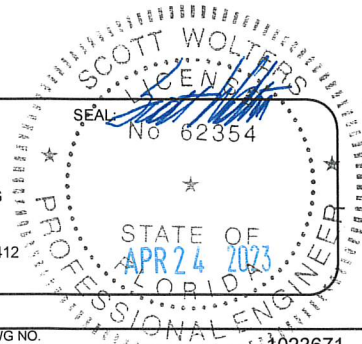

	DWG NO.	1023671
	DRAWN BY	DBN
	DATE	4/24/23
	SHEET DESCRIPTION	SHEET NO. 16 of 16