

OPERATING AWNING WINDOW			
Max Frame	DP	IMPACT	
48 x 36	+50/-60	YES	

**Installed Fastener Schedule:**

1. Seal flange/frame to substrate.
2. Use #8 PH or greater fasteners through nail fin with sufficient length to penetrate a minimum of 1 1/2" into the wood framing. For 2X wood frame substrate (min. S.G. = 0.42).
3. Host structure (wood buck, stud framing and opening) to be designed and anchored to properly transfer all loads to the structure. The host structure is the responsibility of the architect or engineer of record for the project of installation.

**General Notes:**




1. The product shown herein is designed, tested and manufactured to comply with the wind load criteria of the adopted International Building Code (IBC), the International Residential Code (IRC), the Florida Building Code (FBC) and the industry standard requirement for the stated conditions.
2. Buck, framing and masonry by others and is responsibility of architect or engineer of record.
3. All glazing shall conform to ASTM E1300.
4. At minimum, glazing is 3.0mm annealed or tempered - 12.7mm airspace - 3.9mm annealed - 2.3mm SGP Interlayer by DuPont - 3.9mm" annealed.

This schedule addresses only the fasteners required to anchor the window to achieve the rated design pressure up to the size limitations noted. It is not intended as a guide to the installation process and does not address the sealing consideration that may arise in different wall conditions. For the complete installation procedure, see the instructions packaged with the window or go to [www.jeld-wen.com/resources/installation](http://www.jeld-wen.com/resources/installation).

**DISCLAIMER:**

This drawing and its contents are confidential and are not to be reproduced or copied in whole or in part or used or disclosed to others except as authorized by JELD-WEN Inc.

PROJECT ENGINEER: --	DATE: 02/09/2015	<b>JELD-WEN</b>	3737 Lakeport Blvd Klamath Falls, OR, 97601 Phone: (541) 882-3451
DRAWN BY: D. Vezo	SCALE: NTS		
CHECKED BY: D. Stokes	TITLE: Custom Clad Awning with Extruded Sash Impact Window Nail Fin Installation (48" x 36")		
APPROVED BY: --			
PART/PROJECT No: D009187	PLANT NAME AND LOCATION: Bend, Oregon	CAD DWG. No.:	REV: 00 SHEET

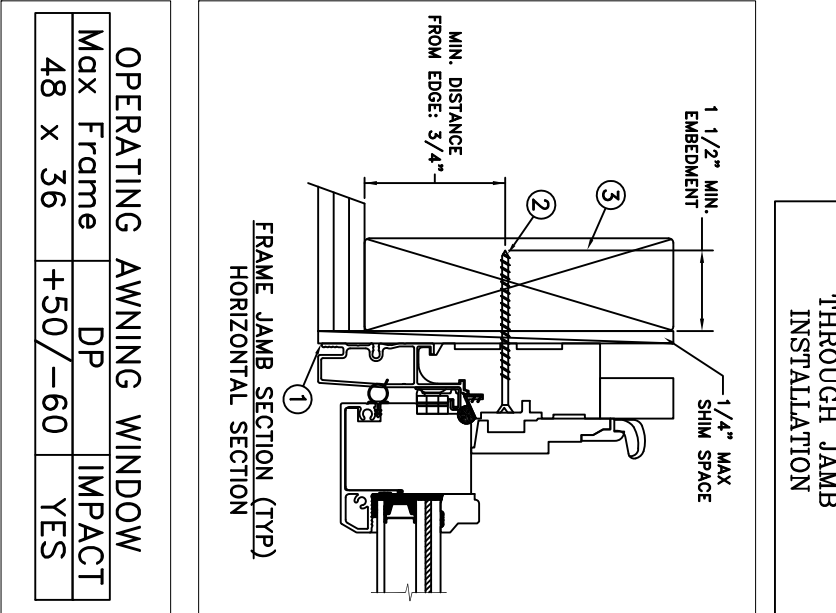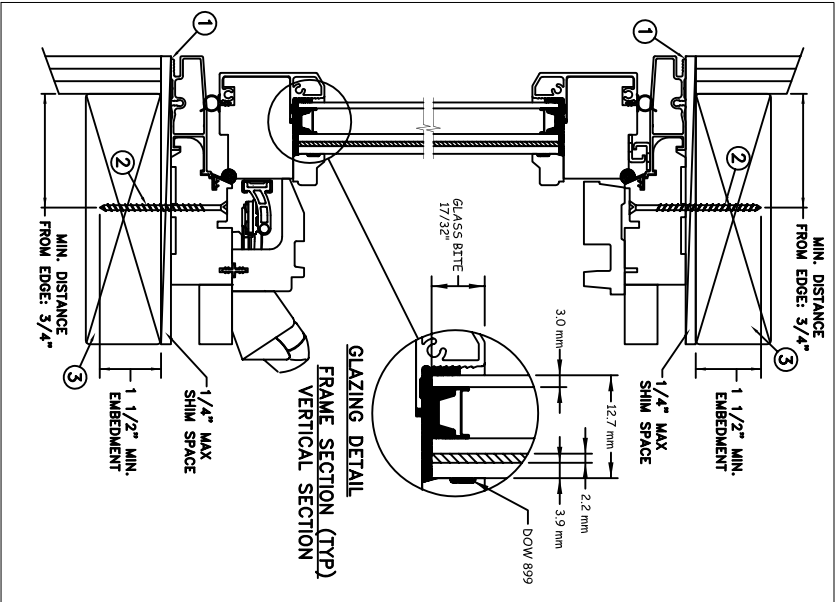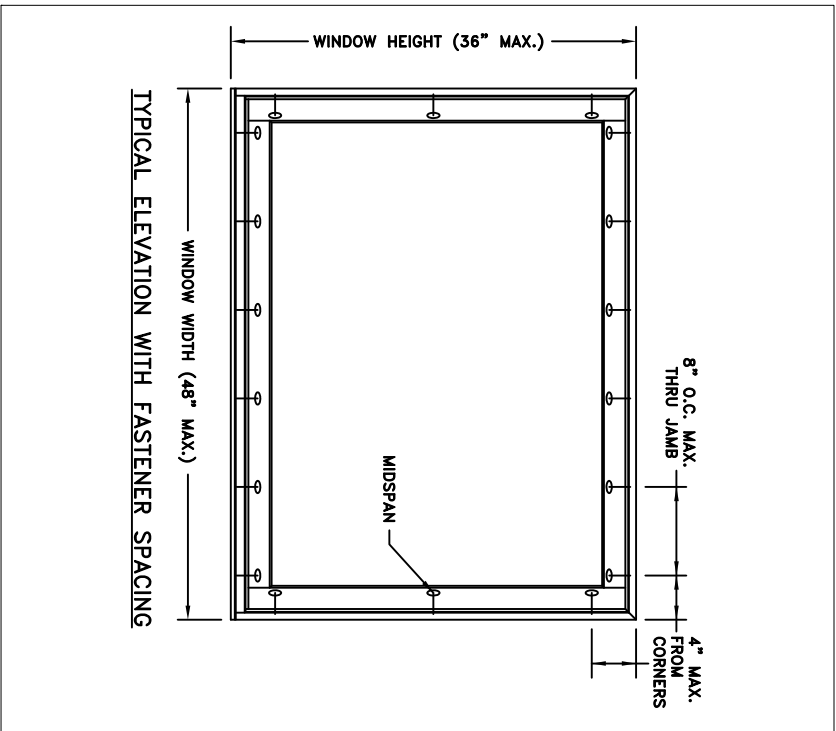

OPERATING AWNING WINDOW		
Max Frame	DP	IMPACT
48 x 36	+50/-60	YES

**Installed Fastener Schedule:**

1. Seal flange/frame to substrate.
2. Use #8 PH or greater fasteners through jamb with sufficient length to penetrate a minimum of 1 1/2" into the wood framing. For 2X wood frame substrate (min. S.G. = 0.42).
3. Host structure (wood buck, stud framing and opening) to be designed and anchored to properly transfer all loads to the structure. The host structure is the responsibility of the architect or engineer of record for the project of installation.

**General Notes:**




1. The product shown herein is designed, tested and manufactured to comply with the wind load criteria of the adopted International Building Code (IBC), the International Residential Code (IRC), the Florida Building Code (FBC) and the industry standard requirement for the stated conditions.
2. Buck, framing and masonry by others and is responsibility of architect or engineer of record.
3. All glazing shall conform to ASTM E1300.
4. At minimum, glazing is 3.0mm annealed or tempered - 12.7mm airspace - 3.9mm annealed - 2.3mm SGP Interlayer by DuPont - 3.9mm" annealed.

This schedule addresses only the fasteners required to anchor the window to achieve the rated design pressure and impact performance (where applicable) up to the size limitations noted. It is not intended as a guide to the installation process and does not address he sealing consideration that may arise in different wall conditions. For the complete installation procedure, see the instructions packaged with the window or go to [www.jeld-wen.com/resources/installation](http://www.jeld-wen.com/resources/installation).

**DISCLAIMER:**

This drawing and its contents are confidential and are not to be reproduced or copied in whole or in part or used or disclosed to others except as authorized by JELD-WEN Inc.

PROJECT ENGINEER: --	DATE: 02/09/2015		
DRAWN BY: D. Vezo	SCALE: NTS		
CHECKED BY: D. Stokes	TITLE: Custom Clad Awning with Extruded Sash Impact Window	3737 Lakeport Blvd Klamath Falls, OR, 97601 Phone: (541) 882-3451	
APPROVED BY: --			
PART/PROJECT No: D009187	PLANT NAME AND LOCATION: Bend, Oregon		CAD DWG. No.:
IDENTIFIER No.	REV: 00	SHEET	

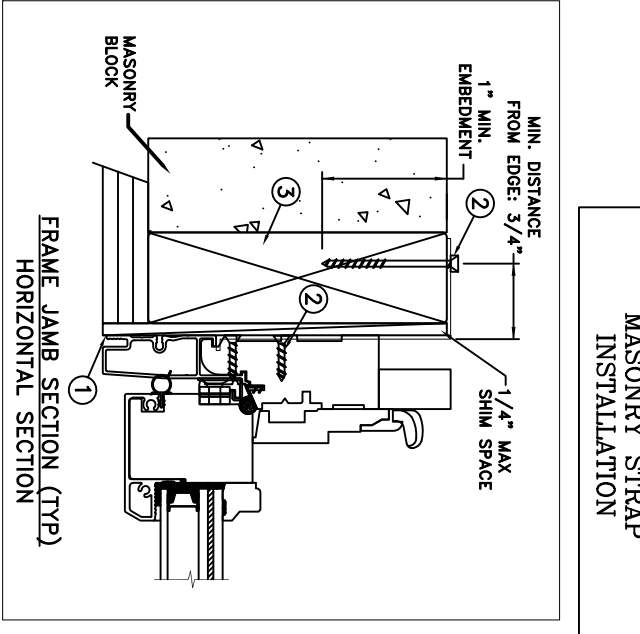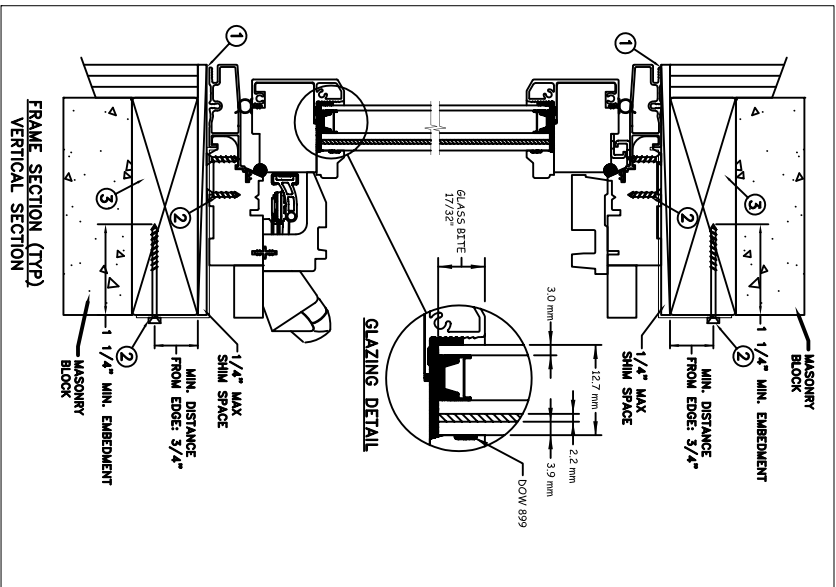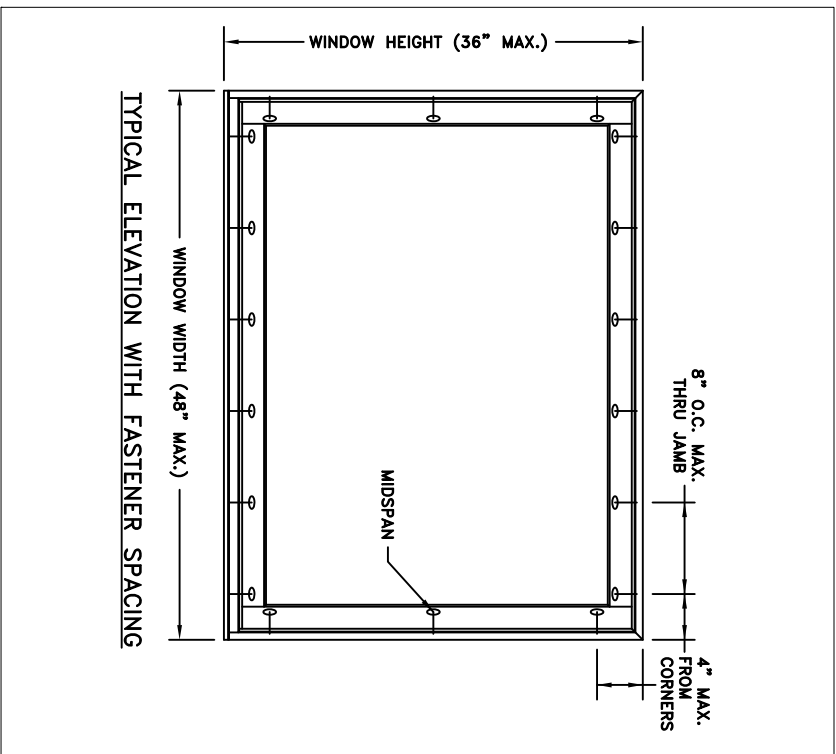

OPERATING AWNING WINDOW			
Max Frame	DP	IMPACT	
48 x 36	+50/-60	YES	

- Installed Fastener Schedule:**
1. Seal flange/frame to substrate.
  2. Install masonry straps to wood frame using #8 corrosion resistant fasteners no more than 4" from each corner and 16" o.c. along the jambs and head. Bend straps around buck and secure with #8 fastener thru masonry strap into buck. Fasteners must be long enough to penetrate at least 1" into framing members.
  3. Host structure (wood buck, stud framing and opening) to be designed and anchored to properly transfer all loads to the structure. The host structure is the responsibility of the architect or engineer of record for the project of installation.

- General Notes:**
1. The product shown herein is designed, tested and manufactured to comply with the wind load criteria of the adopted International Building Code (IBC), the International Residential Code (IRC), the Florida Building Code (FBC) and the Industry standard requirement for the stated conditions.
  2. Buck, framing and masonry by others and is responsibility of architect or engineer of record.
  3. All glazing shall conform to ASTM E1300.
  4. At minimum, glazing is 3.0mm annealed or tempered - 12.7mm airspace - 3.9mm annealed - 2.3mm SGP Interlayer by DuPont - 3.9mm annealed.

This schedule addresses only the fasteners required to anchor the window to achieve the rated design pressure and impact performance (where applicable) up to the size limitations noted. It is not intended as a guide to the installation process and does not address he sealing consideration that may arise in different wall conditions. For the complete installation procedure, see the instructions packaged with the window or go to [www.jeld-wen.com/resources/installation](http://www.jeld-wen.com/resources/installation).

**DISCLAIMER:**  
This drawing and its contents are confidential and are not to be reproduced or copied in whole or in part or used or disclosed to others except as authorized by JELD-WEN Inc.

PROJECT ENGINEER: --	DATE: 02/09/2015			3737 Lakeport Blvd Klamath Falls, OR, 97601 Phone: (541) 882-3451
DRAWN BY: D. Vezo	SCALE: NTS			
CHECKED BY: D. Stokes	TITLE: Custom Clad Awning with Extruded Sash Impact Window	Masonry Strap Installation (48" x 36")		
APPROVED BY: --				
PART/PROJECT No. D009187	PLANT NAME AND LOCATION: Bend, Oregon	CAD DWG. No.:	REV: 00	SHEET