
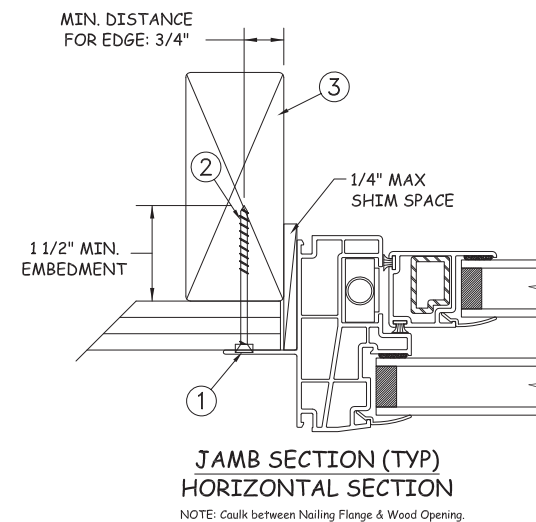
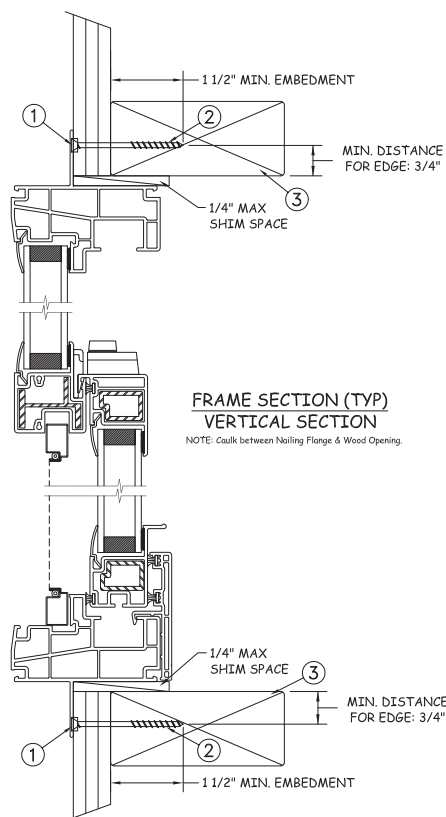


NAIL FIN INSTALLATION

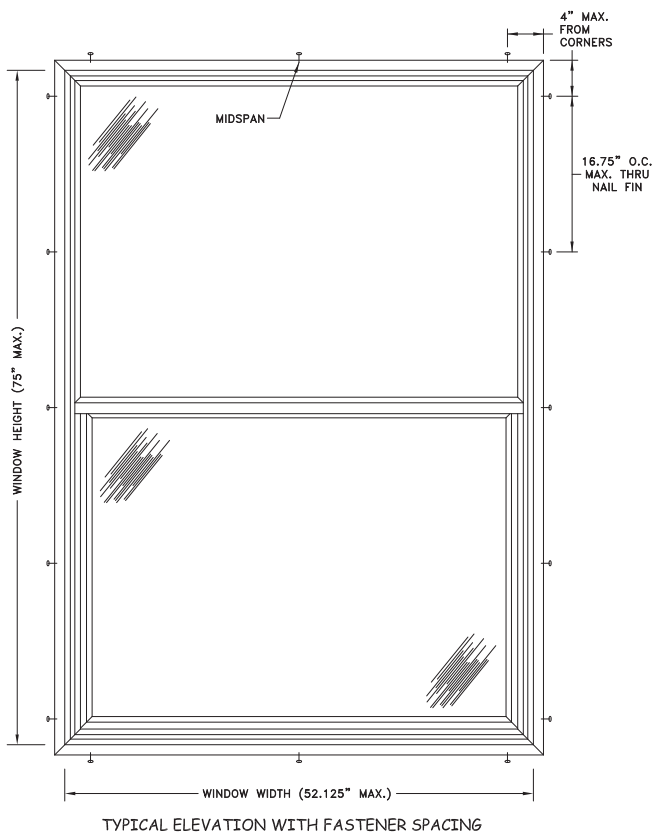

| | | |
|-------------|-----------|--------|
| Max Frame | DP RATING | IMPACT |
| 52.125 x 75 | +65/-70 | NO |

Installation Notes:

1. Seal flange/frame to substrate.
2. Use #10 PH or greater fastener through the nail fin with sufficient length to penetrate a minimum of 1 1/2" into the wood framing. For 2X wood frame substrate (min. S.G. = 0.42).
3. Host structure (wood buck, masonry, steel) to be designed and anchored to properly transfer all loads to the structure. The host structure is the responsibility of the architect or engineer of record for the project of installation.

Addendum to NAMI

Certification No: NI011567.07-R2

Reviewed By: *Dee*

Date Reviewed: 07/25/2017

This schedule addresses only the fasteners required to anchor the window to achieve the rated design pressure up to the size limitations noted. It is not intended as a guide to the installation process and does not address the sealing consideration that may arise in different wall conditions. For the complete installation procedure, see the instructions packaged with the window or go to www.jeld-wen.com/resources/installation.



DISCLAIMER:

This drawing and its contents are confidential and are not to be reproduced or copied in whole or in part or used or disclosed to others except as authorized by JELD-WEN Inc.


General Notes:

1. The product shown herein is designed, tested and manufactured to comply with the wind load criteria of the adopted International Building Code (IBC), the International Residential Code (IRC), the Florida Building Code (FBC) and the industry requirement for the stated conditions.
2. All glazing shall conform to ASTM E1300.
3. At minimum, glazing shall be 3.0mm annealed insulating glass.
4. Use structural or composite shims where required.

| | | | | | |
|-------------|------------------------------|-----------------------------------|--------------------------|---|-----------|
| "AS TESTED" | PROJECT ENGINEER: -- | DATE: 07/24/2017 | JELD-WEN | 3250 Lakeport Blvd Klamath Falls, OR. 97601 Phone: (541) 882-3451 | |
| | DRAWN BY: J.HAWKINS | SCALE: NTS | | Premium Atlantic Vinyl Single Hung Window | |
| | CHECKED BY: D.BELAU | TITLE: | | | |
| | APPROVED BY: J.GOSSSEN | | | | |
| | PART/PROJECT No.: D014587 | IDENTIFIER No. NCTL 210-3876-1 | PLANT NAME AND LOCATION: | CAD DWG. No.: PremATLVinylSH Cert | REV: A |

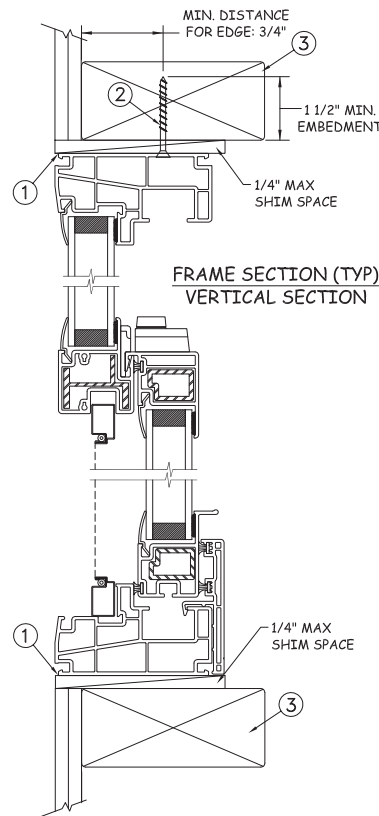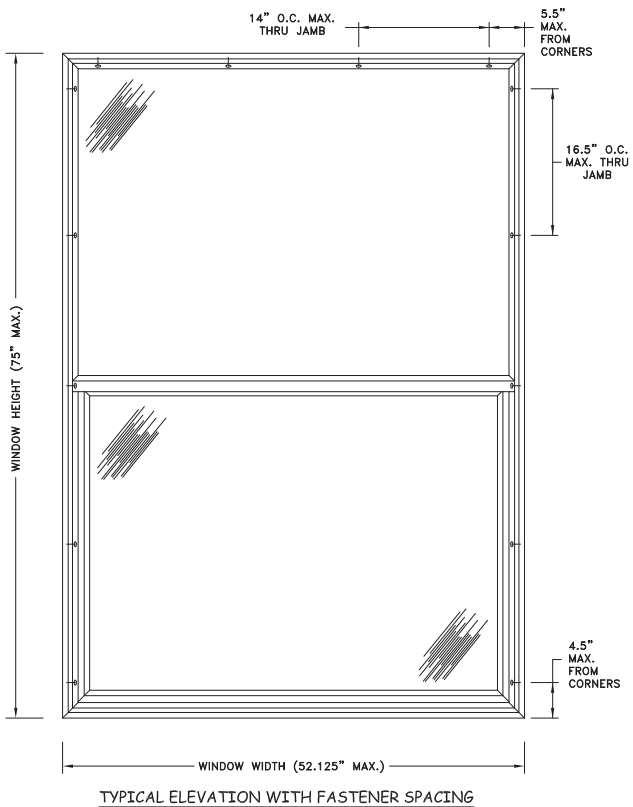

THROUGH FRAME
INSTALLATION

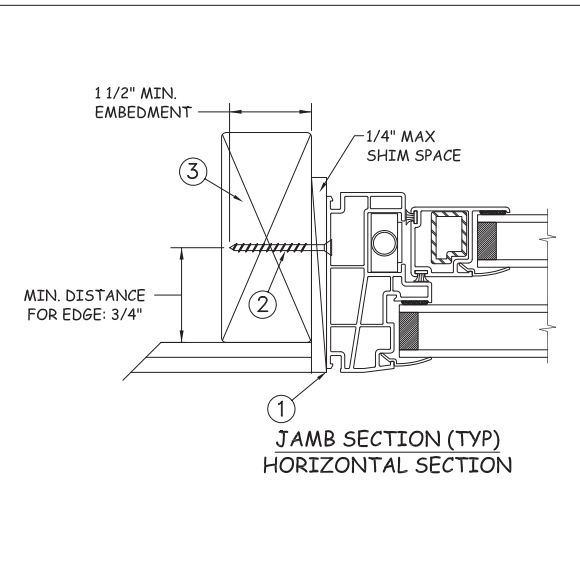

| | | |
|--------------------------|----------------------|--------------|
| Max Frame 52.125 x 75 | DP RATING +65/-70 | IMPACT NO |
|--------------------------|----------------------|--------------|

Installation Notes:

1. Seal flange/frame to substrate.
2. Use #10 PH or greater fastener through the frame with sufficient length to penetrate a minimum of 1 1/2" into the wood framing. For 2X wood frame substrate (min. S.G. = 0.42).
3. Host structure (wood buck, masonry, steel) to be designed and anchored to properly transfer all loads to the structure. The host structure is the responsibility of the architect or engineer of record for the project of installation.

Addendum to NAMI

Certification No: NI011567.07-R2

Reviewed By: *Dee*

Date Reviewed: 07/25/2017

This schedule addresses only the fasteners required to anchor the window to achieve the rated design pressure up to the size limitations noted. It is not intended as a guide to the installation process and does not address the sealing consideration that may arise in different wall conditions. For the complete installation procedure, see the instructions packaged with the window or go to www.jeld-wen.com/resources/installation.

DISCLAIMER:

This drawing and its contents are confidential and are not to be reproduced or copied in whole or in part or used or disclosed to others except as authorized by JELD-WEN Inc.

General Notes:

1. The product shown herein is designed, tested and manufactured to comply with the wind load criteria of the adopted International Building Code (IBC), the International Residential Code (IRC), the Florida Building Code (FBC) and the industry requirement for the stated conditions.
2. All glazing shall conform to ASTM E1300.
3. At minimum, glazing shall be 3.0mm annealed insulating glass.
4. Use structural or composite shims where required.

| | | | | | |
|-------------|------------------------------|--------------------------|--------------------------------------|---|-----------------|
| "AS TESTED" | PROJECT ENGINEER: -- | DATE: 07/24/2017 | | 3250 Lakeport Blvd Klamath Falls, OR. 97601 Phone: (541) 882-3451 | |
| | DRAWN BY: J.HAWKINS | SCALE: NTS | | <p>Premium Atlantic Vinyl Single Hung Window</p> | |
| | CHECKED BY: D.BELAU | TITLE: | | | |
| | APPROVED BY: J.GOOSSEN | | | | |
| | PART/PROJECT No.: D014587 | PLANT NAME AND LOCATION: | CAD DWG. No.: PremATLVinylSH Cert | REV: A | SHEET 2 OF 4 |