


UNI-K FENESTRATION HORIZONTAL ROLLER WINDOW LARGE MISSILE IMPACT

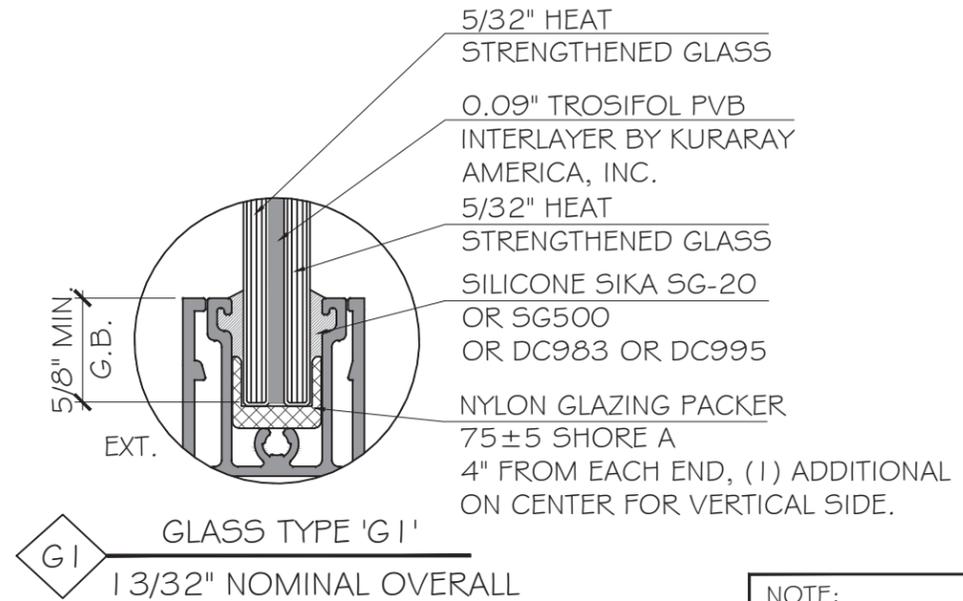

GENERAL NOTES:

- THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE REQUIREMENTS OF THE 2023 (8TH EDITION) FLORIDA BUILDING CODE INCLUDING HIGH VELOCITY HURRICANE ZONE (HVHZ).
- WINDOWS ARE RATED FOR LARGE MISSILE IMPACT. IMPACT SHUTTERS ARE NOT REQUIRED.
- THESE WINDOWS ARE APPROVED FOR AIR AND WATER INFILTRATION.
- ANCHORS SHALL BE AS LISTED, SPACED AS SHOWN ON DETAILS. ANCHORS EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.
- ANCHORING OR LOADING CONDITIONS NOT SHOWN IN THESE DETAILS ARE NOT PART OF THIS APPROVAL.
- MATERIALS INCLUDING BUT NOT LIMITED TO STEEL/ METAL SCREWS THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF THE 2023 (8TH EDITION) FLORIDA BUILDING CODE SECTION AS APPLICABLE.
- METAL STRUCTURES BY OTHERS TO BE DESIGNED TO SUPPORT THE LOADS IMPOSED BY THIS GLAZING SYSTEM AND TO TRANSFER SUCH LOADS TO THE BUILDING MAIN STRUCTURE.
- ULTIMATE LOAD OBTAINED FROM ASCE 7-22, MULTIPLY BY 0.6 SHALL BE LESS THAN OR EQUAL TO MAX. DESIGN LOAD IN THIS DOCUMENT. THE DESIGN LOADS SHOWN IN THIS DOCUMENT ARE ALLOWABLE DESIGN LOADS.
- SEALANT:
ALL FRAME CORNERS, JOINTS, MULLION SEAMS AND PERIMETER GLAZING BEAD TO FRAME INSTALLATION FASTENERS SEALED WITH SILICONE SEALANT.
- MANUFACTURER'S LABEL SHALL BE LOCATED ON A READILY VISIBLE LOCATION IN ACCORDANCE WITH SECTION 1709.9.3 OF FLORIDA BUILDING CODE LABELING TO COMPLY WITH SECTION 1709.9.2.
- HARDWARE CHECKED FOR WIND LOAD IN CLOSED POSITION ONLY; OPERATION PER MANUFACTURER'S INSTRUCTIONS. WINDOWS MUST BE CLOSED AND SECURED WHEN A HURRICANE WARNING IS ISSUED.

USE CHARTS AS FOLLOWS.

- STEP 1:** DETERMINE DESIGN WIND LOAD REQUIREMENTS BASED ON WIND VELOCITY, BLDG. HEIGHT, WIND ZONE USING APPLICABLE ASCE 7-22 STANDARD OR WIND TUNNEL REPORTS.
- STEP 2:** SEE SHEET E1 TO E3 FOR APPROVED TYPICAL ELEVATION #CONFIGURATION. SEE SHEET G1 FOR GLASS CAPACITY.
- STEP 3:** ANCHOR TYPE SEE SHEET A1 TO A4. ANCHOR SPACING SEE SHEET E1 TO E3.
- STEP 4:** THE LOWEST VALUE RESULTING FROM STEPS 2 & 3 THAT EXCEED THE DESIGN WIND PRESSURES DETERMINED THRU STEP 1 SHALL APPLY TO ENTIRE SYSTEM.

NOTE:
GLASS COMPLIES WITH ASTM E1300-09 (3 SEC. GUSTS).

ABBREVIATIONS AND SYMBOLS	
G.B. - GLASS BITE	
D.L.O. - DAYLITE OPENING	
F.H. - FRAME HEIGHT	
F.W. - FRAME WIDTH	
W/ - WITH	
W/O - WITHOUT	
O.C. - ON CENTER	

LIMITATIONS OF USE

A- THIS PRODUCT EVALUATION DOCUMENT (P.E.D.) PREPARED BY THIS ENGINEER IS GENERIC AND DOES NOT PROVIDE INFORMATION FOR A SITE SPECIFIC PROJECT; i.e. WHERE THE SITE CONDITIONS DEVIATE FROM THE P.E.D.

B- CONTRACTOR TO BE RESPONSIBLE FOR THE SELECTION, PURCHASE AND INSTALLATION OF THIS PRODUCT BASED ON THIS PRODUCT EVALUATION PROVIDED HE/SHE DOES NOT DEVIATE FROM THE CONDITIONS DETAILED ON THIS DOCUMENT.

C- THIS PRODUCT EVALUATION DOCUMENT WILL BE CONSIDERED INVALID IF ALTERED BY ANY MEANS.

D- SITE SPECIFIC PROJECTS SHALL BE PREPARED BY A FLORIDA REGISTERED ENGINEER OR ARCHITECT WHICH WILL BECOME THE ENGINEER OF RECORD (E.O.R.) FOR THE PROJECT AND WHO WILL BE RESPONSIBLE FOR THE PROPER USE OF THE P.E.D.

E- THIS P.E.D. SHALL BEAR THE DATE AND ORIGINAL SEAL AND SIGNATURE OF THE PROFESSIONAL ENGINEER OF RECORD THAT PREPARED IT.

FLORIDA APPROVAL:
FL47984.1

YIPING WANG
FLORIDA REGISTRATION
No. 55989
C.A.N. 28877
STATE OF FLORIDA
PROFESSIONAL ENGINEER
February 06th, 2026

MCY ENGINEERING, INC.
GLAZING CONSULTANTS

12781 MIRAMAR PARKWAY #301
MIRAMAR, FL 33027 P: 305.588.5224
www.MCYEngineering.com mcy@mcyengineering.com

HORIZONTAL ROLLER WINDOW - LMI

UNI-K Fenestration
KM 8.5 VIA DURAN TAMBO
GUAYAS, ECUADOR
<https://www.unik-windows.com>



Rev. No.	Date	Drawn By	Description
01	12.27.2025	James	NEW APPLICATION

Drawn Date: 12.27.2025 Scale: AS SHOWN

DRAWING NO.
AD25-56

COVER

Sheet No.
1 OF 16

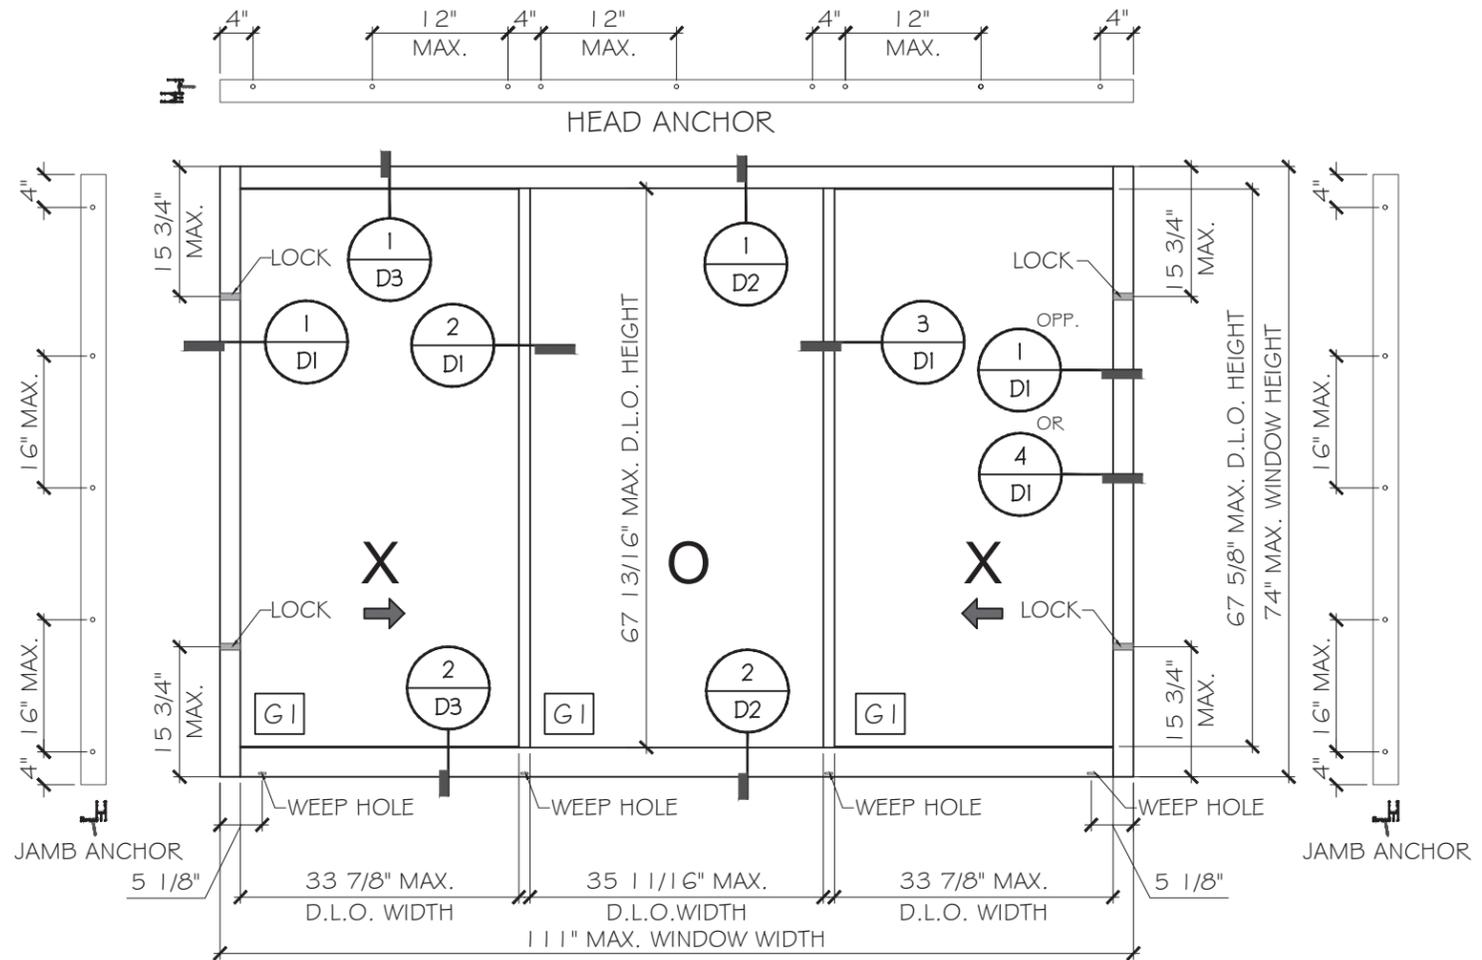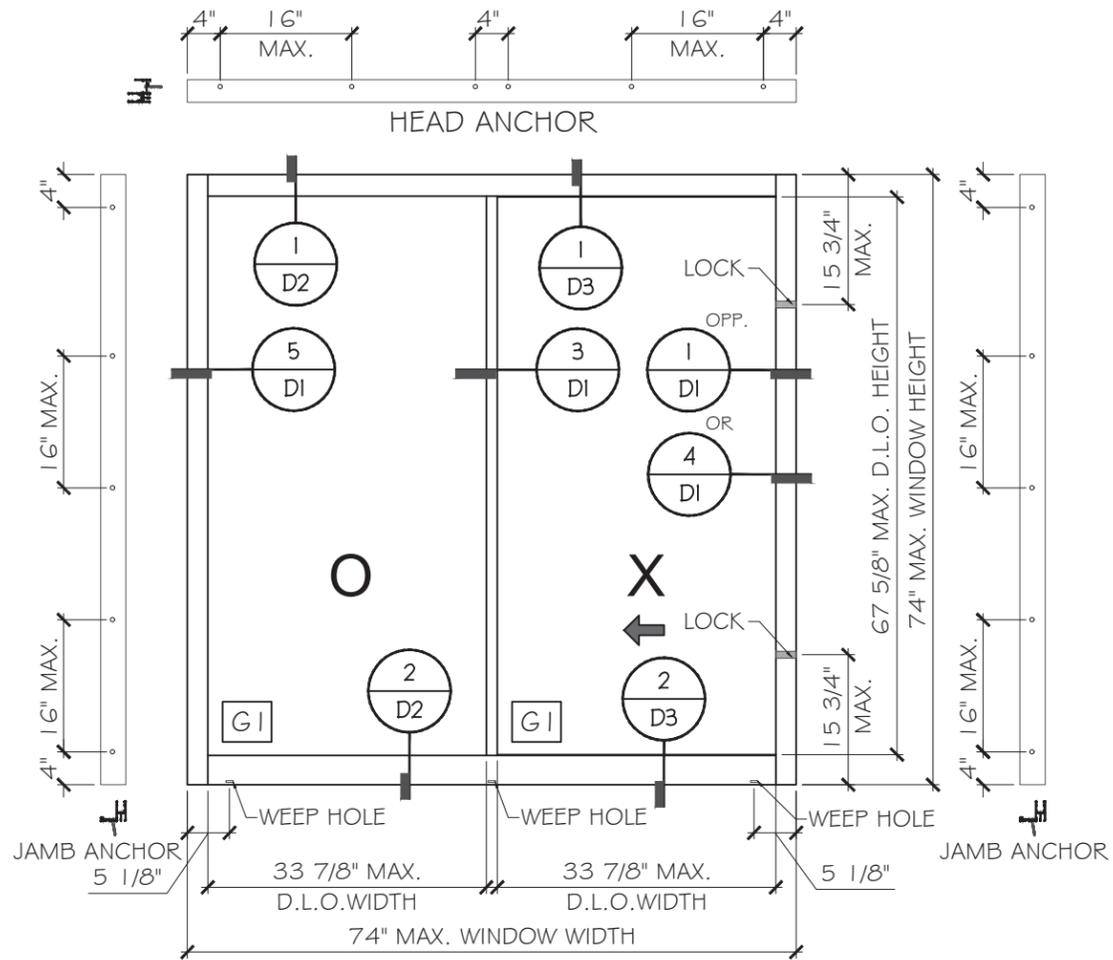


TYPICAL EXTERIOR ELEVATIONS

MAX. DESIGN LOAD: ± 55 PSF
 SEE SHEET G1 FOR OTHER SIZE & DESIGN LOAD.
 SEE SHEET A1 TO A4 FOR ANCHOR OPTIONS

TYPICAL EXTERIOR ELEVATIONS

MAX. DESIGN LOAD: ± 55 PSF
 SEE SHEET G1 FOR OTHER SIZE & DESIGN LOAD.
 SEE SHEET A1 TO A4 FOR ANCHOR OPTIONS

FLORIDA APPROVAL:
FL47984.1

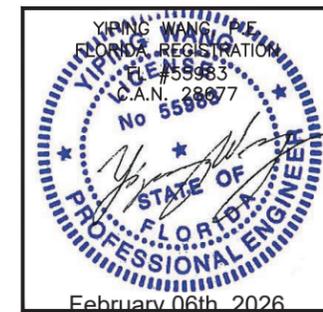

HORIZONTAL ROLLER WINDOW - LMI
UNI-K Fenestration
 KM 8.5 VIA DURAN TAMBO
 GUAYAS, ECUADOR
<https://www.unik-windows.com>

Rev. No.	Date	Drawn By	Description
01	12.27.2025	James	NEW APPLICATION




Drawn Date: 12.27.2025
 Scale: AS SHOWN

DRAWING NO.
AD25-56


Sheet No.
E1

2 OF 16


MCY ENGINEERING, INC.
 GLAZING CONSULTANTS
 12781 MIRAMAR PARKWAY #301
 MIRAMAR, FL 33027
 P: 305.588.5224
www.MCYEngineering.com
mcy@mcyengineering.com

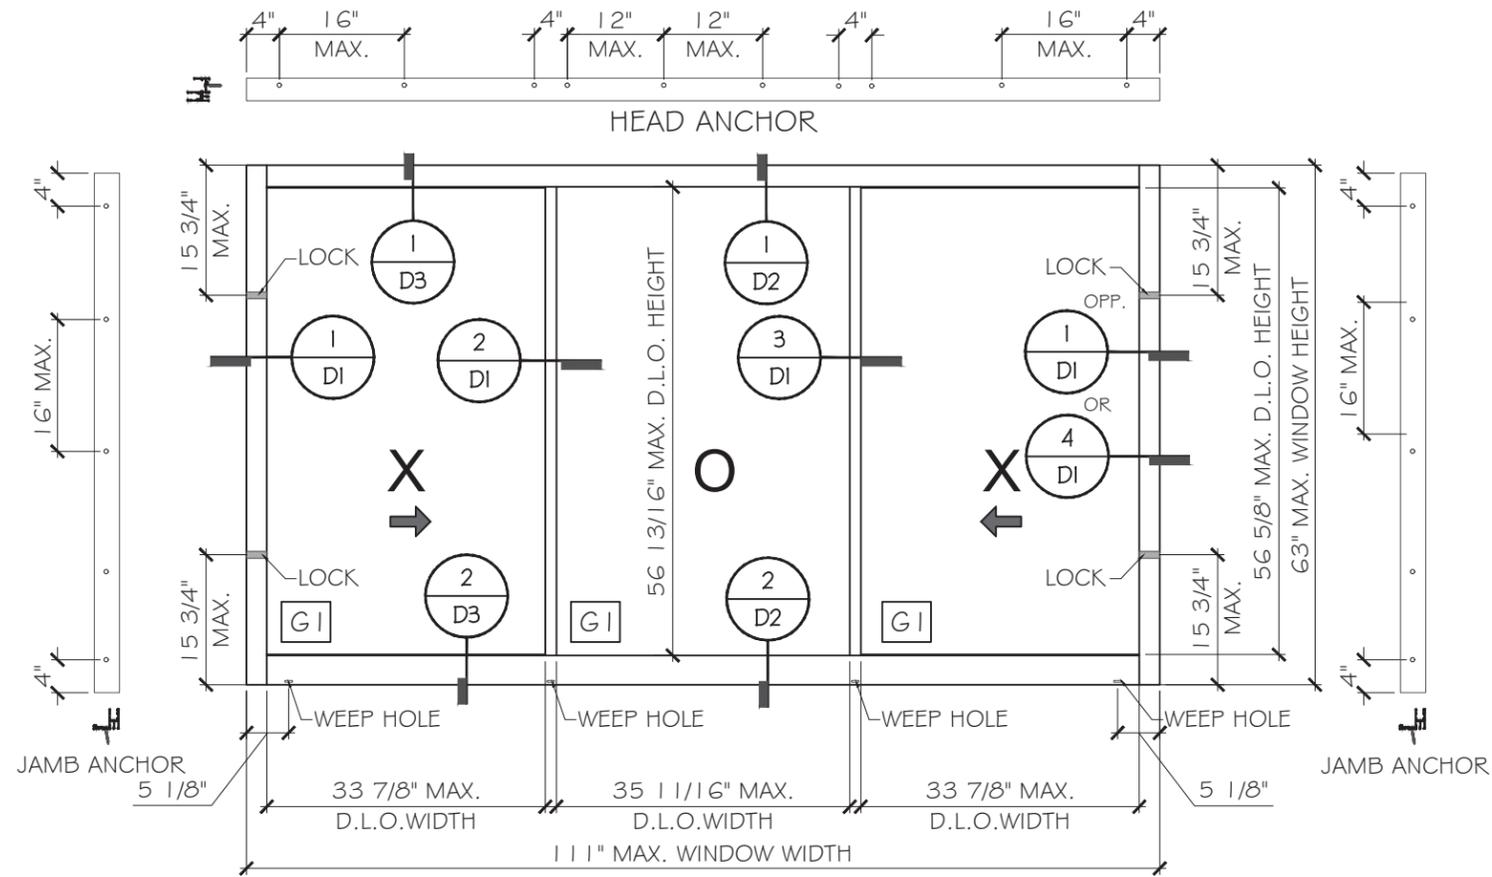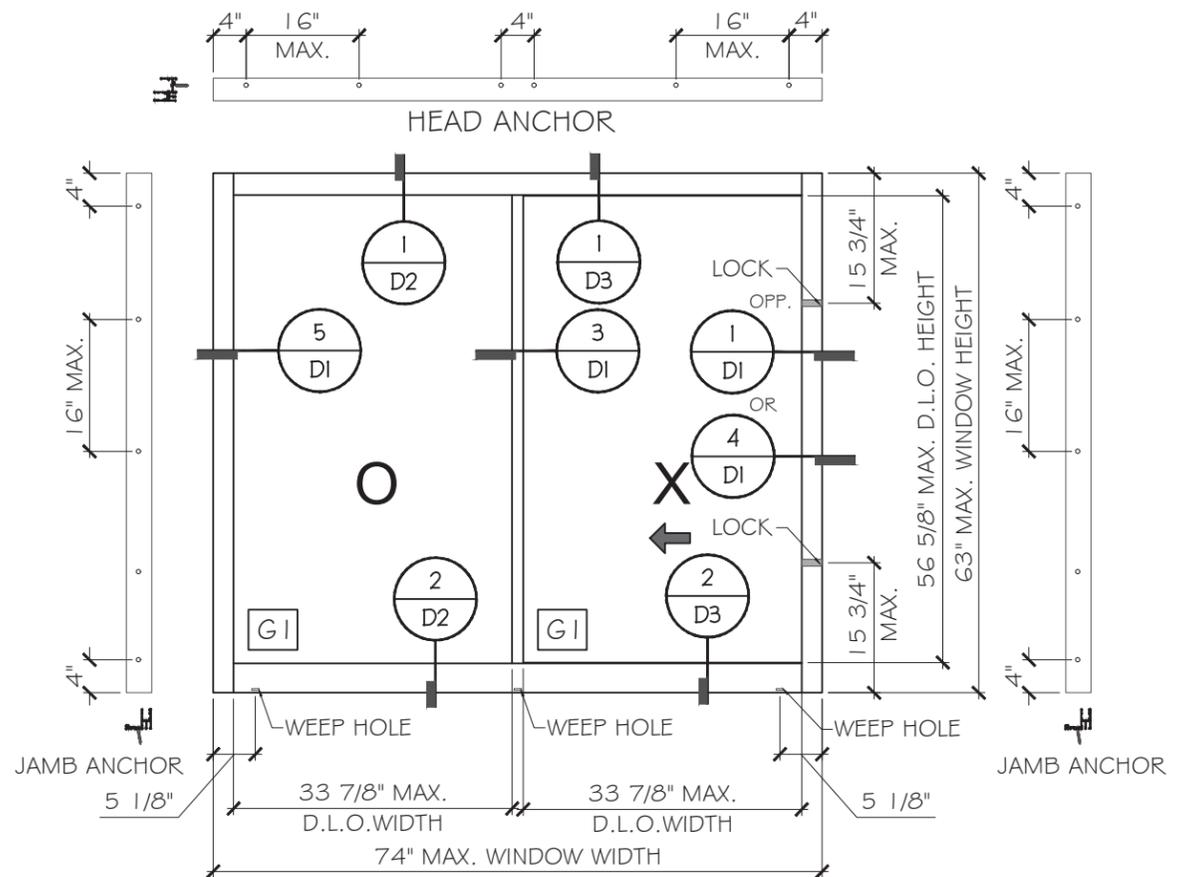


SILL ANCHOR LAYOUT (TYPE A & B & C & AA & CC)



SILL ANCHOR LAYOUT (TYPE A & B & C & AA & CC)



SILL ANCHOR LAYOUT (TYPE BB)



SILL ANCHOR LAYOUT (TYPE BB)


TYPICAL EXTERIOR ELEVATIONS

MAX. DESIGN LOAD: ± 75 PSF
 SEE SHEET G1 FOR OTHER SIZE & DESIGN LOAD.
 SEE SHEET A1 TO A4 FOR ANCHOR OPTIONS



TYPICAL EXTERIOR ELEVATIONS

MAX. DESIGN LOAD: ± 75 PSF
 SEE SHEET G1 FOR OTHER SIZE & DESIGN LOAD.
 SEE SHEET A1 TO A4 FOR ANCHOR OPTIONS


FLORIDA APPROVAL:
FL47984.1

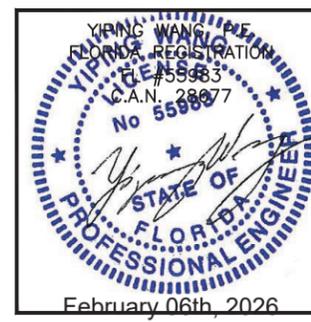

Rev. No.	Date	Drawn By	Description
01	12.27.2025	James	NEW APPLICATION
Drawn Date: 12.27.2025		Scale: AS SHOWN	
DRAWING NO. AD25-56			
Sheet No. E2			
3 OF 16			

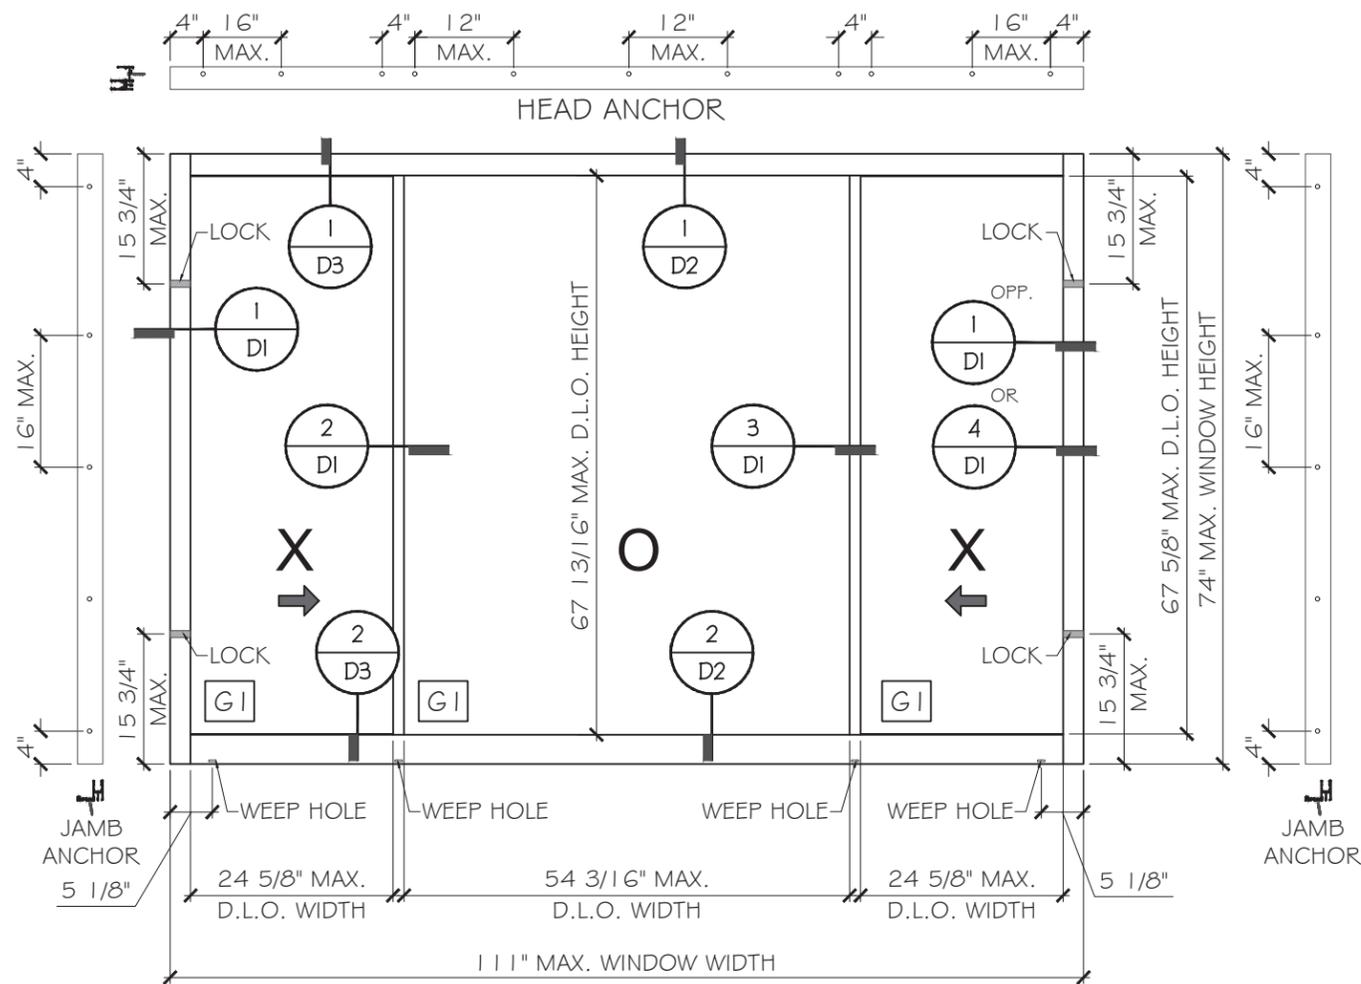


SILL ANCHOR LAYOUT (TYPE A & B & C & AA & CC)




SILL ANCHOR LAYOUT (TYPE BB)

TYPICAL EXTERIOR ELEVATIONS

MAX. DESIGN LOAD: ± 55 PSF
 SEE SHEET G1 FOR OTHER SIZE & DESIGN LOAD.
 SEE SHEET A1 TO A4 FOR ANCHOR OPTIONS

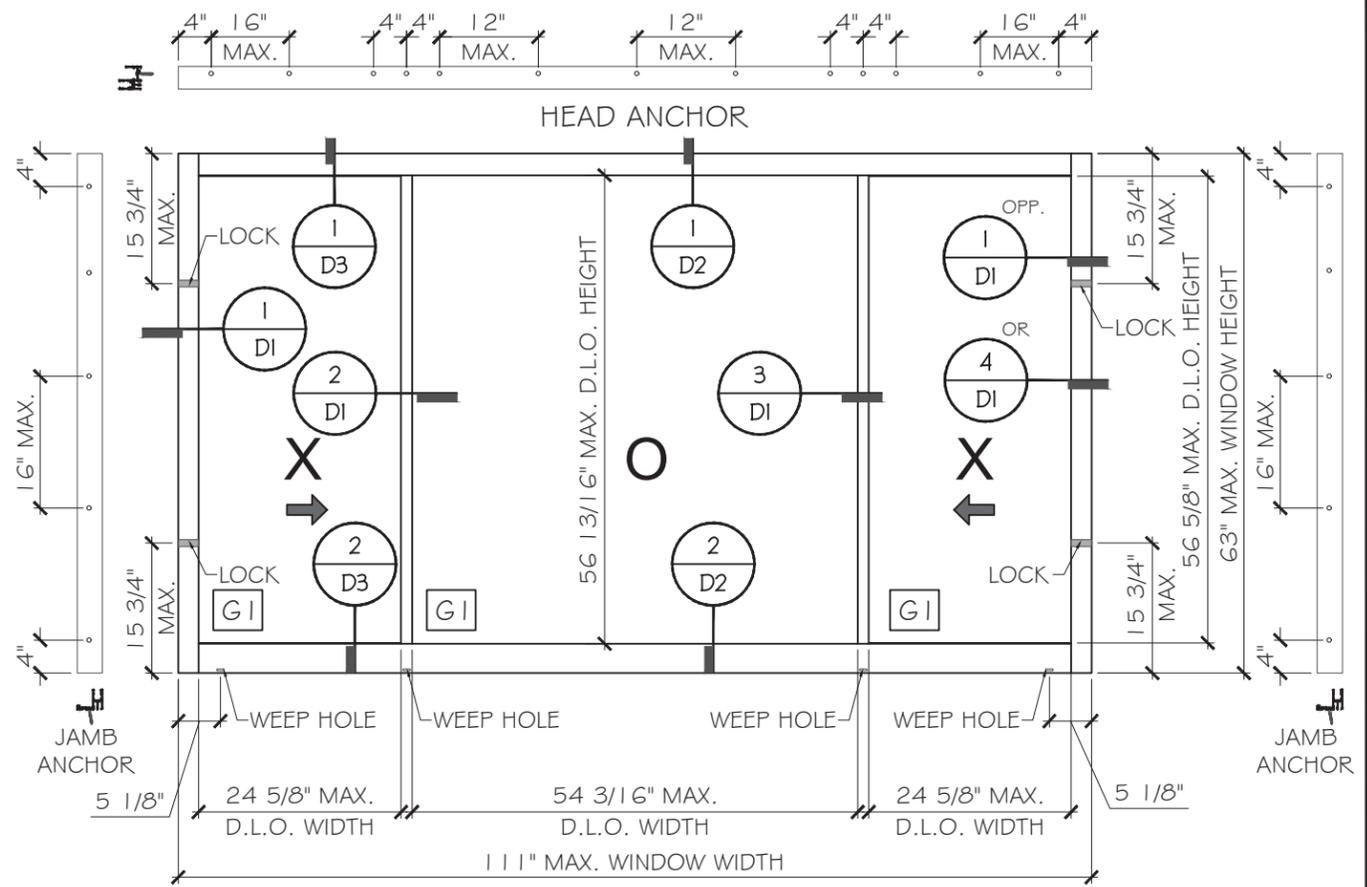

SILL ANCHOR LAYOUT (TYPE A & B & C & AA & CC)




SILL ANCHOR LAYOUT (TYPE BB)

TYPICAL EXTERIOR ELEVATIONS

MAX. DESIGN LOAD: ± 75 PSF
 SEE SHEET G1 FOR OTHER SIZE & DESIGN LOAD.
 SEE SHEET A1 TO A4 FOR ANCHOR OPTIONS

FLORIDA APPROVAL:
 FL47984.1

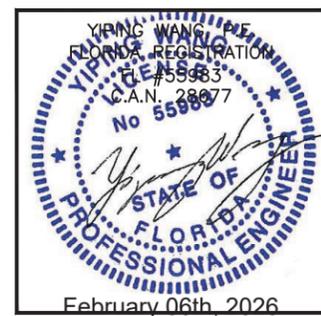

Rev. No.	Date	Drawn By	Description
01	12.27.2025	James	NEW APPLICATION




Drawn Date	Scale
12.27.2025	AS SHOWN
DRAWING NO.	
AD25-56	
Sheet No.	
E3	
4 OF 16	

DESIGN LOAD CAPACITY-PSF (XO OR OX COMMODITY SIZE)		
WINDOW WIDTH	WINDOW HEIGHT	G I (LMI)
INCH	INCH	(+/-)
26 1/2	26	75.0
37		75.0
53 1/8		75.0
74		75.0
26 1/2	39	75.0
37		75.0
53 1/8		75.0
74		75.0
26 1/2	51	75.0
37		75.0
53 1/8		75.0
74		75.0
26 1/2	56	75.0
37		75.0
53 1/8		75.0
74		75.0
26 1/2	63	75.0
37		75.0
53 1/8		75.0
74		75.0
26 1/2	74	55.0
37		55.0
53 1/8		55.0
74		55.0


DESIGN LOAD CAPACITY-PSF (XOX COMMODITY SIZE)		
WINDOW WIDTH	WINDOW HEIGHT	G I (LMI)
INCH	INCH	(+/-)
74	26	75.0
106 1/4		75.0
111		75.0
74	39	75.0
106 1/4		75.0
111		75.0
74	51	75.0
106 1/4		75.0
111		75.0
74	56	75.0
106 1/4		75.0
111		75.0
74	63	75.0
106 1/4		75.0
111		75.0
74	74	55.0
106 1/4		55.0
111		55.0

DESIGN LOAD CAPACITY-PSF (XO OR OX STANDARD SIZE)			
WINDOW WIDTH	WINDOW HEIGHT	G I (LMI)	
INCH	INCH	(+/-)	
36	48	75.0	
48		75.0	
60		75.0	
72		75.0	
84		75.0	
36	60	75.0	
48		75.0	
60		75.0	
72		75.0	
84		55.0	
36	63	75.0	
48		75.0	
60		75.0	
72		75.0	
74		75.0	
36	74	55.0	
48		55.0	
60		55.0	
72		55.0	
74		55.0	
36	80	55.0	
48		55.0	
60		51.3	
36		86	55.0
48			50.3
60	41.0		

DESIGN LOAD CAPACITY-PSF (XOX STANDARD SIZE)		
WINDOW WIDTH	WINDOW HEIGHT	G I (LMI)
INCH	INCH	(+/-)
54	48	75.0
72		75.0
90		75.0
108		75.0
126		75.0
54	60	75.0
72		75.0
90		75.0
108		75.0
126		55.0
54	63	75.0
72		75.0
90		75.0
108		75.0
111		75.0
54	74	55.0
72		55.0
90		55.0
108		55.0
111		55.0
54	80	55.0
72		55.0
90		51.3
54	86	55.0
72		50.3
90		41.0

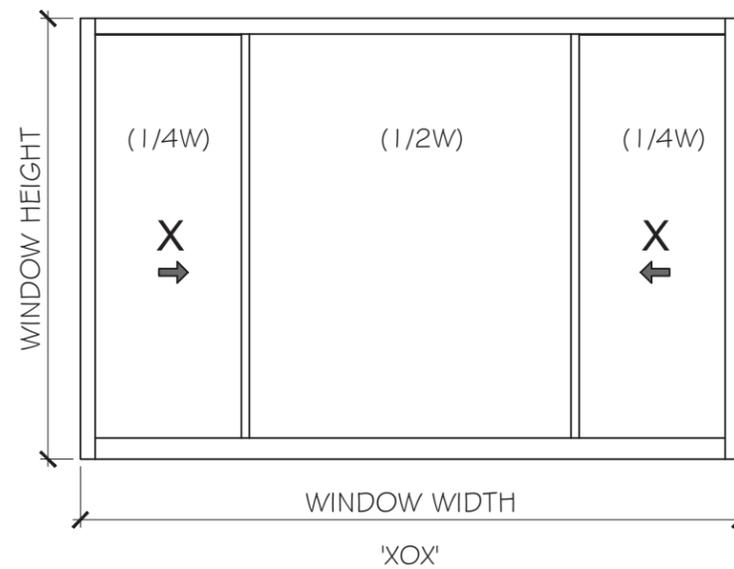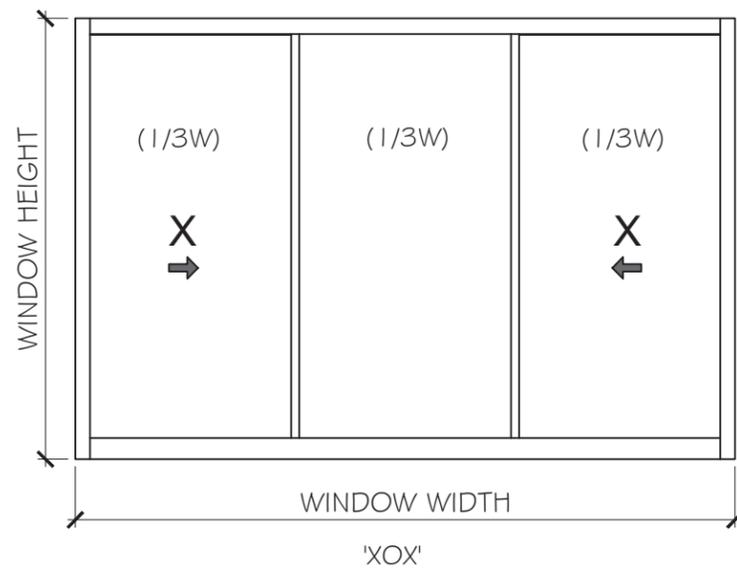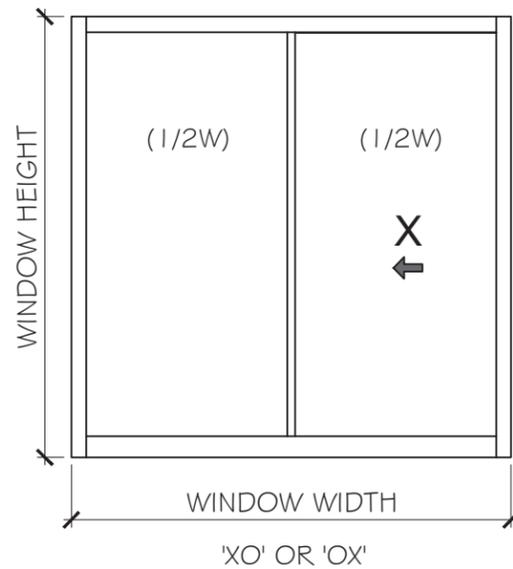

FLORIDA APPROVAL:
FL47984.1

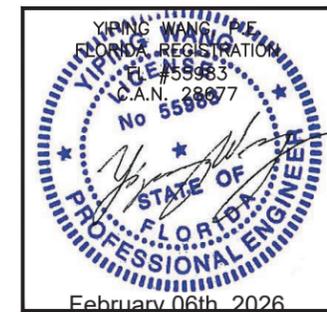

MCY ENGINEERING, INC.
GLAZING CONSULTANTS
12781 MIRAMAR PARKWAY #301
MIRAMAR, FL 33027 P: 305.588.5224
www.MCYEngineering.com mcy@mcyengineering.com

HORIZONTAL ROLLER WINDOW - LMI
UNI-K Fenestration
KM 8.5 VIA DURAN TAMBO
GUAYAS, ECUADOR
https://www.unik-windows.com

Rev. No.	Date	Drawn By	Description
01	12.27.2025	James	NEW APPLICATION

Drawn Date: 12.27.2025 Scale: AS SHOWN

DRAWING NO.
AD25-56

G I

Sheet No.
5 OF 16

HEAD TYPICAL ANCHOR TYPES:

ANCHOR TYPE 'A' - 1/4" DIA. ULTRACON+ BY 'DEWALT' (Fu= 164 KSI, Fy= 148 KSI) INTO 2BY WOOD BUCKS OR WOOD STRUCTURE WITH 1 1/2" MIN. PENETRATION. OR THRU 1 BY/2BY WOOD BUCKS INTO CONCRETE WITH 1 3/4" MIN. EMBEDMENT.








ANCHOR TYPE 'B' - 1/4" DIA. ULTRACON+ BY 'DEWALT' (Fu= 164 KSI, Fy= 148 KSI) DIRECTLY INTO CONCRETE W/1 3/4" MIN. EMBEDMENT.

ANCHOR TYPE 'C' - 1/4" DIA. SELF-DRILLING SCREWS, GRADE 5 (Fu= 120KSI, Fy=92KSI) INTO F.B.C. APPROVED ALUMINUM MULLIONS OR METAL STRUCTURES. (3) THREADS MIN. PENETRATION BEYOND METAL SUBSTRATE. (STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

TYPICAL EDGE DISTANCE INTO CONCRETE = 1 7/8" MIN. INTO WOOD = 7/8" MIN. INTO METAL STRUCTURE = 3/4" MIN.

SUBSTRATE
WOOD :SG=0.55MIN.
CONCRETE : f'c=3000 PSI MIN.
ALUMINUM : 1/8" THK. MIN. (6063-T5, MIN)
STEEL : 12GA THK. MIN. (Fy=36KSI MIN)

NOTE:
METAL STRUCTURES OR WOOD STRUCTURES BY OTHERS TO BE DESIGNED AND ANCHORED PROPERLY TO SUPPORT THE LOADS IMPOSED BY THIS GLAZING SYSTEM AND TO TRANSFER SUCH LOADS TO THE BUILDING MAIN STRUCTURE.

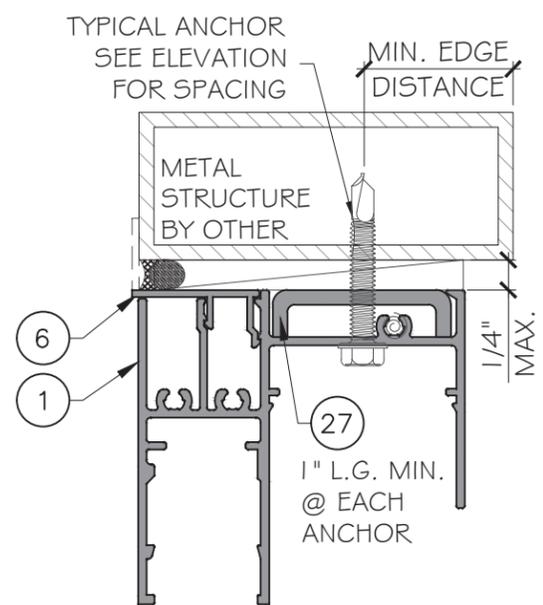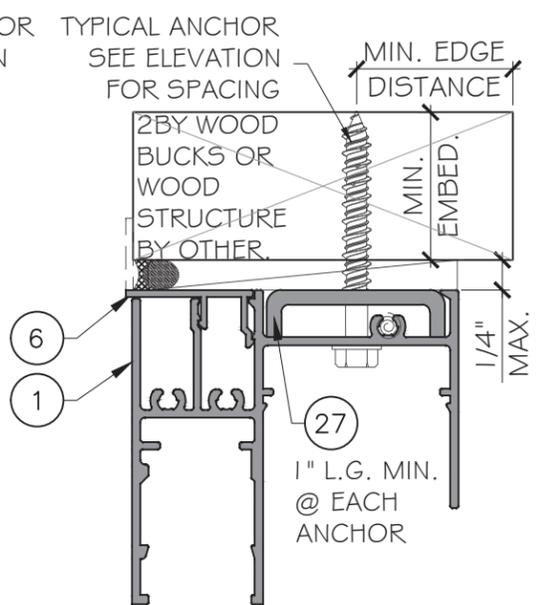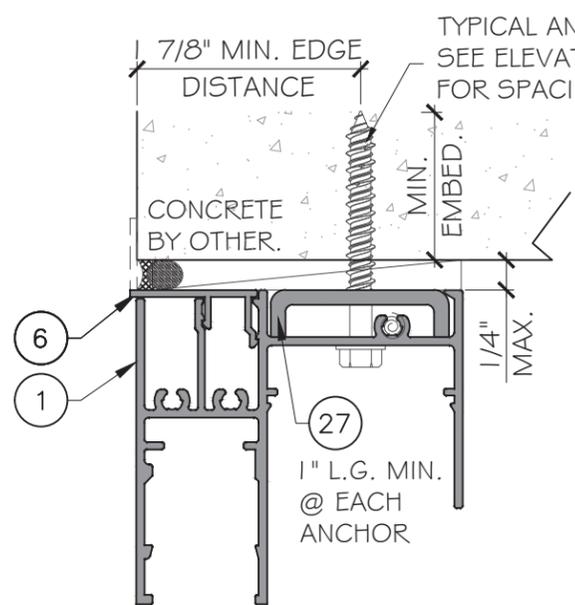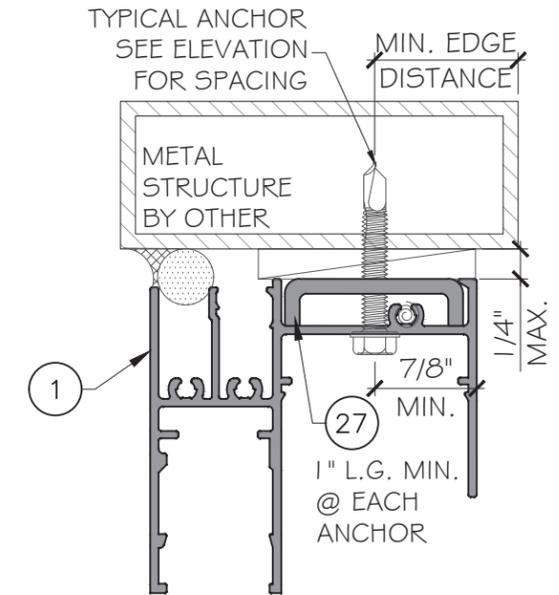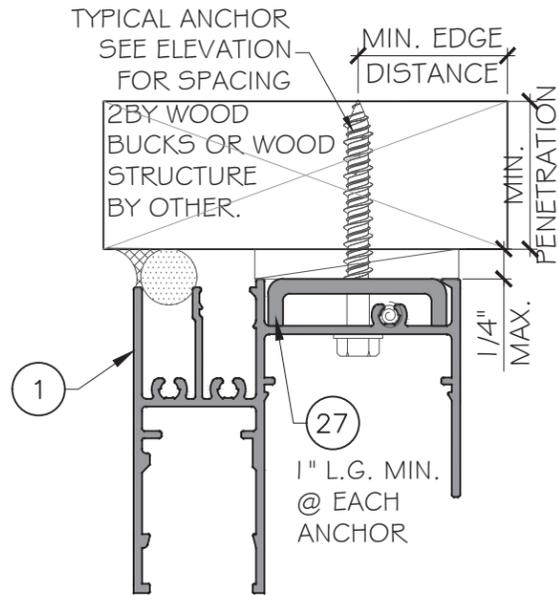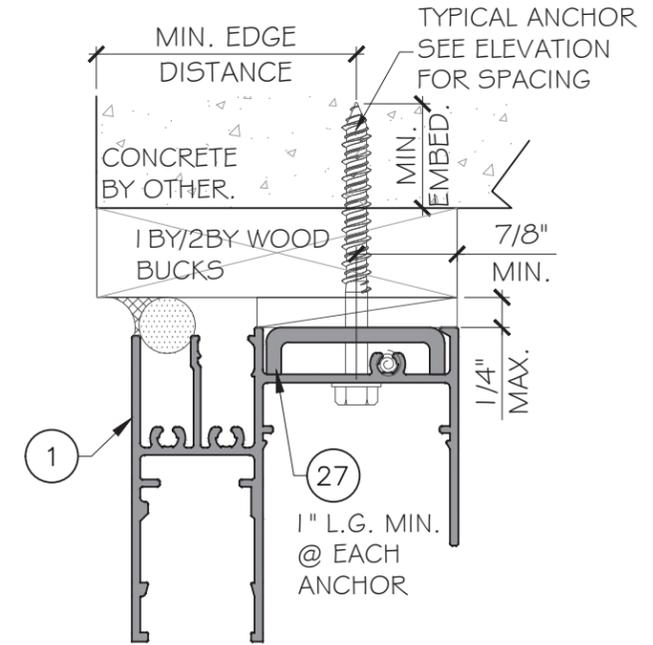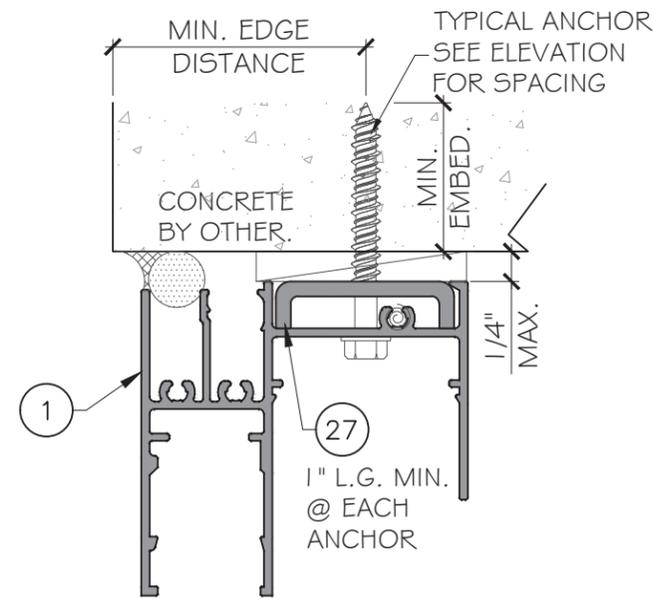

Drawn Date	Scale
12.27.2025	AS SHOWN
DRAWING NO.	
AD25-56	
Sheet No.	
6 OF 16	

FLORIDA APPROVAL:
FL47984.1

YIPING WANG
FLORIDA REGISTRATION
No. 55983
C.A.N. 28877
STATE OF FLORIDA
PROFESSIONAL ENGINEER
February 06th, 2026

JAMB TYPICAL ANCHOR TYPES:

ANCHOR TYPE 'A' - 1/4" DIA. ULTRACON+ BY 'DEWALT' (Fu=164 KSI, Fy=148 KSI) INTO 2BY WOOD BUCKS OR WOOD STRUCTURE WITH 1 1/2" MIN. PENETRATION.

ANCHOR TYPE 'B' - 1/4" DIA. ULTRACON+ BY 'DEWALT' (Fu=164 KSI, Fy=148 KSI) DIRECTLY INTO CONCRETE OR GROUT FILLED BLOCK W/1 1/2" MIN. EMBEDMENT. OR THRU 1 BY/2BY WOOD BUCKS INTO CONCRETE OR GROUT FILLED BLOCK WITH 1 1/2" MIN. EMBEDMENT.

ANCHOR TYPE 'C' - 1/4" DIA. SELF-DRILLING SCREWS, GRADE 5 (Fu=120KSI, Fy=92KSI) INTO F.B.C. APPROVED ALUMINUM MULLIONS OR METAL STRUCTURES.

(3) THREADS MIN. PENET

RATION BEYOND METAL SUBSTRATE.

(STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

TYPICAL EDGE DISTANCE

INTO CONCRETE = 1 1/4" MIN.

INTO WOOD = 1 1/4" MIN.

INTO METAL STRUCTURE = 3/4" MIN.

SUBSTRATE

WOOD :SG=0.55MIN.

CONCRETE : f_c=3000 PSI MIN.






C-90 GROUT FILLED BLOCK: f_m=2 KSI.

ALUMINUM : 1/8" THK. MIN. (6063-T5, MIN)


STEEL : 12GA THK. MIN. (F_y=36KSI MIN)

NOTE:

METAL STRUCTURES OR WOOD STRUCTURES BY OTHERS TO BE DESIGNED AND ANCHORED PROPERLY TO SUPPORT THE LOADS IMPOSED BY THIS GLAZING SYSTEM AND TO TRANSFER SUCH LOADS TO THE BUILDING MAIN STRUCTURE.

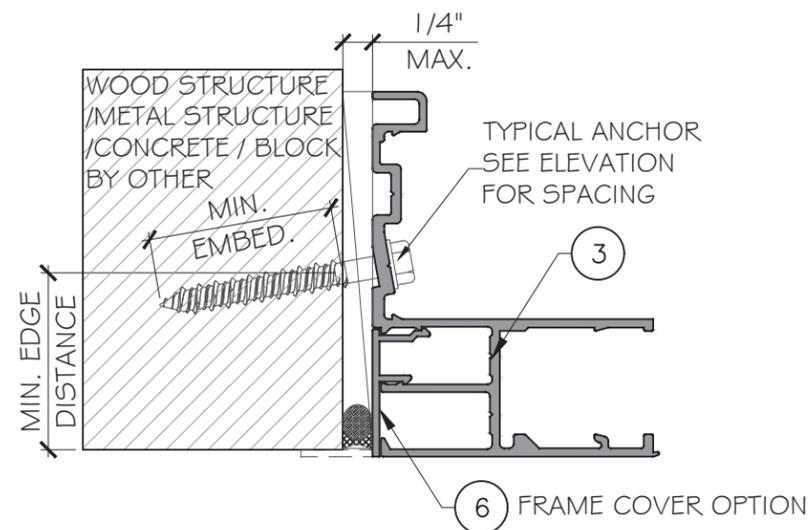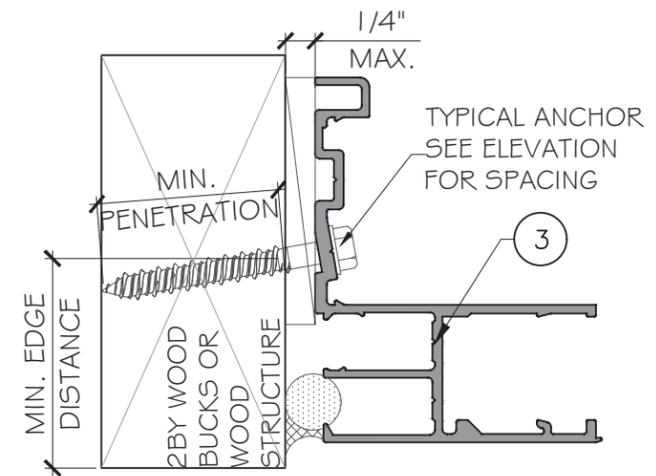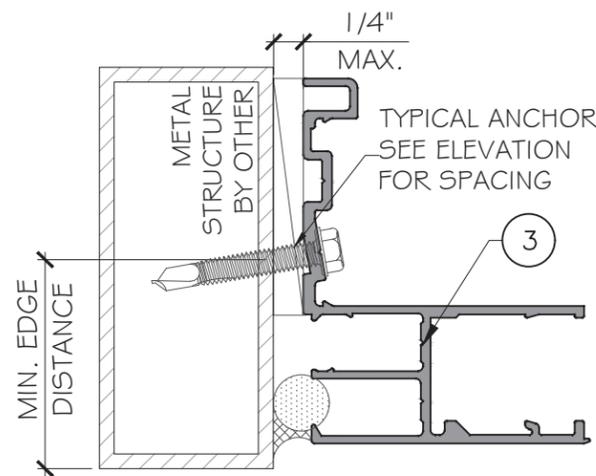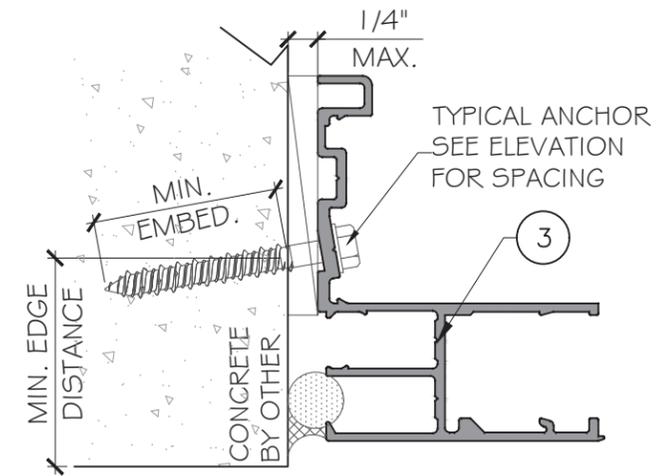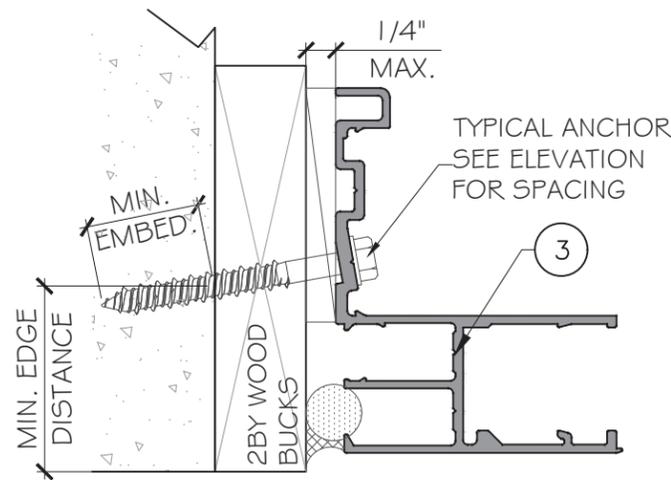

FLORIDA APPROVAL:
FL47984.1

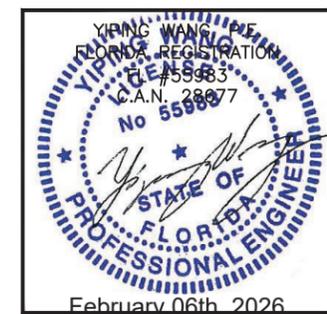

HORIZONTAL ROLLER WINDOW - LMI

UNI-K Fenestration

KM 8.5 VIA DURAN TAMBO
GUAYAS, ECUADOR

https://www.unik-windows.com

MCY ENGINEERING, INC.

GLAZING CONSULTANTS

12781 MIRAMAR PARKWAY #301
MIRAMAR, FL 33027

P: 305.588.5224
www.MCYEngineering.com mcy@mcyengineering.com

Rev. No.	Date	Drawn By	Description
01	12.27.2025	James	NEW APPLICATION

Drawn Date: 12.27.2025
Scale: AS SHOWN

DRAWING NO.
AD25-56

Sheet No.
A2

7 OF 16

SILL TYPICAL ANCHOR TYPES:

ANCHOR TYPE 'A' - 1/4" DIA. ULTRACON+ BY 'DEWALT' (Fu= 164 KSI, Fy= 148 KSI)
 INTO 2BY WOOD BUCKS OR WOOD STRUCTURE
 WITH 1 1/2" MIN. PENETRATION.




ANCHOR TYPE 'B' - 1/4" DIA. ULTRACON+ BY 'DEWALT' (Fu= 164 KSI, Fy= 148 KSI)
 DIRECTLY INTO CONCRETE W/ 1 3/4" MIN. EMBEDMENT.

ANCHOR TYPE 'C' - 1/4" DIA. SELF-DRILLING SCREWS, GRADE 5 (Fu= 120KSI, Fy=92KSI)
 INTO F.B.C. APPROVED ALUMINUM MULLIONS OR METAL STRUCTURES.
 (3) THREADS MIN. PENETRATION BEYOND METAL SUBSTRATE.
 (STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)


TYPICAL EDGE DISTANCE
 INTO CONCRETE = 1 7/8" MIN.
 INTO WOOD = 7/8" MIN.
 INTO METAL STRUCTURE = 3/4" MIN.

SUBSTRATE
 WOOD :SG=0.55MIN.
 CONCRETE : f'c=3000 PSI MIN.
 ALUMINUM : 1/8" THK. MIN. (6063-T5, MIN)
 STEEL : 12GA THK. MIN. (Fy=33KSI MIN)

NOTE:
 METAL STRUCTURES OR WOOD STRUCTURES BY OTHERS TO BE DESIGNED AND
 ANCHORED PROPERLY TO SUPPORT THE LOADS IMPOSED BY THIS GLAZING
 SYSTEM AND TO TRANSFER SUCH LOADS TO THE BUILDING MAIN STRUCTURE.

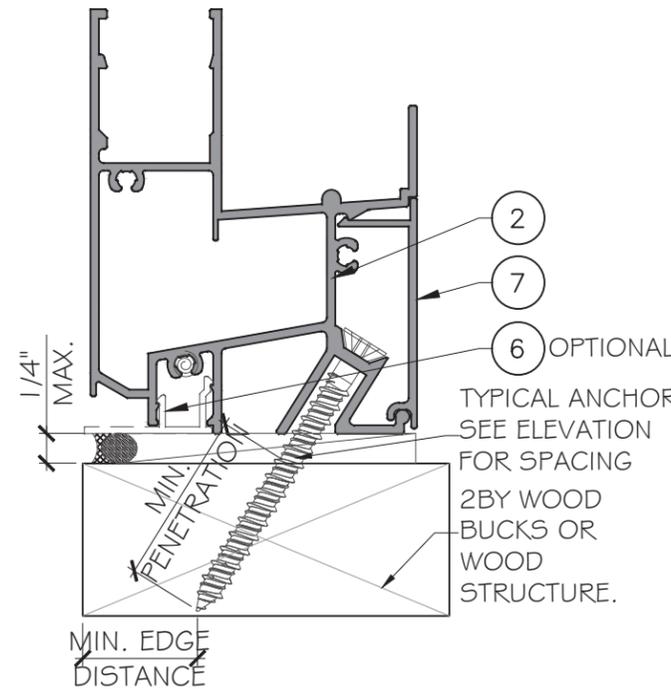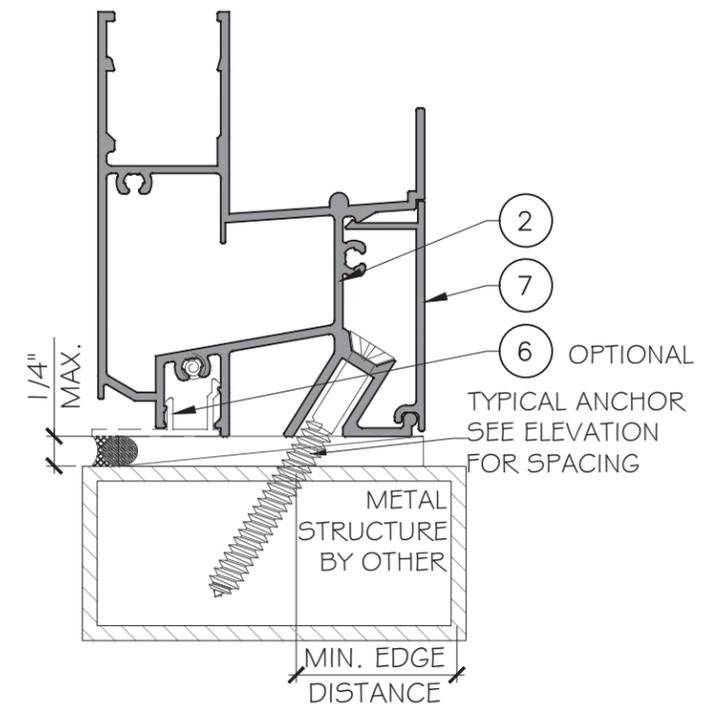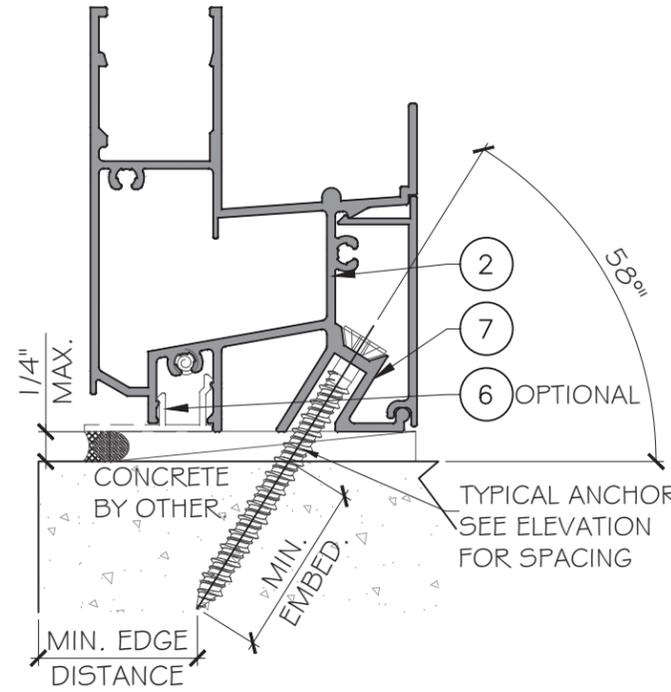

FLORIDA APPROVAL:
 FL47984.1

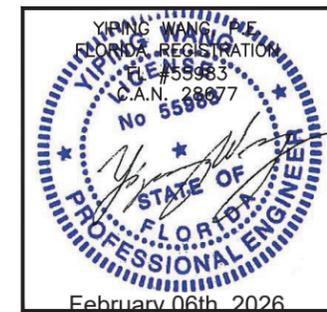

MCY ENGINEERING, INC.
 GLAZING CONSULTANTS
 12781 MIRAMAR PARKWAY #301
 MIRAMAR, FL 33027 P: 305.588.5224
 www.MCYEngineering.com mcy@mcyengineering.com

HORIZONTAL ROLLER WINDOW - LMI
UNI-K Fenestration
 KM 8.5 VIA DURAN TAMBO
 GUAYAS, ECUADOR
<https://www.unik-windows.com>

Rev. No.	Date	Drawn By	Description
01	12.27.2025	James	NEW APPLICATION

Drawn Date: 12.27.2025 Scale: AS SHOWN
 DRAWING NO. AD25-56
 Sheet No. A3
 8 OF 16

SILL TYPICAL ANCHOR TYPES (FLANGE FRAME):

ANCHOR TYPE 'AA' - 1/4" DIA. ULTRACON+ BY 'DEWALT' (Fu= 164 KSI, Fy= 148 KSI)
 INTO 2BY WOOD BUCKS OR WOOD STRUCTURE
 WITH 1 1/2" MIN. PENETRATION.




ANCHOR TYPE 'BB' - 1/4" DIA. ULTRACON+ BY 'DEWALT' (Fu= 164 KSI, Fy= 148 KSI)
 DIRECTLY INTO CONCRETE W/ 1" MIN. EMBEDMENT.

ANCHOR TYPE 'CC' - 1/4" DIA. SELF-DRILLING SCREWS, GRADE 5 (Fu= 120KSI, Fy=92KSI)
 INTO F.B.C. APPROVED ALUMINUM MULLIONS OR METAL STRUCTURES.
 (3) THREADS MIN. PENETRATION BEYOND METAL SUBSTRATE.
 (STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)


TYPICAL EDGE DISTANCE
 INTO CONCRETE = 1 5/8" MIN.
 INTO WOOD = 1 5/8" MIN.
 INTO METAL STRUCTURE = 3/4" MIN.

SUBSTRATE
 WOOD :SG=0.55MIN.
 CONCRETE : f'c=3000 PSI MIN.
 ALUMINUM : 1/8" THK. MIN. (6063-T5, MIN)
 STEEL : 12GA THK. MIN. (Fy=33KSI MIN)

NOTE:
 METAL STRUCTURES OR WOOD STRUCTURES BY OTHERS TO BE DESIGNED AND
 ANCHORED PROPERLY TO SUPPORT THE LOADS IMPOSED BY THIS GLAZING
 SYSTEM AND TO TRANSFER SUCH LOADS TO THE BUILDING MAIN STRUCTURE.

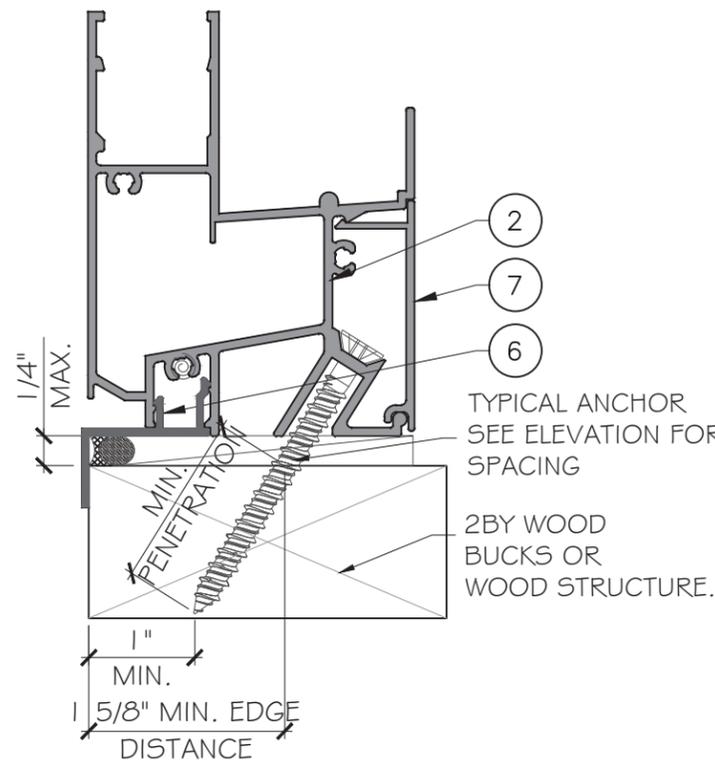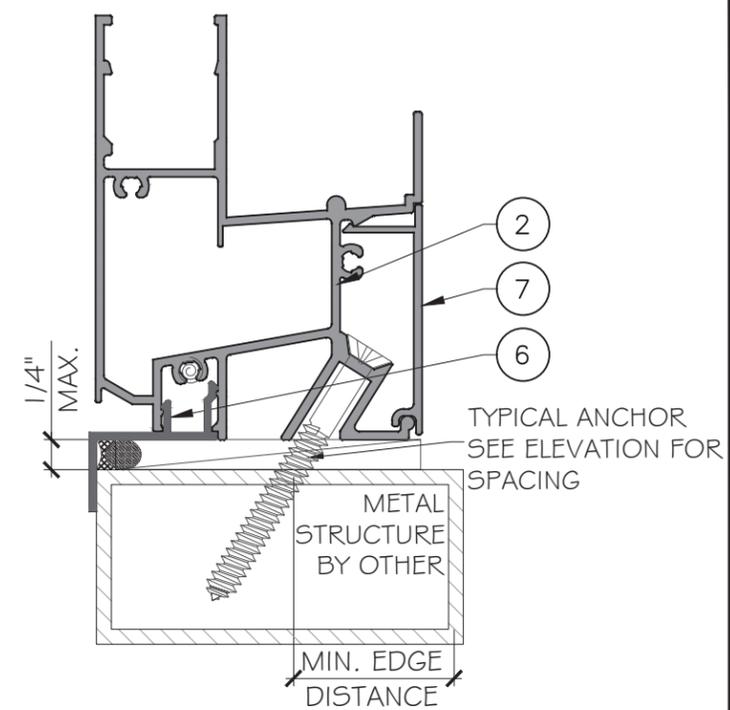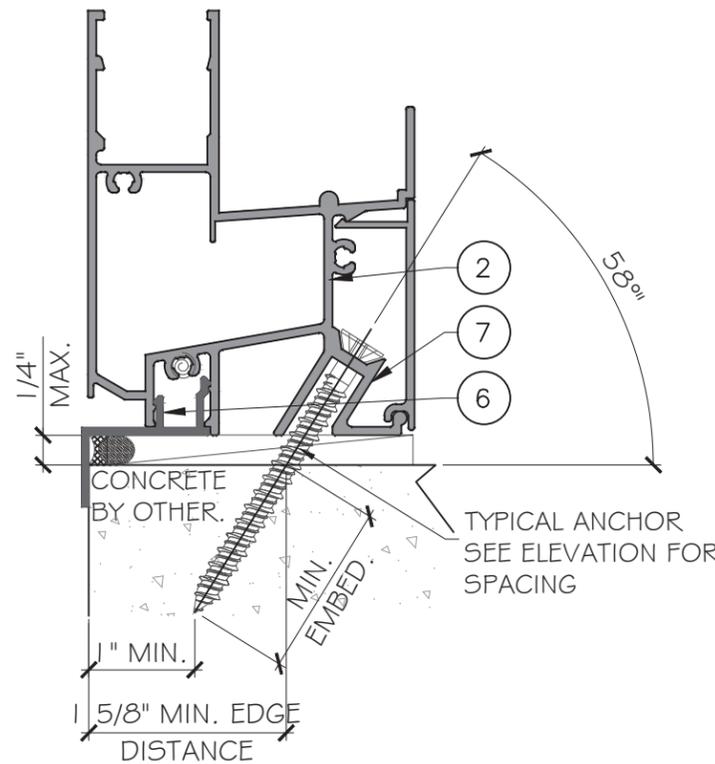

FLORIDA APPROVAL:
 FL47984.1

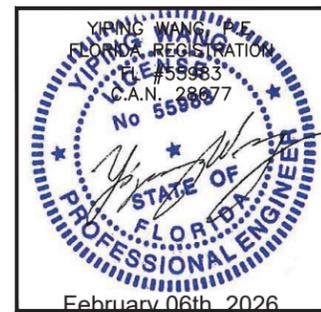

MCY ENGINEERING, INC.
 GLAZING CONSULTANTS
 12781 MIRAMAR PARKWAY #301
 MIRAMAR, FL 33027 P: 305.588.5224
 www.MCYEngineering.com mcy@mcyengineering.com

HORIZONTAL ROLLER WINDOW - LMI
UNI-K Fenestration
 KM 8.5 VIA DURAN TAMBO
 GUAYAS, ECUADOR
<https://www.unik-windows.com>



Rev. No.	Date	Drawn By	Description
01	12.27.2025	James	NEW APPLICATION

Drawn Date: 12.27.2025
 Scale: AS SHOWN

DRAWING NO.
 AD25-56

Sheet No.
 A4

9 OF 16

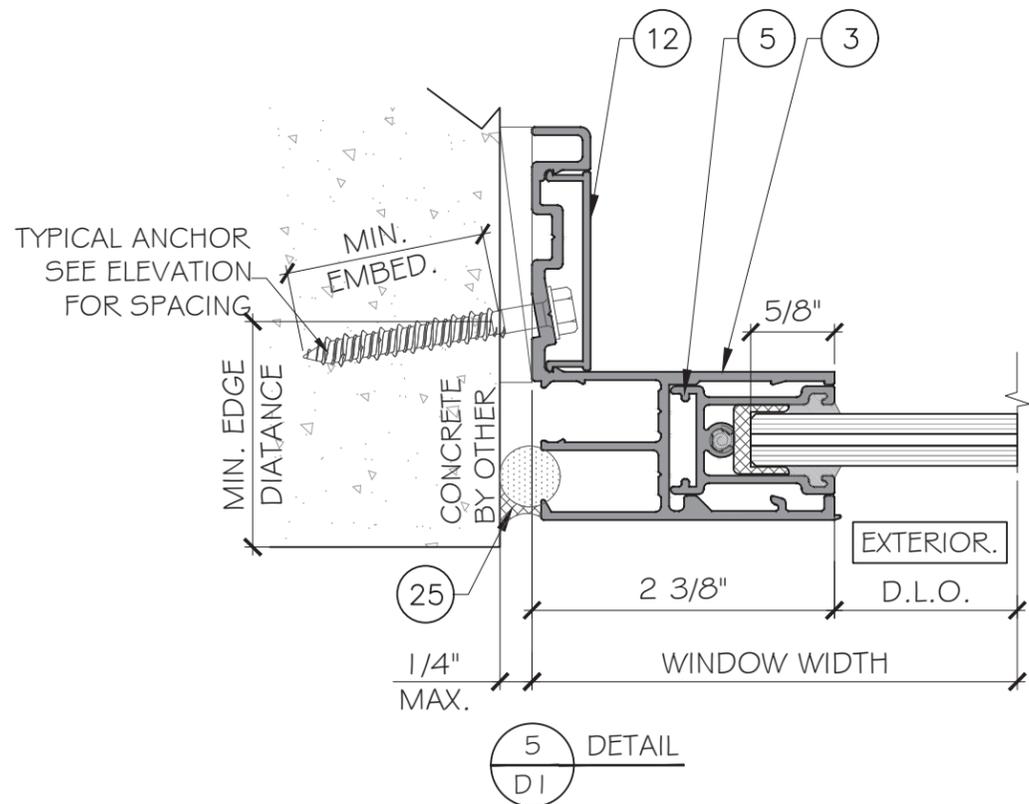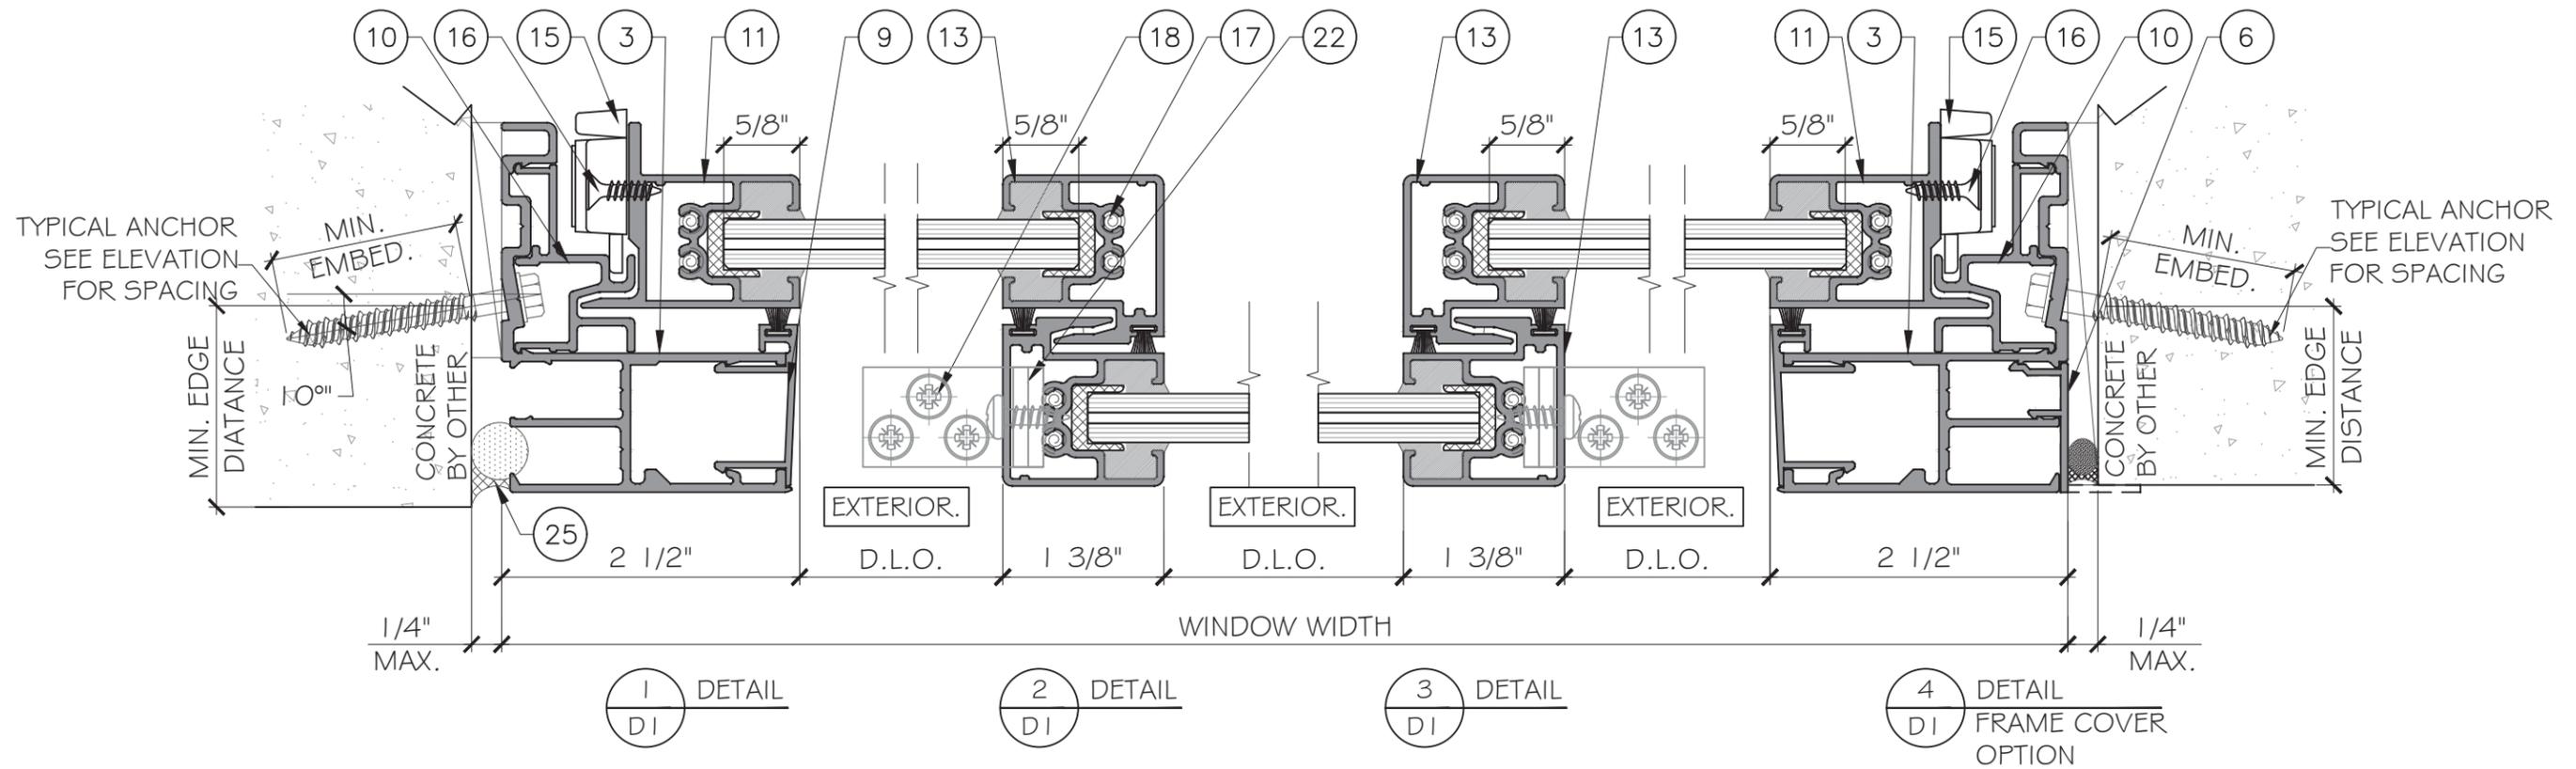

FLORIDA APPROVAL:
FL47984.1





MCY ENGINEERING, INC.
GLAZING CONSULTANTS
12781 MIRAMAR PARKWAY #301
MIRAMAR, FL 33027 P: 305.588.5224
www.MCYEngineering.com mcy@mcyengineering.com

HORIZONTAL ROLLER WINDOW - LMI
UNI-K Fenestration
KM 8.5 VIA DURAN TAMBO
GUAYAS, ECUADOR
https://www.unik-windows.com

Rev. No.	Date	Drawn By	Description
01	12.27.2025	James	NEW APPLICATION

Drawn Date	Scale
12.27.2025	AS SHOWN
DRAWING NO.	
AD25-56	
DI	
Sheet No.	
10 OF 16	

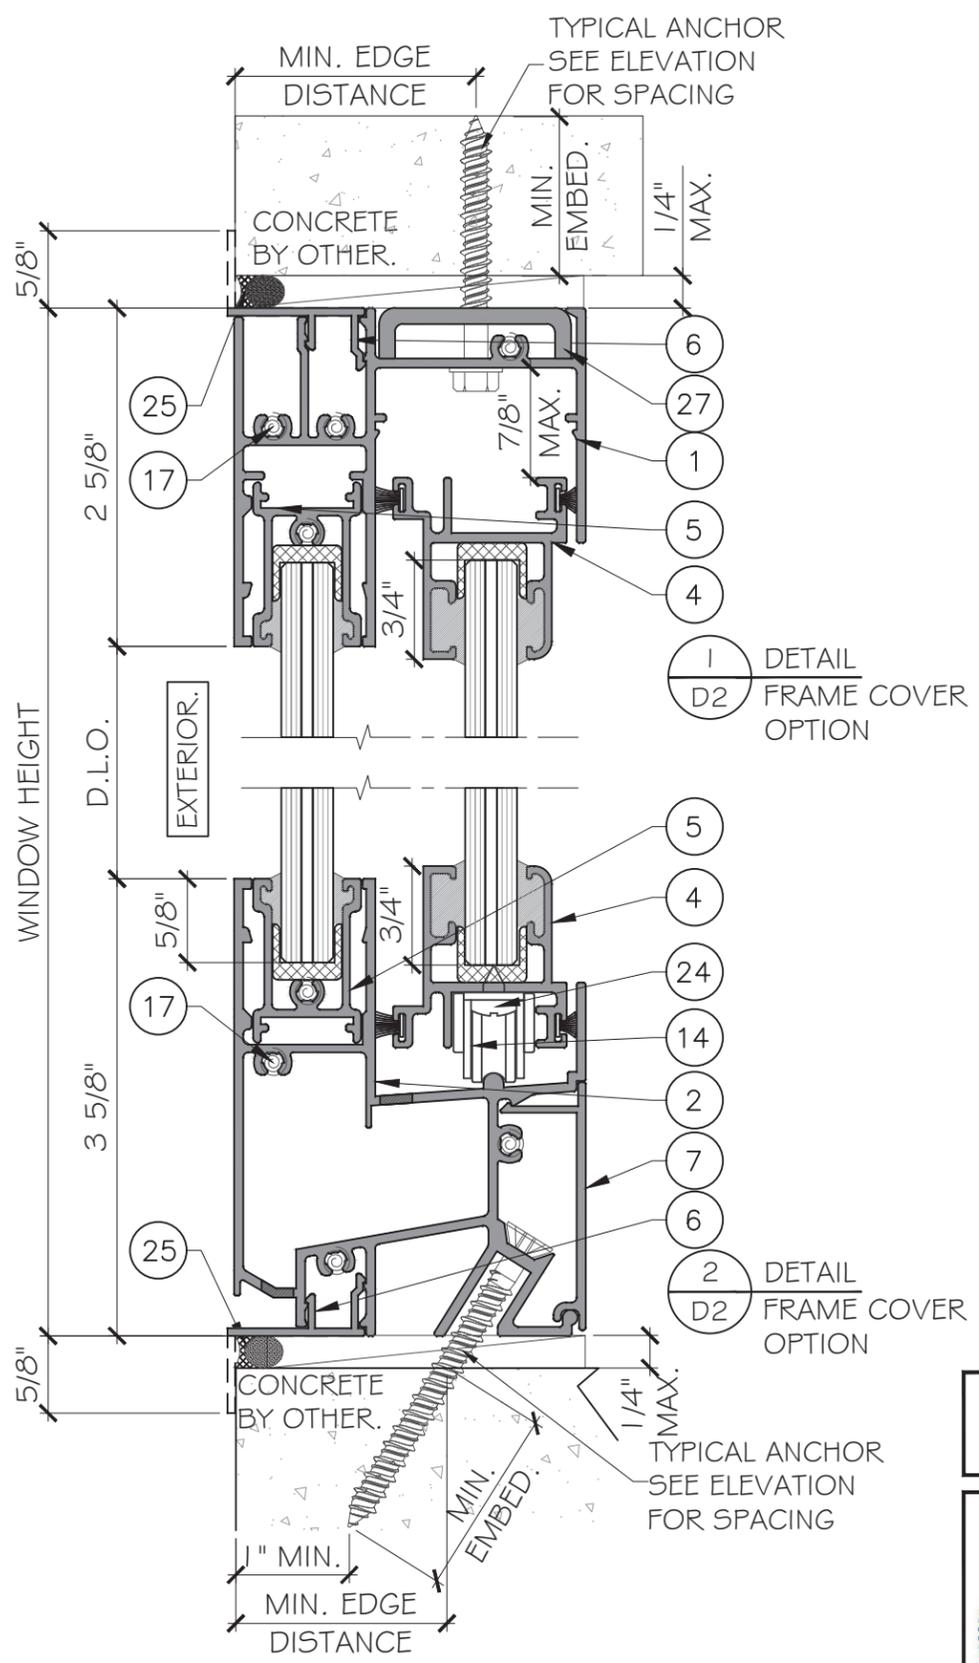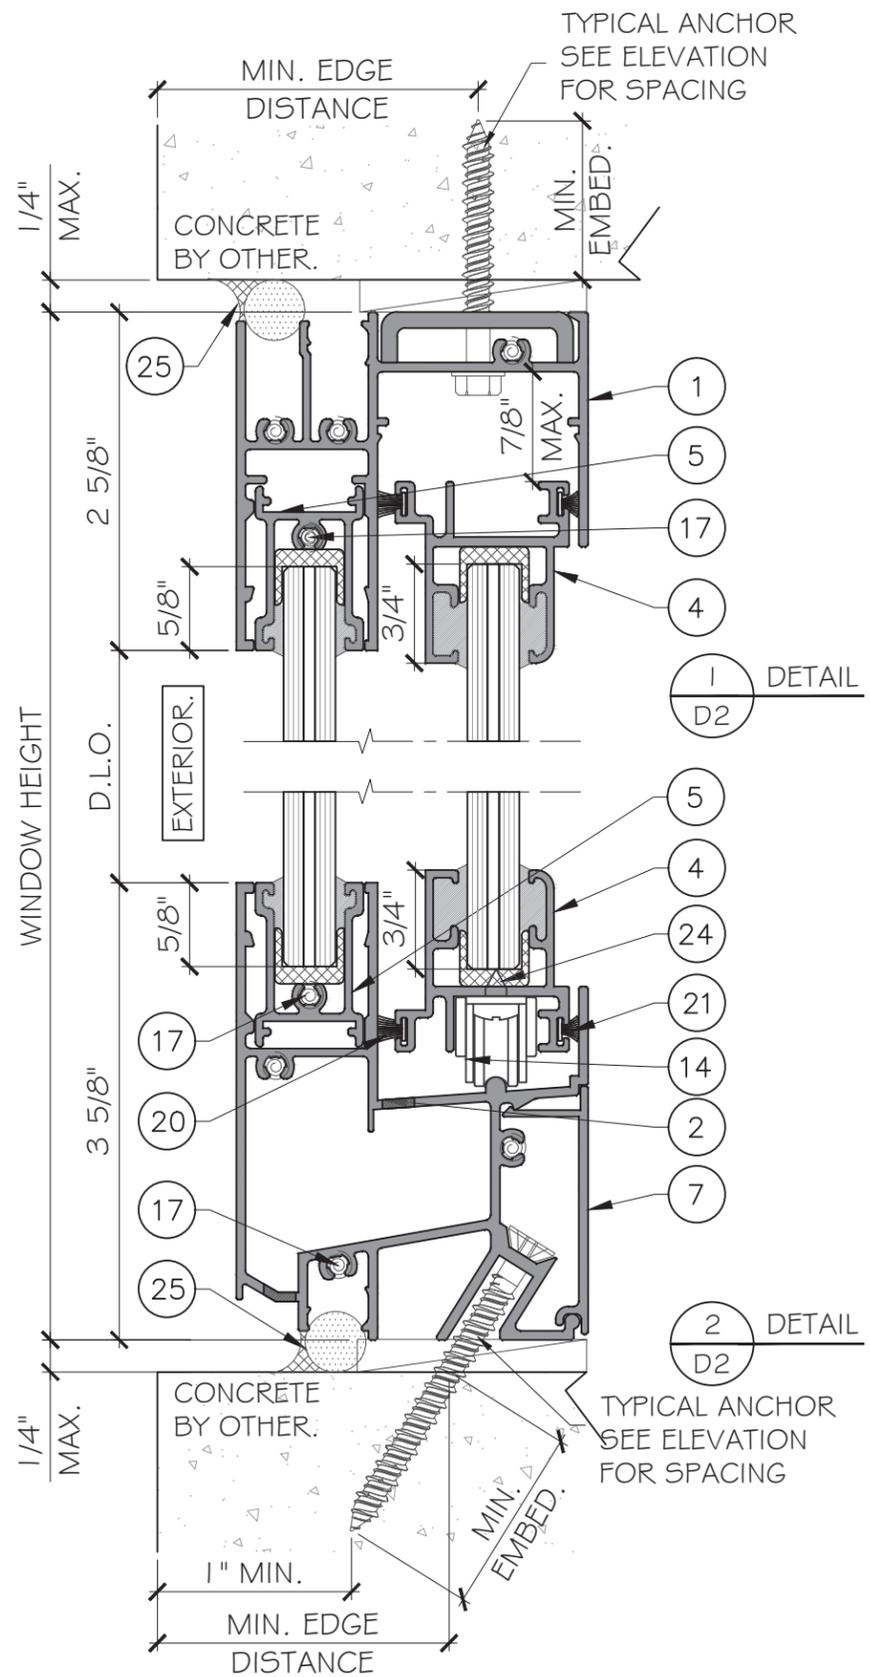


FLORIDA APPROVAL:
FL47984.1




Rev. No.	Date	Drawn By	Description
01	12.27.2025	James	NEW APPLICATION


Drawn Date	Scale
12.27.2025	AS SHOWN
DRAWING NO.	
AD25-56	
Sheet No.	
11 OF 16	

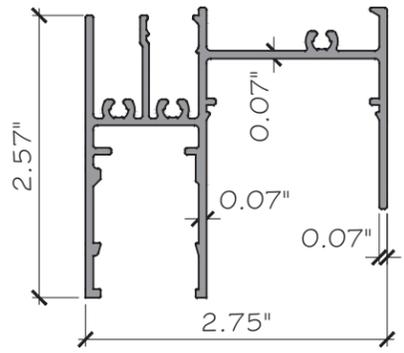


① FRAME HEAD DC1098
ALUM. 6005-T5

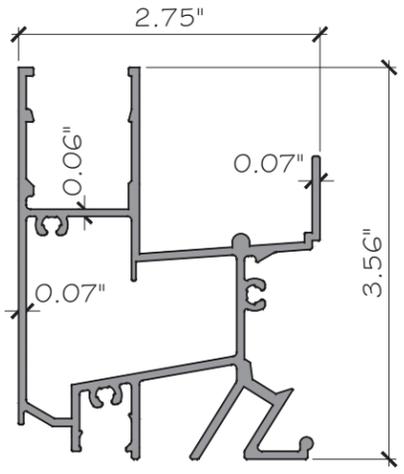


② FRAME SILL DC1100
ALUM. 6005-T5

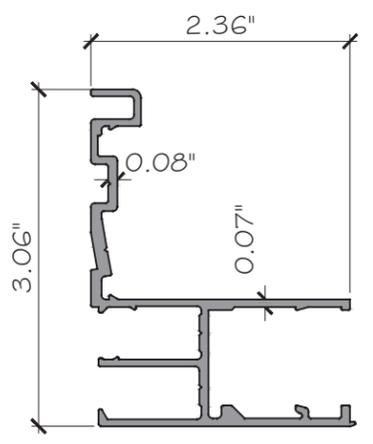


③ FRAME JAMB DC1099
ALUM. 6005-T5




④ SASH TOP/BOTTOM RAIL
DC1101
ALUM. 6005-T5




⑤ SASH FIX DC1104
ALUM. 6005-T5




⑥ FRAME FLANGE COVER
PR-DC1200
ALUM. 6005-T5




⑥ FRAME COVER
PR-DC1200
ALUM. 6005-T5

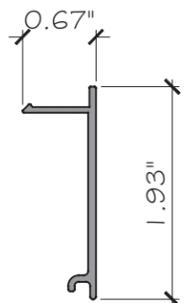


⑦ FRAME SILL COVER
DC1107
ALUM. 6005-T5

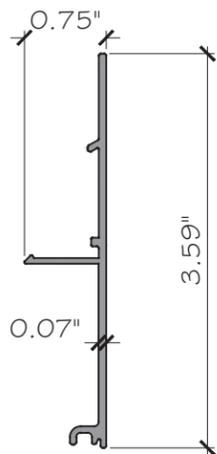


⑧ SILL RISER DC1108
ALUM. 6005-T5



⑨ EXTERIOR FRAME COVER
DC1106
ALUM. 6005-T5




⑩ FRAME LOCK
DC1105
ALUM. 6005-T5

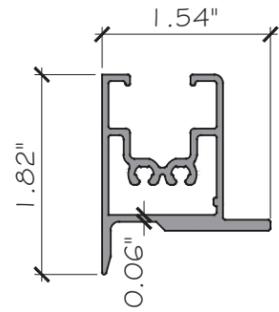


⑪ SASH JAMB DC1103
ALUM. 6005-T5




⑫ FRAME JAMB COVER
DC109
ALUM. 6005-T5

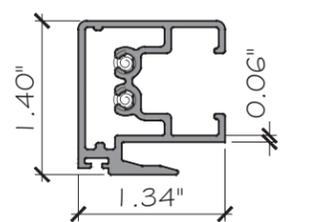

⑬ SASH INTERLOCK
DC1102
ALUM. 6005-T5



⑳ ANGLE. F0012
ALUM. 6005-T5



㉑ ALUM CHANNEL
ALUM. 6005-T5

MCY ENGINEERING, INC.
GLAZING CONSULTANTS
12781 MIRAMAR PARKWAY #301
MIRAMAR, FL 33027 P: 305.588.5224
www.MCYEngineering.com mcy@mcyengineering.com

HORIZONTAL ROLLER WINDOW - LMI
UNI-K Fenestration
KM 8.5 VIA DURAN TAMBO
GUAYAS, ECUADOR
https://www.unik-windows.com

FLORIDA APPROVAL:
FL47984.1

YIPING WANG
FLORIDA REGISTRATION
No. 55983
C.A.N. 28877
STATE OF FLORIDA
PROFESSIONAL ENGINEER
February 06th, 2026


Rev. No.	Date	Drawn By	Description
01	12.27.2025	James	NEW APPLICATION

Drawn Date: 12.27.2025 Scale: AS SHOWN


DRAWING NO. AD25-56

PART


Sheet No. 13 OF 16

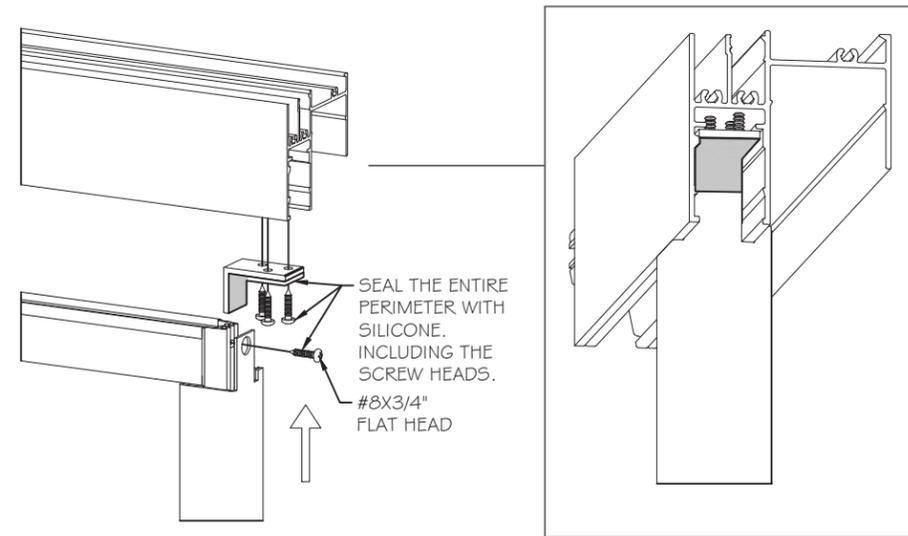


ANCHOR DETAIL FOR FIXED SASH

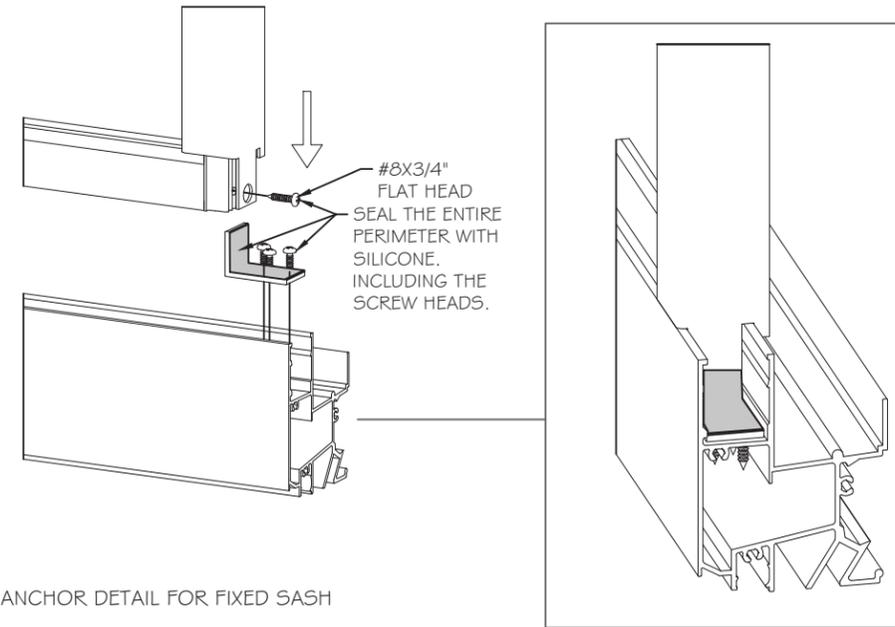



ANCHOR DETAIL FOR FIXED SASH

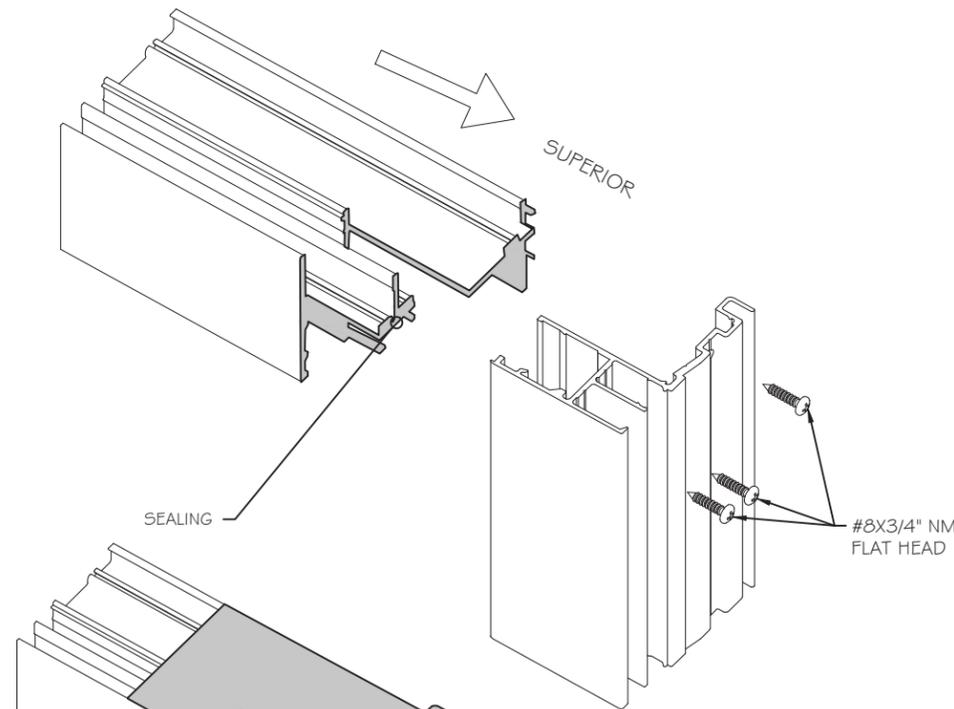

UPPER FRAME CORNER ASSEMBLY

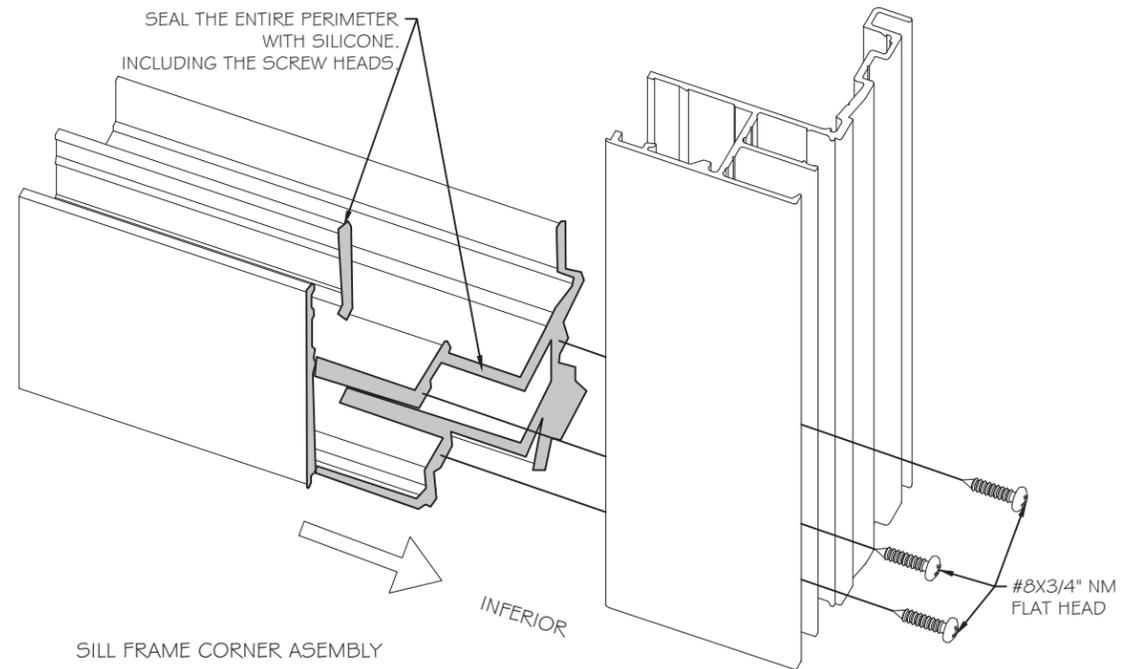

SILL FRAME CORNER ASSEMBLY

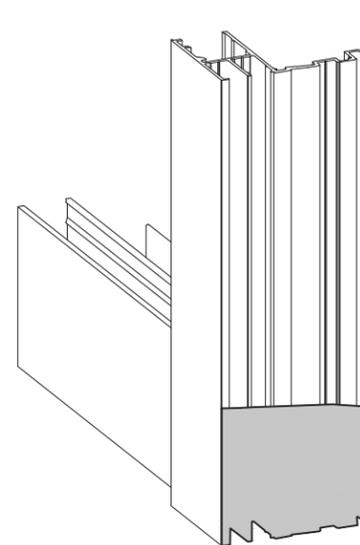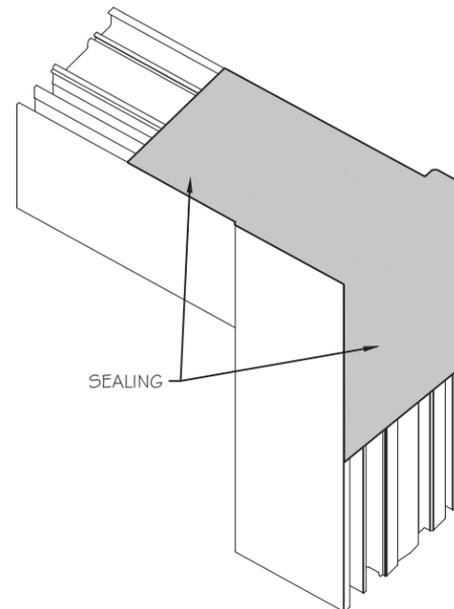

FLORIDA APPROVAL:
FL47984.1

YIPING WANG
FLORIDA REGISTRATION
#55983
C.A.N. 28877
No 55983
STATE OF FLORIDA
PROFESSIONAL ENGINEER
February 06th, 2026


MCY ENGINEERING, INC.
GLAZING CONSULTANTS
12781 MIRAMAR PARKWAY #301
MIRAMAR, FL 33027 P: 305.588.5224
www.MCYEngineering.com mcy@mcyengineering.com

HORIZONTAL ROLLER WINDOW - LMI
UNI-K Fenestration
KM 8.5 VIA DURAN TAMBO
GUAYAS, ECUADOR
https://www.unik-windows.com


Rev. No.	Date	Drawn By	Description
01	12.27.2025	James	NEW APPLICATION

Drawn Date: 12.27.2025 Scale: AS SHOWN
DRAWING NO.: AD25-56
Sheet No.: 14 OF 16


SASH CORNER ASSEMBLY

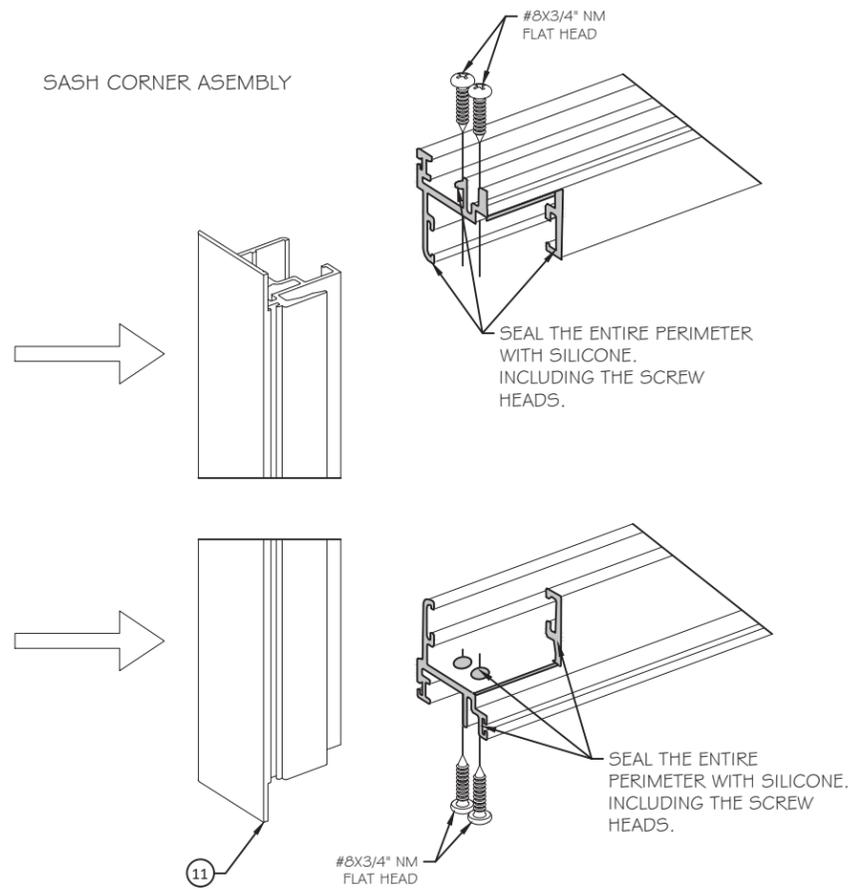

SASH CORNER ASSEMBLY

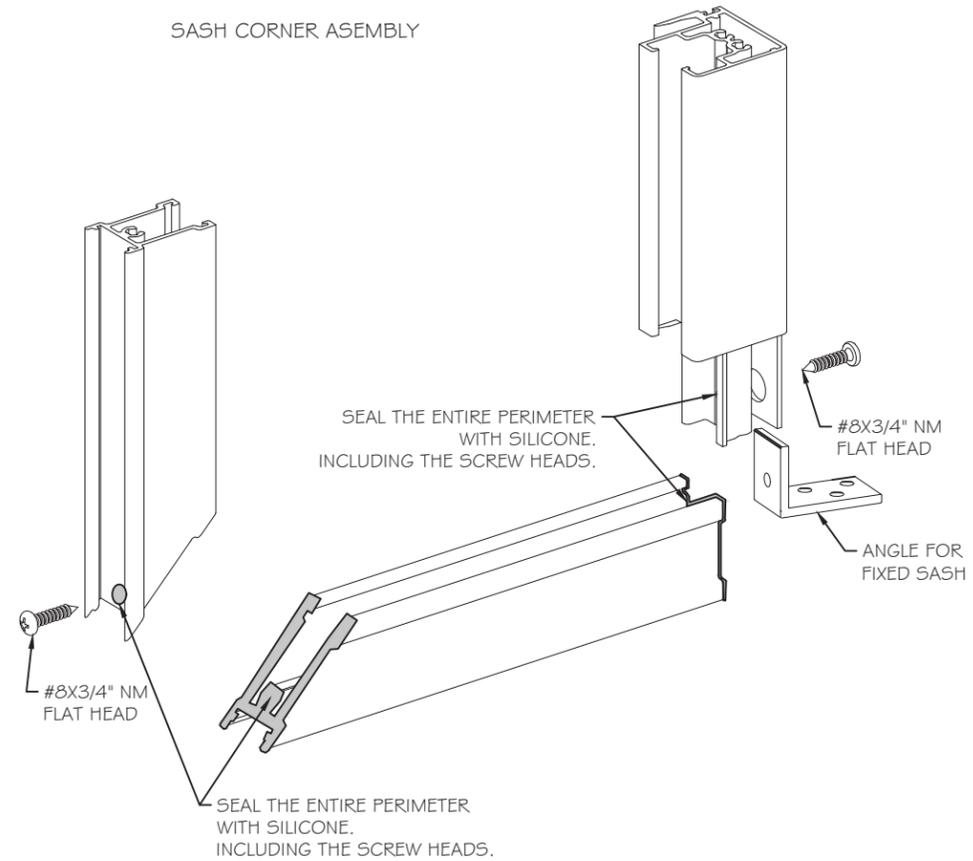

FLORIDA APPROVAL:
FL47984.1

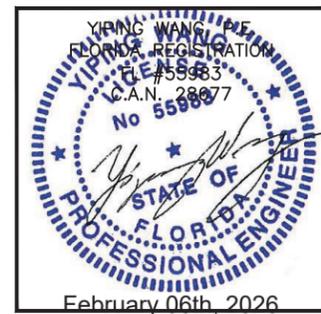

HORIZONTAL ROLLER WINDOW - LMI
UNI-K Fenestration
KM 8.5 VIA DURAN TAMBO
GUAYAS, ECUADOR
<https://www.unik-windows.com>

Rev. No.	Date	Drawn By	Description
01	12.27.2025	James	NEW APPLICATION

Drawn Date: 12.27.2025
Scale: AS SHOWN

DRAWING NO.
AD25-56

ASSEMBLY

Sheet No.
15 OF 16

MCY ENGINEERING, INC.
GLAZING CONSULTANTS
12781 MIRAMAR PARKWAY #301
MIRAMAR, FL 33027 P: 305.588.5224
www.MCYEngineering.com mcy@mcyengineering.com

BILL OF MATERIALS

ITEM	PART	DESCRIPTION	MATERIAL	MANUF. / REMARKS
1	DC1098	FRAME HEAD	ALUMINUM 6005-T5	FISA
2	DC1100	FRAME SILL	ALUMINUM 6005-T5	FISA
3	DC1099	FRAME JAMB	ALUMINUM 6005-T5	FISA
4	DC1101	SASH TOP/BOTTOM RAIL	ALUMINUM 6005-T5	FISA
5	DC1104	SASH FIX	ALUMINUM 6005-T5	FISA
6	PR-DC1200	FRAME FIN COVER	ALUMINUM 6005-T5	FISA
7	DC1107	FRAME SILL COVER	ALUMINUM 6005-T5	FISA
8	DC1108	SILL RISER	ALUMINUM 6005-T5	FISA
9	DC1106	EXTERIOR FRAME COVER	ALUMINUM 6005-T5	FISA
10	DC1105	FRAME LOCK	ALUMINUM 6005-T5	FISA
11	DC1103	SASH JAMB	ALUMINUM 6005-T5	FISA
12	DC1109	FRAME JAMB COVER	ALUMINUM 6005-T5	FISA
13	DC1102	SASH INTERLOCK	ALUMINUM 6005-T5	FISA
14	RU-SFA-KA	ROLLER	POLIAMIDE, INOX	PABOSE
15	AC-SEG-DURA-01	LOCK	ZAMACK, STEEL	T.H. ENTREPRICES LLC
16	AC-T-0.75-8-AV-NM-NX	LOCK SCREW #8X3/4"	ST.STEEL	GOLA
17	AC-T-1-8-RD-NM-NX	FRAME/VENT SCREWS #8 X 3/4"	ST.STEEL	GOLA
18	AC-T-0.62-10-RD-NM-NX	#8 X 3/4"	ST.STEEL	GOLA
19	AC-E-U-V10-8	"U" GLAZING VNYL	EPDM 73 SHORE	EXTRUSIONS
20	AC-FL-5X5-TF	TRI-FIN 5X7	POLYPROPYLENE	ULTRAFAB
21	AC-FL-4.8X4.5-8	FIN SEAL 5X5	POLYPROPYLENE	TESCEAL
22	FO012	ANGLE 1" X 1.5" X 1/8" @MTG.	ALUMINUM 6005-T5	FISA
23	SIKA SG-20	STRUCTURAL SILICONE	SILICONE	SIKA
	SG500	STRUCTURAL SILICONE (AS OPTION)	SILICONE	SIKA
	DC983	STRUCTURAL SILICONE (AS OPTION)	SILICONE	DOW CORNING
	DC995	STRUCTURAL SILICONE (AS OPTION)	SILICONE	DOW CORNING
24	AC-T-0.5-8-RD-NM-NX	ROLLER SCREW #8 X 1/2"	ST.STEEL	GOLA
25	-	WEATHER SEALANT DS791	SILICONE	DOWSIL
26	TA-CORR-DA-01	DRAIN VALVE	PLATSIC	-
27	-	ALUMINUM CHANNEL	ALUMINUM 6005-T5	VARIES

MCY ENGINEERING, INC.
GLAZING CONSULTANTS

12781 MIRAMAR PARKWAY #301
MIRAMAR, FL 33027 P: 305.588.5224
www.MCYEngineering.com mcy@mcyengineering.com

HORIZONTAL ROLLER WINDOW - LMI

UNI-K Fenestration
KM 8.5 VIA DURAN TAMBO
GUAYAS, ECUADOR
https://www.unik-windows.com

Rev. No.	Date	Drawn By	Description
01	12.27.2025	James	NEW APPLICATION

FLORIDA APPROVAL:
FL47984.1

February 06th, 2026

Drawn Date 12.27.2025	Scale AS SHOWN
DRAWING NO. AD25-56	
PART	
Sheet No. 16 OF 16	