
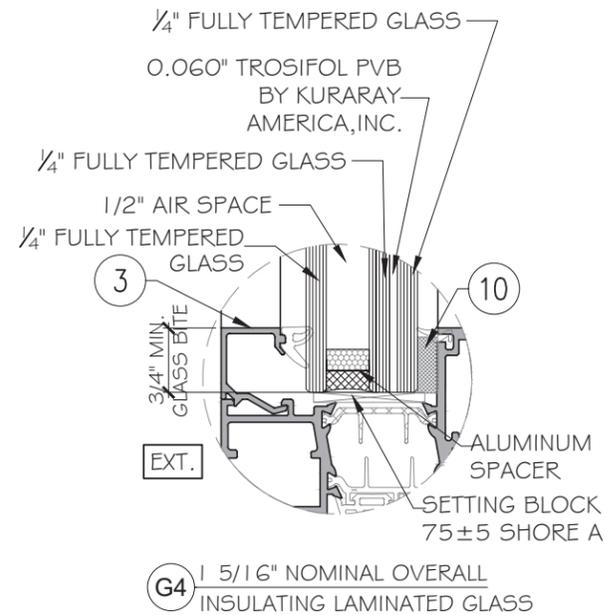


KA 4016 ALUMINUM CASEMENT SMALL MISSILE IMPACT

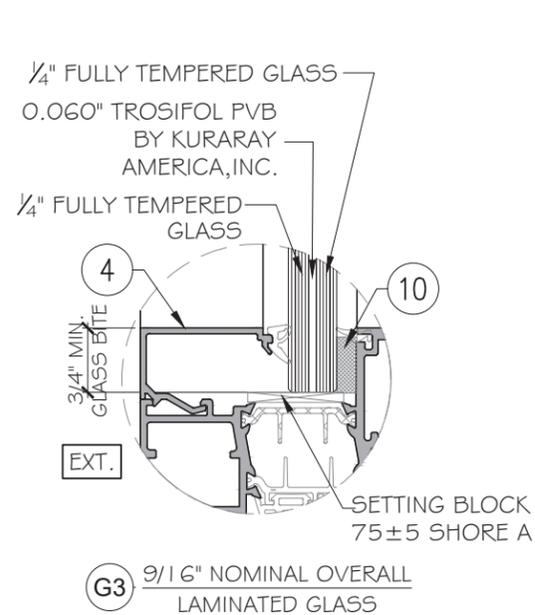

NOTE:
GLASS COMPLIES WITH ASTM E1300-09 (3 SEC. GUSTS)

GENERAL NOTES:

- THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE REQUIREMENTS OF THE FLORIDA BUILDING CODE 8TH EDITION (2023) INCLUDING HIGH VELOCITY HURRICANE ZONE (HVHZ).
- WINDOW IS DESIGNED TO BE USED AT SMALL MISSILE AREA.
- WINDOWS ARE RATED FOR SMALL MISSILE IMPACT. IMPACT SHUTTERS ARE REQUIRED FOR INSTALLATIONS UP TO 30 FT OF GRADE. SHUTTERS ARE NOT REQUIRED FOR INSTALLATIONS ABOVE 30 FT OF GRADE.
- WINDOWS ARE APPROVED FOR AIR RESISTANCE AND WATER RESISTANCE.
- ANCHORS SHALL BE AS LISTED, SPACED AS SHOWN ON DETAILS. ANCHORS EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.
- ANCHORING OR LOADING CONDITIONS NOT SHOWN IN THESE DETAILS ARE NOT PART OF THIS APPROVAL.
- MATERIALS INCLUDING BUT NOT LIMITED TO STEEL/METAL SCREWS THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF THE FLORIDA BUILDING CODE 8TH EDITION 2023 SECTION AS APPLICABLE.
- WOOD BUCKS/METAL STRUCTURES BY OTHERS TO BE DESIGNED TO SUPPORT THE LOADS IMPOSED BY THIS GLAZING SYSTEM AND TO TRANSFER SUCH LOADS TO THE BUILDING MAIN STRUCTURE.
- ULTIMATE LOAD OBTAINED FROM ASCE 7-22, MULTIPLY BY 0.6 SHALL BE LESS THAN OR EQUAL TO MAX. DESIGN LOAD IN THIS DOCUMENT. THE DESIGN LOADS SHOWN IN THIS DOCUMENT ARE ALLOWABLE DESIGN LOADS.
- MANUFACTURER'S LABEL SHALL BE LOCATED ON A READILY VISIBLE LOCATION IN ACCORDANCE WITH SECTION 1709.9.3 OF FLORIDA BUILDING CODE LABELING TO COMPLY WITH SECTION 1709.9.2.
- NOTE: HARDWARE CHECKED FOR WIND LOAD IN CLOSED POSITION ONLY; OPERATION PER MANUFACTURER'S INSTRUCTIONS. WINDOWS MUST BE CLOSED AND SECURED WHEN A HURRICANE WARNING IS ISSUED.

INSTRUCTIONS:

USE CHARTS AS FOLLOWS.

- STEP 1:** DETERMINE DESIGN WIND LOAD REQUIREMENTS BASED ON WIND VELOCITY, BLDG. HEIGHT, WIND ZONE USING APPLICABLE ASCE 7-22 STANDARD.
- STEP 2:** SEE TYPICAL ELEVATION ON SHEET E1 FOR MAXIMUM SIZES AND DESIGN LOADS.
- STEP 3:** SEE ANCHOR TYPES ON SHEET A1. SEE SHEET E1 FOR ANCHOR SPACING.
- STEP 4:** THE LOWEST VALUE RESULTING FROM STEPS 2 THAT EXCEED THE DESIGN WIND PRESSURES DETERMINED THRU STEP 1 SHALL APPLY TO ENTIRE SYSTEM.

ABBREVIATIONS AND SYMBOLS	
D.L.O. - DAYLITE OPENING	CL - CENTER LINE
F.H. - FRAME HEIGHT	S.S. - STAINLESS STEEL
F.W. - FRAME WIDTH	H.S. - HEAT STRENGTHENED
LG. - LONG	SSG - STRUCTURAL SILICONE GLAZED
STL. - STEEL	TEMP. - TEMPERED
ALUM. - ALUMINUM	O.C. - ON CENTER
MULL. - MULLION	SECTION NUMBER
HORIZ. - HORIZONTAL	
W/ - WITH	
W/O - WITHOUT	
VERT. - VERTICAL	
G.B. - GLASS BITE	

LIMITATIONS OF USE

A- THIS PRODUCT EVALUATION DOCUMENT (P.E.D.) PREPARED BY THIS ENGINEER IS GENERIC AND DOES NOT PROVIDE INFORMATION FOR A SITE SPECIFIC PROJECT; I.E. WHERE THE SITE CONDITIONS DEVIATE FROM THE P.E.D.

B- CONTRACTOR TO BE RESPONSIBLE FOR THE SELECTION, PURCHASE AND INSTALLATION OF THIS PRODUCT BASED ON THIS PRODUCT EVALUATION PROVIDED HEREIN. HE/SHE DOES NOT DEVIATE FROM THE CONDITIONS DETAILED ON THIS DOCUMENT.

C- THIS PRODUCT EVALUATION DOCUMENT WILL BE CONSIDERED INVALID IF ALTERED BY ANY MEANS.

D- SITE SPECIFIC PROJECTS SHALL BE PREPARED BY A FLORIDA REGISTERED ENGINEER OR ARCHITECT WHICH WILL BECOME THE ENGINEER OF RECORD (E.O.R.) FOR THE PROJECT AND WHO WILL BE RESPONSIBLE FOR THE PROPER USE OF THE P.E.D.

E- THIS P.E.D. SHALL BEAR THE DATE AND ORIGINAL SEAL AND SIGNATURE OF THE PROFESSIONAL ENGINEER OF RECORD THAT PREPARED IT.





FL#48028.2

MCY ENGINEERING, INC.
 GLAZING CONSULTANTS
 12781 MIRAMAR PARKWAY #301
 MIRAMAR, FL 33027 P: 305.588.5224
 www.MCYEngineering.com mcy@mcyengineering.com


KA 4016 ALUMINUM CASEMENT - S.M.I.
UNIK FENESTRATION
 KM 8.5 VIA DURAN TAMBO
 GUAYAS, ECUADOR
 https://www.veptrikoec.com

Rev. No.	Date	Description

Drawn Date: 02.03.2026 Scale: Drawing No.: AD26-04B
 Sheet No.: 1 OF 10

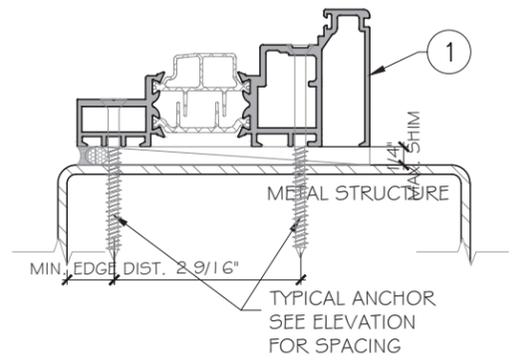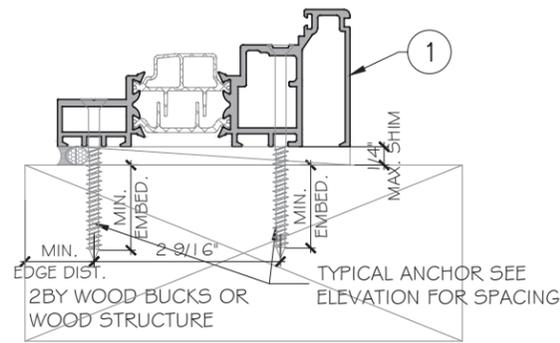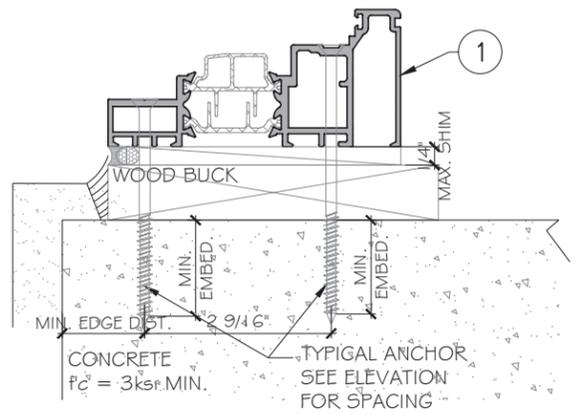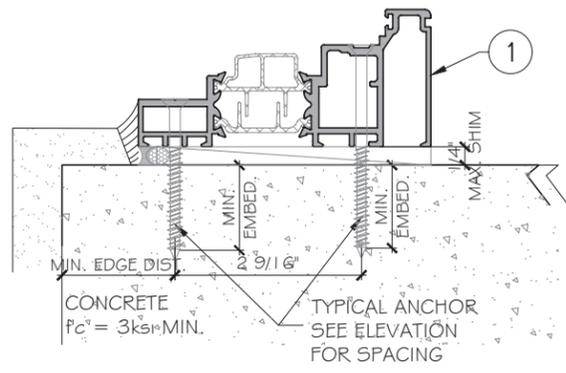

FL#48028.2

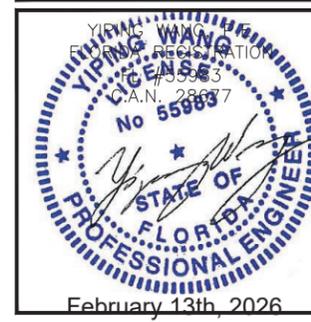

KA 4016 ALUMINUM CASEMENT - S.M.I.
UNIK FENESTRATION
 KM 8.5 VIA DURAN TAMBO
 GUAYAS, ECUADOR
<https://www.yetrikoecc.com>

Rev. No.	Date	Drawn By	Description


Drawn Date: 02.03.2026 Scale: DRAWING NO.:


AD26-04B

A2


Sheet No. 4 OF 10

MCY ENGINEERING, INC.
 GLAZING CONSULTANTS
 12781 MIRAMAR PARKWAY #301
 MIRAMAR, FL 33027 P: 305.588.5224
www.MCYEngineering.com mcy@mcyengineering.com



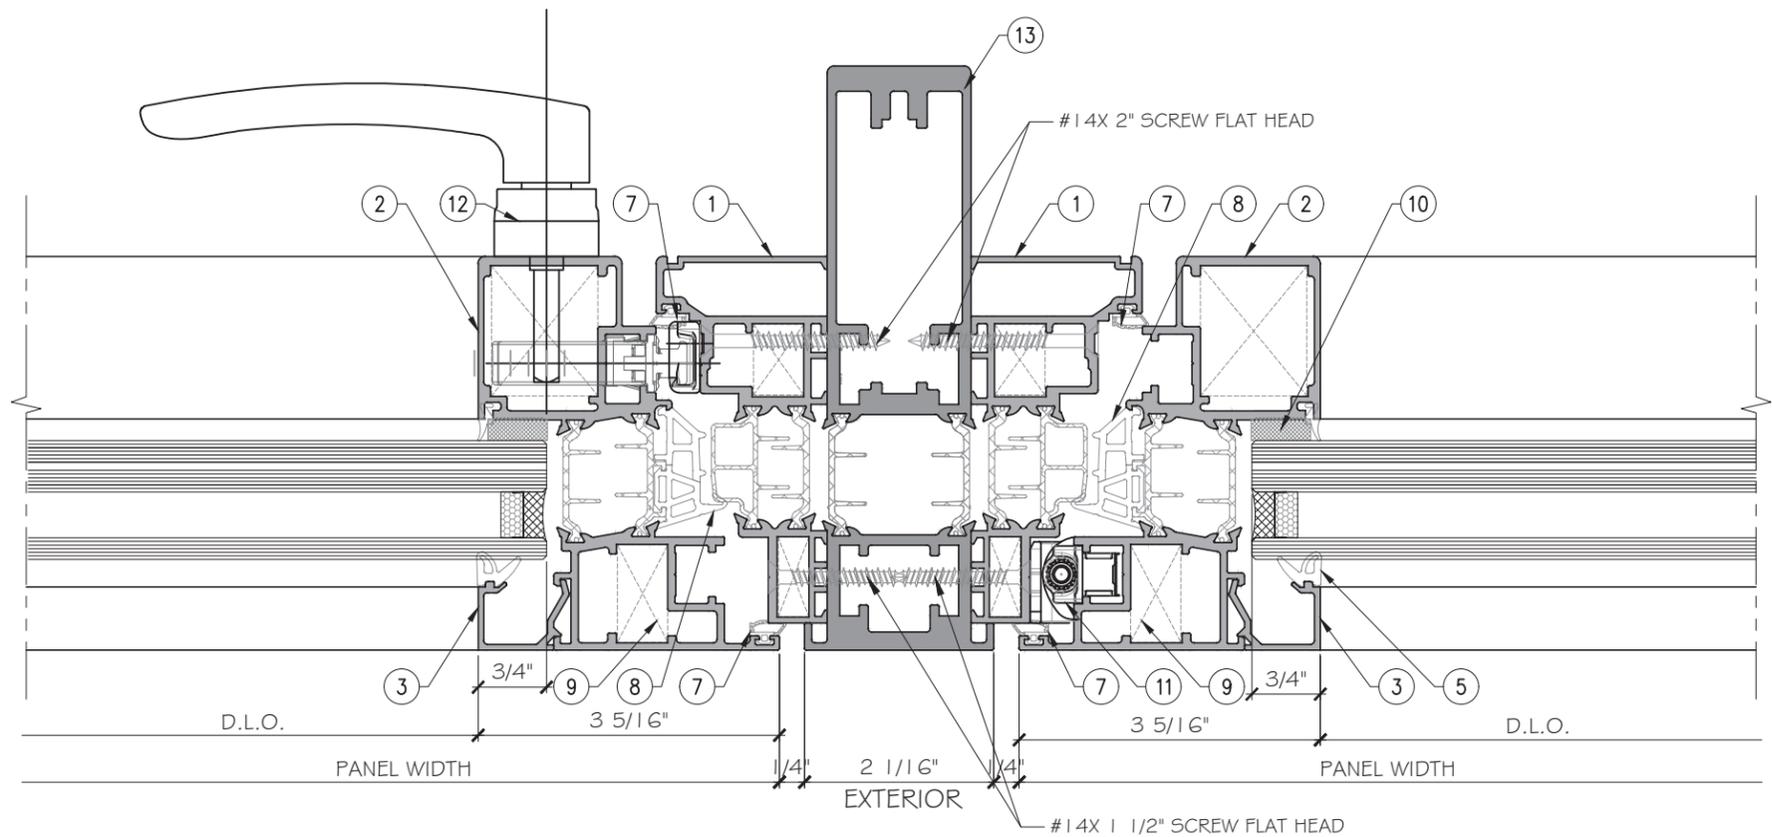

F
D3
DETAIL

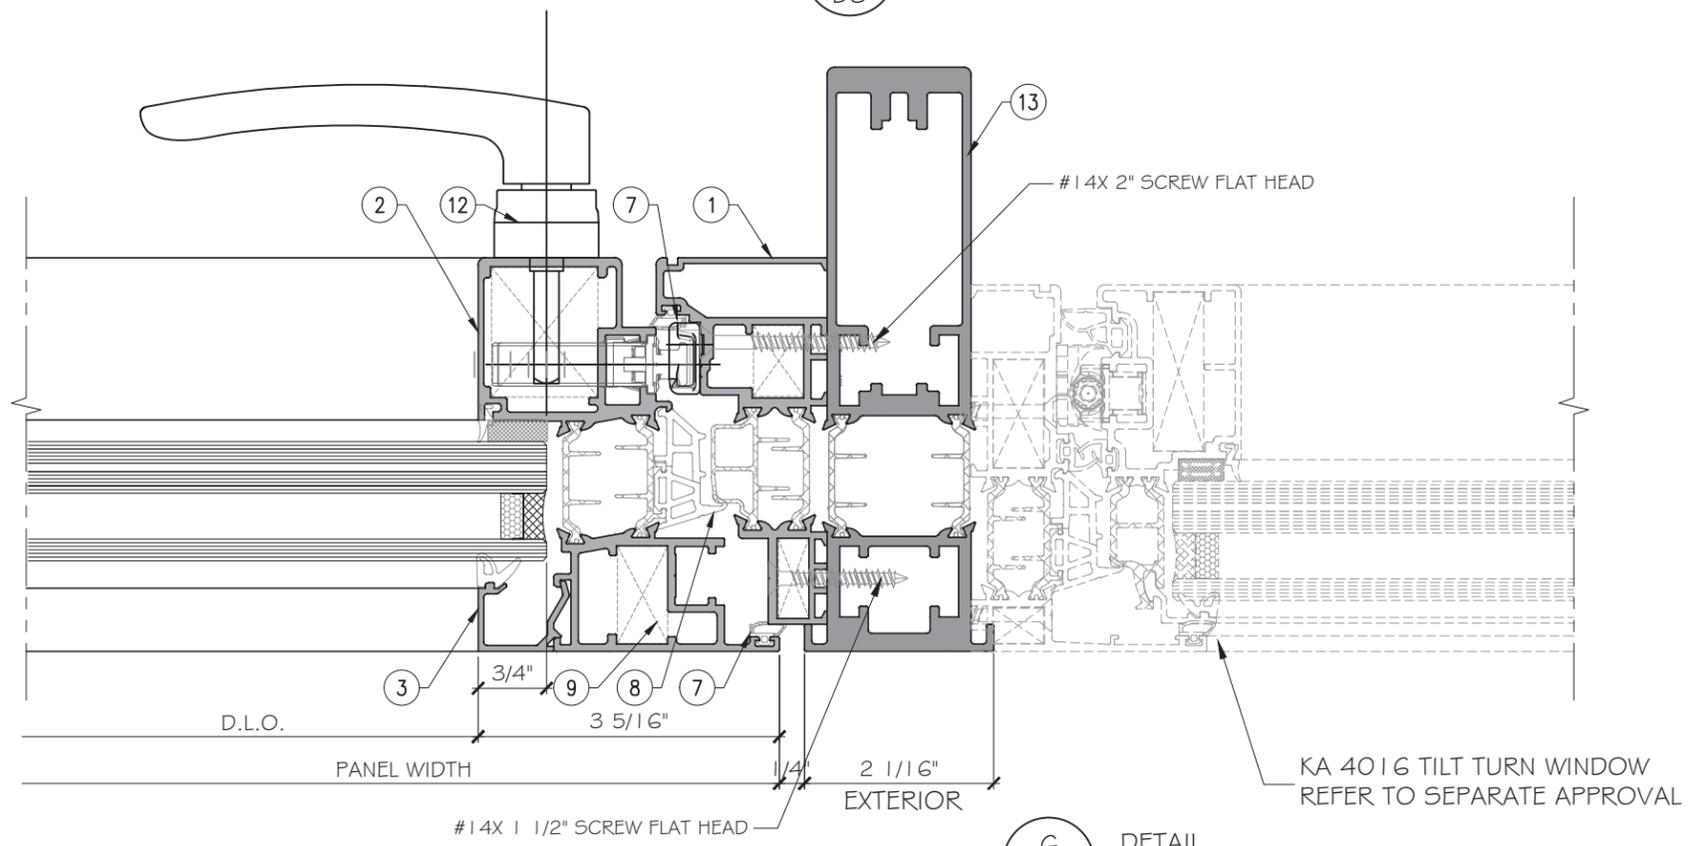

G
D3
DETAIL

KA 4016 TILT TURN WINDOW
REFER TO SEPARATE APPROVAL

FL#48028.2

February 13th, 2026


Rev. No.	Date	Drawn By	Description

Drawn Date: 02.03.2026 Scale: Drawing No.: AD26-04B

Sheet No.: 7 OF 10

KA 4016 ALUMINUM CASEMENT - S.M.I.
UNIK FENESTRATION
KM 8.5 VIA DURAN TAMBO
GUAYAS, ECUADOR
<https://www.vetrikoeec.com>

MCY ENGINEERING, INC.
GLAZING CONSULTANTS
12781 MIRAMAR PARKWAY #301
MIRAMAR, FL 33027 P: 305.588.5224
www.MCYEngineering.com mcy@mcyengineering.com

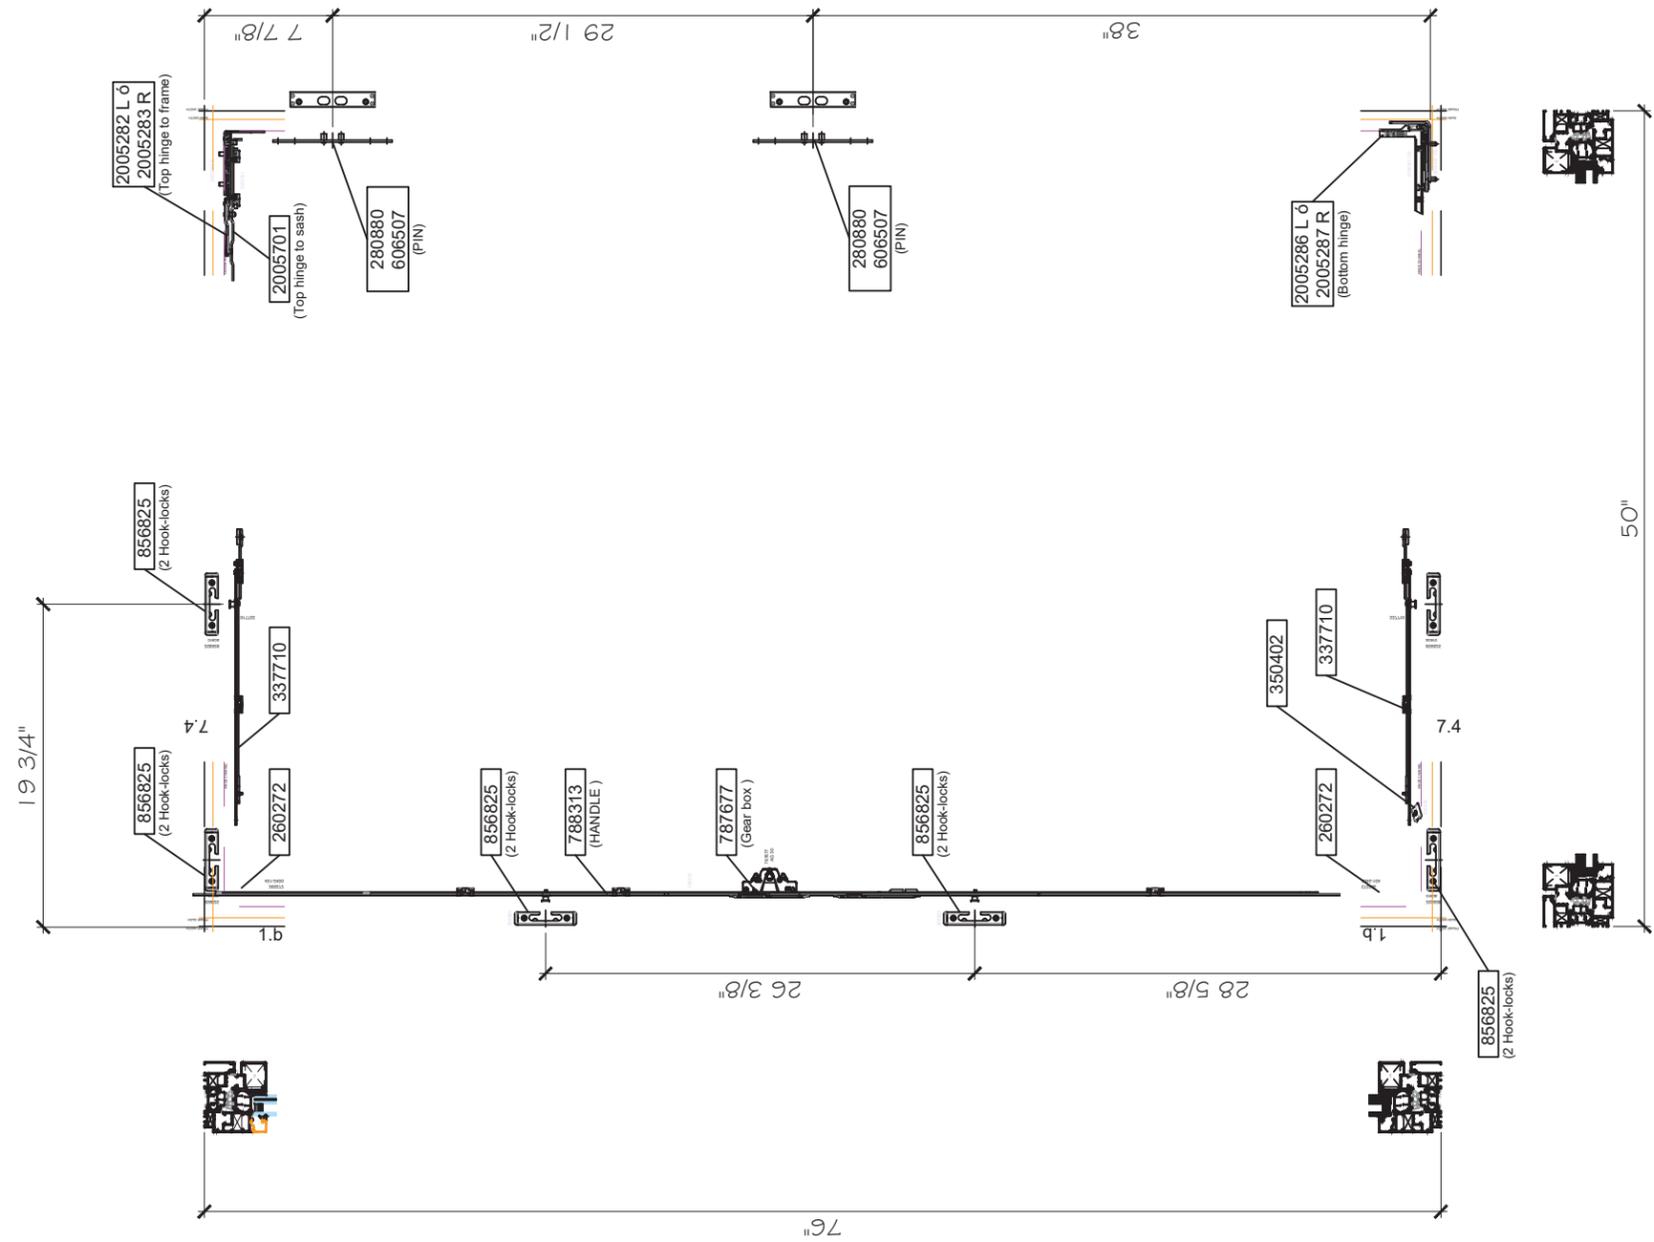

CASEMENT HARDWARE

FL#48028.2

YIPING WANG
 ENGINEER REGISTRATION
 No 55983
 F.A.N. 28637

STATE OF FLORIDA
 PROFESSIONAL ENGINEER

February 13th, 2026


Drawn Date	Scale
02.03.2026	
DRAWING NO.	
AD26-04B	
HWR	
Sheet No.	
8 OF 10	

KA 4016 ALUMINUM CASEMENT - S.M.I.
 UNIK FENESTRATION
 KM 8.5 VIA DURAN TAMBO
 GUAYAS, ECUADOR
<https://www.yetrikoecc.com>


MCY

MCY ENGINEERING, INC.
 GLAZING CONSULTANTS


12781 MIRAMAR PARKWAY #301
 MIRAMAR, FL 33027 P: 305.588.5224
www.MCYEngineering.com mcy@mcyengineering.com

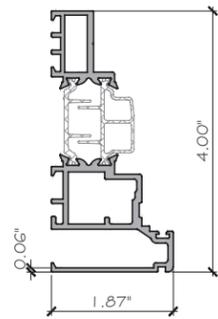


① FRAME JAMB
DC-1006/1007 ALUM. 6063-T6

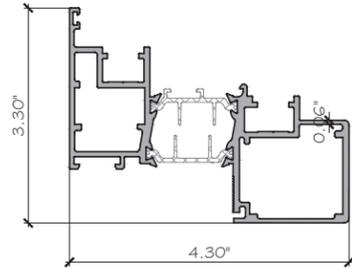


② SASH
DC-1008/1009 ALUM. 6063-T6



③ GLASS COVER
FI-6254 ALUM. 6063-T6



④ GLASS COVER
FI-5895 ALUM. 6063-T6

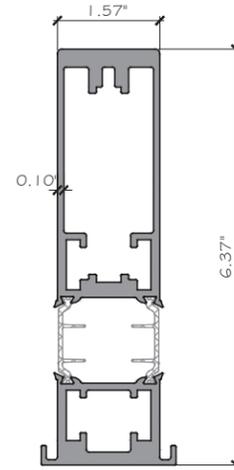

⑬ MULLION
DC-1010/1011 ALUM. 6063-T6

BILL OF MATERIALS

ITEM	PART	DESCRIPTION	MATERIAL	REMARKS
1	DC1006/1007	FRAME JAMB	ALUM. 6063-T6	FISA
2	DC-1008/1009	SASH	ALUM. 6063-T6	FISA
3	FI-6254	GLASS COVER	ALUM. 6063-T6	FISA
4	FI-5895	GLASS COVER	ALUM. 6063-T5	FISA
5	AC-E-022	EXTERIOR GASKET	EPDM	PRICAL
6	AC-E-KA-01	GLASS SPACER FOR STRUCTURAL SILICONE	PLASTIC	PRICAL
7	AC-E-019	DOOR EXTERIOR GASKET	EPDM	PRICAL
8	AC-E-030	CENTRAL GASKET	EPDM	PRICAL
9	FI-5210,5209,4026	ALUMINUM CORNER JOINT	ALUM. ALLOY	FISA
10	GE 2000/SG-20 /SG-500/DOWSIL 983 /DOWSIL 995	STRUCTURAL SILICONE	SILICONE	SIKA
11	2005287	WINDOW HIDDEN HINGE	STAINLESS STEEL	ROTO
12	CRM-VITAL	WINDOW HANDLE	STAINLESS STEEL	ROTO
13	DC-1010/1011	MULLION	ALUM. 6063-T5	FISA

MCY ENGINEERING, INC.
GLAZING CONSULTANTS




12781 MIRAMAR PARKWAY #301
MIRAMAR, FL 33027 P: 305.588.5224
www.MCYEngineering.com mcy@mcyengineering.com

KA 4016 ALUMINUM CASEMENT - S.M.I.

UNIK FENESTRATION

KM 8.5 VIA DURAN TAMBO
GUAYAS, ECUADOR
https://www.yetrikoeec.com

FL#48028.2

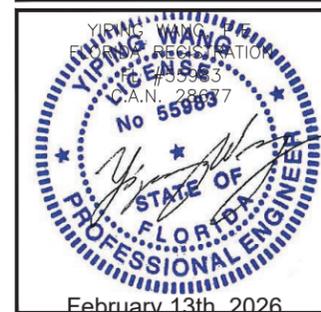

Rev. No.	Date	Drawn By	Description

Drawn Date 02.03.2026	Scale
DRAWING NO. AD26-04B	
PARTS	
Sheet No. 9 OF 10	

