



## GENERAL NOTES

- 1. EVALUATED FOR USE IN LOCATIONS ADHERING TO THE FLORIDA BUILDING CODE AND WHERE PRESSURE REQUIREMENTS AS DETERMINED BY ASCE 7, MINIMUM DESIGN LOADS FOR BUILDINGS AND OTHER STRUCTURES, DOES NOT EXCEED THE DESIGN PRESSURES LISTED.
- 2. WHEN INSTALLED IN THE WIND-BORNE DEBRIS REGION, HURRICANE PROTECTIVE SYSTEM IS REQUIRED.
- 3. NOT APPROVED FOR USE IN THE HIGH VELOCITY HURRICANE ZONE (HVHZ).

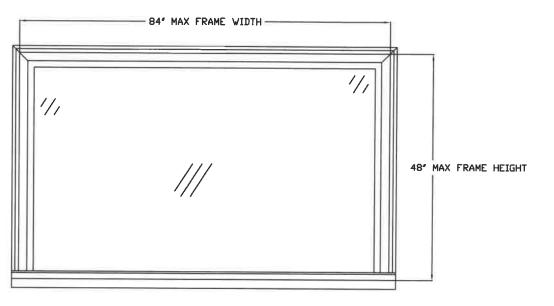


+/- 60.0 DESIGN PRESSURE

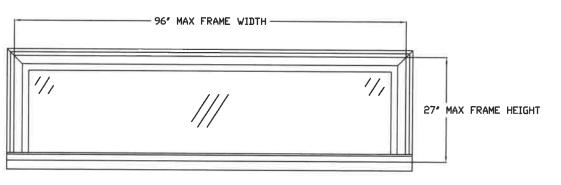

+/- 70.0 DESIGN PRESSURE

	TABLE OF CONTENTS							
SHEET ;	DESCRIPTION							
1	TYPICAL ELEVATIONS & GENERAL NOTES							
2	ANCHORING LOCATIONS & DETAILS							





DRAWING NO.:


DWG-MA-FL0156-06 SHEET 1 OF 2


KURT BALTHAZOR FLORIDA P.E. #56533

	PRODUCT: TRANSOM				PART OR ASSEMBLY: TYPICAL ELEVATIONS & GENERAL NOTES				
					SWS	SWS	BY		
					11/5/20   EDGE DISTANCE	11/2/10   MISC UPDATES		REVISIONS	
					В		NO.		
	DATE: 11/10/06								
ŀ	DATE: 11/10/06 SCALE: N.T.S. DWG. BY: SWS								
Į.	_		BY:	_	S	WS	5		
E	CHK. BY:								

60185


MASONITE INTERNATIONAL CORP. 1955 POWIS RD. WEST CHICAGO, IL 6018

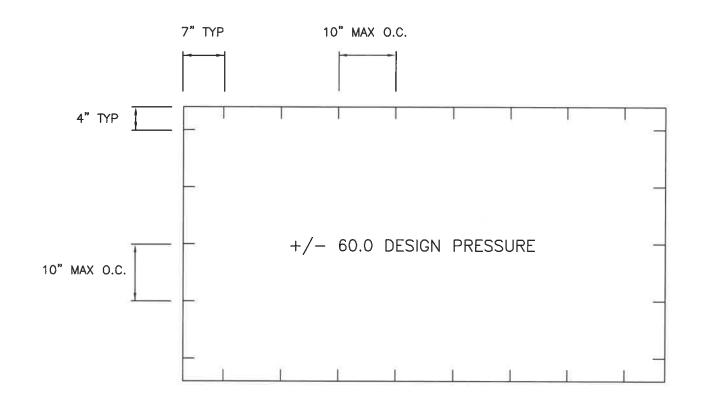

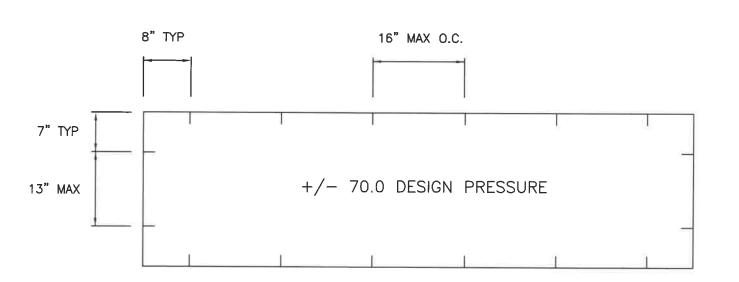

## ATTACHMENT DETAIL

- 1. ANCHOR ANALYSIS FOR LOADING CONDITIONS PREPARED, SIGNED, AND SEALED BY JOSEPH A. REED, P.E. (FLORIDA #58920). FASTENERS ANALYZED FOR USE INCLUDE #8 WOOD SCREWS. A PHYSICAL SHIM MUST BE PLACED IN SHIM SPACE AT EACH ANCHOR LOCATION.
- 2. THE WOOD SCREW SINGLE SHEAR DESIGN VALUES COME FROM ANSI/AF&PA NDA FOR SOUTHERN PINE LUMBER AND ACHEIVEMENT OF 1-1/2" MINIMUM EMBEDMENT. MINIMUM EDGE DISTANCE 3/4".
- 3. WOOD BUCKS BY OTHERS MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO STRUCTURE.
- 4. MINIMUM LATERAL DESIGN VALUE STRENGTH OF 54 LBS.

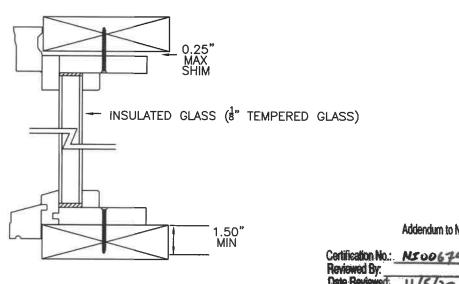

**TYPICAL** ANCHOR INSTALLATION Addendum to NAM

DATE: 11/10/06

MASONITE INTERNATIONAL CORP. 1955 POWIS RD. WEST CHICAGO, IL 6018

SCALE: N.T.S. DWG. BY: SWS

CHK, BY: DRAWING NO .:

DWG-MA-FL0156-06

SHEET 2 OF 2