

EQUIVALENCY OF STANDARDS EVALUATION

<u>Product Manufacturer:</u> UNI-K Fenestration LLC. 3201 NE 183 Street, Unit 3008 Aventura, Florida 33160	<u>Product Name/Model & Description:</u> Picture window – large and small missile impact
--	---

Code: 8th Edition Florida Building Code (2023), inclusive of all Supplements effective as of this report date.

Compliance Method: Product Approval Rule 61G20-3.015(4)(d) – Equivalency of Standards

Certification of Equivalence: The testing standards listed below, although not explicitly referenced within the above-noted building code, are hereby deemed equivalent for the purposes of determining this product’s compliance with the above-noted building code:

Product Testing and Certification:


- QAI laboratories-test report #MED3738a

Performance Testing:


- TAS 201-94 (Large and Small Missile Impact Test)
- TAS 202-94 (Uniform Static Test)
- TAS 203-94 (Cyclic Wind Pressure Loading)

Equivalency Evaluation to AAMA 501-15:

- Code Requirements for testing to AAMA 501-15:
 - Section 1709.8.4 of the Florida Building Code requires glazed curtain wall, window wall and storefront systems to be tested in accordance with the requirements of that section and the Laboratory Test requirements of the American Architectural Manufacturers Association (AAMA) Standard 501 with HVHZ complying with Section 2411.3.2.1.1
 - This product is tested to HVHZ requirements. Product approval is for HVHZ.
 - Therefore, Section 2411.3.2.1.1 govern with regards to Load Sequencing.
 - All other requirements of Section 1709.8.4 must be met.
 - Section 2411.3.2.1.1 require glazed curtain wall, window wall and storefront systems to be tested in accordance with the requirements of that section and the laboratory test requirements of the American Architectural Manufacturers Association (AAMA) Standard 501, following test load sequence and test load duration in TA 202.
 - Test Report listed above in accordance with TAS 202 and its required load sequencing.
- Conformance to AAMA 501-15:
 - Laboratory Test requirements in AAMA 501-15 include sections listed as required and as optional. They are:

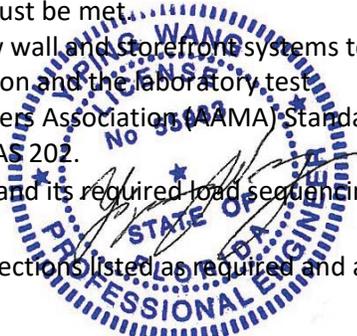

December 19th, 2025



- **Required** – All required testing performed and documented in Test Report listed above demonstrating compliance with Section 1709.8.4 and Section 2411.3.2.1.1.
 - Section 2.1 - Test Load Sequence
 - Section 2.2 - Preload Test at 50% DP
 - Section 2.3 - ASTM E283 Air Leakage
 - Section 2.4 - ASTM E331 Water Penetration
 - Section 2.9 - ASTM E330 Testing
 - Section 2.10 - ASTM E331 Water Resistance Repeated
 - Section 2.11 - ASTM E330 at 150% DP

All above tests in TAS 202 were performed in accordance with the standard requirements as documented in test reports listed above.

- **Optional** – The following sections in AAMA 501-15 are listed as optional and were not performed.
 - Section 2.5
 - Section 2.6
 - Section 2.7
 - Section 2.8
 - Section 2.12
 - Section 2.13
 - Section 2.14
 - Section 2.15

- **Conclusion**
 - Based on the above evaluation, the Laboratory Test requirements of the American Architectural Manufacturers Association (AAMA) Standard 501 with HVHZ complying with Section 1709.8.4 and Section 2411.3.2.1.1 of the 8th Edition Florida Building Code (2023) have been met by the testing documented in test report listed above.



December 19th, 2025