

Micah Swartz, P.E.

Project Number: MS24-05007
Project Name: Opaque Steel Edge Door 90min Frame
Date: 6/6/2024 Page: 1 of 8

**Product Approval Supporting Calculations
Alternative Anchorage Analysis & Design**

Project Number: MS24-05007


Drawing Number: D015882

Reference Test Report: NCTL-210-3844-1

Product Name: Opaque Steel Edge Door with 90min Frame (39x86)

Prepared for:

Jeld-Wen Windows & Doors
3737 Lakeport Blvd.
Klamath Falls, OR

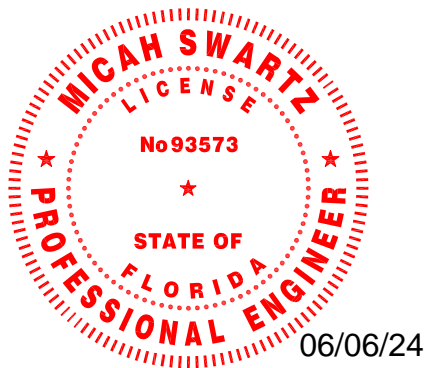

Prepared by:
Micah Swartz, P.E.

This item has been digitally signed and sealed by Micah Swartz, P.E. on the date adjacent to the seal.

Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Micah Swartz, PE
Florida License No. PE 93573

Scope:

Micah Swartz, P.E. is contracted by Jeld-Wen Windows & Doors to evaluate alternative anchorage for the product: Opaque Steel Edge Door with 90min Frame (39x86). This evaluation is based on testing performed by National Certified Testing Laboratories (NCTL) in Orlando, Florida, test report no.: NCTL-210-3844-1 and dated 41211.

This evaluation does not include the air infiltration, water resistance or water penetration of the installation method or the installed product. In addition, the design of the building substrate to resist the superimposed loads is by others.

Reference Standards:

Florida Building Code, Building, 2023 Edition

ANSI/AWC NDS 2018 - National Design Specification (NDS) for Wood Construction

ANSI S100-16 (2020) North American Specification for the Design of Cold-Formed Steel Structural Members

ICC-ES Report ESR-1976 ITW Buildex TEKS Self-Drilling Fasteners

NOA 24-0102.06 Tapcon Concrete and Masonry Anchors with Advanced Threadform Technology

Certification of Independence:

In accordance with Rule 61G20-3 Florida Administrative Code, Micah Swartz, P.E. hereby certifies the following:

- (1) Micah Swartz, P.E. does not have, nor does it intend to acquire or will it acquire, a financial interest in any company manufacturing or distributing products tested or labeled by the agency.
- (2) Micah Swartz, P.E. is not owned, operated or controlled by any company manufacturing or distributing products it tests or labels.
- (3) Micah Swartz, P.E. does not have, nor will acquire, a financial interest in any company manufacturing or distributing products for which the reports are being issued.
- (4) Micah Swartz, P.E. does not have, nor will acquire, a financial interest in any other entity involved in the approval process of the product.

Design Summary:

The table below summarizes the product: Opaque Steel Edge Door with 90min Frame (39x86) and their corresponding performance levels as established by testing.

Table 1: Summary of Test Results

Series/Model	Test Report Number	Size (W x H)	Performance
Opaque Steel Edge Door with 90min Frame (39x86)	NCTL-210-3844-1 (41211)	39x86	+66 psf / -66 psf

As Tested Design:

Screw Information:

Screw Size: 8 Screw Embed: 1.5 in Edge Distance: 3/4 in (minimum)

Wood Screw Lateral: 106 lbs

Alternative Fasteners:

Screw Information:

Screw Size: 8 Screw Embed: 1.5 in Edge Distance: 3/4 in (minimum)

Wood Screw Lateral: 106 lbs

Tapcon Information:

Tapcon Size: 1/4 Embedment: 1-1/4 in (minimum) Edge Distance: 2-1/2 in (minimum)

Tapcon Lateral (Concrete): 203 lbs

Tapcon Lateral (CMU): 161 lbs

Subject: As Tested - Wood Screw Lateral Design - Single Shear

Input:

Calculation:

Screw Information:

Screw Size: 8

Root Diameter: 0.131 in

Screw Embed: 1.5 in

Main Member Type: S-P-F G: 0.42 F_{em} : 3,350 psi thickness (t_m): 1.5 inSide Member Type: Steel G: N/A F_{es} : 36,000 psi thickness (t_s): 0.06 in**Lateral Design Factors - Table 12.3.1A (NDS 2018)**

D:	0.131	in	Diameter
F_{yb} :	100	ksi	Dowel Bending Yield Strength
F_{em} :	3,350	psi	Main Member dowel bearing strength
F_{es} :	36,000	psi	Side Member dowel bearing strength
l_m :	1.5	in	Main Member dowel bearing length
l_s :	0.06	in	Side Member dowel bearing length
R_d :	2.2		Reduction term - Table 12.3.1B (NDS 2018)
R_e :	0.0931		$= F_{em}/F_{es}$
R_t :	25.0		$= l_m/l_s$
k_1 :	0.939		See Table
k_2 :	0.538		See Table

Reference Lateral Design Values - Table 12.3.1A (NDS 2018)

$$Z_{Im}: 299 \text{ lbs} \quad Z_{Im} = \frac{D l_m F_{em}}{R_d} \text{ (EQ 12.3 - 1)}$$

$$Z_{II}: 121 \text{ lbs} \quad Z_{II} = \frac{k_1 D l_s F_{es}}{R_d} \text{ (EQ 12.3 - 3)}$$

$$Z_{III_m}: 136 \text{ lbs} \quad Z_{III_m} = \frac{k_2 D l_m F_{em}}{(1 + 2R_e) R_d} \text{ (EQ 12.3 - 4)}$$

$$Z_{IV}: 112 \text{ lbs} \quad Z_{IV} = \frac{D^2}{R_d} \sqrt{\frac{2F_{em}F_{yb}}{3(1 + R_e)}} \text{ (EQ 12.3 - 6)}$$

$$Z_{MIN}: 112 \text{ lbs}$$

Note: Side member is part of the Jeld-Wen assembly and verified during testing. Modes Z_{Is} and Z_{IIs} are not applicable to the calculation.

Subject: As Tested - Wood Screw Lateral Design - Single Shear Cont.**Adjusted Lateral Design Values** $Z' = Z * C_D * C_M * C_t * C_g * C_{\Delta}$ – As per table 11.3.1 NDS 2018

C_D :	1.6	Load Duration Factor - Table 2.3.2 (NDS 2018)
C_M :	1.0	Wet Service Factor - Table 11.3.3 (NDS 2018)
C_t :	1.0	Temperature Factor - Table 11.3.4 (NDS 2018)
C_g :	1.0	Group Action Factor - Section 11.3.6 (NDS 2018)
C_{Δ} :	1.0	Geometry Factor - Section 12.5.1.1 (NDS 2018)

 Z' : **178** lbs**Fastener Bending Across Shim Space**

Ω :	1.67	
L:	0.25	in Maximum Shim Gap
D:	0.131	in Diameter
F_{yb} :	100	ksi Dowel Bending Yield Strength

$$\frac{F_{yb}}{\Omega} = \frac{M}{S} = \frac{16ZL}{\pi D^3} \Leftrightarrow Z = \frac{F_{yb} \pi D^3}{16 \Omega L}$$

Where $M = \frac{ZL}{2}$ (Guided Bending) Z_n/Ω : **106** lbs**Bearing on Masonry Strap**

Ω :	3.00	
F_u :	33	ksi Tensile Strength of strap
t:	20	GA
t:	0.036	in thickness of strap
D:	0.131	in

$$\frac{P_{nv}}{\Omega} = 2.7 * t * D * F_u - (EQ.J4.3.1 - 4, AISI S100)$$

 P_{nv}/Ω : **140** lbs

Subject: Wood Screw Lateral Design - Single Shear

Input:
 Calculation:

Screw Information:

Screw Size: Root Diameter: in
 Screw Embed: in

Main Member Type: G: F_{em}: psi thickness (t_m): in

Side Member Type: G: F_{es}: psi thickness (t_s): in

Lateral Design Factors - Table 12.3.1A (NDS 2018)

D:	<input type="text" value="0.131"/>	in	Diameter
F _{yb} :	<input type="text" value="100"/>	ksi	Dowel Bending Yield Strength
F _{em} :	<input type="text" value="3,350"/>	psi	Main Member dowel bearing strength
F _{es} :	<input type="text" value="3,350"/>	psi	Side Member dowel bearing strength
l _m :	<input type="text" value="1.5"/>	in	Main Member dowel bearing length
l _s :	<input type="text" value="1.25"/>	in	Side Member dowel bearing length
R _d :	<input type="text" value="2.2"/>		Reduction term - Table 12.3.1B (NDS 2018)
R _e :	<input type="text" value="1"/>		= F _{em} /F _{es}
R _t :	<input type="text" value="1.2"/>		= l _m /l _s
k ₁ :	<input type="text" value="0.459"/>		See Table
k ₂ :	<input type="text" value="1.111"/>		See Table

Reference Lateral Design Values - Table 12.3.1A (NDS 2018)

Z_{I_m}: lbs $Z_{I_m} = \frac{D l_m F_{em}}{R_d}$ (EQ 12.3 - 1)

Z_{II}: lbs $Z_{II} = \frac{k_1 D l_s F_{es}}{R_d}$ (EQ 12.3 - 3)

Z_{III_m}: lbs $Z_{III_m} = \frac{k_2 D l_m F_{em}}{(1 + 2R_e) R_d}$ (EQ 12.3 - 4)

Z_{IV}: lbs $Z_{IV} = \frac{D^2}{R_d} \sqrt{\frac{2F_{em}F_{yb}}{3(1 + R_e)}}$ (EQ 12.3 - 6)

Z_{MIN}: lbs

Note: Side member is part of the Jeld-Wen assembly and verified during testing. Modes Z_{Is} and Z_{IIIs} are not applicable to the calculation.

Subject: Wood Screw Lateral Design - Single Shear Cont.**Adjusted Lateral Design Values** $Z' = Z * C_D * C_M * C_t * C_g * C_{\Delta}$ – As per table 11.3.1 NDS 2018

C_D :	1.6	Load Duration Factor - Table 2.3.2 (NDS 2018)
C_M :	1.0	Wet Service Factor - Table 11.3.3 (NDS 2018)
C_t :	1.0	Temperature Factor - Table 11.3.4 (NDS 2018)
C_g :	1.0	Group Action Factor - Section 11.3.6 (NDS 2018)
C_{Δ} :	1.0	Geometry Factor - Section 12.5.1.1 (NDS 2018)

 Z' : 132 lbs**Fastener Bending Across Shim Space**

Ω :	1.67	
L:	0.25	in Maximum Shim Gap
D:	0.131	in Diameter
F_{yb} :	100	ksi Dowel Bending Yield Strength

$$\frac{F_{yb}}{\Omega} = \frac{M}{S} = \frac{16ZL}{\pi D^3} \Leftrightarrow Z = \frac{F_{yb} \pi D^3}{16 \Omega L}$$

Where $M = \frac{ZL}{2}$ (Guided Bending) Z_n/Ω : 106 lbs**Bearing on Masonry Strap**

Ω :	3.00	
F_u :	33	ksi Tensile Strength of strap
t:	20	GA
t:	0.036	in thickness of strap
D:	0.131	in

$$\frac{P_{nv}}{\Omega} = 2.7 * t * D * F_u - (EQ.J4.3.1 - 4, AISI S100)$$

 P_{nv}/Ω : 140 lbs

Micah Swartz, P.E.

Project Number: MS24-05007
Project Name: Opaque Steel Edge Door 90min Frame
Date: 6/6/2024 Page: 8 of 8

Subject: Tapcon Lateral Design

Input:
Calculation:

Tapcon Size:

Size: 1/4
D: 0.25 in Nominal Diameter
D_{sh}: 0.19 in Shank Diameter

Fastener Shear Capacity - 3,000 psi Concrete

P_{nv}/Ω: 237 lbs See Table 1B of NOA 24-0102.06

Fastener Shear Capacity - Medium-Weight CMU

P_{nv}/Ω: 161 lbs See Table 3 of NOA 24-0102.06

Note:

- Critical anchor spacing is 16D
- Minimum Anchor Embedment is 1-1/4"
- Minimum Edge Distance is 2-1/4"

Fastener Bending Across Shim Space

L: 0.25 in Maximum Shim Gap
D_{sh}: 0.19 in Shank Diameter of Tapcon
F_{yb}: 100 ksi Yield Strength of Tapcon

Ω: 3.00

$$\frac{F_{yb}}{\Omega} = \frac{M}{S} = \frac{16P_n L}{\pi D^3} \Leftrightarrow P_n = \frac{F_{yb} \pi D^3}{16 \Omega L}$$

Where $M = \frac{P_n L}{2}$ (Guided Bending)

P_n/Ω: 539 lbs

Bearing Strength of Masonry Straps - AISI S100

Size: 1/4 Tapcon Size
D_{sh}: 0.19 in Shank Diameter of Tapcon Screw
F_u: 33 ksi Tensile Strength of Masonry Strap
t: 20 GA
t: 0.0359 in Thickness of Masonry Strap

Ω: 3.00

$$\frac{P_{nv}}{\Omega} = 2.7 * t * D * F_u \text{ - (EQ. J4.3.1 - 3, AISI S100)}$$

P_{nv}/Ω: 203 lbs