

Evaluation Report

“Cee-Lock Panel”

Metal Roof Assembly

Manufacturer:

Berridge Manufacturing Company

1720 Maury Road

Houston, TX 77026

(800) 231-8127

for

Florida Product Approval

FL 11269.1 R8

Florida Building Code 8th Edition (2023)

Method: 1 - D

Category: Roofing

Sub - Category: Metal Roofing

Product: “Cee-Lock” Roof Panel

Material: Steel

Panel Thickness: 24 gauge

Panel Width: 16-1/2” or 11-3/4”

Support: Wood Deck

Prepared by:

James L. Buckner, P.E., S.E.C.B.

Florida Professional Engineer # 31242

Florida Evaluation ANE ID: 1916

Project Manager: Diana Galloway

Report No. 23-542-CL-S4W-ER

(Revises Report No. 20-227-CL-S4W-ER, FL11269.1 R7)


Date: 09/26/2023

Contents:

Evaluation Report

Pages 1 – 10

This item has been digitally signed and sealed by James L. Buckner, P.E., on this date below. Printed copies of this document are not considered signed and sealed, and the signature must be verified on any electronic copies.

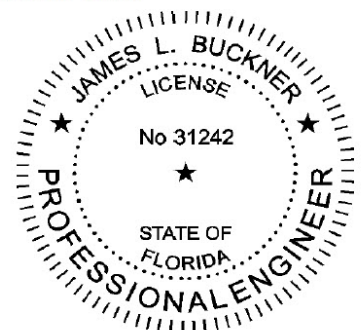

James L. Buckner, P.E.

FL31242

Date: 2023.09.26 15:25:27
-04'00

CBUCK, Inc. dba CBUCK Engineering

Phone: (561) 491-9927 · Email: cbuck@cbuckinc.net · Website: www.cbuckinc.net

Business: 1374 Community Dr., Jupiter, FL 33458

Manufacturer:	Berridge Manufacturing Company 1720 Maury Road Houston, TX 77026 (800) 231-8127 www.berridge.com
Product Name:	“Cee-Lock”
Product Category:	Roofing
Product Sub-Category	Metal Roofing
Compliance Method:	State Product Approval Rule 61G20-3.005 (1) (d)
Product/System Description:	“Cee-Lock” Snap-Lock Roof Panel 1-1/2” Rib Height, 24 gauge Steel roof panel restrained by panel clips fastened into Plywood Deck.
Product Assembly as Evaluated:	Refer to Page 4 of this report for product assembly components/materials & standards: <ol style="list-style-type: none">1. Roof Panel2. Panel Clip3. Fasteners4. Underlayment5. Insulation (Optional)
Support:	Type: Wood Deck (Design of support and its attachment to support framing is outside the scope of this evaluation.) Description: <ul style="list-style-type: none">• 15/32 (min.) or greater plywood, (Per Table A),• or Wood plank (min. specific gravity of 0.42)
Slope:	Minimum slope shall be in compliance with FBC Chapter 15 Section 1507.4.2, applicable code sections and in accordance with manufacturer’s recommendations.
Performance:	Wind Uplift Resistance: <ul style="list-style-type: none">• Design Uplift Pressure: Refer to Table A (Refer to “Table A” attachment details herein)

- Performance Standards:** The product described herein has demonstrated compliance with:
- UL580-06 – *Test for Uplift Resistance of Roof Assemblies*
 - UL 1897-15 – *Uplift test for roof covering systems*
 - TAS 125-03 – *Standard Requirements for Metal Roofing Systems*
- Standards Equivalency:** The UL 580-94 & UL 1897-98 standard version used to test the evaluated product assembly is equivalent with the prescribed standards in UL 580-06 & UL 1897-15 adopted by the Florida Building Code 8th Edition (2023).
- Code Compliance:** The product described herein has demonstrated compliance with Florida Building Code 8th Edition (2023), Section 1504.3.2.
- Evaluation Report Scope:** This product evaluation is limited to compliance with the structural requirements of the Florida Building Code, as related to the scope section to Florida Product Approval Rule 61G20-3.001.
- Limitations and Conditions of Use:**
- Scope of “Limitations and Conditions of Use” for this evaluation:
This evaluation report for “Optional Statewide Approval” contains technical documentation, specifications and installation method(s) which include “Limitations and Conditions of Use” throughout the report in accordance with Rule 61G20-3.005. Per Rule 61G20-3.004, the Florida Building Commission is the authority to approve products under “Optional Statewide Approval”.
 - Option for application outside “Limitations and Conditions of Use”
Rule 61G20-3.005(1)(e) allows engineering analysis for “project specific approval by the local authorities having jurisdiction in accordance with the alternate methods and materials authorized in the Code”. Any modification of the product as evaluated in this report and approved by the Florida Building Commission is outside the scope of this evaluation and will be the responsibility of others.
 - This report is a building code product evaluation per FLPE rule (FAC) 61G15-36 to comply with Florida product approval rule (FAC) 61G20-3. This evaluation report is part of the Florida Building Commission approval for the listed code related criteria. This report by James Buckner, P.E. and CBLUE Engineering is not a design certification of code compliance construction submittal documentation, per FBC section 107, for any individual structure, site specific or permit design.
 - All metal components and fasteners shall be corrosion resistant in accordance with applicable sections of FBC, including but limited to Sections 1504.3.2, 1506.6 and 1507.4.4.
 - Design of support system is outside the scope of this report.
 - Fire Classification is outside the scope of Rule 61G20-3, and is therefore not included in this evaluation.
 - This evaluation report does not evaluate the use of this product for use in the High Velocity Hurricane Zone code section. (Dade & Broward Counties)
- Quality Assurance:** The manufacturer has demonstrated compliance of roof panel products in accordance with the Florida Building Code and Rule 61G20-3.0005 (3) for manufacturing under a quality assurance program audited by an approved quality assurance entity through UL, LLC (FBC Organization #: QUA 9625).

**Components/Materials
(by Manufacturer):**

<p>Roof Panel:</p> <p>Material: Steel</p> <p>Thickness: 24 gauge (min.)</p> <p>Panel Width(s): 16.5" (max.) Coverage, or 11.75 (max.) Coverage</p> <p>Rib Height: 1-1/2"</p> <p>Yield Strength: 40 ksi min.</p> <p>Steel Grade: 40</p> <p>Corrosion Resistance: In compliance with FBC Section 1507.4.3:</p> <ul style="list-style-type: none"> • ASTM A792 coated, or • ASTM A653 G90 galvanized steel 	<p>Berridge "Cee-Lock"</p> <p>Steel</p> <p>24 gauge (min.)</p> <p>16.5" (max.) Coverage, or 11.75 (max.) Coverage</p> <p>1-1/2"</p> <p>40 ksi min.</p> <p>40</p> <p>In compliance with FBC Section 1507.4.3:</p> <ul style="list-style-type: none"> • ASTM A792 coated, or • ASTM A653 G90 galvanized steel
<p>Roof Panel Clips:</p> <p><u>CLIP 1</u></p> <p>Type: One-Piece, fixed clip</p> <p>Material: Steel</p> <p>Thickness: 24 Gauge</p> <p>Dimensions: 1-7/16" (tall) x 1-3/8" (wide) x 3" (long)</p> <p><u>CLIP 2</u></p> <p>Type: One-Piece, fixed continuous clip</p> <p>Material: Steel</p> <p>Thickness: 24 Gauge or 22 Gauge (See Table A)</p> <p>Dimensions: 1-7/16"(tall) x 1-3/8"(wide) x continuous (w/panel length)</p> <p>Yield Strength: 40 ksi min.</p> <p>Corrosion Resistance: Per FBC Section 1506.7</p>	<p>PICK ONE OF THE FOLLOWING:</p> <p>Berridge "Cee-Clip"</p> <p>One-Piece, fixed clip</p> <p>Steel</p> <p>24 Gauge</p> <p>1-7/16" (tall) x 1-3/8" (wide) x 3" (long)</p> <p>Berridge "Cee-Rib" Clip</p> <p>One-Piece, fixed continuous clip</p> <p>Steel</p> <p>24 Gauge or 22 Gauge (See Table A)</p> <p>1-7/16"(tall) x 1-3/8"(wide) x continuous (w/panel length)</p> <p>40 ksi min.</p> <p>Per FBC Section 1506.7</p>
<p>Vinyl Weatherseal:</p> <p>Berridge "Weatherseal" Patent 4641475</p> <p>Snap on seam</p>	<p>Berridge "Weatherseal"</p> <p>Patent 4641475</p> <p>Snap on seam</p>
<p>Fastener:</p> <p><u>FASTENER 1</u></p> <p>Size : #10 x 1"</p> <p><u>FASTENER 2</u></p> <p>Size : #12-11 x 1"</p> <p>Corrosion Resistance: Per FBC Section 1506.6 and 1507.4.4</p> <p>Standard: Per ANSI/ASME B18.6.1</p>	<p>PICK ONE OF THE FOLLOWING:</p> <p>Pancake-Head Wood Screw</p> <p>#10 x 1"</p> <p>Pancake-Head Wood Screw</p> <p>#12-11 x 1"</p> <p>Per FBC Section 1506.6 and 1507.4.4</p> <p>Per ANSI/ASME B18.6.1</p>

**Components & Materials:
(by Others)**

<p>Underlayment:</p> <p>Material and application shall be in compliance with FBC Section 1507.1.1 and in accordance with applicable code sections and manufacturer's recommendations.</p> <p>Insulation (Optional):</p> <p>Type: Rigid Insulation Board</p> <p>Thickness: 3" (max.)</p> <p>Properties:</p> <p>Density: 2.25 pcf (lbs/ft³) min.</p> <p>Or Compressive Strength: 20 psi min.</p> <p>Insulation Notes:</p> <ul style="list-style-type: none"> • Rigid Insulation shall meet minimum density OR compressive strength. 	<p>Underlayment:</p> <p>Material and application shall be in compliance with FBC Section 1507.1.1 and in accordance with applicable code sections and manufacturer's recommendations.</p> <p>Insulation (Optional):</p> <p>Rigid Insulation Board</p> <p>3" (max.)</p> <p>2.25 pcf (lbs/ft³) min.</p> <p>20 psi min.</p>
---	---

- Insulation shall comply with FBC Section 1508. When insulation is incorporated, fastener length shall conform to penetrate thru bottom of support a minimum of 3/16".

Installation:

Installation Method:

(Refer to "TABLE A" below and drawings at the end of this report.)

- Clip Spacing or Fastener Spacing Along Continuous Clip:
Refer to "TABLE A" Below (along the length of the panel)
- # fasteners per Clip: **Refer to "TABLE A" Below**
- Rib Interlock: Snap-Lock
 (Panel ribs shall be fully engaged to form an integral snap-lock.)
- Minimum fastener penetration thru bottom of support, 3/16".
- For panel construction at the end of panels, refer to manufacturer's instructions and any site specific design.

TABLE "A"								
ALLOWABLE LOADS								
#	Panel Width	Deck Thickness	Panel Clip	Fastener	# Fasteners per Attachment	Clip or Fastener Spacing	Vinyl Weather Seal?	DESIGN PRESSURE (PSF)
1.	11-3/4"	15/32"min.	Cee-Clip	#12	2	20"	No	- 56
2.	16-1/2"	15/32"min.	24 Ga. Cee-Rib	#10	1	20"	No	- 74.75
3.	16-1/2"	15/32"min.	24 Ga. Cee-Rib	#10	1	10"	No	-108.5
4.	11-3/4"	15/32"min.	24 Ga. Cee-Rib	#12	1	4"	No	- 176
5.	11-3/4"	15/32"min.	Cee-Clip	#12	2	8"	No	- 176
6.	16-1/2"	15/32"min.	22 Ga. Cee-Rib	#12	1	6"	Yes	- 146
<ul style="list-style-type: none"> • Allowable design pressure(s) for allowable stress design (ASD). 								


Install the "Cee-Lock" roof panel assembly in compliance with the installation method listed in this report and applicable code sections of FBC 8th Edition (2023). The installation method described herein is in accordance with the scope of this evaluation report. Refer to manufacturer's installation instructions as a supplemental guide for attachment.

Referenced Data:


1. TAS 125-03 Uplift Test (Per UL580-94 and UL 1897-98)
By Force Engineering & Testing Inc.(FBC Organization #TST ID: 5328)
Report #: 49-0194TA, 49-0194TB & 49-0194TC , Test Date: 09/21/06
2. TAS 125-03 Uplift Test (Per UL580-06 and UL 1897-04)
By Force Engineering & Testing Inc.(FBC Organization #TST ID: 5328)
Report #: 49-0192T-13A,B, Test Date: 10/28/13
2. TAS 125-03 Uplift Test
By Force Engineering & Testing Inc. (FBC Organization ID# TST 5328)
Report # 49-0009T-18B, Dated 4/11/18
3. Quality Assurance
UL, LLC (FBC Organization #: QUA 9625)
4. Equivalency of Test Standard Certification
By James L. Buckner, P.E. @ CBUG Engineering
(FBC Organization # ANE 1916)
5. Certification of Independence
By James L. Buckner, P.E. @ CBUG Engineering
(FBC Organization # ANE 1916)
6. Engineering Analysis
By CBUG Engineering

Installation Method
Berridge Manufacturing Company
“Cee-Lock” (24 gauge Steel) Roof Panel attached to Wood Deck

Drawings

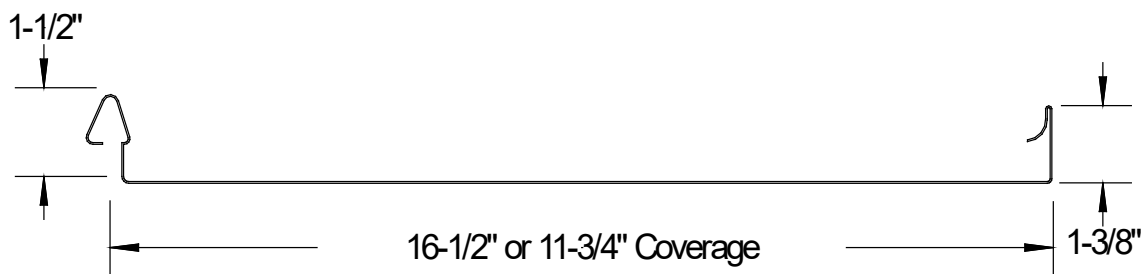


Typical Panel Profile

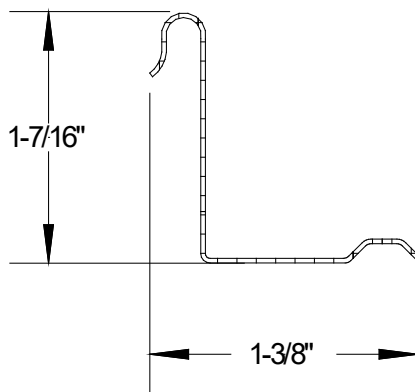


**Berridge “Cee-Clip”
Panel Clip Profile Side View**


Installation Method Berridge Manufacturing Company "Cee-Lock" (24 gauge Steel) Roof Panel attached to Wood Deck

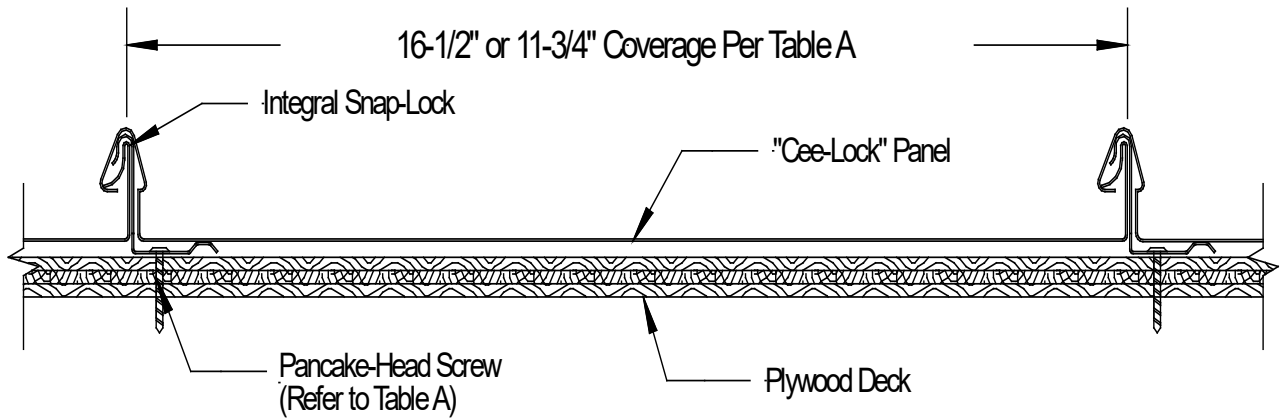

Typical Assembly Profile View (Typical Fastening Pattern Across Width)

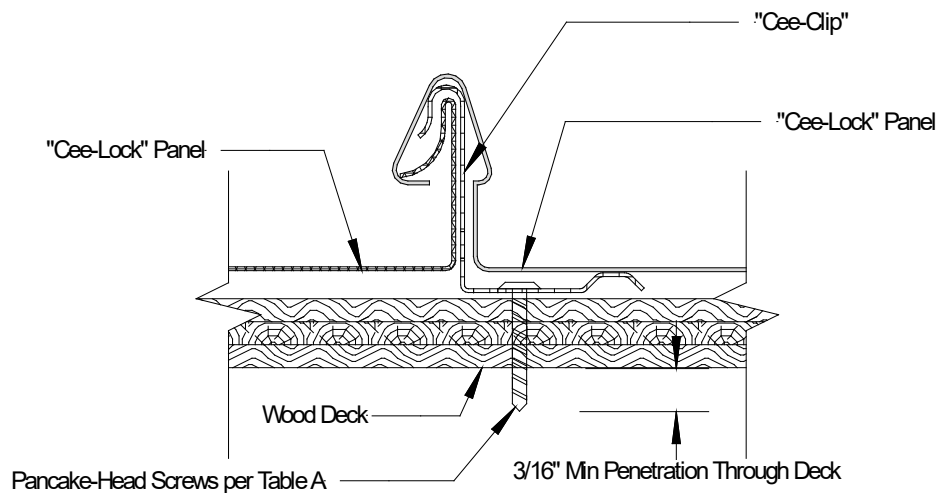


Typical Panel Clip Assembly

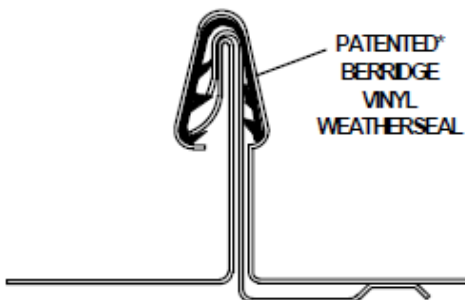


*U.S.PATENT NO. 4641475

Typical Clip Assembly with Berridge Vinyl Weatherseal (Refer to Table A)

Installation Method Berridge Manufacturing Company "Cee-Lock" (24 gauge Steel) Roof Panel attached to Wood Deck

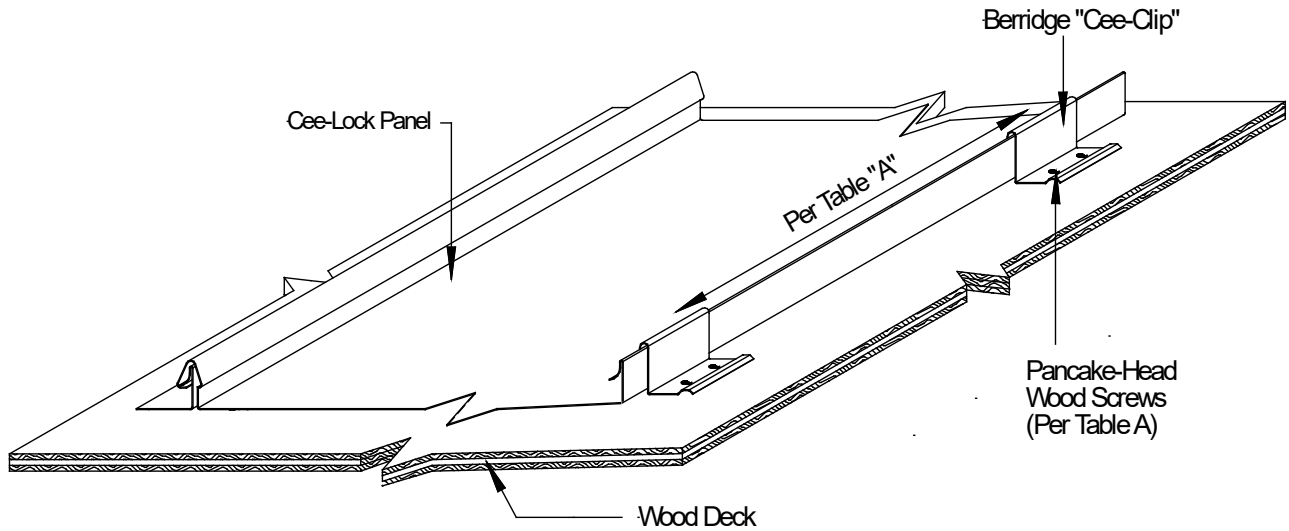

Typical Roof Assembly with Berridge "Cee-Clip" Panel Clip - Isometric View

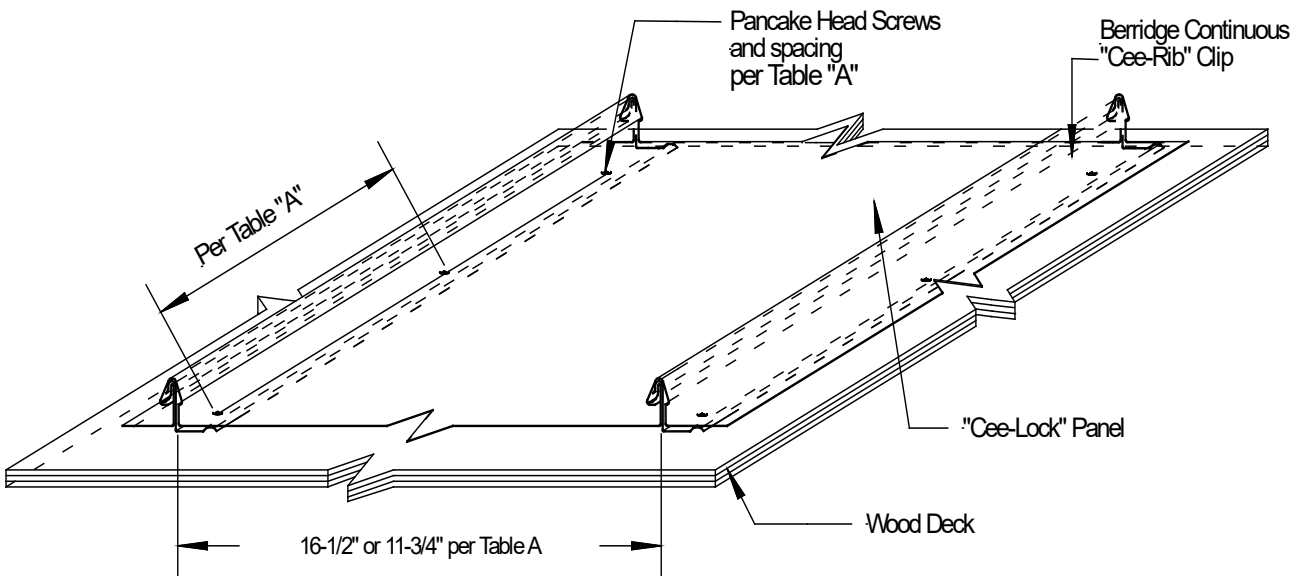

Typical Roof Assembly with Berridge Continuous "Cee-Rib" Panel Clip - Isometric View

Installation Method
Berridge Manufacturing Company
“Cee-Lock” (24 gauge Steel) Roof Panel attached to Wood Deck

TABLE “A” ALLOWABLE LOADS								
#	Panel Width	Deck Thickness	Panel Clip	Fastener	# Fasteners per Attachment	Clip or Fastener Spacing	Vinyl Weather Seal?	DESIGN PRESSURE (PSF)
1.	11-3/4”	15/32” min.	Cee-Clip	#12	2	20”	No	- 56
2.	16-1/2”	15/32” min.	24 Ga. Cee-Rib	#10	1	20”	No	- 74.75
3.	16-1/2”	15/32” min.	24 Ga. Cee-Rib	#10	1	10”	No	-108.5
4.	11-3/4”	15/32” min.	24 Ga. Cee-Rib	#12	1	4”	No	- 176
5.	11-3/4”	15/32” min.	Cee-Clip	#12	2	8”	No	- 176
6.	16-1/2”	15/32” min.	22 Ga. Cee-Rib	#12	1	6”	Yes	- 146