



NEMO|etc.

Certificate of Authorization #32455
353 Christian Street, Unit #13
Oxford, CT 06478
(203) 262-9245

ENGINEER

EVALUATE

TEST

CONSULT

EVALUATION REPORT BY FLORIDA P.E.

Soprema, Inc.

310 Quadral Drive
Wadsworth, OH 44281
(800) 356-3521

Evaluation Report 2759.06.10-R19

FL13806-R18

Date of Issuance: 06/16/2010

Revision 19: 10/06/2022

SCOPE:

This Evaluation Report is issued under [Rule 61G20-3](#) and the applicable rules and regulations governing the use of construction materials in the State of Florida. The documentation submitted has been reviewed by Robert Nieminen, P.E. for use of the product under the Florida Building Code. The product described herein has been evaluated for compliance with the [7th Edition \(2020\) Florida Building Code sections noted herein](#).

DESCRIPTION: Soprema Liquid Applied Roof Systems

LABELING: Labeling shall be in accordance with the requirements of the Accredited Quality Assurance Agency noted herein.


CONTINUED COMPLIANCE: This Evaluation Report is valid until such time as the named product(s) changes, the referenced Quality Assurance or production facility location(s) changes, or Code provisions that relate to the product(s) change. Acceptance of our Evaluation Reports by the named client constitutes agreement to notify NEMO ETC, LLC of any changes to the product(s), the Quality Assurance or the production facility location(s). NEMO ETC, LLC requires a complete review of its Evaluation Report relative to updated Code requirements with each Code Cycle.

ADVERTISEMENT: The Florida Product Approval Number (FL#) preceded by the words "NEMO P.E. Evaluated" may be displayed in advertising literature. If any portion of the Evaluation Report is displayed, then it shall be done in its entirety.

INSPECTION: Upon request, a copy of this entire Evaluation Report shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This Evaluation Report consists of pages 1 through 6, plus a 55-page Appendix.

Prepared by:

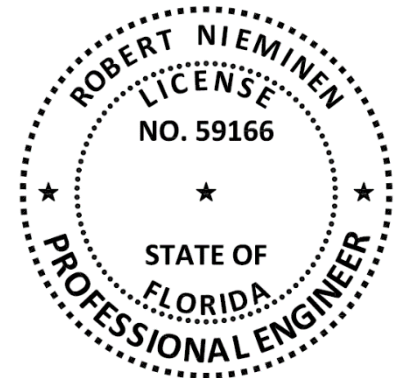

CERTIFICATION OF INDEPENDENCE:

1. NEMO ETC, LLC does not have, nor does it intend to acquire or will it acquire, a financial interest in any company manufacturing or distributing products it evaluates.
2. NEMO ETC, LLC is not owned, operated or controlled by any company manufacturing or distributing products it evaluates.
3. Robert Nieminen, P.E. does not have nor will acquire, a financial interest in any company manufacturing or distributing products for which the evaluation reports are being issued.
4. Robert Nieminen, P.E. does not have, nor will acquire, a financial interest in any other entity involved in the approval process of the product.
5. This is a building code evaluation. Neither NEMO ETC, LLC nor Robert Nieminen, P.E. are, in any way, the Designer of Record for any project on which this Evaluation Report, or previous versions thereof, is/was used for permitting or design guidance unless retained specifically for that purpose.

©2019 NEMO ETC, LLC

ROOFING SYSTEMS EVALUATION:
1. SCOPE:

Product Category: Roofing
Sub-Category: Liquid Applied Roof Systems
Product Approval Method: Method 1, Option D – Codified Material, Evaluation by Engineer
Compliance Statement: **Liquid Applied Roof Systems**, as produced by **Soprema, Inc.**, have demonstrated compliance with the following sections of the **7th Edition (2020) Florida Building Code** through testing in accordance with the following Standards. Compliance is subject to the Installation Requirements and Limitations / Conditions of Use set forth herein.

2. STANDARDS:

<u>SECTION</u>	<u>PROPERTY</u>	<u>STANDARD</u>	<u>YEAR</u>
1504.3.1	Wind resistance	FM 4474	2011
1504.6	Physical properties	ASTM G155	2013
1504.7	Impact resistance	FM 4470, Section 4.6	2016
1507.11.2	Material standard	ASTM D6163	2015
1507.11.2	Material standard	ASTM D6164	2011

3. REFERENCES:

<u>ENTITY</u>	<u>EXAMINATION</u>	<u>REFERENCE</u>	<u>DATE</u>
NEMO (TST6049)	M-D 13-1362	4S-SOP-18-002.02.19	02/04/2019
NEMO (TST6049)	Physical properties	4p-SOP-19-SSLAP-04.A	11/06/2019
NEMO (TST6049)	Physical properties	4p-SOP-20-SSLAP-03.C	03/09/2021
ACRC (TST4671)	TAS 114	15-033	12/15/2015
ACRC (TST4671)	TAS 114	15-035	12/16/2015
ERD (TST6049)	FM 4474	2778.07.05	07/15/2005
ERD (TST6049)	FM 4474	S32840.06.10	06/22/2010
ERD (TST6049)	FM 4474	S39920.01.12-R1	05/24/2012
ERD (TST6049)	FM 4474	S41370.07.12	07/13/2012
ERD (TST6049)	FM 4474	S43200SC	10/21/2012
ERD (TST6049)	FM 4474	S45070.08.13	08/13/2013
ERD (TST6049)	FM 4474	S47170.05.14-1	05/12/2014
ERD (TST6049)	FM 4470/4474	NG-SC9815.11.15	11/06/2015
ERD (TST6049)	FM 4474	S10695.02.16-2	02/23/2016
ERD (TST6049)	FM 4474	S10695.02.16-1-R1	04/01/2016
ERD (TST6049)	FM 4474	SOP-SC11825.16	10/19/2016
FM (TST1867)	FM 4470/FM 4474	3009610	10/22/2001
FM (TST1867)	FM 4470/FM 4474	3012321	07/29/2002
FM (TST1867)	FM 4470/FM 4474	3014751	08/27/2003
FM (TST1867)	FM 4470/FM 4474	3018579	10/09/2003
FM (TST1867)	FM 4470/FM 4474	3019317	06/30/2004
FM (TST1867)	FM 4470/FM 4474	3024311	11/01/2006
FM (TST1867)	FM 4470/FM 4474	3025185	05/22/2007
FM (TST1867)	FM 4470/FM 4474	3031818	02/20/2009
FM (TST1867)	FM 4470/FM 4474	3032172	06/12/2009
FM (TST1867)	FM 4470/FM 4474	3036182	07/31/2009
FM (TST1867)	FM 4470/FM 4474	3035625	10/29/2009
FM (TST1867)	FM 4470/FM 4474	3042559	06/28/2011
FM (TST1867)	FM 4470/FM 4474	3042905 (released)	01/10/2012
FM (TST1867)	FM 4470/FM 4474	3044801	02/27/2012
FM (TST1867)	FM 4470/FM 4474	3046328 (released)	09/13/2012
FM (TST1867)	FM 4470/FM 4474	3041769 (released)	09/27/2012
FM (TST1867)	FM 4470/FM 4474	3045363 (released)	10/12/2012
FM (TST1867)	FM 4470/FM 4474	3045101	11/05/2012
FM (TST1867)	FM 4470/FM 4474	3046765	02/15/2013
FM (TST1867)	FM 4470/FM 4474	797-08292-267	04/22/2013
FM (TST1867)	FM 4470/FM 4474	3046941	12/19/2013
FM (TST1867)	FM 4470/FM 4474	3048085 (released)	02/07/2014

ENTITY	EXAMINATION	REFERENCE	DATE
FM (TST1867)	FM 4470/FM 4474	RR200234	03/16/2015
FM (TST1867)	FM 4470/FM 4474	3053841	03/27/2015
FM (TST1867)	FM 4470/FM 4474	3051109	05/11/2015
FM (TST1867)	FM 4470/FM 4474	RR202234	09/29/2015
FM (TST1867)	FM 4470/FM 4474	RR202235	10/07/2015
FM (TST1867)	FM 4470/FM 4474	3054633	12/18/2015
FM (TST1867)	FM 4470/FM 4474	3055167 (released)	02/10/2016
FM (TST1867)	FM 4470/FM 4474	3053475 (released)	02/11/2016
FM (TST1867)	FM 4470/FM 4474	3056403 (released)	01/10/2017
FM (TST1867)	FM 4470/FM 4474	RR214777	09/13/2018
NEMO	P.E. Evaluation	S35000.12.10-R32	04/08/2022
NEMO (TST6049)	FM 4474	4L-SOP-18-005.07.18	07/13/2018
NEMO (TST6049)	FM 4474	4L-SOP-18-005-09.18-2	09/20/2018
NEMO (TST6049)	FM 4474	4L-SOP-18-005-08.18-1	01/25/2019
NEMO (TST6049)	Criticality	4i-SOP-19-SSCRT-03.A	10/22/2019
NEMO (TST6049)	FM 4474	4a-SOP-19-LSWUS-05.A	10/23/2019
NEMO (TST6049)	FM 4474	4a-SOP-19-LSWUS-07.A	11/20/2019
SOPREMA	Traceability	Equivalency declaration	01/25/2021
UL, LLC. (QUA9625)	Quality Control (ALSAN)	Service Confirmation	03/17/2022
UL, LLC. (QUA9625)	Quality Control (Mod Bit)	Service Confirmation	03/17/2022

4. PRODUCT DESCRIPTION:

This Evaluation Report covers Soprema Liquid Applied Roof Systems applied to Approved substrates as outlined in the Limitations / Conditions of Use herein. The following products make up the subject systems.

TABLE 1A: EVALUATED COMPONENTS - LIQUID APPLIED MEMBRANES				
TYPE	PRODUCT	MATERIAL STANDARD		PLANT(s)
		REFERENCE	TYPE	
LIQUID APPLIED ROOF COMPONENTS	ALSAN RS 230 Field or Flash	M-D 13-1362	'flexible'	Wadsworth, OH
	ALSAN Trafik RS 730 Field or Flash			
	ALSAN RS 260 LO Field or Flash			
	ALSAN RS LO Catalyst Powder			
	ALSAN RS Fleece			Saint-Elzéar, QC

TABLE 1B: EVALUATED COMPONENTS - ACCESSORIES		
TYPE	PRODUCT	PLANT(S)
PRIMERS	ALSAN RS 276 Primer	Wadsworth, OH
	ALSAN RS 222 Primer	
SURFACING	ALSAN RS 233 Self-Leveling Mortar, mixture of:	
	ALSAN RS 210	Wadsworth, OH
	ALSAN RS 223 Mixing Powder	New Rochelle, NY
	ALSAN Trafik RS 733 Self-Leveling Mortar, mixture of:	
	ALSAN Trafik RS 733, Part A	Wadsworth, OH
	ALSAN Trafik RS 733, Part B	New Rochelle, NY
	ALSAN RS 263 LO Self-Leveling Mortar, mixture of:	
	ALSAN RS 240 LO	Wadsworth, OH
	ALSAN RS 223 Mixing Powder	New Rochelle, NY
	ALSAN Trafik RS 263 LO Self-Leveling Mortar, mixture of:	
	ALSAN Trafik RS 263, Part A	Wadsworth, OH
	ALSAN Trafik RS 263, Part B	New Rochelle, NY
	ALSAN RS 281 Finish	Wadsworth, OH
	ALSAN Trafik RS 781 CLR	Wadsworth, OH
	ALSAN RS 287 Color Finish Base	Wadsworth, OH
	ALSAN Trafik RS 787 CF	Wadsworth, OH
	ALSAN RS 289 Textured Base	Wadsworth, OH
	ALSAN Trafik RS 789 LT	Wadsworth, OH

TABLE 1C: EVALUATED COMPONENTS – SUB-ASSEMBLY MEMBRANES

TYPE	PRODUCT	MATERIAL STANDARD			PLANT(S)
		REFERENCE	TYPE	GRADE	
BASE SHEETS	MODIFIED SOPRA G	ASTM D4601	2	N/A	MS, OH
	SOPRABASE S	ASTM D4601	2	N/A	OH
	SOPRABASE TG	ASTM D4601	2	N/A	MS, OH
PLY SHEETS	SOPRA IV	ASTM D2178	4	N/A	AL
	SOPRA VI	ASTM D2178	6	N/A	AL
MECHANICALLY ATTACHED, SMOOTH SBS MEMBRANES	SOPRAFX Base 611	ASTM D6164	1	S	MS*, OH
	SOPRAFX Base 612	ASTM D6164	1	S	MS*, OH
	SOPRAFX Base 613	ASTM D6164	1	S	MS*, OH
	SOPRAFX Base 622	ASTM D6164	1	S	MS*, OH
	SOPRAFX Base 614	ASTM D6164	2	S	MS*, OH
SMOOTH SBS MEMBRANES	COLVENT TG	ASTM D6163	1	S	OH
	ELASTOPHENE Flam 2.2	ASTM D6163	1	S	MS*, OH
	ELASTOPHENE Flam 3.0	ASTM D6163	1	S	MS*, OH
	ELASTOPHENE Flam Stick	ASTM D6163	1	S	QC
	ELASTOPHENE Sanded 2.2	ASTM D6163	1	S	MS*, OH
	ELASTOPHENE Sanded 3.0	ASTM D6163	1	S	OH
	ELASTOPHENE SP 2.2	ASTM D6163	1	S	OH
	ELASTOPHENE SP 3.0	ASTM D6163	1	S	MS*, OH
	ELASTOPHENE Stick	ASTM D6163	1	S	OH
	COLVENT 180 TG	ASTM D6164	1	S	OH
	SOPRALENE 180 Sanded	ASTM D6164	1	S	MS*, OH
	SOPRALENE 180 Sanded 2.2	ASTM D6164	1	S	MS*, OH
	SOPRALENE 180 SP 3.0	ASTM D6164	1	S	MS*, OH
	SOPRALENE 180 SP 3.5	ASTM D6164	1	S	MS*, OH
	SOPRALENE Flam 180	ASTM D6164	1	S	MS*, OH
	SOPRALENE Flam Stick	ASTM D6164	1	S	MS*, OH
	SOPRALENE Stick	ASTM D6164	1	S	MS*, OH
	SOPRALENE 250 Sanded	ASTM D6164	2	S	OH
	SOPRALENE 250 SP	ASTM D6164	2	S	OH
	SOPRALENE Flam 250	ASTM D6164	2	S	MS*, OH
GRANULE SBS MEMBRANES	ELASTOPHENE Flam FR GR	ASTM D6163	1	G	MS*, OH
	ELASTOPHENE Flam LS FR GR	ASTM D6163	1	G	MS*, OH
	ELASTOPHENE FR GR	ASTM D6163	1	G	MS*, OH
	ELASTOPHENE LS FR GR	ASTM D6163	1	G	MS* OH
	ELASTOPHENE Stick FR GR	ASTM D6163	1	G	OH
	SOPRALENE 180 FR GR	ASTM D6164	1	G	MS*, OH
	SOPRALENE Flam 180 FR GR	ASTM D6164	1	G	MS*, OH
	SOPRALENE Flam 180 GR	ASTM D6164	1	G	MS*, OH
	SOPRALENE 250 FR GR	ASTM D6164	2	G	OH
	SOPRALENE Flam 250 FR GR	ASTM D6164	2	G	OH

*Indicates membrane/plant combination is Certified by ISO/IEC 17065 Certification Entity; Nemo|cert. (www.nemocert.com) to the noted standard.

5. LIMITATIONS:

- 5.1 This is a Building Code Evaluation. Neither NEMO ETC, LLC nor Robert Nieminen, P.E. are, in any way, the Designer of Record for any project on which this Evaluation Report, or previous versions thereof, is/was used for permitting or design guidance unless retained specifically for that purpose.
- 5.2 This Evaluation Report is not for use in FBC High Velocity Hurricane Zone jurisdictions (i.e., Broward and Miami-Dade Counties).
- 5.3 This Evaluation Report pertains to above-deck roof components. Roof decks and structural members shall be in accordance with FBC requirements to the satisfaction of the Authority Having Jurisdiction.
- 5.4 This Evaluation Report does not include evaluation of fire classification. Refer to **FBC 1505** for requirements and limitations regarding roof assembly fire classification. Refer to **FBC 2603** for requirements and limitations concerning the use of foam plastic insulation.
- 5.5 This Evaluation Report does not include evaluation of roof edge termination. Refer to **FBC 1504.5** for requirements and limitations regarding edge securement for low-slope roofs.
- 5.6 Refer to **FBC 1511** for requirements and limitations regarding recover installations.
- 5.6.1 For mechanically attached components over existing roof decks, fasteners shall be tested in the existing deck for withdrawal resistance. A qualified design professional shall review the data for comparison to the minimum requirements for the system. Testing shall be in accordance with [ANSI/SPRI FX-1](#) or [Testing Application Standard TAS 105](#).
- 5.6.2 For bonded insulation or membrane over existing substrates in a re-roof (tear off) or recover installation, the existing deck or existing roof surface shall be examined for compatibility with the adhesive to be installed. If any surface conditions exist that bring system performance into question, field uplift testing in accordance with [ANSI/SPRI IA-1](#), [ASTM E907](#), [FM Loss Prevention Data Sheet 1-52](#) or [Testing Application Standard TAS 124](#) shall be conducted on mock-ups of the proposed new roof assembly.
- 5.6.3 For bonded insulation or membrane over existing substrates in a recover installation, the existing roof system shall be capable of resisting project design pressures on its own merit to the satisfaction of the Authority Having Jurisdiction, as documented through field uplift testing in accordance with [ASTM E907](#), [FM Loss Prevention Data Sheet 1-52](#) or [Testing Application Standard TAS 124](#).
- 5.7 Refer to Appendix 1 for system attachment requirements for wind load resistance.
- 5.7.1 "MDP" = Maximum Design Pressure is the result of testing for wind load resistance based on allowable wind loads, and reflects the ultimate passing pressure divided by 2 (the 2 to 1 margin of safety per **FBC 1504.9** has already been applied). Refer to **FBC 1609** for determination of design wind loads.
- 5.7.2 For mechanically attached components or partially-bonded insulation, the maximum design pressure for the selected assembly shall meet or exceed at least the Zone 1 PRIME design pressure determined in accordance with **FBC Chapter 16**. Elevated pressure zones shall employ an attachment density designed by a qualified design professional to resist the elevated pressure criteria. Commonly used methods are [ANSI/SPRI WD1](#), [FM Loss Prevention Data Sheet 1-29](#), [Roofing Application Standard RAS 117](#) and [Roofing Application Standard RAS 137](#). Assemblies marked with an asterisk* carry the limitations set forth in **Section 2.2.10.1 of FM Loss Prevention Data Sheet 1-29 (February 2020)** for Zone 2/3 enhancements.
- 5.7.3 For assemblies with all components fully bonded in place, the maximum design pressure for the selected assembly shall meet or exceed critical design pressure determined in accordance with **FBC Chapter 16**. No rational analysis is permitted for these systems.
- 5.8 All components in the roof assembly shall have quality assurance audit in accordance with **F.A.C. Rule 61G20-3**. Refer to the Product Approval of the component manufacturer for components listed in Appendix 1 that are produced by a Product Manufacturer other than the report holder on Page 1 of this Evaluation Report.

6. INSTALLATION:

Soprema Liquid Applied Roof Systems shall be installed in accordance with **Soprema, Inc.** current, published installation instructions, subject to the Limitations / Conditions of Use noted herein.

7. BUILDING PERMIT REQUIREMENTS:

As required by the Building Official or Authority Having Jurisdiction in order to properly evaluate the installation of this product.

8. MANUFACTURING PLANTS:

Contact the named QA entity for manufacturing facilities covered by **F.A.C. Rule 61G20-3** QA requirements. Refer to [Section 4](#) herein for products and production locations having met codified material standards.

9. QUALITY ASSURANCE ENTITY:

UL LLC – QUA9625; (360) 817-5512; Vinycia.Seman@ul.com

- THE 55-PAGES THAT FOLLOW FORM PART OF THIS EVALUATION REPORT -

APPENDIX 1: ATTACHMENT REQUIREMENTS FOR WIND UPLIFT RESISTANCE

TABLE	DECK	APPLICATION	TYPE	DESCRIPTION	PAGE
1A	Wood	New or Reroof (Tear-Off)	A-2	Mech. Attached Anchor Sheet, Bonded Insulation, Bonded Roof Cover	12
1B	Wood	New, Reroof (Tear-Off) or Recover	B-1	Mech. Attached Base Insulation, Bonded Top Insulation, Bonded Roof Cover	12
1C	Wood	New, Reroof (Tear-Off) or Recover	C-1	Mech. Attached Insulation, Bonded Roof Cover	16
1D	Wood	New, Reroof (Tear-Off) or Recover	D-2	Insulated, Mechanically Attached SOPRAPHIX, Bonded Roof Cover	17
2A	Steel	New or Reroof (Tear-Off)	A-1	Bonded Insulation, Bonded Roof Cover	19
2B	Steel or Structural concrete	New, Reroof (Tear-Off) or Recover	B-1	Mech. Attached Base Insulation, Bonded Top Insulation, Bonded Roof Cover	23
2C	Steel or Structural concrete	New, Reroof (Tear-Off) or Recover	C-1	Mech. Attached Insulation, Bonded Roof Cover	29
2D	Steel	New, Reroof (Tear-Off) or Recover	D-1	Insulated, Mechanically Attached Base Sheet, Bonded Roof Cover	33
2E	Steel	New, Reroof (Tear-Off) or Recover	D-2	Insulated, Mechanically Attached SOPRAPHIX, Bonded Roof Cover	33
3A	Structural concrete	New or Reroof (Tear-Off)	A-1	Bonded Insulation, Bonded Roof Cover	35
3B	Structural concrete	New or Reroof (Tear-Off) or Recover	D-2	Insulated, Mechanically Attached SOPRAPHIX, Bonded Roof Cover	39
3C	Structural concrete	New or Reroof (Tear-Off)	F-1	Non-Insulated, Bonded Roof Cover	40
3D	Structural concrete	New or Reroof (Tear-Off)	F-2	Non-Insulated, Bonded Base Ply(s), Bonded Roof Cover	41
4A	Lightweight concrete / concrete	New, Reroof (Tear-Off)	A-1	LWC to Deck, Bonded Insulation, Bonded Roof Cover	42
4B	Lightweight concrete / concrete	New, Reroof (Tear-Off)	A-1	LWC to Deck, Bonded Vapor Barrier, Bonded Insulation, Bonded Roof Cover	43
4C	Lightweight concrete / steel or concrete	New, Reroof (Tear-Off)	E-1	LWC to Deck, Mechanically Attached Base Sheet, Bonded Roof Cover	44
4D	Lightweight concrete / steel	New, Reroof (Tear-Off)	E-1	Thermal Barrier to Deck, Temp Roof to Thermal Barrier, LWC to Temp Roof, Mech. Attached Base Sheet, Bonded Roof Cover	44
4E	Lightweight concrete / steel or concrete	New, Reroof (Tear-Off)	E-2	LWC to Deck, Mechanically Attached SOPRAPHIX, Bonded Roof Cover	45
4F	Lightweight concrete / steel	New	F	LWC to Deck, Bonded Roof Cover	45
4G	Lightweight concrete / concrete	New	F	LWC to Deck, Bonded Roof Cover	46
5A	Cementitious Wood Fiber	New, Reroof (Tear-Off)	A-1	Bonded Insulation, Bonded Roof Cover	48
5B	Cementitious Wood Fiber	New, Reroof (Tear-Off)	A-1a	Bonded Thermal Barrier, Bonded Vapor Barrier, Bonded Insulation, Bonded Roof Cover	50
6A	Existing Gypsum	Reroof (Tear-Off)	A-1	Bonded Insulation, Bonded Roof Cover	52
7A	Various	Recover	A-1	Bonded Insulation, Bonded Roof Cover	53
7B	Existing LWIC or Gypsum	Reroof (Tear-Off) or Recover	E-2	Non-Insulated, Mech. Attached SOPRAPHIX, Bonded Roof Cover	55
7C	Various	Recover	F	Non-Insulated, Bonded Roof Cover	55

The following notes apply to the systems outlined herein:

- 1 The roof system evaluation herein pertains to above-deck roof components. Roof decks and structural members shall be in accordance with FBC requirements to the satisfaction of the Authority Having Jurisdiction.
- 2 Unless otherwise noted, fasteners and stress plates shall be as follows. Fastener shall be of sufficient length for the following engagements:

FASTENER/PLATE OPTIONS				
DECK TYPE	BY	FBC FILE	PARTS	MINIMUM ENGAGEMENT
Wood	Altenloh, Brinck and Co. U.S., Inc.	FL4500	Trufast #14 HD with Trufast 3" Metal Insulation Plate	Minimum ¾-inch plywood penetration or wood plank embedment
	OMG, Inc.	FL699	OMG #14 Roofgrip with Flat Bottom Plate (Accutrac), OMG HD with OMG 3 in. Galvalume Steel Plate	
	SFS Group USA, Inc.	FL20311	Dekfast DF-#14-PH3 with PLT-H-2-7/8 or PLT-R-3	
	SOPREMA, Inc.	N/A	SOPREMA #14 Fastener with SOPREMA 3 in. Insulation Plate, SOPREMA #14 MP Fastener with SOPREMA 3" Metal Insulation Plate	
Steel	Altenloh, Brinck and Co. U.S., Inc.	FL4500	Trufast #12 DP or Trufast #14 HD with Trufast 3" Metal Insulation Plate	Minimum ¾-inch steel penetration and engage the top flute of the steel deck
	OMG, Inc.	FL699	OMG #12 or #14 Roofgrip with Recessed or Flat Bottom Plate (Accutrac), OMG #12 Standard or HD with OMG 3 in. Galvalume Steel Plate	
	SFS Group USA, Inc.	FL20311	Dekfast DF-#12-PH3 or DF-#14-PH3 with PLT-R-3	
	SOPREMA, Inc.	N/A	SOPREMA #12 or #14 Fastener with SOPREMA 3 in. Insulation Plate, SOPREMA #12 DP or #14 MP Fastener with SOPREMA 3" Metal Insulation Plate	
Structural Concrete	Altenloh, Brinck and Co. U.S., Inc.	FL4500	Trufast #14 HD or Trufast Fluted Concrete Nail with Trufast 3" Metal Insulation Plate	Minimum 1-inch embedment. Fastener installed with a pilot hole in accordance with the fastener manufacturer's published installation instructions
	OMG, Inc.	FL699	OMG #14 Roofgrip with Recessed or Flat Bottom Plate (Accutrac), OMG HD or CD-10 with OMG 3 in. Galvalume Steel Plate	
	SFS Group USA, Inc.	FL20311	Dekfast DF-#14-PH3 with PLT-R-3	
	SOPREMA, Inc.	N/A	SOPREMA #14 Fastener with SOPREMA 3 in. Insulation Plate or SOPREMA #14 MP Fastener or SOPREMA Fluted Concrete Nail with SOPREMA 3" Metal Insulation Plate	

- 3 Unless otherwise noted, insulation may be any one layer or combination of FBC Approved (Local or Statewide) board(s) that meet FBC 1505 and, for foam plastic, FBC Chapter 26, when installed with the roof cover.
- 4 Minimum 200 psi, minimum 2-inch thick FBC Approved lightweight insulating concrete may be substituted for, or installed below, rigid insulation board for System Types B-1, C-1, C-2, D-1 or D-2, whereby fasteners are installed through the lightweight insulating concrete to engage the structural deck. The structural deck shall be of equal or greater type, thickness and strength to the steel and structural concrete deck listings. Roof decks and structural members shall be in accordance with FBC requirements to the satisfaction of the Authority Having Jurisdiction. This is a wind uplift resistance allowance and does not purport to address non-wind-uplift-related issues, such as deck venting or moisture levels within the LWIC and the potential effect on overlying components.
- 5 Preliminary insulation attachment for System Type D: Unless otherwise noted, refer to Section 2.2.10.1.3 of [FM Loss Prevention Data Sheet](#) 1-29 (February 2020).
- 6 Unless otherwise noted, insulation adhesive application rates are as follows.
 Ribbon or bead width is at the time of application; the ribbons/beads shall expand as noted in the manufacturer's published instructions.
 When multiple layers(s) of insulation and/or coverboard are installed in ribbon-applied adhesive, board joints shall be staggered.
 The maximum edge distance from the adhesive ribbon to the edge of the insulation board shall be not less than one-half the specified ribbons spacing.

INSULATION ADHESIVE REFERENCES				
By	FBC FILE	ADHESIVE	MINIMUM RATE	NOTE
SOPREMA, Inc.	NOA 18-0502.04	DUOTACK	Continuous 0.5 to 0.75-inch wide ribbons, 12-inch o.c.	DUOTACK 365 may be used anywhere DUOTACK is referenced.
		DUOTACK 365	Continuous 0.5 to 0.75-inch wide ribbons, 12-inch o.c.	
		DUOTACK SPF	Continuous 2.5 wide ribbons, 12-inch o.c.	DUOTACK SPF may be used for insulation securement anywhere DUOTACK is referenced, except directly to existing gypsum decks, in recover applications over existing smooth-surfaced asphaltic built-up roof (BUR) or when used to adhere expanded polystyrene
	NOA 22-0224.04	DUOTACK SPF HFO	Continuous 2.5-3.5 wide ribbons, 12-inch o.c.	
Generic	N/A	Hot asphalt	Full coverage at 25-30 lbs/square	

- 7 Unless otherwise noted, all insulations are flat-stock or taper board of the minimum thickness noted. Tapered polyisocyanurate at the following thickness limitations may be substituted with the following Maximum Design Pressure (MDP) limitations. In no case shall these values be used to 'increase' the MDP listings in the tables; rather if MDP listing below meets or exceeds that listed for a particular system in the tables, then the thinner board listed below may be used as a drop-in for the equivalent thicker material listed in the table.

MDP LIMITATIONS FOR TAPERED POLYISOCYANURATE INSULATIONS				
ADHESIVE	INSULATION		MIN. TAPERED THICKNESS (IN)	MDP (psf)
	LISTED PRODUCT	FBC FILE		
DUOTACK, DUOTACK 365 or DUOTACK SPF	Any polyisocyanurate listed with adhesive herein	Various	0.5	-157.5
DUOTACK SPF HFO	Any polyisocyanurate listed with adhesive herein	Various	1.0	-117.5

- 8 For adhered roof insulation and board-size: Unless otherwise noted, refer to Section 2.2.10.6.2 of [FM Loss Prevention Data Sheet](#) 1-29 (February 2020).
- 9 For mechanically attached components or partially-bonded insulation, the maximum design pressure for the selected assembly shall meet or exceed at least the Zone 1 PRIME design pressure determined in accordance with FBC Chapter 16. Elevated pressure zones shall employ an attachment density designed by a qualified design professional to resist the elevated pressure criteria. Commonly used methods are ANSI/SPRI WD1, [FM Loss Prevention Data Sheet](#) 1-29, [Roofing Application Standard](#) RAS 117 and [Roofing Application Standard](#) RAS 137. Assemblies marked with an asterisk* carry the limitations set forth in Section 2.2.10.1 of [FM Loss Prevention Data Sheet](#) 1-29 (February 2020) for Zone 2/3 enhancements.
- 10 For assemblies with all components fully bonded, the maximum design pressure for the selected assembly shall meet or exceed critical design pressure determined in accordance with FBC Chapter 16. No rational analysis is permitted for these systems.
- 11 For mechanically attached components over existing decks, fasteners shall be tested in the existing deck for withdrawal resistance. A qualified design professional shall review the data for comparison to the minimum requirements for the system. Testing and analysis shall be in accordance with [ANSI/SPRI FX-1](#) or [Testing Application Standard](#) TAS 105.
- 12 For bonded insulation or membrane over existing substrates in a re-roof (tear off) or recover installation, the existing deck or existing roof surface shall be examined for compatibility with the adhesive to be installed. If any surface conditions exist that bring system performance into question, field uplift testing in accordance shall be conducted on mock-ups of the proposed new roof assembly. For bonded insulation or membrane over existing substrates in a recover installation, the existing roof system shall be capable of resisting project design pressures on its own merit to the satisfaction of the Authority Having Jurisdiction, as documented through field uplift testing. Field uplift testing shall be in accordance with ASTM E907, [FM Loss Prevention Data Sheet](#) 1-52 or [Testing Application Standard](#) TAS 124.
- 13 Refer to FBC 1511 for requirements and limitations regarding recover installations. For Structural Concrete Deck or Recover Applications using System Type C-1 the base insulation layer is optional and for System Type C-2, D-1 or D-2, the insulation is optional. Alternatively, an FBC Approved insulation board or coverboard may be used as a separation layer. Board products shall be preliminarily attached prior to roof cover installation (Note 5 herein). The separator component shall be documented as meeting FBC 1505 and, for foam plastic, FBC Chapter 26, when installed with the roof cover in Recover applications.
- 14 Lightweight insulating concrete (LWIC) shall be cast in accordance with FBC Section 1917 to the satisfaction of the Authority Having Jurisdiction. For systems where specific LWIC is referenced, refer to current LWIC Product Approval for specific deck construction and limitations. Unless otherwise noted, for systems where specific LWIC is not referenced, the minimum design mix shall be 300 psi. In all cases, the minimum top-coat thickness is 2-inches. For LWIC over structural concrete, reference is made to FBC Section 1917.4.1, Point 1. For "pre-existent" LWIC references, listings were established through testing over lightweight concrete cast using only foaming agent (ASTM C896), water and Portland cement (ASTM C150), with no proprietary additives, in accordance with procedures adopted by Miami-Dade BCCO (FBC CER1592). Use of these listings in new construction or re-roof (tear-off) applications is at the discretion of the Designer or Record and Authority Having Jurisdiction.

- 15 For bonded membrane applications, unless otherwise noted, refer to the following.

ALSAN RS COMPONENTS & APPLICATION RATES:			
PRODUCT	RATE		
ALSAN RS 222 Primer (“RS 222”)	1 gal/square		
ALSAN RS 276 Primer (“RS 276”)	1 gal/square		
AQUAFIN VAPORTIGHT COAT-SG3 (“AVC-SG3”)	Refer to AQUAFIN, Inc. published requirements.		
ALSAN RS 233 Self-Leveling Mortar or ALSAN Trafik RS 733 Self-Leveling Mortar	1.8 gal/square (85-95 wet mils)		
ALSAN RS 230 system	Base coat of ALSAN RS 230 applied at 3.9 gal/sq. followed by ALSAN RS Fleece into the wet base coat, and top coat of ALSAN RS 230 at 1.9 gal/sq.		
ALSAN Trafik RS 730 system	Base coat of ALSAN Trafik RS 730 applied at 3.9 gal/sq. followed by ALSAN RS Fleece into the wet base coat, and top coat of ALSAN Trafik RS 730 at 1.9 gal/sq.		
ALSAN RS 260 LO system	Base coat of ALSAN RS 260 LO applied at 3.9 gal/sq. followed by ALSAN RS Fleece into the wet base coat, and top coat of ALSAN RS 260 LO at 1.9 gal/sq.		
ALSAN RS 263 LO Self-Leveling Mortar	1.8 gal/square (85-95 wet mils)		
ALSAN RS 281 Finish	0.74 gal/square (smooth-surface); 1.23 gal/square (aggregate-surface)		
ALSAN RS 287 Color Finish Base	1.2 gal/square		
ALSAN RS 289 Textured Base LT	3.2 gal/square		
Note: Optional finish surfacing materials, including additional application(s) of ALSAN RS 230, ALSAN RS 260 LO, ALSAN RS 233 Self-Leveling Mortar, ALSAN Trafik RS 733 Self-Leveling Mortar, ALSAN RS 263 LO Self-Leveling Mortar, ALSAN Trafik RS 263 LO Self-Leveling Mortar, ALSAN RS 281 (clear), ALSAN Trafik RS 781 CLR, ALSAN RS 287 (+ color pack), ALSAN Trafik RS 787 CF, ALSAN RS 289 LT (+ color pack), ALSAN Trafik RS 789, ALSAN RS Textured Coating, ALSAN Trafik RS 790 and/or quartz aggregates and vinyl chips, may be applied to the final ALSAN RS or ALSAN Trafik RS surface with no adverse effect on system wind uplift performance.			
MODIFIED BITUMEN VAPOR BARRIER & BASE PLY REFERENCES:			
REFERENCE	LAYER	MATERIALS	APPLICATION
SBS-CA2	Base Ply:	ELASTOPHENE Sanded, SOPRALENE 180 Sanded 2.2, SOPRALENE 180 Sanded, SOPRALENE 250 Sanded	0.5 to 1-inch wide ribbons COLPLY EF spaced as noted
SBS-CA3	Base Ply:	One or two plies ELASTOPHENE Sanded, SOPRALENE 180 Sanded 2.2, SOPRALENE 180 Sanded, SOPRALENE 250 Sanded	COLPLY EF Adhesive at 1.5 – 2.5 gal/square
	VB Cap Ply:	ELASTOPHENE LS FR GR, ELASTOPHENE FR GR, SOPRALENE 180 FR GR, SOPRALENE 250 FR GR	
SBS-CA4	Base Ply:	ELASTOPHENE Sanded, SOPRALENE 180 Sanded 2.2, SOPRALENE 180 Sanded, SOPRALENE 250 Sanded	COLPLY Adhesive at 1.5-2.0 gal/square.
	VB Cap Ply:	ELASTOPHENE LS FR GR, ELASTOPHENE FR GR, SOPRALENE 180 FR GR, SOPRALENE 250 FR GR	
SBS-TAP	Base Ply:	COLVENT TG, COLVENT 180 TG	Torch-applied, Partial Bond
SBS-TAF*	Base Ply:	ELASTOPHENE Flam 2.2◊, ELASTOPHENE Flam 3.0◊, ELASTOPHENE SP 2.2, COLPHENE SP 2.2, ELASTOPHENE SP 3.0, COLPHENE SP 3.0, SOPRALENE Flam 180◊, SOPRALENE 180 SP 3.0, SOPRALENE 180 SP 3.5, COLPHENE 180 SP 3.5, SOPRALENE Flam 250◊ or SOPRALENE 250 SP	Torch-Applied, Full Bond
	VB Cap Ply:	ELASTOPHENE Flam LS FR GR, ELASTOPHENE Flam FR GR, SOPRALENE Flam 180 GR, SOPRALENE Flam 180 FR GR, SOPRALENE Flam 250 FR GR	
SBS-SA1**	Base Ply:	ELASTOPHENE Stick, ELASTOPHENE Flam Stick◊, SOPRALENE Stick, SOPRALENE Flam Stick◊	Self-adhering
	VB Cap Ply:	ELASTOPHENE Stick FR GR	

Notes: *Base Ply membranes marked with an asterisk (◇) have a poly-film top surface, and require installation of a torch-applied membrane overtop. ALSAN products shall not be applied to a poly-film top surface.
 **Top surfaces of SOPREMA membranes having a sand finish shall be primed with Elastocol 500, Elastocol Stick or Elastocol Stick Zero at 1 gal/sq. (0.6 l/m²) prior to application of subsequent self-adhering (SBS-SA1) membranes.

- 16 Thermal barrier / vapor barrier combination options for use over **steel decks** followed by bonded insulation and/or coverboard carry the following MDP limitations. The lesser of the MDP listings below vs. that for the selected assembly applies:

THERMAL BARRIER / VAPOR BARRIER OPTIONS FOR STEEL DECKS; FOLLOWED BY BONDED INSULATION PER TABLE 2A OR 2B:									
OPTION #	THERMAL BARRIER				PRIMER	VAPOR BARRIER (Note 15)		ADHESIVE PER TABLE 2A OR 2B (Notes 6,7,8)	MDP (psf)
	DECK (Note 1)	TYPE	FASTEN	ATTACH		BASE PLY	CAP PLY (GRANULE)		
S-TB/VB-1.	Min. 22 ga., type B, Grade 33 steel	Min. 0.5-inch DensDeck, DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	SOPREMA #14 MP with SOPREMA 3" Metal Insulation Plate	1 per 4.0 ft ²	None	SBS-CA3 or SBS-CA4 (sanded top)	None	DUOTACK	-45.0*
S-TB/VB-2.	Min. 22 ga., type B, Grade 33 steel	Min. 0.5-inch DensDeck, DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	SOPREMA #14 MP with SOPREMA 3" Metal Insulation Plate	1 per 4.0 ft ²	None	(Optional) SBS-CA3	SBS-CA3	DUOTACK 365	-45.0*
S-TB/VB-3.	Min. 22 ga., type B, Grade 33 steel	Min. 0.5-inch DensDeck, DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	SOPREMA #14 MP with SOPREMA 3" Metal Insulation Plate	1 per 4.0 ft ²	None	(Optional) SBS-CA4	SBS-CA4	DUOTACK 365	-45.0*
S-TB/VB-4.	Min. 22 ga., type B, Grade 33 steel	0.25-inch DEXcell FA Glass Mat Roof Board	SOPREMA #14 MP with SOPREMA 3" Metal Insulation Plate	1 per 4.0 ft ²	None	SBS-CA3 (sanded top)	None	DUOTACK	-45.0*
S-TB/VB-5.	Min. 22 ga., type B, Grade 33 steel	0.25-inch DEXcell FA Glass Mat Roof Board	SOPREMA #14 MP with SOPREMA 3" Metal Insulation Plate	1 per 4.0 ft ²	None	(Optional) SBS-CA3	SBS-CA3	DUOTACK 365	-45.0*
S-TB/VB-6.	Min. 22 ga., type B, Grade 33 steel	Min. 0.5-inch DensDeck, DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	SOPREMA #14 MP with SOPREMA 3" Metal Insulation Plate	1 per 4.0 ft ²	ELASTOCOL 500	SBS-TAF (sanded top)	None	DUOTACK	-45.0*
S-TB/VB-7.	Min. 22 ga., type B, Grade 33 steel	Min. 0.5-inch DensDeck, DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	SOPREMA #14 MP with SOPREMA 3" Metal Insulation Plate	1 per 4.0 ft ²	ELASTOCOL 500	(Optional) SBS-TAF	SBS-TAF	DUOTACK 365	-45.0*
S-TB/VB-8.	Min. 22 ga., type B, Grade 33 steel	0.25-inch DEXcell FA Glass Mat Roof Board	SOPREMA #14 MP with SOPREMA 3" Metal Insulation Plate	1 per 4.0 ft ²	None	SBS-TAF (sanded top)	None	DUOTACK	-45.0*
S-TB/VB-9.	Min. 22 ga., type B, Grade 33 steel	0.25-inch DEXcell FA Glass Mat Roof Board	SOPREMA #14 MP with SOPREMA 3" Metal Insulation Plate	1 per 4.0 ft ²	None	(Optional) SBS-TAF	SBS-TAF	DUOTACK 365	-45.0*
S-TB/VB-10.	Min. 22 ga., type B, Grade 33 steel	Min. 0.5-inch DensDeck, DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	SOPREMA #14 MP with SOPREMA 3" Metal Insulation Plate	1 per 4.0 ft ²	ELASTOCOL Stick or ELASTOCOL Stick Zero	SOPRAVAP'R or SBS-SA1 (sanded top)	None	DUOTACK	-45.0*
S-TB/VB-11.	Min. 22 ga., type B, Grade 33 steel	Min. 0.5-inch DensDeck, DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	SOPREMA #14 MP with SOPREMA 3" Metal Insulation Plate	1 per 4.0 ft ²	ELASTOCOL Stick or ELASTOCOL Stick Zero	(Optional) SBS-SA1	SBS-TAF	DUOTACK 365	-45.0*
S-TB/VB-12.	Min. 22 ga., type B, Grade 33 steel	0.25-inch DEXcell FA Glass Mat Roof Board	SOPREMA #14 MP with SOPREMA 3" Metal Insulation Plate	1 per 4.0 ft ²	ELASTOCOL Stick or ELASTOCOL Stick Zero	SOPRAVAP'R or SBS-SA1 (sanded top)	None	DUOTACK	-45.0*
S-TB/VB-13.	Min. 22 ga., type B, Grade 33 steel	0.25-inch DEXcell FA Glass Mat Roof Board	SOPREMA #14 MP with SOPREMA 3" Metal Insulation Plate	1 per 4.0 ft ²	ELASTOCOL Stick or ELASTOCOL Stick Zero	(Optional) SBS-SA1	SBS-TAF	DUOTACK 365	-45.0*
S-TB/VB-14.	22 ga., Type B, Grade 40 steel	Min. 0.5-inch DEXcell FA Glass Mat Roof Board or min. 7/16-inch DEXcell Cement Roof Board	DUOTACK 365	12-inch o.c.	None	SBS-TAF (sanded top)	None	DUOTACK	-45.0*
S-TB/VB-15.	22 ga., Type B, Grade 40 steel	Min. 0.5-inch DEXcell FA Glass Mat Roof Board or min. 7/16-inch DEXcell Cement Roof Board	DUOTACK 365	12-inch o.c.	None	(Optional) SBS-TAF	SBS-TAF	DUOTACK 365	-45.0*
S-TB/VB-16.	22 ga., Type B, Grade 40 steel	Min. 0.5-inch DEXcell FA Glass Mat Roof Board or min. 7/16-inch DEXcell Cement Roof Board	DUOTACK 365	12-inch o.c.	ELASTOCOL Stick or ELASTOCOL Stick Zero	SOPRAVAP'R or SBS-SA1 (sanded top)	None	DUOTACK	-45.0*

THERMAL BARRIER / VAPOR BARRIER OPTIONS FOR STEEL DECKS; FOLLOWED BY BONDED INSULATION PER TABLE 2A OR 2B:									
OPTION #	THERMAL BARRIER				PRIMER	VAPOR BARRIER (Note 15)		ADHESIVE PER TABLE 2A OR 2B (Notes 6,7,8)	MDP (psf)
	DECK (Note 1)	TYPE	FASTEN	ATTACH		BASE PLY	CAP PLY (GRANULE)		
S-TB/VB-17.	22 ga., Type B, Grade 40 steel	Min. 0.5-inch DEXcell FA Glass Mat Roof Board or min. 7/16-inch DEXcell Cement Roof Board	DUOTACK 365	12-inch o.c.	ELASTOCOL Stick or ELASTOCOL Stick Zero	(Optional) SBS- SA1	SBS-TAF	DUOTACK 365	-45.0*
S-TB/VB-18.	Min. 22 ga., type B, Grade 33 steel	0.5-inch DEXcell FA Glass Mat Roof Board	SOPREMA #14 MP with SOPREMA 3" Metal Insulation Plate	1 per 2.0 ft ²	None	SBS-CA3 (sanded top)	None	DUOTACK	-75.0
S-TB/VB-19.	Min. 22 ga., type B, Grade 33 steel	0.5-inch DEXcell FA Glass Mat Roof Board	SOPREMA #14 MP with SOPREMA 3" Metal Insulation Plate	1 per 2.0 ft ²	None	SBS-TAF (sanded top)	None	DUOTACK	-75.0
S-TB/VB-20.	Min. 22 ga., type B, Grade 33 steel	0.5-inch DEXcell FA Glass Mat Roof Board	SOPREMA #14 MP with SOPREMA 3" Metal Insulation Plate	1 per 2.0 ft ²	None	(Optional) SBS- TAF	SBS-TAF	DUOTACK 365	-75.0
S-TB/VB-21.	Min. 22 ga., type B, Grade 40 steel	Min. 0.5-inch DensDeck, DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	SOPREMA #14 MP with SOPREMA 3" Metal Insulation Plate	1 per 2.0 ft ²	None	SBS-CA3 or SBS- CA4 (sanded top)	None	DUOTACK	-82.5
S-TB/VB-22.	Min. 22 ga., type B, Grade 40 steel	Min. 0.5-inch DensDeck, DensDeck Prime, DEXcell FA Glass Mat Roof Board or SECUROCK Gypsum-Fiber Roof Board	SOPREMA #14 MP with SOPREMA 3" Metal Insulation Plate	1 per 2.0 ft ²	ELASTOCOL 500	SBS-TAF (sanded top)	None	DUOTACK	-82.5
S-TB/VB-23.	Min. 22 ga., type B, Grade 40 steel	Min. 0.5-inch DensDeck, DensDeck Prime, DEXcell FA Glass Mat Roof Board or SECUROCK Gypsum-Fiber Roof Board	SOPREMA #14 MP with SOPREMA 3" Metal Insulation Plate	1 per 2.0 ft ²	ELASTOCOL 500	(Optional) SBS- TAF	SBS-TAF	DUOTACK 365	-82.5
S-TB/VB-24.	Min. 22 ga., type B, Grade 40 steel	Min. 0.5-inch DensDeck, DensDeck Prime, DEXcell FA Glass Mat Roof Board or SECUROCK Gypsum-Fiber Roof Board	SOPREMA #14 MP with SOPREMA 3" Metal Insulation Plate	1 per 2.0 ft ²	ELASTOCOL Stick or ELASTOCOL Stick Zero	SOPRAVAP'R or SBS-SA1 (sanded top)	None	DUOTACK	-82.5
S-TB/VB-25.	Min. 22 ga., type B, Grade 40 steel	Min. 0.5-inch DensDeck, DensDeck Prime, DEXcell FA Glass Mat Roof Board or SECUROCK Gypsum-Fiber Roof Board	SOPREMA #14 MP with SOPREMA 3" Metal Insulation Plate	1 per 2.0 ft ²	ELASTOCOL Stick or ELASTOCOL Stick Zero	(Optional) SBS- SA1	SBS-TAF	DUOTACK 365	-82.5
S-TB/VB-26.	22 ga., Type B, Grade 40 steel	Min. 0.5-inch DEXcell FA Glass Mat Roof Board or min. 7/16-inch DEXcell Cement Roof Board	DUOTACK 365	6-inch o.c.	None	SBS-TAF (sanded top)	None	DUOTACK	-127.5
S-TB/VB-27.	22 ga., Type B, Grade 40 steel	Min. 0.5-inch DEXcell FA Glass Mat Roof Board or min. 7/16-inch DEXcell Cement Roof Board	DUOTACK 365	6-inch o.c.	None	(Optional) SBS- TAF	SBS-TAF	DUOTACK 365	-127.5
S-TB/VB-28.	22 ga., Type B, Grade 40 steel	Min. 0.5-inch DEXcell FA Glass Mat Roof Board or min. 7/16-inch DEXcell Cement Roof Board	DUOTACK 365	6-inch o.c.	ELASTOCOL Stick or ELASTOCOL Stick Zero	SOPRAVAP'R or SBS-SA1 (sanded top)	None	DUOTACK	-127.5
S-TB/VB-29.	22 ga., Type B, Grade 40 steel	Min. 0.5-inch DEXcell FA Glass Mat Roof Board or min. 7/16-inch DEXcell Cement Roof Board	DUOTACK 365	6-inch o.c.	ELASTOCOL Stick or ELASTOCOL Stick Zero	(Optional) SBS- SA1	SBS-TAF	DUOTACK 365	-127.5
S-TB/VB-30.	22 ga., Type B, Grade 40 steel	Min. 0.5-inch DensDeck Prime	DUOTACK SPF HFO	12-inch o.c.	ELASTOCOL Stick or ELASTOCOL Stick Zero	SOPRAVAP'R or SBS-SA1 (sanded top)	None	DUOTACK SPF HFO	-75.0
S-TB/VB-31.	22 ga., Type B, Grade 40 steel	Min. 0.5-inch DensDeck Prime	DUOTACK SPF HFO	12-inch o.c.	ELASTOCOL Stick or ELASTOCOL Stick Zero	(Optional) SBS- SA1	SBS-TAF	DUOTACK SPF HFO	-75.0
S-TB/VB-32.	22 ga., Type B, Grade 40 steel	Min. 0.5-inch DEXcell FA Glass Mat Roof Board or min. 7/16-inch DEXcell Cement Roof Board	DUOTACK SPF HFO	12-inch o.c.	ELASTOCOL Stick Zero	SOPRAVAP'R	None	DUOTACK SPF HFO	-75.0

THERMAL BARRIER / VAPOR BARRIER OPTIONS FOR STEEL DECKS; FOLLOWED BY BONDED INSULATION PER TABLE 2A OR 2B:									
OPTION #	THERMAL BARRIER				PRIMER	VAPOR BARRIER (Note 15)		ADHESIVE PER TABLE 2A OR 2B (Notes 6,7,8)	MDP (psf)
	DECK (Note 1)	TYPE	FASTEN	ATTACH		BASE PLY	CAP PLY (GRANULE)		
S-TB/VB-33.	22 ga., Type B, Grade 40 steel	Min. 0.5-inch SECUROCK Gypsum-Fiber Roof Board	DUOTACK SPF HFO	12-inch o.c.	ELASTOCOL 500	SBS-TAF (sanded top)	None	DUOTACK SPF HFO	-75.0
S-TB/VB-34.	22 ga., Type B, Grade 40 steel	Min. 0.5-inch SECUROCK Gypsum-Fiber Roof Board	DUOTACK SPF HFO	12-inch o.c.	ELASTOCOL 500	(Optional) SBS- TAF	SBS-TAF	DUOTACK SPF HFO	-75.0
S-TB/VB-35.	22 ga., Type B, Grade 40 steel	Min. 0.5-inch SECUROCK Gypsum-Fiber Roof Board	DUOTACK SPF HFO	12-inch o.c.	ELASTOCOL Stick Zero	SOPRAVAP'R	None	DUOTACK SPF HFO	-75.0
S-TB/VB-36.	22 ga., Type B, Grade 40 steel	Min. 0.5-inch SECUROCK Gypsum-Fiber Roof Board	DUOTACK SPF HFO	12-inch o.c.	ELASTOCOL Stick or ELASTOCOL Stick Zero	SBS-SA1 (sanded top)	None	DUOTACK SPF HFO	-75.0
S-TB/VB-37.	22 ga., Type B, Grade 40 steel	Min. 0.5-inch SECUROCK Gypsum-Fiber Roof Board	DUOTACK SPF HFO	12-inch o.c.	ELASTOCOL Stick or ELASTOCOL Stick Zero	(Optional) SBS- SA1	SBS-TAF	DUOTACK SPF HFO	-75.0
S-TB/VB-38.	22 ga., Type B, Grade 40 steel	Min. 0.5-inch DensDeck Prime	DUOTACK SPF HFO	6-inch o.c.	ELASTOCOL Stick or ELASTOCOL Stick Zero	SOPRAVAP'R or SBS-SA1 (sanded top)	None	DUOTACK SPF HFO, 6-inch o.c.	-127.5
S-TB/VB-39.	22 ga., Type B, Grade 40 steel	Min. 0.5-inch DensDeck Prime	DUOTACK SPF HFO	6-inch o.c.	ELASTOCOL Stick or ELASTOCOL Stick Zero	(Optional) SBS- SA1	SBS-TAF	DUOTACK SPF HFO, 6-inch o.c.	-127.5
S-TB/VB-40.	22 ga., Type B, Grade 40 steel	Min. 0.5-inch DEXcell FA Glass Mat Roof Board or min. 7/16-inch DEXcell Cement Roof Board	DUOTACK SPF HFO	6-inch o.c.	ELASTOCOL Stick Zero	SOPRAVAP'R	None	DUOTACK SPF HFO, 6-inch o.c.	-127.5
S-TB/VB-41.	22 ga., Type B, Grade 40 steel	Min. 0.5-inch SECUROCK Gypsum-Fiber Roof Board	DUOTACK SPF HFO	6-inch o.c.	ELASTOCOL 500	SBS-TAF (sanded top)	None	DUOTACK SPF HFO, 6-inch o.c.	-127.5
S-TB/VB-42.	22 ga., Type B, Grade 40 steel	Min. 0.5-inch SECUROCK Gypsum-Fiber Roof Board	DUOTACK SPF HFO	6-inch o.c.	ELASTOCOL 500	(Optional) SBS- TAF	SBS-TAF	DUOTACK SPF HFO, 6-inch o.c.	-127.5
S-TB/VB-43.	22 ga., Type B, Grade 40 steel	Min. 0.5-inch SECUROCK Gypsum-Fiber Roof Board	DUOTACK SPF HFO	6-inch o.c.	ELASTOCOL Stick Zero	SOPRAVAP'R	None	DUOTACK SPF HFO, 6-inch o.c.	-127.5
S-TB/VB-44.	22 ga., Type B, Grade 40 steel	Min. 0.5-inch SECUROCK Gypsum-Fiber Roof Board	DUOTACK SPF HFO	6-inch o.c.	ELASTOCOL Stick or ELASTOCOL Stick Zero	SBS-SA1 (sanded top)	None	DUOTACK SPF HFO, 6-inch o.c.	-127.5
S-TB/VB-45.	22 ga., Type B, Grade 40 steel	Min. 0.5-inch SECUROCK Gypsum-Fiber Roof Board	DUOTACK SPF HFO	6-inch o.c.	ELASTOCOL Stick or ELASTOCOL Stick Zero	(Optional) SBS- SA1	SBS-TAF	DUOTACK SPF HFO, 6-inch o.c.	-127.5

17 Vapor barrier options for use over **structural concrete deck** followed by bonded insulation carry the following MDP limitations. The lesser of the MDP listings below vs. that for the selected assembly applies:

ONE-PLY VAPOR BARRIER OPTIONS; STRUCTURAL CONCRETE DECK; FOLLOWED BY BONDED INSULATION PER TABLE 3A:				
OPTION #	PRIMER	VAPOR BARRIER (Note 15)	ADHESIVE PER TABLE 3A (Notes 6,7,8)	MDP (psf)
C-VB-1.	none	SOPRASMART XP HD 180 Sanded applied in DUOTACK, ribbons 12-inch o.c. (laps are torched or sealed with a hot air gun)	DUOTACK	-52.5
C-VB-2.	ASTM D41	SBS-CA4 (granule top)	DUOTACK	-97.5
C-VB-3.	ASTM D41	SBS-CA4 (sanded top)	DUOTACK	-120.0
C-VB-4.	none	SBS-CA2 (sanded or granule top), ribbons 6-inch o.c.	DUOTACK	-120.0
C-VB-5.	(Optional) ASTM D41, ELASTOCOL 500	SBS-CA3 (granule top)	DUOTACK	-195.0
C-VB-6.	ASTM D41	SBS-TAF (granule top)	DUOTACK	-195.0
C-VB-7.	ELASTOCOL Stick, ELASTOCOL Stick Zero	SBS-SA1 (granule top)	DUOTACK	-195.0
C-VB-8.	none	SBS-CA2 (sanded or granule top), ribbons 6-inch o.c.	DUOTACK (ribbons shall be applied perpendicular to vapor barrier adhesive ribbons)	-207.5
C-VB-9.	ASTM D41	SBS-TAP (sanded top)	DUOTACK	-232.5
C-VB-10.	ELASTOCOL Stick Zero	SOPRAVAP'R, self-adhering	DUOTACK	-240.0
C-VB-11.	none	SBS-CA3 (sanded top)	DUOTACK	-255.0
C-VB-12.	ASTM D41, ELASTOCOL 500	SBS-CA3 (sanded top)	DUOTACK	-270.0
C-VB-13.	ELASTOCOL Stick, ELASTOCOL Stick Zero	SBS-SA1 (sanded top)	DUOTACK	-315.0
C-VB-14.	ASTM D41	SBS-TAF (sanded top)	DUOTACK	-382.5
C-VB-15.	none	SBS-CA2 (sanded or granule top), ribbons 6-inch o.c.	DUOTACK, 6-inch o.c.	-445.0
C-VB-16.	ASTM D41	SBS-CA4 (granule top)	DUOTACK SPF HFO	-97.5
C-VB-17.	ASTM D41	SBS-CA4 (sanded top)	DUOTACK SPF HFO	-120.0
C-VB-18.	(Optional) ASTM D41, ELASTOCOL 500	SBS-CA3 (granule top)	DUOTACK SPF HFO	-195.0
C-VB-19.	ASTM D41	SBS-TAF (granule top)	DUOTACK SPF HFO	-195.0
C-VB-20.	ELASTOCOL Stick, ELASTOCOL Stick Zero	SBS-SA1 (granule top)	DUOTACK SPF HFO	-195.0
C-VB-21.	(Optional) ASTM D41, ELASTOCOL 500	SBS-CA3 (sanded top)	DUOTACK SPF HFO	-222.5
C-VB-22.	ASTM D41	SBS-TAP or SBS-TAF (sanded top)	DUOTACK SPF HFO	-222.5
C-VB-23.	ELASTOCOL Stick, ELASTOCOL Stick Zero	SBS-SA1 (sanded top)	DUOTACK SPF HFO	-222.5
C-VB-24.	ELASTOCOL Stick Zero	SOPRAVAP'R, self-adhering	DUOTACK SPF HFO	-392.5
C-VB-25.	ASTM D41	SOPRA IV, SOPRA VI, MODIFIED SOPRA G applied in hot asphalt	hot asphalt	-270.0
C-VB-26.	none	SBS-CA2 (sanded top), ribbons 6-inch o.c.	hot asphalt	-367.5
C-VB-27.	ASTM D41	SBS-TAF (sanded top)	hot asphalt	-367.5

MINIMUM TWO-PLY VAPOR BARRIER OPTIONS; STRUCTURAL CONCRETE DECK; FOLLOWED BY BONDED INSULATION PER TABLE 3A:					
OPTION #	PRIMER	VAPOR BARRIER (Note 15)		ADHESIVE PER TABLE 3A (Notes 6,7,8)	MDP (psf)
		BASE PLY	CAP PLY		
C-VB-28.	ASTM D41	SBS-CA4	SBS-CA4 or SBS-TAF (granule top)	DUOTACK	-97.5
C-VB-29.	ASTM D41	SBS-CA4	SBS-CA4 (sanded top)	DUOTACK	-120.0
C-VB-30.	none	SBS-CA2, ribbons 6-inch o.c.	SBS-CA3 or SBS-TAF (sanded or granule top)	DUOTACK	-120.0

MINIMUM TWO-PLY VAPOR BARRIER OPTIONS; STRUCTURAL CONCRETE DECK; FOLLOWED BY BONDED INSULATION PER TABLE 3A:					
OPTION #	PRIMER	VAPOR BARRIER (Note 15)		ADHESIVE PER TABLE 3A (Notes 6,7,8)	MDP (psf)
		BASE PLY	CAP PLY		
C-VB-31.	(Optional) ASTM D41, ELASTOCOL 500	SBS-CA3	SBS-CA3, SBS-CA4, SBS-TAF or SBS-SA1 (granule top)	DUOTACK	-195.0
C-VB-32.	ASTM D41	SBS-TAF	SBS-CA3, SBS-CA4, SBS-TAF or SBS-SA1 (granule top)	DUOTACK	-195.0
C-VB-33.	ELASTOCOL Stick, ELASTOCOL Stick Zero	SBS-SA1	SBS-CA3, SBS-CA4, SBS-TAF or SBS-SA1 (granule top)	DUOTACK	-195.0
C-VB-34.	None	SBS-CA2, ribbons 6-inch o.c.	SBS-CA3 or SBS-TAF (sanded or granule top)	DUOTACK (ribbons shall be applied perpendicular to vapor barrier adhesive ribbons)	-207.5
C-VB-35.	ASTM D41	SBS-TAP	SBS-TAF (sanded top)	DUOTACK	-232.5
C-VB-36.	None	SBS-CA3	SBS-CA3 (sanded top)	DUOTACK	-255.0
C-VB-37.	ASTM D41, ELASTOCOL 500	SBS-CA3	SBS-CA3 (sanded top)	DUOTACK	-270.0
C-VB-38.	ELASTOCOL Stick, ELASTOCOL Stick Zero	SBS-SA1	SBS-SA1 (sanded top)	DUOTACK	-315.0
C-VB-39.	ASTM D41	SBS-TAF	SBS-TAF (sanded top)	DUOTACK	-382.5
C-VB-40.	None	SBS-CA2, ribbons 6-inch o.c.	SBS-CA3 (sanded or granule top)	DUOTACK, 6-inch o.c.	-382.5
C-VB-41.	None	SBS-CA2, ribbons 6-inch o.c.	SBS-TAF (sanded or granule top)	DUOTACK, 6-inch o.c.	-445.0
C-VB-42.	ASTM D41	SBS-CA4	SBS-CA4 or SBS-TAF (granule top)	DUOTACK SPF HFO	-97.5
C-VB-43.	ASTM D41	SBS-CA4	SBS-CA4 (sanded top)	DUOTACK SPF HFO	-120.0
C-VB-44.	(Optional) ASTM D41, ELASTOCOL 500	SBS-CA3	SBS-CA3, SBS-CA4, SBS-TAF or SBS-SA1 (granule top)	DUOTACK SPF HFO	-195.0
C-VB-45.	ASTM D41	SBS-TAF	SBS-CA3, SBS-CA4, SBS-TAF or SBS-SA1 (granule top)	DUOTACK SPF HFO	-195.0
C-VB-46.	ELASTOCOL Stick, ELASTOCOL Stick Zero	SBS-SA1	SBS-CA3, SBS-CA4, SBS-TAF or SBS-SA1 (granule top)	DUOTACK SPF HFO	-195.0
C-VB-47.	(Optional) ASTM D41, ELASTOCOL 500	SBS-CA3	SBS-CA3 (sanded top)	DUOTACK SPF HFO	-222.5
C-VB-48.	ASTM D41	SBS-TAP or SBS-TAF	SBS-TAF (sanded top)	DUOTACK SPF HFO	-222.5
C-VB-49.	ELASTOCOL Stick, ELASTOCOL Stick Zero	SBS-SA1	SBS-SA1 (sanded top)	DUOTACK SPF HFO	-222.5
C-VB-50.	none	SBS-CA2, ribbons 6-inch o.c.	SBS-CA3 or SBS-TAF (sanded top)	hot asphalt	-367.5
C-VB-51.	ASTM D41	SBS-TAF	SBS-TAF (sanded top)	hot asphalt	-367.5
Note: Top surfaces of membranes having a sand finish shall be primed with ELASTOCOL 500, ELASTOCOL Stick or ELASTOCOL Stick Zero prior to application of subsequent self-adhering membranes.					

18 Optional dry-in / temporary roof options for use over structural concrete deck followed by LWC carry the following Maximum Design Pressure (MDP) limitations.

DRY-IN / TEMPORARY ROOF OPTIONS; STRUCTURAL CONCRETE DECK; FOLLOWED BY LWC PER LWC SYSTEM TABLES :				
OPTION #	PRIMER	DRY-IN / TEMPORARY ROOF (Note 15)		MDP (psf)
		BASE PLY	CAP PLY	
LWC-VB-1.	None	SBS-CA3 (sanded top)	None	-255.0
LWC-VB-2.	None	SBS-CA3	SBS-CA3 (sanded or granule top)	-255.0
LWC-VB-3.	ASTM D41, Elastocol 500	SBS-CA3 (sanded top)	None	-270.0
LWC-VB-4.	ASTM D41, Elastocol 500	SBS-CA3	SBS-CA3 (sanded or granule top)	-270.0
LWC-VB-5.	ASTM D41, Elastocol 500	SBS-TAF (sanded top)	None	-367.5
LWC-VB-6.	ASTM D41, Elastocol 500	SBS-TAF	SBS-TAF (sanded or granule top)	-367.5
LWC-VB-7.	None	SBS-CA2, ribbons 6-inch o.c.	SBS-CA3 (sanded or granule top)	-382.5
LWC-VB-8.	None	SBS-CA2 (sanded or granule top), ribbons 6-inch o.c.	None	-445.0
LWC-VB-9.	None	SBS-CA2, ribbons 6-inch o.c.	SBS-TAF (sanded or granule top)	-445.0

- 19 Vapor barrier options for use over **existing gypsum decks** followed by bonded insulation carry the following MDP limitations. The lesser of the MDP listings below vs. that for the selected assembly applies:

VAPOR BARRIER OPTIONS; EXISTING GYPSUM DECKS; FOLLOWED BY BONDED INSULATION PER TABLE 6A:				
OPTION #	VAPOR BARRIER (Note 15)		ADHESIVE PER TABLE 6A (Notes 6,7,8)	MDP (psf)
	BASE PLY	CAP PLY		
GYP-VB-1.	SBS-CA2 (sanded or granule top), ribbons 6-inch o.c.	None	DUOTACK	-120.0
GYP-VB-2.	SBS-CA2, ribbons 6-inch o.c.	SBS-CA3 or SBS-TAF (sanded or granule top)	DUOTACK	-120.0
GYP-VB-3.	SBS-CA2 (sanded or granule top), ribbons 6-inch o.c.	None	DUOTACK (ribbons shall be applied perpendicular to vapor barrier adhesive ribbons)	-207.5
GYP-VB-4.	SBS-CA2, ribbons 6-inch o.c.	SBS-CA3 or SBS-TAF (sanded or granule top)	DUOTACK (ribbons shall be applied perpendicular to vapor barrier adhesive ribbons)	-207.5
GYP-VB-5.	SBS-CA2, ribbons 6-inch o.c.	SBS-CA3 (sanded or granule top)	DUOTACK, 6-inch o.c.	-382.5
GYP-VB-6.	SBS-CA2 (sanded or granule top), ribbons 6-inch o.c.	None	DUOTACK, 6-inch o.c.	-445.0
GYP-VB-7.	SBS-CA2, ribbons 6-inch o.c.	SBS-TAF (sanded or granule top)	DUOTACK, 6-inch o.c.	-445.0

- 20 For System Types B-1, B-2, C-1, C-2, D-1 or D-2, SOPRAVAP'R may be installed atop the roof deck prior to installation of the insulation and roof cover. Refer to [FM Loss Prevention Data Sheet](#) 1-29 (February 2020) for design and installation recommendations and limitations.
- 21 Overburden of soil and plantings (for 'garden roofs'; root barriers, filter fabric, drainage components, EPS / XPS insulation, etc.) or concrete topping slabs, that are specified by the Designer of Record, acceptable to the Authority Having Jurisdiction and do not form part of the load path to the liquid applied roof system, are permissible over the assemblies noted herein with no adverse effect on the wind uplift performance of the SOPREMA system. The Authority Having Jurisdiction may require integrity flood testing (ASTM D5957) or Electric Field Vector Mapping tests of all waterproofing systems prior to placement of overburden materials. Testing, if required by the Authority Having Jurisdiction, should be conducted by a qualified testing agency or professional.
- 22 The following products are interchangeable within the scope of this Evaluation Report:

ACCEPTABLE ALTERNATES				
SUB-CATEGORY	BY	LISTED PRODUCT HEREIN	ALTERNATE	
			PRODUCT	FBC FILE
Adhesives	SOPREMA	DUOTACK SPF HFO	Polyset Commercial Roofing Adhesive (formerly Polyset CR-20)	FL1365
Roofing Insulation	SOPREMA	SOPRA-ISOs	ACFoam II	FL17989
		SOPRA-ISO+s	ACFoam III	
		SOPRA-ISOr	H-Shield	FL5968
		SOPRA-ISO+r	H-Shield CG	
		SOPRA-ISOx	Multi-Max FA3	FL11207
		SOPRA-ISO+x	Ultra-Max	
	Georgia-Pacific Gypsum	DensDeck Prime	DensDeck StormX Prime Roof Board	FL1250

ACCEPTABLE ALTERNATES				
SUB-CATEGORY	BY	LISTED PRODUCT HEREIN	ALTERNATE	
			PRODUCT	FBC FILE
Roofing Fasteners	SOPREMA	SOPREMA #12 DP	Trufast #12 DP	FL4500
		SOPREMA #14 MP	Trufast #14 HD	
		SOPREMA #15 HD	Trufast #15 EHD	
		SOPREMA Fluted Concrete Nail	Trufast Fluted Concrete Nail	
		SOPREMA Versa-Fast Fastener	Trufast Versa-Fast Fastener	
		SOPREMA 1.2 in. Base Sheet Fastener	Trufast FM-75 Base Sheet Fastener	
		SOPREMA 1.7 in. Base Sheet Fastener	Trufast FM-90 Base Sheet Fastener	
		SOPREMA Twin Loc-Nail	Trufast Twin Loc-Nail Assembled Fastener	
		SOPREMA 2" Seam Plate	Trufast 2" Barbed Metal Seam Plate	
		SOPREMA 2.4" Seam Plate	Trufast 2.4" Scoop Seam Plate	
		SOPREMA 3" Metal Insulation Plate	Trufast 3" Metal Insulation Plate	
		SOPRAFIX MBB-R	Trufast Recessed Batten Bar (BB-18-R)	
		SOPREMA Versa-Fast Plate	Trufast Versa-Fast Plate	
		SOPREMA #12 Fastener	Dekfast DF-#12-PH3	FL20311
		SOPREMA #14 Fastener	Dekfast DF-#14-PH3	
		SOPREMA #15 Fastener	Dekfast DF-#15-PH3	
		SOPRAFIX 2" SB Stress Plate	Dekfast PLT-R-2-4B	
		SOPRAFIX 2-3/8" SB Stress Plate	Dekfast PLT-R-2-3/8-6B	
		SOPREMA 3" Round Insulation Plate	Dekfast PLT-R-3	
Modified Bitumen	SOPREMA	SOPRAFIX BASE 611	SOPRAFIX BASE 612, SOPRAFIX BASE 613, SOPRAFIX BASE 614, SOPRALENE FLAM 180, SOPRALENE FLAM 250	FL3915
		SOPRAFIX BASE 612	SOPRAFIX BASE 614, SOPRALENE FLAM 180, SOPRALENE FLAM 250	
		SOPRAFIX BASE 613	SOPRAFIX BASE 612, SOPRAFIX BASE 614, SOPRALENE FLAM 180, SOPRALENE FLAM 250	
		SOPRAFIX BASE 614	SOPRALENE FLAM 250	
		SOPRAFIX BASE 622	SOPRALENE 180 Sanded, SOPRALENE 180 SP 3.0, SOPRALENE 180 SP 3.5, SOPRALENE 250 Sanded, SOPRALENE 250 SP	

23 "MDP" = Maximum Design Pressure is the result of testing for wind load resistance based on allowable wind loads. Refer to FBC 1609 for determination of design wind loads.

TABLE 1A: WOOD DECKS – NEW CONSTRUCTION OR REROOF (TEAR-OFF)											
SYSTEM TYPE A-2: MECHANICALLY ATTACHED ANCHOR SHEET, BONDED INSULATION, BONDED ROOF COVER											
System No.	Deck (Note 1)	Anchor Sheet		Base Insulation Layer(s)		Top Insulation Layer		Roof Cover (Note 15)			MDP (psf)
		Type	Attach	Type	Attach (Notes 6,7,8)	Type	Attach (Notes 6,7,8)	Base Ply	Primer	LARS	
W-1.	Min. 19/32-inch plywood	One or two layers MODIFIED SOPRA G, SOPRABASE S	12 ga. annular ring shank nails with min. 3/8" dia head through min. 32 ga., 1-5/8" dia "tin caps" spaced 6-inch o.c. at 4-inch wide side laps and 6-inch o.c. at three equally spaced rows in the center of the sheet	(Optional) Min. 1.5-inch SOPRA-ISOs, ENRGY 3, SOPRA-ISOr or SOPRA-ISOx	DUOTACK in ribbons run atop anchor sheet fastener rows	Min. 7/16-inch DEXcell Cement Roof Board or min. 0.5-inch SECUROCK Cement Roof Board	DUOTACK ribbons spaced 6" o.c. or, if no base insulation, run atop anchor sheet fastener rows	None	RS 276	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-45.0

TABLE 1B: WOOD DECKS – NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER										
SYSTEM TYPE B-1: MECHANICALLY ATTACHED BASE INSULATION, BONDED TOP INSULATION, BONDED ROOF COVER										
System No.	Deck (Note 1)	Base Insulation Layer			Top Insulation Layer		Roof Cover (Note 15)			MDP (psf)
		Type	Fastener (Note 11)	Attach	Type	Attach (Notes 6,7,8)	Base Ply	Primer	LARS	
No BASE PLY:										
W-2.	Min. 19/32-inch APA rated OSB or CDX plywood	Min 2-inch SOPRA-ISOs, SOPRA-ISOr, SOPRA-ISO+r, SOPRA-ISOx or SOPRA-ISO+x	Versa-Fast Plate with minimum one (1) Versa-Fast Fastener installed into the center-hole of the Versa-Fast Plate.	1 per 2.7 ft²	Min. 7/16-inch DEXcell Cement Roof Board or min. 0.5-inch SECUROCK Cement Roof Board	DUOTACK	None	RS 276	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-45.0*
W-3.	Min. 15/32-inch APA rated BCX plywood	Min 2-inch SOPRA-ISOs, SOPRA-ISOr, SOPRA-ISO+r, SOPRA-ISOx or SOPRA-ISO+x	Versa-Fast Plate with minimum two (2) Versa-Fast Fastener or SOPREMA #14 MP Fastener installed 180° into the holes of the Versa-Fast Plate	1 per 1.8 ft² (18 per 4x8 ft board)	Min. 0.5-inch SECUROCK Cement Roof Board	DUOTACK	None	RS 276	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-67.5
W-4.	Min. 19/32-inch APA rated OSB or CDX plywood	Min 2-inch SOPRA-ISOs, SOPRA-ISO+r or SOPRA-ISO+x	Versa-Fast Plate with minimum one (1) Versa-Fast Fastener installed into the center-hole of the Versa-Fast Plate.	1 per 2.7 ft²	Min. 7/16-inch DEXcell Cement Roof Board or min. 0.5-inch SECUROCK Cement Roof Board	DUOTACK SPF HFO	None	RS 276	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-45.0*
W-5.	Min. 15/32-inch APA rated BCX plywood	Min 2-inch SOPRA-ISOs, SOPRA-ISO+r or SOPRA-ISO+x	Versa-Fast Plate with minimum two (2) Versa-Fast Fastener or SOPREMA #14 MP Fastener installed 180° into the holes of the Versa-Fast Plate	1 per 1.8 ft² (18 per 4x8 ft board)	Min. 0.5-inch SECUROCK Cement Roof Board	DUOTACK SPF HFO	None	RS 276	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-67.5
COLD APPLIED BASE:										

TABLE 1B: WOOD DECKS – NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE B-1: MECHANICALLY ATTACHED BASE INSULATION, BONDED TOP INSULATION, BONDED ROOF COVER

System No.	Deck (Note 1)	Base Insulation Layer			Top Insulation Layer		Roof Cover (Note 15)			MDP (psf)
		Type	Fastener (Note 11)	Attach	Type	Attach (Notes 6,7,8)	Base Ply	Primer	LARS	
W-6.	Min. 19/32-inch APA rated OSB or CDX plywood	Min 2-inch SOPRA-ISOs, SOPRA-ISOr, SOPRA-ISO+r, SOPRA-ISOx or SOPRA-ISO+x	Versa-Fast Plate with minimum one (1) Versa-Fast Fastener installed into the center-hole of the Versa-Fast Plate.	1 per 2.7 ft ²	Min. 0.125-inch SOPRABOARD, Min. 0.25-inch DensDeck Prime, DEXcell FA Glass Mat Roof Board or SECURROCK Gypsum Fiber Roof Board or Min. 7/16-inch DEXcell Cement Roof Board	DUOTACK	SBS-CA3	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-45.0*
W-7.	Min. 19/32-inch APA rated OSB or CDX plywood	Min 2-inch SOPRA-ISOs, SOPRA-ISOr, SOPRA-ISO+r, SOPRA-ISOx or SOPRA-ISO+x	Versa-Fast Plate with minimum one (1) Versa-Fast Fastener installed into the center-hole of the Versa-Fast Plate.	1 per 2.7 ft ²	Min. 0.125-inch SOPRABOARD primed with DETEC “TruGround Conductive Primer”	DUOTACK	SBS-CA3	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-45.0*
W-8.	Min. 19/32-inch APA rated OSB or CDX plywood	Min 2-inch SOPRA-ISOs, SOPRA-ISOr, SOPRA-ISO+r, SOPRA-ISOx or SOPRA-ISO+x	Versa-Fast Plate with minimum one (1) Versa-Fast Fastener installed into the center-hole of the Versa-Fast Plate.	1 per 2.7 ft ²	SOPRASMART Board 180 Sanded	DUOTACK	(Optional) SBS-CA3	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-45.0*
W-9.	Min. 15/32-inch APA rated BCX plywood	Min 2-inch SOPRA-ISOs, SOPRA-ISOr, SOPRA-ISO+r, SOPRA-ISOx or SOPRA-ISO+x	Versa-Fast Plate with minimum two (2) Versa-Fast Fastener or SOPREMA #14 MP Fastener installed 180° into the holes of the Versa-Fast Plate	1 per 1.8 ft ² (18 per 4x8 ft board)	SOPRASMART Board 180 Sanded	DUOTACK	(Optional) SBS-CA3	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-67.5
W-10.	Min. 15/32-inch APA rated BCX plywood	Min 2-inch SOPRA-ISOs, SOPRA-ISOr, SOPRA-ISO+r, SOPRA-ISOx or SOPRA-ISO+x	Versa-Fast Plate with minimum two (2) Versa-Fast Fastener or SOPREMA #14 MP Fastener installed 180° into the holes of the Versa-Fast Plate	1 per 1.8 ft ² (18 per 4x8 ft board)	Min. 0.25-inch DensDeck Prime, DEXcell FA Glass Mat Roof Board or SECURROCK Gypsum Fiber Roof Board or Min. 7/16-inch DEXcell Cement Roof Board	DUOTACK	SBS-CA3	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-67.5
W-11.	Min. 19/32-inch APA rated OSB or CDX plywood	Min 2-inch SOPRA-ISOs, SOPRA-ISO+r or SOPRA-ISO+x	Versa-Fast Plate with minimum one (1) Versa-Fast Fastener installed into the center-hole of the Versa-Fast Plate.	1 per 2.7 ft ²	Min. 0.25-inch DensDeck Prime or SECURROCK Gypsum Fiber Roof Board or Min. 7/16-inch DEXcell Cement Roof Board	DUOTACK SPF HFO	SBS-CA3	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-45.0*
W-12.	Min. 15/32-inch APA rated BCX plywood	Min 2-inch SOPRA-ISOs, SOPRA-ISO+r or SOPRA-ISO+x	Versa-Fast Plate with minimum two (2) Versa-Fast Fastener or SOPREMA #14 MP Fastener installed 180° into the holes of the Versa-Fast Plate	1 per 1.8 ft ² (18 per 4x8 ft board)	Min. 0.25-inch DensDeck Prime or SECURROCK Gypsum Fiber Roof Board or Min. 7/16-inch DEXcell Cement Roof Board	DUOTACK SPF HFO	SBS-CA3	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-67.5

TORCH APPLIED BASE:

TABLE 1B: WOOD DECKS – NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE B-1: MECHANICALLY ATTACHED BASE INSULATION, BONDED TOP INSULATION, BONDED ROOF COVER

System No.	Deck (Note 1)	Base Insulation Layer			Top Insulation Layer		Roof Cover (Note 15)			MDP (psf)
		Type	Fastener (Note 11)	Attach	Type	Attach (Notes 6,7,8)	Base Ply	Primer	LARS	
W-13.	Min. 19/32-inch APA rated OSB or CDX plywood	Min 2-inch SOPRA-ISOs, SOPRA-ISOr, SOPRA-ISO+r, SOPRA-ISOx or SOPRA-ISO+x	Versa-Fast Plate with minimum one (1) Versa-Fast Fastener installed into the center-hole of the Versa-Fast Plate.	1 per 2.7 ft ²	Min. 0.125-inch SOPRABOARD, Min. 0.25-inch DensDeck Prime, DEXcell FA Glass Mat Roof Board or SECUROCK Gypsum Fiber Roof Board or Min. 7/16-inch DEXcell Cement Roof Board	DUOTACK	SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-45.0*
W-14.	Min. 19/32-inch APA rated OSB or CDX plywood	Min 2-inch SOPRA-ISOs, SOPRA-ISOr, SOPRA-ISO+r, SOPRA-ISOx or SOPRA-ISO+x	Versa-Fast Plate with minimum one (1) Versa-Fast Fastener installed into the center-hole of the Versa-Fast Plate.	1 per 2.7 ft ²	SOPRASMART Board 180 Sanded (for no Base Ply) or SOPRASMART Board 180 (for TA Base Ply)	DUOTACK	(Optional) SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-45.0*
W-15.	Min. 15/32-inch APA rated BCX plywood	Min 2-inch SOPRA-ISOs, SOPRA-ISOr, SOPRA-ISO+r, SOPRA-ISOx or SOPRA-ISO+x	Versa-Fast Plate with minimum two (2) Versa-Fast Fastener or SOPREMA #14 MP Fastener installed 180° into the holes of the Versa-Fast Plate	1 per 1.8 ft ² (18 per 4x8 ft board)	Min. 0.25-inch SOPRABOARD, DensDeck Prime, DEXcell FA Glass Mat Roof Board or SECUROCK Gypsum Fiber Roof Board or Min. 7/16-inch DEXcell Cement Roof Board	DUOTACK	SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-67.5
W-16.	Min. 15/32-inch APA rated BCX plywood	Min 2-inch SOPRA-ISOs, SOPRA-ISOr, SOPRA-ISO+r, SOPRA-ISOx or SOPRA-ISO+x	Versa-Fast Plate with minimum two (2) Versa-Fast Fastener or SOPREMA #14 MP Fastener installed 180° into the holes of the Versa-Fast Plate	1 per 1.8 ft ² (18 per 4x8 ft board)	SOPRASMART Board 180 Sanded (for no Base Ply) or SOPRASMART Board 180 (for TA Base Ply)	DUOTACK	(Optional) SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-67.5
W-17.	Min. 19/32-inch APA rated OSB or CDX plywood	Min 2-inch SOPRA-ISOs, SOPRA-ISO+r or SOPRA-ISO+x	Versa-Fast Plate with minimum one (1) Versa-Fast Fastener installed into the center-hole of the Versa-Fast Plate.	1 per 2.7 ft ²	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum Fiber Roof Board or Min. 7/16-inch DEXcell Cement Roof Board	DUOTACK SPF HFO	SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-45.0*
W-18.	Min. 15/32-inch APA rated BCX plywood	Min 2-inch SOPRA-ISOs, SOPRA-ISO+r or SOPRA-ISO+x	Versa-Fast Plate with minimum two (2) Versa-Fast Fastener or SOPREMA #14 MP Fastener installed 180° into the holes of the Versa-Fast Plate	1 per 1.8 ft ² (18 per 4x8 ft board)	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum Fiber Roof Board or Min. 7/16-inch DEXcell Cement Roof Board	DUOTACK SPF HFO	SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-67.5

SELF-ADHERING BASE:

TABLE 1B: WOOD DECKS – NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE B-1: MECHANICALLY ATTACHED BASE INSULATION, BONDED TOP INSULATION, BONDED ROOF COVER

System No.	Deck (Note 1)	Base Insulation Layer			Top Insulation Layer		Roof Cover (Note 15)			MDP (psf)
		Type	Fastener (Note 11)	Attach	Type	Attach (Notes 6,7,8)	Base Ply	Primer	LARS	
W-19.	Min. 19/32-inch APA rated OSB or CDX plywood	Min 2-inch SOPRA-ISOs, SOPRA-ISOr, SOPRA-ISO+r, SOPRA-ISOx or SOPRA-ISO+x	Versa-Fast Plate with minimum one (1) Versa-Fast Fastener installed into the center-hole of the Versa-Fast Plate.	1 per 2.7 ft ²	Min. 0.125-inch SOPRABOARD. Top surface primed with Elastocol Stick Zero. or Min. 0.25-inch DensDeck Prime, DEXcell FA Glass Mat Roof Board or SECUROCK Gypsum Fiber Roof Board or Min. 7/16-inch DEXcell Cement Roof Board. Top surface primed with Elastocol Stick or Elastocol Stick Zero.	DUOTACK	SBS-SA1	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-45.0*
W-20.	Min. 19/32-inch APA rated OSB or CDX plywood	Min 2-inch SOPRA-ISOs, SOPRA-ISOr, SOPRA-ISO+r, SOPRA-ISOx or SOPRA-ISO+x	Versa-Fast Plate with minimum one (1) Versa-Fast Fastener installed into the center-hole of the Versa-Fast Plate.	1 per 2.7 ft ²	SOPRASMART Board 180 Sanded. Top surface primed with Elastocol Stick Zero	DUOTACK	(Optional) SBS-SA1	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-45.0*
W-21.	Min. 15/32-inch APA rated BCX plywood	Min 2-inch SOPRA-ISOs, SOPRA-ISOr, SOPRA-ISO+r, SOPRA-ISOx or SOPRA-ISO+x	Versa-Fast Plate with minimum two (2) Versa-Fast Fastener or SOPREMA #14 MP Fastener installed 180° into the holes of the Versa-Fast Plate	1 per 1.8 ft ² (18 per 4x8 ft board)	Min. 0.25-inch SOPRABOARD. Top surface primed with Elastocol Stick Zero	DUOTACK	SBS-SA1	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-67.5
W-22.	Min. 15/32-inch APA rated BCX plywood	Min 2-inch SOPRA-ISOs, SOPRA-ISOr, SOPRA-ISO+r, SOPRA-ISOx or SOPRA-ISO+x	Versa-Fast Plate with minimum two (2) Versa-Fast Fastener or SOPREMA #14 MP Fastener installed 180° into the holes of the Versa-Fast Plate	1 per 1.8 ft ² (18 per 4x8 ft board)	SOPRASMART Board 180 Sanded. Top surface primed with Elastocol Stick Zero	DUOTACK	(Optional) SBS-SA1	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-67.5
W-23.	Min. 15/32-inch APA rated BCX plywood	Min 2-inch SOPRA-ISOs, SOPRA-ISOr, SOPRA-ISO+r, SOPRA-ISOx or SOPRA-ISO+x	Versa-Fast Plate with minimum two (2) Versa-Fast Fastener or SOPREMA #14 MP Fastener installed 180° into the holes of the Versa-Fast Plate	1 per 1.8 ft ² (18 per 4x8 ft board)	Min. 0.25-inch DensDeck Prime, DEXcell FA Glass Mat Roof Board or SECUROCK Gypsum Fiber Roof Board or Min. 7/16-inch DEXcell Cement Roof Board. Top surface primed with Elastocol Stick or Elastocol Stick Zero.	DUOTACK	SBS-SA1	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-67.5
W-24.	Min. 19/32-inch APA rated OSB or CDX plywood	Min 2-inch SOPRA-ISOs, SOPRA-ISO+r or SOPRA-ISO+x	Versa-Fast Plate with minimum one (1) Versa-Fast Fastener installed into the center-hole of the Versa-Fast Plate.	1 per 2.7 ft ²	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum Fiber Roof Board or Min. 7/16-inch DEXcell Cement Roof Board. Top surface primed with ELASTOCOL Stick or ELASTOCOL Stick Zero.	DUOTACK SPF HFO	SBS-SA1	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-45.0*

TABLE 1b: WOOD DECKS – NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE B-1: MECHANICALLY ATTACHED BASE INSULATION, BONDED TOP INSULATION, BONDED ROOF COVER

System No.	Deck (Note 1)	Base Insulation Layer			Top Insulation Layer		Roof Cover (Note 15)			MDP (psf)
		Type	Fastener (Note 11)	Attach	Type	Attach (Notes 6,7,8)	Base Ply	Primer	LARS	
W-25.	Min. 15/32-inch APA rated BCX plywood	Min 2-inch SOPRA-ISOs, SOPRA-ISO+r or SOPRA-ISO+x	Versa-Fast Plate with minimum two (2) Versa-Fast Fastener or SOPREMA #14 MP Fastener installed 180° into the holes of the Versa-Fast Plate	1 per 1.8 ft ² (18 per 4x8 ft board)	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum Fiber Roof Board or Min. 7/16-inch DEXcell Cement Roof Board. Top surface primed with ELASTOCOL Stick or ELASTOCOL Stick Zero.	DUOTACK SPF HFO	SBS-SA1	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-67.5

TABLE 1c: WOOD DECKS – NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE C-1: MECHANICALLY ATTACHED INSULATION, BONDED ROOF COVER

Sys. No.	Deck (Note 1)	Base Insulation and/or Thermal Barrier Layer(s)	Top Insulation Layer			Roof Cover (Note 15)			MDP (psf)
			Type	Fastener (Note 11)	Attach	Base Ply	Primer	LARS	
No Base Ply:									
W-26.	Min. 19/32-inch plywood	(Optional) One or more layers, any combination, loose laid	Min. 7/16-inch DEXcell Cement Roof Board or 0.5-inch SECUROCK Cement Roof Board	SOPREMA #14 MP Fastener with SOPREMA 3” Metal Insulation Plate	1 per 2.0 ft²	None	RS 276	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-45.0*
Torch Applied Base:									
W-27.	Min. 19/32-inch plywood	(Optional) One or more layers, any combination, loose laid	Min. 0.125-inch SOPRABOARD or min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	SOPREMA #14 Fastener with SOPREMA 3” Round Insulation Plate	1 per 2.3 ft²	SBS-TAP or SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-30.0*
W-28.	Min. 19/32-inch plywood	(Optional) One or more layers, any combination, loose laid	Min. 0.125-inch SOPRABOARD or min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	SOPREMA #14 MP Fastener with SOPREMA 3” Metal Insulation Plate or OMG #14 Roofgrip with Flat Bottom Plate (Accutrac)	1 per 2.3 ft²	SBS-TAP or SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-37.5*
W-29.	Min. 19/32-inch plywood	(Optional) One or more layers, any combination, loose laid	Min. 0.125-inch SOPRABOARD or min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	SOPREMA #14 MP Fastener with SOPREMA 3” Metal Insulation Plate or OMG #14 Roofgrip with Flat Bottom Plate (Accutrac)	1 per 2.0 ft²	SBS-TAP or SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-45.0*
W-30.	Min. 19/32-inch plywood	(Optional) One or more layers, any combination, loose laid	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	Note 2	1 per 1.6 ft²	SBS-TAP or SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-52.5
W-31.	Min. 19/32-inch plywood	(Optional) One or more layers, any combination, loose laid	Min. 0.125-inch SOPRABOARD	SOPREMA #15 Fastener with SOPREMA 3” Round Insulation Plate	1 per 1.3 ft²	SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-75.0
Self-Adhering Base:									
W-32.	Min. 19/32-inch plywood	(Optional) One or more layers, any combination, loose laid	Min. 0.125-inch SOPRABOARD primed with Elastocol 500, Elastocol Stick or Elastocol Stick Zero	SOPREMA #14 Fastener with SOPREMA 3” Round Insulation Plate	1 per 2.3 ft2	SBS-SA1	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-30.0*

**TABLE 1c: WOOD DECKS – NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE C-1: MECHANICALLY ATTACHED INSULATION, BONDED ROOF COVER**

Sys. No.	Deck (Note 1)	Base Insulation and/or Thermal Barrier Layer(s)	Top Insulation Layer			Roof Cover (Note 15)			MDP (psf)
			Type	Fastener (Note 11)	Attach	Base Ply	Primer	LARS	
W-33.	Min. 19/32-inch plywood	(Optional) One or more layers, any combination, loose laid	Min. 0.125-inch SOPRABOARD primed with Elastocol 500, Elastocol Stick or Elastocol Stick Zero or 0.25-inch DensDeck Prime	SOPREMA #14 MP Fastener with SOPREMA 3" Metal Insulation Plate or OMG #14 Roofgrip with Flat Bottom Plate (Accutrac)	1 per 2.3 ft ²	SBS-SA1	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-37.5*
W-34.	Min. 19/32-inch plywood	(Optional) One or more layers, any combination, loose laid	Min. 0.125-inch SOPRABOARD primed with Elastocol 500, Elastocol Stick or Elastocol Stick Zero or 0.25-inch DensDeck Prime	SOPREMA #14 MP Fastener with SOPREMA 3" Metal Insulation Plate or OMG #14 Roofgrip with Flat Bottom Plate (Accutrac)	1 per 2.0 ft ²	SBS-SA1	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-45.0*

**TABLE 1d: WOOD DECKS – NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE D-2: INSULATED, MECHANICALLY ATTACHED SOPRAPHIX, BONDED ROOF COVER**

System No.	Deck (Note 1)	Slip Sheet	Insulation and/or Thermal Barrier	Base Sheet			Roof Cover (Note 15)			MDP (psf)
				Type	Fastener (Note 11)	Spacing	Base Ply	Primer	LARS	
W-35.	Min. 19/32-inch plywood	(Optional) One or more layers MODIFIED SOPRA-G, loose laid	Any combination, prelim attach	SOPRAPHIX Base 622	SOPREMA #14 MP Fastener with SOPRAPHIX 2-inch Seam Plate	18-inch o.c. within the 4-inch wide, hot-air-welded side laps	(Optional) SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-37.5*
W-36.	Min. 15/32-inch plywood or OSB	(Optional) One or more layers MODIFIED SOPRA-G, loose laid	Any combination, prelim attach	SOPRAPHIX Base 622	SOPREMA #14 MP Fastener with SOPRAPHIX 2-inch Seam Plate	12-inch o.c. within the 4-inch wide, hot-air-welded side laps	(Optional) SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-45.0*
W-37.	Min. 19/32-inch plywood	(Optional) One or more layers MODIFIED SOPRA-G, loose laid	Any combination, prelim attach	SOPRAPHIX Base 622	SOPREMA #14 MP Fastener with SOPRAPHIX 2-inch Seam Plate	12-inch o.c. within the 4-inch wide, hot-air-welded side laps	(Optional) SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-52.5
W-38.	Min. 19/32-inch plywood	(Optional) One or more layers MODIFIED SOPRA-G, loose laid	Any combination, prelim attach	SOPRAPHIX Base 622, SOPRAPHIX Base 641	OMG Large Head #15 Roofgrip with Polymer Batten Strip or SOPREMA #15 Fastener with SOPRAPHIX MBB or MBB-R	6-inch o.c. within 5-inch wide, heat-welded or self-adhering laps.	SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-60.0
W-39.	Min. 19/32-inch plywood	(Optional) One or more layers MODIFIED SOPRA-G, loose laid	Any combination, prelim attach	SOPRAPHIX Base 614	OMG Large Head #15 Roofgrip with Polymer Batten Strip or SOPREMA #15 Fastener with SOPRAPHIX MBB or MBB-R	6-inch o.c. within 5-inch wide, heat-welded or self-adhering laps.	SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-60.0
W-40.	Min. 19/32-inch plywood	(Optional) One or more layers MODIFIED SOPRA-G, loose laid	Any combination, prelim attach	SOPRAPHIX Base 622	SOPREMA #14 MP Fastener with SOPRAPHIX 2-inch Seam Plate	6-inch o.c. within the 4-inch wide, hot-air-welded side laps	(Optional) SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-82.5

**TABLE 1D: WOOD DECKS – NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE D-2: INSULATED, MECHANICALLY ATTACHED SOPRAPHIX, BONDED ROOF COVER**

System No.	Deck (Note 1)	Slip Sheet	Insulation and/or Thermal Barrier	Base Sheet			Roof Cover (Note 15)			MDP (psf)
				Type	Fastener (Note 11)	Spacing	Base Ply	Primer	LARS	
W-41.	Min. 19/32-inch plywood	(Optional) One or more layers MODIFIED SOPRA-G, loose laid	Any combination, prelim attach	SOPRAPHIX Base 622, SOPRAPHIX Base 641	OMG Large Head #15 Roofgrip with Polymer Batten Strip or SOPREMA #15 Fastener with SOPRAPHIX MBB or MBB-R	6-inch o.c. within 5-inch wide, heat-welded or self-adhering laps.	SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-90.0
W-42.	Min. 19/32-inch plywood	(Optional) One or more layers MODIFIED SOPRA-G, loose laid	Any combination, prelim attach	SOPRAPHIX Base 614	OMG Large Head #15 Roofgrip with Polymer Batten Strip or SOPREMA #15 Fastener with SOPRAPHIX MBB or MBB-R	6-inch o.c. within 5-inch wide, heat-welded or self-adhering laps.	SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-90.0

TABLE 2A: STEEL DECKS – NEW CONSTRUCTION OR REROOF (TEAR-OFF)
SYSTEM TYPE A-1: BONDED INSULATION, BONDED ROOF COVER
 REFER TO [NOTE 12](#) FOR THERMAL BARRIER / VAPOR BARRIER COMBINATION OPTIONS

System No.	Deck (Note 1)	Thermal Barrier		Base Insulation Layer		Top Insulation Layer		Roof Cover (Note 15)				MDP (psf)
		Type	Attach (Notes 6,7,8)	Type	Attach (Notes 6,7,8)	Type	Attach (Notes 6,7,8)	Base Ply	Ply	Primer	LARS	
No Base Ply:												
S-1.	22 ga., Type B, Grade 40 steel	(Optional) Min. 0.5-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	DUOTACK 365, ribbons 6" o.c. (on each deck flange)	Min. 2-inch SOPRA-ISOs, SOPRA-ISO+s, SOPRA-ISOr or SOPRA-ISO+r	TO DECK: DUOTACK 365, ribbons 6" o.c. (on each deck flange) TO THERMAL BARRIER: DUOTACK	Additional optional layer(s), min. 1.5-inch base insulation followed by min. 0.5-inch SECUROCK Cement Roof Board	DUOTACK	None	None	RS 276	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-97.5
Cold Applied Base:												
S-2.	22 ga., Type B, Grade 40 steel	(Optional) Min. 0.5-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	DUOTACK 365, ribbons 6" o.c. (on each deck flange)	Min. 2-inch SOPRA-ISOs, SOPRA-ISO+s, SOPRA-ISOr, SOPRA-ISO+r or SOPRA-ISOx	TO DECK: DUOTACK 365, ribbons 6" o.c. (on each deck flange) TO THERMAL BARRIER: DUOTACK	Additional optional layer(s), min. 1.5-inch base insulation followed by min. 0.125-inch SOPRABOARD, optionally primed with DETEC "TruGround Conductive Primer"	DUOTACK	SBS-CA3	None	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-60.0
S-3.	22 ga., Type B, Grade 40 steel	(Optional) Min. 0.5-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	DUOTACK 365, ribbons 6" o.c. (on each deck flange)	Min. 2-inch SOPRA-ISOs, SOPRA-ISO+s, SOPRA-ISOr, SOPRA-ISO+r or SOPRA-ISOx	TO DECK: DUOTACK 365, ribbons 6" o.c. (on each deck flange) TO THERMAL BARRIER: DUOTACK	Additional optional layer(s), min. 1.5-inch base insulation followed by SOPRASMART Board 180 Sanded	DUOTACK	(Optional) SBS-CA3	None	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-60.0
S-4.	22 ga., Type B, Grade 40 steel	(Optional) Min. 0.5-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	DUOTACK 365, ribbons 6" o.c. (on each deck flange)	Min. 2-inch SOPRA-ISOs, SOPRA-ISO+s, SOPRA-ISOr or SOPRA-ISO+r	TO DECK: DUOTACK 365, ribbons 6" o.c. (on each deck flange) TO THERMAL BARRIER: DUOTACK	Additional optional layer(s), min. 1.5-inch base insulation followed by min. 0.25-inch DensDeck Prime, DEXcell FA Glass Mat Roof Board or SECUROCK Gypsum Fiber Roof Board	DUOTACK	SBS-CA3	None	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-82.5
S-5.	22 ga., Type B, Grade 40 steel	(Optional) Min. 0.5-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	DUOTACK 365, ribbons 6" o.c. (on each deck flange)	Min. 2-inch SOPRA-ISOs, SOPRA-ISO+s, SOPRA-ISOr or SOPRA-ISO+r	TO DECK: DUOTACK 365, ribbons 6" o.c. (on each deck flange) TO THERMAL BARRIER: DUOTACK	Additional optional layer(s), min. 1.5-inch base insulation followed by min. 0.5-inch SECUROCK Gypsum Fiber Roof Board	DUOTACK	SBS-CA3	None	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-90.0
S-6.	22 ga., Type B, Grade 40 steel	(Optional) Min. 0.5-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	DUOTACK 365, ribbons 6" o.c. (on each deck flange)	Min. 2-inch SOPRA-ISOs, SOPRA-ISO+s, SOPRA-ISOr or SOPRA-ISO+r	TO DECK: DUOTACK 365, ribbons 6" o.c. (on each deck flange) TO THERMAL BARRIER: DUOTACK	Additional optional layer(s), min. 1.5-inch base insulation followed by min. 0.5-inch DensDeck Prime	DUOTACK	SBS-CA3	None	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-97.5

TABLE 2A: STEEL DECKS – NEW CONSTRUCTION OR REROOF (TEAR-OFF)
SYSTEM TYPE A-1: BONDED INSULATION, BONDED ROOF COVER
 REFER TO [NOTE 12](#) FOR THERMAL BARRIER / VAPOR BARRIER COMBINATION OPTIONS

System No.	Deck (Note 1)	Thermal Barrier		Base Insulation Layer		Top Insulation Layer		Roof Cover (Note 15)				MDP (psf)
		Type	Attach (Notes 6,7,8)	Type	Attach (Notes 6,7,8)	Type	Attach (Notes 6,7,8)	Base Ply	Ply	Primer	LARS	
S-7.	22 ga., Type B, Grade 40 steel	(Optional) Min. 0.5-inch DensDeck Prime, DEXcell FA Glass Mat Roof Board, SECUROCK Gypsum-Fiber Roof Board or SECUROCK Cement Roof Board or min. 7/16-inch DEXcell Cement Roof Board	DUOTACK SPF HFO, ribbons 12" o.c. (on every-other deck flange)	Min. 1.5-inch SOPRA-ISOS, SOPRA-ISO+R, SOPRA-ISO+x or SOPRA-XPS	DUOTACK SPF HFO	Min. 0.25-inch SOPRABOARD, DensDeck Prime, DEXcell FA Glass Mat Roof Board or SECUROCK Gypsum-Fiber Roof Board or min. 7/16-inch DEXcell Cement Roof Board	DUOTACK SPF HFO	SBS-CA3	None	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-75.0
S-8.	22 ga., Type B, Grade 40 steel	(Optional) Min. 0.5-inch DensDeck Prime, DEXcell FA Glass Mat Roof Board, SECUROCK Gypsum-Fiber Roof Board or SECUROCK Cement Roof Board or min. 7/16-inch DEXcell Cement Roof Board	DUOTACK SPF HFO, ribbons 6" o.c. (on each deck flange)	Min. 1.5-inch SOPRA-ISOS, SOPRA-ISO+R, SOPRA-ISO+x or SOPRA-XPS	DUOTACK SPF HFO, ribbons 6" o.c.	Min. 0.25-inch SOPRABOARD, DensDeck Prime, DEXcell FA Glass Mat Roof Board or SECUROCK Gypsum-Fiber Roof Board or min. 7/16-inch DEXcell Cement Roof Board	DUOTACK SPF HFO, ribbons 6" o.c.	SBS-CA3	None	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-97.5
TORCH APPLIED BASE:												
S-9.	22 ga., Type B, Grade 40 steel	(Optional) Min. 0.5-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	DUOTACK 365, ribbons 6" o.c. (on each deck flange)	Min. 2-inch SOPRA-ISOS, SOPRA-ISO+s, SOPRA-ISOR or SOPRA-ISO+r	TO DECK: DUOTACK 365, ribbons 6" o.c. (on each deck flange) TO THERMAL BARRIER: DUOTACK	Additional optional layer(s), min. 1.5-inch base insulation followed by min. 0.25-inch SOPRABOARD, DensDeck Prime, DEXcell FA Glass Mat Roof Board or SECUROCK Gypsum Fiber Roof Board	DUOTACK	SBS-TAF	(Optional) SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-82.5
S-10.	22 ga., Type B, Grade 40 steel	(Optional) Min. 0.5-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	DUOTACK 365, ribbons 6" o.c. (on each deck flange)	Min. 2-inch SOPRA-ISOS, SOPRA-ISO+s, SOPRA-ISOR or SOPRA-ISO+r	TO DECK: DUOTACK 365, ribbons 6" o.c. (on each deck flange) TO THERMAL BARRIER: DUOTACK	Additional optional layer(s), min. 1.5-inch base insulation followed by min. 0.5-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	DUOTACK	SBS-TAF	(Optional) SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-97.5
S-11.	22 ga., Type B, Grade 40 steel	(Optional) Min. 0.5-inch DensDeck Prime, DEXcell FA Glass Mat Roof Board, SECUROCK Gypsum-Fiber Roof Board or SECUROCK Cement Roof Board or min. 7/16-inch DEXcell Cement Roof Board	DUOTACK SPF HFO, ribbons 12" o.c. (on every-other deck flange)	Min. 1.5-inch SOPRA-ISOS, SOPRA-ISO+R, SOPRA-ISO+x or SOPRA-XPS	DUOTACK SPF HFO	Min. 0.25-inch SOPRABOARD, DensDeck Prime, DEXcell FA Glass Mat Roof Board or SECUROCK Gypsum-Fiber Roof Board or min. 7/16-inch DEXcell Cement Roof Board	DUOTACK SPF HFO	SBS-TAF	(Optional) SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-75.0

TABLE 2A: STEEL DECKS – NEW CONSTRUCTION OR REROOF (TEAR-OFF)
SYSTEM TYPE A-1: BONDED INSULATION, BONDED ROOF COVER
 REFER TO [NOTE 12](#) FOR THERMAL BARRIER / VAPOR BARRIER COMBINATION OPTIONS

System No.	Deck (Note 1)	Thermal Barrier		Base Insulation Layer		Top Insulation Layer		Roof Cover (Note 15)				MDP (psf)
		Type	Attach (Notes 6,7,8)	Type	Attach (Notes 6,7,8)	Type	Attach (Notes 6,7,8)	Base Ply	Ply	Primer	LARS	
S-12.	22 ga., Type B, Grade 40 steel	(Optional) Min. 0.5-inch DensDeck Prime, DEXcell FA Glass Mat Roof Board, SECUROCK Gypsum-Fiber Roof Board or SECUROCK Cement Roof Board or min. 7/16-inch DEXcell Cement Roof Board	DUOTACK SPF HFO, ribbons 6" o.c. (on each deck flange)	Min. 1.5-inch SOPRA-ISOs, SOPRA-ISO+R, SOPRA-ISO+x or SOPRA-XPS	DUOTACK SPF HFO, ribbons 6" o.c.	Min. 0.25-inch SOPRABOARD, DensDeck Prime, DEXcell FA Glass Mat Roof Board or SECUROCK Gypsum-Fiber Roof Board or min. 7/16-inch DEXcell Cement Roof Board	DUOTACK SPF HFO, ribbons 6" o.c.	SBS-TAF	(Optional) SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-127.5
SELF-ADHERING BASE:												
S-13.	22 ga., Type B, Grade 40 steel	(Optional) Min. 0.5-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	DUOTACK 365, ribbons 6" o.c. (on each deck flange)	Min. 2-inch SOPRA-ISOs, SOPRA-ISO+s, SOPRA-ISOr, SOPRA-ISO+r or SOPRA-ISOx	TO DECK: DUOTACK 365, ribbons 6" o.c. (on each deck flange) TO THERMAL BARRIER: DUOTACK	Additional optional layer(s), min. 1.5-inch base insulation followed by min. 0.125-inch SOPRABOARD primed with Elastocol Stick Zero	DUOTACK	SBS-SA1	(Optional) SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-52.5
S-14.	22 ga., Type B, Grade 40 steel	(Optional) Min. 0.5-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	DUOTACK 365, ribbons 6" o.c. (on each deck flange)	Min. 2-inch SOPRA-ISOs, SOPRA-ISO+s, SOPRA-ISOr or SOPRA-ISO+r	TO DECK: DUOTACK 365, ribbons 6" o.c. (on each deck flange) TO THERMAL BARRIER: DUOTACK	Additional optional layer(s), min. 1.5-inch base insulation followed by min. 0.25-inch SOPRABOARD, DensDeck Prime, DEXcell FA Glass Mat Roof Board or SECUROCK Gypsum Fiber Roof Board primed with Elastocol Stick Zero	DUOTACK	SBS-SA1	(Optional) SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-82.5
S-15.	22 ga., Type B, Grade 40 steel	(Optional) Min. 0.5-inch DensDeck Prime, DEXcell FA Glass Mat Roof Board, SECUROCK Gypsum-Fiber Roof Board or SECUROCK Cement Roof Board or min. 7/16-inch DEXcell Cement Roof Board	DUOTACK SPF HFO, ribbons 12" o.c. (on every-other deck flange)	Min. 1.5-inch SOPRA-ISOs, SOPRA-ISO+R, SOPRA-ISO+x or SOPRA-XPS	DUOTACK SPF HFO	Min. 0.25-inch SOPRABOARD or DensDeck Prime. Top surface primed with ELASTOCOL Stick Zero.	DUOTACK SPF HFO	SBS-SA1	(Optional) SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-75.0

TABLE 2A: STEEL DECKS – NEW CONSTRUCTION OR REROOF (TEAR-OFF)
SYSTEM TYPE A-1: BONDED INSULATION, BONDED ROOF COVER
 REFER TO [NOTE 12](#) FOR THERMAL BARRIER / VAPOR BARRIER COMBINATION OPTIONS

System No.	Deck (Note 1)	Thermal Barrier		Base Insulation Layer		Top Insulation Layer		Roof Cover (Note 15)				MDP (psf)
		Type	Attach (Notes 6,7,8)	Type	Attach (Notes 6,7,8)	Type	Attach (Notes 6,7,8)	Base Ply	Ply	Primer	LARS	
S-16.	22 ga., Type B, Grade 40 steel	(Optional) Min. 0.5-inch DensDeck Prime, DEXcell FA Glass Mat Roof Board, SECUROCK Gypsum-Fiber Roof Board or SECUROCK Cement Roof Board or min. 7/16-inch DEXcell Cement Roof Board	DUOTACK SPF HFO, ribbons 12" o.c. (on every-other deck flange)	Min. 1.5-inch SOPRA-ISOs, SOPRA-ISO+R, SOPRA-ISO+x or SOPRA-XPS	DUOTACK SPF HFO	Min. 0.25-inch DEXcell FA Glass Mat Roof Board or SECUROCK Gypsum-Fiber Roof Board or min. 7/16-inch DEXcell Cement Roof Board. Top surface primed with ELASTOCOL Stick or ELASTOCOL Stick Zero.	DUOTACK SPF HFO	SBS-SA1	(Optional) SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-75.0
S-17.	22 ga., Type B, Grade 40 steel	(Optional) Min. 0.5-inch DensDeck Prime, DEXcell FA Glass Mat Roof Board, SECUROCK Gypsum-Fiber Roof Board or SECUROCK Cement Roof Board or min. 7/16-inch DEXcell Cement Roof Board	DUOTACK SPF HFO, ribbons 6" o.c. (on each deck flange)	Min. 1.5-inch SOPRA-ISOs, SOPRA-ISO+R, SOPRA-ISO+x or SOPRA-XPS	DUOTACK SPF HFO, ribbons 6" o.c.	Min. 0.25-inch SOPRABOARD or DensDeck Prime. Top surface primed with ELASTOCOL Stick Zero.	DUOTACK SPF HFO, ribbons 6" o.c.	SBS-SA1	SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-127.5
S-18.	22 ga., Type B, Grade 40 steel	(Optional) Min. 0.5-inch DensDeck Prime, DEXcell FA Glass Mat Roof Board, SECUROCK Gypsum-Fiber Roof Board or SECUROCK Cement Roof Board or min. 7/16-inch DEXcell Cement Roof Board	DUOTACK SPF HFO, ribbons 6" o.c. (on each deck flange)	Min. 1.5-inch SOPRA-ISOs, SOPRA-ISO+R, SOPRA-ISO+x or SOPRA-XPS	DUOTACK SPF HFO, ribbons 6" o.c.	Min. 0.25-inch DEXcell FA Glass Mat Roof Board or SECUROCK Gypsum-Fiber Roof Board or min. 7/16-inch DEXcell Cement Roof Board. Top surface primed with ELASTOCOL Stick or ELASTOCOL Stick Zero.	DUOTACK SPF HFO, ribbons 6" o.c.	SBS-SA1	SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-127.5

TABLE 2B: STEEL OR STRUCTURAL CONCRETE DECKS – NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE B-1: MECHANICALLY ATTACHED BASE INSULATION, BONDED TOP INSULATION, BONDED ROOF COVER

System No.	Deck (Note 1)	Base Insulation Layer			Top Insulation Layer		Roof Cover (Note 15)				MDP (psf)
		Type	Fasten	Attach	Type	Attach (Notes 6,7,8)	Base Ply	Ply	Primer	LARS	
No Base Ply:											
S-19.	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structrual concrete	Min. 2-inch SOPRA-ISOs or SOPRA-ISOr or min. 0.5-inch SECUROCK Cement Roof Board	Note 2	1 per 1.6 ft2	Min. 0.5-inch SECUROCK Cement Roof Board	DUOTACK	None	None	RS 276	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-82.5
S-20.	Min. 22 ga., type B, Grade 80 steel or min. 2,500 psi structrual concrete	Min. 2-inch SOPRA-ISOs or SOPRA-ISOr or min. 0.5-inch SECUROCK Cement Roof Board	Note 2	1 per 1.0 ft2	Min. 0.5-inch SECUROCK Cement Roof Board	DUOTACK, 6-inch o.c.	None	None	RS 276	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-127.5
COLD-APPLIED BASE:											
S-21.	Min. 22 ga. type B, Grade 33 steel or min. 2,500 psi structrual concrete	Min. 1.5-inch SOPRA-ISOs, SOPRA-ISO+s, SOPRA-ISOr or SOPRA-ISO+r	SOPREMA #15 HD with SOPREMA 3” Metal Insulation Plate	1 per 1.8 ft²	Additional layer(s) base insulation followed by min. 0.125-inch SOPRABOARD, optionally primed with DETEC “TruGround Conductive Primer”	DUOTACK	SBS-CA3	None	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-52.5
S-22.	Min. 22 ga. type B, Grade 33 steel or min. 2,500 psi structrual concrete	Min. 1.5-inch SOPRA-ISOs, SOPRA-ISO+s, SOPRA-ISOr or SOPRA-ISO+r	SOPREMA #15 HD with SOPREMA 3” Metal Insulation Plate	1 per 1.8 ft²	Additional layer(s) base insulation followed by SOPRASMART Board 180 Sanded	DUOTACK	(Optional) SBS-CA3	None	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-52.5
S-23.	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structrual concrete	Min 2-inch SOPRA-ISOs, SOPRA-ISOr, SOPRA-ISO+r, SOPRA-ISOx or SOPRA-ISO+x	SOPREMA #14 MP with SOPREMA 3” Metal Insulation Plate	1 per 1.6 ft²	Min. 0.25-inch SOPRABOARD primed with DETEC “TruGround Conductive Primer”	DUOTACK	SBS-CA3	None	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-82.5
S-24.	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structrual concrete	Min 2-inch SOPRA-ISOs, SOPRA-ISOr, SOPRA-ISO+r, SOPRA-ISOx or SOPRA-ISO+x	SOPREMA #14 MP with SOPREMA 3” Metal Insulation Plate	1 per 1.6 ft²	Min. 0.25-inch DensDeck Prime, DEXcell FA Glass Mat Roof Board or SECUROCK Gypsum Fiber Roof Board or min. 7/16-inch DEXcell Cement Roof Board	DUOTACK	SBS-CA3	None	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-82.5
S-25.	Min. 22 ga., type B, Grade 40 steel or min. 2,500 psi structrual concrete	Min 2-inch SOPRA-ISOr	SOPREMA #14 MP with SOPREMA 3” Metal Insulation Plate	1 per 1.0 ft²	Min. 0.25-inch SOPRABOARD, optionally primed with DETEC “TruGround Conductive Primer”	DUOTACK 365, 6-inch o.c.	SBS-CA3	None	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-135.0
S-26.	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structrual concrete	Min 1.5-inch SOPRA-ISOs, SOPRA-ISO+r or SOPRA-ISO+x	Soprema #14 MP with Soprema 3” Metal Insulation Plate	1 per 2.0 ft²	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum Fiber Roof Board or Min. 7/16-inch DEXcell Cement Roof Board	DUOTACK SPF HFO	SBS-CA3	None	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-45.0*
S-27.	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structrual concrete	Min 2-inch SOPRA-ISOs, SOPRA-ISO+r or SOPRA-ISO+x	Soprema #14 MP with Soprema 3” Metal Insulation Plate	1 per 4.0 ft²	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum Fiber Roof Board or Min. 7/16-inch DEXcell Cement Roof Board	DUOTACK SPF HFO	SBS-CA3	None	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-45.0*

TABLE 2B: STEEL OR STRUCTURAL CONCRETE DECKS – NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE B-1: MECHANICALLY ATTACHED BASE INSULATION, BONDED TOP INSULATION, BONDED ROOF COVER

System No.	Deck (Note 1)	Base Insulation Layer			Top Insulation Layer		Roof Cover (Note 15)				MDP (psf)
		Type	Fasten	Attach	Type	Attach (Notes 6,7,8)	Base Ply	Ply	Primer	LARS	
S-28.	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	Min 2-inch SOPRA-ISOs, SOPRA-ISO+r or SOPRA-ISO+x	Soprema #14 MP with Soprema 3" Metal Insulation Plate	1 per 1.6 ft ²	Min. 0.25-inch SOPRABOARD or DEXcell FA Glass Mat Roof Board	DUOTACK SPF HFO	SBS-CA3	None	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-75.0
S-29.	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	Min 2-inch SOPRA-ISOs, SOPRA-ISO+r or SOPRA-ISO+x	Soprema #14 MP with Soprema 3" Metal Insulation Plate	1 per 1.6 ft ²	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum Fiber Roof Board or Min. 7/16-inch DEXcell Cement Roof Board	DUOTACK SPF HFO	SBS-CA3	None	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-82.5
TORCH APPLIED BASE:											
S-30.	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	Min 1.5-inch SOPRA-ISOs or SOPRA-ISOr	SOPREMA #14 MP with SOPREMA 3" Metal Insulation Plate	1 per 2.0 ft ²	Min. 0.125-inch SOPRABOARD	DUOTACK	SBS-TAP, SBS-TAF	(Optional) SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-45.0*
S-31.	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	Min 1.5-inch SOPRA-ISOs or SOPRA-ISOr	SOPREMA #14 MP with SOPREMA 3" Metal Insulation Plate	1 per 2.0 ft ²	SOPRASMART Board 180 (for TA Base Ply) or SOPRASMART Board 180 Sanded (for no Base Ply)	DUOTACK	(Optional) SBS-TAP, SBS-TAF	None	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-45.0*
S-32.	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	Min 1.5-inch SOPRA-ISOs or SOPRA-ISOr	SOPREMA #14 MP with SOPREMA 3" Metal Insulation Plate	1 per 2.0 ft ²	Min. 0.25-inch DensDeck Prime, DEXcell FA Gypsum Fiber Roof Board or min. 7/16-inch DEXcell Cement Roof Board	DUOTACK	SBS-TAP, SBS-TAF	(Optional) SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-45.0*
S-33.	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	Min 2-inch SOPRA-ISOs or SOPRA-ISOr	SOPREMA #14 MP with SOPREMA 3" Metal Insulation Plate	1 per 4.0 ft ²	Min. 0.125-inch SOPRABOARD	DUOTACK	SBS-TAP, SBS-TAF	(Optional) SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-45.0*
S-34.	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	Min 2-inch SOPRA-ISOs or SOPRA-ISOr	SOPREMA #14 MP with SOPREMA 3" Metal Insulation Plate	1 per 4.0 ft ²	SOPRASMART Board 180 (for TA Base Ply) or SOPRASMART Board 180 Sanded (for no Base Ply)	DUOTACK	(Optional) SBS-TAP, SBS-TAF	None	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-45.0*
S-35.	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	Min 2-inch SOPRA-ISOs or SOPRA-ISOr	SOPREMA #14 MP with SOPREMA 3" Metal Insulation Plate	1 per 4.0 ft ²	Min. 0.25-inch DensDeck Prime, DEXcell FA Glass Mat Roof Board or SECUROCK Gypsum Fiber Roof Board or min. 7/16-inch DEXcell Cement Roof Board	DUOTACK	SBS-TAP, SBS-TAF	(Optional) SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-45.0*
S-36.	Min. 22 ga., type B, Grade 33 steel	Min. 0.5-inch DEXcell FA Glass Mat Roof Board	SOPREMA #14 MP with SOPREMA 3" Metal Insulation Plate	1 per 4.0 ft ²	Min. 1-inch SOPRA-ISOs or SOPRA-ISOr; followed by min. 0.125-inch SOPRABOARD	DUOTACK	SBS-TAF	(Optional) SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-45.0*

TABLE 2B: STEEL OR STRUCTURAL CONCRETE DECKS – NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE B-1: MECHANICALLY ATTACHED BASE INSULATION, BONDED TOP INSULATION, BONDED ROOF COVER

System No.	Deck (Note 1)	Base Insulation Layer			Top Insulation Layer		Roof Cover (Note 15)				MDP (psf)
		Type	Fasten	Attach	Type	Attach (Notes 6,7,8)	Base Ply	Ply	Primer	LARS	
S-37.	Min. 22 ga., type B, Grade 33 steel	Min. 0.5-inch DEXcell FA Glass Mat Roof Board	SOPREMA #14 MP with SOPREMA 3" Metal Insulation Plate	1 per 4.0 ft ²	Min. 1-inch SOPRA-ISOs or SOPRA-ISOR; followed by SOPRASMART Board 180 (for TA Base Ply) or SOPRASMART Board 180 Sanded (for no Base Ply)	DUOTACK	(Optional) SBS-TAP, SBS-TAF	None	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-45.0*
S-38.	Min. 22 ga., type B, Grade 33 steel	Min. 0.5-inch DEXcell FA Glass Mat Roof Board	SOPREMA #14 MP with SOPREMA 3" Metal Insulation Plate	1 per 4.0 ft ²	Min. 1-inch SOPRA-ISOs or SOPRA-ISOR; followed by min. 0.25-inch DensDeck Prime, DEXcell FA Glass Mat Roof Board or SECUROCK Gypsum Fiber Roof Board or min. 7/16-inch DEXcell Cement Roof Board	DUOTACK	SBS-TAF	(Optional) SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-45.0*
S-39.	Min. 22 ga. type B, Grade 33 steel or min. 2,500 psi structural concrete	Min. 1.5-inch SOPRA-ISOs, SOPRA-ISO+s, SOPRA-ISOR or SOPRA-ISO+r	SOPREMA #15 HD with SOPREMA 3" Metal Insulation Plate	1 per 1.8 ft ²	Additional layer(s) base insulation followed by min. 0.125-inch SOPRABOARD	DUOTACK	SBS-TAF	(Optional) SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-52.5
S-40.	Min. 22 ga. type B, Grade 33 steel or min. 2,500 psi structural concrete	Min. 1.5-inch SOPRA-ISOs, SOPRA-ISO+s, SOPRA-ISOR or SOPRA-ISO+r	SOPREMA #15 HD with SOPREMA 3" Metal Insulation Plate	1 per 1.8 ft ²	Additional layer(s) base insulation followed by SOPRASMART Board 180 (for TA Base Ply) or SOPRASMART Board 180 Sanded (for no Base Ply)	DUOTACK	(Optional) SBS-TAF	None	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-52.5
S-41.	Min. 22 ga. type B, Grade 33 steel or min. 2,500 psi structural concrete	Min. 2-inch SOPRA-ISOs or ENRGY 3	Note 2	1 per 2.0 ft ²	Min. 0.375-inch SECUROCK Gypsum-Fiber Roof Board	DUOTACK	SBS-TAP, SBS-TAF	(Optional) SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-60.0
S-42.	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	Min 2-inch SOPRA-ISOs, SOPRA-ISOR, SOPRA-ISO+r, SOPRA-ISOx or SOPRA-ISO+x	SOPREMA #14 MP with SOPREMA 3" Metal Insulation Plate	1 per 1.6 ft ²	Min. 0.25-inch SOPRABOARD	DUOTACK	SBS-TAF	(Optional) SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-82.5
S-43.	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	Min 2-inch SOPRA-ISOs, SOPRA-ISOR, SOPRA-ISO+r, SOPRA-ISOx or SOPRA-ISO+x	SOPREMA #14 MP with SOPREMA 3" Metal Insulation Plate	1 per 1.6 ft ²	Min. 0.25-inch DensDeck Prime, DEXcell FA Glass Mat Roof Board or SECUROCK Gypsum Fiber Roof Board or min. 7/16-inch DEXcell Cement Roof Board	DUOTACK	SBS-TAF	(Optional) SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-82.5
S-44.	Min. 22 ga., type B, Grade 40 steel or min. 2,500 psi structural concrete	Min 2-inch SOPRA-ISOR	SOPREMA #14 MP with SOPREMA 3" Metal Insulation Plate	1 per 1.0 ft ²	Min. 0.25-inch SOPRABOARD	DUOTACK 365, 6-inch o.c.	SBS-TAF	(Optional) SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-135.0
S-45.	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	Min 1.5-inch SOPRA-ISOs, SOPRA-ISO+r or SOPRA-ISO+x	Soprema #14 MP with Soprema 3" Metal Insulation Plate	1 per 2.0 ft ²	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum Fiber Roof Board or Min. 7/16-inch DEXcell Cement Roof Board	DUOTACK SPF HFO	SBS-TAP, SBS-TAF	(Optional) SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-45.0*

TABLE 2B: STEEL OR STRUCTURAL CONCRETE DECKS – NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE B-1: MECHANICALLY ATTACHED BASE INSULATION, BONDED TOP INSULATION, BONDED ROOF COVER

System No.	Deck (Note 1)	Base Insulation Layer			Top Insulation Layer		Roof Cover (Note 15)				MDP (psf)
		Type	Fasten	Attach	Type	Attach (Notes 6,7,8)	Base Ply	Ply	Primer	LARS	
S-46.	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	Min 2-inch SOPRA-ISOs, SOPRA-ISO+r or SOPRA-ISO+x	Soprema #14 MP with Soprema 3" Metal Insulation Plate	1 per 4.0 ft ²	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum Fiber Roof Board or Min. 7/16-inch DEXcell Cement Roof Board	DUOTACK SPF HFO	SBS-TAP, SBS-TAF	(Optional) SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-45.0*
S-47.	Min. 22 ga. type B, Grade 33 steel or min. 2,500 psi structural concrete	Min. 2-inch SOPRA-ISOs	Note 2	1 per 2.0 ft ²	Min. 0.375-inch SECUROCK Gypsum-Fiber Roof Board	DUOTACK SPF HFO	SBS-TAP, SBS-TAF	(Optional) SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-60.0
S-48.	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	Min 2-inch SOPRA-ISOs, SOPRA-ISO+r or SOPRA-ISO+x	Soprema #14 MP with Soprema 3" Metal Insulation Plate	1 per 1.6 ft ²	Min. 0.25-inch SOPRABOARD or DEXcell FA Glass Mat Roof Board	DUOTACK SPF HFO	SBS-TAF	(Optional) SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-75.0
S-49.	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	Min 2-inch SOPRA-ISOs, SOPRA-ISO+r or SOPRA-ISO+x	Soprema #14 MP with Soprema 3" Metal Insulation Plate	1 per 1.6 ft ²	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum Fiber Roof Board or Min. 7/16-inch DEXcell Cement Roof Board	DUOTACK SPF HFO	SBS-TAF	(Optional) SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-82.5
S-50.	Min. 22 ga., Type B, Grade 40 steel; 6 ft span or min. 2,500 psi structural concrete	Min. 2-inch SOPRA-ISOs	Soprema #14 MP or #15 HD with Soprema 3" Metal Insulation Plate	1 per 1.0 ft ²	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	DUOTACK SPF HFO	SBS-TAF	(Optional) SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-105.0
S-51.	Min. 22 ga., Type B, Grade 40 steel; 6 ft span or min. 2,500 psi structural concrete	Min. 2-inch SOPRA-ISOs	Soprema #14 MP or #15 HD with Soprema 3" Metal Insulation Plate	1 per 1.0 ft ²	Min. 0.25-inch SOPRABOARD, DEXcell FA Glass Mat Roof Board or min. 7/16-inch DEXcell Cement Roof Board	DUOTACK SPF HFO, 6" o.c.	SBS-TAF	(Optional) SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-105.0
SELF-ADHERING BASE:											
S-52.	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	Min 1.5-inch SOPRA-ISOs or SOPRA-ISOr	SOPREMA #14 MP with SOPREMA 3" Metal Insulation Plate	1 per 2.0 ft ²	Min. 0.125-inch SOPRABOARD primed with Elastocol Stick Zero	DUOTACK	SBS-SA1	(Optional) SBS-SA1 or SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-45.0*
S-53.	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	Min 1.5-inch SOPRA-ISOs or SOPRA-ISOr	SOPREMA #14 MP with SOPREMA 3" Metal Insulation Plate	1 per 2.0 ft ²	Min. 0.25-inch DensDeck Prime, DEXcell FA Glass Mat Roof Board or SECUROCK Gypsum Fiber Roof Board or min. 7/16-inch DEXcell Cement Roof Board. Top surface primed with Elastocol Stick or Elastocol Stick Zero.	DUOTACK	SBS-SA1	(Optional) SBS-SA1 or SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-45.0*

TABLE 2B: STEEL OR STRUCTURAL CONCRETE DECKS – NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE B-1: MECHANICALLY ATTACHED BASE INSULATION, BONDED TOP INSULATION, BONDED ROOF COVER

System No.	Deck (Note 1)	Base Insulation Layer			Top Insulation Layer		Roof Cover (Note 15)				MDP (psf)
		Type	Fasten	Attach	Type	Attach (Notes 6,7,8)	Base Ply	Ply	Primer	LARS	
S-54.	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	Min 2-inch SOPRA-ISOrs or SOPRA-ISOr	SOPREMA #14 MP with SOPREMA 3" Metal Insulation Plate	1 per 4.0 ft ²	Min. 0.125-inch SOPRABOARD primed with Elastocol Stick Zero	DUOTACK	SBS-SA1	(Optional) SBS-SA1 or SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-45.0*
S-55.	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	Min 2-inch SOPRA-ISOrs or SOPRA-ISOr	SOPREMA #14 MP with SOPREMA 3" Metal Insulation Plate	1 per 4.0 ft ²	Min. 0.25-inch DensDeck Prime, DEXcell FA Glass Mat Roof Board or SECURROCK Gypsum Fiber Roof Board or min. 7/16-inch DEXcell Cement Roof Board. Top surface primed with Elastocol Stick or Elastocol Stick Zero	DUOTACK	SBS-SA1	(Optional) SBS-SA1 or SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-45.0*
S-56.	Min. 22 ga., type B, Grade 33 steel	Min. 0.5-inch DEXcell FA Glass Mat Roof Board	SOPREMA #14 MP with SOPREMA 3" Metal Insulation Plate	1 per 4.0 ft ²	Min. 1-inch SOPRA-ISOrs or SOPRA-ISOr; followed by Min. 0.125-inch SOPRABOARD primed with Elastocol Stick Zero	DUOTACK	SBS-SA1	(Optional) SBS-SA1 or SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-45.0*
S-57.	Min. 22 ga., type B, Grade 33 steel	Min. 0.5-inch DEXcell FA Glass Mat Roof Board	SOPREMA #14 MP with SOPREMA 3" Metal Insulation Plate	1 per 4.0 ft ²	Min. 1-inch SOPRA-ISOrs or SOPRA-ISOr; followed by min. 0.25-inch DensDeck Prime, DEXcell FA Glass Mat Roof Board or SECURROCK Gypsum Fiber Roof Board or min. 7/16-inch DEXcell Cement Roof Board. Top surface primed with Elastocol Stick or Elastocol Stick Zero	DUOTACK	SBS-SA1	(Optional) SBS-SA1 or SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-45.0*
S-58.	Min. 22 ga. type B, Grade 33 steel or min. 2,500 psi structural concrete	Min. 1.5-inch SOPRA-ISOrs, SOPRA-ISOr+, SOPRA-ISOr or SOPRA-ISOr+	SOPREMA #15 HD with SOPREMA 3" Metal Insulation Plate	1 per 1.8 ft ²	Min. 0.125-inch SOPRABOARD; primed with Elastocol Stick Zero	DUOTACK	SBS-SA1	(Optional) SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-52.5
S-59.	Min. 22 ga. type B, Grade 33 steel or min. 2,500 psi structural concrete	Min. 2-inch SOPRA-ISOrs or ENRGY 3	Note 2	1 per 2.0 ft ²	Min. 0.375-inch SECURROCK Gypsum-Fiber Roof Board primed with Elastocol Stick or Elastocol Stick Zero.	DUOTACK	SBS-SA1	(Optional) SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-60.0
S-60.	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	Min 2-inch SOPRA-ISOrs, SOPRA-ISOr, SOPRA-ISOr+, SOPRA-ISOrx or SOPRA-ISOrx	SOPREMA #14 MP with SOPREMA 3" Metal Insulation Plate	1 per 1.6 ft ²	Min. 0.25-inch SOPRABOARD primed with Elastocol Stick Zero	DUOTACK	SBS-SA1	(Optional) SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-82.5
S-61.	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	Min 2-inch SOPRA-ISOrs, SOPRA-ISOr, SOPRA-ISOr+, SOPRA-ISOrx or SOPRA-ISOrx	SOPREMA #14 MP with SOPREMA 3" Metal Insulation Plate	1 per 1.6 ft ²	Min. 0.25-inch DensDeck Prime, DEXcell FA Glass Mat Roof Board or SECURROCK Gypsum Fiber Roof Board or min. 7/16-inch DEXcell Cement Roof Board. Top surface primed with Elastocol Stick or Elastocol Stick Zero.	DUOTACK	SBS-SA1	(Optional) SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-82.5

TABLE 2B: STEEL OR STRUCTURAL CONCRETE DECKS – NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE B-1: MECHANICALLY ATTACHED BASE INSULATION, BONDED TOP INSULATION, BONDED ROOF COVER

System No.	Deck (Note 1)	Base Insulation Layer			Top Insulation Layer		Roof Cover (Note 15)				MDP (psf)
		Type	Fasten	Attach	Type	Attach (Notes 6,7,8)	Base Ply	Ply	Primer	LARS	
S-62.	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	Min 1.5-inch SOPRA-ISOs, SOPRA-ISO+r or SOPRA-ISO+x	Soprema #14 MP with Soprema 3" Metal Insulation Plate	1 per 2.0 ft ²	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum Fiber Roof Board or Min. 7/16-inch DEXcell Cement Roof Board. Top surface primed with ELASTOCOL Stick or ELASTOCOL Stick Zero.	DUOTACK SPF HFO	SBS-SA1	(Optional) SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-45.0*
S-63.	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	Min 2-inch SOPRA-ISOs, SOPRA-ISO+r or SOPRA-ISO+x	Soprema #14 MP with Soprema 3" Metal Insulation Plate	1 per 4.0 ft ²	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum Fiber Roof Board or Min. 7/16-inch DEXcell Cement Roof Board. Top surface primed with ELASTOCOL Stick or ELASTOCOL Stick Zero.	DUOTACK SPF HFO	SBS-SA1	(Optional) SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-45.0*
S-64.	Min. 22 ga. type B, Grade 33 steel or min. 2,500 psi structural concrete	Min. 2-inch SOPRA-ISOs	Note 2	1 per 2.0 ft ²	Min. 0.375-inch SECUROCK Gypsum-Fiber Roof Board primed with ELASTOCOL Stick or ELASTOCOL Stick Zero.	DUOTACK SPF HFO	SBS-SA1	(Optional) SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-60.0
S-65.	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	Min 2-inch SOPRA-ISOs, SOPRA-ISO+r or SOPRA-ISO+x	Soprema #14 MP with Soprema 3" Metal Insulation Plate	1 per 1.6 ft ²	Min. 0.25-inch SOPRABOARD. Top surface primed with ELASTOCOL Stick Zero.	DUOTACK SPF HFO	SBS-SA1	(Optional) SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-75.0
S-66.	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	Min 2-inch SOPRA-ISOs, SOPRA-ISO+r or SOPRA-ISO+x	Soprema #14 MP with Soprema 3" Metal Insulation Plate	1 per 1.6 ft ²	Min. 0.25-inch DEXcell FA Glass Mat Roof Board. Top surface primed with ELASTOCOL Stick or ELASTOCOL Stick Zero.	DUOTACK SPF HFO	SBS-SA1	(Optional) SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-75.0
S-67.	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	Min 2-inch SOPRA-ISOs, SOPRA-ISO+r or SOPRA-ISO+x	Soprema #14 MP with Soprema 3" Metal Insulation Plate	1 per 1.6 ft ²	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum Fiber Roof Board or Min. 7/16-inch DEXcell Cement Roof Board. Top surface primed with ELASTOCOL Stick or ELASTOCOL Stick Zero.	DUOTACK SPF HFO	SBS-SA1	(Optional) SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-82.5
S-68.	Min. 22 ga., Type B, Grade 40 steel; 6 ft span or min. 2,500 psi structural concrete	Min. 2-inch SOPRA-ISOs	Soprema #14 MP or #15 HD with Soprema 3" Metal Insulation Plate	1 per 1.0 ft ²	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board. Top surface primed with ELASTOCOL Stick or ELASTOCOL Stick Zero.	DUOTACK SPF HFO	SBS-SA1	SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-105.0
S-69.	Min. 22 ga., Type B, Grade 40 steel; 6 ft span or min. 2,500 psi structural concrete	Min. 2-inch SOPRA-ISOs	Soprema #14 MP or #15 HD with Soprema 3" Metal Insulation Plate	1 per 1.0 ft ²	Min. 0.25-inch SOPRABOARD. Top surface primed with ELASTOCOL Stick Zero.	DUOTACK SPF HFO, 6" o.c.	SBS-SA1	SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-105.0

TABLE 2B: STEEL OR STRUCTURAL CONCRETE DECKS – NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE B-1: MECHANICALLY ATTACHED BASE INSULATION, BONDED TOP INSULATION, BONDED ROOF COVER

System No.	Deck (Note 1)	Base Insulation Layer			Top Insulation Layer		Roof Cover (Note 15)				MDP (psf)
		Type	Fasten	Attach	Type	Attach (Notes 6,7,8)	Base Ply	Ply	Primer	LARS	
S-70.	Min. 22 ga., Type B, Grade 40 steel; 6 ft span or min. 2,500 psi structural concrete	Min. 2-inch SOPRA-ISOs	Soprema #14 MP or #15 HD with Soprema 3" Metal Insulation Plate	1 per 1.0 ft ²	Min. 0.25-inch DEXcell FA Glass Mat Roof Board or min. 7/16-inch DEXcell Cement Roof Board. Top surface primed with ELASTOCOL Stick or ELASTOCOL Stick Zero.	DUOTACK SPF HFO, 6" o.c.	SBS-SA1	SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-105.0

TABLE 2C: STEEL OR STRUCTURAL CONCRETE DECKS – NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE C-1: MECHANICALLY ATTACHED INSULATION, BONDED ROOF COVER

System No.	Deck (Note 1 & 12)	Base Insulation Layer	Top Insulation Layer			Roof Cover (Note 15)				MDP (psf)
			Type	Fasten	Attach	Base Ply	Ply	Primer	LARS	
No BASE PLY:										
S-71.	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structrual concrete	One or more layers, any combination, loose laid	Min. 7/16-inch DEXcell Cement Roof Board	Note 2	1 per 2.0 ft²	None	None	RS 276	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-45.0*
S-72.	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structrual concrete	One or more layers, any combination, loose laid	Min. 0.5-inch SECUROCK Cement Roof Board	Note 2	1 per 1.0 ft²	None	None	RS 276	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-82.5
S-73.	Min. 22 ga., type B, Grade 80 steel or min. 2,500 psi structrual concrete	One or more layers, any combination, loose laid	Min. 0.5-inch SECUROCK Cement Roof Board	Note 2	1 per 1.0 ft²	None	None	RS 276	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-150.0
COLD-APPLIED BASE:										
S-74.	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	One or more layers, min. 1.5-inch, any combination, loose laid	Min. 0.25-inch DEXcell FA Glass Mat Roof Board or min. 7/16-inch DEXcell Cement Roof Board	SOPREMA #14 MP with SOPREMA 3” Metal Insulation Plate	1 per 4.0 ft²	SBS-CA3	None	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-45.0*
S-75.	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	One or more layers, min. 1.5-inch, any combination, loose laid	Min. 0.25-inch DensDeck Prime	SOPREMA #14 MP with SOPREMA 3” Metal Insulation Plate	1 per 1.8 ft²	SBS-CA3	None	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-52.5
S-76.	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	One or more layers, min. 1.5-inch, any combination, loose laid	Min. 0.5-inch DensDeck Prime	SOPREMA #14 MP with SOPREMA 3” Metal Insulation Plate	1 per 1.8 ft²	SBS-CA3	None	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-67.5
S-77.	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	One or more layers, min. 1.5-inch, any combination, loose laid	Min. 0.5-inch DensDeck Prime	SOPREMA #14 MP with SOPREMA 3” Metal Insulation Plate	1 per 1.6 ft²	SBS-CA3	None	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-75.0
S-78.	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	One or more layers, min. 1.5-inch, any combination, loose laid	Min. 0.5-inch DensDeck Prime	Note 2	1 per 1.0 ft²	SBS-CA3	None	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-82.5

TABLE 2c: STEEL OR STRUCTURAL CONCRETE DECKS – NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE C-1: MECHANICALLY ATTACHED INSULATION, BONDED ROOF COVER

System No.	Deck (Note 1 & 12)	Base Insulation Layer	Top Insulation Layer			Roof Cover (Note 15)				MDP (psf)
			Type	Fasten	Attach	Base Ply	Ply	Primer	LARS	
S-79.	Min. 22 ga., type B, Grade 80 steel or min. 2,500 psi structural concrete	One or more layers, min. 1.5-inch, any combination, loose laid	Min. 0.5-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	SOPREMA #14 MP with SOPREMA 3" Metal Insulation Plate	1 per 1.3 ft ²	SBS-CA3	None	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-90.0
S-80.	Min. 22 ga., type B, Grade 80 steel or min. 2,500 psi structural concrete	One or more layers, min. 1.5-inch, any combination, loose laid	Min. 0.5-inch DensDeck Prime	Note 2	1 per 1.0 ft ²	SBS-CA3	None	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-127.5
TORCH APPLIED BASE:										
S-81.	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	One or more layers, min. 1.5-inch, any combination, loose laid	Min. 0.25-inch DEXcell FA Glass Mat Roof Board or min. 7/16-inch DEXcell Cement Roof Board	SOPREMA #14 MP with SOPREMA 3" Metal Insulation Plate	1 per 4.0 ft ²	SBS-TAF	(Optional) SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-45.0*
S-82.	Min. 22 ga., type B, Grade 33 steel	One or more layers, min. 1.5-inch, any combination, loose laid	Min. 0.5-inch DensDeck Prime	Note 2	1 per 4.0 ft ²	SBS-TAF	(Optional) SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-45.0*
S-83.	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	(Optional) One or more layers, any combination, loose laid	Min. 0.25-inch DensDeck Prime	OMG HD with 3 in. Galvalume Steel Plate	1 per 4.0 ft ²	SBS-TAF	(Optional) SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-45.0*
S-84.	Min. 22 ga. type B, Grade 33 steel or min. 2,500 psi structural concrete	(Optional) One or more layers, any combination, loose laid	Min. 0.25-inch DensDeck primed with Elastocol Stick	Note 2	1 per 2.0 ft ²	SBS-TAP, SBS-TAF	(Optional) SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-45.0*
S-85.	Min. 22 ga. type B, Grade 33 steel or min. 2,500 psi structural concrete	(Optional) One or more layers, any combination, loose laid	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	Note 2	1 per 4.0 ft ²	SBS-TAF	(Optional) SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-45.0*
S-86.	Min. 22 ga. type B, Grade 33 steel or min. 2,500 psi structural concrete	(Optional) One or more layers, any combination, loose laid	Min 0.375-inch SECUROCK Gypsum-Fiber Roof Board	Note 2	1 per 2.7 ft ²	SBS-TAP, SBS-TAF	(Optional) SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-45.0*
S-87.	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	(Optional) One or more layers, any combination, loose laid	Min. 0.125-inch SOPRABOARD	Note 2	1 per 4.0 ft ²	SBS-TAF	(Optional) SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-45.0*
S-88.	Min. 22 ga. type B, Grade 33 steel or min. 2,500 psi structural concrete	(Optional) One or more layers, any combination, loose laid	Min. 0.125-inch SOPRABOARD	Note 2	1 per 2.0 ft ²	SBS-TAP, SBS-TAF	(Optional) SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-45.0*
S-89.	Min. 22 ga. type B, Grade 33 steel or min. 2,500 psi structural concrete	(Optional for recover) One or more layers, any combination, loose laid	Min. 0.25-inch DEXcell FA Glass Mat Roof Board	SOPREMA #14 MP with SOPREMA 3" Metal Insulation Plate	1 per 2.0 ft ²	SBS-TAF	(Optional) SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-45.0*
S-90.	Min. 22 ga. type B, Grade 33 steel or min. 2,500 psi structural concrete	(Optional for recover) One or more layers, any combination, loose laid	Min. 0.25-inch DEXcell FA Glass Mat Roof Board	SOPREMA #14 MP with SOPREMA 3" Metal Insulation Plate	1 per 1.8 ft ²	SBS-TAF	(Optional) SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-45.0
S-91.	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	One or more layers, min. 1.5-inch, any combination, loose laid	Min. 0.5-inch SECUROCK Gypsum-Fiber Roof Board	Note 2	1 per 1.8 ft ²	SBS-TAF	(Optional) SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-52.5

TABLE 2c: STEEL OR STRUCTURAL CONCRETE DECKS – NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE C-1: MECHANICALLY ATTACHED INSULATION, BONDED ROOF COVER

System No.	Deck (Note 1 & 12)	Base Insulation Layer	Top Insulation Layer			Roof Cover (Note 15)				MDP (psf)
			Type	Fasten	Attach	Base Ply	Ply	Primer	LARS	
S-92.	Min. 22 ga., type B, Grade 80 steel or min. 2,500 psi structural concrete	One or more layers, min. 1.4-inch, any combination, loose laid	Min. 0.25-inch DensDeck or DensDeck Prime	OMG #14 Roofgrip with Flat Bottom Plate (Accutrac)	1 per 1.8 ft ²	SBS-TAF	(Optional) SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-60.0
S-93.	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	One or more layers, any combination, loose laid	Min. 0.125-inch SOPRABOARD	Note 2	1 per 2.0 ft ²	SBS-TAF	(Optional) SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-60.0
S-94.	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	One or more layers, min. 1.5-inch, any combination, loose laid	Min. 0.5-inch DensDeck Prime	SOPREMA #14 MP with SOPREMA 3" Metal Insulation Plate	1 per 1.8 ft ²	SBS-TAF	(Optional) SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-67.5
S-95.	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	One or more layers, min. 1.5-inch, any combination, loose laid	Min. 0.5-inch SECUROCK Gypsum-Fiber Roof Board	SOPREMA #14 MP with SOPREMA 3" Metal Insulation Plate	1 per 1.3 ft ²	SBS-TAF (D6164 only)	(Optional) SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-67.5
S-96.	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	One or more layers, any combination, loose laid	Min. 0.125-inch SOPRABOARD	Note 2	1 per 2.0 ft ²	SBS-TAF (D6164 only)	(Optional) SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-67.5
S-97.	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	One or more layers, min. 1.5-inch, any combination, loose laid	Min. 0.5-inch DensDeck Prime	SOPREMA #14 MP with SOPREMA 3" Metal Insulation Plate	1 per 1.6 ft ²	SBS-TAF	(Optional) SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-75.0
S-98.	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	One or more layers, min. 1.5-inch, any combination, loose laid	Min. 0.375-inch SECUROCK Gypsum-Fiber Roof Board	SOPREMA #14 MP with SOPREMA 3" Metal Insulation Plate	1 per 1.3 ft ²	SBS-TAF (D6164 only)	(Optional) SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-75.0
S-99.	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	One or more layers, min. 1.5-inch, any combination, loose laid	Min. 0.5-inch DensDeck Prime	Note 2	1 per 1.0 ft ²	SBS-TAF	(Optional) SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-82.5
S-100.	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	One or more layers, any combination, loose laid	Min. 0.5-inch SECUROCK Cement Roof Board primed with Elastocol 500	Note 2	1 per 1.0 ft ²	SBS-TAF	(Optional) SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-82.5
S-101.	Min. 22 ga., type B, Grade 80 steel or min. 2,500 psi structural concrete	One or more layers, min. 1.5-inch, any combination, loose laid	Min. 0.5-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	SOPREMA #14 MP with SOPREMA 3" Metal Insulation Plate	1 per 1.3 ft ²	SBS-TAF	(Optional) SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-90.0
S-102.	Min. 22 ga., type B, Grade 80 steel or min. 2,500 psi structural concrete	One or more layers, min. 1.5-inch, any combination, loose laid	Min. 0.5-inch DensDeck Prime	Note 2	1 per 1.0 ft ²	SBS-TAF	(Optional) SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-127.5
S-103.	Min. 22 ga., type B, Grade 80 steel or min. 2,500 psi structural concrete	One or more layers, any combination, loose laid	Min. 0.5-inch SECUROCK Cement Roof Board primed with Elastocol 500	Note 2	1 per 1.0 ft ²	SBS-TAF	(Optional) SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-150.0
S-104.	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	One or more layers, min. 1.5-inch, any combination, loose laid	Min. 0.5-inch SECUROCK Gypsum-Fiber Roof Board	SOPREMA #14 MP with SOPREMA 3" Metal Insulation Plate	1 per 1.3 ft ²	SBS-TAF	(Optional) SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-157.5

TABLE 2c: STEEL OR STRUCTURAL CONCRETE DECKS – NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE C-1: MECHANICALLY ATTACHED INSULATION, BONDED ROOF COVER

System No.	Deck (Note 1 & 12)	Base Insulation Layer	Top Insulation Layer			Roof Cover (Note 15)				MDP (psf)
			Type	Fasten	Attach	Base Ply	Ply	Primer	LARS	
S-105.	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	One or more layers, min. 1.5-inch, any combination, loose laid	Min. 0.5-inch SECUROCK Gypsum-Fiber Roof Board	SOPREMA #14 MP with SOPREMA 3" Metal Insulation Plate	1 per 1.0 ft ²	SBS-TAF	(Optional) SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-172.5
SELF-ADHERING BASE:										
S-106.	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	One or more layers, min. 1.5-inch, any combination, loose laid	Min. 0.25-inch DEXcell FA Glass Mat Roof Board or min. 7/16-inch DEXcell Cement Roof Board primed with Elastocol Stick or Elastocol Stick Zero	SOPREMA #14 MP with SOPREMA 3" Metal Insulation Plate	1 per 4.0 ft ²	SBS-SA1	(Optional) SBS-SA1 or SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-45.0*
S-107.	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	(Optional for recover) One or more layers, any combination, loose laid	Min. 0.5-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board primed with Elastocol Stick or Elastocol Stick Zero	SOPREMA #14 MP with SOPREMA 3" Metal Insulation Plate	1 per 4.0 ft ²	SBS-SA1	(Optional) SBS-SA1 or SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-45.0*
S-108.	Min. 22 ga. type B, Grade 33 steel or min. 2,500 psi structural concrete	(Optional) One or more layers, any combination, loose laid	Min 0.375-inch SECUROCK Gypsum-Fiber Roof Board primed with D41, Elastocol Stick or Elastocol Stick Zero	Note 2	1 per 2.7 ft ²	SBS-SA1	(Optional) SBS-SA1 or SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-45.0*
S-109.	Min. 22 ga. type B, Grade 33 steel or min. 2,500 psi structural concrete	(Optional) One or more layers, any combination, loose laid	Min. 1.5-inch SOPRA-ISO+s, SOPRA-ISO+r or SOPRA-ISO+x	Note 2	1 per 2.0 ft ²	SBS-SA1	(Optional) SBS-SA1 or SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-45.0*
S-110.	Min. 22 ga. type B, Grade 33 steel or min. 2,500 psi structural concrete	(Optional) One or more layers, any combination, loose laid	Min. 1.5-inch SOPRA-ISOs or SOPRA-ISOr <i>mist-primed with Elastocol 500, Elastocol Stick, Elastocol Stick Zero</i>	Note 2	1 per 2.0 ft ²	SBS-SA1	(Optional) SBS-SA1 or SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-45.0*
S-111.	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	(Optional) One or more layers, any combination, loose laid	Min. 0.25-inch DensDeck primed with D41 primer, Elastocol Stick or Elastocol Stick Zero or DensDeck Prime	Note 2	1 per 2.0 ft ²	SBS-SA1	(Optional) SBS-SA1 or SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-45.0*
S-112.	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	(Optional) One or more layers, any combination, loose laid	Min. 0.125-inch SOPRABOARD primed with Elastocol 500, Elastocol Stick or Elastocol Stick Zero	Note 2	1 per 2.0 ft ²	SBS-SA1	(Optional) SBS-SA1 or SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-45.0*
S-113.	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	(Optional for recover) One or more layers, any combination, loose laid	Min. 0.25-inch DEXcell FA Glass Mat Roof Board primed with Elastocol Stick or Elastocol Stick Zero	SOPREMA #14 MP with SOPREMA 3" Metal Insulation Plate	1 per 1.8 ft ²	SBS-SA1	(Optional) SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-45.0
S-114.	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	One or more layers, min. 1.4-inch, any combination, loose laid	Min. 0.25-inch DensDeck Prime	SOPREMA #14 MP with SOPREMA 3" Metal Insulation Plate	1 per 1.8 ft ²	SBS-SA1	(Optional) SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-52.5
S-115.	Min. 22 ga., type B, Grade 80 steel or min. 2,500 psi structural concrete	One or more layers, min. 1.4-inch, any combination, loose laid	Min. 0.25-inch DensDeck primed with D41 primer, Elastocol Stick or Elastocol Stick Zero or DensDeck Prime	OMG #14 Roofgrip with Flat Bottom Plate (Accutrac)	1 per 1.8 ft ²	SBS-SA1	(Optional) SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-60.0

TABLE 2d: STEEL DECKS OR STRUCTURAL CONCRETE DECKS – NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE D-1: INSULATED, MECHANICALLY ATTACHED BASE SHEET, BONDED ROOF COVER

System No.	Deck (Note 1)	Insulation	Base Sheet			Roof Cover (Note 15)			MDP (psf)
			Base	Fastener (Note 11)	Spacing	Base Ply	Primer	LARS	
S-116.	Min. 22 ga., type B, Grade 33 steel or min. 2,500 psi structural concrete	Min. 1.5-inch, One or more layers, any combination	SOPRABASE TG	SOPREMA #14 MP with SOPREMA 3" Metal Insulation Plate	12-inch o.c. at the 4-inch side laps and 12-inch o.c. at two, equally spaced, staggered center rows	SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-52.5

TABLE 2e: STEEL DECKS – NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE D-2: INSULATED, MECHANICALLY ATTACHED SOPRAPHIX, BONDED ROOF COVER

System No.	Deck (Note 1)	Insulation	Base Sheet			Roof Cover (Note 15)			MDP (psf)
			Type	Fastener (Note 11)	Spacing	Base Ply	Primer	LARS	
S-117.	Min. 22 ga., type B, Grade 33 steel	Min. 1.5-inch, One or more layers, any combination	SOPRAPHIX Base 622	SOPREMA #14 MP with SOPREMA 2" Seam Plate	18-inch o.c. within min. 4-inch wide, heat-welded side laps	(Optional) SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-45.0*
S-118.	Min. 22 ga., type B, Grade 33 steel	Min. 1.5-inch, One or more layers, any combination	SOPRAPHIX Base 622	SOPREMA #14 MP with SOPREMA 2" Seam Plate	12-inch o.c. within min. 4-inch wide, heat-welded side laps	(Optional) SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-52.5
S-119.	Min. 22 ga., type B, Grade 33 steel	Min. 1.5-inch, One or more layers, any combination	SOPRAPHIX Base 622	SOPREMA #15 HD with SOPREMA 2" Seam Plate	12-inch o.c. within min. 4-inch wide, heat-welded side laps	(Optional) SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-67.5
S-120.	Min. 22 ga., type B, Grade 33 steel	Min. 1.5-inch, One or more layers, any combination	SOPRAPHIX Base 611, 612 or 614	SOPREMA #15 HD with SOPREMA 2" Seam Plate	12-inch o.c. within min. 4-inch wide, heat-welded side laps	SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-67.5
S-121.	Min. 22 ga., type B, Grade 80 steel	Min. 1.5-inch, One or more layers, any combination	SOPRAPHIX Base 622	SOPREMA #14 MP with SOPREMA 2" Seam Plate	12-inch o.c. within min. 4-inch wide, heat-welded side laps	(Optional) SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-67.5
S-122.	Min. 22 ga., type B, Grade 80 steel	Min. 1.5-inch, One or more layers, any combination	SOPRAPHIX Base 611, 612 or 614	SOPREMA #14 MD with SOPREMA 2" Seam Plate	12-inch o.c. within min. 4-inch wide, heat-welded side laps	SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-67.5
S-123.	Min. 22 ga., type B, Grade 33 steel	Min. 1.5-inch, One or more layers, any combination	SOPRAPHIX Base 622	SOPREMA #15 HD with SOPREMA 2.4" Seam Plate	12-inch o.c. within min. 4-inch wide, heat-welded side laps	(Optional) SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-75.0
S-124.	Min. 22 ga., type B, Grade 33 steel	Min. 1.5-inch, One or more layers, any combination	SOPRAPHIX Base 641	Trufast #15 EHD with Trufast 2.4" Barbed Metal Seam Plate	12-inch o.c. within min. 5-inch wide, self-adhered side laps	SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-75.0
S-125.	Min. 22 ga., type B, Grade 33 steel	Min. 1.5-inch, One or more layers, any combination	SOPRAPHIX Base 611, 612 or 614	SOPREMA #15 HD with SOPREMA 2.4" Seam Plate	12-inch o.c. within min. 4-inch wide, heat-welded side laps	SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-75.0
S-126.	Min. 22 ga., type B, Grade 80 steel	Min. 1.5-inch, One or more layers, any combination	SOPRAPHIX Base 622	SOPREMA #14 MP with SOPREMA 2.4" Seam Plate	12-inch o.c. within min. 4-inch wide, heat-welded side laps	(Optional) SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-75.0

TABLE 2E: STEEL DECKS – NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE D-2: INSULATED, MECHANICALLY ATTACHED SOPRAPHIX, BONDED ROOF COVER

System No.	Deck (Note 1)	Insulation	Base Sheet			Roof Cover (Note 15)			MDP (psf)
			Type	Fastener (Note 11)	Spacing	Base Ply	Primer	LARS	
S-127.	Min. 22 ga., type B, Grade 80 steel	Min. 1.5-inch, One or more layers, any combination	SOPRAPHIX Base 614	SOPREMA #15 HD with SOPREMA 2.4" Seam Plate	12-inch o.c. within min. 4-inch wide, heat-welded side laps	SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-97.5
S-128.	Min. 22 ga., type B, Grade 33 steel	Min. 1.5-inch, One or more layers, any combination	SOPRAPHIX Base 622	SOPREMA #15 HD with SOPREMA 2" Seam Plate or SOPREMA 2.4" Seam Plate	6-inch o.c. within min. 4-inch wide, heat-welded side laps	(Optional) SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-112.5
S-129.	Min. 22 ga., type B, Grade 33 steel	Min. 1.5-inch, One or more layers, any combination	SOPRAPHIX Base 641	Trufast #15 EHD with Trufast 2.4" Barbed Metal Seam Plate	6-inch o.c. within min. 5-inch wide, self-adhered side laps	SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-120.0
S-130.	Min. 22 ga., type B, Grade 33 steel	Min. 1.5-inch, One or more layers, any combination	SOPRAPHIX Base 611, 612 or 614	SOPREMA #15 HD with SOPREMA 2" Seam Plate or SOPREMA 2.4" Seam Plate	6-inch o.c. within min. 4-inch wide, heat-welded side laps	SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-120.0
S-131.	Min. 22 ga., type B, Grade 80 steel	Min. 1.5-inch, One or more layers, any combination	SOPRAPHIX Base 622	SOPREMA #14 or #15 HD with SOPREMA 2" Seam Plate	6-inch o.c. within min. 4-inch wide, heat-welded side laps	(Optional) SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-120.0
S-132.	Min. 22 ga., type B, Grade 80 steel	Min. 1.5-inch, One or more layers, any combination	SOPRAPHIX Base 622	SOPREMA #15 HD with SOPREMA 2.4" Seam Plate	6-inch o.c. within min. 4-inch wide, heat-welded side laps	(Optional) SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-135.0

TABLE 3A: STRUCTURAL CONCRETE DECKS – NEW CONSTRUCTION OR REROOF (TEAR-OFF)
SYSTEM TYPE A-1: BONDED INSULATION, BONDED ROOF COVER

REFER TO [Notes 6,7,8](#) FOR VAPOR BARRIER OPTIONS

System No.	Deck (Note 1)	Base Insulation Layer		Top Insulation Layer		Roof Cover (Note 15)				MDP (psf)
		Type	Attach (Notes 6,7,8)	Type	Attach (Notes 6,7,8)	Base Ply	Ply	Primer	LARS	
NO BASE PLY:										
C-1	Structural concrete	(Optional) Min. 1.5-inch SOPRA-ISOs, SOPRA-ISO+s, ENRGY 3, ENRGY 3 CGF, SOPRA-ISOr, SOPRA-ISO+r, SOPRA-ISOx or SOPRA-ISO+x	DUOTACK	Min. 7/16-inch DEXcell Cement Roof Board	DUOTACK	None	None	RS 276	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-217.5
C-2	Structural concrete	(Optional) Min. 1.5-inch SOPRA-ISOs, SOPRA-ISO+s, ENRGY 3, ENRGY 3 CGF, SOPRA-ISOr, SOPRA-ISO+r, SOPRA-ISOx or SOPRA-ISO+x	DUOTACK	Min. 0.5-inch SECUROCK Cement Roof Board	DUOTACK	None	None	RS 276	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-382.5
C-3	Structural concrete	(Optional) Min. 1.5-inch SOPRA-ISOs, SOPRA-ISO+s, SOPRA-ISOr, SOPRA-ISO+r or SOPRA-ISO+x	DUOTACK SPF HFO	Min. 7/16-inch DEXcell Cement Roof Board	DUOTACK SPF HFO	None	None	RS 276	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-217.5
COLD-APPLIED BASE PLY:										
C-4	Structural Concrete	Min. 0.25-inch SOPRABOARD optionally primed with DETEC “TruGround Conductive Primer”	COLPLY EF Adhesive, 6-inch o.c.	None	N/A	SBS-CA3	None	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-382.5
C-5	Structural concrete	(Optional) Min. 1.5-inch SOPRA-ISOs, SOPRA-ISO+s, EnergyGuard POLYISO Insulation, ENRGY 3, ENRGY 3 CGF, SOPRA-ISOr, SOPRA-ISO+r, SOPRA-ISOx or SOPRA-ISO+x	DUOTACK	Min. 0.25-inch DEXcell FA Glass Mat Roof Board	DUOTACK	SBS-CA3	None	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-120.0
C-6	Structural Concrete	(Optional) Min. 1.5-inch SOPRA-ISOs, SOPRA-ISO+s, EnergyGuard POLYISO Insulation, ENRGY 3, ENRGY 3 CGF, SOPRA-ISOr, SOPRA-ISO+r, SOPRA-ISOx or SOPRA-ISO+x	DUOTACK	Min. 7/16-inch DEXcell Cement Roof Board	DUOTACK	SBS-CA3	None	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-190.0
C-7	Structural Concrete	(Optional) Min. 1.5-inch SOPRA-ISOs, SOPRA-ISO+s, EnergyGuard POLYISO Insulation, ENRGY 3, ENRGY 3 CGF, SOPRA-ISOr, SOPRA-ISO+r, SOPRA-ISOx or SOPRA-ISO+x	DUOTACK, 6-inch o.c.	Min. 7/16-inch DEXcell Cement Roof Board	DUOTACK, 6-inch o.c.	SBS-CA3	None	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-285.0
C-8	Structural concrete	(Optional) Min. 1.5-inch SOPRA-ISOs, SOPRA-ISO+s, EnergyGuard POLYISO Insulation, ENRGY 3, ENRGY 3 CGF, SOPRA-ISOr, SOPRA-ISO+r, SOPRA-ISOx or SOPRA-ISO+x	DUOTACK	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum Fiber Roof Board	DUOTACK	SBS-CA3	None	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-315.0
C-9	Structural concrete	(Optional) Min. 1.5-inch SOPRA-ISOs, SOPRA-ISO+s, EnergyGuard POLYISO Insulation, ENRGY 3, ENRGY 3 CGF, SOPRA-ISOr, SOPRA-ISO+r, SOPRA-ISOx or SOPRA-ISO+x	DUOTACK	Min. 0.125-inch SOPRABOARD, optionally primed with DETEC “TruGround Conductive Primer”	DUOTACK	SBS-CA3	None	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-382.5

**TABLE 3A: STRUCTURAL CONCRETE DECKS – NEW CONSTRUCTION OR REROOF (TEAR-OFF)
SYSTEM TYPE A-1: BONDED INSULATION, BONDED ROOF COVER**

REFER TO [TABLE 3](#) FOR VAPOR BARRIER OPTIONS

System No.	Deck (Note 1)	Base Insulation Layer		Top Insulation Layer		Roof Cover (Note 15)				MDP (psf)
		Type	Attach (Notes 6,7,8)	Type	Attach (Notes 6,7,8)	Base Ply	Ply	Primer	LARS	
C-10	Structural concrete	(Optional) Min. 1.5-inch SOPRA-ISOs, SOPRA-ISO+s, EnergyGuard POLYISO Insulation, ENRGY 3, ENRGY 3 CGF, SOPRA-ISOr, SOPRA-ISO+r, SOPRA-ISOx or SOPRA-ISO+x	DUOTACK	SOPRASMART Board 180 Sanded	DUOTACK	(Optional) SBS-CA3	None	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-382.5
C-11	Structural concrete	(Optional) Min. 1.5-inch SOPRA-ISOs, SOPRA-ISO+s, SOPRA-ISOr, SOPRA-ISO+r, SOPRA-ISOx or SOPRA-ISO+x	DUOTACK SPF HFO	Min. 7/16-inch DEXcell Cement Roof Board	DUOTACK SPF HFO	(Optional) SBS-CA3	None	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-190.0
C-12	Structural concrete	Min. 1.5-inch SOPRA-ISO+s, SOPRA-ISOr, SOPRA-ISO+r, SOPRA-ISOx or SOPRA-ISO+x	DUOTACK SPF HFO	Min. 0.25-inch DensDeck Prime, DEXcell FA Glass Mat Roof Board or SECUROCK Gypsum-Fiber Roof Board	DUOTACK SPF HFO	(Optional) SBS-CA3	None	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-270.0
C-13	Structural concrete	(Optional) Min. 1-inch SOPRA-ISOs	DUOTACK SPF HFO	Min. 0.25-inch DensDeck Prime, DEXcell FA Glass Mat Roof Board or SECUROCK Gypsum-Fiber Roof Board	DUOTACK SPF HFO	(Optional) SBS-CA3	None	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-315.0
C-14	Structural concrete	Min. 0.25-inch DEXcell FA Glass Mat Roof Board	DUOTACK SPF HFO	None	N/A	(Optional) SBS-CA3	None	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-382.5
TORCH BASE PLY:										
C-15	Structural Concrete	Min. 0.25-inch SOPRABOARD optionally primed with DETEC "TruGround Conductive Primer"	COLPLY EF Adhesive, 6-inch o.c.	None	N/A	SBS-TAF	(Optional) SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-382.5
C-16	Structural concrete	(Optional) One or more layer(s), min. 1-inch SOPRA-ISOs, SOPRA-ISO+s, SOPRA-ISOr, SOPRA-ISO+r, SOPRA-ISOx, SOPRA-ISO+x or SOPRA-XPS	DUOTACK	Min. 0.25-inch DEXcell FA Glass Mat Roof Board	DUOTACK	SBS-TAF	(Optional) SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-187.5
C-17	Structural concrete	(Optional) One or more layer(s), min. 1-inch SOPRA-ISOs, SOPRA-ISO+s, SOPRA-ISOr, SOPRA-ISO+r, SOPRA-ISOx, SOPRA-ISO+x or SOPRA-XPS	DUOTACK, 6-inch o.c.	Min. 0.25-inch DEXcell FA Glass Mat Roof Board	DUOTACK, 6-inch o.c.	SBS-TAF	(Optional) SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-227.5
C-18	Structural concrete	Min. 1.5-inch SOPRA-ISOs, SOPRA-ISO+s, EnergyGuard POLYISO Insulation, ENRGY 3, ENRGY 3 CGF, SOPRA-ISOr, SOPRA-ISO+r, SOPRA-ISOx or SOPRA-ISO+x	DUOTACK	SOPRASMART ISO HD 180 (for TA Base Ply) or SOPRASMART ISO HD 180 Sanded (for no Base Ply)	DUOTACK	(Optional) SBS-TAF	None	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-307.5

**TABLE 3A: STRUCTURAL CONCRETE DECKS – NEW CONSTRUCTION OR REROOF (TEAR-OFF)
SYSTEM TYPE A-1: BONDED INSULATION, BONDED ROOF COVER**

REFER TO [TABLE 3](#) FOR VAPOR BARRIER OPTIONS

System No.	Deck (Note 1)	Base Insulation Layer		Top Insulation Layer		Roof Cover (Note 15)				MDP (psf)
		Type	Attach (Notes 6,7,8)	Type	Attach (Notes 6,7,8)	Base Ply	Ply	Primer	LARS	
C-19	Structural concrete	(Optional) Min. 1.5-inch SOPRA-ISOs, SOPRA-ISO+s, EnergyGuard POLYISO Insulation, ENRGY 3, ENRGY 3 CGF, SOPRA-ISOr, SOPRA-ISO+r, SOPRA-ISOr or SOPRA-ISO+x	DUOTACK	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum Fiber Roof Board	DUOTACK	SBS-TAF	(Optional) SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-315.0
C-20	Structural concrete	(Optional) Min. 1.5-inch SOPRA-ISOs, SOPRA-ISO+s, ENRGY 3, ENRGY 3 CGF, SOPRA-ISOr, SOPRA-ISO+r, SOPRA-ISOr or SOPRA-ISO+x	DUOTACK 365	Min. 0.5-inch SECUROCK Cement Roof Board. Top surface primed with ELASTOCOL 500.	DUOTACK 365	SBS-TAF	(Optional) SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-315.0
C-21	Structural concrete	(Optional) Min. 1.5-inch SOPRA-ISOs, SOPRA-ISO+s, EnergyGuard POLYISO Insulation, ENRGY 3, ENRGY 3 CGF, SOPRA-ISOr, SOPRA-ISO+r, SOPRA-ISOr or SOPRA-ISO+x	DUOTACK	Min. 7/16-inch DEXcell Cement Roof Board	DUOTACK	SBS-TAF	(Optional) SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-367.5
C-22	Structural concrete	(Optional) Min. 1.5-inch SOPRA-ISOs, SOPRA-ISO+s, EnergyGuard POLYISO Insulation, ENRGY 3, ENRGY 3 CGF, SOPRA-ISOr, SOPRA-ISO+r, SOPRA-ISOr or SOPRA-ISO+x	DUOTACK	Min. 0.125-inch SOPRABOARD	DUOTACK	SBS-TAF	(Optional) SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-382.5
C-23	Structural concrete	(Optional) Min. 1.5-inch SOPRA-ISOs, SOPRA-ISO+s, EnergyGuard POLYISO Insulation, ENRGY 3, ENRGY 3 CGF, SOPRA-ISOr, SOPRA-ISO+r, SOPRA-ISOr or SOPRA-ISO+x	DUOTACK	SOPRASMART Board 180 (for TA Base Ply) or SOPRASMART Board 180 Sanded (for no Base Ply)	DUOTACK	(Optional) SBS-TAF	None	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-382.5
C-24	Structural concrete	Min. 1.5-inch SOPRA-ISO+s, SOPRA-ISOr, SOPRA-ISO+r, SOPRA-ISOr or SOPRA-ISO+x	DUOTACK SPF HFO	Min. 0.25-inch DensDeck Prime, DEXcell FA Glass Mat Roof Board or SECUROCK Gypsum-Fiber Roof Board or Min. 7/16-inch DEXcell Cement Roof Board	DUOTACK SPF HFO	SBS-TAF	(Optional) SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-270.0
C-25	Structural concrete	(Optional) Min. 1-inch SOPRA-ISOs	DUOTACK SPF HFO	Min. 0.25-inch DensDeck Prime, DEXcell FA Glass Mat Roof Board or SECUROCK Gypsum-Fiber Roof Board or Min. 7/16-inch DEXcell Cement Roof Board	DUOTACK SPF HFO	SBS-TAF	(Optional) SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-315.0
C-26	Structural concrete	Min. 0.25-inch DEXcell FA Glass Mat Roof Board	DUOTACK SPF HFO	None	N/A	SBS-TAF	(Optional) SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-592.5

SELF-ADHERING BASE PLY:

**TABLE 3A: STRUCTURAL CONCRETE DECKS – NEW CONSTRUCTION OR REROOF (TEAR-OFF)
SYSTEM TYPE A-1: BONDED INSULATION, BONDED ROOF COVER**

REFER TO [TABLE 3](#) FOR VAPOR BARRIER OPTIONS

System No.	Deck (Note 1)	Base Insulation Layer		Top Insulation Layer		Roof Cover (Note 15)				MDP (psf)
		Type	Attach (Notes 6,7,8)	Type	Attach (Notes 6,7,8)	Base Ply	Ply	Primer	LARS	
C-27	Structural concrete	(Optional) Min. 1.5-inch SOPRA-ISOs, SOPRA-ISO+s, ENRGY 3, ENRGY 3 CGF, SOPRA-ISOr, SOPRA-ISO+r, SOPRA-ISOr or SOPRA-ISO+x	DUOTACK	Min. 0.25-inch DEXcell FA Glass Mat Roof Board primed with Elastocol Stick or Elastocol Stick Zero	DUOTACK	SBS-SA1	(Optional) SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-120.0
C-28	Structural concrete	Min. 1.5-inch SOPRA-ISOs, SOPRA-ISO+s, EnergyGuard POLYISO Insulation, ENRGY 3, ENRGY 3 CGF, SOPRA-ISOr, SOPRA-ISO+r, SOPRA-ISOr or SOPRA-ISO+x	DUOTACK	Min. 7/16-inch DEXcell Cement Roof Board primed with Elastocol Stick or Elastocol Stick Zero	DUOTACK	SBS-SA1	(Optional) SBS-SA1 or SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-190.0
C-29	Structural concrete	(Optional) Min. 1.5-inch SOPRA-ISOs, SOPRA-ISO+s, EnergyGuard POLYISO Insulation, ENRGY 3, ENRGY 3 CGF, SOPRA-ISOr, SOPRA-ISO+r, SOPRA-ISOr or SOPRA-ISO+x	DUOTACK	Min. 0.125-inch SOPRABOARD primed with Elastocol Stick Zero	DUOTACK	SBS-SA1	(Optional) SBS-SA1	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-270.0
C-30	Structural concrete	(Optional) Min. 1.5-inch SOPRA-ISOs, SOPRA-ISO+s, EnergyGuard POLYISO Insulation, ENRGY 3, ENRGY 3 CGF, SOPRA-ISOr, SOPRA-ISO+r, SOPRA-ISOr or SOPRA-ISO+x	DUOTACK	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board. Top surface primed with Elastocol Stick or Elastocol Stick Zero	DUOTACK	SBS-SA1	(Optional) SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-315.0
C-31	Structural concrete	(Optional) Min. 1.5-inch SOPRA-ISOs, SOPRA-ISO+s, EnergyGuard POLYISO Insulation, ENRGY 3, ENRGY 3 CGF, SOPRA-ISOr, SOPRA-ISO+r, SOPRA-ISOr or SOPRA-ISO+x	DUOTACK	Min. 0.125-inch SOPRABOARD	DUOTACK	SBS-SA1	SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-382.5
C-32	Structural concrete	(Optional) Min. 1-inch SOPRA-ISOs or min. 1.5-inch SOPRA-ISO+s, SOPRA-ISOr, SOPRA-ISO+r or SOPRA-ISO+x	DUOTACK SPF HFO	Min. 7/16-inch DEXcell Cement Roof Board. Top surface primed with ELASTOCOL Stick or ELASTOCOL Stick Zero	DUOTACK SPF HFO	SBS-SA1	(Optional) SBS-SA1 or SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-190.0
C-33	Structural concrete	(Optional) Min. 1-inch SOPRA-ISOs or min. 1.5-inch SOPRA-ISO+s, SOPRA-ISOr, SOPRA-ISO+r or SOPRA-ISO+x	DUOTACK SPF HFO	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	DUOTACK SPF HFO	SBS-SA1	(Optional) SBS-SA1 or SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-215.0
C-34	Structural concrete	Min. 1.5-inch SOPRA-ISO+s, SOPRA-ISOr, SOPRA-ISO+r or SOPRA-ISO+x	DUOTACK SPF HFO	Min. 0.25-inch DensDeck Prime, DEXcell FA Glass Mat Roof Board or SECUROCK Gypsum-Fiber Roof Board. Top surface primed with ELASTOCOL Stick or ELASTOCOL Stick Zero.	DUOTACK SPF HFO	SBS-SA1	(Optional) SBS-SA1 or SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-270.0

**TABLE 3A: STRUCTURAL CONCRETE DECKS – NEW CONSTRUCTION OR REROOF (TEAR-OFF)
SYSTEM TYPE A-1: BONDED INSULATION, BONDED ROOF COVER**

REFER TO [NOTE 12](#) FOR VAPOR BARRIER OPTIONS

System No.	Deck (Note 1)	Base Insulation Layer		Top Insulation Layer		Roof Cover (Note 15)				MDP (psf)
		Type	Attach (Notes 6,7,8)	Type	Attach (Notes 6,7,8)	Base Ply	Ply	Primer	LARS	
C-35	Structural concrete	Min. 0.25-inch DEXcell FA Glass Mat Roof Board. Top surface shall be primed with ELASTOCOL Stick or ELASTOCOL Stick Zero.	DUOTACK SPF HFO	None	N/A	SBS-SA1	(Optional) SBS-SA1 or SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-285.0
C-36	Structural concrete	(Optional) Min. 1-inch SOPRA-ISOs	DUOTACK SPF HFO	Min. 0.25-inch DensDeck Prime, DEXcell FA Glass Mat Roof Board or SECUROCK Gypsum-Fiber Roof Board. Top surface primed with ELASTOCOL Stick or ELASTOCOL Stick Zero.	DUOTACK SPF HFO	SBS-SA1	SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-315.0
C-37	Structural concrete	Min. 0.25-inch DEXcell FA Glass Mat Roof Board. Top surface shall be primed with ELASTOCOL Stick or ELASTOCOL Stick Zero.	DUOTACK SPF HFO	None	N/A	SBS-SA1	SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-382.5

**TABLE 3B: STRUCTURAL CONCRETE DECKS – NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE D-2: INSULATED, MECHANICALLY ATTACHED SOPRAPHIX, BONDED ROOF COVER**

System No.	Deck (Note 1)	Insulation and/or Thermal Barrier	Base Sheet			Roof Cover (Note 15)			MDP (psf)
			Type	Fastener (Note 11)	Spacing	Base Ply	Primer	LARS	
C-38	Min. 2,500 psi structural concrete	Min. 1.5-inch, One or more layers, any combination	SOPRAPHIX Base 622	SOPREMA #14 MP or SOPREMA Fluted Concrete Nail with SOPREMA 2" Seam Plate	18-inch o.c. within 4-inch wide, heat-welded side laps	(Optional) SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-45.0*
C-39	Min. 2,500 psi structural concrete	Min. 1.5-inch, One or more layers, any combination	SOPRAPHIX Base 611, 612 or 614	SOPREMA #14 MP or SOPREMA Fluted Concrete Nail with SOPREMA 2" Seam Plate	18-inch o.c. within 4-inch wide, heat-welded or self-adhering laps	SBS-TA	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-45.0*
C-40	Min. 2,500 psi structural concrete	Min. 1.5-inch, One or more layers, any combination	SOPRAPHIX Base 611, 612 or 614	SOPREMA #14 MP or SOPREMA Fluted Concrete Nail with SOPREMA 2" Seam Plate or SOPREMA 2.4" Seam Plate	12-inch o.c. within 5-inch wide, heat-welded side laps	SBS-TA	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-60.0
C-41	Min. 2,500 psi structural concrete	Min. 1.5-inch, One or more layers, any combination	SOPRAPHIX Base 622	SOPREMA #14 MP or SOPREMA Fluted Concrete Nail with SOPREMA 2" Seam Plate	12-inch o.c. within 4-inch wide, heat-welded laps	(Optional) SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-67.5
C-42	Min. 2,500 psi structural concrete	Min. 1.5-inch, One or more layers, any combination	SOPRAPHIX Base 611, 612 or 614	SOPREMA #14 MP or SOPREMA Fluted Concrete Nail with SOPREMA 2" Seam Plate	12-inch o.c. within 4-inch wide, heat-welded laps	SBS-TA	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-67.5
C-43	Min. 2,500 psi structural concrete	Min. 1.5-inch, One or more layers, any combination	SOPRAPHIX Base 611 or 612	SOPREMA #14 MP or SOPREMA Fluted Concrete Nail with SOPREMA 2.4" Seam Plate	12-inch o.c. within 4-inch wide, heat-welded laps	SBS-TA	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-75.0

TABLE 3B: STRUCTURAL CONCRETE DECKS – NEW CONSTRUCTION, REROOF (TEAR-OFF) OR RECOVER
SYSTEM TYPE D-2: INSULATED, MECHANICALLY ATTACHED SOPRAPHIX, BONDED ROOF COVER

System No.	Deck (Note 1)	Insulation and/or Thermal Barrier	Base Sheet			Roof Cover (Note 15)			MDP (psf)
			Type	Fastener (Note 11)	Spacing	Base Ply	Primer	LARS	
C-44	Min. 2,500 psi structural concrete	Min. 1.5-inch, One or more layers, any combination	SOPRAPHIX Base 622	SOPREMA #14 MP or SOPREMA Fluted Concrete Nail with SOPREMA 2.4" Seam Plate	12-inch o.c. within 4-inch wide, heat-welded laps	(Optional) SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-97.5
C-45	Min. 2,500 psi structural concrete	Min. 1.5-inch, One or more layers, any combination	SOPRAPHIX Base 614	SOPREMA #14 MP or SOPREMA Fluted Concrete Nail with SOPREMA 2.4" Seam Plate	12-inch o.c. within 4-inch wide, heat-welded laps	SBS-TA	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-97.5
C-46	Min. 2,500 psi structural concrete	Min. 1.5-inch, One or more layers, any combination	SOPRAPHIX Base 611, 612 or 614	SOPREMA #14 MP or SOPREMA Fluted Concrete Nail with SOPREMA 2" Seam Plate or SOPREMA 2.4" Seam Plate	6-inch o.c. within 4-inch wide, heat-welded laps	SBS-TA	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-120.0
C-47	Min. 2,500 psi structural concrete	Min. 1.5-inch, One or more layers, any combination	SOPRAPHIX Base 611, 612 or 614	SOPREMA #14 MP or SOPREMA Fluted Concrete Nail with SOPREMA 2" Seam Plate or SOPREMA 2.4" Seam Plate	6-inch o.c. within 4-inch wide, heat-welded laps	SBS-TA	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-120.0
C-48	Min. 2,500 psi structural concrete	Min. 1.5-inch, One or more layers, any combination	SOPRAPHIX Base 622	SOPREMA #14 MP or SOPREMA Fluted Concrete Nail with SOPREMA 2.4" Seam Plate	6-inch o.c. within min. 4-inch wide, heat-welded side laps	(Optional) SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-135.0

TABLE 3C: STRUCTURAL CONCRETE DECKS – NEW CONSTRUCTION OR REROOF (TEAR-OFF)
SYSTEM TYPE F-1: NON-INSULATED, BONDED ROOF COVER

System No.	Deck (Note 1)	Primer	Roof Cover (Note 15)	MDP (psf)
C-49	Structural concrete	RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-495.0
C-50	Structural concrete	AVC-SG3	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-845.0
C-51	Structural concrete	RS 276	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-940.0

**TABLE 3D: STRUCTURAL CONCRETE DECKS – NEW CONSTRUCTION OR REROOF (TEAR-OFF)
SYSTEM TYPE F-2: NON-INSULATED, BONDED BASE PLY(S), BONDED ROOF COVER**

System No.	Deck (Note 1)	Primer	Roof Cover (Note 15)			MDP (psf)
			Base Ply(s)	Primer	LARS	
C-52	Structural concrete	None	SBS-CA2, ribbons 12-inch o.c.	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-60.0
C-53	Structural concrete	None	SBS-CA2, ribbons 6-inch o.c.	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-180.0
C-54	Structural concrete	(Optional) ASTM D41	SBS-CA3	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-270.0
C-55	Structural concrete	ASTM D41	SBS-TAP followed by (optional) one or more SBS-TAF and/or (optional) ELASTOPHENE Flam HS FR GR, ELASTOPHENE Flam GR, ELASTOPHENE Flam LS FR GR, ELASTOPHENE Flam FR GR, ELASTOPHENE Flam HP FR GR, SOPRALENE Flam 180 GR, COLPHENE Flam 180 GR, SOPRALENE Flam 180 FR GR, COLPHENE Flam 180 FR GR, SOPRALENE Flam 250 FR GR or COLPHENE Flam 250 FR GR, torch applied Or One or more SBS-TAF followed by (optional) ELASTOPHENE Flam HS FR GR, ELASTOPHENE Flam GR, ELASTOPHENE Flam LS FR GR, ELASTOPHENE Flam FR GR, ELASTOPHENE Flam HP FR GR, SOPRALENE Flam 180 GR, COLPHENE Flam 180 GR, SOPRALENE Flam 180 FR GR, COLPHENE Flam 180 FR GR, SOPRALENE Flam 250 FR GR or COLPHENE Flam 250 FR GR, torch applied Or One ply of ELASTOPHENE Flam HS FR GR, ELASTOPHENE Flam GR, ELASTOPHENE Flam LS FR GR, ELASTOPHENE Flam FR GR, ELASTOPHENE Flam HP FR GR, SOPRALENE Flam 180 GR, COLPHENE Flam 180 GR, SOPRALENE Flam 180 FR GR, COLPHENE Flam 180 FR GR, SOPRALENE Flam 250 FR GR or COLPHENE Flam 250 FR GR, torch applied	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-392.5

TABLE 4A: LIGHTWEIGHT INSULATING CONCRETE OVER STRUCUTRAL CONCRETE DECKS - NEW CONSTRUCTION OR REROOF (TEAR-OFF)
SYSTEM TYPE A-1: LWC TO DECK, BONDED INSULATION, BONDED ROOF COVER

 REFER TO [NOTE 13](#) FOR DRY-IN / TEMPORARY ROOF OPTIONS (BETWEEN STRUCTURAL CONCRETE AND LIGHTWEIGHT CONCRETE)

System No.	Deck (Note 1)	Lightweight Concrete (Note 14)	Base Insulation Layer		Coverboard		Roof Cover (Note 15)			MDP (psf)
			Type	Attach	Type	Attach	Base Ply	Primer	LARS	
CELCORE (FL2037):										
TORCH APPLIED BASE:										
LWC-1.	Structural concrete	Min. 300 psi, min 2-inch thick Celcore MF Cellular Concrete with Celcore HS Rheology Modifying Admixture. After setting to support foot traffic, Celcore PVA Curing Compound is applied	Min. 0.125-inch SOPRABOARD	DUOTACK	None	N/A	SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-115.0
LWC-2.	Structural concrete	Min. 300 psi, min 2-inch thick Celcore MF Cellular Concrete with Celcore HS Rheology Modifying Admixture. After setting to support foot traffic, Celcore PVA Curing Compound is applied	SOPRASMART Board 180 (for TA Base Ply) or SOPRASMART Board 180 Sanded (for no Base Ply)	DUOTACK	None	N/A	(Optional) SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-115.0
LWC-3.	Structural concrete	Min. 300 psi, min 2-inch thick Celcore MF Cellular Concrete with Celcore HS Rheology Modifying Admixture. After setting to support foot traffic, Celcore PVA Curing Compound is applied	Min. 2-inch SOPRA-ISO+s or SOPRA-ISO+r	DUOTACK	Min. 0.125-inch SOPRABOARD	DUOTACK	SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-170.0
LWC-4.	Structural concrete	Min. 300 psi, min 2-inch thick Celcore MF Cellular Concrete with Celcore HS Rheology Modifying Admixture. After setting to support foot traffic, Celcore PVA Curing Compound is applied	Min. 2-inch SOPRA-ISO+s or SOPRA-ISO+r	DUOTACK	SOPRASMART Board 180 or SOPRASMART ISO HD 180 (for TA Base Ply) or SOPRASMART Board 180 Sanded or SOPRASMART ISO HD 180 Sanded (for no Base Ply)	DUOTACK	(Optional) SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-170.0
SELF-ADHERING BASE:										
LWC-5.	Structural concrete	Min. 300 psi, min 2-inch thick Celcore MF Cellular Concrete with Celcore HS Rheology Modifying Admixture. After setting to support foot traffic, Celcore PVA Curing Compound is applied	Min. 0.125-inch SOPRABOARD	DUOTACK	None	N/A	SBS-SA1	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-115.0
LWC-6.	Structural concrete	Min. 300 psi, min 2-inch thick Celcore MF Cellular Concrete with Celcore HS Rheology Modifying Admixture. After setting to support foot traffic, Celcore PVA Curing Compound is applied	Min. 2-inch SOPRA-ISO+s or SOPRA-ISO+r	DUOTACK	Min. 0.125-inch SOPRABOARD	DUOTACK	SBS-SA1	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-155.0

TABLE 4B: LIGHTWEIGHT INSULATING CONCRETE OVER STRUCTURAL CONCRETE DECKS - NEW CONSTRUCTION OR REROOF (TEAR-OFF)
SYSTEM TYPE A-1: LWC TO DECK, BONDED VAPOR BARRIER, BONDED INSULATION, BONDED ROOF COVER
 REFER TO [NOTE 13](#) FOR DRY-IN / TEMPORARY ROOF OPTIONS (BETWEEN STRUCTURAL CONCRETE AND LIGHTWEIGHT CONCRETE)

System No.	Deck (Note 1)	Lightweight Concrete (Note 14)	Vapor Barrier	Base Insulation Layer		Coverboard		Roof Cover (Note 15)			MDP (psf)
				Type	Attach	Type	Attach	Base Ply	Primer	LARS	
PRE-EXISTENT CELLULAR LWC:											
TORCH APPLIED BASE:											
LWC-7.	Structural Concrete	Cellular lightweight concrete, Min. 330 psi, Min. 2-inch top coat Note: To qualify the LWIC under this assembly, a SOPREMA 1.7 in. Base Sheet Fastener or OMG CR Assembled Base Sheet Fastener (1.7") shall achieve an average withdrawal of 101 lbf when tested per TAS 105 or ANSI/SPRI FX-1	SBS-CA2, 12-inch o.c. (sanded-top)	Min. 1.5-inch SOPRA-ISOs, SOPRA-ISO+s, EnergyGuard POLYISO Insulation, ENRGY 3, ENRGY 3 CGF, SOPRA-ISOr, SOPRA-ISO+r, SOPRA-ISOx or SOPRA-ISO+x	DUOTACK	SOPRASMART XP HD 180 (for TA Base Ply) or SOPRASMART XP HD 180 Sanded (for no Base Ply)	DUOTACK	(Optional) SBS-TAP or SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-52.5
LWC-8.	Structural Concrete	Cellular lightweight concrete, Min. 330 psi, Min. 2-inch top coat Note: To qualify the LWIC under this assembly, a SOPREMA 1.7 in. Base Sheet Fastener or OMG CR Assembled Base Sheet Fastener (1.7") shall achieve an average withdrawal of 101 lbf when tested per TAS 105 or ANSI/SPRI FX-1	SBS-CA2, 12-inch o.c. (sanded-top)	Min. 1.5-inch SOPRA-ISOs, SOPRA-ISO+s, EnergyGuard POLYISO Insulation, ENRGY 3, ENRGY 3 CGF, SOPRA-ISOr, SOPRA-ISO+r, SOPRA-ISOx or SOPRA-ISO+x	DUOTACK	Min. 0.125-inch SOPRABOARD, Min. 0.25-inch DensDeck Prime, DEXcell FA Glass Mat Roof Board or SECUROCK Gypsum-Fiber Roof Board or Min. 7/16-inch DEXcell Cement Roof Board	DUOTACK	TA-F	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-60.0
LWC-9.	Structural Concrete	Cellular lightweight concrete, Min. 330 psi, Min. 2-inch top coat Note: To qualify the LWIC under this assembly, a SOPREMA 1.7 in. Base Sheet Fastener or OMG CR Assembled Base Sheet Fastener (1.7") shall achieve an average withdrawal of 101 lbf when tested per TAS 105 or ANSI/SPRI FX-1	SBS-CA2, 12-inch o.c. (sanded-top)	Min. 1.5-inch SOPRA-ISOs, SOPRA-ISO+s, EnergyGuard POLYISO Insulation, ENRGY 3, ENRGY 3 CGF, SOPRA-ISOr, SOPRA-ISO+r, SOPRA-ISOx or SOPRA-ISO+x	DUOTACK	SOPRASMART Board 180 or SOPRASMART ISO HD 180 (for TA Base Ply) or SOPRASMART Board 180 Sanded or SOPRASMART ISO HD 180 Sanded (for no Base Ply)	DUOTACK	(Optional) SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-60.0
SELF-ADHERING BASE:											
LWC-10.	Structural Concrete	Cellular lightweight concrete, Min. 330 psi, Min. 2-inch top coat Note: To qualify the LWIC under this assembly, a SOPREMA 1.7 in. Base Sheet Fastener or OMG CR Assembled Base Sheet Fastener (1.7") shall achieve an average withdrawal of 101 lbf when tested per TAS 105 or ANSI/SPRI FX-1	SBS-CA2 (sanded-top)	Min. 1.5-inch SOPRA-ISOs, SOPRA-ISO+s, EnergyGuard POLYISO Insulation, ENRGY 3, ENRGY 3 CGF, SOPRA-ISOr, SOPRA-ISO+r, SOPRA-ISOx or SOPRA-ISO+x	DUOTACK	Min. 0.125-inch SOPRABOARD, Min. 0.25-inch DensDeck Prime, DEXcell FA Glass Mat Roof Board or SECUROCK Gypsum-Fiber Roof Board or Min. 7/16-inch DEXcell Cement Roof Board. Top surface primed with Elastocol Stick Zero	DUOTACK	SBS-SA1	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-60.0

TABLE 4c: LIGHTWEIGHT INSULATING CONCRETE OVER STEEL OR STRUCTURAL CONCRETE DECKS – NEW CONSTRUCTION OR REROOF (TEAR-OFF)
SYSTEM TYPE E-1: LWC TO DECK, MECHANICALLY ATTACHED BASE SHEET, BONDED ROOF COVER

 REFER TO [NOTE 13](#) FOR DRY-IN / TEMPORARY ROOF OPTIONS (BETWEEN STRUCTURAL CONCRETE AND LIGHTWEIGHT CONCRETE)

System No.	Deck (Note 1)	Lightweight Concrete (Note 14)	Base Sheet			Roof Cover (Note 15)			MDP (psf)
			Base	Fasten	Spacing	Base Ply	Primer	LARS	
CELCORE (FL2037):									
LWC-11.	Min. 22 ga. steel at max 5 ft spans or structural concrete	Min. 300 psi, min 2-inch thick Celcore Cellular Concrete. After setting to support foot traffic, Celcore PVA Curing Compound is applied.	MODIFIED SOPRA-G, SOPRABASE S	SOPREMA 1.7 in. Base Sheet Fastener	7-inch o.c. at the 3-inch lap and 7-inch o.c. in two, equally spaced, staggered center rows	SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-75.0
PRE-EXISTENT CELLULAR LWC:									
LWC-12.	Min. 22 ga. type B steel at max. 5 ft spans or min. 2,500 psi structural concrete	Cellular lightweight concrete, Min. 300 psi, Min. 2-inch top coat. <i>Note: To qualify the LWIC under this assembly, a 1.8-inch Twin Loc-Nail shall achieve an average withdrawal of 99 lbf when tested per TAS 105 or ANSI/SPRI FX-1</i>	SOPRABASE TG	Min. 1.8-inch SOPREMA Twin Loc-Nail	9-inch o.c. at 4-inch laps and 9-inch o.c. in two, equally spaced, staggered center rows	SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-67.5
LWC-13.	Min. 22 ga. type B steel at max. 5 ft spans or min. 2,500 psi structural concrete	Cellular lightweight concrete, Min. 300 psi, Min. 2-inch top coat. <i>Note: To qualify the LWIC under this assembly, a 1.8-inch Twin Loc-Nail shall achieve an average withdrawal of 110 lbf when tested per TAS 105 or ANSI/SPRI FX-1</i>	SOPRABASE S, SOPRALENE 180 Sanded 2.2, SOPRALENE 180 Sanded	Min. 1.8-inch SOPREMA Twin Loc-Nail	9-inch o.c. at 4-inch laps and 9-inch o.c. in two, equally spaced, staggered center rows	SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-75.0

TABLE 4d: LIGHTWEIGHT INSULATING CONCRETE OVER STEEL DECKS – NEW CONSTRUCTION OR REROOF (TEAR-OFF)
SYSTEM TYPE E-1: THERMAL BARRIER TO DECK, TEMP ROOF TO THERMAL BARRIER, LWC TO TEMP ROOF, MECHANICALLY ATTACHED BASE SHEET, BONDED ROOF COVER

Sys. No.	Deck (Note 1)	Thermal Barrier			Temp Roof	Lightweight Concrete (Note 14)	Base Sheet			Roof Cover (Note 15)			MDP (psf)
		Type	Fast.	Attach			Base	Fastener (Note 11)	Spacing	Base Ply	Primer	LARS	
CELCORE (FL2037):													
LWC-14.	Min. 22 ga. type B steel at max. 6 ft spans	Min. 0.625-inch SECUROCK Gypsum-Fiber Roof Board	Note 2	1 per 1.6 ft²	SBS-TAF	Min. 300 psi, min 2-inch thick Celcore MF Cellular Concrete with Celcore HS Rheology Modifying Admixture. After setting to support foot traffic, Celcore PVA Curing Compound.	MODIFIED SOPRA-G, SOPRABASE S	SOPREMA 1.7 in. Base Sheet Fastener	7-inch o.c. at the 3-inch lap and 7-inch o.c. in two, equally spaced, staggered center rows	SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-75.0

TABLE 4E: LIGHTWEIGHT INSULATING CONCRETE OVER STEEL OR STRUCTURAL CONCRETE DECKS – NEW CONSTRUCTION OR REROOF (TEAR-OFF)
SYSTEM TYPE E-2: LWC TO DECK, MECHANICALLY ATTACHED SOPRAPHIX, BONDED ROOF COVER

 REFER TO [TABLE 1E](#) FOR DRY-IN / TEMPORARY ROOF OPTIONS (BETWEEN STRUCTURAL CONCRETE AND LIGHTWEIGHT CONCRETE)

System No.	Deck (Note 1)	Lightweight Concrete (Note 14)	Base Membrane			Roof Cover (Note 15)			MDP (psf)
			Base	Fastener (Note 11)	Spacing	Ply	Primer	LARS	
CELCORE (FL2037):									
LWC-15.	Min. 22 ga., type BV, Grade 40 steel or min. 2,500 psi structural concrete	Deck treated with Celcore S-1. Celcore MF with Celcore HS Rheology Modifying Admixture, Min. 300 psi, Min. 2-inch top coat Optional Celcore SBS (Sanded Bonding Surface) may be applied.	SOPRAPHIX Base 613	Versa-Fast Fastener & Plate	Versa-Fast Plate spaced 9-inch o.c. within the 5-inch wide, heat-welded side laps. Two (2) min. 2¼" long Versa-Fast Fastener installed 180° into the holes of the Versa-Fast Plate, parallel to the width-direction of the sheet.	(Optional) One or two SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-45.0
LWC-16.	Structural concrete	Treatment: Optional, Celcore S-1. LWC: Celcore MF with Celcore HS Rheology Modifying Admixture, Min. 390 psi, Min. 2-inch top coat. Surfacing: Optional, Celcore SBS (Sanded Bonding Surface).	SOPRAPHIX Base 613	Versa-Fast Fastener & Plate	Versa-Fast Plate spaced 10-inch o.c. within the 5-inch wide, heat-welded side laps. Two (2) min. 2¼" long Versa-Fast Fastener installed 180° into the holes of the Versa-Fast Plate, parallel to the width-direction of the sheet.	(Optional) One or two SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-45.0
LWC-17.	Structural concrete	Treatment: Optional when Dry-In/Temp Roof installed (Note 18), Celcore S-1. LWC: Celcore MF with Celcore HS Rheology Modifying Admixture, Min. 390 psi, Min. 2-inch top coat. Surfacing: Optional, Celcore SBS (Sanded Bonding Surface).	SOPRAPHIX Base 613	Versa-Fast Fastener & Plate	Versa-Fast Plate spaced 10-inch o.c. within the 5-inch wide, heat-welded side laps. Four (4) min. 2¼" long Versa-Fast Fastener installed into every-other hole of the Versa-Fast Plate, forming a square pattern with the square edges oriented in the principle directions of the roll.	(Optional) One or two SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-75.0

TABLE 4F: LIGHTWEIGHT INSULATING CONCRETE OVER STEEL DECKS – NEW CONSTRUCTION
SYSTEM TYPE F: LWC TO DECK, BONDED ROOF COVER

System No.	Deck (Note 1)	Lightweight Concrete (Note 14)			Primer	Roof Cover (Note 15)				MDP (psf)
		Bonding Agent	Type	Treatment		Base Ply	Ply	Primer	LARS	
CELCORE (FL2037):										
LWC-18.	Min. 22 ga., type BV, Grade 40 steel at max. 6 ft spans; 5/8" puddle welds, 6" o.c.	Celcore S-1 Deck Preparation Slurry	Celcore MF Cellular Concrete with Celcore HS Rheology Modifying Admixture, Min. 340 psi, min. 2-inch thick	Celcore PVA Curing Compound	None	SBS-CA2, 12-inch o.c.	(Optional) SBS-CA3 or SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-60.0
LWC-19.	Min. 22 ga., type BV, Grade 40 steel at max. 6 ft spans; 5/8" puddle welds, 6" o.c.	Celcore S-1 Deck Preparation Slurry	Celcore MF Cellular Concrete with Celcore HS Rheology Modifying Admixture, Min. 340 psi, min. 2-inch thick	Celcore PVA Curing Compound	None	SBS-CA2, 6-inch o.c.	(Optional) SBS-CA3 or SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-90.0

TABLE 4G: LIGHTWEIGHT INSULATING CONCRETE OVER STRUCTURAL CONCRETE DECKS – NEW CONSTRUCTION
SYSTEM TYPE F: LWC TO DECK, BONDED ROOF COVER

REFER TO [NOTE 13](#) FOR DRY-IN / TEMPORARY ROOF OPTIONS (BETWEEN STRUCTURAL CONCRETE AND LIGHTWEIGHT CONCRETE)

System No.	Deck (Note 1)	Dry-In / Temp Roof	Lightweight Concrete (Note 14)			Primer	Roof Cover (Note 15)				MDP (psf)
			Bonding Agent	Type	Treatment		Base Ply	Ply	Primer	LARS	
CELCORE (FL2037):											
LWC-20.	Structural Concrete	Note 18	None	Celcore MF Cellular Concrete with Celcore HS Rheology Modifying Admixture, Min. 300 psi, min. 2-inch thick.	Celcore PVA Curing Comp	(Optional) ASTM D41, Elastocol 500, Elastocol Stick	SBS-CA2, 12-inch o.c.	(Optional) SBS-CA3 or SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-60.0
LWC-21.	Structural Concrete	Note 18	None	Celcore MF Cellular Concrete with Celcore HS Rheology Modifying Admixture, Min. 330 psi, min. 2-inch thick	Celcore PVA Curing Compound	None	SBS-CA2, 6-inch o.c.	(Optional) SBS-CA3 or SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-180.0
LWC-22.	Structural Concrete	Note 18	None	Celcore MF Cellular Concrete with Celcore HS Rheology Modifying Admixture, Min. 330 psi, min. 2-inch thick	Celcore PVA Curing Compound	None	SBS-CA3	(Optional) SBS-CA3 or SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-392.5
LWC-23.	Structural concrete	Note 18	None	Celcore MF Cellular Concrete with Celcore HS Rheology Modifying Admixture, Min. 300 psi, min. 2-inch thick.	Celcore PVA Curing Compound	ASTM D41, Elastocol 500 or Elastocol Stick	SBS-TAP	(Optional) SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-217.5
LWC-24.	Structural concrete	None	None	Celcore MF Cellular Concrete with Celcore HS Rheology Modifying Admixture, Min. 300 psi, min. 2-inch thick.	Celcore PVA Curing Compound	ASTM D41, Elastocol 500 or Elastocol Stick	SBS-TAP	(Optional) SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-262.5
LWC-25.	Structural concrete	Note 18	None	Celcore MF Cellular Concrete with Celcore HS Rheology Modifying Admixture, Min. 300 psi, min. 2-inch thick.	Celcore PVA Curing Compound	None	SBS-TAP	(Optional) SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-307.5
CONCRECEL (FL5584 & FL10500):											
LWC-26.	Structural Concrete	(Optional) Asphaltic plies with asphalt flood coat	Concrecel Bonding Agent	Concrecel Concrete, Min. 300 psi, min. 2-inch thick	Concrecel Curing Comp	(Optional) ASTM D41, Elastocol 500, Elastocol Stick	SBS-CA2, 12-inch o.c.	(Optional) SBS-CA3 or SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-60.0
LWC-27.	Structural concrete	Asphaltic plies with asphalt flood coat	Concrecel Bonding Agent	Concrecel Concrete, Min. 300 psi, min. 2-inch thick	Concrecel Curing Compound	ASTM D41, Elastocol 500 or Elastocol Stick	SBS-TAP	(Optional) SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-202.5
LWC-28.	Structural concrete	None	None	Concrecel Concrete, Min. 300 psi, min. 2-inch thick	Concrecel Curing Compound	ASTM D41, Elastocol 500 or Elastocol Stick	SBS-TAP	(Optional) SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-217.5
ELASTIZELL (FL4994):											

TABLE 4G: LIGHTWEIGHT INSULATING CONCRETE OVER STRUCTURAL CONCRETE DECKS – NEW CONSTRUCTION
SYSTEM TYPE F: LWC TO DECK, BONDED ROOF COVER

REFER TO [NOTE 18](#) FOR DRY-IN / TEMPORARY ROOF OPTIONS (BETWEEN STRUCTURAL CONCRETE AND LIGHTWEIGHT CONCRETE)

System No.	Deck (Note 1)	Dry-In / Temp Roof	Lightweight Concrete (Note 14)			Primer	Roof Cover (Note 15)				MDP (psf)
			Bonding Agent	Type	Treatment		Base Ply	Ply	Primer	LARS	
LWC-29.	Structural Concrete	Note 18	None	Elastizell, Min. 300 psi, min. 2-inch thick.	None	(Optional) ASTM D41, Elastocol 500, Elastocol Stick	SBS-CA2, 12-inch o.c.	(Optional) SBS-CA3 or SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-60.0
LWC-30.	Structural concrete	Note 18	None	Elastizell, Min. 300 psi, min. 2-inch thick.	None	ASTM D41, Elastocol 500 or Elastocol Stick	SBS-TAP	(Optional) SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-217.5
PRE-EXISTENT CELLULAR LWC:											
LWC-31.	Structural Concrete	Note 18	None	Cellular lightweight concrete, Min. 330 psi, Min. 2-inch top coat <i>Note: To qualify the LWIC under this assembly, a SOPREMA 1.7 in. Base Sheet Fastener or OMG CR Assembled Base Sheet Fastener (1.7") shall achieve an average withdrawal of 101 lbf when tested per TAS 105 or ANSI/SPRI FX-1</i>	None	None	SBS-CA2, 12-inch o.c.	(Optional) SBS-CA3 or SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-60.0
LWC-32.	Structural Concrete	Note 18	None	Cellular lightweight concrete, Min. 350 psi, Min. 2-inch top coat <i>Note: To qualify the LWIC under this assembly, a SOPREMA 1.7 in. Base Sheet Fastener or OMG CR Assembled Base Sheet Fastener (1.7") shall achieve an average withdrawal of 101 lbf when tested per TAS 105 or ANSI/SPRI FX-1</i>	None	None	SBS-CA2, 6-inch o.c.	(Optional) SBS-CA3 or SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-180.0

TABLE 5A: CEMENTITIOUS WOOF FIBER DECKS – NEW CONSTRUCTION OR REROOF (TEAR-OFF)
SYSTEM TYPE A-1: BONDED INSULATION, BONDED ROOF COVER

System No.	Deck (Note 1)	Base Insulation Layer		Top Insulation Layer		Roof Cover (Note 15)				MDP (psf)
		Type	Attach (Notes 6,7,8)	Type	Attach (Notes 6,7,8)	Base Ply	Ply	Primer	LARS	
COLD APPLIED BASE:										
CWF-1.	Min. 2-inch Tectum Plank	Min. 1.5-inch SOPRA-ISOs, SOPRA-ISO+s, SOPRA-ISOr or SOPRA-ISO+r	DUOTACK, 4-inch o.c.	Min. 0.25-inch DEXcell FA Glass Mat Roof Board	DUOTACK	SBS-CA3	(Optional) SBS-CA3, SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-163.0
CWF-2.	Min. 2-inch Tectum Plank	Min. 1.5-inch SOPRA-ISOs, SOPRA-ISO+s, SOPRA-ISOr or SOPRA-ISO+r	DUOTACK, 4-inch o.c.	Min. 0.25-inch DEXcell FA Glass Mat Roof Board	DUOTACK, 6-inch o.c.	SBS-CA3	(Optional) SBS-CA3, SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-185.0
CWF-3.	Min. 2-inch Tectum Plank	Min. 0.25-inch DEXcell FA Glass Mat Roof Board	DUOTACK, 4-inch o.c.	None	N/A	SBS-CA3	(Optional) SBS-CA3, SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-185.0
CWF-4.	Min. 2-inch Tectum Plank	Min. 1.5-inch SOPRA-ISOs, SOPRA-ISO+s, SOPRA-ISOr or SOPRA-ISO+r	DUOTACK, 4-inch o.c.	Min. 7/16-inch DEXcell Cement Roof Board	DUOTACK	SBS-CA3	(Optional) SBS-CA3, SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-190.0
CWF-5.	Min. 2-inch Tectum Plank	Min. 1.5-inch SOPRA-ISOs, SOPRA-ISO+s, SOPRA-ISOr or SOPRA-ISO+r	DUOTACK, 4-inch o.c.	Min. 7/16-inch DEXcell Cement Roof Board	DUOTACK, 6-inch o.c.	SBS-CA3	(Optional) SBS-CA3, SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-285.0
CWF-6.	Min. 2-inch Tectum Plank	Min. 7/16-inch DEXcell Cement Roof Board	DUOTACK, 4-inch o.c.	None	N/A	SBS-CA3	(Optional) SBS-CA3, SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-285.0
CWF-7.	Min. 2-inch Tectum Plank	(Optional) Min. 1.5-inch SOPRA-ISOs, SOPRA-ISO+s, SOPRA-ISOr or SOPRA-ISOx	DUOTACK SPF HFO	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board or Min. 7/16-inch DEXcell Cement Roof Board	DUOTACK SPF HFO	SBS-CA3	(Optional) SBS-CA3, SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-75.0
TORCH-APPLIED BASE:										
CWF-8.	Min. 2-inch Tectum Plank	Min. 1.5-inch SOPRA-ISOs, SOPRA-ISO+s, SOPRA-ISOr or SOPRA-ISO+r	DUOTACK, 4-inch o.c.	Min. 0.25-inch DEXcell FA Glass Mat Roof Board	DUOTACK	SBS-TAF	(Optional) SBS-CA3, SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-163.0
CWF-9.	Min. 2-inch Tectum Plank	Min. 1.5-inch SOPRA-ISOs, SOPRA-ISO+s, SOPRA-ISOr or SOPRA-ISO+r	DUOTACK, 4-inch o.c.	Min. 0.25-inch DEXcell FA Glass Mat Roof Board	DUOTACK, 6-inch o.c.	SBS-TAF	(Optional) SBS-CA3, SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-185.0
CWF-10.	Min. 2-inch Tectum Plank	Min. 0.25-inch DEXcell FA Glass Mat Roof Board	DUOTACK, 4-inch o.c.	None	N/A	SBS-TAF	(Optional) SBS-CA3, SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-185.0
CWF-11.	Min. 2-inch Tectum Plank	Min. 1.5-inch SOPRA-ISOs, SOPRA-ISO+s, SOPRA-ISOr or SOPRA-ISO+r	DUOTACK, 4-inch o.c.	Min. 7/16-inch DEXcell Cement Roof Board	DUOTACK	SBS-TAF	(Optional) SBS-CA3, SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-190.0
CWF-12.	Min. 2-inch Tectum Plank	Min. 1.5-inch SOPRA-ISOs, SOPRA-ISO+s, SOPRA-ISOr or SOPRA-ISO+r	DUOTACK, 4-inch o.c.	Min. 7/16-inch DEXcell Cement Roof Board	DUOTACK, 6-inch o.c.	SBS-TAF	(Optional) SBS-CA3, SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-285.0

TABLE 5A: CEMENTITIOUS WOOF FIBER DECKS – NEW CONSTRUCTION OR REROOF (TEAR-OFF)
SYSTEM TYPE A-1: BONDED INSULATION, BONDED ROOF COVER

System No.	Deck (Note 1)	Base Insulation Layer		Top Insulation Layer		Roof Cover (Note 15)				MDP (psf)
		Type	Attach (Notes 6,7,8)	Type	Attach (Notes 6,7,8)	Base Ply	Ply	Primer	LARS	
CWF-13.	Min. 2-inch Tectum Plank	Min. 7/16-inch DEXcell Cement Roof Board	DUOTACK, 4-inch o.c.	None	N/A	SBS-TAF	(Optional) SBS-CA3, SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-285.0
CWF-14.	Min. 2-inch Tectum Plank	(Optional) Min. 1.5-inch SOPRA-ISOs, SOPRA-ISO+s, SOPRA-ISOr or SOPRA-ISOx	DUOTACK SPF HFO	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board or Min. 7/16-inch DEXcell Cement Roof Board	DUOTACK SPF HFO	SBS-TAF	(Optional) SBS-CA3, SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-75.0
SELF-ADHERING BASE:										
CWF-15.	Min. 2-inch Tectum Plank	Min. 1.5-inch SOPRA-ISOs, SOPRA-ISO+s, SOPRA-ISOr or SOPRA-ISO+r	DUOTACK, 4-inch o.c.	Min. 0.25-inch DEXcell FA Glass Mat Roof Board primed with Elastocol Stick or Elastocol Stick Zero	DUOTACK	SBS-SA1	(Optional) SBS-CA3, SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-163.0
CWF-16.	Min. 2-inch Tectum Plank	Min. 1.5-inch SOPRA-ISOs, SOPRA-ISO+s, SOPRA-ISOr or SOPRA-ISO+r	DUOTACK, 4-inch o.c.	Min. 0.25-inch DEXcell FA Glass Mat Roof Board primed with Elastocol Stick or Elastocol Stick Zero	DUOTACK, 6-inch o.c.	SBS-SA1	(Optional) SBS-CA3, SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-185.0
CWF-17.	Min. 2-inch Tectum Plank	Min. 0.25-inch DEXcell FA Glass Mat Roof Board	DUOTACK, 4-inch o.c.	None	N/A	SBS-SA1	(Optional) SBS-CA3, SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-185.0
CWF-18.	Min. 2-inch Tectum Plank	Min. 1.5-inch SOPRA-ISOs, SOPRA-ISO+s, SOPRA-ISOr or SOPRA-ISO+r	DUOTACK, 4-inch o.c.	Min. 7/16-inch DEXcell Cement Roof Board primed with Elastocol Stick or Elastocol Stick Zero	DUOTACK	SBS-SA1	(Optional) SBS-CA3, SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-190.0
CWF-19.	Min. 2-inch Tectum Plank	Min. 1.5-inch SOPRA-ISOs, SOPRA-ISO+s, SOPRA-ISOr or SOPRA-ISO+r	DUOTACK, 4-inch o.c.	Min. 7/16-inch DEXcell Cement Roof Board primed with Elastocol Stick or Elastocol Stick Zero	DUOTACK, 6-inch o.c.	SBS-SA1	(Optional) SBS-CA3, SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-285.0
CWF-20.	Min. 2-inch Tectum Plank	Min. 7/16-inch DEXcell Cement Roof Board	DUOTACK, 4-inch o.c.	None	N/A	SBS-SA1	(Optional) SBS-CA3, SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-285.0
CWF-21.	Min. 2-inch Tectum Plank	(Optional) Min. 1.5-inch SOPRA-ISOs, SOPRA-ISO+s, SOPRA-ISOr or SOPRA-ISOx	DUOTACK SPF HFO	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board or Min. 7/16-inch DEXcell Cement Roof Board. Top surface primed with ELASTOCOL Stick or ELASTOCOL Stick Zero.	DUOTACK SPF HFO	SBS-SA1	(Optional) SBS-CA3, SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-75.0

TABLE 5B: CEMENTITIOUS WOOF FIBER DECKS – NEW CONSTRUCTION OR REROOF (TEAR-OFF)
SYSTEM TYPE A-1A: BONDED THERMAL BARRIER, BONDED VAPOR BARRIER, BONDED INSULATION, BONDED ROOF COVER

System No.	Deck (Note 1)	Thermal Barrier		Primer	Vapor Barrier	Base Insulation Layer		Top Insulation Layer		Roof Cover (Note 15)				MDP (psf)
		Type	Attach (Notes 6,7,8)			Type	Attach (Notes 6,7,8)	Type	Attach (Notes 6,7,8)	Base Ply	Ply	Primer	LARS	
COLD APPLIED BASE:														
CWF-22.	Min. 2-inch Tectum Plank	Min. 0.25-inch DEXcell FA Glass Mat Roof Board	DUOTACK, 4-inch o.c.	None	SBS-CA3 or SBS-TAF	Min. 1.5-inch SOPRA-ISOs, SOPRA-ISO+s, SOPRA-ISOr or SOPRA-ISO+r	DUOTACK	Min. 0.25-inch DEXcell FA Glass Mat Roof Board or Min. 7/16-inch DEXcell Cement Roof Board	DUOTACK	SBS-CA3	(Optional) SBS-CA3, SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-163.0
CWF-23.	Min. 2-inch Tectum Plank	Min. 0.25-inch DEXcell FA Glass Mat Roof Board	DUOTACK, 4-inch o.c.	Elastocol Stick or Elastocol Stick Zero	SOPRAVAP' R, self-adhering or SBS-SA1	Min. 1.5-inch SOPRA-ISOs, SOPRA-ISO+s, SOPRA-ISOr or SOPRA-ISO+r	DUOTACK	Min. 0.25-inch DEXcell FA Glass Mat Roof Board Min. 7/16-inch DEXcell Cement Roof Board	DUOTACK	SBS-CA3	(Optional) SBS-CA3, SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-163.0
CWF-24.	Min. 2-inch Tectum Plank	Min. 0.25-inch DEXcell FA Glass Mat Roof Board	DUOTACK, 4-inch o.c.	None	SBS-CA3 or SBS-TAF	Min. 1.5-inch SOPRA-ISOs, SOPRA-ISO+s, SOPRA-ISOr or SOPRA-ISO+r	DUOTACK, 6-inch o.c.	Min. 0.25-inch DEXcell FA Glass Mat Roof Board	DUOTACK, 6-inch o.c.	SBS-CA3	(Optional) SBS-CA3, SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-185.0
CWF-25.	Min. 2-inch Tectum Plank	Min. 0.25-inch DEXcell FA Glass Mat Roof Board	DUOTACK, 4-inch o.c.	Elastocol Stick or Elastocol Stick Zero	SOPRAVAP' R, self-adhering or SBS-SA1	Min. 1.5-inch SOPRA-ISOs, SOPRA-ISO+s, SOPRA-ISOr or SOPRA-ISO+r	DUOTACK, 6-inch o.c.	Min. 0.25-inch DEXcell FA Glass Mat Roof Board	DUOTACK, 6-inch o.c.	SBS-CA3	(Optional) SBS-CA3, SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-185.0
TORCH-APPLIED BASE:														
CWF-26.	Min. 2-inch Tectum Plank	Min. 0.25-inch DEXcell FA Glass Mat Roof Board	DUOTACK, 4-inch o.c.	None	SBS-CA3 or SBS-TAF	Min. 1.5-inch SOPRA-ISOs, SOPRA-ISO+s, SOPRA-ISOr or SOPRA-ISO+r	DUOTACK	Min. 0.25-inch DEXcell FA Glass Mat Roof Board or Min. 7/16-inch DEXcell Cement Roof Board	DUOTACK	SBS-TAF	(Optional) SBS-CA3, SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-163.0
CWF-27.	Min. 2-inch Tectum Plank	Min. 0.25-inch DEXcell FA Glass Mat Roof Board	DUOTACK, 4-inch o.c.	Elastocol Stick or Elastocol Stick Zero	SOPRAVAP' R, self-adhering or SBS-SA1	Min. 1.5-inch SOPRA-ISOs, SOPRA-ISO+s, SOPRA-ISOr or SOPRA-ISO+r	DUOTACK	Min. 0.25-inch DEXcell FA Glass Mat Roof Board or Min. 7/16-inch DEXcell Cement Roof Board	DUOTACK	SBS-TAF	(Optional) SBS-CA3, SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-163.0

TABLE 5B: CEMENTITIOUS WOOF FIBER DECKS – NEW CONSTRUCTION OR REROOF (TEAR-OFF)
SYSTEM TYPE A-1A: BONDED THERMAL BARRIER, BONDED VAPOR BARRIER, BONDED INSULATION, BONDED ROOF COVER

System No.	Deck (Note 1)	Thermal Barrier		Primer	Vapor Barrier	Base Insulation Layer		Top Insulation Layer		Roof Cover (Note 15)				MDP (psf)
		Type	Attach (Notes 6,7,8)			Type	Attach (Notes 6,7,8)	Type	Attach (Notes 6,7,8)	Base Ply	Ply	Primer	LARS	
CWF-28.	Min. 2-inch Tectum Plank	Min. 0.25-inch DEXcell FA Glass Mat Roof Board	DUOTACK, 4-inch o.c.	None	SBS-CA3 or SBS-TAF	Min. 1.5-inch SOPRA-ISOs, SOPRA-ISO+s, SOPRA-ISOr or SOPRA-ISO+r	DUOTACK, 6-inch o.c.	Min. 0.25-inch DEXcell FA Glass Mat Roof Board or Min. 7/16-inch DEXcell Cement Roof Board	DUOTACK, 6-inch o.c.	SBS-TAF	(Optional) SBS-CA3, SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-185.0
CWF-29.	Min. 2-inch Tectum Plank	Min. 0.25-inch DEXcell FA Glass Mat Roof Board	DUOTACK, 4-inch o.c.	Elastocol Stick or Elastocol Stick Zero	SOPRAVAP' R, self-adhering or SBS-SA1	Min. 1.5-inch SOPRA-ISOs, SOPRA-ISO+s, SOPRA-ISOr or SOPRA-ISO+r	DUOTACK, 6-inch o.c.	Min. 0.25-inch DEXcell FA Glass Mat Roof Board or Min. 7/16-inch DEXcell Cement Roof Board	DUOTACK, 6-inch o.c.	SBS-TAF	(Optional) SBS-CA3, SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-185.0
SELF-ADHERING BASE:														
CWF-30.	Min. 2-inch Tectum Plank	Min. 0.25-inch DEXcell FA Glass Mat Roof Board	DUOTACK, 4-inch o.c.	None	SBS-CA3 or SBS-TAF	Min. 1.5-inch SOPRA-ISOs, SOPRA-ISO+s, SOPRA-ISOr or SOPRA-ISO+r	DUOTACK	Min. 0.25-inch DEXcell FA Glass Mat Roof Board or Min. 7/16-inch DEXcell Cement Roof Board. Top surface primed with Elastocol Stick or Elastocol Stick Zero	DUOTACK	SBS-SA1	(Optional) SBS-CA3, SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-163.0
CWF-31.	Min. 2-inch Tectum Plank	Min. 0.25-inch DEXcell FA Glass Mat Roof Board	DUOTACK, 4-inch o.c.	Elastocol Stick or Elastocol Stick Zero	SOPRAVAP' R, self-adhering or SBS-SA1	Min. 1.5-inch SOPRA-ISOs, SOPRA-ISO+s, SOPRA-ISOr or SOPRA-ISO+r	DUOTACK	Min. 0.25-inch DEXcell FA Glass Mat Roof Board or Min. 7/16-inch DEXcell Cement Roof Board. Top surface primed with Elastocol Stick or Elastocol Stick Zero	DUOTACK	SBS-SA1	(Optional) SBS-CA3, SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-163.0
CWF-32.	Min. 2-inch Tectum Plank	Min. 0.25-inch DEXcell FA Glass Mat Roof Board	DUOTACK, 4-inch o.c.	None	SBS-CA3 or SBS-TAF	Min. 1.5-inch SOPRA-ISOs, SOPRA-ISO+s, SOPRA-ISOr or SOPRA-ISO+r	DUOTACK, 6-inch o.c.	Min. 0.25-inch DEXcell FA Glass Mat Roof Board or Min. 7/16-inch DEXcell Cement Roof Board. Top surface primed with Elastocol Stick or Elastocol Stick Zero	DUOTACK, 6-inch o.c.	SBS-SA1	(Optional) SBS-CA3, SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-185.0
CWF-33.	Min. 2-inch Tectum Plank	Min. 0.25-inch DEXcell FA Glass Mat Roof Board	DUOTACK, 4-inch o.c.	Elastocol Stick or Elastocol Stick Zero	SOPRAVAP' R, self-adhering or SBS-SA1	Min. 1.5-inch SOPRA-ISOs, SOPRA-ISO+s, SOPRA-ISOr or SOPRA-ISO+r	DUOTACK, 6-inch o.c.	Min. 0.25-inch DEXcell FA Glass Mat Roof Board or Min. 7/16-inch DEXcell Cement Roof Board. Top surface primed with Elastocol Stick or Elastocol Stick Zero	DUOTACK, 6-inch o.c.	SBS-SA1	(Optional) SBS-CA3, SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-185.0

TABLE 6A: GYPSUM DECKS – REROOF (TEAR-OFF)
SYSTEM TYPE A-1: BONDED INSULATION, BONDED ROOF COVER
 REFER TO [NOTE 15](#) FOR VAPOR BARRIER OPTIONS.

System No.	Deck (Note 1 and Note 12)	Base Insulation Layer		Top Insulation Layer		Roof Cover (Note 15)				MDP (psf)
		Type	Attach (Notes 6,7,8)	Type	Attach (Notes 6,7,8)	Base Ply	Ply	Primer	LARS	
COLD-APPLIED BASE PLY:										
G-1	Existing poured gypsum or gypsum plank	(Optional) Min. 1.5-inch SOPRA-ISOs, SOPRA-ISO+s, EnergyGuard POLYSIO Insulation, ENRGY 3, ENRGY 3 CGF, SOPRA-ISOr, SOPRA-ISO+r or SOPRA-ISOx	DUOTACK	Min. 0.125-inch SOPRABOARD optionally primed with DETEC “TruGround Conductive Primer”	DUOTACK	SBS-CA3	(Optional) SBS-CA3, SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-115.0
TORCHED BASE PLY:										
G-2	Existing poured gypsum or gypsum plank	(Optional) Min. 1.5-inch SOPRA-ISOs, SOPRA-ISO+s, EnergyGuard POLYSIO Insulation, ENRGY 3, ENRGY 3 CGF, SOPRA-ISOr, SOPRA-ISO+r or SOPRA-ISOx	DUOTACK	SOPRASMART XP HD 180 (for TA Base Ply) or SOPRASMART XP HD 180 Sanded (for no Base Ply)	DUOTACK	(Optional) SBS-TAP, SBS-TAF	(Optional) SBS-CA3, SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-52.5
G-3	Existing poured gypsum or gypsum plank	(Optional) Min. 1.5-inch SOPRA-ISOs, SOPRA-ISO+s, EnergyGuard POLYSIO Insulation, ENRGY 3, ENRGY 3 CGF, SOPRA-ISOr, SOPRA-ISO+r or SOPRA-ISOx	DUOTACK	Min. 0.125-inch SOPRABOARD	DUOTACK	SBS-TAP, SBS-TAF	(Optional) SBS-CA3, SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-155.0
G-4	Existing poured gypsum or gypsum plank	(Optional) Min. 1.5-inch SOPRA-ISOs, SOPRA-ISO+s, EnergyGuard POLYSIO Insulation, ENRGY 3, ENRGY 3 CGF, SOPRA-ISOr, SOPRA-ISO+r or SOPRA-ISOx	DUOTACK	SOPRASMART Board 180 or SOPRASMART ISO HD 180 (for TA Base Ply) or SOPRASMART Board 180 Sanded or SOPRASMART ISO HD 180 Sanded (for no Base Ply)	DUOTACK	(Optional) SBS-TAP, SBS-TAF	(Optional) SBS-CA3, SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-162.5
G-5	Existing poured gypsum or gypsum plank	(Optional) Min. 1.5-inch SOPRA-ISOs, SOPRA-ISO+s, EnergyGuard POLYSIO Insulation, ENRGY 3, ENRGY 3 CGF, SOPRA-ISOr, SOPRA-ISO+r or SOPRA-ISOx	DUOTACK	Min. 0.25-inch DensDeck	DUOTACK	SBS-TAF	(Optional) SBS-CA3, SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-162.5
G-6	Existing poured gypsum or gypsum plank	(Optional) Min. 2-inch SOPRA-ISOs, SOPRA-ISO+s, EnergyGuard POLYSIO Insulation, ENRGY 3, ENRGY 3 CGF, SOPRA-ISOr, SOPRA-ISO+r or SOPRA-ISOx	DUOTACK	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	DUOTACK	SBS-TAP, SBS-TAF	(Optional) SBS-CA3, SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-162.5
G-7	Existing poured gypsum or gypsum plank	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board or Min. 7/16-inch DEXcell Cement Roof Board	DUOTACK SPF HFO	None	N/A	SBS-TAF	(Optional) SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-245.0
G-8	Existing poured gypsum or gypsum plank	Min. 1.5-inch SOPRA-ISOs, SOPRA-ISO+s, SOPRA-ISOr, SOPRA-ISO+r, SOPRA-ISOx or SOPRA-ISO+x	DUOTACK SPF HFO	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board or Min. 7/16-inch DEXcell Cement Roof Board	DUOTACK SPF HFO	SBS-TAF	(Optional) SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-245.0

TABLE 7A: RECOVER APPLICATIONS
SYSTEM TYPE A-1: BONDED INSULATION, BONDED ROOF COVER

^A The reported MDP documents the allowable maximum design pressure of the new insulation, coverboard and roof cover when adhered to the substrate, irrespective of the deck type (See [Note 1](#)) or performance of the substrate (See [Note 12](#)). The deck and substrate shall be capable of resisting the project design pressure requirements, not to exceed the noted MDP, to the satisfaction of the Authority Having Jurisdiction.

System No.	Substrate (Note 1 and Note 12)	Base Insulation Layer		Top Insulation Layer		Roof Cover (Note 15)			MDP (psf)
		Type	Attach (Notes 6,7,8)	Type	Attach (Notes 6,7,8)	Base Ply	Primer	LARS	
TORCH APPLIED BASE:									
R-1	Smooth- or granule-surface modified bitumen or BUR	(Optional) Min. 1.5-inch SOPRA-ISOs, SOPRA-ISO+s, EnergyGuard POLYSIO Insulation, ENRGY 3, ENRGY 3 CGF, SOPRA-ISOr, SOPRA-ISO+r or SOPRA-ISOx	DUOTACK	Min. 0.125-inch SOPRABOARD	DUOTACK	SBS-TAP, SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-150.0
R-2	Smooth- or granule-surface modified bitumen or BUR	(Optional) Min. 1.5-inch SOPRA-ISOs, SOPRA-ISO+s, EnergyGuard POLYSIO Insulation, ENRGY 3, ENRGY 3 CGF, SOPRA-ISOr, SOPRA-ISO+r or SOPRA-ISOx	DUOTACK	SOPRASMART Board 180 or SOPRASMART ISO HD 180 (for TA Base Ply) or SOPRASMART Board 180 Sanded or SOPRASMART ISO HD 180 Sanded (for no Base Ply)	DUOTACK	(Optional) SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-150.0
R-3	Smooth- or granule-surface modified bitumen or BUR	(Optional) Min. 1.5-inch SOPRA-ISOs, SOPRA-ISO+s, EnergyGuard POLYSIO Insulation, ENRGY 3, ENRGY 3 CGF, SOPRA-ISOr, SOPRA-ISO+r or SOPRA-ISOx	DUOTACK	Min. 0.25-inch DensDeck	DUOTACK	SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-150.0
R-4	Smooth- or granule-surface modified bitumen or BUR	(Optional) Min. 1.5-inch SOPRA-ISOs, SOPRA-ISO+s, EnergyGuard POLYSIO Insulation, ENRGY 3, ENRGY 3 CGF, SOPRA-ISOr, SOPRA-ISO+r or SOPRA-ISOx	DUOTACK	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	DUOTACK	SBS-TAP	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-150.0
R-5	Smooth- or granule-surface modified bitumen or BUR	(Optional) Min. 1.5-inch SOPRA-ISOs, SOPRA-ISO+s, EnergyGuard POLYSIO Insulation, ENRGY 3, ENRGY 3 CGF, SOPRA-ISOr, SOPRA-ISO+r or SOPRA-ISOx	DUOTACK	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	DUOTACK	SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-195.0
R-6	Smooth-surface SBS modified bitumen	Min. 2-inch SOPRA-ISOs, SOPRA-ISO+s, EnergyGuard POLYSIO Insulation, ENRGY 3, ENRGY 3 CGF, SOPRA-ISOr, SOPRA-ISO+r or SOPRA-ISOx	DUOTACK	Min. 0.125-inch SOPRABOARD or min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	DUOTACK	SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-260.0
R-7	Smooth-surface SBS modified bitumen	Min. 2-inch SOPRA-ISOs, SOPRA-ISO+s, EnergyGuard POLYSIO Insulation, ENRGY 3, ENRGY 3 CGF, SOPRA-ISOr, SOPRA-ISO+r or SOPRA-ISOx	DUOTACK	SOPRASMART Board 180 or SOPRASMART ISO HD 180 (for TA Base Ply) or SOPRASMART Board 180 Sanded or SOPRASMART ISO HD 180 Sanded (for no Base Ply)	DUOTACK	(Optional) SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-260.0
R-8	Existing sand-surface SBS modified bitumen	(Optional) Min. 1.5-inch SOPRA-ISOs, SOPRA-ISO+s, SOPRA-ISOr, SOPRA-ISO+r, SOPRA-ISOx or SOPRA-ISO+x	DUOTACK SPF HFO	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	DUOTACK SPF HFO	SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-222.5
R-9	Existing granule-surfaced modified bitumen or smooth-surface asphaltic built-up roof	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	DUOTACK SPF HFO	None	N/A	SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-245.0
R-10	Existing smooth-surface asphaltic built-up roof	Min. 1.5-inch SOPRA-ISOs, SOPRA-ISO+s, SOPRA-ISOr, SOPRA-ISO+r, SOPRA-ISOx or SOPRA-ISO+x	DUOTACK SPF HFO	Min. 0.25-inch DensDeck Prime or SECUROCK Gypsum-Fiber Roof Board	DUOTACK SPF HFO	SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-262.5

TABLE 7A: RECOVER APPLICATIONS
SYSTEM TYPE A-1: BONDED INSULATION, BONDED ROOF COVER

^A The reported MDP documents the allowable maximum design pressure of the new insulation, coverboard and roof cover when adhered to the substrate, irrespective of the deck type (See [Note 1](#)) or performance of the substrate (See [Note 12](#)). The deck and substrate shall be capable of resisting the project design pressure requirements, not to exceed the noted MDP, to the satisfaction of the Authority Having Jurisdiction.

System No.	Substrate (Note 1 and Note 12)	Base Insulation Layer		Top Insulation Layer		Roof Cover (Note 15)			MDP (psf)
		Type	Attach (Notes 6,7,8)	Type	Attach (Notes 6,7,8)	Base Ply	Primer	LARS	
R-11	Existing granule-surfaced modified bitumen	Min. 1.5-inch SOPRA-ISOs, SOPRA-ISO+s, SOPRA-ISOr, SOPRA-ISO+r, SOPRA-ISOx or SOPRA-ISO+x	DUOTACK SPF HFO	Min. 0.25-inch DensDeck Prime or SECUROCK Gypusm-Fiber Roof Board	DUOTACK SPF HFO	SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-270.0
SELF-ADHERING BASE:									
R-12	Smooth- or granule-surface modified bitumen or BUR	Min. 1.4-inch SOPRA-ISOs, SOPRA-ISO+s, EnergyGuard POLYSIO Insulation, ENRGY 3, ENRGY 3 CGF, SOPRA-ISOr, SOPRA-ISO+r or SOPRA-ISOx	DUOTACK	(Optional) Additional layers of base insulation	DUOTACK	SBS-SA1	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-150.0
R-13	Smooth- or granule-surface modified bitumen or BUR	(Optional) Min. 1.5-inch SOPRA-ISOs, SOPRA-ISO+s, EnergyGuard POLYSIO Insulation, ENRGY 3, ENRGY 3 CGF, SOPRA-ISOr, SOPRA-ISO+r or SOPRA-ISOx	DUOTACK	Min. 0.125-inch SOPRABOARD	DUOTACK	SBS-SA1	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-150.0
R-14	Smooth- or granule-surface modified bitumen or BUR	(Optional) Min. 2-inch SOPRA-ISOs, SOPRA-ISO+s, EnergyGuard POLYSIO Insulation, ENRGY 3, ENRGY 3 CGF, SOPRA-ISOr, SOPRA-ISO+r or SOPRA-ISOx	DUOTACK	Min. 0.25-inch SECUROCK Gypsum-Fiber Roof Board	DUOTACK	SBS-SA1	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-150.0
R-15	Existing sand-surface SBS modified bitumen	(Optional) Min. 1.5-inch SOPRA-ISOs, SOPRA-ISO+s, SOPRA-ISOr, SOPRA-ISO+r, SOPRA-ISOx or SOPRA-ISO+x	DUOTACK SPF HFO	Min. 0.25-inch DensDeck Prime or SECUROCK Gypusm-Fiber Roof Board. Top surface primed with ELASTOCOL Stick or ELASTOCOL Stick Zero.	DUOTACK SPF HFO	SBS-SA1	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-222.5
R-16	Existing granule-surfaced modified bitumen or smooth-surface asphaltic built-up roof	Min. 0.25-inch DensDeck Prime or SECUROCK Gypusm-Fiber Roof Board. Top surface primed with ELASTOCOL Stick or ELASTOCOL Stick Zero.	DUOTACK SPF HFO	None	N/A	SBS-SA1	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-245.0
R-17	Existing smooth-surface asphaltic built-up roof	Min. 1.5-inch SOPRA-ISOs, SOPRA-ISO+s, SOPRA-ISOr, SOPRA-ISO+r, SOPRA-ISOx or SOPRA-ISO+x	DUOTACK SPF HFO	Min. 0.25-inch DensDeck Prime or SECUROCK Gypusm-Fiber Roof Board. Top surface primed with ELASTOCOL Stick or ELASTOCOL Stick Zero.	DUOTACK SPF HFO	SBS-SA1	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-262.5
R-18	Existing granule-surfaced modified bitumen	Min. 1.5-inch SOPRA-ISOs, SOPRA-ISO+s, SOPRA-ISOr, SOPRA-ISO+r, SOPRA-ISOx or SOPRA-ISO+x	DUOTACK SPF HFO	Min. 0.25-inch DensDeck Prime or SECUROCK Gypusm-Fiber Roof Board. Top surface primed with ELASTOCOL Stick or ELASTOCOL Stick Zero.	DUOTACK SPF HFO	SBS-SA1	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-270.0

TABLE 7B: RE-ROOF (TEAR-OFF) OR RECOVER APPLICATIONS
SYSTEM TYPE E-2: MECHANICALLY ATTACHED SOPRAPHIX, BONDED ROOF COVER

System No.	Substrate (Note 1 and Note 12)	Base Membrane			Roof Cover (Note 15)			MDP (psf)
		Type	Fastener (Note 11)	Spacing	Ply	Primer	LARS	
R-19	Pre-existent min. 300 psi cellular lightweight insulating concrete over steel or structural concrete deck or poured gypsum or gypsum plank	SOPRAPHIX Base 613	Versa-Fast Fastener & Plate to engage existing substrate (Field W/D $\geq$ 193 lbf; see Note below)	Versa-Fast Plate spaced 9-inch o.c. within the 5-inch wide, heat-welded side laps. Minimum two (2) Versa-Fast Fastener installed 180° into the holes of the Versa-Fast Plate, parallel to the width-direction of the sheet (see Note below).	(Optional) One or two SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-45.0
R-20	Pre-existent min. 360 psi aggregate or min. 320 psi cellular lightweight insulating concrete over structural concrete deck or poured gypsum or gypsum plank	SOPRAPHIX Base 613	Versa-Fast Fastener & Plate to engage existing substrate (Field W/D $\geq$ 226 lbf; see Note below)	Versa-Fast Plate spaced 9-inch o.c. within the 5-inch wide, heat-welded side laps. Minimum three (3) Versa-Fast Fastener installed parallel to the width direction of the sheet into the holes of the Versa-Fast Plate (see Note below).	(Optional) One or two SBS-TAF	(Optional) RS 222	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-52.5

Note: The number of Versa-Fast Fastener used in the Versa-Fast Plate may be increased from the minimum noted in order to achieve the required minimum field withdrawal performance noted for the system.

TABLE 7C: RECOVER APPLICATIONS
SYSTEM TYPE F: NON-INSULATED, BONDED ROOF COVER

^A The reported MDP documents the allowable maximum design pressure of the new roof cover when adhered to the substrate, irrespective of the deck type (See [Note 1](#)) or performance of the substrate (See [Note 12](#)). The deck and substrate shall be capable of resisting the project design pressure requirements, not to exceed the noted MDP, to the satisfaction of the Authority Having Jurisdiction.

System No.	Substrate (Note 1 and Note 12)	Treatment	Roof Cover (Note 15)	MDP (psf)
R-21	Existing granule surfaced SBS modified bitumen roof cover	Remove loose granules	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-217.5
R-22	Existing fully-adhered, PVC single ply roof cover	Clean with ALSAN RS Cleaner	ALSAN RS 230, ALSAN Trafik RS 730 or ALSAN RS 260 LO system	-217.5