

**EVALUATION REPORT OF
CENTRAL STATES MANUFACTURING, INC.
'R-LOC PANEL'**


**FLORIDA BUILDING CODE 6TH EDITION (2017)
FLORIDA PRODUCT APPROVAL
FL 14024.1-R3
PANEL WALLS
SIDING**

**Prepared For:
Central States Manufacturing, Inc.
302 Jane Place
Lowell, AR 72745
Telephone: (800) 356-2733
Fax: (800) 356-2971**

**Prepared By:
Bala Sockalingam, Ph.D., P.E.
Florida Professional Engineer #62240
1216 N Lansing Ave., Suite C
Tulsa, OK 74106
Telephone: (918) 492-5992
FAX: (866) 366-1543**

**This report consists of
Evaluation Report (2 Pages including cover)
Installation Details (1 Page)**

**Report No. C2184-4
Date: 9.19.2017**

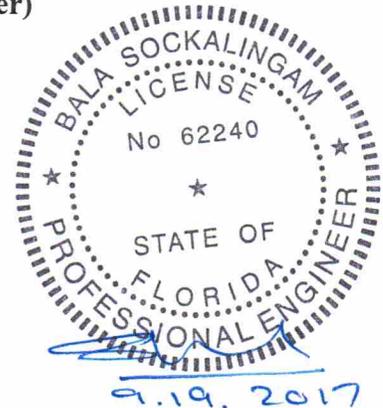

Manufacturer: Central States Manufacturing, Inc.

Product Name: R-Loc Panel

Panel Description: 36" wide coverage with (4) 1-1/4" high ribs

Materials: Min. 26 ga., 80 ksi steel or min. 24 ga., 50 ksi steel. Galvanized coated steel (ASTM A653) or Galvalume coated steel (ASTM A792) or painted steel (ASTM A755).

Support Description: Min. 16 ga., 50 ksi steel section. (Must be designed by others)

Design Uplift Pressure: 44.2 psf @ fastener spacing of 60 o.c. (3 or more spans)
(Factor of Safety = 2) 112.7 psf @ fastener spacing of 24 o.c. (3 or more spans)

Panel Attachment:
At all supports: #12-14 x 1-1/4" long SDS with washer @ 12" o.c. across panel width

Sidelap Attachment: 1/4"-14 x 7/8" long SDS with washer @ 20" o.c.


Test Standards: Wall assembly tested in accordance with ASTM E1592-01 'Test Method for Structural Performance of Sheet Metal Roof and Siding Systems by Uniform Static Air Pressure Difference'.

Test Equivalency: The test procedures in ASTM E1592-01 comply with test procedures prescribed in ASTM E1592-05(2012).

Code Compliance: The product described herein has demonstrated compliance with FBC 2017 Section 1404.5.

Product Limitations: Design wind loads shall be determined for each project in accordance with FBC 2017 Section 1609 or ASCE 7-10 using allowable stress design. The maximum support spacing listed herein shall not be exceeded. The design pressure for reduced support spacing may be computed using rational analysis prepared by a Florida Professional Engineer. This evaluation report is not applicable in High Velocity Hurricane Zone.

Supporting Documents: ASTM E1592 Test Reports
Force Engineering and Testing Inc.
Report No. 410-0237T-13A, B, Reporting Date 12/21/2013

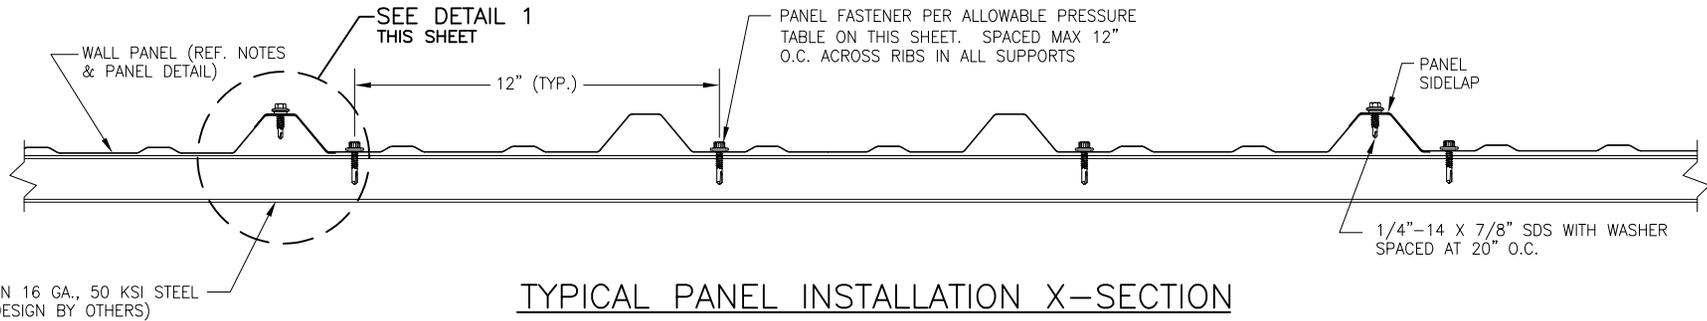

TYPICAL PANEL INSTALLATION X-SECTION

#12-14 X 1-1/4" LONG SELF DRILLING SCREW WITH INTEGRAL WASHER @ 12" O.C.

R-LOC PANEL

SIDELAP FASTENER 1/4"-14 SDS WITH WASHER @ 20" O.C.

MAX 60" O.C.

#12-14 X 1-1/4" LONG SELF DRILLING SCREW WITH INTEGRAL WASHER @ 12" O.C.

MIN 16 GA. SUPPORTS (DESIGN BY OTHERS)


SECTION VIEW

ALLOWABLE OUTWARD PRESSURE

PANEL FASTENERS SPACING ALONG RIB	PRESSURE (PSF)
60"	44.2
24"	112.7

GENERAL NOTES:

1. STRUCTURAL WALL PANEL HAS BEEN DESIGNED IN ACCORDANCE WITH THE FLORIDA BUILDING CODE (FBC).
2. PANELS SHALL BE MIN. 26 GA. (t = 0.019"). EFFECTIVE COVERING WIDTH OF PANEL = 36".
3. WALL PANELS SHALL BE INSTALLED OVER STRUCTURE AS SPECIFIED ON THIS DRAWING.
4. REQUIRED DESIGN WIND LOADS SHALL BE DETERMINED FOR EACH PROJECT. THIS PANEL SYSTEM MAY NOT BE INSTALLED WHEN THE REQUIRED DESIGN WIND LOADS ARE GREATER THAN THE ALLOWABLE WIND LOADS SPECIFIED ON THIS DRAWING.
5. ALL FASTENERS MUST BE IN ACCORDANCE WITH THIS DRAWING & THE FLORIDA BUILDING CODE. IF A DIFFERENCE OCCURS BETWEEN THE MINIMUM REQUIREMENTS OF THIS DRAWING & THE CODE, THE CODE SHALL CONTROL.
6. PURLINS/JOISTS/TRUSSES MUST BE DESIGNED TO WITHSTAND WIND LOADS AS REQUIRED FOR EACH APPLICATION AND ARE THE RESPONSIBILITY OF OTHERS.

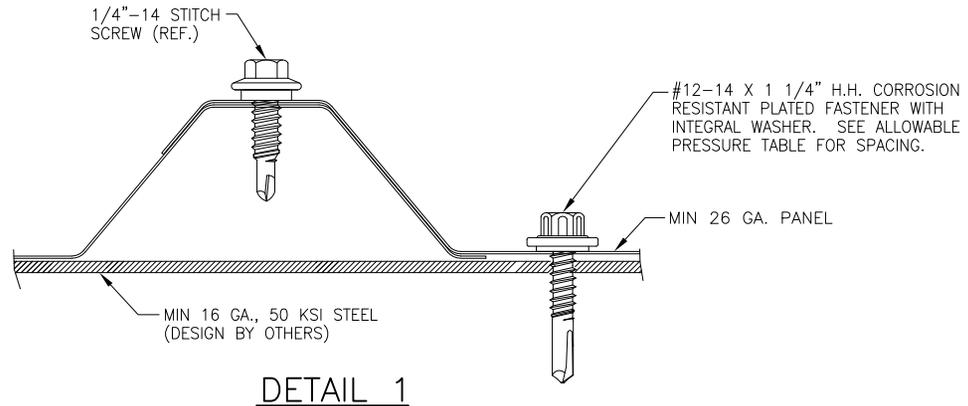

DETAIL 1

DRAWN BY: B.S.	CHECKED BY: A.H.
PLOT:	DATE: 8/21/15
NO.	REVISION DESCRIPTION
DATE	
BY	
DESCRIPTION	
DRAWING TITLE R-LOC WALL PANEL	
CONSULTANTS BALA SOCKALINGAM, PH.D., P.E.	
MANUFACTURER CENTRAL STATES MANUFACTURING, INC.	
1216 N LANSING AVE, SUITE C TULSA, OK 74106 PHONE: 918-492-9992 FAX: 866-366-1543	
302 JANE PLACE LOWELL, AR 72745 800-356-2733	
DRAWING NO. 2184-4	REV.
PAGE NO. 1	OF 1