

## Evaluation Report "Deep Deck" Metal Roof Assembly

**Manufacturer:**  
**Berridge Manufacturing Company**  
1720 Maury Road  
Houston, TX 77026  
(800) 231-8127

*for*

**Florida Product Approval**  
**# FL 14210.5 R6**  
**Florida Building Code 8th Edition (2023)**

**Method:** 1 - D  
**Category:** Structural Components  
**Sub - Category:** Roof Deck

**Product:** "Deep Deck" Roof Panel  
**Material:** Steel  
**Panel Width:** 36"  
**Support:** Steel Purlins


### Prepared by:

James L. Buckner, P.E., S.E.C.B.  
Florida Professional Engineer # 31242  
Florida Evaluation ANE ID: 1916  
Project Manager: Diana Galloway  
Report No. 23-542-DD-S4,2P-ER  
(Revises Report No. 20-227-DD-S4,2P-ER, FL14210.5 R5)  
Date: 09/26/2023

### Contents:

Evaluation Report                      Pages 1 – 7

This item has been digitally signed and sealed by James L. Buckner, P.E., on this date below. Printed copies of this document are not considered signed and sealed, and the signature must be verified on any electronic copies.

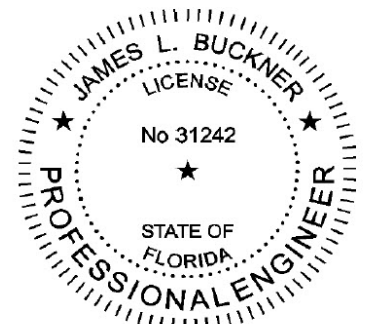

James L. Buckner, P.E.  
FL31242

Date: 2023.09.26 15:25:27  
1-04'00

<b>Manufacturer:</b>	<b>Berridge Manufacturing Company</b> 1720 Maury Road Houston, TX 77026 (800) 231-8127 <a href="http://www.berridge.com">www.berridge.com</a>
<b>Product Name:</b>	<b>“Deep Deck”</b>
<b>Product Category:</b>	Structural Components
<b>Product Sub-Category</b>	Roof Deck
<b>Compliance Method:</b>	State Product Approval Rule 61G20-3.005 (1) (d)
<b>Product/System Description:</b>	“Deep Deck” Roof Panel Steel lapped roof panel fastened into Steel Purlins.
<b>Product Assembly as Evaluated:</b>	Refer to Page 4 of this report for product assembly components/materials & standards: <ol style="list-style-type: none"><li>1. Roof Panel</li><li>2. Panel Clip</li><li>3. Fasteners</li></ol>
<b>Support:</b>	<b>Type:</b> Steel Purlins (Design of steel support and its attachment to support framing is outside the scope of this evaluation.) <b>Description:</b> <ul style="list-style-type: none"><li>• 16 Gauge minimum</li><li>• Yield Strength: 50 ksi minimum</li></ul>
<b>Slope:</b>	Minimum slope shall be in compliance with FBC Chapter 15 based on the type of roof covering, applicable code sections and in accordance with manufacturer’s recommendations.
<b>Performance:</b>	Wind Uplift Resistance: <ul style="list-style-type: none"><li>• Design Uplift Pressure: <b>Refer to Table “A”</b> (Refer to “Table A” attachment details herein)</li></ul>

- Performance Standards:** The product described herein has demonstrated compliance with:
- UL580-06 – *Test for Uplift Resistance of Roof Assemblies*
  - UL 1897-15 – *Uplift test for roof covering systems*
  - TAS 125-03 – *Standard Requirements for Metal Roofing Systems*
- Standards Equivalency:** The UL 580-94 & UL 1897-98 standard version used to test the evaluated product assembly is equivalent with the prescribed standards in UL 580-06 & UL 1897-15 adopted by the Florida Building Code 8th Edition (2023).
- Code Compliance:** The product described herein has demonstrated compliance with Florida Building Code 8th Edition (2023), Section 1504.3.2.
- Evaluation Report Scope:** This product evaluation is limited to compliance with the structural requirements of the Florida Building Code, as related to the scope section to Florida Product Approval Rule 61G20-3.001.
- Limitations and Conditions of Use:**
- Diaphragm and axial load capacity is outside the scope of this evaluation.
  - Scope of “Limitations and Conditions of Use” for this evaluation:  
This evaluation report for “Optional Statewide Approval” contains technical documentation, specifications and installation method(s) which include “Limitations and Conditions of Use” throughout the report in accordance with Rule 61G20-3.005. Per Rule 61G20-3.004, the Florida Building Commission is the authority to approve products under “Optional Statewide Approval”.
  - Option for application outside “Limitations and Conditions of Use”  
Rule 61G20-3.005(1)(e) allows engineering analysis for “project specific approval by the local authorities having jurisdiction in accordance with the alternate methods and materials authorized in the Code”. Any modification of the product as evaluated in this report and approved by the Florida Building Commission is outside the scope of this evaluation and will be the responsibility of others.
  - This report is a building code product evaluation per FLPE rule (FAC) 61G15-36 to comply with Florida product approval rule (FAC) 61G20-3. This evaluation report is part of the Florida Building Commission approval for the listed code related criteria. This report by James Buckner, P.E. and CBUGK Engineering is not a design certification of code compliance construction submittal documentation, per FBC section 107, for any individual structure, site specific or permit design.
  - All metal components and fasteners shall be corrosion resistant in accordance with applicable sections of FBC.
  - Design of support system is outside the scope of this report. Support shall be designed by others and shall comply with the FBC Chapters 22 for steel and Chapter 16 for structural loading.
  - Fire Classification is outside the scope of Rule 61G20-3, and is therefore not included in this evaluation. This evaluation report does not evaluate the use of this product for use in the High Velocity Hurricane Zone code section. (Dade & Broward Counties).
- Quality Assurance:** The manufacturer has demonstrated compliance of roof panel products in accordance with the Florida Building Code and Rule 61G20-3.0005 (3) for manufacturing under a quality assurance program audited by an approved quality assurance entity through **UL, LLC (FBC Organization #: QUA 9625)**.

**Components/Materials  
(by Manufacturer):**

**Roof Panel:**

Material: Berridge "Deep Deck"  
Steel  
Thickness: 24 gauge (min.) or 22 gauge (min.)  
Panel Width: 36" (max.) Coverage  
Rib Height: 1-1/2"  
Yield Strength: 40 ksi min.  
Steel Grade: 40  
Corrosion Resistance: In compliance with FBC Section 1507.4.3:

- ASTM A792 coated, or
- ASTM A653 G90 galvanized steel

**Fastener:**

**FASTENER 1:**

Type: Panel to Deck Fastener  
Hex-Head Screw with WSW  
Size : **1/4" - 14 x 1"**  
Corrosion Resistance: Per FBC Section 1506.6 and 1507.4.4  
Standard: Per FBC 1507.6.6

**FASTENER 2:**

Type: Panel to Panel, Stitch Fastener  
Hex-Head Screw with WSW  
Size : **1/4" x 7/8"**  
Corrosion Resistance: Per FBC Section 1506.6 and 1507.4.4  
Standard: Per FBC 1507.6.6

**Installation:**

**Installation Method:**

(Refer to **"TABLE A"** below and drawings at the end of this report.)

- Purlin Spacing: **Refer to "TABLE A" Below**
- Fastener spacing: **7.2" o.c.**  
(every corrugation valley)
- # fasteners (at each purlin intersection): **Refer to "TABLE A"**
- **Sidelap spacing: 18" o.c.** (along the length of the side laps)
- Minimum fastener penetration thru bottom of support, 3/4".  
(through flange of steel purlins)

<b>TABLE "A"</b>				
<b>"Deep Deck" Steel Roof Panel attached to Steel Purlins"</b>				
<b>ALLOWABLE LOADS</b>				
	<b>METHOD 1:</b>	<b>METHOD 2:</b>	<b>METHOD 3:</b>	<b>METHOD 4:</b>
<b>Design Pressure:</b>	<b>- 100 PSF</b>	<b>- 110 PSF</b>	<b>- 182 PSF</b>	<b>- 160 PSF</b>
Panel Thickness:	24 ga. (min.)	24 ga. (min.)	24 ga. (min.)	22 ga. (min.)
Purlin Spacing:	60" (5'- 0")	60" (5'- 0")	30" (2'-6")	60" (5'-0")
Fastener Spacing:	7.2"	7.2"	7.2"	7.2"
# of Fasteners:	1	2	1	2
Side-lap Spacing:	18"	18"	18"	18"
Span Condition:	3 or more	3 or more	3 or more	3 or more
Notes: • Allowable design pressure(s) for allowable stress design (ASD). • Fastener Attachment to Steel Supports May Be Designed By A Qualified Design Professional As Required By The Florida Building Code For Site Specific Projects. • Diaphragm and axial load capacity are not included in this evaluation.				


Install the "Deep Deck" roof panel assembly in compliance with the installation method listed in this report and applicable code sections of FBC 8th Edition (2023). The installation method described herein is in accordance with the scope of this evaluation report. Refer to manufacturer's installation instructions as a supplemental guide for attachment.

**Referenced Data:**


1. TAS 125-03 Uplift Test  
Force Engineering & Testing Inc. (FBC Organization ID# TST 5328)  
Report # 49-0419T-08A-C, & D Dated 12/08/08
2. Quality Assurance  
UL, LLC (FBC Organization #: QUA 9625)
3. Equivalency of Test Standard Certification  
By James L. Buckner, P.E. @ CBUCK Engineering  
(FBC Organization # ANE 1916)
4. Certification of Independence  
By James L. Buckner, P.E. @ CBUCK Engineering  
(FBC Organization # ANE 1916)

## Installation Method Berridge Manufacturing Company "Deep Deck" Steel Roof Panel attached to Steel Purlins

### Drawings

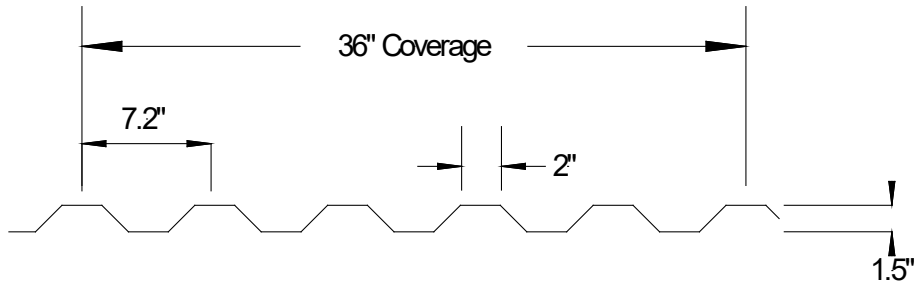


Typical Panel Profile

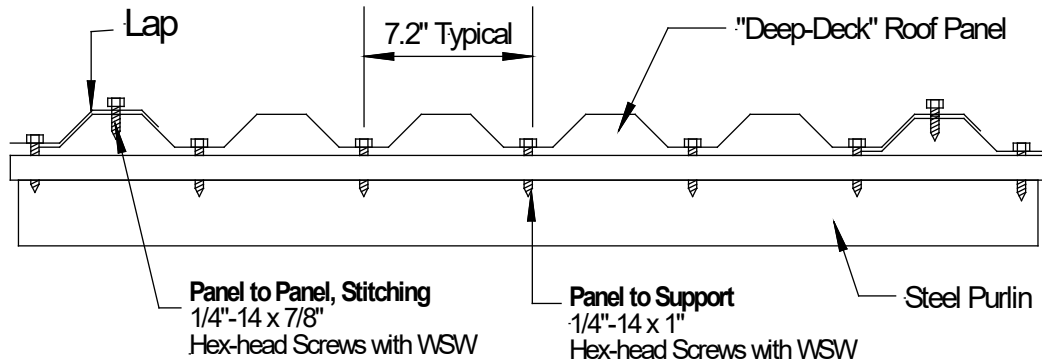

### Assembly Profile View


Typical Fastening Pattern Across Row – One Screw per Purlin Intersection

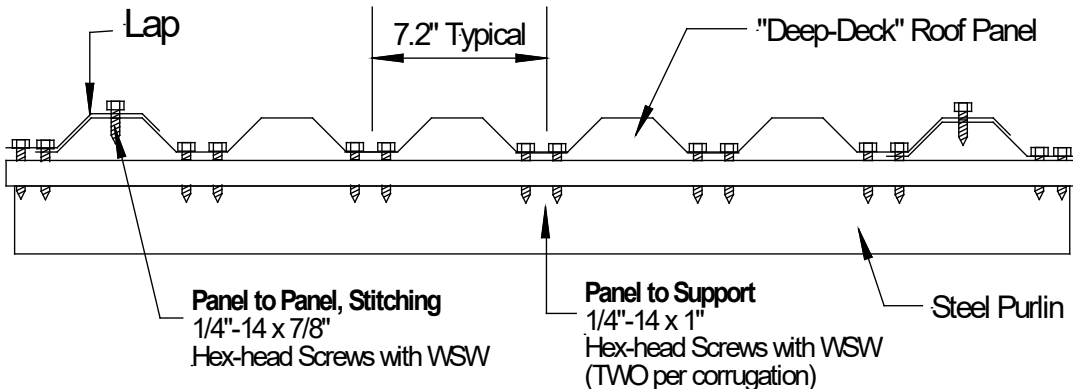

### Assembly Profile View

Typical Fastening Pattern Across Row – Two Screws per Purlin Intersection

## Installation Method Berridge Manufacturing Company "Deep Deck" Steel Roof Panel attached to Steel Purlins

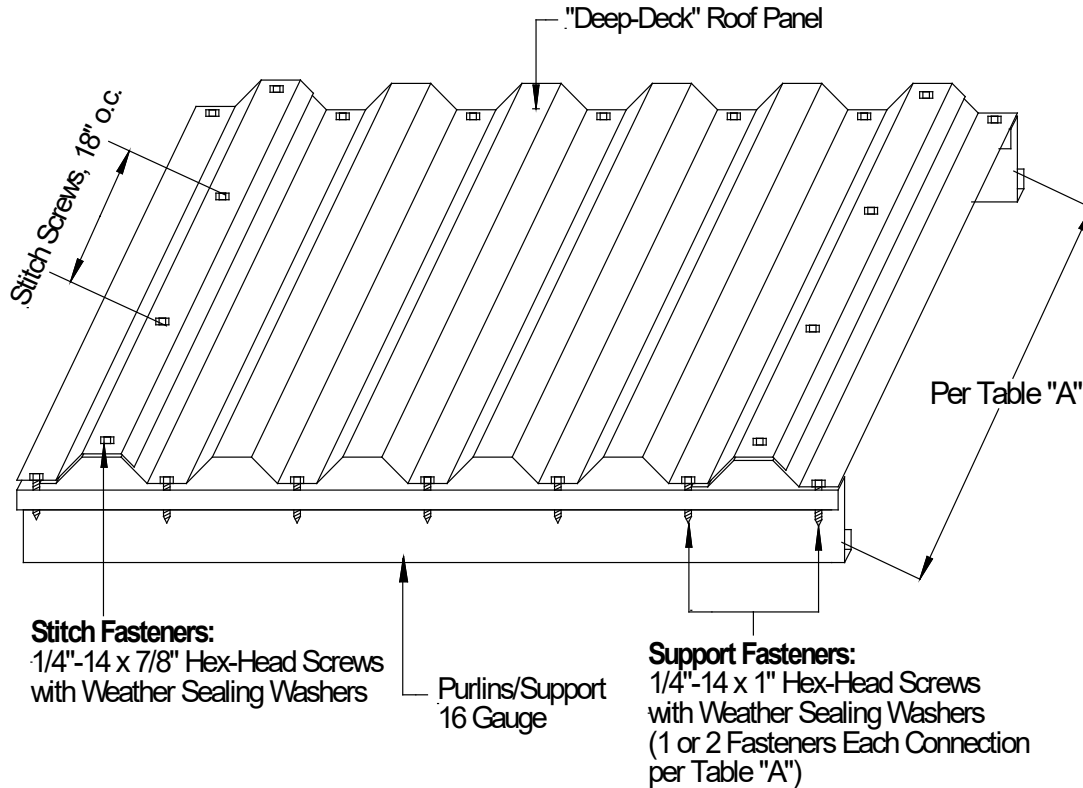

**Typical Roof Assembly  
Isometric View**

<b>TABLE "A"</b> <b>"Deep Deck" Steel Roof Panel attached to Steel Purlins"</b> <b>ALLOWABLE LOADS</b>				
	<b>METHOD 1:</b>	<b>METHOD 2:</b>	<b>METHOD 3:</b>	<b>METHOD 4:</b>
<b>Design Pressure:</b>	- 100 PSF	- 110 PSF	- 182 PSF	- 160 PSF
<b>Panel Thickness:</b>	24 ga. (min.)	24 ga. (min.)	24 ga. (min.)	22 ga. (min.)
<b>Purlin Spacing:</b>	60" (5'- 0")	60" (5'- 0")	30" (2'-6")	60" (5'-0")
<b>Fastener Spacing:</b>	7.2"	7.2"	7.2"	7.2"
<b># of Fasteners:</b>	1	2	1	2
<b>Side-lap Spacing:</b>	18"	18"	18"	18"
<b>Span Condition:</b>	3 or more	3 or more	3 or more	3 or more