



398 E DANIA BEACH BLVD. SUITE 338, DANIA BEACH, FL 33004

Product Evaluation Report

of

**JELD-WEN, inc.
Contours Steel Door, Wood Edge
6'-8" Opaque Outswing Impact Door Units
With & Without Non-Impact Sidelites**

for

Florida Product Approval

Report No. 7945

Current Florida Building Code

Method:	1 – A (Certification)
Category:	Exterior Doors
Sub – Category:	Swinging Exterior Door Assemblies
Product:	Contours Steel Door, Wood Edge
Material:	Steel/Wood
Product Dimensions:	107" X 81.25" (Maximum)

Prepared for:


**JELD-WEN, inc.
3737 Lakeport Blvd.
Klamath Falls, OR. 97601**

Prepared by:

Hermes F. Norero, P.E.
Florida Professional Engineer # 73778
Date: 03/28/2022

Contents:

Evaluation Report Pages 1 – 3

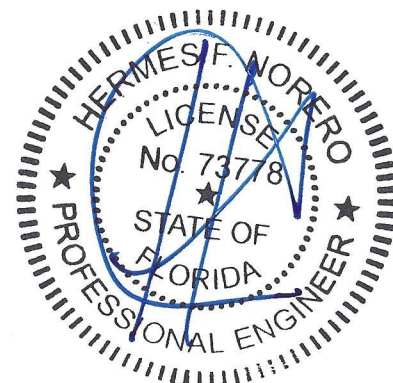

Hermes F. Norero, P.E.
Florida No. 73778

Manufacturer: JELD-WEN, inc.

Product Category: Exterior Doors

Product Sub-Category: Swinging Exterior Door Assemblies

Compliance Method: State Product Approval Method (1)(a)

Product Name: **Contours Steel Door, Wood Edge**
107" X 81.25" (Maximum)

Scope: This is a Product Evaluation Report issued by Hermes F. Norero, P.E. (FL # 73778) for **JELD-WEN, inc.** based on Method 1a of the State of Florida Product Approval, Florida Department of Business and Professional Regulation - Florida Building Commission.

Hermes F. Norero, P.E. does not have nor will acquire financial interest in the company manufacturing or distributing the product or in any other entity involved in the approval process of the product named herein.

This product has been evaluated for use in locations adhering to the current Florida Building Code.

See Installation Instructions **D015000**, signed and sealed by Hermes F. Norero, P.E. (FL # 73778) for specific use parameters.

Limits of Use:

1. This product has been evaluated and is in compliance with the current Florida Building Code, including the "High Velocity Hurricane Zone" (HVHZ).
2. Product anchors shall be as listed and spaced as shown on details. Anchor embedment into substrate material shall be beyond wall dressing or stucco.
3. When used in areas requiring wind borne debris protection this door product complies with Chapter 16 of the current Florida Building Code and does not require an impact resistant covering on outswing doors.
4. Non-Impact sidelites do require an impact resistant covering when used in areas requiring wind borne debris protection to comply with Chapter 16 of the current Florida Building Code.
5. Site conditions that deviate from the details of drawing **D015000** require further engineering analysis by a licensed engineer or registered architect.
6. See Installation Instructions **D015000** for size and design pressure limitations.

Certification Agency: The manufacturer has demonstrated compliance of products in accordance with the Florida Building Code for manufacturing under a quality assurance program audited by an approved quality assurance entity through **National Accreditation & Management Institute, Inc.** (FBC Organization # CER1773).

Performance Standards: The product described herein has been evaluated per:

- TAS 201-94
- TAS 202-94
- TAS 203-94

Referenced Data:

1. Product Testing performed by **Certified Testing Laboratory, Inc.** (FBC Organization # TST1577)
Report #: CTLA696W, Report Date: 11/01/2001
TAS Report Engineer of Record: Ramesh Patel, FL P.E. No. 20224
2. Certification Agency
National Accreditation & Management Institute, Inc.
(FBC Organization # CER1773)
3. Component Material Testing of Dylite Expandable Polystyrene by **Intertek Testing Services NA, Inc.**
ASTM E84
Report#: 3113726SAT-001 R1 Report Date: 03/13/2009

Installation:

Refer to Installation Instructions (**D015000**) for anchor spacing and more details of the installation requirements.

Design Pressure:

Refer to Installation Instructions (**D015000**) for design pressures based on size, configuration, and glass types.